

7500

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE STATE OF IDAHO,
IN AND FOR THE COUNTY OF TWIN FALLS

IN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM.

CIVIL CASE NUMBER: 39576

Ident. Number: A25-07407
Date Received: 7/14/1989
Receipt No: E009737/80
Received By: _____

NOTICE OF CLAIM TO A WATER RIGHT
ACQUIRED UNDER STATE LAW

1. Name: COUNTRY LIFE EST. WATER USERS ASSN. 208-523-4534
Address: C/O GENE A. SCOTT
10284 N. 25TH E.
IDAHO FALLS, ID 83401

2. Date of Priority: APR 02, 1986

3. Source: GROUNDWATER Trib. to:

4. Point of Diversion:

Township	Range	Section	1/4 of	1/4 of	1/4	Lot	County
03N	38E	15	NW	SW			BONNEVILLE

5. Description of diverting works:
WELLS(2) AND PUMPS(2) FOR DOMESTIC AND IRRIGATION USES.

6. Water is used for the following purposes:

Purpose	From	To	C.F.S	(or)	A.F.A.
IRRIGATION	04/01	11/01	0.120		
DOMESTIC	01/01	12/31	0.190		

7. Total Quantity Appropriated is:
0.310 C.F.S. (and/or) A.F.A.

8. Total consumptive use is 15.0 Acre Feet Per Annum.

9. Non-irrigation uses:
18 FAMILIES.

10. Place of Use:

Township	Range	Section	1/4 of	1/4	Lot	Use	Acres
03N	38E	15	NW	SW		IRR	6.0

A25-07407

Page 1

Date: 07/14/89



MICROFILMED

NOV 07 1992

10. Place of Use: Continued

Township	Range	Section	1/4 of 1/4	Lot	Use	Acres
03N	38E	15	NW SW		DOMEST	
Section Acres						6.0
Total Acres						6.0

11. Place of use in counties: BONNEVILLE

12. Do you own the property listed above as place of use? YES

13. Other Water Rights Used:
A25-07033, A25-07046

14. Remarks:
2 P/D IN NWSW, S15, T3N, R38E. P/D LEGAL ALSO KNOWN AS
LOT 1 & LOT 6W, BLK 2, COUNTRY LIFE ESTATES DIVISION NO. 1.

15. Basis of Claim: PERMIT

16. Signature(s)

(a.) By signing below, I/We acknowledge that I/We have received, read and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not X wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments: _____

For Organizations:

I do solemnly swear or affirm that I am VICE PRES. of
Title
COUNTRY LIFE EST. WATER, that I have signed the foregoing
Organization USERS ASSOC.
document in the space below as VICE PRES. of
Title

COUNTRY LIFE EST. WATER and that the statements contained in the
Organization USERS ASSOC.
foregoing document are true and correct.

Gene A. Sater
Signature of Authorized Agent

V.P. COUNTRY LIFE EST. WATER
Title and Organization USERS ASSOC.

7-14-89
Date

State of Idaho)
County of BONNEVILLE) SS.

Subscribed and sworn (or affirmed) before me this 14 day
of JULY 19 89


[Signature]
Notary Public

Seal

Residing at IDAHO FALLS

My Commission Expires 9-12-94

A25-07407

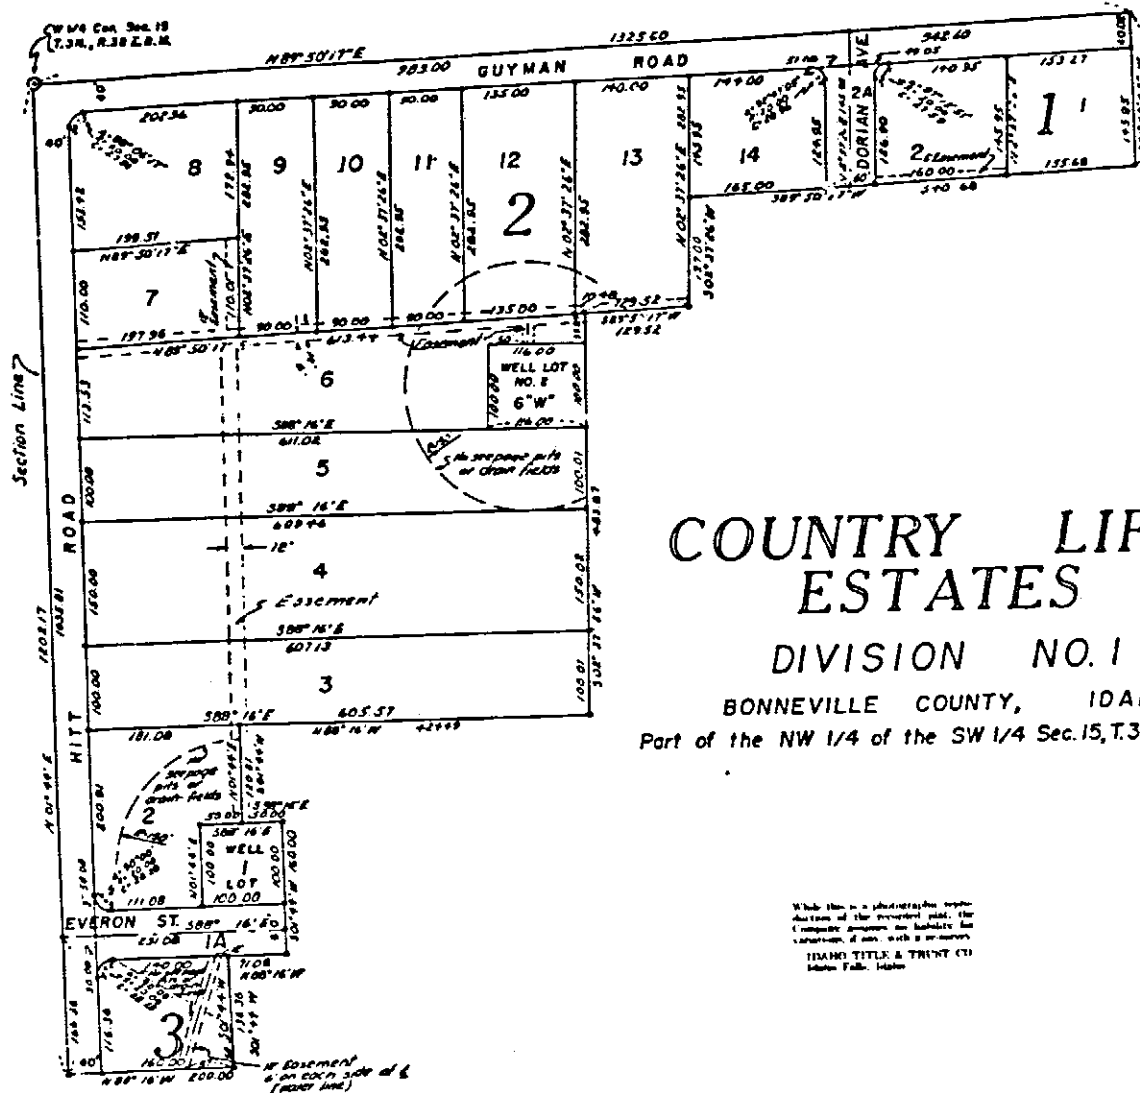

COUNTRY LIFE ESTATES

DIVISION NO. 1

BONNEVILLE COUNTY, IDAHO

Part of the NW 1/4 of the SW 1/4 Sec. 15, T.3N, R.38 E.B.M.

While this is a photographic reproduction of the accepted plat, the Computer assumes no liability for variations of any kind with a plat.

IDAHO TITLE & TRUST CO.
Boise, Idaho

NOV 6 7 1992



Log for claim 25-07407

Spatial Dynamics CAT

12/7/00

TR	SEC	QQ	Acres Claimed	Acres Found	COMMENT
03n38e	15	NWSW	6	40	POD placement? / Indiscernible
Totals:			6	40	

OWNER CODE	NAME & ADDRESS	PRIORITY DATE	WATER USE	USE PERIOD FROM TO	DIVERSION RATE	DIVERSION VOLUME
C	COUNTRY LIFE EST WATER USERS ASSN C/O GENE A SCOTT 10284 N 25TH E IDAHO FALLS ID 83401 (208) 523-4534	04/02/1986	IRRIGATION DOMESTIC	04-01 11-01 01-01 12-31	0.120 CFS 0.190 CFS	
TOTAL DIVERSION:					0.310 CFS	
CONSUMPTIVE USE:						15.00 AFA

Water Source: GROUNDWATER

Tributary to:

Stage: PERMIT

Point(s) of Diversion: T03N R38E S15 NWSW BONNEVILLE County

Place of use Legal Description for: IRRIGATION

NE				NW				SW				SE						
NENE	NWNE	SWNE	SENE	NENW	NWNW	SWNW	SENW	NESW	NWSW	SWSW	SESW	NESE	NWSE	SWSE	SESE			
T	R	S	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	SUM		
03N 38E 15 :															6.0			
															TOTAL ACRES	6.0		

Place of use Legal Description for: DOMESTIC

NE				NW				SW				SE						
NENE	NWNE	SWNE	SENE	NENW	NWNW	SWNW	SENW	NESW	NWSW	SWSW	SESW	NESE	NWSE	SWSE	SESE			
T	R	S	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac	: Lt Ac Lt Ac Lt Ac Lt Ac			
03N 38E 15 :															D			

POU County: BONNEVILLE

Non-Irrigation Uses: 18 FAMILIES.

Other Rights: A25-07033, A25-07046

Other Water Rights with Same Point(s) of Diversion with Stage (Includes All Sources):
A25-07033 A25-07046

Other Water Rights Listing Overlapping Place(s) of Use:

A01-00069 A01-00070 A01-00109B A01-00110B A01-00111B A01-00112B A01-00113B A01-00115B A01-00262 A01-00309
A01-10156 A01-10157 A01-10158 A01-10159 A01-10160

Conditions of Approval:

- 041 - Irrigation use under this right is authorized only in connection with a domestic use.

Remarks: GEN 2 P/D IN NWSW, S15, T3N, R38E. P/D LEGAL ALSO KNOWN AS LOT 1 & LOT 6W, BLK 2, COUNTRY LIFE ESTATES DIVISION NO. 1.

Dates: Exam Made Date: Verified Date: 07/15/1986 Objection Filed Date:

Misc: Water District Number: Field Inspection Flag:
Presumption Flag:

AJ5809NP
No. A25-07407

IDAHO DEPARTMENT OF WATER RESOURCES
ADJUDICATION CLAIM PROFILE REPORT

DATE: 10/24/00
PAGE: 159

=====

Audit: 07/14/89 MEYER 03/29/95 POST-STD

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. **15-07407**

Priority: April 2, 1986

Maximum Diversion Rate: 0.19 CFS
Maximum Diversion Volume:¹ 21.6 AF

This is to certify, that COUNTRY LIFE ESTATES WATER USERS ASSN.

C/O BILL FLAGLER
2600 EVERON ST.

IDAHO FALLS, ID 834010000

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated April 2, 1986; and has submitted Proof of Beneficial Use on September 23, 1988. An examination indicates that the works have a diversion capacity of 1.290 cfs of water from a **GROUNDWATER** source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.19 CFS	21.6 AF

LOCATION OF POINT(S) OF DIVERSION:

NWSW , Sec. 15, Township 03N, Range 38E
BONNEVILLE County

PLACE OF USE: DOMESTIC

TWN RGE SEC

03N 38E 15 NWSW

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. 2 points of diversion located in NWSW, S15, T3N, R38E
6. Domestic use is for 18 homes.

MICROFILMED

OCT 16 1990


State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 25-07407

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 16th
day of OCTOBER, 1990.

Acting for

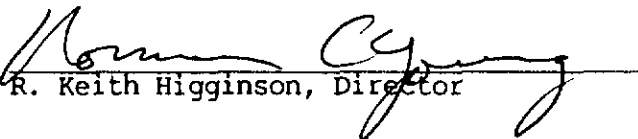
R. Keith Higginson, Director

MICROFILMED

OCT 16 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

APPROVED

Department of Water Resources
Eastern District Office

To appropriate the public waters of the State of Idaho

1. Name of applicant Country Life Estates Water Users Assn. Phone 523-7076
c/o Bill Flagler
Post office address 2600 Everon St., Idaho Falls, Idaho 83401

2. Source of water supply Groundwater which is a tributary of _____

3. Location of point of diversion is NW $\frac{1}{4}$ of SW $\frac{1}{4}$ of Section 15 Township 3N

Range 38E B.M. Bonneville County, additional points of diversion if any: _____

Two p/d located in lot 1 & lot 6W Block 2 Country Life Estates Division No. 1

4. Water will be used for the following purposes:

Amount 0.19cfs for Domestic purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount 0.12cfs for Irrigation purposes from 4/1 to 11/1 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a. 0.31 cubic feet per second and/or b. _____ acre-feet per annum.

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. Two wells & pumps to a common
system serving 48 lots within Country Life Estates.

b. Height of storage dam _____ feet, active reservoir capacity _____ acre-feet; total reservoir
capacity _____ acre-feet, materials used in storage dam: _____

Period of year when water will be diverted to storage _____ to _____ inclusive.
(Month/Day) (Month/Day)

c. Proposed well diameter is 8 inches; proposed depth of well is 210 feet.

7. Time required for the completion of the works and application of the water to the proposed beneficial
use is 1 years (minimum 1 year - maximum 5 years).

8. Description of proposed uses:

a. If water is not for irrigation:

(1) Give the place of use of water: NW $\frac{1}{4}$ of SW $\frac{1}{4}$ of Section 15 Township 3N

Range 38E B.M.

(2) Amount of power to be generated: _____ horsepower under _____ feet of head.

(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served _____, or number of families to be
supplied with domestic water 18.

(5) If water is to be used for other purposes describe: _____

MICROFILMED

APPENDIX A

Total number of acres to be irrigated 6


b. Who owns the land to be irrigated or place of use	Homeowners
--	------------

Downloaded from <http://www.jstor.org/stable/2346122> on Tue, 20 Jun 2016 12:02:05 UTC
All use subject to [JSTOR Terms and Conditions](#)

[illegible]

11. Map of proposed project show clearly the proposed point of diversion, place of use, section number, township and range number.

SEE ATTACHED PLAT MAPS.

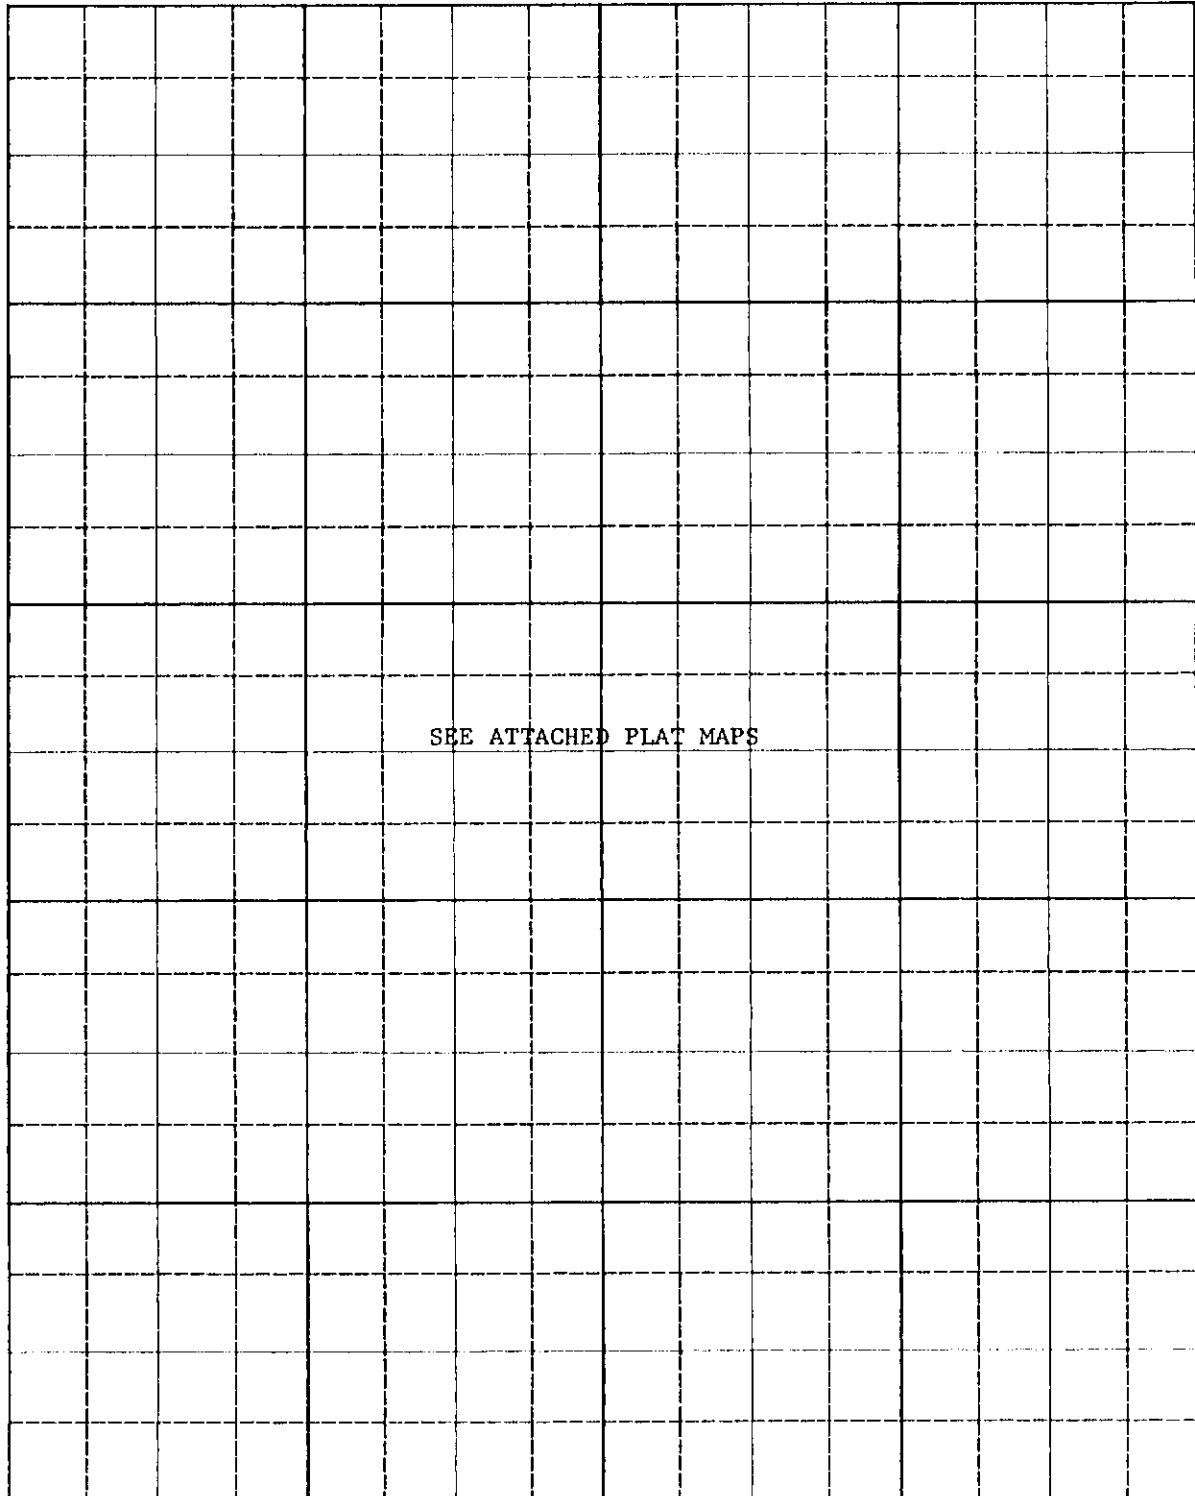

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Bill Flagler (President)
(Applicant)

MICROFILMED

Proposed Priority 4/2/86

Assisted By KCW 27 MAR 1986

MICROFILMED

Received by MID Date 4/2/86 Time 10:30

Preliminary check by HWJ Fee \$ 45.00 # 35584

Received by MID Date 4/2/86

Publication prepared by MID Date 4/9

Published in Post Register

Publication dates 4/17 + 4/24/86

Publication approved CW Date 5-17-86

Protests filed by: none

Copies of protests forwarded by _____

Hearing held by _____ Date _____

Recommended for approval denial by RK KW


ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES


This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 25-7407, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:
 - a. SUBJECT TO ALL PRIOR WATER RIGHTS.
 - b. Proof of construction of works and application of water to beneficial use shall be submitted on or before July 1, 19 87.
 - c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
 - d. Other: Irrigation use under this permit is authorized only in connection with a domestic use.

Witness my hand this 16th day of June, 1986.

J. Glen Saylor
Chief, Operations Bureau

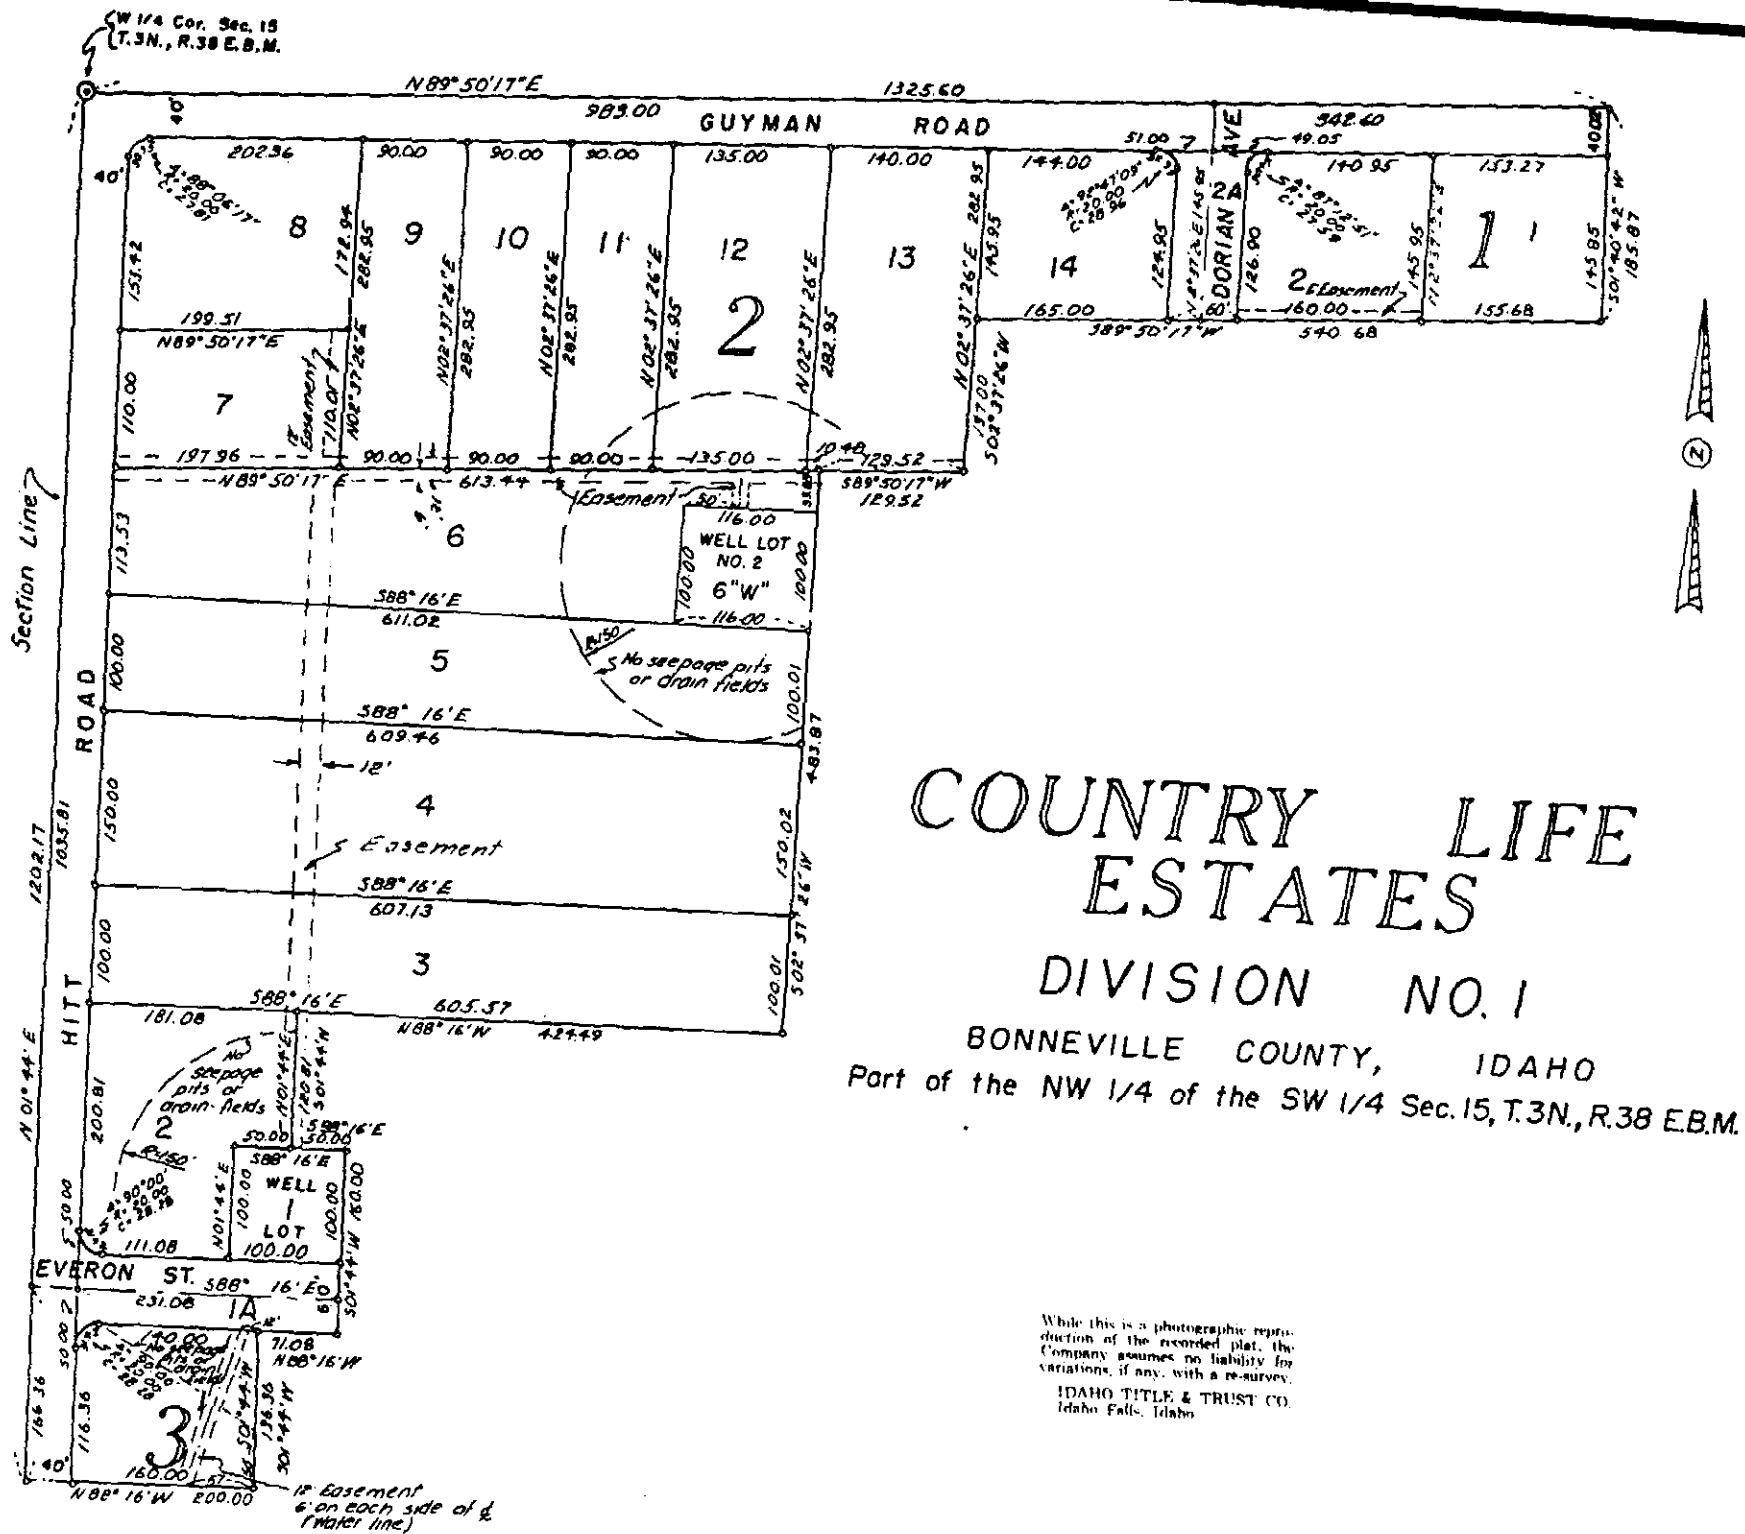



COUNTRY LIFE ESTATES


DIVISION NO. 2

BONNEVILLE COUNTY, IDAHO

Part of the NW 1/4 of the SW 1/4 Sec. 15, T.3N., R.38 E.B.M.

DAVID E. BENTON & ASSOCIATES — CONSULTING ENGINEERS
IDAHO FALLS, IDAHO

Note: An easement, 10 feet in width, adjacent to all streets is reserved for power, telephone, and television cable.

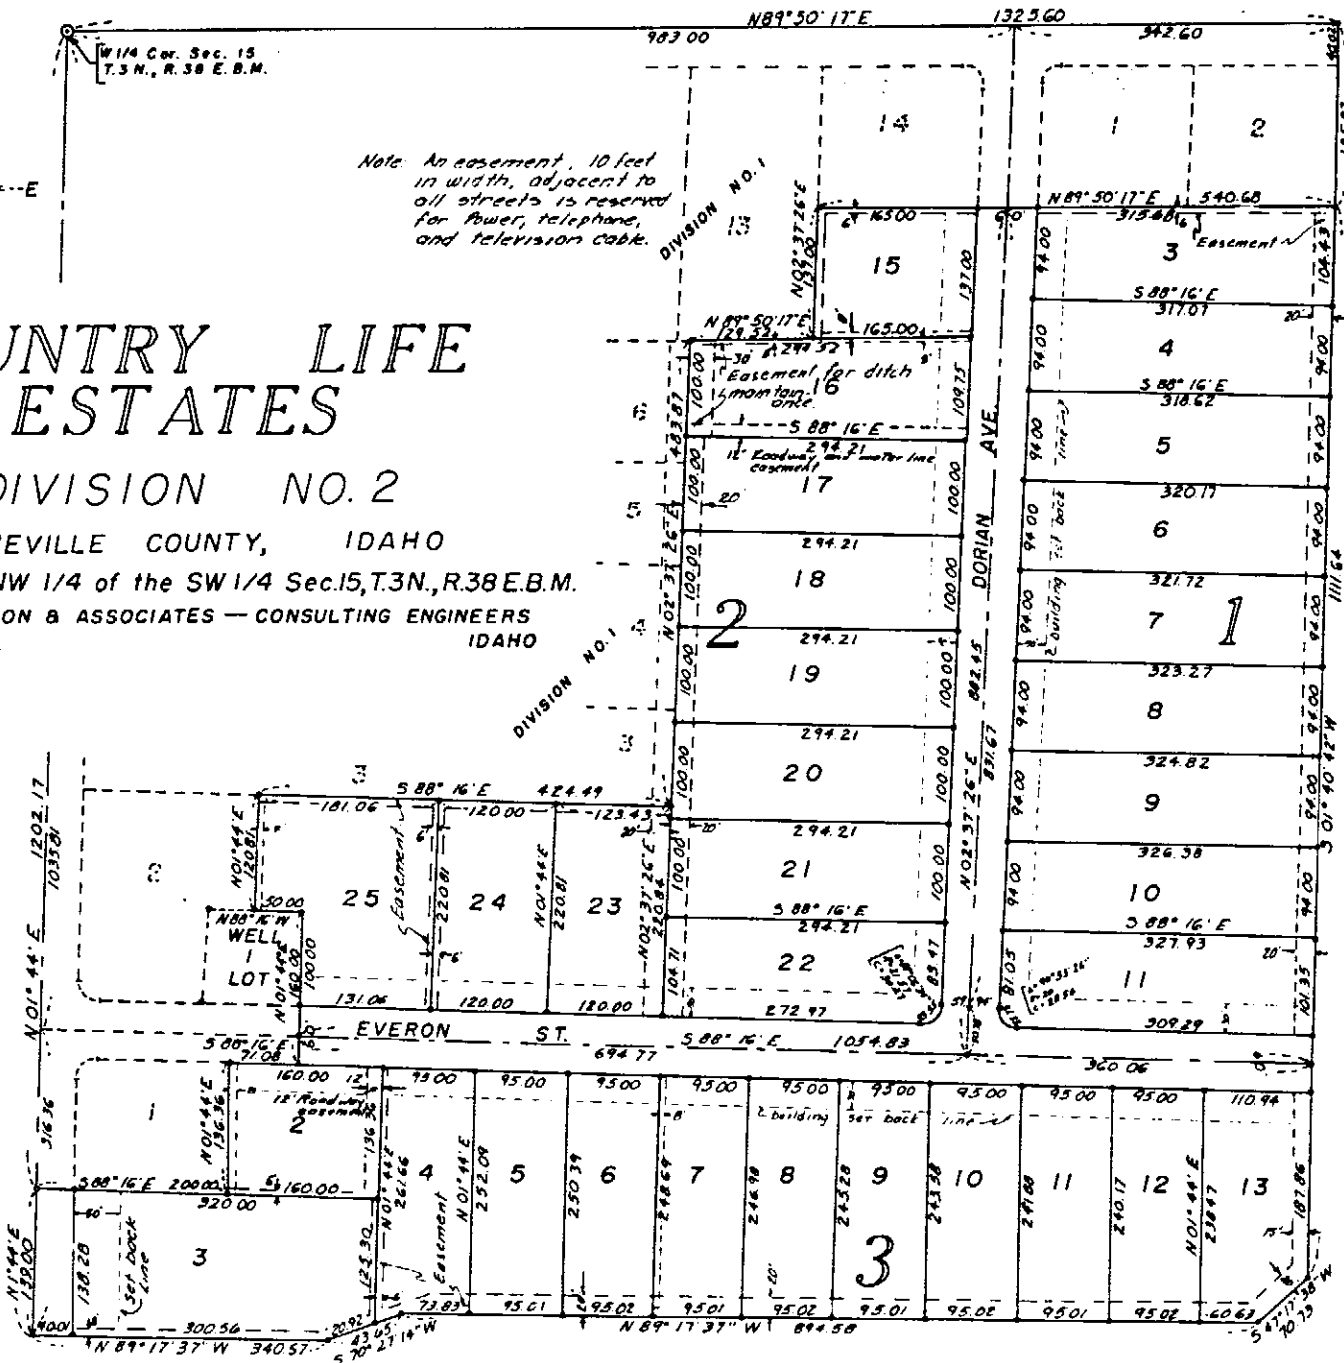

While this is a photographic reproduction of the recorded plat, the Company assumes no liability for variations, if any, with a re-survey.
IDAHO TITLE & TRUST CO.
Idaho Falls, Idaho

MICROFILMED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JUN 13 1990

A. GENERAL INFORMATION

Permit No. Department of Water Resources
1. Owner: Country Life Estates Water Users Assn. Phone No. 523-7076/526-7413
Current Address: c/o Bill Flagler
2600 Everon St. Idaho Falls, Id. 83401
2. Accompanied by: Trent Parker EXAM. DATE: 6-16-89
Address: 10315 Dorian Idaho Falls, Id 83401 Phone No.
Relationship to Permit Holder: Partner
3. Source: Groundwater tributary to

B. OVERLAP REVIEW

1. Other water rights with same place of use: surface water
canal Corp 01-0262 25-7033, 25-7046 (owned by Staker)
(No overlaps)
2. Other water rights with same point of diversion: 25-7033, 7046 (No overlaps)
(owned by Staker)
☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

see attached Diagrams

MICROFILMED

OCT 16 1990

Scale: 1" =

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required). ☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).
☒ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater).

System Description (continued)

3. Narrative: Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

(20hp) Well + pump #1 to 23,000 gal. storage tank, to pressure system with 2 Booster pumps, to 48 domestic homes with less than 1/2 acre irrigation. Second (30hp) well + pump are for back up purposes only

☐ See Remarks on page 4 for continuation

4.

	Well or Diversion Identification No.*	Motor Make	Hp	Motor model Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Pumps	#1	N/A	30	N/A	N/A	N/A
	#2	N/A	20	N/A	N/A	N/A
Boosters	A	GE	5	UVK 182TDR7102DNL	Aurora	88-3921
	B	GE	7.5	TWN 184TDR7325CNL	Aurora	88-3922
	C	GE	10	Booster 112P269R060F	Aurora	88-3923

*Code to correspond with No. on map and aerial photo

5. Point(s) of Diversion:

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
#1			NW	SW	15	3N	38E	Bonneville	Maps/on site inspection
#2			NW	SW	15	3N	38E	Bonneville	Maps/on site inspection

6. Place(s) of Use:

Indicate Method of Determination _____

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
3N	38E	15										D							

MICROFILMED

0011-1011

Do not use this space

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Theoretical						

2. Measurements:

Theoretical Calculations

Static water level from well logs = 130' (well #1 30' to 40') and 110' (well #2 20' to 30').
66 psi at time of exam

E. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

1. Measured Method:

2. Alternate Method for Checking Purposes:

(see attached sheet) #2

$$Q_{20} = 0.54 \text{ cfs}, Q_{30} = 0.75 \text{ cfs} \therefore Q = Q_{20} + Q_{30} = 1.29 \text{ cfs}$$

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3); Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

$$V_{Dom} = (1.2) (18) = 21.6 \text{ af}$$

MICROFILMED

OCT 16 1990

H. REMARKS AND OVERLAP REVIEW ANALYSIS

limit to amount for 18 homes and 21.6 afa
 (because from tables for 18 houses $\Rightarrow$ 0.19 cfs)
 Recommend license for 18 homes = 0.19 cfs

Each lot irrigates $\frac{1}{2}$ acre or less
 Overlap 25-7033 Domestic (5 units) 0.70
 25-7040 Domestic (25 units) 0.73 cfs
 Theoretical cap = 1.29 cfs, 0.70 + 0.73 = 1.43 cfs
 1.12 < 1.29 cfs
 Using total Q applied for of 0.31 for 25-7040 The total = 1.24 < 1.29 cfs
 Recommend no conditions

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic	1-1	12-31	0.19	21.6
Totals:			0.19 cfs	21.6 afa

2. Recommended Amendments

- ☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

J. AUTHENTICATION

Field Examiner's Name Larry L. Waters
 Signature Larry L. Waters
 Certification Date _____
 Field Report Preparation Date 8-3-89

CONSULTANT SEAL

K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

MICROFILMED

OCT 16 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
LICENSING REPORT

25-7407

PERMIT NO.

Item H

18 Houses served

Houses served

Rate of flow (cfs)

15

0.18

18

x

20

0.2

$$X = \left(\frac{0.20 - 0.18}{5} \right) (3) + 0.18$$

$$X = \underline{\underline{0.19 \text{ cfs}}}$$

MICROFILMED

OCT 16 1990

Larry P. Martin

SIGNATURE

Page 1 of Page 2

STATE OF IDAHO
DEPT. OF WATER RESOURCES
LICENSING REPORT

25-7407
PERMIT NO.

Item E₂

$$Q_{20} = \frac{hp (8.814) (eff)}{1.11 + (65 \times 2.28)} = \frac{20 (8.814) (.8)}{110 + (65 \times 2.28)} = 0.54 \text{ cfs}$$

$$Q_{30} = \frac{30 (8.814) (.8)}{130 + (65 \times 2.28)} = 0.75 \text{ cfs}$$


$$Q = Q_{20} + Q_{30} = 1.29 \text{ cfs}$$


MICROFILMED

OCT 16 1990

Larry J. Martin
SIGNATURE

Page 2 of Page 2

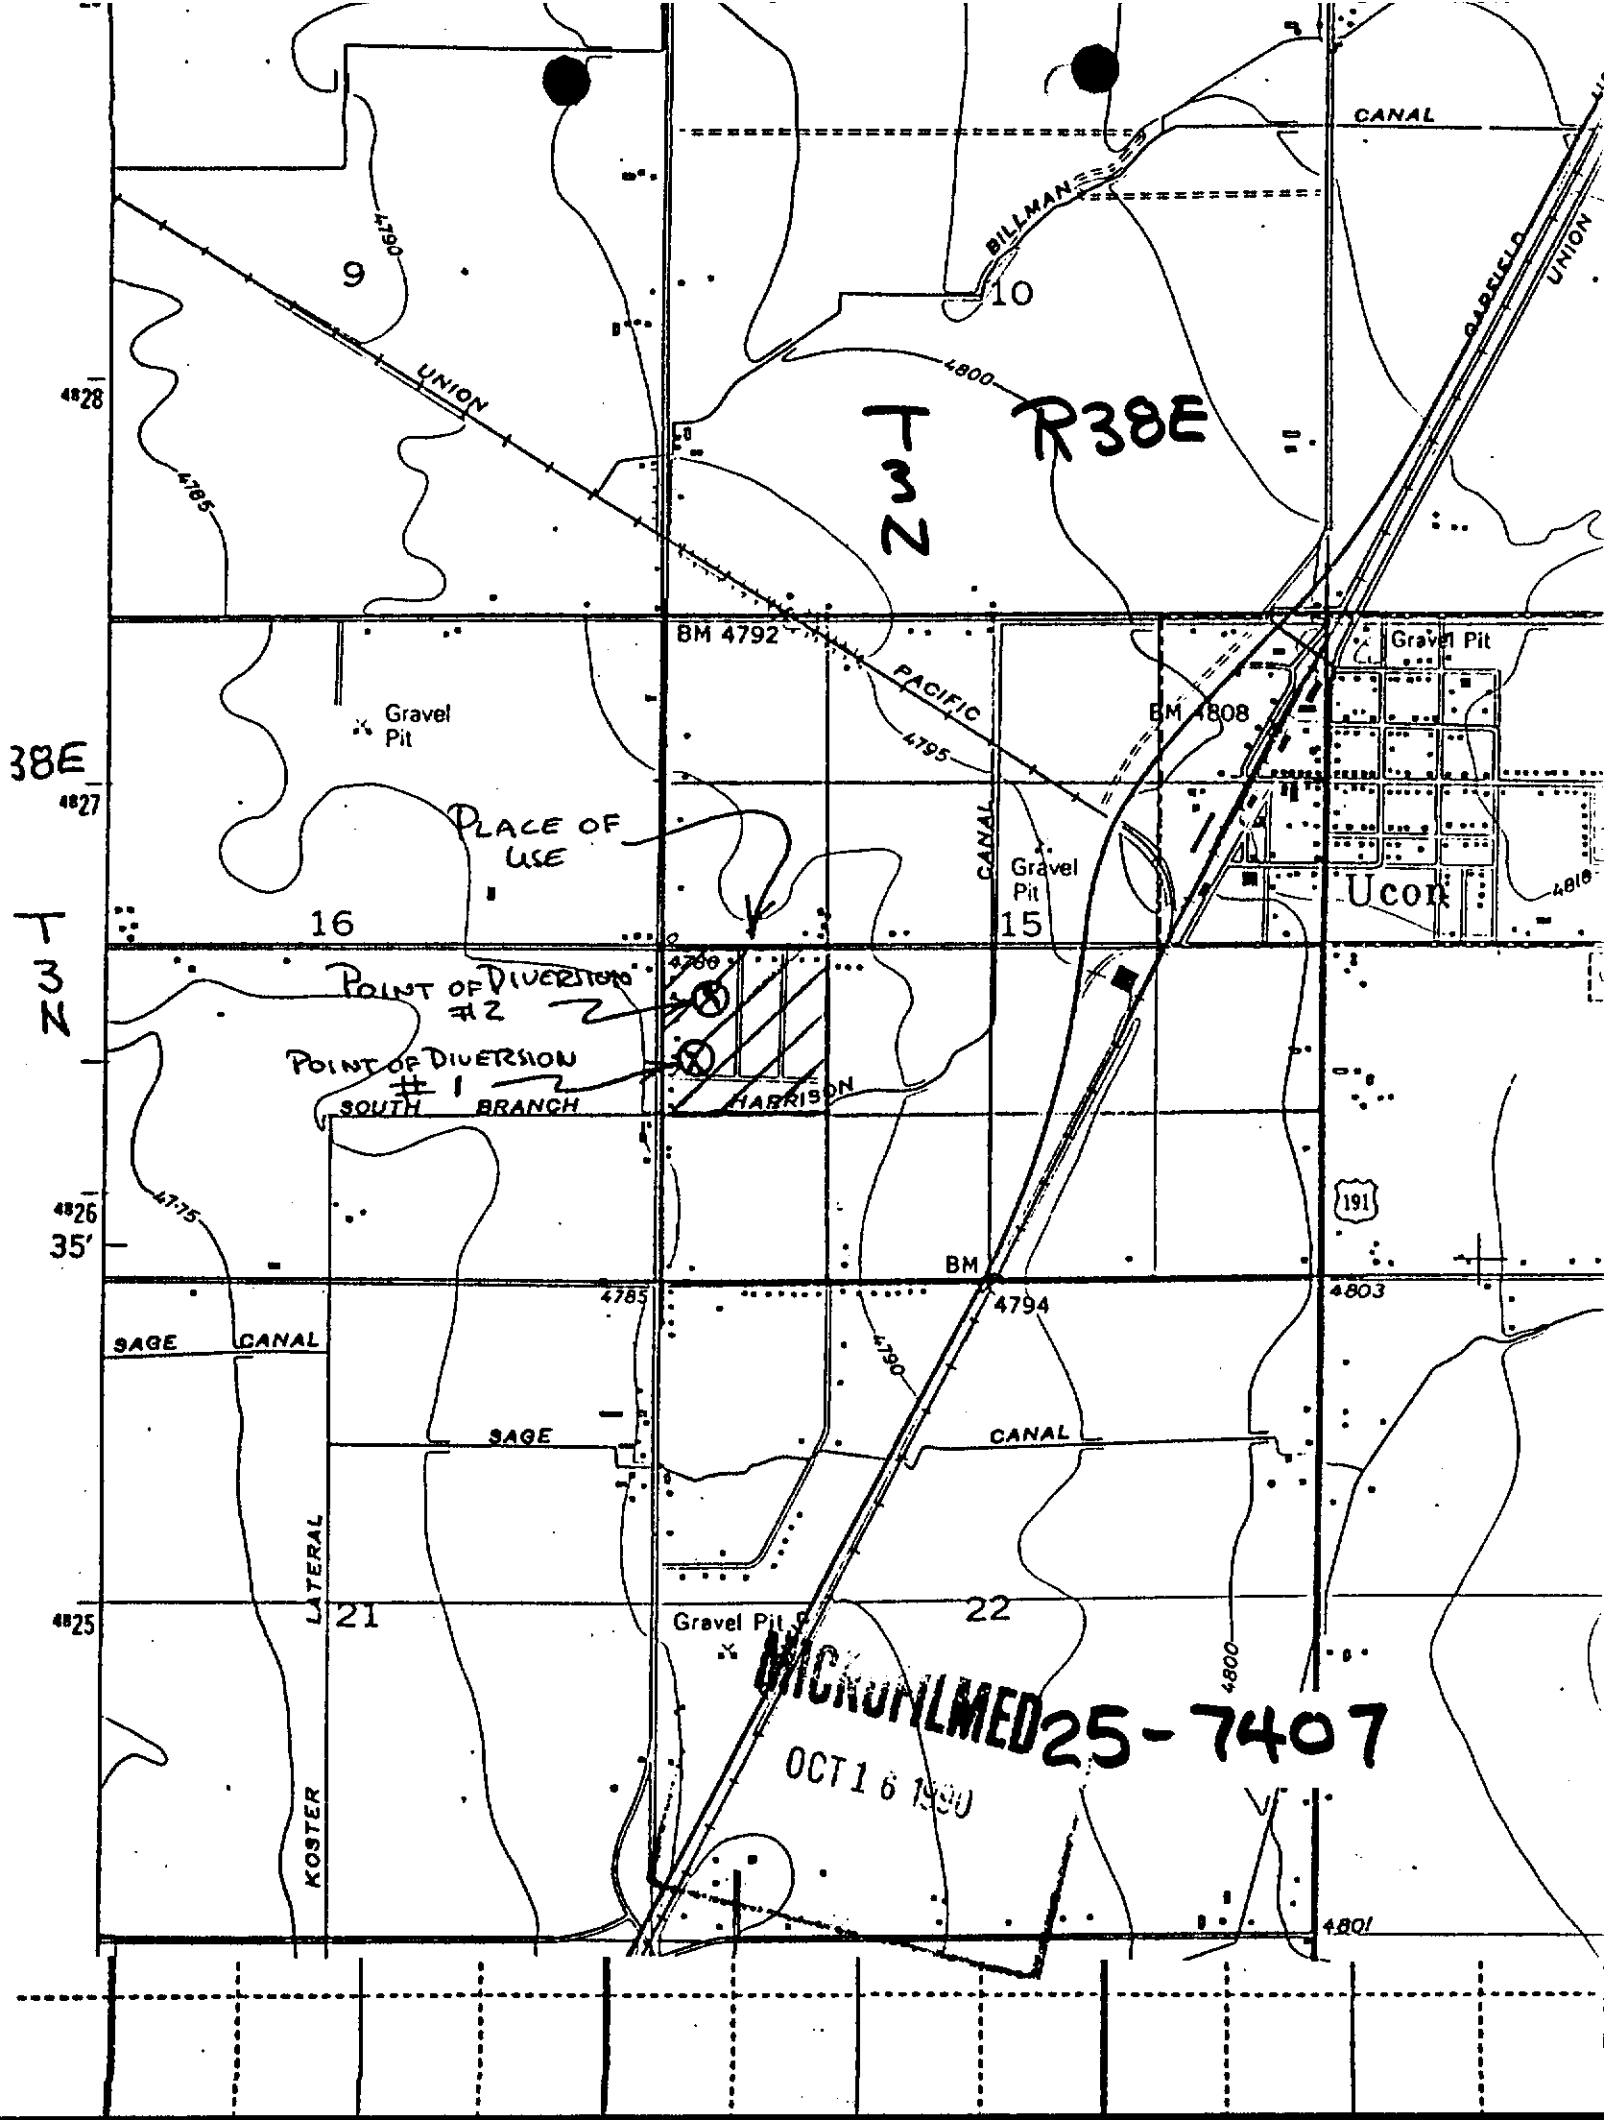



COUNTRY LIFE ESTATES


DIVISION NO. 2

BONNEVILLE COUNTY, IDAHO

Part of the NW 1/4 of the SW 1/4 Sec. 15, T.3N., R.38E.B.M.

DAVID E. BENTON & ASSOCIATES — CONSULTING ENGINEERS
IDAHO FALLS, IDAHO

Note: An easement, 10 feet in width, adjacent to oil streets is reserved for power, telephone, and television cables.

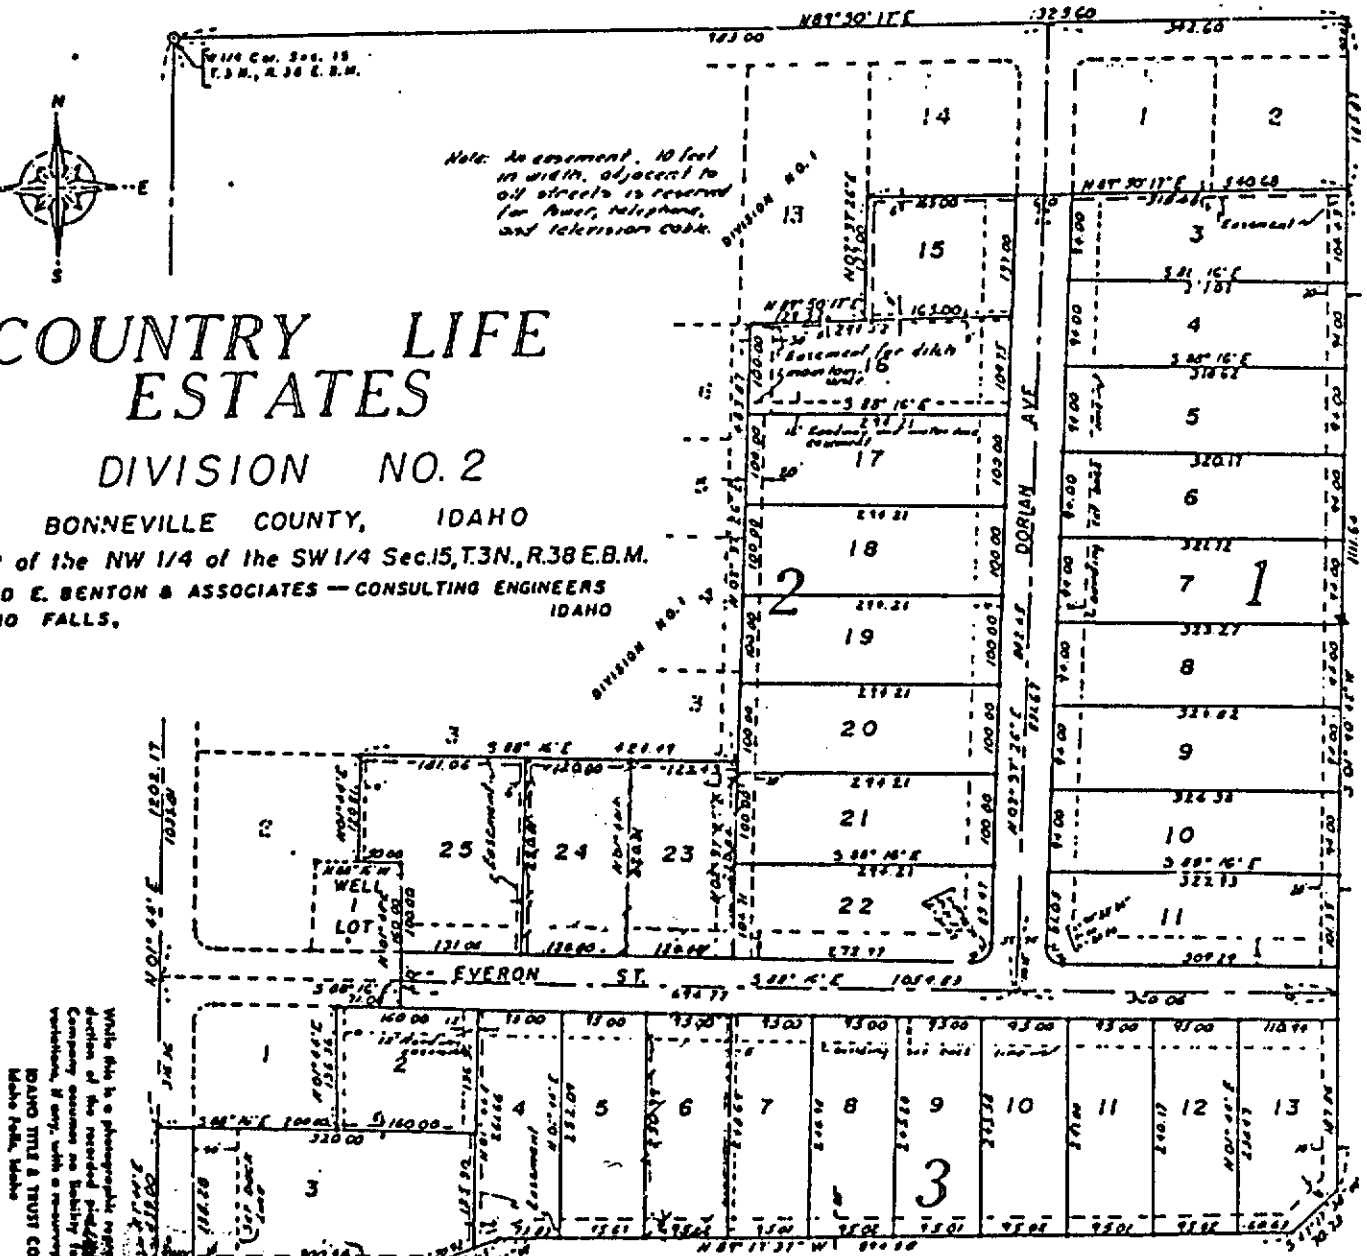


While this is a photographic reproduction of the original plat, the accuracy of the dimensions of the recorded plat, and the accuracy of the original plat, is not guaranteed. It may, with a reasonable degree of care, be used for reference only.

DAVID E. BENTON & ASSOCIATES
IDAHO FALLS, IDAHO

OCT 16 1990

PLACE OF USE

25-7407

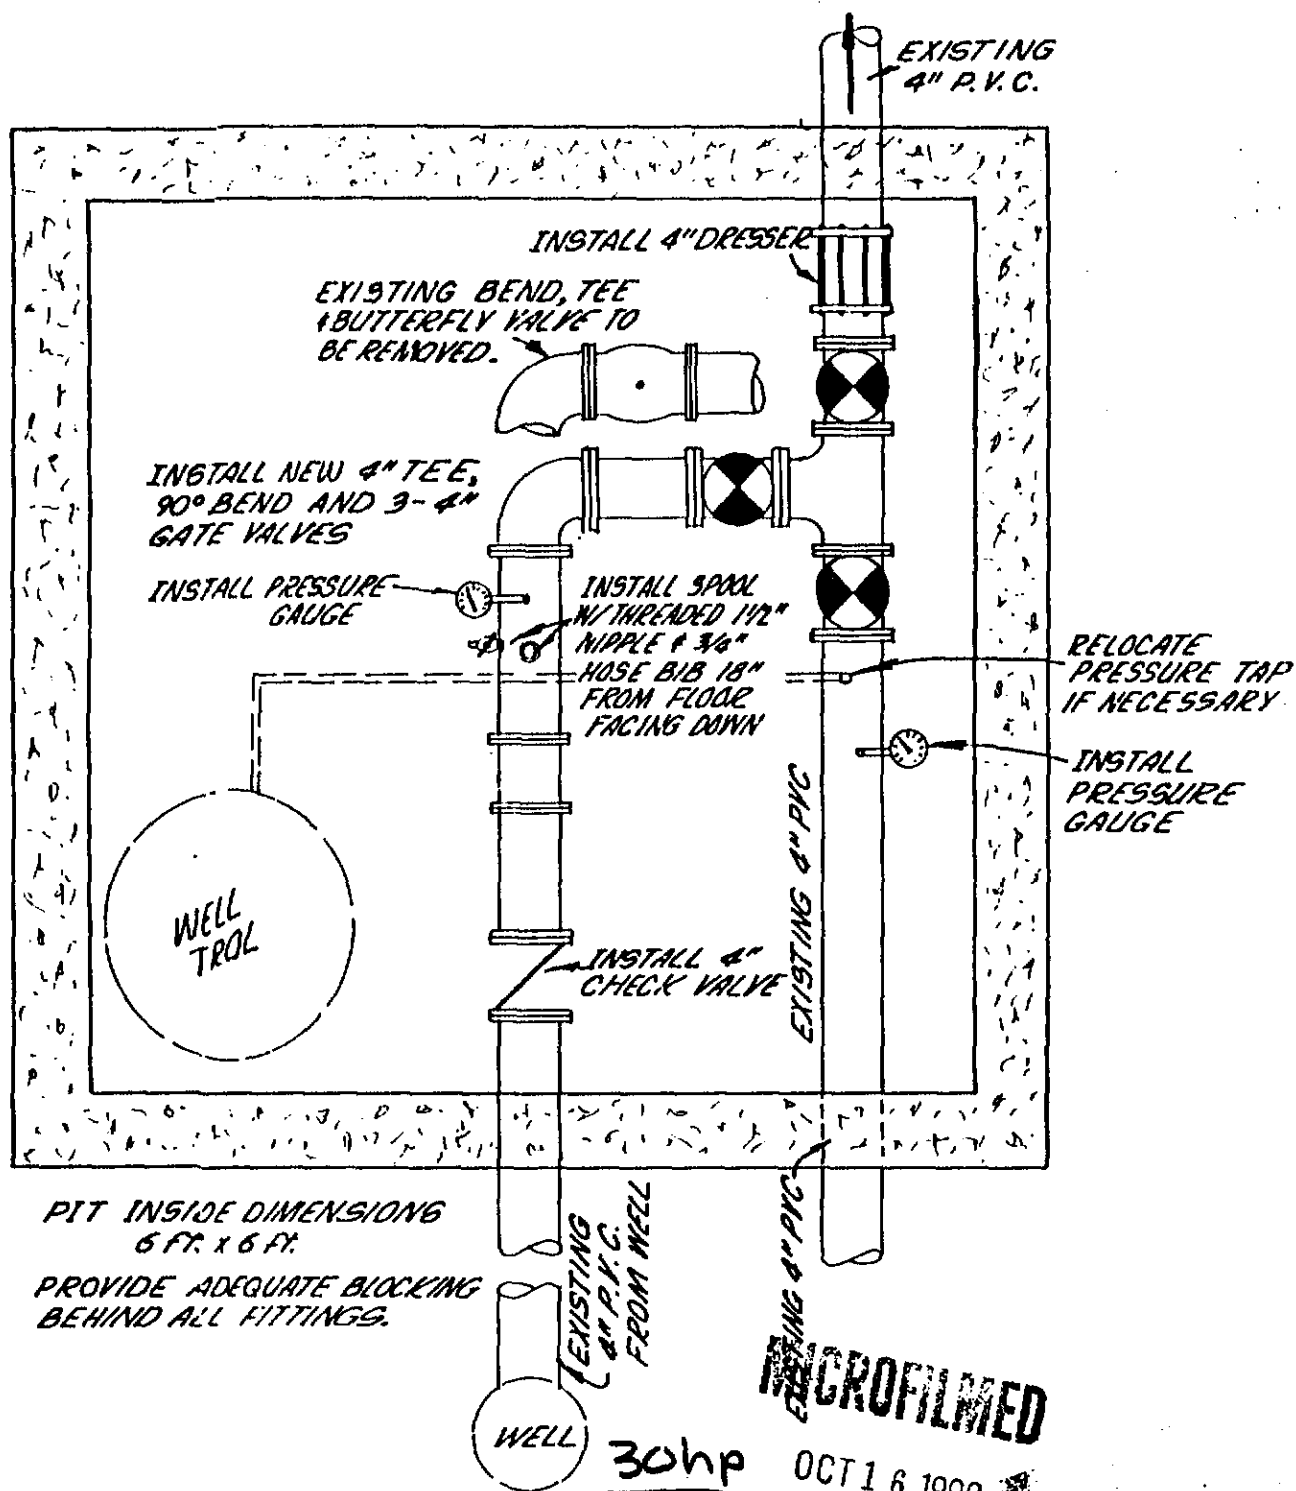

PIT INSIDE DIMENSIONS
6 FT. X 6 FT.

PROVIDE ADEQUATE BLOCKING
BEHIND ALL FITTINGS.

EXISTING
4\"/>

30hp


MICROFILMED

OCT 16 1990

WELL No. 1
PIPING IMPROVEMENTS

1" = 1'

25-7407

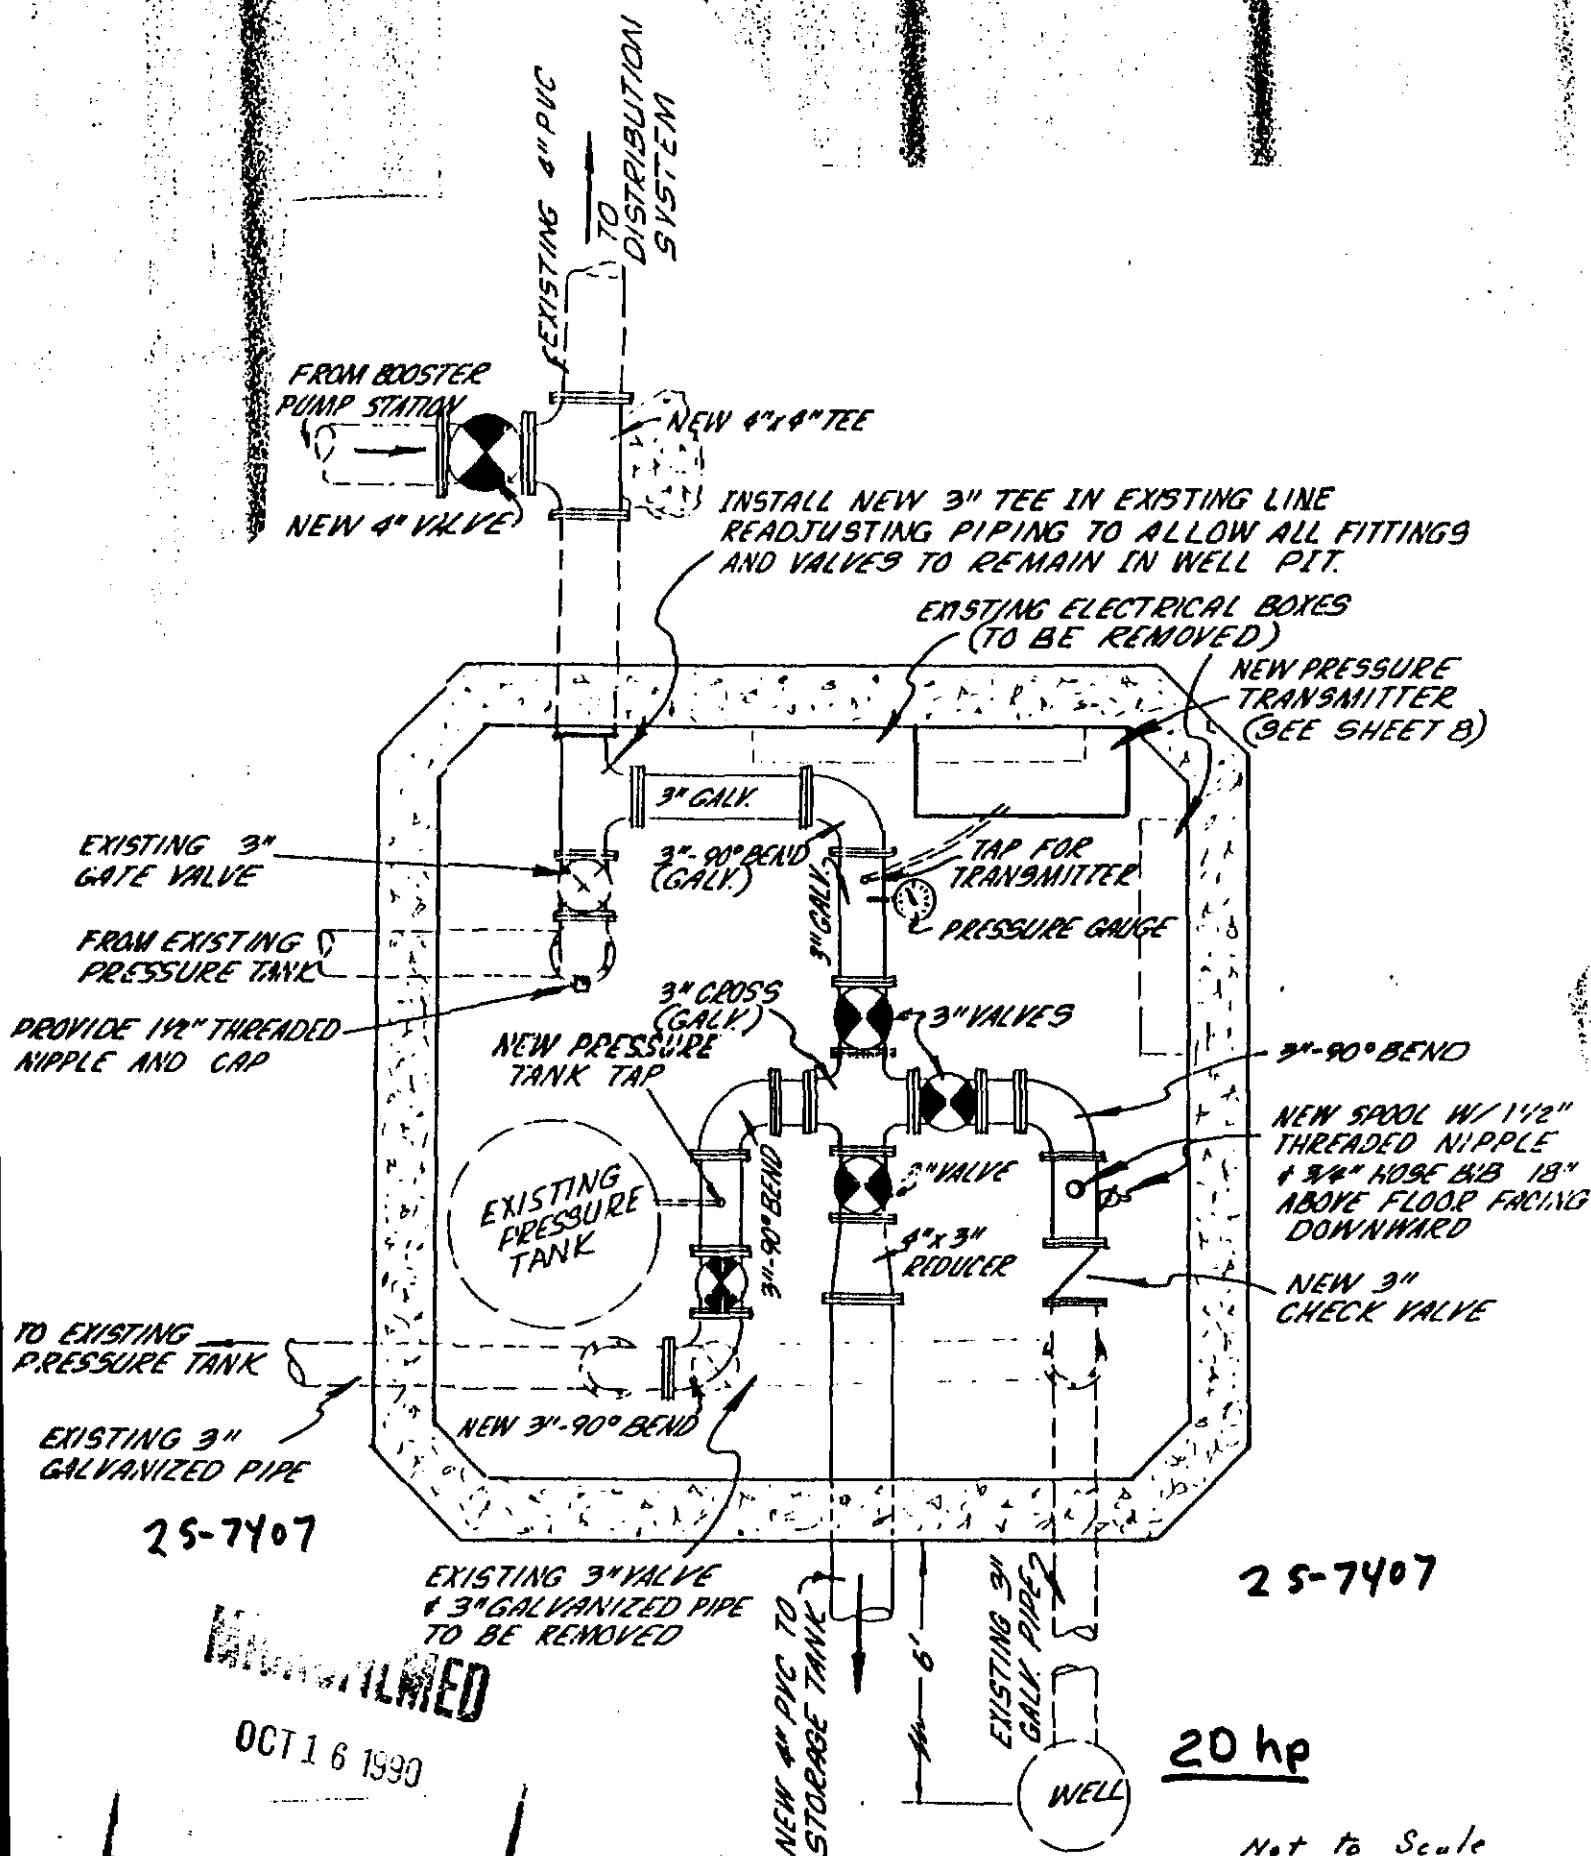

NOT FILMED

OCT 16 1990

WELL NO. 2 PIPING IMPROVEMENTS

Not to Scale

- SCHEMATIC



OCT 16 1990

25-7407

OCT 16 1990

UNPROCESSED

EXISTING PRESSURE TANK

WELL PIT EXISTING

PRESSURE CONTROLS
SEE DETAIL ON SHEET 3

WELL PUMP 20 HP

WELL #2

1" CI-TSP #1/2" CONTROL 24" BELOW GRADE

1" CS #6 CU + 1" #6 CU GND
WELL POWER 24" BELOW GRADE

PUMPHOUSE

WATER
TANK

BY UTILITY

ELECTRICAL CONTROL PANELS

WELL CONTROLS

1" CU W 5 CONTROL CABLES

