

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE STATE OF IDAHO,
IN AND FOR THE COUNTY OF TWIN FALLS

IN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM.

CIVIL CASE NUMBER: 39576

Ident. Number: A29-11371
Date Received: 8/12/1993
Receipt No: E013232
Received By: _____

NOTICE OF CLAIM TO A WATER RIGHT
ACQUIRED UNDER STATE LAW

1. Name: CONNIE M ROWLAND 208-237-6244
Address: 1254 W SYPHON RD
POCATELLO ID 83202

2. Date of Priority: MAY 1, 1963

3. Source: SPRINGS Trib. to: PORTNEUF RIVER

4. Point of Diversion:

Township	Range	Section	1/4 of	1/4 of	1/4 of	Lot	County
06S	33E	1	NE	NE	NW	3	POWER

5. Description of diverting works:
SPRING FORMS POND DAMMED BY HEADGATE WHICH FLOWS INTO PORTNEUF

6. Water is used for the following purposes:

Purpose	From	To	C.F.S	(or)	A.F.A.
IRRIGATION	04/01	11/01	0.260		
STOCKWATER	01/01	12/31	0.020		

7. Total Quantity Appropriated is:
0.280 C.F.S. (and/or) A.F.A.

8. Total consumptive use is 39.0 Acre Feet Per Annum.

9. Non-irrigation uses:
STOCKWATER, NONE AT PRESENT

10. Place of Use:

Township	Range	Section	1/4 of	1/4 of	Lot	Use	Acres
06S	33E	1	NW	NE		IRR	13.0
			NW	NE		STOCK	

MICROFILMED

10. Place of Use: Continued

Township	Range	Section	1/4 of 1/4	Lot	Use	Acres
					Section Acres	13.0
					Total Acres	13.0

11. Place of use in counties: POWER

12. Do you own the property listed above as place of use? YES

13. Other Water Rights Used:
GROUNDWATER (IRRIGATION & DOMESTIC)

14. Remarks:

15. Basis of Claim: BENEFICIAL USE

16. Signature(s)

(a.) By signing below, I/We acknowledge that I/We have received, read and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not _____ wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments: _____

For Individuals:

I/We do solemnly swear or affirm that the statements contained in the foregoing document are true and correct.

Signature of Claimant(s): _____ Date: _____
_____ Date: _____

MICROFILMED
APR 14 1994

State of Idaho)
) SS.
County of _____)

Subscribed and sworn (or affirmed) before me this _____ day
of _____ 19 _____

Notary Public

Seal

Residing at _____

My Commission Expires _____

MICROFILMED

APR 14 1994

BY May 3, 1990IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE
STATE OF IDAHO, IN AND FOR THE COUNTY OF TWIN FALLSIN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM

CIVIL CASE NUMBER: 39576

Ident. Number A29-11371Date Received 4-17-90Receipt Number E013232OK #1780 63.00

RECEIVED

APR 17 1990

Department of Water Resources
Eastern District OfficeNOTICE OF CLAIM
TO A
WATER RIGHT
ACQUIRED UNDER STATE LAW

RECEIVED

APR - 2 1990

Department of Water Resources
Eastern District Office

Please type or print clearly

1. Name of Claimant (s) Connie M. Rowland Phone (208) 237-6244Mailing Address 1254 W. Syphen Rd, Pocatello, ID Zip 832022. Date of Priority (Only one (1) per claim) May 1, 19633. Source of water supply (a) Springs
which is tributary to (b) Portneuf River4. a. Location of existing point of diversion is: Township 6S Range 33E Section 1,
NE 1/4 of NE 1/4 of NW 1/4, Govt. Lot, 3 B.M., County of Power

Additional points of diversion if any: _____

b. If instream flow, beginning point of claimed instream flow is:

Township 6S Range 33E Section 1, NE 1/4 of NE 1/4 of NWGovt. Lot 3 B.M., County of Powerending point is: Township 6S Range 33E Section 1, NE 1/4 of NE 1/4 ofNW 1/4, Govt. Lot 3 B.M., County of Power5. Description of existing diversion works (Dams, Reservoirs, Ditches, Wells, Pumps, Pipelines, Headgates, Etc),
including the dates of any changes or enlargements in use, the dimensions of the diversion works as
constructed and as enlarged and the depth of each well. Spring forms a pond. (dammed by
boarded headgate) which overflows into Portneuf River.
Irrigation pump - 7.5 hp (suction tube 2 1/4") plus mainline
and laterals. Approx. 150 gals. min.

MICROFILMED

APR 14 1994

A2911371



6. Water is claimed for the following purposes:

(both dates are inclusive)

(cfs)

(acre feet)

For Irrigation purposes from 4/1 to 11/1 amount .26 or _____

For Stock water purposes from 1/1 to 12/31 amount .02 or _____

For _____ purposes from _____ to _____ amount _____ or _____

For _____ purposes from _____ to _____ amount _____ or _____

7. Total quantity claimed (a) .28 (cfs) and/or (b) _____ (acre feet)

8. Total consumptive use claimed is 39 acre feet per annum.

9. Non-irrigation uses; describe fully (eg. Domestic: Give number of households served; Stockwater: Type and number of livestock Etc.) Currently no stock (previously cattle, horses, sheep)


10. Description of place of use:

a. If water is for Irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol in the corresponding place of use below. See inst

TWP	RNG	SEC	NE 1/4				NW	
			NE1/4	NW1/4	SW1/4	SE1/4	NE1/4	NW1/4
<u>6S</u>	<u>33E</u>	<u>1</u>		<u>13</u>			<u>13</u>	
				<u>S</u>			<u>S</u>	

Original letter dated 4/3/90
PLEASE HASSLE ME
 I made a correction where you circled, but am not entirely convinced you're right. Don't NE 1/4 of NW 1/4 (as per legal description) be long, when I originally placed it? Spence, Chowland
 from I thrive on stress.



Total number of acres irrigated 13

11. In which county (ies) are lands listed above as place of use located? Power

12. Do you own the property listed above as place of use? Yes X No _____

If your answer is No, describe in Remarks below the authority you have to claim this water right.

13. Describe any other water rights used at the same place and for the same purposes as described above.

Groundwater (irrigation + domestic) or None ()

14. Remarks:

MICROFILMED

APR 14 1994

Last Name Rowland Ident No. _____

Copies: White -State, Yellow-Claimant

Scale: 2 inches equals 1 mile

See attached aerial photo & legal description

[illegible]

APR 14 1994

Last Name Rowland

Ident No.

Copies: White-State, Yellow-Claimant

15. Basis of Claim (check one) Beneficial Use ☒ Posted Notice _____ License _____ Permit _____

Decree _____

If applicable provide IDWR Water Right Number _____

Court _____ Case Number _____ Decree Date _____

Plaintiff vs Defendant _____

16. Signature (s)

(a.) By signing below, I/We acknowledge that I/We have received, read, and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not ☒ wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments 2

For Individuals: I do solemnly swear or affirm that the statements contained in the foregoing document are true and correct.

Signature of Claimant (s) Connie Rowland Date 3-30-90

Date _____

For Organizations: I do solemnly swear or affirm that I am _____

Title

of _____, that I have signed the foregoing

Organization

document in the space below as _____ of _____

Title

Organization

and that the statements contained in the foregoing document are true and correct.

Signature of Authorized Agent _____

Title and Organization _____ Date _____

State of Idaho/or _____

County of Bannock SS.

Subscribed and sworn (or affirmed) before me this 30th day of March 19 90

SEAL

Notary Public J. Randy Smith

Residing at Pocatello, Idaho

My Commission Expires 3/10/92

Please Print Name

17. Notice of Appearance:

Notice is hereby given that I, _____ will be acting as attorney at law on behalf of the claimant signing above, and that all notices required by law to be mailed by the director to the claimant signing above should be mailed to me at the address listed below.

Signature _____

Address _____

Date _____

Last Name Rowland Ident. Number _____

Copies White-State, Yellow-Claimant

MICROFILMED
APR 14 1996

DATE 7-14-99

KILOWATT HOURS (kwh_2) 29584

IF MOTOR, PUMP, OR SYSTEM HAVE CHANGED SINCE FIELD INVENTORY, NOTE
CHANGES HERE: _____

5. = Complex, exam incomplete

Date 5/3/01 Sig. BAC

Record
200883

FOLLOW-UP DATE

KILOWATT HOUR METER		WATER MEASUREMENT METER and MOUNTING PIPE INFORMATION	
Utility	El Paso Electric	METER INFORMATION	
Pole No.		Manufacturer	
Meter Manufacturer	G.E.	Model Number	
Meter Serial No.	55 950 653	Type (std. meter)	
Disc Constant(Kh)	28.8	PIPE INFORMATION	
Rated Voltage	240 V	Pipe material	Steel
Demand	5.6	Outside Diameter	6.68"
Multiplier (Mult)	1	Inside Diameter	2 1/4" Thick
CTR (Current) PTR (Voltage)		Distance of straight pipe upstream and down	Upstream /Down 10 10+

Exam complete. Y N

std confid F G (F) P

2

old pipe

Determination of Power Consumption Coefficient

Kilowatts of Energy Consumed

$KW = 3.6 \times Kh \times \text{Multiplier} \times \text{No. of revolutions}(N) \div \text{Time}(T) \text{ in seconds per N}$

Cond.#1 $N = 3$ (No. of Disc Rev) Time (sec) = $(52.45) + (52.30) + (52.48) / 3 = 52.41$ Ave

3.6×28.8 (Kh) $\times 1$ (Mult) $\times 3$ (N) $\div 52.41$ (T) = 5.93 KW

Cond.#2 $N =$ (No. of Disc Rev) Time (sec) = () + () + () / 3 = Ave

$3.6 \times$ (Kh) $\times$ (Mult) $\times$ (N) $\div$ (T) = KW

Cond.#3 $N =$ (No. of Disc Rev) Time (sec) = () + () + () / 3 = Ave

$3.6 \times$ (Kh) $\times$ (Mult) $\times$ (N) $\div$ (T) = KW

Measured Flow Rate and Discharge Pressure - Enter flow rate as determined by the "standard" water measurement meter in GPM, and discharge pressure measured in PSI. Attach documentation to support data such as notes, printout tapes etc.

GPM Cond. #1 195.8 #2 #3

PSI Cond. #1 #2 #3

Power Consumption Coefficient (PCC) = KW $\times$ 5431 $\div$ GPM

PCC Cond. #1 = 5.93 (KW) $\times 5431 + 195.8$ (gpm) = 164.48 (kWh/ac.ft)

Percent

PCC Cond. # Claim = (kWh/ac.ft)

Percent

PCC Cond. Date 5/3/01 Sig. BAC = (kWh/ac.ft)

Percent or sea

Is the system operat
(see form PCC)

Record
200893

anges in system operation? Yes / No

Water Level Data

Does the well have access to measure water levels? Yes / No

Static Water Level ft Pumping Water Level ft (at condition #)
Date Date

Describe system operating conditions and how percentage of seasonal use is obtained: _____

Handlines to pasture & yard

Sketch of pumping plant layout or attach photograph of pumping plant and piping:

Claim _____

Doc Source East Water

Measurement District

Date 5/3/01 Sig. Bar

Record
200883

Comments: Hillside setting 2 was running during readings (See field report)

Operator reports system only run a total of two weeks per year. 10 birds were on, but system has multiple leaks.

Operator is long distance truck driver. Rarely home to turn on the system.

I certify that the above information is true and correct to the best of my knowledge and ability and the measurements taken and recorded are in accordance with the standards and specifications of the equipment used.

Signature John Mueller Date 7-14-99
(person performing measurements)

99-07-14 15:00:35
+2.074E+0 ft/s
+1.984E+2 gal/m
+TOTAL 0000463 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:01:34
+2.047E+0 ft/s
+1.959E+2 gal/m
+TOTAL 0000658 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:02:34
+2.061E+0 ft/s
+1.972E+2 gal/m
+TOTAL 0000355 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:03:34
+2.058E+0 ft/s
+1.969E+2 gal/m
+TOTAL 0001052 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:04:34
+2.061E+0 ft/s
+1.972E+2 gal/m
+TOTAL 0001249 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:05:34
+2.059E+0 ft/s
+1.970E+2 gal/m
+TOTAL 0001446 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:06:34
+2.056E+0 ft/s
+1.968E+2 gal/m
+TOTAL 0001644 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:07:34
+2.073E+0 ft/s
+1.984E+2 gal/m
+TOTAL 0001842 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:08:34
+2.058E+0 ft/s
+1.969E+2 gal/m
+TOTAL 0002038 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:09:34
+1.986E+0 ft/s
+1.900E+2 gal/m
+TOTAL 0002233 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:10:34
+2.000E+0 ft/s
+1.914E+2 gal/m
+TOTAL 0002423 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 14:58 test

SITE SETUP

SITE SETUP

PIPE PARAMETER

PIPE PARAM

OUTER DIAMETER	6.6800in
PIPE MATERIAL	CARBON STEEL
WALL THICKNESS	0.2140in
LINING MATERIAL	NO LINING
LINING THICKNESS	0.0000in
KIND OF FLUID	WATER
SENSOR MOUNTING	V
SENSOR TYPE	FLGIS
TRANS. VOLTAGE	ITIME

+1.968E+2 gal/m
+TOTAL 0001644 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:07:34
+2.073E+0 ft/s
+1.984E+2 gal/m
+TOTAL 0001842 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:08:34
+2.058E+0 ft/s
+1.969E+2 gal/m
+TOTAL 0002038 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:09:34
+1.986E+0 ft/s
+1.900E+2 gal/m
+TOTAL 0002233 gal
-TOTAL 0000000 gal
NORMAL

99-07-14 15:10:34
+2.000E+0 ft/s
+1.914E+2 gal/m
+TOTAL 0002423 gal
-TOTAL 0000000 gal
NORMAL

195.8 GPM

Claim

Doc Source East Water

Measurement District

Date 5/3/01 Sig. BAC

Record

200893

WATER MEASUREMENT DISTRICT
FIELD REPORT

DISTRICT EWMD RECORD NUMBER 200883

SITE DATA:

EXAMINER (inv_name) B Coutor

EXAM DATE 5/13/98 DIVERSION NAME Spring
(site_visit) (div_name)

GPS FILE C061321A SITE TAG NUMBER A000 7675
(gps_filnam) (site_tagno)

GPS OFFSET (offset) 15' E 3' South of pump

TAG LOCATION (tag_locat) power meter conduit

POD LEGAL (pod) T 6 N 33 E, Sec 1, NE NE NW

DISTRICT MEASUREMENT CAPABILITY (std_rcmd):

SONIC (s) SONIC/DIG (sd) SONIC @ PVT (sp)

COLLINS (c) PYGMY (p)

MEASUREMENT RECOMMENDATIONS (op_num):

PCC (2) HOUR METER (7) IRR. FLOWMETER (1)

ALTERNATE (3) FLOWMETER (8) CRP 1014

AMEND CHANNEL DEVICE 1019

her method selected (pcc_ok) YES NO

(trkng_reqd) YES NO

water level meas. (wl_access) YES NO

loss. w/o major change (qmtr_ez) YES NO

up_date) 1999

OWNER/OPERATOR INFORMATION

OWNER (name) Connie Rowland

ADDRESS # 494

OPERATOR (contact) _____

ADDRESS _____

PHONE 237 6244

CEL PHONE _____


PHONE _____

CEL PHONE _____

* Please update database name file

PUMPING PLANT SKETCH

VALVE	=	⊠
CHECK VALVE	=	▷
AIR VAC	=	⊗
PRESS. RELIEF	=	Ⓟ
INDIVE/UPDIVE	=	==
HOSE BIB	=	Ⓟ
PRESS. GAGE	=	Ⓟ
WELL ACCESS	=	Ⓟ

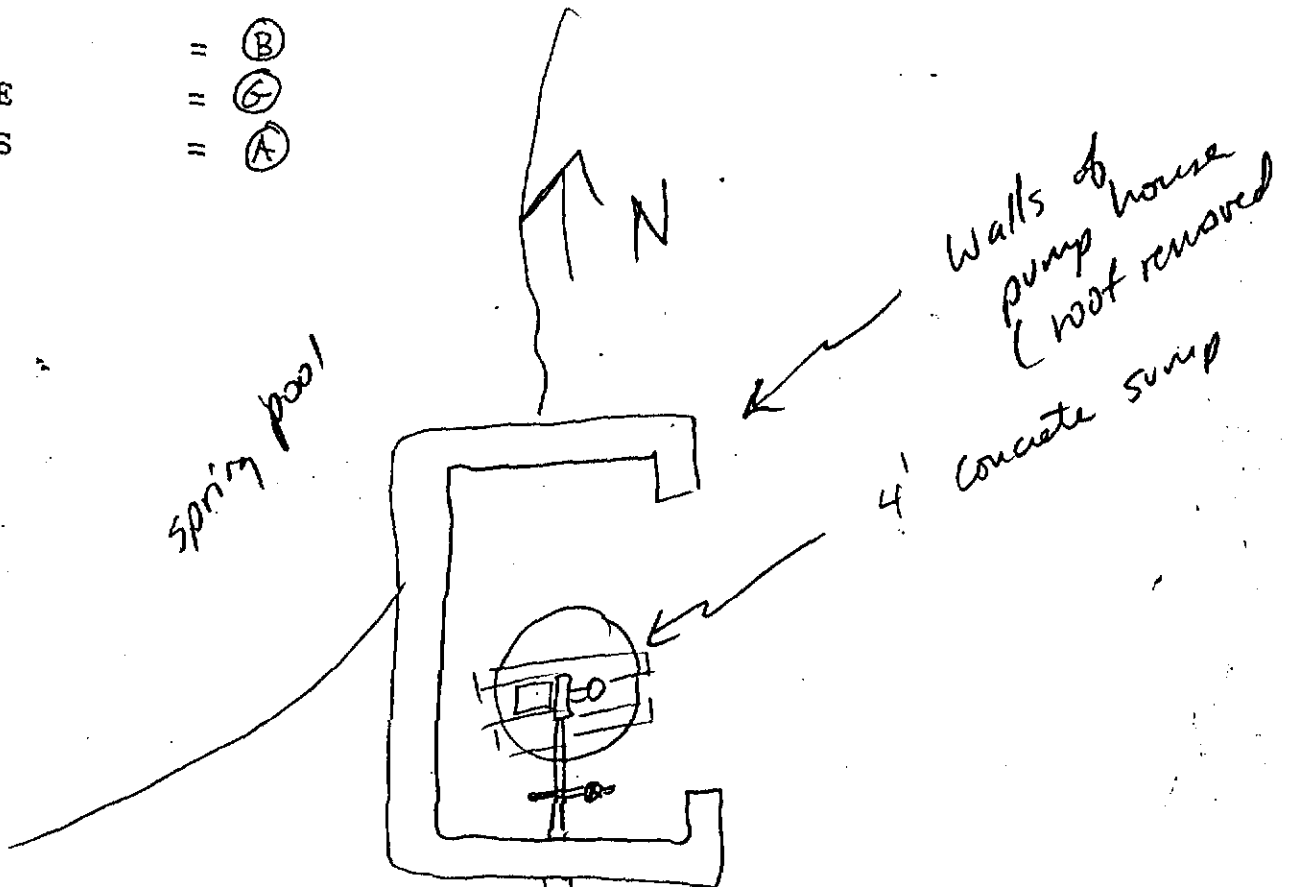

Claim _____

Doc Source East Water

Measurement District

Date 5/3/01 Sig. BAC

Record

200893

Buried mainline,
partially exposed
for enough distance
for good sonic reading

WELL/PUMP INFORMATION:

DEPTH OF WELL: _____

WATER LEVELS:

PRE-SEASON STATIC: _____
(swl_pre)DURING-SEASON STATIC: _____
(swl_mid)POST-SEASON STATIC: _____
(swl_post)DYNAMIC WATER LEVEL: _____
(pmpng_wl)

Claim _____
Doc Source East Water
Measurement District
Date 5/3/01 Sig. BarDATE Record
(swl) 200893
DATE _____
(pwl_date)

DOES STATIC WATER LEVEL DROP OR RISE OVER SEASON? YES NO

DOES ANOTHER WELL SPECIFICALLY INTERFERE WITH THIS WELL? YES NO

PUMP AND MOTOR INFORMATION:

WELL MOTOR

MFG: USSERIAL: 5720? N11N245R0125HP: 7 1/2

WELL PUMP

MFG: UniversalSERIAL: 13 JAN 87 024TYPE: _____ VERT T CENT SUBMER
(pump_type) (v) (c) (s)

BOOSTER 1 MOTOR

MFG: _____

SERIAL: _____

HP: _____

BOOSTER 1 PUMP

MFG: _____

SERIAL: _____

TYPE: _____ VERT T CENT SUBMER

BOOSTER 2 MOTOR

MFG: _____

SERIAL: _____

HP: _____

BOOSTER 2 PUMP

MFG: _____

SERIAL: _____

TYPE: _____ VERT T CENT SUBMER

UTILITY KWH METER INFORMATION:

UTILITY: Rd. Power
(utility)POLE #: _____
(pole_no)

MAX KW DEMAND _____

KILOWATT HRS 27274 x 1
(kwh_1)

(use date of exam for "kwh1_date")

UTILITY ACCOUNT NUMBER 13700410500
(acct_no)KWH METER SERIAL: 55450653
(pwrmttr_sn)METER MFG: GE
(pwrmttr_mfg)Kh DISK CONSTANT _____
(kh)MULTIPLIER 1
(disk_mult)

SYSTEM DESCRIPTION/NARRATIVE COMMENTS:

SYSTEM TYPE Solid Set
(system_type)

COMMENTS TO DATA-ENTER (exam_notes): (please enter notes on attached Open Channel meas. form).

FILE-ONLY COMMENTS: GPM/ PCC Calculations:

$$\underline{GPM_A} = 117$$

$$\underline{KWA} = 4.8$$

$$\underline{PENT_A} = 100$$

$$\underline{PCC_A_DSC} = \text{"Theoretical PCC"}$$


$$\underline{PCC_AF_QAL} = \text{"9"}$$

$$\underline{EXAM_COMPLETE} = \text{"N"}$$

$$\underline{GPM} = \frac{\text{Water HP} \times 3960}{\text{TOT}} = \frac{(7.5 \times 5) \times 3960}{(30 + 2 + 3(\text{friction}) + 2.31 \times 40)} = 117$$

$$\underline{PCC} = 2 \times \text{PWL} + 4 \times \text{PSI} = 2 \times 32 + 4 \times 40 = 224$$

$$\underline{KW} = \frac{PCC \times GPM}{5431} = \frac{224 \times 117}{5431} = 4.8$$



Claim _____
Doc Source East Water
Measurement District
Date 5/3/01 Sig. BAC

I certify that the above info
of my knowledge and ability are
are in accordance with the sta
equipment used.

Record
200893

correct to the best
taken and recorded
ations of the

Signature Byron A. Contor

Date 5/13/98


EASTERN WATER MEASUREMENT DISTRICT

SUPPLEMENTAL DATA FORM A

SKETCH OF IRRIGATED LANDS AND MAJOR COMPONENTS OF DELIVERY SYSTEM/S

crop	acres
1	
2	
3	
4	
total	

Not to Scale

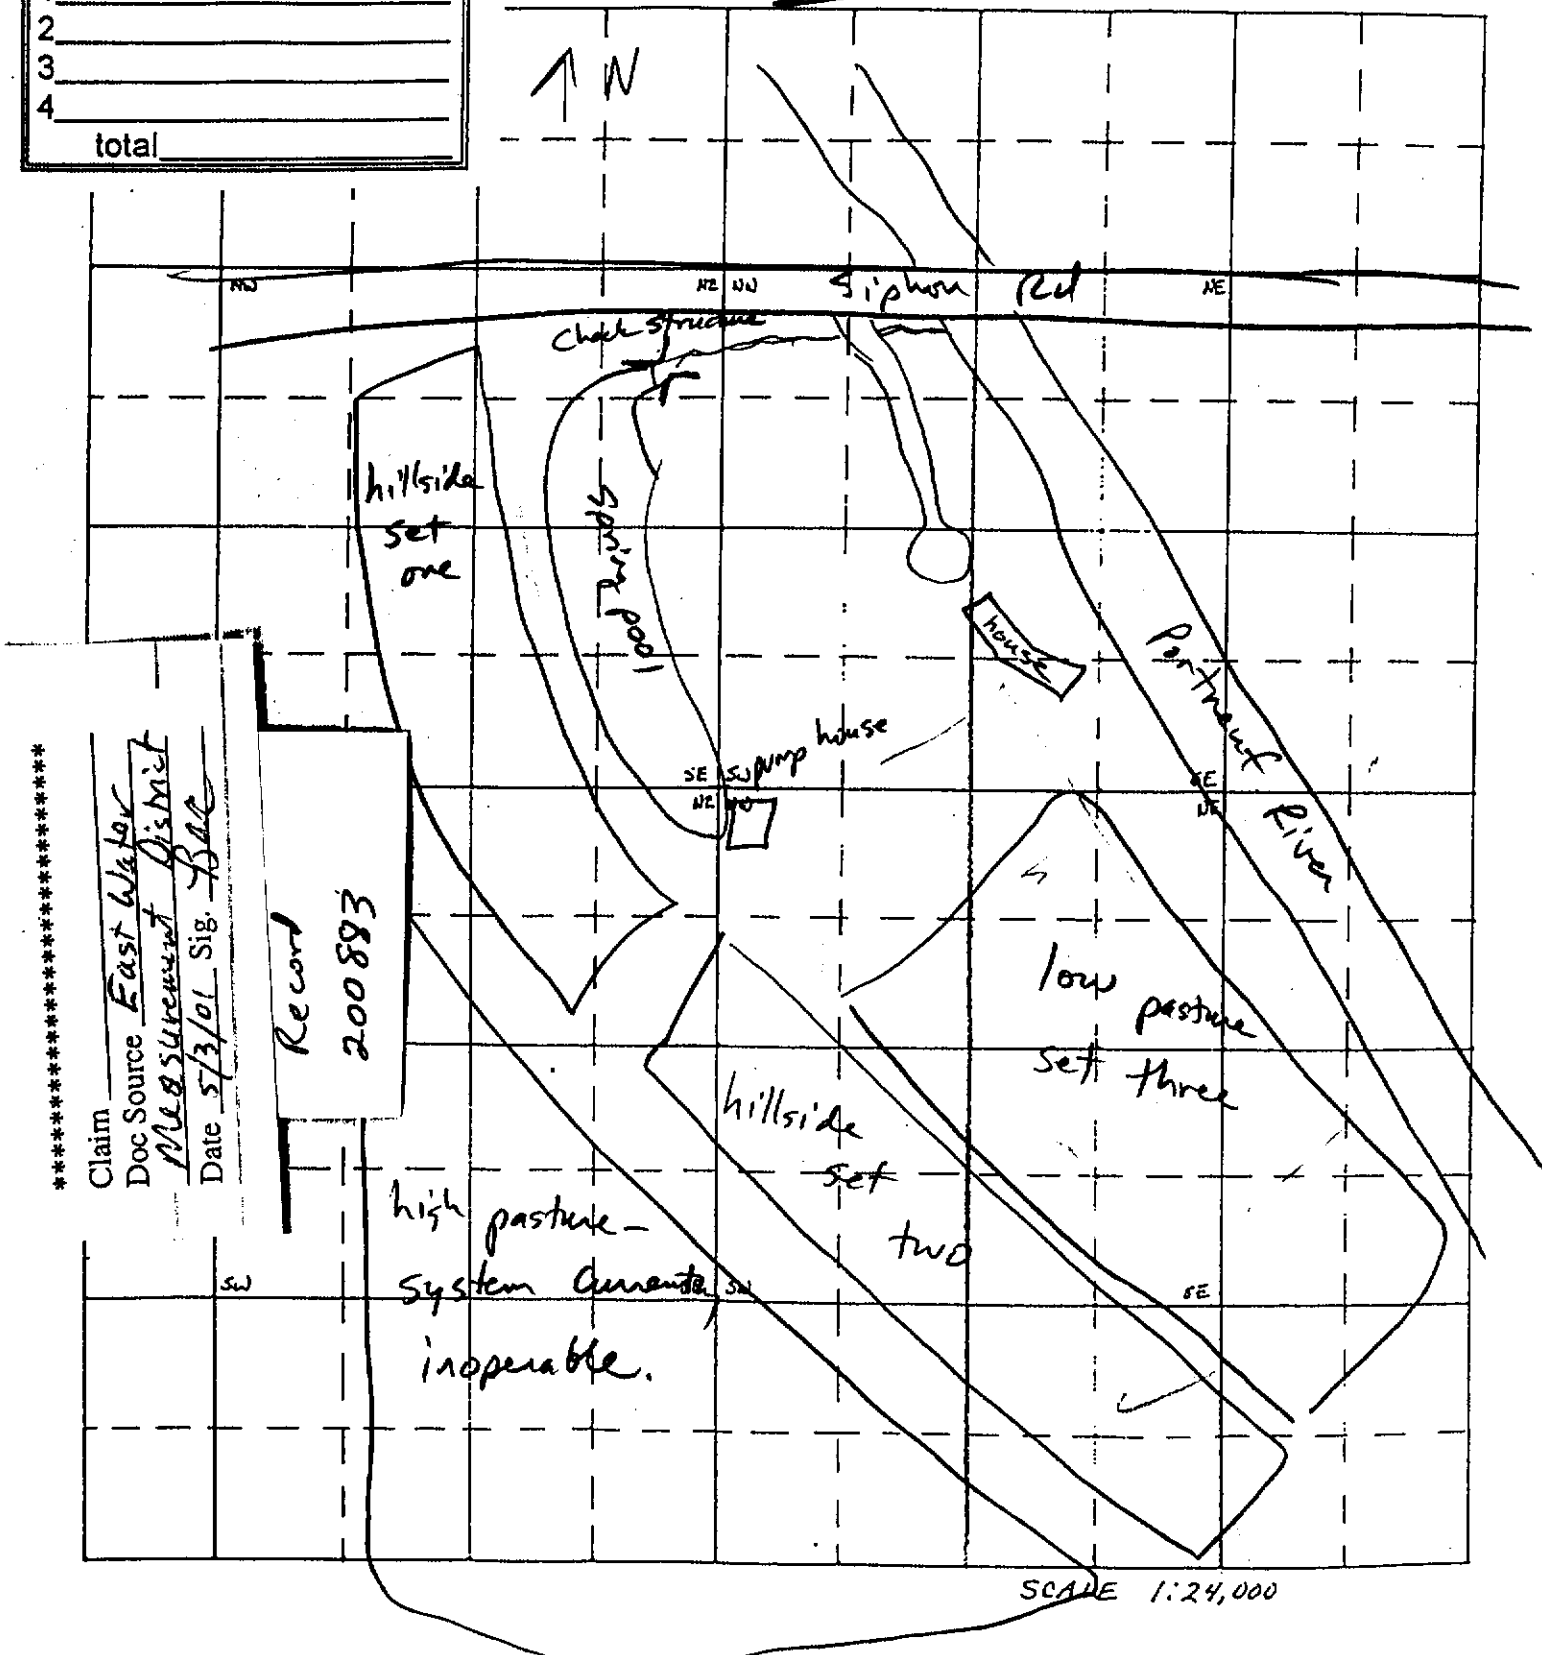

 Claim East Water
 Doc Source Measurement District
 Date 5/3/01 Sig. BAC

Open Channel Flow Measurements
(Attach To WMD Field Form)

Site Tag Number- A0007675 Owner- Connie M Rowland
Record Number- 200883 Date- 5/13/98
Examiner- B. Couton
Installed Measuring Device- NONE

Hydrographer Measurement- ± 250 GPM total flow of spring.

Data Entry:

Observations About Current Conditions- Owner uses centrifugal pump to pressurize spring water to underground sprinkler system. Current POA less than 5 acres pending repair of upper pasture system. Owner states pump capacity is 130 GPM. Dedicated power meter PCC w/ tracking should work. Calculated pump capacity is 117 GPM (see inventory form).
Information From Interview With Operator-

Equations Used For Measurement- upstream = 0.40 downstream = 0.35
 $V = 4.64 \sqrt{Dh} = 1.04 \text{ ft/s}$, depth ≈ 0.36 width ≈ 1.5
 $Q = AV = 0.36 \times 1.5 \times 1.04 \approx .56 \text{ cfs} \approx 250 \text{ GPM}$

Total Flow Through Diversion-

Notes For Data Entry-

Notes For File Only-

Claim

Doc Source East Water

Measurement District

Date 5/3/01 Sig. Bar

Record

200883

NAME_1	CONNIE M ROWLAND	ADRES_ID	494
		POD	06S 33E A NENENW 65 33 E 1 NENENW
NAME_2		DIV_RATE	0.28
		UNITS	CFS
ADDRESS_1	1254 W SYPHON ROAD	SURF_FLG	X
		CONTACT	
ADDRESS_2		COMMENTS	
CITY	POCATELLO		
ST	ID		
ZIP	83202	SITE_VISIT	
PHONE	2083276244	EXAMINER	
REGPOD88	1	SITE_TAGNO	
RECNO	200883		
WRNUMBER	A29-11371		

5/8/98 2018 327 6244 disconnected
information 237-6244 - Monday not
Wed 13th 3 PM 237-6244

Chubbuck Xchange - N - Yellowstone Hwy
Chubbuck Rd + 1 mile N - Syphon
left - west - 4 1/2 miles - govt & Big Sky Ave
further west from here

Claim _____
Doc Source East Water
Measurement District
Date 5/3/01 Sig. BAC

Record
200883



State of Idaho

DEPARTMENT OF WATER RESOURCES

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

May 2
~~April 4~~, 2001

Connie M. Rowland
1254 W. Syphon Road
Pocatello, Idaho 83202

Re: Adjudication Claim 29-11371

Dear Water User:

Attached is a copy of an Adjudication Claim for a water right near American Falls or Pocatello, Idaho. This claim is based upon "beneficial use." This means that the underlying water right was perfected by the original user simply developing a diversion and using the right. This was completely legal and appropriate up until March 25, 1963, for ground water uses, or up until May 20, 1971 for surface water uses. However, this method of perfecting a water right did not result in a paper record of the water right with the department.

In order to recommend your adjudication claim to the court, I need you to supply "evidence of priority" and "evidence of beneficial use." The enclosed pamphlet describes some typical sources that may be used. If an affidavit is used, it must clearly show that the person making the affidavit personally observed the water use. The more detail the affidavit gives, indicating dates, circumstances, amounts and details of water use, the better. As I review the documentation provided, my standard will be:

The documentation should tend to indicate that diversion works were in place and had adequate capacity for the claimed use. The documentation should also tend to indicate that water was applied to the claimed beneficial use on the claimed place of use.

Please review these documents, and provide documentation of the historical use of this right. Feel free to call me if you have questions. You should be able to reach me Thursday or Friday mornings.

Sincerely,

Bryce A. Contor
Senior Water Resource Agent

Log for claim A29-11371

Spatial Dynamics LTD

9/26/00

TR	SEC	QQ	Acres Claimed	Acres Found	COMMENT
06s33e	1	NWNE	13	14	
Totals:			13	14	

AJ5809NP
No. A29-11371

IDAHO DEPARTMENT OF WATER RESOURCES
ADJUDICATION CLAIM PROFILE REPORT

DATE: 05/24/00
PAGE: 168

OWNER CODE	NAME & ADDRESS	PRIORITY DATE	WATER USE	USE PERIOD FROM TO	DIVERSION RATE	DIVERSION VOLUME
C	CONNIE M ROWLAND 1254 W SYPHON RD POCATELLO ID 83202 (208) 237-6244	05/01/1963	IRRIGATION STOCKWATER	04-01 11-01 01-01 12-31	0.260 CFS 0.020 CFS	
TOTAL DIVERSION:					0.280 CFS	
CONSUMPTIVE USE:						39.00 AFA

Water Source: SPRINGS

Tributary to: PORTNEUF RIVER

Stage: BENEFICIAL USE

Point(s) of Diversion: T06S R33E S01 Lot03(NENENW)

POWER County

Place of use Legal Description for: IRRIGATION

				NE				NW				SW				SE					
T	R	S	:	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	:	SUM
06S	33E	1	:			13														:	13.0
																				TOTAL ACRES	13.0

Place of use Legal Description for: STOCKWATER

				NE				NW				SW				SE					
T	R	S	:	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	:	
06S	33E	1	:			S														:	

POU County: POWER

Non-Irrigation Uses: STOCKWATER, NONE AT PRESENT

Other Rights: GROUNDWATER (IRRIGATION & DOMESTIC)

Other Water Rights with Same Point(s) of Diversion with Stage (Includes All Sources):
29-10958 A29-10958

Other Water Rights Listing Overlapping Place(s) of Use:
A29-04012 A29-04012B

Dates: Exam Made Date: Verified Date: Objection Filed Date:

Misc: Water District Number: Field Inspection Flag:
Presumption Flag:

Audit: 08/12/93 THOMPSON 03/29/95 POST-STD

WARRANTY DEED

FOR VALUE RECEIVED, PHILLIP W. MEADER and MARION E. MEADER, formerly husband and wife, the grantors, do hereby grant, bargain, sell and convey unto THOMAS E. ROWLAND and CONNIE MARIE ROWLAND, husband and wife, the grantees, the following described premises, in Power County, Idaho, to-wit:

Beginning at the Northeast corner of the Northwest Quarter, Section 1, Township 6 South, Range 33 E., B.M., thence South on the meridional centerline of Section 1, 30 feet, more or less, to the intersection of the South right of way line of road and meridional centerline of said Section 1, to the true point of beginning; thence continuing South 453.5 feet, more or less, to an intersection with Easterly right of way line of County Road; thence North 47°08' West along the Easterly right of way line of County Road, 473.85 feet; thence North 39°43' East 169.75 feet, more or less, with intersection with South right of way line of road; thence North 89°53' East 238.80 feet on the South right of way line of road, more or less, to the true point of beginning. ALSO:

Beginning at the Northeast corner of the Northwest Quarter, Section 1, Township 6 South, Range 33 E., B.M., thence South on the meridional centerline of said Section 1, 30.0 feet, more or less, to an intersection with the South right of way line of road and meridional centerline of said Section 1, to the true point of beginning; thence continuing South 1566.6 feet; thence North 46°48' East 685.50 feet; thence North 16°03' West 924.42 feet, more or less, to Westerly bank of Portneuf River; thence North 45°53' West 301.6 feet, more or less, to the South right of way line of road; thence South 89°53' West 28.6 feet, more or less, to the true point of beginning. . .

Subject, however, to levies and assessments under the Michaud Irrigation District; easement to U. S. A. sewer line easement, recorded January 18, 1945, Book 85, No. 545, Record Power County, Idaho, said easement being for sewer line; and easement to Idaho Power Company recorded December 7, 1962, as Instrument No. 84162, Records of Power County, Idaho, said

MICROFILMED

APR 24 1994

19
Instrument
95717
Power Cty
Courthouse