

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE STATE OF IDAHO,
IN AND FOR THE COUNTY OF TWIN FALLS

IN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM.

CIVIL CASE NUMBER: 39576

Ident. Number: A22-07000
Date Received: 7/19/1988
Receipt No: 6000779
Received By: SM

NOTICE OF CLAIM TO A WATER RIGHT
ACQUIRED UNDER STATE LAW

1. Name:	ROGER ERIKSON	208-356-3413
Address:	1786 WEST MAIN	
	REXBURG, ID	83440
OR		
Name:	TED ERIKSON	208-356-3412
Address:	1786 WEST MAIN	
	REXBURG, ID	83440
OR		
Name:	WAYNE ERIKSON	208-356-7993
Address:	1786 WEST MAIN	
	REXBURG, ID	83440

A2207000

2. Date of Priority: JUN 13, 1967

3. Source: GROUNDWATER Trib. to:

4. Point of Diversion:

Township	Range	Section	1/4 of	1/4 of	1/4	Lot	County
05N	40E	9	NW	SE	NW		MADISON

5. Description of diverting works:
400' WELL W/ PUMP TO HANDLINE SPRINKLER SYSTEM

6. Water is used for the following purposes:

Purpose	From	To	C.F.S	(or)	A.F.A.
IRRIGATION	04/01	11/01	1.960		

7. Total Quantity Appropriated is:
1.960 C.F.S. (and/or) A.F.A.

8. Total consumptive use is 392.5 Acre Feet Per Annum.

9. Non-irrigation uses:
NONE

A22-07000

Page 1

Date: 07/19/88

UNRECORDED
OCT 29 1992

10. Place of Use:

Township	Range	Section	1/4	of	1/4	Lot	Use	Acres
05N	40E	9	NE		NW		IRR	38.0
			NW		NW		IRR	40.0
			SW		NW		IRR	40.0
			SE		NW		IRR	39.0
							Section Acres	157.0
							Total Acres	157.0

11. Place of use in counties: MADISON

12. Do you own the property listed above as place of use? YES

13. Other Water Rights Used:
NONE

14. Remarks:

15. Basis of Claim: LICENSE

16. Signature(s)

(a.) By signing below, I/We acknowledge that I/We have received, read and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not ☒ wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments: 1

For Individuals:

I/We do solemnly swear or affirm that the statements contained in the foregoing document are true and correct.

Signature of Claimant(s): Wayne Erikson Date: July 19, 88


Date: _____

State of Idaho)
County of Bonneville) ss.

Subscribed and sworn (or affirmed) before me this 19th day
of July 19 88 Valleen Wray
Notary Public

Seal

Residing at Idaho Falls
My Commission Expires 5/29/1991

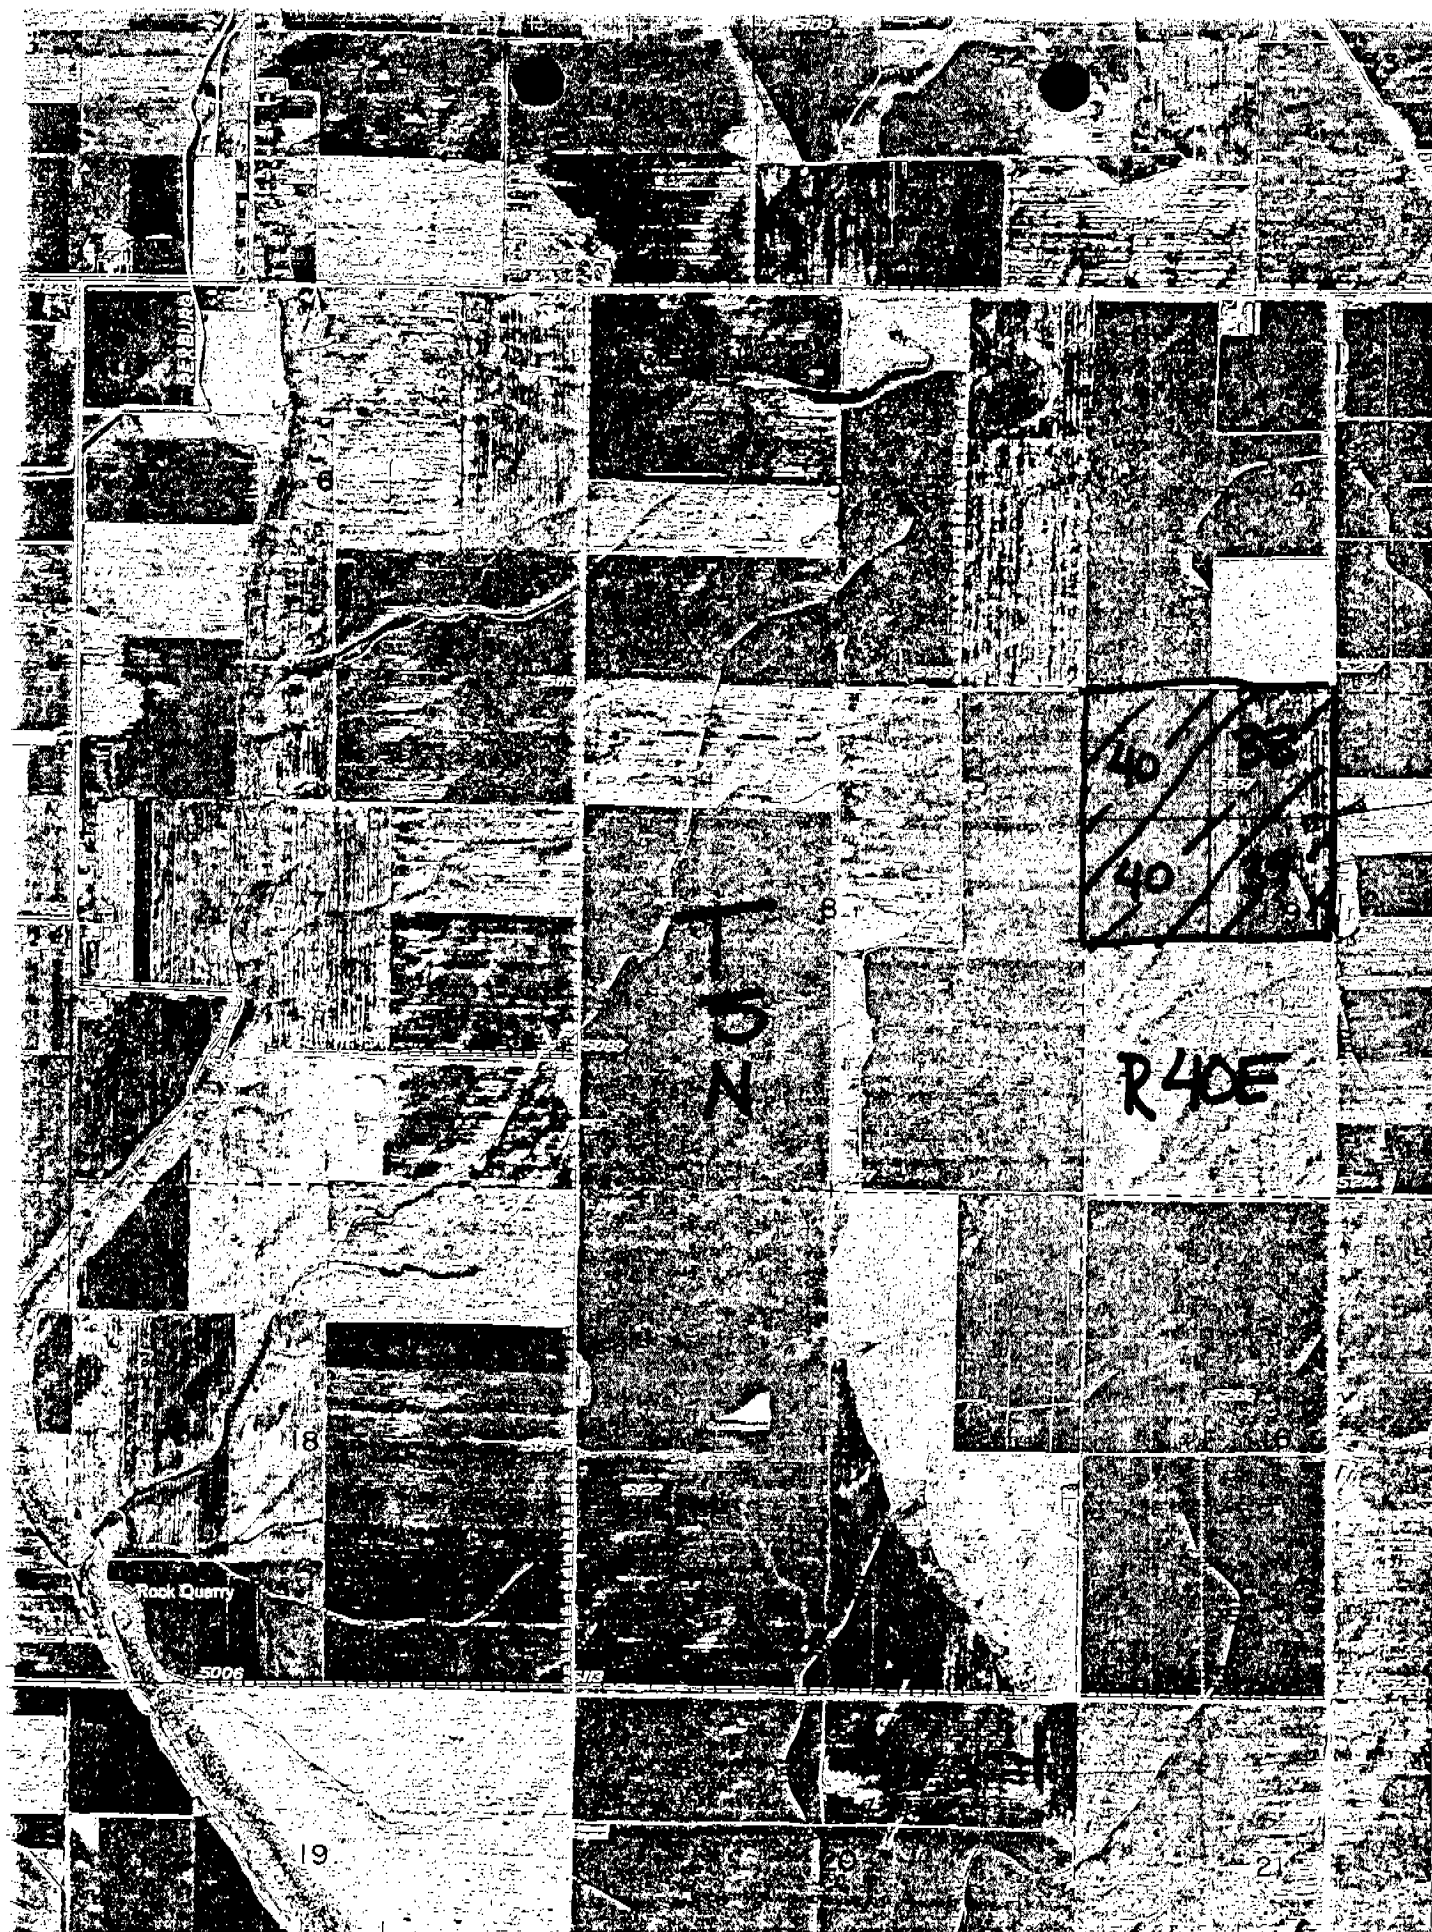

4850
T 6 N
T 5 N
4849
47' 30"
4848
4847
4846
4845000m N
43° 45'
111° 45'

Log for claim 22-07000

Spatial Dynamics BTD

7/3/01

TR	SEC	QQ	Acres Claimed	Acres Found	COMMENT
05n40e	9	NENW	38	38	
05n40e	9	NWNW	40	40	
05n40e	9	SWNW	40	40	
05n40e	9	SEnw	39	39	
Totals:			157	157	

State of Idaho
Department of Water Administration

LICENSE OF WATER RIGHT

License of Water Right No. 22-7000 Priority June 13, 1967 Amount 1.96 cfs

THIS IS TO CERTIFY, that ROBERT A. ERIKSON
of Rexburg, Idaho, has complied with the terms and conditions of Permit
No. 22-7000 issued pursuant to Application for Permit dated June 13, 1967,
and has submitted proof to the Department of Water Administration on October 26, 1972,
that he has applied water to a beneficial use; an examination by the Department indicates that the
works have a capacity of 1.96 cfs, and that the water has in fact been applied to a
beneficial use; a right to the use of water from a ground water source
tributary of _____, is hereby confirmed in the following amounts:
Amount 1.96 cfs for Irrigation from April 1 to Nov. 1 (both dates inclusive)
Amount _____ for _____ from _____ to _____ (both dates inclusive)
Amount _____ for _____ from _____ to _____ (both dates inclusive)
Subject, however, to the condition that no more than 1.96 cfs of water be diverted at
any one time, said waters to be diverted within the _____

SE $\frac{1}{4}$ NW $\frac{1}{4}$ Sec. 9, Twp. 5 N, Rge. 40 E, B.M.

in the county of Madison; and that the amount of water so diverted and to which such
right is entitled and confirmed is for the purposes aforesaid and is limited to the amount which can
actually be beneficially used and shall not exceed 549.5 acre feet per year or
3.5 acre feet per acre.

Description and location of place of use:

TWP.	RANGE	SEC.	NE $\frac{1}{4}$				NW $\frac{1}{4}$				SW $\frac{1}{4}$				SE $\frac{1}{4}$				TOTALS
			NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	
5 N	40 E	9					38	40	40	39									157

Total number of acres irrigated 157

A measuring device of a type approved by this Department shall be permanently
maintained as part of the diverting works.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands
or place of use herein described, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho, this 29 day of
November, 19 73


Director

22-7000

RECEIVED

JUN 13 1967

9:00 A.M.

Department of Reclamation

Identification No. 22-7000

Application No. 41200

STATE OF IDAHO

DEPARTMENT OF RECLAMATION

APPROVED

LICENSED FOR 1/1/68 FEB 1/68

APPLICATION FOR PERMIT

To appropriate the Public Waters of the State of Idaho

1. Name of applicant Robert A. Erikson
post office address Route 11, Rexburg, Idaho 83440
2. Source of water supply subterranean well which is a tributary of _____
3. a. Location of point of diversion is SE $\frac{1}{4}$ of NW $\frac{1}{4}$ of Section 9 Township 5N
Range 40E B.M. Madison County; additional points of diversion if any: _____

b. If water is not consumed, it will be discharged into _____ at a point in _____ $\frac{1}{4}$
of _____ $\frac{1}{4}$ of Section _____ Township _____ Range _____ B.M.
4. Quantity to be appropriated:
a. 3.2 cubic feet per second and/or
b. _____ acre feet per annum will be stored.
5. Water will be used for the following purposes:
irrigation purpose from March 1 to October 15 (both dates inclusive)
_____ purpose from _____ to _____ (both dates inclusive)
_____ purpose from _____ to _____ (both dates inclusive)
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. pump and sprinkler system

b. Height of storage dam _____ feet; active reservoir capacity _____ acre feet; total reservoir
capacity _____ acre feet; materials used in storage dam: _____

c. Proposed well diameter is _____ inches; proposed depth of well is _____ feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use
is 5 years.
b. Estimated construction cost is \$ 23,000.
8. Description of proposed uses:
a. If water is not for irrigation:
(1) Give the place of use of water: _____ $\frac{1}{4}$ of _____ $\frac{1}{4}$ of Section _____ Township _____
Range _____ B.M.
(2) Amount of power to be generated: _____ hp under _____ feet of head.
(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served _____, or number of families to be
supplied with domestic water _____.
(5) If water is to be used for other purposes describe: _____

22-7000

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

TWP.	RANGE	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
5 N	40 E	9					40	40	40	40									160

Total number of acres to be irrigated 160

c. Describe any other water rights used for the same purposes None


9. a. Who owns the property at the point of diversion Robert A. Erikson

b. Who owns the land to be irrigated or place of use Robert A. Erikson

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing

10. Remarks

11. Map of proposed project:

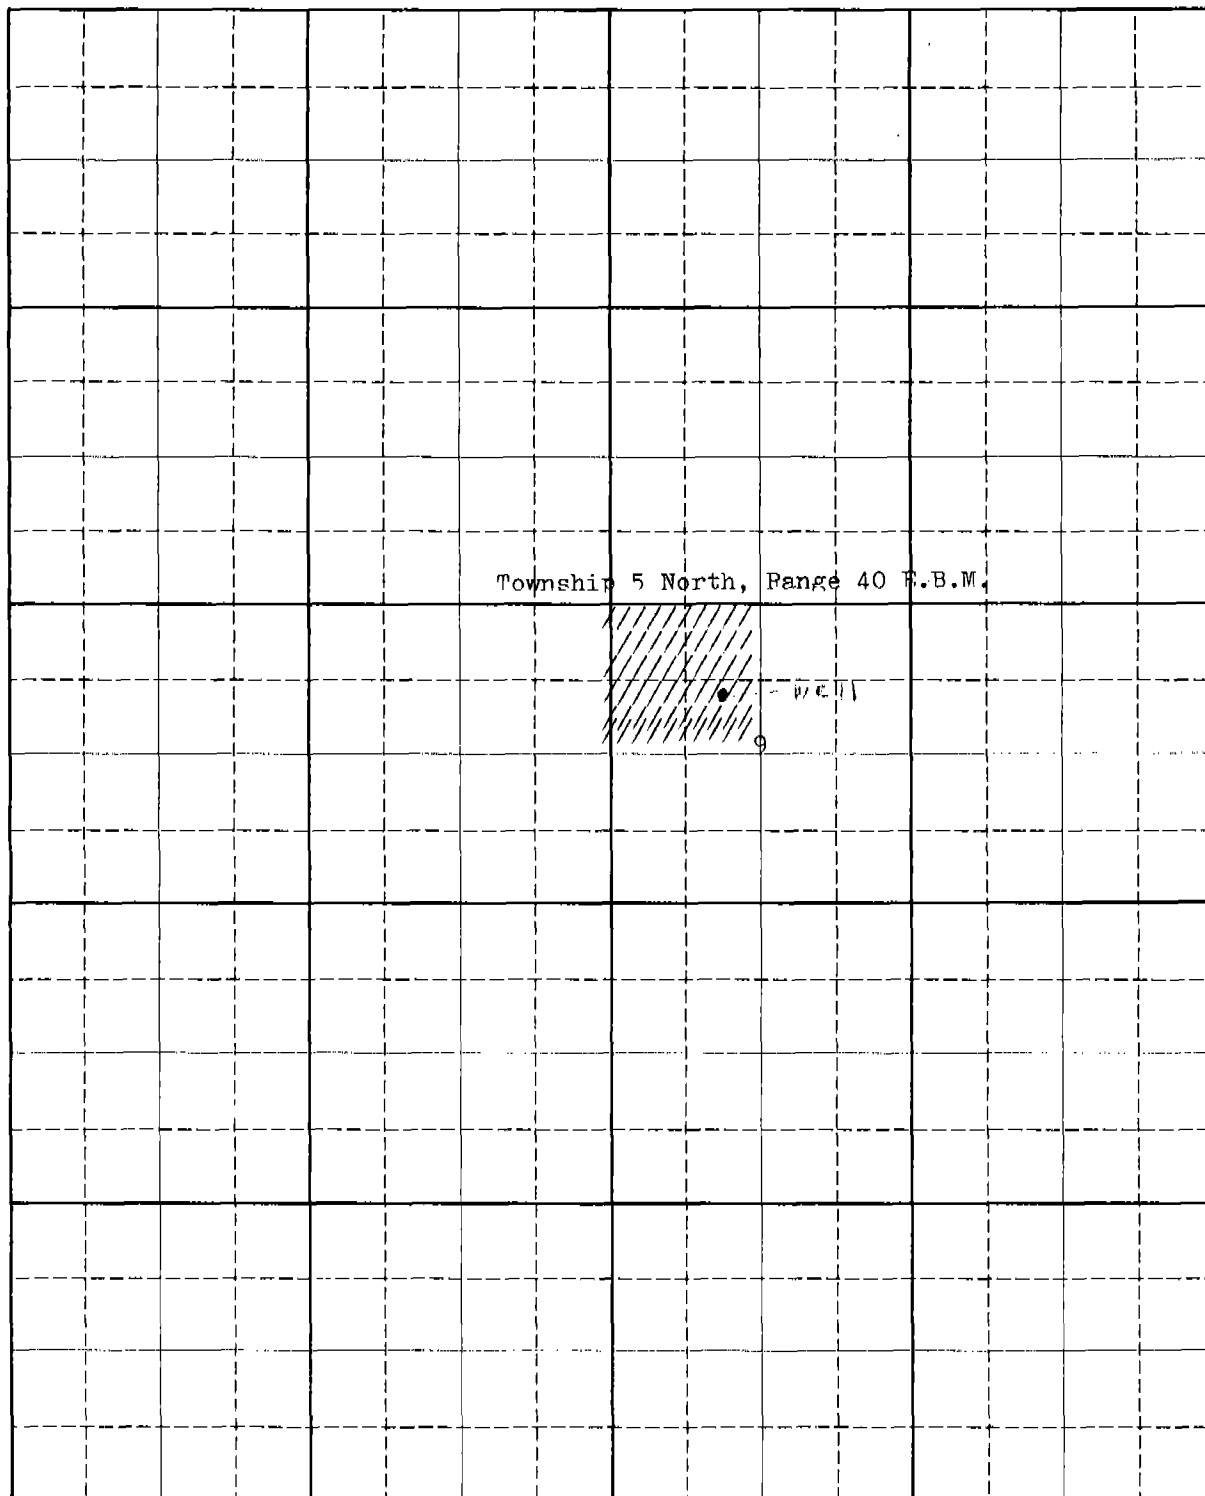

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Robert A. Erickson
(Applicant)

22-7000

Received by ML Date 6-13-67 Time 9:00 A.M.
 Preliminary check by ML Fee \$ 35.00
 Received by ML Date June 13 1967
 Publication prepared by KS Date 6-20-67
 Published in Bozeman Journal
 Publication dates June 29 - July 6
 Publication approved KS Date 2-10-67 (in Gregory, Kelly)
 Priority reduced to _____ Reason _____

 Protests filed by: _____

 Copies of protests forwarded by _____
 Hearing held by _____ Date _____
 Recommended for ☒ approval ☐ Denial by CSS R.H. Higgins June

ACTION OF STATE RECLAMATION ENGINEER

APPROVED

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 22-7000, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before November 1, 19 72.
- c. Other: The applicant shall permanently install a measuring device of a type approved by the department as part of the diverting works.

2. Denial of said application is for the following reasons: _____

Witness my hand this 6th day of November 19 67.

R. Keith Higgins
 State Reclamation Engineer

FIELD REPORT

- TOTAL ACREAGE** _____ 160

Permit No. 22-7000
Examination for b/u

R. 40 E



T.
6
N


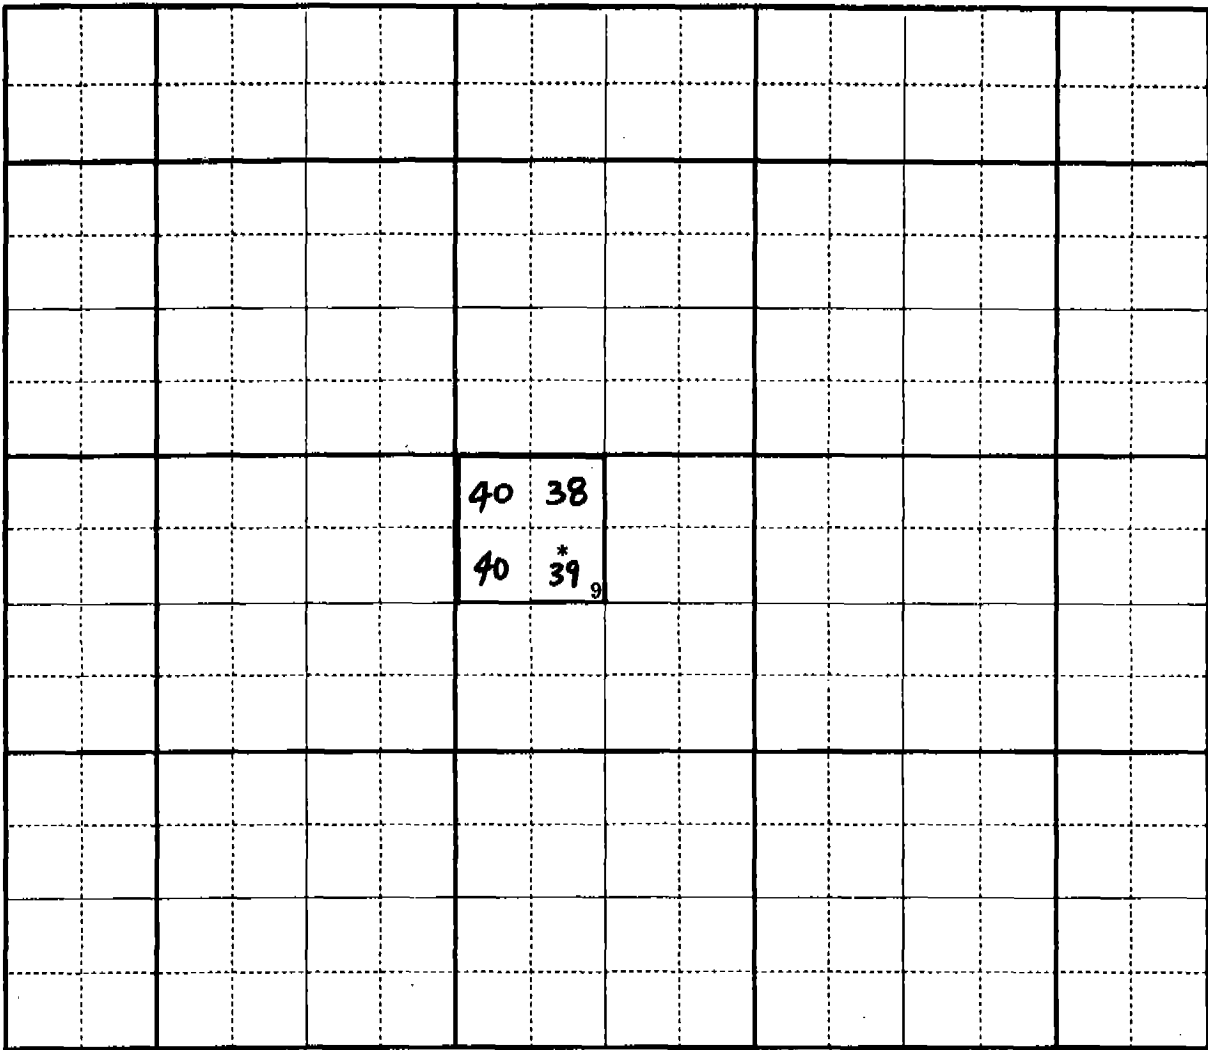


Diagram of System

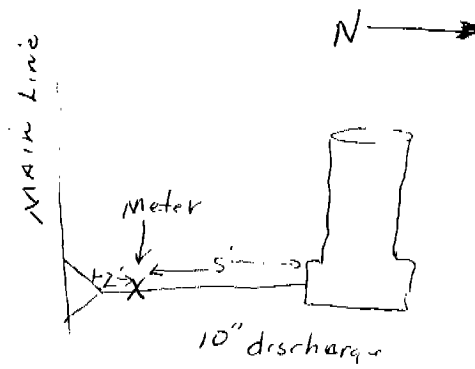

DATE OF EXAM June 19, 1973

ACREAGE
Found 157
Recommended 157

Irrigation Requirement 3.5 Ac Ft/Ac

USE
Irrigation Q = 1.96 c.f.s. V = 550 AF/Ann. from April 1 to Nov 1
Domestic Q = _____ c.f.s. V = _____ AF/Ann. from _____ to _____
Livestock Q = _____ c.f.s. V = _____ AF/Ann. from _____ to _____

Is water co-mingled? yes _____ no ☒

Name source: _____
twp. _____ N/S, Rge _____ E/W, B.M., Sec _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Exchange? yes _____ no ☒

Name source exchanged with: _____
twp. _____ N/S, Rge _____ E/W, B.M., Sec _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Point of injection: _____
twp. _____ N/S, Rge _____ E/W, B.M., Sec _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Point of exchange: _____
twp. _____ N/S, Rge _____ E/W, B.M., Sec _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Total Q measured 1.96 cfs Method of measurement = Pitot Tube

Total Q recommended 1.96 cfs Meter No. A1003 Type _____ Condition IDWA meter

Total V recommended 550 AF/Ann

Recommended Amendments:

P.D. _____
Place of Use _____
Other _____
None ☒

MEASUREMENT CALCULATION: 932
6 laterals w 33, 30WS sprinklers/lateral = 198 sprinklers, 40psi Aug
4.45 gpm/Noz x 198 = 881.10 gal/system = 1.96 cfs

157 Ac x 3.5 AF/Ac = 550 AF/Ann

SYSTEM DESCRIPTION:

GE TRI-CIAD MOTOR 200 HP Ser # LBJ102150
JOHNSTON Pump NO Serial Number
10" discharge into 8" main line

REMARKS:

McBrometer Meter # 72 10785 installed, but not
working. Owner states dial indicates that it has
not worked since installation.
No justification given for early start season, I
recommend license be issued for standard season.

Examiner's Signature William Rhoads Date June 22, 1973

Checked by Norman C. Young, P.E. Date June 22, 1973

Approved by _____ Date _____

