

A25-04124 Summary 8/28/03

- 1) Ownership: Owner is recently deceased but will has not been finalized.
Note attached & address form.
- 2) POD / POB: Appear to be correct. POD GPS
659729 E 271164 N,
Waypoint 4124.
- 3) Q: Claimed less than 0.20 g/s. Pump
controller indicates 1 1/2 horsepower,
evidence of priority indicates 170' static.
No theoretical calculated since claim < 0.20.
- 4) Water use: as claimed.
- 5) Volume:

20 employees X 52 weeks X 6 days -
use 15 gallons/person/shift from Field
Examiner's Handbook Table 3
 $20 \times 52 \times 6 \times 15 = \underline{93,600}$ gallons

Two toilet rooms service customers @ 400 gallons
per day (Table 3 - stores)
 $52 \times 6 \times 2 \times 400 = \underline{249,600}$ gallons

A25-04124 Summary p2

Parts washer 30 gallons/week per shop yr.
~~Fill fluid in~~ 52 x 30 = 1560 gallons
~~Tractor~~

Fill fluid in 30 tractors/yr x 200 gallons
Tractor tires

6000 gallons

pressure washer / steam
cleaner

3 gallons/min x 4 hrs/day x
150 days

$$3 \times 60 \times 4 \times 150 = \underline{108,000} \text{ gallons}$$

Volume Summary

employees	93,600	gallons
customer toilet rooms	249,600	gallons
Parts washer	1,560	gallons
Tractor fluid	6,000	gallons
pressure washer	<u>108,000</u>	gallons
	458,760	gallons

$$\frac{458,760}{325,850} = 1.41 \text{ acre feet}$$

A25-04124 Summary p3

- 6) Evidence of priority: Copy in file is hard to see, maybe look at Statutory claim file 25-4124?
- 7) Photos Well, motor controller, well house.

Byron A. Contor

A25- 4124 Field 8/28/03

- Photos - 2 of well / motor control /
1 of outside of well house
- pump controller label - Sta-Rite

motor model M4#025-20

1 1/2 horsepower

pressure gage (owners) 38 psi

- Water usage

more 10 yrs ago ~ 19-20 employees long term

average (maybe 25?)

3 restrooms - 100+ customers - 150? / day

Steam cleaner / pressure washer
in summer 10 hrs - 30 min

parts washer maybe - 20-30 gallons / week

steam cleaner / pressure washer

3 gallons / minute 4 hrs day summer

very little in winter

6 days / week summer

often 12 hrs. day

Fill time 30 trucks / yr - 200 gallons avg -

GPS 4124

659,729 E

271,161 N

3 meters S of well

271,164 N corrected

A25-04124 Terry Killiard 8/22/03
208-522-7291 Tractor Sales MSG.

Terry or Rand

Keith Doris/kgs deceased.

8/25/03 522-7291 - Rand or Terry - Thursday, AM
anytime

August 18, 2003

Keith Douglass
282 3rd St
Idaho Falls, ID 83401

Re: Water Right Adjudication Claim(s) A25-04124

Dear Water User:

Idaho Department of Water Resources (IDWR) is reviewing claims to water rights in the Snake River Basin Adjudication in your area. Water Resources Field Services has been retained to do field inspections to aid the Department in making correct recommendations to the court. In the next weeks and months I will be contacting you to make an appointment to look at your diversion works and uses of water.


This is the water right for the commercial building identified as a Farm Equipment Sales and Service Dealer in the claim.

I look forward to helping make sure your water right recommendation is correct. Please contact me if there is a particular time that would be convenient for you. You may call in the evenings, or leave a message on the answering machine.

Sincerely,

Bryce A. Contor

Water Resources
Field Services
208 663 4667

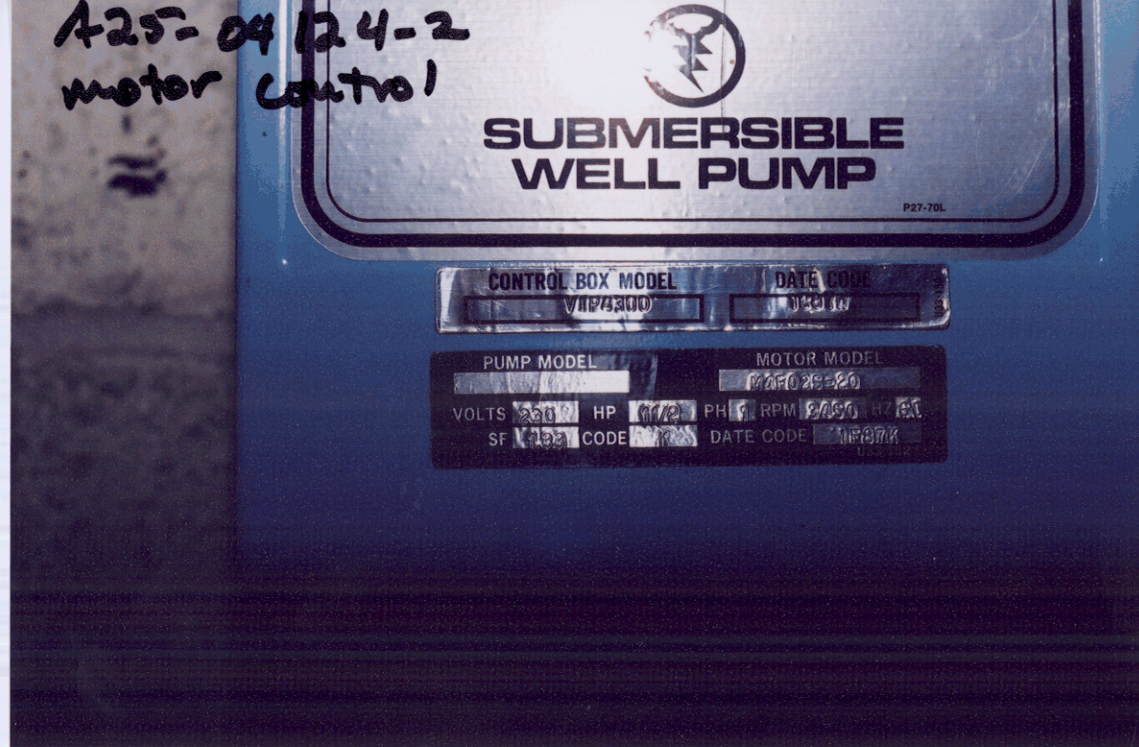

SNAKE RIVER BASIN ADJUDICATION
CHANGE IN ADDRESS OF NOTICE OF CLAIM

Claim Number(s): A25-04124

Previous Mailing Address: Keith and/or Imogene Douglass
282 3rd St
Idaho Falls ID 83401

New Mailing Address: Fra Keith Douglass c/o
Tractor Sales
PO Box 50250
Idaho Falls 83405

Telephone Number: (208) 522 7291

Signature of Claimant(s): Imogene Douglass Co-Rep of Keith Douglass

Please return this completed form to:

Adjudication Bureau
Idaho Dept. of Water Resources
1301 N. Orchard St.
Boise, ID 83706-2237
Ph. 1/800/451-4129 or
FAX 208/327-5400

Adjudication Bureau
Idaho Dept. of Water Resources
2735 Airport Way
Boise, ID 83705-5082
Ph. 208/334-2190 or
FAX 208/334-2348

Adjudication Bureau
Idaho Dept. of Water Resources
1341 Fillmore St., Ste. 200
Twin Falls, ID 83301-3380 or
FAX 208/736-3037

Adjudication Bureau
Idaho Dept. of Water Resources
900 N. Skyline, Ste. A
Idaho Falls, ID 83402-3653 or
FAX 208/525-7177

SS
ADDRESS FM
Revised 12/13/1999

IDWR Use Only:
Data Entry: _____

Date: _____