


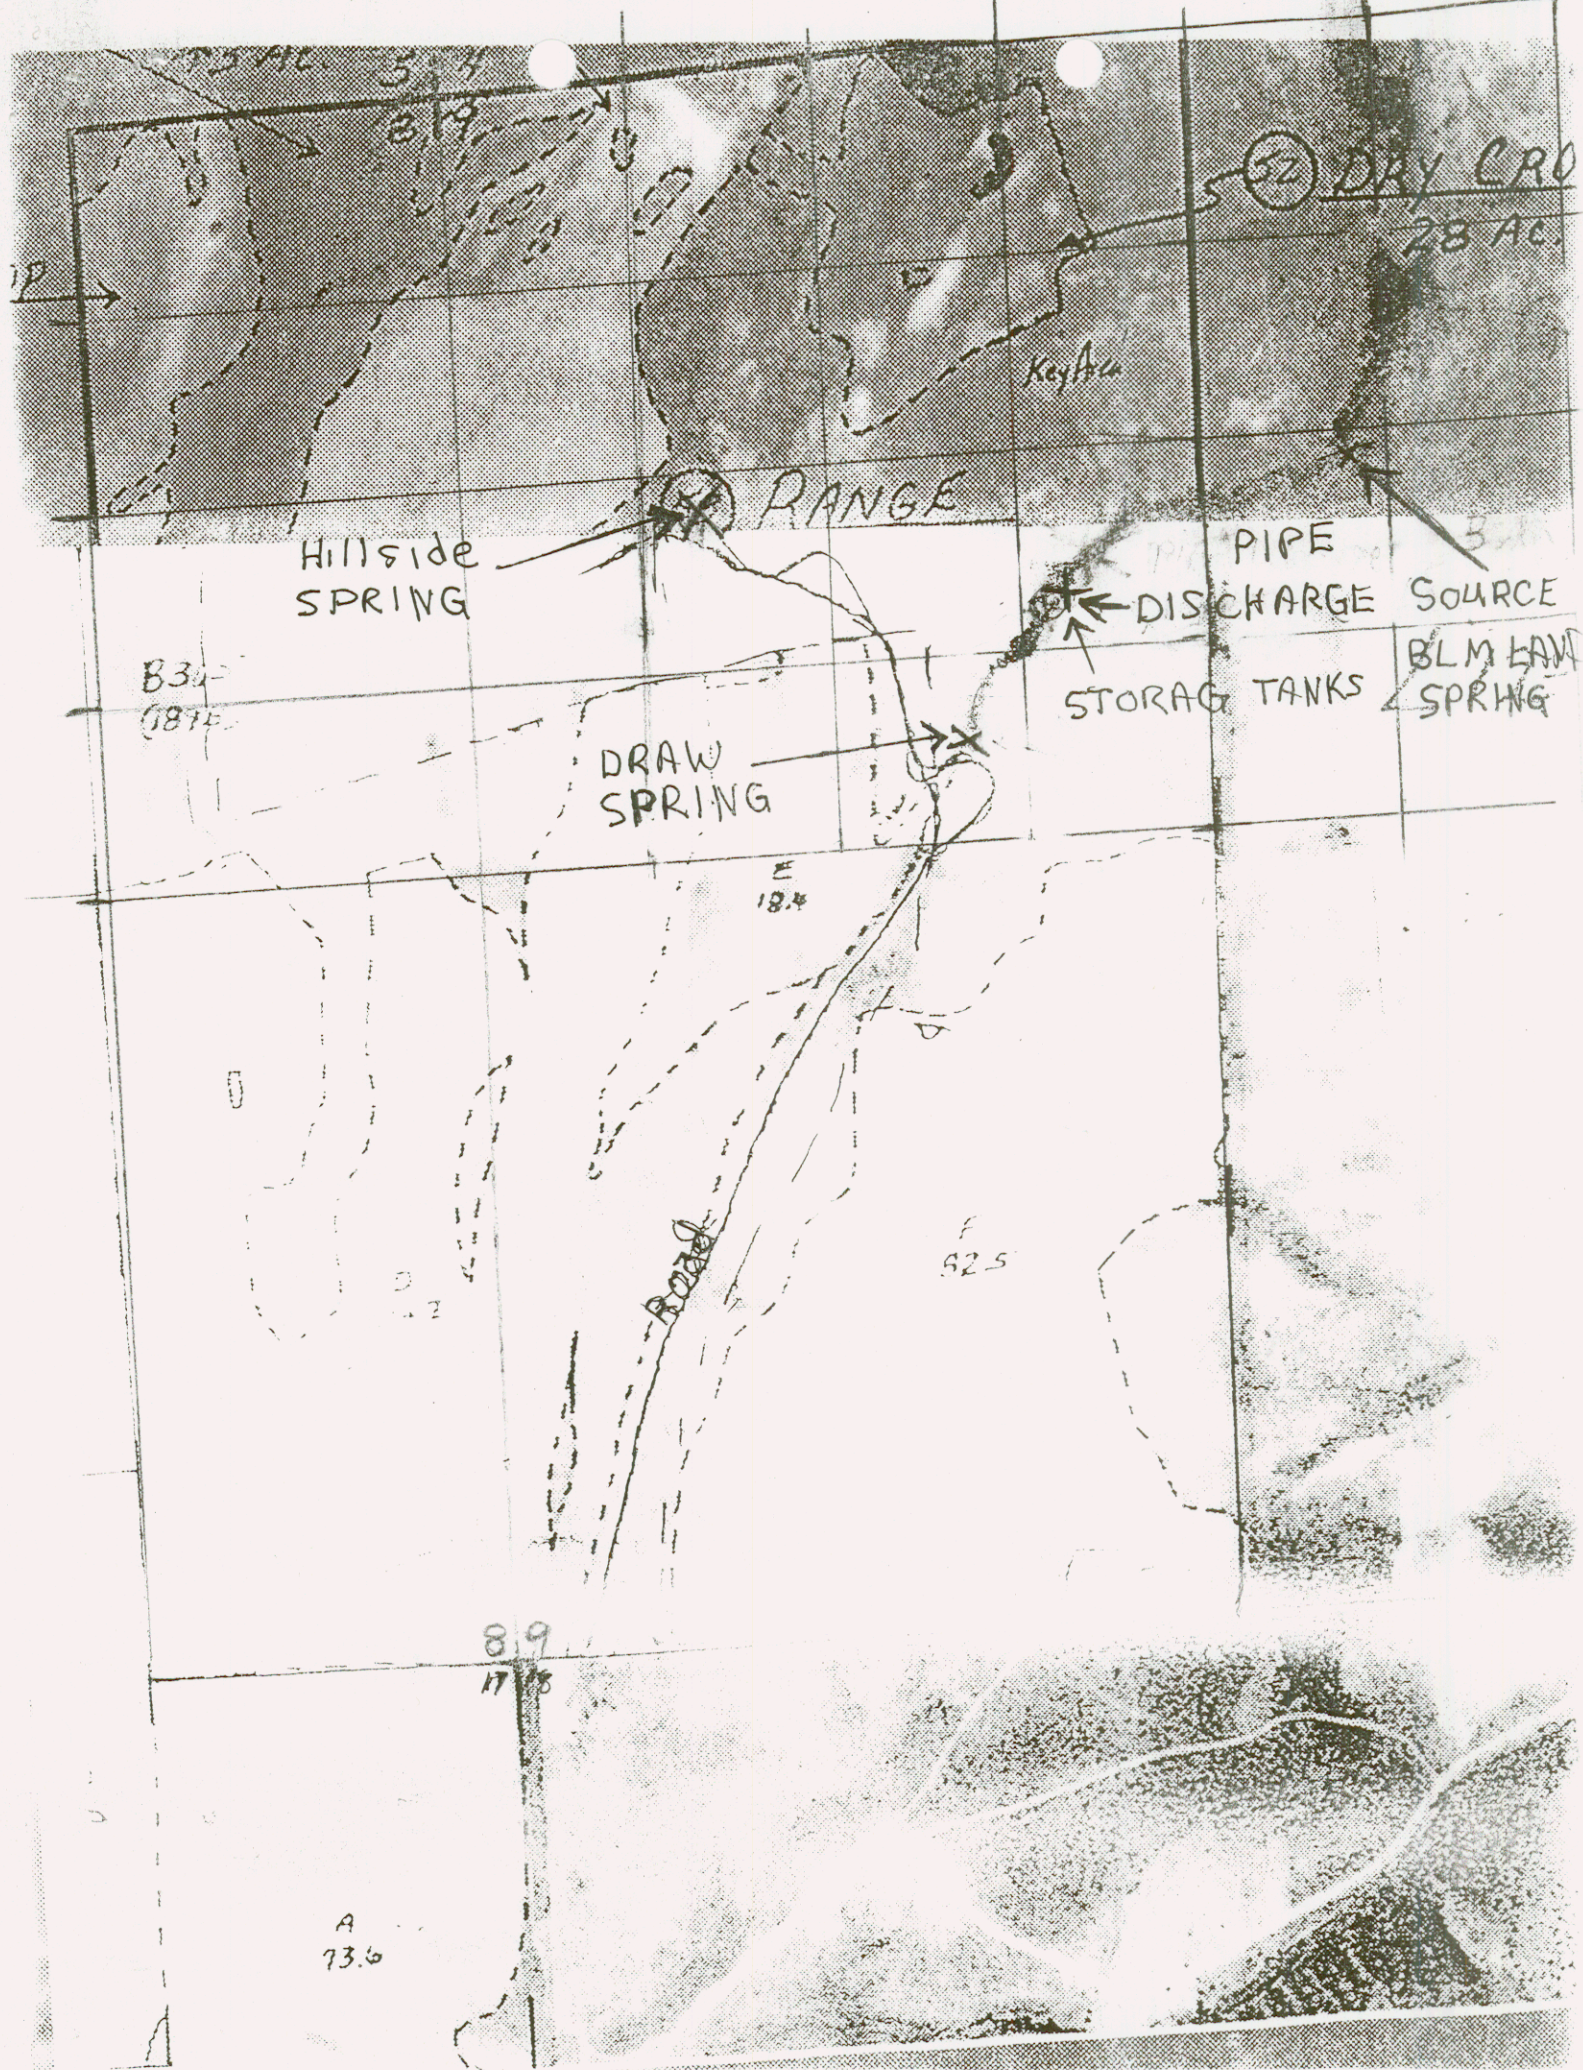

IP →

52 DAY CRO
28 AC.

Key Area

RANGE

Hillside
SPRING

B34-
(1874)

PIPE
DISCHARGE SOURCE
STORAGE TANKS
BLM LAND
SPRING

DRAW
SPRING

E
18.4

F
92.5

89
17.8

A
73.6