

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE
STATE OF IDAHO, IN AND FOR THE COUNTY OF TWIN FALLS

In Re SRBA)
Case No. 39576) NOTICE OF COMPLETED
) ADMINISTRATIVE PROCEEDINGS
)
) Water Rights 35-02094F, 35-02219A,
) 35-02219B, 35-08045
) and 35-07811

IDWR has completed the following Administrative Proceeding:

☒ Change of Address
☐ Substitution of Party
☐ I.C. 42-222 Transfer

CHANGE OF ADDRESS

Name of Claimant: JOHN L DEWEY
New Address: 773 N 850 W
BLACKFOOT ID 83221-5248
Phone: (208) 684-3421

Claimant's Water Rights: 35-02094F, 35-02219A, 35-02219B, 35-08045,
and 35-07811

The Claimant has filed Objections or Responses to the following water
rights:

NOTICE OF COMPLETED
ADMINISTRATIVE PROCEEDING
11/16/1998

35-02094F, 35-02219A, 35-02219B,
35-08045 AND 35-07811

CERTIFICATE OF MAILING

I certify that on 11-27-98 I mailed the original and copies of this form to the following persons, postage prepaid and addressed as follows:

1. Original to:
Clerk of the District Court
Snake River Basin Adjudication
253 Third Avenue North
P.O. Box 2707
Twin Falls, Idaho 83303-2707
2. One Copy to:
Each party in the subcase, or attorney of record:

JOHN L DEWEY
773 N 850 W
BLACKFOOT ID 83221-5248
3. One Copy to:
Chief, Natural Resources Division
Office of the Attorney General
P.O. Box 44449
Boise, Idaho 83711-4449
4. One Copy to:
United States Dept. of Justice
Environment & Natural Resource Div.
550 West Fort Street, MSC 033
Boise, ID 83724

Sandy Egbert
Signature of person or attorney mailing the form



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098
Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

November 5, 1998

KARL J. DREHER
DIRECTOR

RECEIVED

NOV 12 1998

JOHN L DEWEY
773 N 850 W
BLACKFOOT ID 83221-5248

cc: W.D.

Re: Snake River Basin Adjudication (SRBA)
Water Right #35-02094F, 35-02219A, 35-02219B, 35-08045
& 35-07811

Department of Water Resources

Change of Address

records modified

NCAP prepared 11-13-98

Dear Claimant:

IDWR has been notified the address presently in our records is incorrect. Although we have reached you at the address above, we need your written confirmation this is your correct mailing address before we can change our records. Future notices related to your water right(s) can be sent only to the address on your water right(s) or as otherwise changed by you.

Please sign your name at the bottom of this letter and return it to this office. Make corrections to your name and address if necessary and list any other water rights you may have before returning this letter by November 20, 1998. Thank you for your help.

If your mail delivery address changes in any form, please contact us in writing so we can update our records.

If there has been a change in ownership of the property connected with the water right(s) referenced above, please call this office toll-free at 1-800/451-4129 to obtain a form to make this required change to the water right record.

Sincerely,

Sally Sherman
Technical Records Specialist
Adjudication Bureau

SS:region

#####

The address is correct as shown above or as otherwise changed.

Claimant Signature

208-684-3421
Telephone No.

cc: W.O.

fee due 50¢

PENALTY FOR PRIVATE
USE TO AVOID PAYMENT
OF POSTAGE, \$300


35-02894F
✓ - 02219A
✓ - 02219B
✓ - 08045

U.S. POSTAL SERVICE

PS FORM 3547

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
1201 North Orchard Street, P.O. Box 83720
Boise, Idaho 83720-0098

ADDRESS SERVICE
REQUESTED



First-Class Mail
Postage & Fees Paid
USPS
Permit No. 110


0322

IMPORTANT WATER RIGHT INFORMATION

35-07811
JOHN L DEWEY
639 W 175 N
BLACKFOOT ID 83221

DEWEY 639 832213005 1898 05 09 1998
DEWEY 773 N 850 W
BLACKFOOT ID 83221-5248
FORM 3547

8322175878



return

PENALTY FOR PRIVATE
USE TO AVOID PAYMENT

July 17, 1998

NOTICE OF ERROR
REPLY

RECEIVED
AUG 10 1998
Department of Water Resources
Eastern Region

Please type or print clearly, fill out this form completely and mail.

Return this reply form to IDWR by the deadline date printed below if you want IDWR to change your recommendation or you want to let IDWR know that you agree with its recommendation.

YOUR DEADLINE FOR RETURNING A NOTICE OF ERROR REPLY IS: August 14, 1998

Water right number: ~~35-08045~~

JOHN L DEWEY
689 W 175 N
BLACKFOOT ID 83221

Daytime Telephone Number:
Evening Telephone Number:


1. Describe the portion of the proposed recommendation with which you disagree (e.g. priority date, period of use, source):
2. Describe the changes you wish to make in the proposed recommendation:
3. Give a brief explanation as to why you disagree with these portions:

☒ I AGREE with this proposed recommendation; no changes need to be made.

DATE:

8/3/98

SIGNATURE:



Please print your name:

John Dewey

NO. OF CLAIMS IN POLYGON _____

CLAIM NUMBERS 35-08045

DATE _____

AGENT _____

TRANSFER NUMBER _____

OBJECTION FILED _____

TOTAL ACRES FROM RECOMMENDATION 40

GEOGRAPHIC INFO SYSTEM _____

RIGHT NO				NE				NW				SW				SE			
	TNS	RNG	SEC	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE
RECOM	<u>25</u>	<u>34E</u>	<u>25</u>							<u>4</u>									
GIS										<u>4</u>									
RECOM																			
GIS																			
RECOM																			
GIS																			
RECOM																			
GIS																			

UPDATED

POLYGON #

UPDATED

B35-DBPOU.DBF _____

ATTRIBUTES OF B35-POU.SHP () 601

B35-DBPOD.DBF _____

ATTRIBUTES OF B35-POD.SHP () _____

Claimant:

J.L. DOWDY

P.O.D./Source 497 # G.W. S.W.

689 W. 175 N

Township 2S, Range 34E, Section 25

Blackfoot R 83221

1. NW SW NW

2.

3.

Other Rights:

P/U CONFLICT yes () no ()

P/D CONFLICT yes () no ()

SENT FOR DECREE yes () no ()

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 35-08045

Priority: June 17, 1982

Maximum Diversion Rate: 0.14 CFS
Maximum Diversion Volume: 15.2 AF

This is to certify, that JOHN L. DEWEY
689 W. 175 N.

BLACKFOOT, ID 832210000

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated June 17, 1982; and has submitted Proof of Beneficial Use on July 29, 1987. An examination indicates that the works have a diversion capacity of .140 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	04/01 to 11/01	0.12 CFS	14.0 AF
DOMESTIC	01/01 to 12/31	0.04 CFS	1.2 AF
	Totals	0.14 CFS	15.2 AF

LOCATION OF POINT(S) OF DIVERSION:

SWNW, Sec. 25, Township 02S, Range 34E
BINGHAM County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
02S	34E	25	SWNW 4			4
Total number of acres irrigated:						4

PLACE OF USE: DOMESTIC

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>
02S	34E	25
		NWNW

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.

PAGE 2

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 35-08045

CONDITIONS/REMARKS:

4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. This right when combined with all other rights shall provide no more than .03 cfs per acre nor more than 3.5 afa per acre for the lands above.
6. Domestic use is for 1 home.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 19TH day of NOVEMBER, 1990.

Acting for

R. Keith Higginson, Director

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JUN 13 1990
35-8695

A. GENERAL INFORMATION

1. Owner: John L. Dewey
Current Address: 689 W 17 N Blackfoot ID. 83221
2. Accompanied by: John L. Dewey
Address: Same
Relationship to Permit Holder: Owner (perm holder)
3. Source: groundwater tributary to _____

Permit No. _____
Phone No. 689-5411


EXAM. DATE: 6-2-89
Phone No. Same

B. OVERLAP REVIEW

1. Other water rights with same place of use: None ☐ Copies Attached
2. Other water rights with same point of diversion: None ☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. Diversion System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

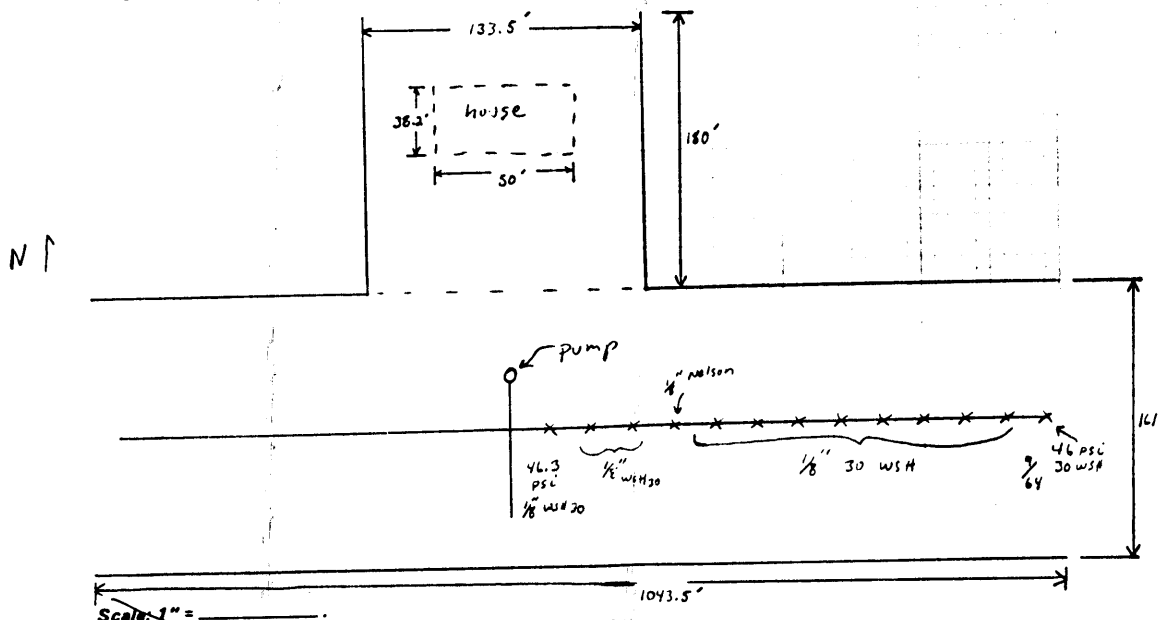

- Scale: 1" = _____
2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required).
☐ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater).
- ☒ Aerial Photo Attached
(required for irrigation of 10 acres or more).

System Description (continued)

3. Narrative: Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)
well 42' deep Pump 1 1

well 42' deep, Pump to house and irrigation system with 12 heads max. operation at one time. beginning pressure = 46.3 psi and ending pressure = 46 psi for irrigation system. the irrigation system consists of 4 acres and with 0.5 acres also irrigated around the house.

4.

Well as Planned				
-----------------	--	--	--	--

☐ See Remarks on page 4 for continuation

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Berkley	3	2823028202	Berkley (Dixie-mfg)	46 psi

*Code to correspond with No. on map and aerial photo.

*Code to correspond with No. on map and aerial photo

- 5. Point(s) of Diversion:**

[illegible]

- 6. Place(s) of Use:**

[illegible]

Do not use this space

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Pressure gage	Pitot	Excel			0-100 (Psi)	

2. Measurements:

beginning pressure = 46.3 psi
 end pressure = 46 psi

E. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

1. Measured Method:

0.09 cfs

2. Alternate Method for Checking Purposes:

0.14 cfs

} from attached sheet

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3) : Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{ir} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \text{irrigating } (4) (2) = 12 \text{ afa}$

$V_{dr} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = 0.09 (1.9835) (214) = 38.2 \text{ afa}$

$V = \text{Smaller of } V_{ir} \text{ and } V_{dr} = 12 \text{ afa}$

2. Volume Calculations for Other Uses:

$V_{Dom} = 12 \text{ afa (from chart)}$

H. REMARKS AND OVERLAP REVIEW ANALYSIS

1/2 acre irrigated with house and 4
acres irrigated behind domestic area.
No overlaps (Canal RI not used)

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<u>irrigation</u>	<u>4/1</u>	<u>12/15</u>	<u>0.09</u>	<u>12 afa</u>
<u>domestic</u>	<u>1/1</u>	<u>12/31</u>	<u>0.04</u>	<u>1.2 afa</u>
Totals:			<u>0.13 cfs</u>	<u>13.4 afa</u>

2. Recommended Amendments

- ☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other


J. AUTHENTICATION

Field Examiner's Name Larry Waters
Signature Larry L. Waters
Certification Date _____
Field Report Preparation Date 6-5-89

CONSULTANT SEAL

- K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

10-10-90
SC

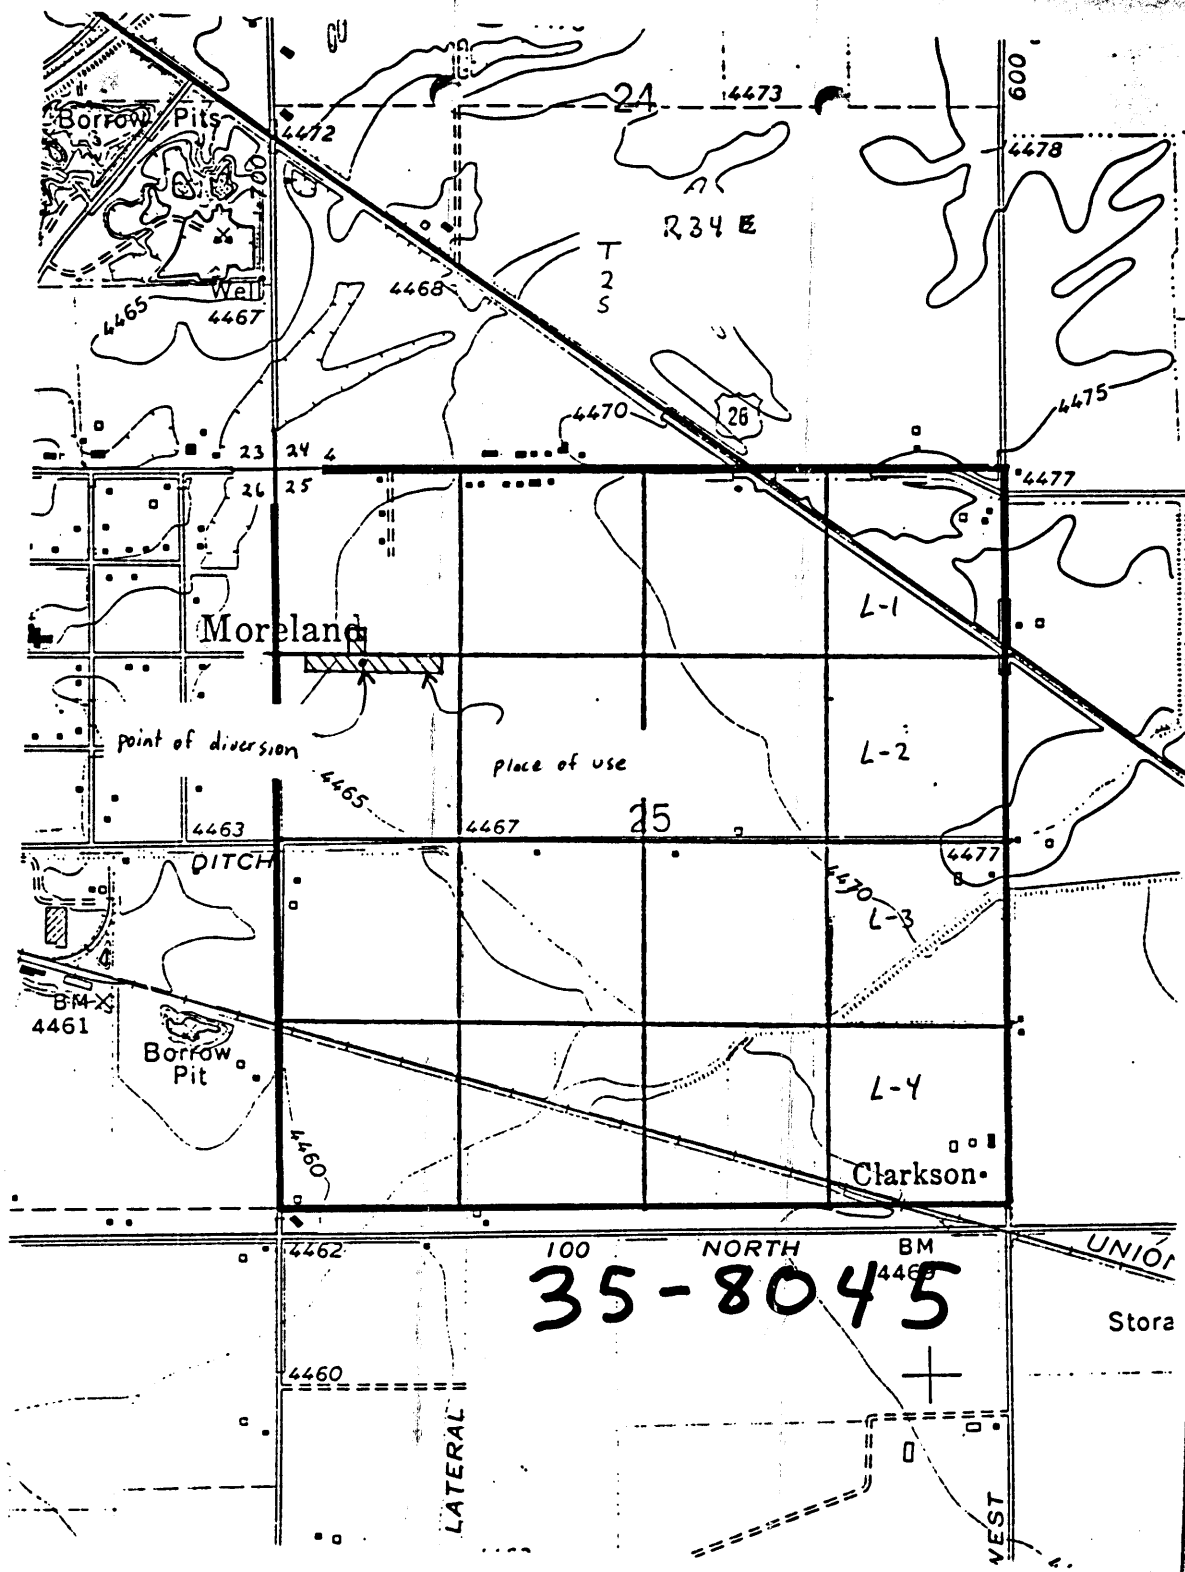

35-8045