


29-07811 POU Field Exam: 9/19/02



Looking North at spring collection system. Barrel collects overflow of spring that Sam Chandler doesn't collect. Spring water enters a pipe system to POU. Actual Spring located about 100 feet up the draw or south of the collection system (csaxton).

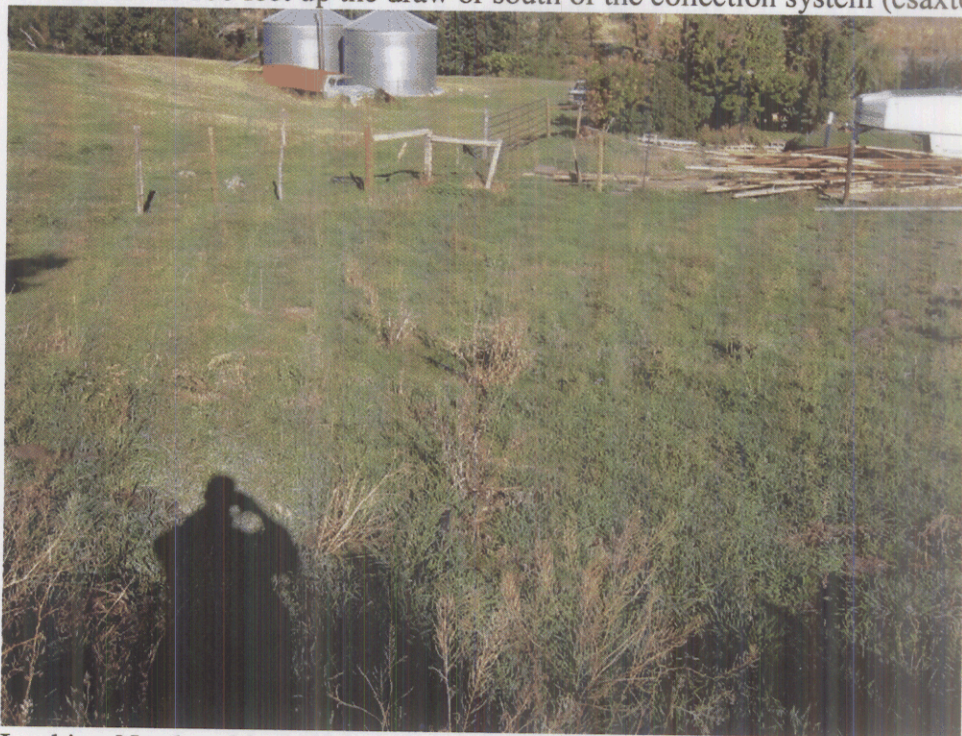

Looking North at black pipe that carries spring water to licensed POU (csaxton).