



State of Idaho

DEPARTMENT OF WATER RESOURCES

15 West Center Street, Soda Springs, ID 83276

Phone: (208) 547-3993 Fax: (208) 547-3939 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

October 18, 2004

Shoshone-Bannock Tribe
Attn: Tribal Utilities
P.O. Box 306
Fort Hall, ID 83203

REF: Snake River Basin Adjudication (SRBA)
Claim 27-7000

Subject: Service area boundary

RESPONSE DATE: OCTOBER 29, 2004

Dear Kathy:

Per our conversation from today I've enclosed a map with the Licensed, the SRBA claimed and your area outlined in the different colors as indicated. The area that you indicated is substantially reduced from the 1971 license. The area outlined in yellow is the 1971 licensed service boundary. The area outlined in green on the map is the area indicated as the service boundary on the map I received on October 12th. The area outlined by red is what the Fort Hall Water and Sewer District claimed in the Snake River Basin Adjudication as the service boundaries. Who services the area in yellow? Has new development occurred in the area outlined in red? Has part of the water right been abandoned? Was this water right split?


Please review that map and get back to me on these differences at 547-3993.

Respectfully,

Cindy E. Bird
Adjudication Bureau

Enclosure: Area map.

11. Map of proposed project:

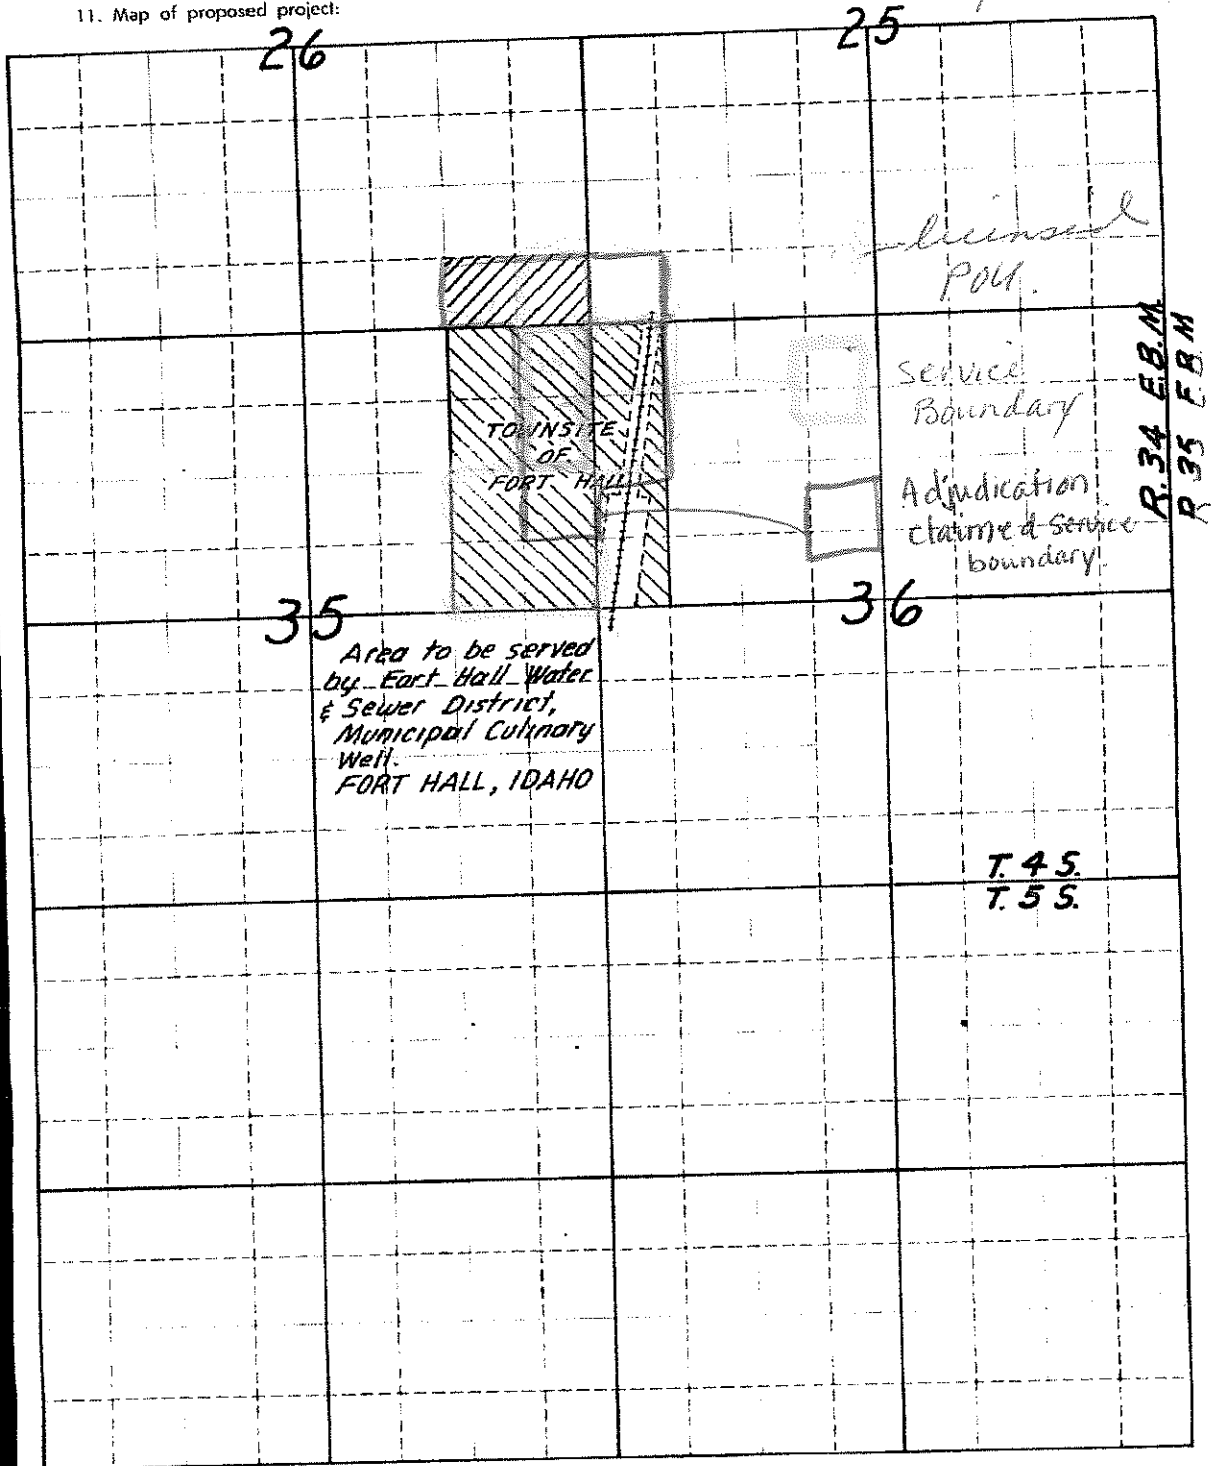

Scale: 2-inches-equal-1-mile


BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Harold D. Schmidt
(Applicant)

Fort Hall Water and Sewer District
c/o Harold D. Schmidt
P. O. Box 105
Fort Hall, Idaho

27-1000

11. Map of proposed project:

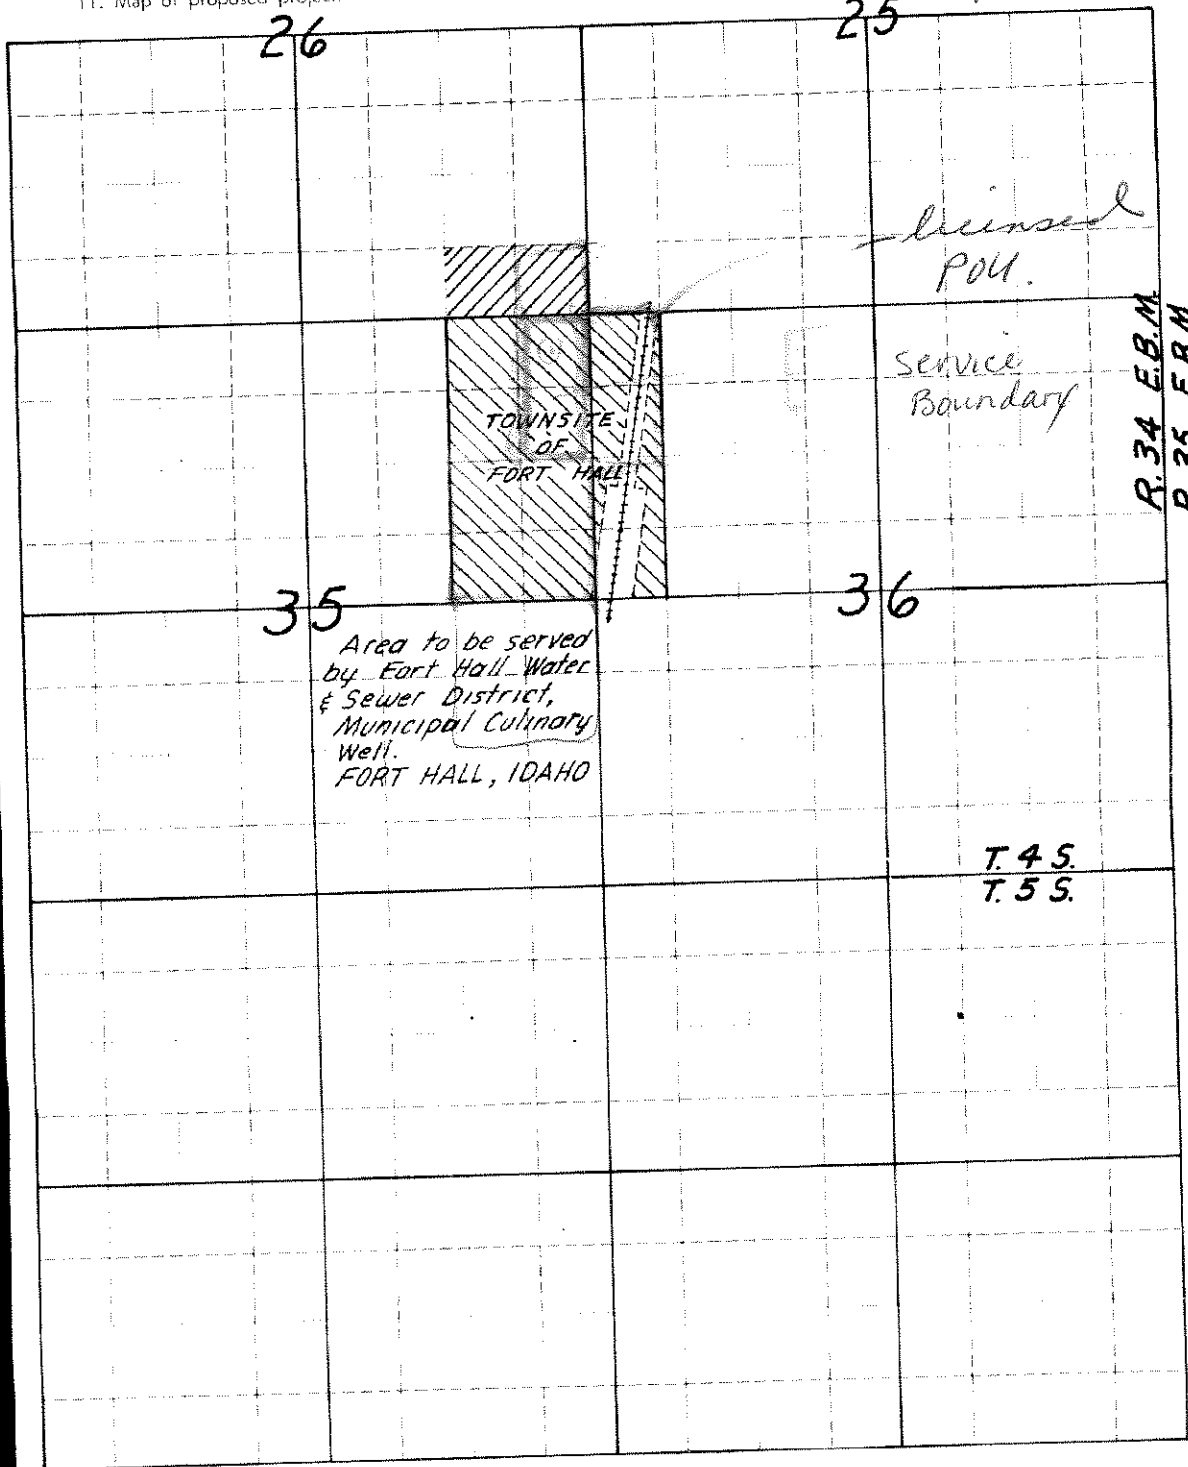

Scale: 2-inches-equal-1-mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Harold D. Schmidt
(Applicant)

Fort Hall Water and Sewer District
c/o Harold D. Schmidt
P. O. Box 105
Fort Hall, Idaho

22-2000

Department of Reclamation requires that this report shall be filed with the State Reclamation Engineer within 30 days after completion or abandonment of this well.

WELL OWNER:

Name Fort Hall Sewer & Water Dist.

Address Fort Hall, Idaho

Engineer: David E. Benton, 1400 Benton Idaho

Owner's Permit No. 27-1000 Falls, Ida.

NATURE OF WORK (check): Replacement well ☐

New well ☒ Deepened ☐ Abandoned ☐

Water is to be used for: (Domestic) Municipal

METHOD OF CONSTRUCTION: Rotary ☐ Cable ☒

Dug ☐ Other

(explain)

CASING SCHEDULE: Threaded ☐ Welded ☒

28 "Diam. from 0 ft. to 50 ft.

15 "Diam. from 0 ft. to 154 ft.

12 "Diam. from 140 ft. to 190 ft.

"Diam. from ft. to ft.

Thickness of casing: 3/16-5/16 Material:

Steel ☒ concrete ☐ wood ☐ other ☐

(explain)

PERFORATED? Yes ☐ No ☒ Type of perforator used:

Size of perforations: " by "

perforations from ft. to ft.

perforations from ft. to ft.

perforations from ft. to ft.

perforations from ft. to ft.

WAS SCREEN INSTALLED? Yes ☐ No ☒

Manufacturer's name

Type Model No.

Diam. Slot size Set from ft. to ft.

Diam. Slot size Set from ft. to ft.

CONSTRUCTION: Well gravel packed? Yes ☐

No. ☒ size of gravel Gravel

placed from ft. to ft. Surface seal

provided? Yes ☐ No ☐ To what depth?

ft. Material used in seal:

Did any strata contain unusable water? Yes ☒

No. ☐ Type of water: Sandy


Depth of strata 18 ft. Method of sealing

strata off: Neat Cement

Surface casing used? Yes ☒ No. ☐

Cemented in place? Yes ☒ No ☐

Locate well in section

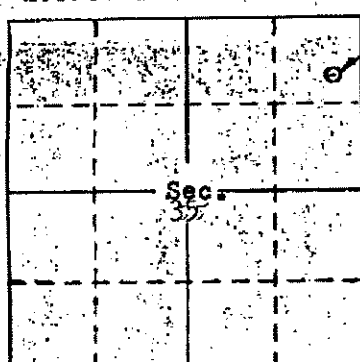

WELL

Size of drilled hole: 28-16-12" Total
depth of well: 300' Standing water
level below ground: 29' Temp.
Fahr. 56 ° Test delivery: 2200 gpm

or cfs Pump? ☒ Bail ☐

Size of pump and motor used to make test:
10" Pump --100 B.H.P.

Length of time of test: 33 Hrs. 30 Min.

Drawdown: 9" +24' Artesian pressure: ft.

above land surface Give flow 5 cfs

or gpm. Shutoff pressure:

Controlled by: Valve ☒ Cap ☒ Plug ☐

No control ☐ Does well leak around casing?

Yes ☐ No ☒

DEPTH MATERIAL WATER
FROM TO YES OR NO

FEET	FEET		
0	20	Sand	
20	24	Sandy Clay	
24	40	Clay	
40	45	Sandy Clay	
45	55	Gravel	
55	65	Sand some gravel	yes
65	107	Gravel water	yes
107	120	Clay & gravel	no
120	130	Clay small amount of gravel	no
130	133	Sand and gravel	yes
133	154	Broken lava (Blk)	yes
154	170	Hard lava	no
170	176	Broken lava (Blk)	no
176	186	Clay brown	no
186	188	Broken lava (Blk)	no
188	202	Hard lava (Blk)	no
202	237	Brown sand stone some	yes
237	261	Lava (Blk)	no
261	272	Pross lava some	yes
272	285	Red lava hard	no
285	300	Lava cinders some crevices	yes

Work started: October 23, 1967

Work finished: January 30, 1968

Well Driller's Statement: This well was drilled under my supervision and this report is true to the best of my knowledge.

Name: Jack Cushman

Address: 1405 South Broadway

Signed by: Jack Cushman