


Date:	1/24/2008
Agent:	S. Hemenway
Claimant:	Stephen C. Vanzandt
WR#	67-14896
Mailing Address:	176 Maurice St. N. #309, Twin Falls, ID 83301
Phone #:	(208) 736-7134 WK (208)738-2190
Location of POD:	T15N R1W Sec 26 SENENE beginning point; NWNWNE Ending point
System Description:	In-Stream Stocwater Use
Measuring Device:	N/A, not required due to Basin Wide Issue #12
Field Exam:	N/A, not required (Idaho Code 42-113, and due to being <0.20 cfs (per Dave Tuthill, director IDWR)
Nonirrigation Uses:	None
Other Uses:	None
Other WRs Used:	67-98 (irrigation WR POU overlaps NENE, and NWNE Sec. 26)
Supplemental Water:	None
Basis of Claim:	Beneficial Use
Priority Date:	5/20/1883
Evidence of Priority:	N/A, not required (Idaho Code 42-113)

NOTES:

2 unnamed streams come on to property claimed and owned by Vanzandt. They comingle, and end at the same point (ending point POD). Added the 2nd beginning point to ECVR in order to include the entire POU being claimed for In-Stream Stockwater Use.
When checking the QQQ on ArcView for the POD in the NENE, it defaulted to SENENE, and had to be manually changed to NWNENE, where the unnamed stream first comes on to the property owned, and being claimed by Vanzandt.

Recommendation:

N11, N13, X02, C18
BASIN WIDE ISSUE #12 (MAX. DIVERSION RATE IS 0.02 CFS)

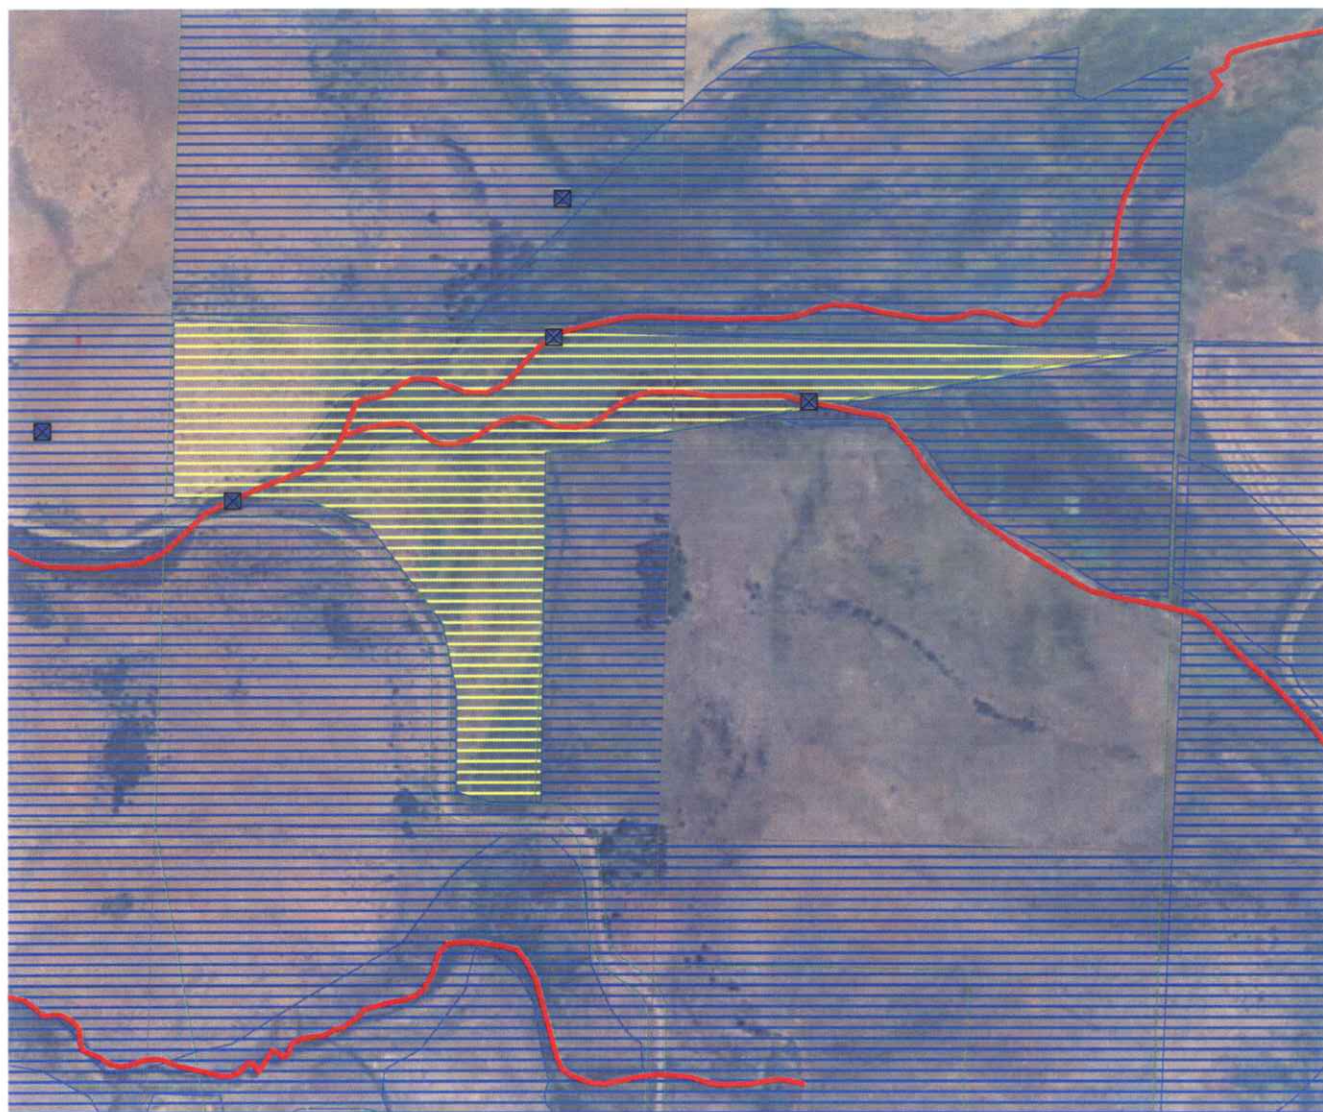

- Recommendation POD
- Streams.shp
- Adams taxlots
- GCDB15N01W GCDB
- Recommendation POU
- Administrative BasinsAdminbas.shp



0.2 0 0.2 0.4 Miles

67-14896

1/24/2008

S. Hemenway