

November 20, 1998

**NOTICE OF ERROR
REPLY**

**RECEIVED
DEC 16 1998**

Department of Water Resources
Eastern Region

Please type or print clearly, fill out this form completely and mail.

Return this reply form to IDWR by the deadline date printed below if you want IDWR to change your recommendation or you want to let IDWR know that you agree with its recommendation.

YOUR DEADLINE FOR RETURNING A NOTICE OF ERROR REPLY IS: December 18, 1998

Water right number: 35-07135

CLARENCE T FEHRINGER
3168 W 1600 S
ABERDEEN ID 83210

Daytime Telephone Number: 397-4266
Evening Telephone Number: 397-4266

1. Describe the portion of the proposed recommendation with which you disagree (e.g. priority date, period of use, source):

2. Describe the changes you wish to make in the proposed recommendation:

3. Give a brief explanation as to why you disagree with these portions:

✓ I AGREE with this proposed recommendation; no changes need to be made.


DATE: 12-11-98 SIGNATURE: Clarence T. Fehringer
Please print your name: CLARENCE T. FEHRINGER

IDAHO DEPARTMENT OF WATER RESOURCES

CLARENCE T. FEHRINGER

Water Right No(s).

35-07135

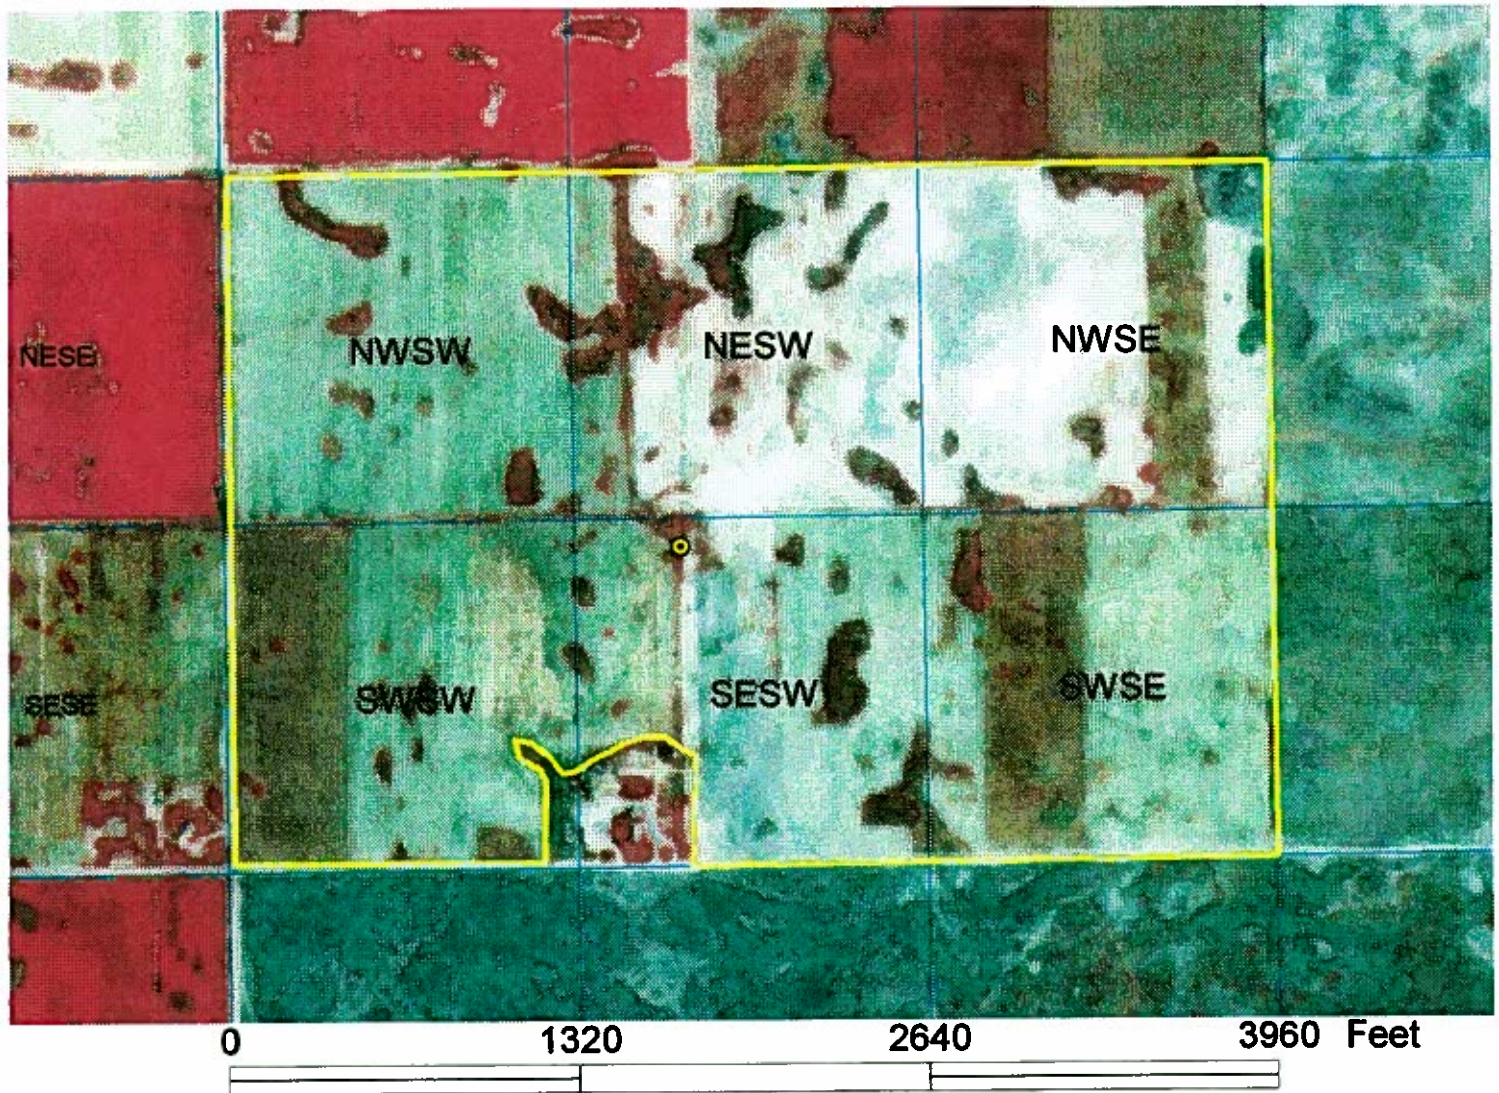

Point of Diversion
Location



Place of Use
Boundary




Section Lines



Quarter/Quarter Lines

Township(s) 05S, Range(s) 30E
Section(s) 23



GIS Place of Use Illustration
1987/1988 NAPP Photography
Prepared by: Greg Taylor
Date: Sept. 28, 1998

Water Right Number - R35-07135

Prefix Translation: RESEARCH

Old (D) Number -

*** C - CURRENT OWNER ***
FENRINGER
CLARENCE T
1 - 3168 WEST 1600 SOUTH
2 -
3 -
City- ABERDEEN
Phone - 208-397-4266
State- ID Zip- 83210

Priority Date - 04/29/1970
Region - 15 EASTERN
Stage - L - LICENSE
Status -

Source - GROUNDWATER
Tributary -

Turn Rng Sec Tract Lot RFlg County Point of Diversion
05S 30E 23 NW SE SW (11) BINGHAM

Code Description Period From Period To Water Use Diversion Rate Diversion Volume
01 - IRRIGATION 04/01 10/5T 3.900 928.00

Total Div. Rate - 3.900
Total Div. Volume - 928.00
Total Consumptive Use - 928.00
KW Usage -

Turn	Rng	Sec	Tract	Lot	Acres	Place of Use	Code	Description	County
05S	30E	23	NE SW		40.0	01	IRRIGATION	(11) BINGHAM	
05S	30E	23	NW SW		39.0	01	IRRIGATION	(11) BINGHAM	
05S	30E	23	SW SW		37.0	01	IRRIGATION	(11) BINGHAM	
05S	30E	23	SE SW		36.0	01	IRRIGATION	(11) BINGHAM	
05S	30E	23	NW SE		40.0	01	IRRIGATION	(11) BINGHAM	
05S	30E	23	SW SE		40.0	01	IRRIGATION	(11) BINGHAM	

Total Acres: 232.0

- - - - - Diversion Means - WELL 250', 16" CASING, 150 HP PUMP, WHEEL LINES (10)

- - - - - Non-Irrigation Use -

- - - - - Other Rights for Same Use - NONE

- - - - - Remarks -
No Remarks found.

Water right number - R35-07135

Prefix Translation: RESEARCH

+ - - - - - Old Water Right Numbers - - - - - +
+ - - - - - No Old Water Right Numbers Found - - - - - +

+ - - - - - Conditions of Approval - - - - - +
No Conditions of Approval found.

+ - - - - - Decree Plaintiff - - - + - - - - - Decree Defendant - - - + - - - - - Decree Date - - +
00/00/0000

+ - - - - - Comments - - - - - +
No Comments Found

+ - - - - - Audit Fields - - +
11/03/92 DCARLSON

+ - - - - - Adjudication Rights Dates and Flags Area - - - - - +
Court Report Filing - 00/00/0000 Field Inspection Made - 11/03/1992 Civil Case Number - 39576
Objection Filed Date - 00/00/0000 Verified Date - 11/03/1992 Old Case Number -
Response Filed Date - 00/00/0000 Last Amended Date - 00/00/0000 Temporary Right - P
Claim Received Date - 05/03/1989 Receipt Number - M003344 Water District -
POU Ownership Flag - Y Federal/State Indicator - S
Name Connector - Presumption Flag -
Notice of Error Flag -

AST: FENRINGER
ADDRESS: 3168 WEST 1600 SOUTH
CITY: ABERDEEN
PHONE NUMBER: 208-897-4266

FIRST: CLARENCE T.

STATE: ID ZIP: 85210

OWNER CODE: C

FIELD EXAM REQUIRED?

DATABASE FIELD EXAMINER
N

AD REMARKS IN CLAIM

FIELD EXAMINATION INFORMATION

CONTACT PERSON:

11.3.92

DATE OF FIELD EXAM:

APPOINTMENT MADE: V () N (X)

PHONE NUMBER: () - - -
TIME: - : - A () P ()
PHONE NUMBER: () - - -

ACCOMPANIED BY:

RELATIONSHIP TO CLAIMANT:

DIRECTIONS TO PROPERTY / REMARKS:

Offie Levin

CLAIM NUMBER: A35-07135

A. AJ CLAIM: # A35-07135

PRIORITY DATE: 06-29-1970

STAGE 1

B. MR RECORD: # 35-07135

PRIORITY DATE: 06-29-1970

STAGE: 1

∴ FIELD EXAM REQUIRED?

DUE TO PRIORITY DATE DISCREPANCY? (Y/N)

DATABASE **EXAMPLE**

ARE THERE OBVIOUS REASONS TO QUESTION THE PRIORITY DATE CLAIMED? ☐ YES ☒ NO
IF YES EXPLAIN.

ZEKRAK 5:

RECOMMENDED PRIORITY DATE:

04-29-1970

REVIEWED BY

DATE

1. AJ CLAIM POINT OF DIVERSION AND SOURCE:

RIGHT	TWP.	RGE.	SEC.	1/4	1/4	1/4	LOT	CNTY
A35-07135	03S	30E	23	NW	SE	SW		BINGHAM

OTHER AJ CLAIMS WITH SAME AJ POD
A PREFIX R PREFIX
NONE NONE
WR RECORDS IN SAME 40 ACRE TRACT
NONE

SOURCE: GROUNDWATER

TRIG:

2. WR POINT OF DIVERSION AND SOURCE:

RIGHT	TWP.	RGE.	SEC.	1/4	1/4	1/4	LOT	CNTY
A35-07135	03S	30E	23	SE	SW			BINGHAM

OTHER WR RECORDS WITH SAME WR POD
AJ CLAIMS IN SAME 40 ACRE TRACT
A PREFIX R PREFIX
NONE A35-10805 NONE

SOURCE: GROUNDWATER

TRIG:

3. FIELD EXAM REQUIRED?

DUE TO POD DISCREPANCY?	(Y/N)	DATABASE	FIELD EXAMINER
DUE TO SOURCE DISCREPANCY?	(Y/N)	Y	---
		N	---

Pod is ok

REMARKS:

RECOMMENDED POINT(S) OF DIVERSION AND SOURCE:	
TYPE	RCE. SEC.
1/4	1/4

SOURCE: GROUNDWATER

TRID:

RECEIVED BY:

DATE:

$$\frac{11}{3} \frac{1}{92}$$

A. ROOT WATER RIGHT NUMBERS: A35-07135

B. POB LISTING

TWP	RNG	SEC	1/4	1/4	LOT	NAME	AJ #/ACRES	NR #/ACRES	LANDSAT DATA	FIELD EXAM.	RECOMM. ACRES
035	30E	23	NE	SW		FERRINGER, CLARENCE T.	A35-07135 740.0	35-07135 740.0	37.0	40	
035	30E	23	NW	SW		FERRINGER, CLARENCE T.	A35-07135 739.0	35-07135 739.0	40.0	39	
035	30E	23	SW	SW		FERRINGER, CLARENCE T.	A35-07135 737.0	35-07135 737.0	37.0	37	
035	30E	23	SE	SW		FERRINGER, CLARENCE T.	A35-07135 736.0	35-07135 736.0	36.0	36	
035	30E	23	SE	SW		FERRINGER, CLARENCE T.	A35-10805 /	-			
035	30E	23	NW	SE		FERRINGER, CLARENCE T.	A35-07135 740.0	35-07135 740.0	39.0	40	
035	30E	23	SW	SE		FERRINGER, CLARENCE T.	A35-07135 740.0	35-07135 740.0	40.0	40	
TOTAL ACRES							A35-07135 232.00	232.00	232.00		

ARE IRRIGATED ACRES FOUND IN TRACTS OTHER THAN INDICATED ABOVE, Y () N (X)

(X)

(X)

C. FIELD EXAM REQUIRED?

DUE TO POB DISCREPANCY? (Y/N)

DATABASE N FIELD EXAMINER

PRESCRIPTION FLAG:

REMARKS:

RECOMMENDATIONS:

TOTAL ACRES: 232
REVIEWED BY: DC
DATE: 11/3/92

1. AS CLAIMED USES:

PURPOSES
A35-07135 IRRIGATION

MONTH/DAY
FROM 04-01 TO 11-01 10/31

DIVERSION QUANTITY
3.900 CFS

TOTAL DIVERSION RATE/VOLUME CLAIMED

3.900 CFS

2. WR RECORDED USES:

PURPOSES
35-07135 IRRIGATION

MONTH/DAY
FROM 04-01 TO 11-01

DIVERSION QUANTITY
3.900 CFS 812.00 AF/A

TOTAL DIVERSION RATE/VOLUME CLAIMED

3.900 CFS 812.00 AF/A

RESUMPTION FLAG:

3. FIELD EXAM REQUIRED?

DUE TO WATER-USE DISCREPANCY? (Y/N) FIELD
DUE TO DIVERSION RATE DISCREPANCY? (Y/N) DATABASE EXAMINER
DUE TO PERIOD FROM/TO DISCREPANCY? (Y/N) N N 12

4. PERIOD OF USE:

RECOMMEND AS CLAIMED?

RECOMMEND TO WR STANDARDS OR OTHER?

REMARKS:

Y (X) N (X)
Y (X) N () EXPLAIN IN REMARKS, BELOW.

1. DOES DIVERSION RATE CLAIMED AGREE WITH EXISTING RECORDS?

AJ TOTAL CLAIMED DIVERSION RATE: 3.900 CFS
NR ROOT RIGHT TOTAL DIVERSION RATE: 3.900 CFS

Y(☒) N(☐)

IF NO OR IF STATUTORY CLAIM OR BENEFICIAL USE THEN FLOW MEASUREMENT REQUIRED.

IF AN AMOUNT SMALLER THAN THE ORIGINAL DIVERSION RATE IS ##
CLAIMED AND AN EXAM IS NOT REQUIRED, EXPLAIN IN REMARKS.

FLOW MEASUREMENT REQUIRED?

DUE TO STAGE OR DIVERSION RATE DISCREPANCY? (Y/N)

FIELD DATABASE EXAMINER
N

3.

FLOW MEASUREMENT

MEASUREMENT METHOD _____, SEE ATTACHED CALCULATIONS.

4. ARE OTHER WATER RIGHTS USED? Y(☐) N(☐) IF YES COMPLETE OVERLAP REVIEW.

OTHER RIGHTS LISTED IN CLAIM: NONE

NO CLAIMS FOUND WITH SAME POU AND IRRIGATION USAGE

LIST ALL RIGHTS WITH SAME POU BUT NOT USED FOR IRRIGATION.

CLAIM NO.	PURPOSES	NAME	MONTH/DAY	RATE	VOLUME
A35-10805	DOMESTIC	FERRINGER, CLARENCE T.	FROM 01-01 TO 12-31	0.040 CFS	
A35-10805	STOCKWATER	FERRINGER, CLARENCE T.	FROM 01-01 TO 12-31	0.030 CFS	

1. RATE/VOLUME CALCULATIONS: (IRRIGATION)

1A. IRRIGATION RATE
ACRES _____ X 0.02 CFS/ACRE = _____ CFS
(TAKEN FROM P/R REVIEW)

1B. CALCULATIONS

DOES AMOUNT CLAIMED EXCEED 0.02 CFS/ACRE? Y() N()

*** IF YES ADDITIONAL WATER USE FORM FILLED AND ATTACHED? Y() N() ***

2. IRRIGATION CONSUMPTIVE USE

CLAIMED CONSUMPTIVE USE = 720.0 AF/A

ACRES 232 X CONSUMPTIVE VOL. AF/A FOR AREA 3 =

TOTAL CONSUMPTIVE USE 696 AF/A

3. IRRIGATION DIVERSION VOLUME

CLAIMED DIVERSION VOLUME = _____ AF/A

ACRES 232 X DIVERSION VOL. AF/A FOR AREA 4 =

TOTAL DIVERSION VOLUME 928 AF/A

4. CALCULATIONS FOR USES OTHER THAN IRRIGATION:

SEE ATTACHED SHEET? Y() N()

REMARKS: (INCLUDE LIMITATIONS ON CONSUMPTIVE USE FOR COMBINED RIGHTS.)

RECOMMENDATIONS:

REC. PURPOSES	REC. PERIOD		REC. DIV RATE CFS	REC. DIV VOL. AF/A	REC. CONS. USE
	FROM	TO			
IRRIGATION	04-01	01-01	3.900	918	790.0
TOTAL FOR THIS RIGHT	0531		3.900		696

REVIEWED BY: IX DATE: 11/3/92

4. CHECK ONLY THE FOLLOWING THAT APPLY:

ACCEPTED
AS CLAIMED

NEEDS
REVIEW

MEMBERSHIP
CORRECT/ABANDON
ADDITIONAL DIV. AMOUNT

5. SPLIT WATER RIGHT REVIEW

ROOT WATER RIGHT NUMBER: 35-07135
TOTAL DIVERSION RATE OF WR SPLITS

DATABASE
3.900

EXAMINER

CFS

SPLITS:

OLD RIGHT NUMBERS	CURRENT CLAIM NUMBERS	DIVERSION RATE	CURRENT "R" CLAIM NUM.	"R" DIV. RATE	WR RIGHT NUMBERS	DIVERSION RATE
-	A35-07135	3.900	-	-	35-07135	3.900
TOTAL CFS						3.900

DIVERSION RATE REVIEW

DO THE SUM CFS RATE OF THE SPLITS EQUAL THE ROOT RIGHT CFS RATE? (Y/N)
IF NO, IS THE WRITTEN REVIEW SHEET ATTACHED? (Y/N)

DATABASE
Y

FIELD
EXAMINER

REMARKS:

NOTIFICATION:

SIGNATURE:

NAME OF FIELD EXAMINER:

DATE: 11/3/92

TITLE: WFA

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
ADJUDICATION CLAIM VERIFICATION REPORT

CLAIM NUMBER: A35-07135

13:45:20
10/30/91

NR ELEMENT	FIELD EXAM Y/N	CORRESPONDENCE SENT/RECEIVED BY WHOM/DATE	FIELD EXAM BY WHOM/DATE	CHANGE CLAIM Y/N	VERIFIED BY CODE	COMPLETED REVIEW WHOM/DATE	COMPLETED DATA ENTRY WHOM/DATE	VERIFIED DATE WHOM/DATE
PROPERTY DATE								
POINT OF DIV	Y		<i>W. W. W.</i>	No				
SUBJECT								
PLACE OF USE				No				
TYPE, AMOUNT CFS/VOLUME								
ON SUPPLIERS USE								
PURPOSES								
PERIOD OF USE								
ASSETS OF CLAIM				Yes				
REMARKS								

"VERIFIED BY" CODES

- TOPO MAP/ORTHO-PQ = 1
- ASCS MAP = 2
- MASTER RECORDS = 3
- NAPP PHOTOS = 4
- FIELD EXAM = 5
- OTHER (SEE REMARKS) = 6

THESE CODES ARE USED TO INDICATE HOW THE FIELD EXAMINER VERIFIED THE INFORMATION
USED FOR THIS FIELD EXAMINATION. INDICATED ARE ALL CODES WHICH APPLY.

ans Felled
bowed

Duffin Rd.

3200 W

HEL
2
45.1

HEL
9
32.7

HEL
10
73.2

HEL
3
55.1

HEL
7
18.6


HEL
8
20.0

Jensen Rd.

3700 W

Finsen Rd.

1600 S

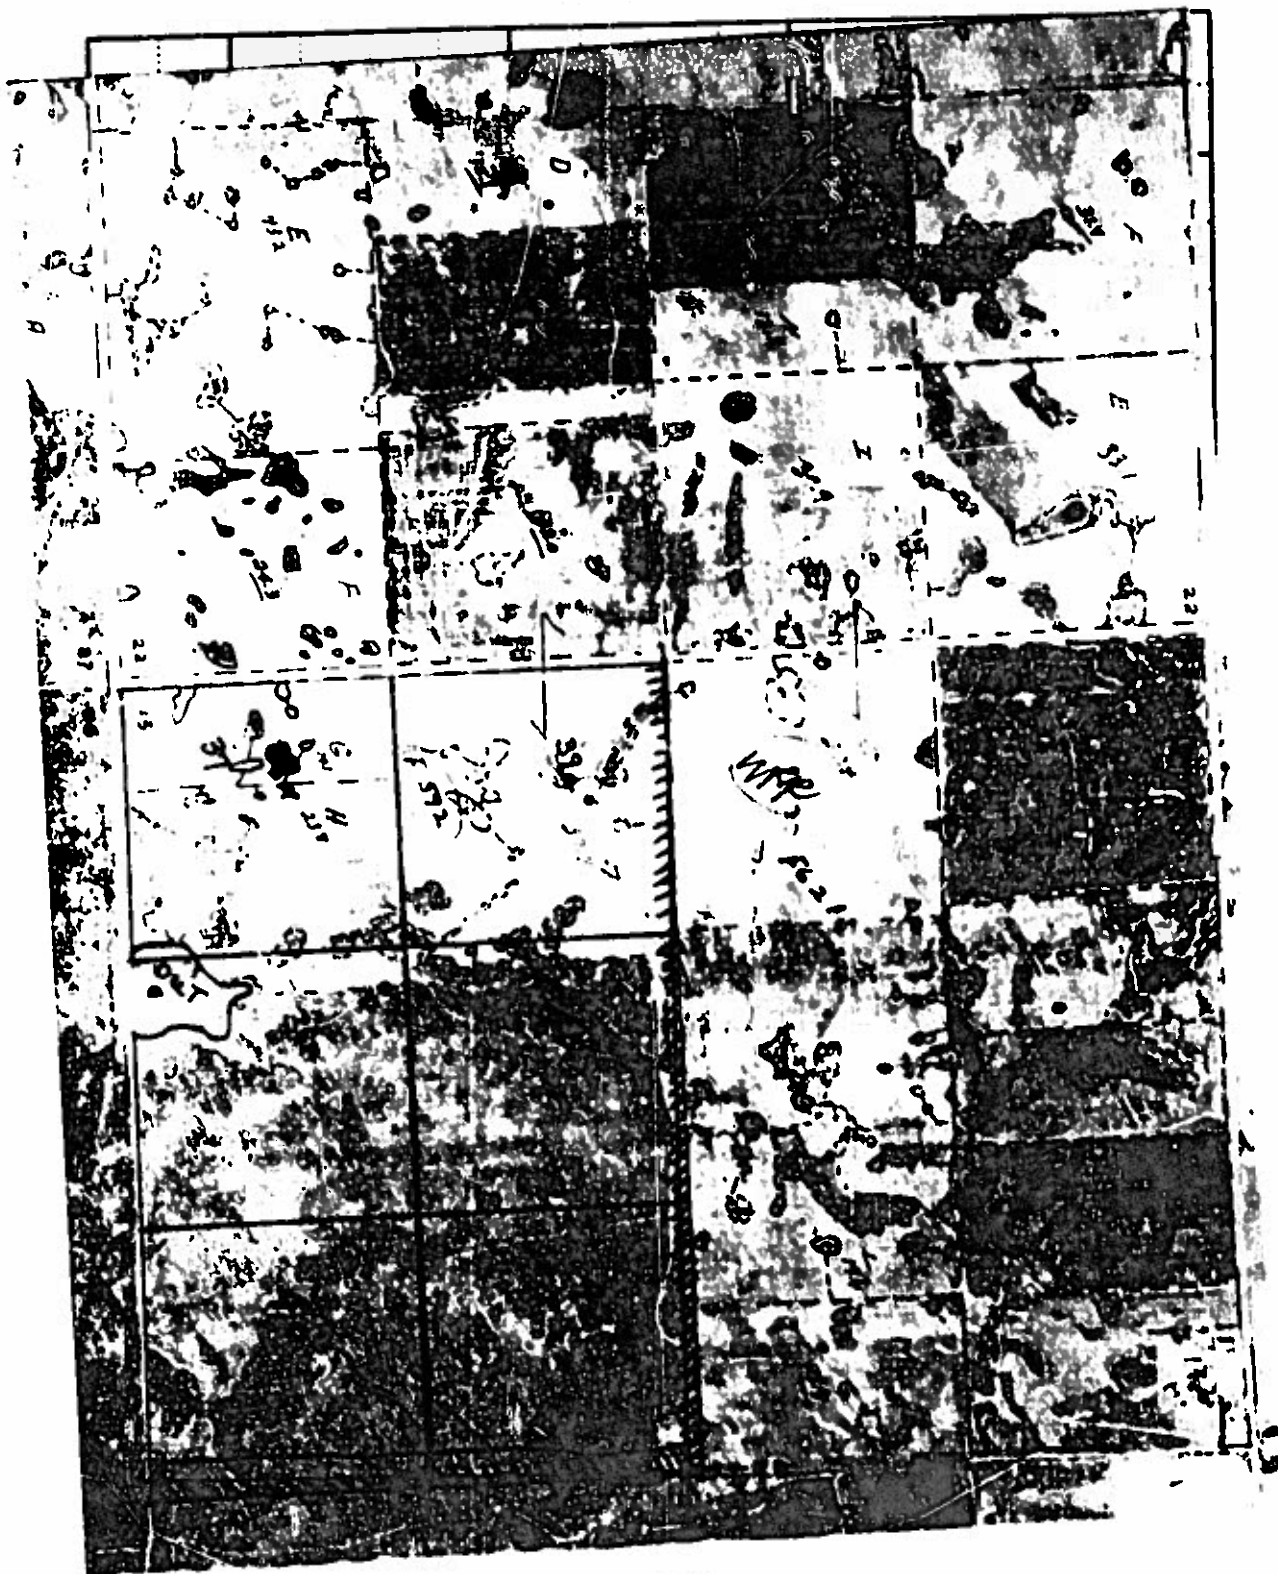

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE STATE OF IDAHO,
IN AND FOR THE COUNTY OF TWIN FALLS

IN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM.

CIVIL CASE NUMBER: 39576

Ident. Number: A35-07135
Date Received: 5/03/1989
Receipt No: 12023344
Received By: AB

NOTICE OF CLAIM TO A WATER RIGHT
ACQUIRED UNDER STATE LAW

1. Name: CLARENCE T. FEHRINGER
Address: 3168 WEST 1600 SOUTH
ABERDEEN, ID

208-397-4266

83210

2. Date of Priority: APR 29, 1970

3. Source: GROUNDWATER

Trib. to:

4. Point of Diversion:

Township	Range	Section	1/4 of	1/4 of	1/4 of	Lot	County
05S	30E	23	NW	SE	SW		BINGHAM

5. Description of diverting works:

WELL 250', 16" CASING, 150 HP PUMP, WHEEL LINES (10)

6. Water is used for the following purposes:

Purpose	From	To	C.F.S.	(or)	A.F.A.
IRRIGATION	04/01	11/01	3.900		

7. Total Quantity Appropriated is:
3.900 C.F.S. (and/or)

A.F.A.

8. Total consumptive use is 720.0 Acre Feet Per Annum.

9. Non-irrigation uses:

10. Place of Use:

Township	Range	Section	1/4 of	1/4 of	Lot	Use	Acres
05S	30E	23	NE	SW		IRR	40.0
			NW	SW		IRR	39.0
			SW	SW		IRR	37.0
			SE	SW		IRR	36.0

A35-07135

Page 1

Date: 05/03/89

A3507135



MICROFILMED

DEC 10 1992

10. Place of Use: Continued

Township	Range	Section	1/4 of	1/4	Lot	Use	Acres
05S	30E	23	NW	SE		IRR	40.0
			SW	SE		IRR	40.0
						Section Acres	232.0
						Total Acres	232.0

11. Place of use in counties: BINGHAM

12. Do you own the property listed above as place of use? YES

13. Other Water Rights Used:
NONE

14. Remarks:

15. Basis of Claim: LICENSE

16. Signature(s)

(a.) By signing below, I/We acknowledge that I/We have received, read and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not x wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments: 1

For Individuals:

I/We do solemnly swear or affirm that the statements contained in the foregoing document are true and correct.

Signature of Claimant(s): Clarence T. Lehninger Date: 5-3-89


Date: _____

State of Idaho)
County of Bingham) SS.

Subscribed and sworn (or affirmed) before me this 3rd day
of May 19 89 Anna Bauman
Notary Public

Seal

Residing at Boise Idaho
My Commission Expires 12/7 1994

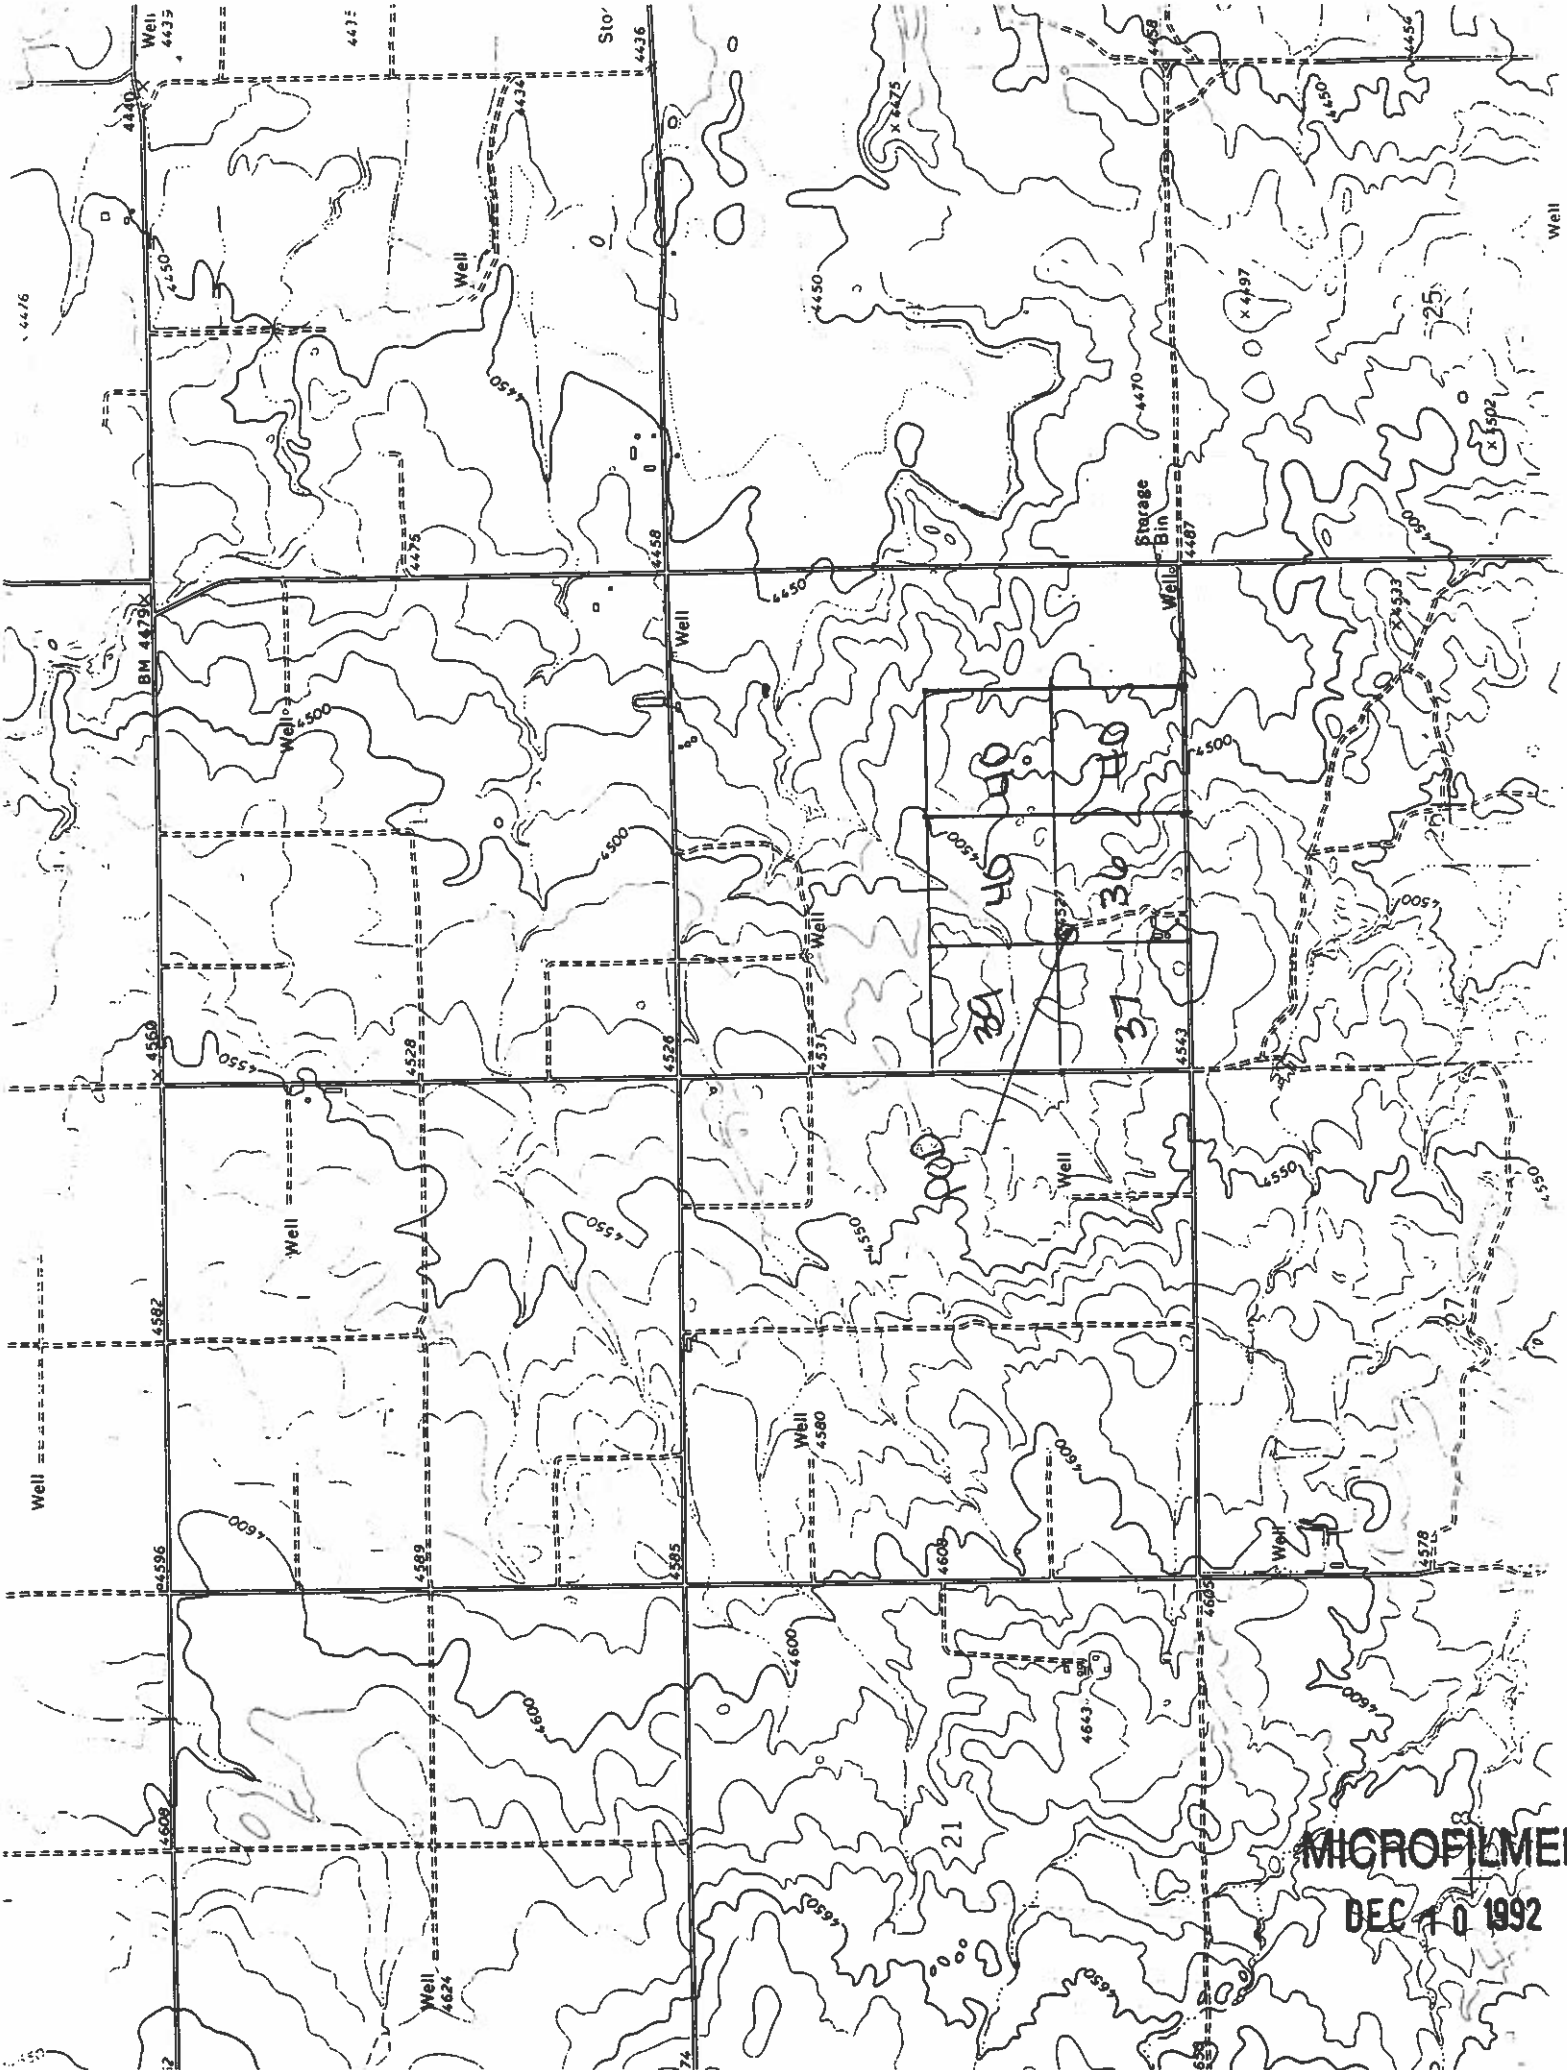

MICROFILMED
DEC 10 1992

45-7135

A dark, high-contrast image of a grid, possibly a ledger or a data table, with a diagonal line running across it. The grid is composed of many small squares, and the diagonal line is prominent, suggesting a path or a sequence of data points. The image is heavily degraded with noise and scratches.

1991-1992



1255)

DATE OF EXAM Aug 31, 1972

ACREAGE
Found 232
Recommended 232

Irrigation Requirement 3.5 Ac Ft/Ac

USE
Irrigation Q = 364 c.f.s. V = 812 AFI Ann. from April 1 to Nov 1
Domestic Q = c.f.s. V = AFI Ann. from to
Livestock Q = c.f.s. V = AFI Ann. from to

Is water co-mingled? yes no ✓

Name source NA
twp. N/S, Rge E/W, B.M., Sec Sub V₄ V₄ County

Exchange? yes no ✓

Name source exchanged with: NA
twp. N/S, Rge E/W, B.M., Sec Sub V₄ V₄ County

Point of injection:
twp. N/S, Rge NA E/W, B.M., Sec Sub V₄ V₄ County

Point of exchange:
twp. N/S, Rge NA E/W, B.M., Sec Sub V₄ V₄ County

Total Q measured 3.7 Method of measurement McCracker

Total Q recommended 3.7 Meter No 72-10338 Type MC100 Condition New

Total V recommended 812 AFI Ann

Recommended Amendments.

P.D.
Place of Use
Other
None

MEASUREMENT CALCULATION:
1750 gpm = 3.7 cfs
3.7 x 4.2 = 16.61 A-c-ft/acre = 8.12

SYSTEM DESCRIPTION:
GE TRI-CLAD Pump Motor 150 Hp Ser # CFJ326137
Layne & Bowler Vert. Line 1650 gpm 316' P/K/ft
SPRINKLER SYSTEM

REMARKS: System & land shown by Mr. Fehring

Examiner's Signature William Rhoads Date Sept 5, 1972

Checked by Norman C. Young, P.E. Date 12-9-72

Approved by Date