

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE STATE OF IDAHO,
IN AND FOR THE COUNTY OF TWIN FALLS

IN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM.

CIVIL CASE NUMBER: 39576

Ident. Number: A43-07094
Date Received: 3/16/1989
Receipt No: S006574
Received By: SCC

NOTICE OF CLAIM TO A WATER RIGHT
ACQUIRED UNDER STATE LAW

1. Name: EDWARD GOODRICH 208-638-5545
Address: HC 61 BOX 1260
MALTA, ID 83342

OR
Name: PATSY GOODRICH 208-638-5545
Address: HC 61 BOX 1260
MALTA, ID 83342

2. Date of Priority: JUL 22, 1977

3. Source: GROUNDWATER Trib. to:

4. Point of Diversion:

Township	Range	Section	1/4 of	1/4 of	1/4	Lot	County
13S	25E	23	NW	NW	NE		CASSIA

5. Description of diverting works:
WELL, PUMP & SPRINKLERS.

6. Water is used for the following purposes:

Purpose	From	To	C.F.S	(or)	A.F.A.
IRRIGATION	03/15	11/15	0.100		15.00

7. Total Quantity Appropriated is:
0.100 C.F.S. (and/or) 15.00 A.F.A.

8. Total consumptive use is 15.0 Acre Feet Per Annum.

9. Non-irrigation uses:

A43-07094

Page 1

Date: 03/16/89

MICROFILMED

MAR 04 1993

10. Place of Use:

Township	Range	Section	1/4 of	1/4	Lot	Use	Acres
13S	25E	23	NW	NE		IRR	5.0
						Section Acres	5.0
						Total Acres	5.0

11. Place of use in counties: CASSIA

12. Do you own the property listed above as place of use? YES

13. Other Water Rights Used:
A43-07099A

14. Remarks:
TWO WELLS ARE USED AT P/D ONE IS FOR BACK-UP.

15. Basis of Claim: LICENSE

16. Signature(s)

(a.) By signing below, I/We acknowledge that I/We have received, read and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not _____ wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments: _____

For Individuals:

I/We do solemnly swear or affirm that the statements contained in the foregoing document are true and correct.

Signature of Claimant(s): Edward E. Goodman Date: 3-16-89

Date: _____


State of Idaho)
County of Twin Falls) SS.

Subscribed and sworn (or affirmed) before me this 16th day
of March 19 89

Stim C. Allen
Notary Public

Seal

Residing at Twin Falls
My Commission Expires Dec 7, 1994

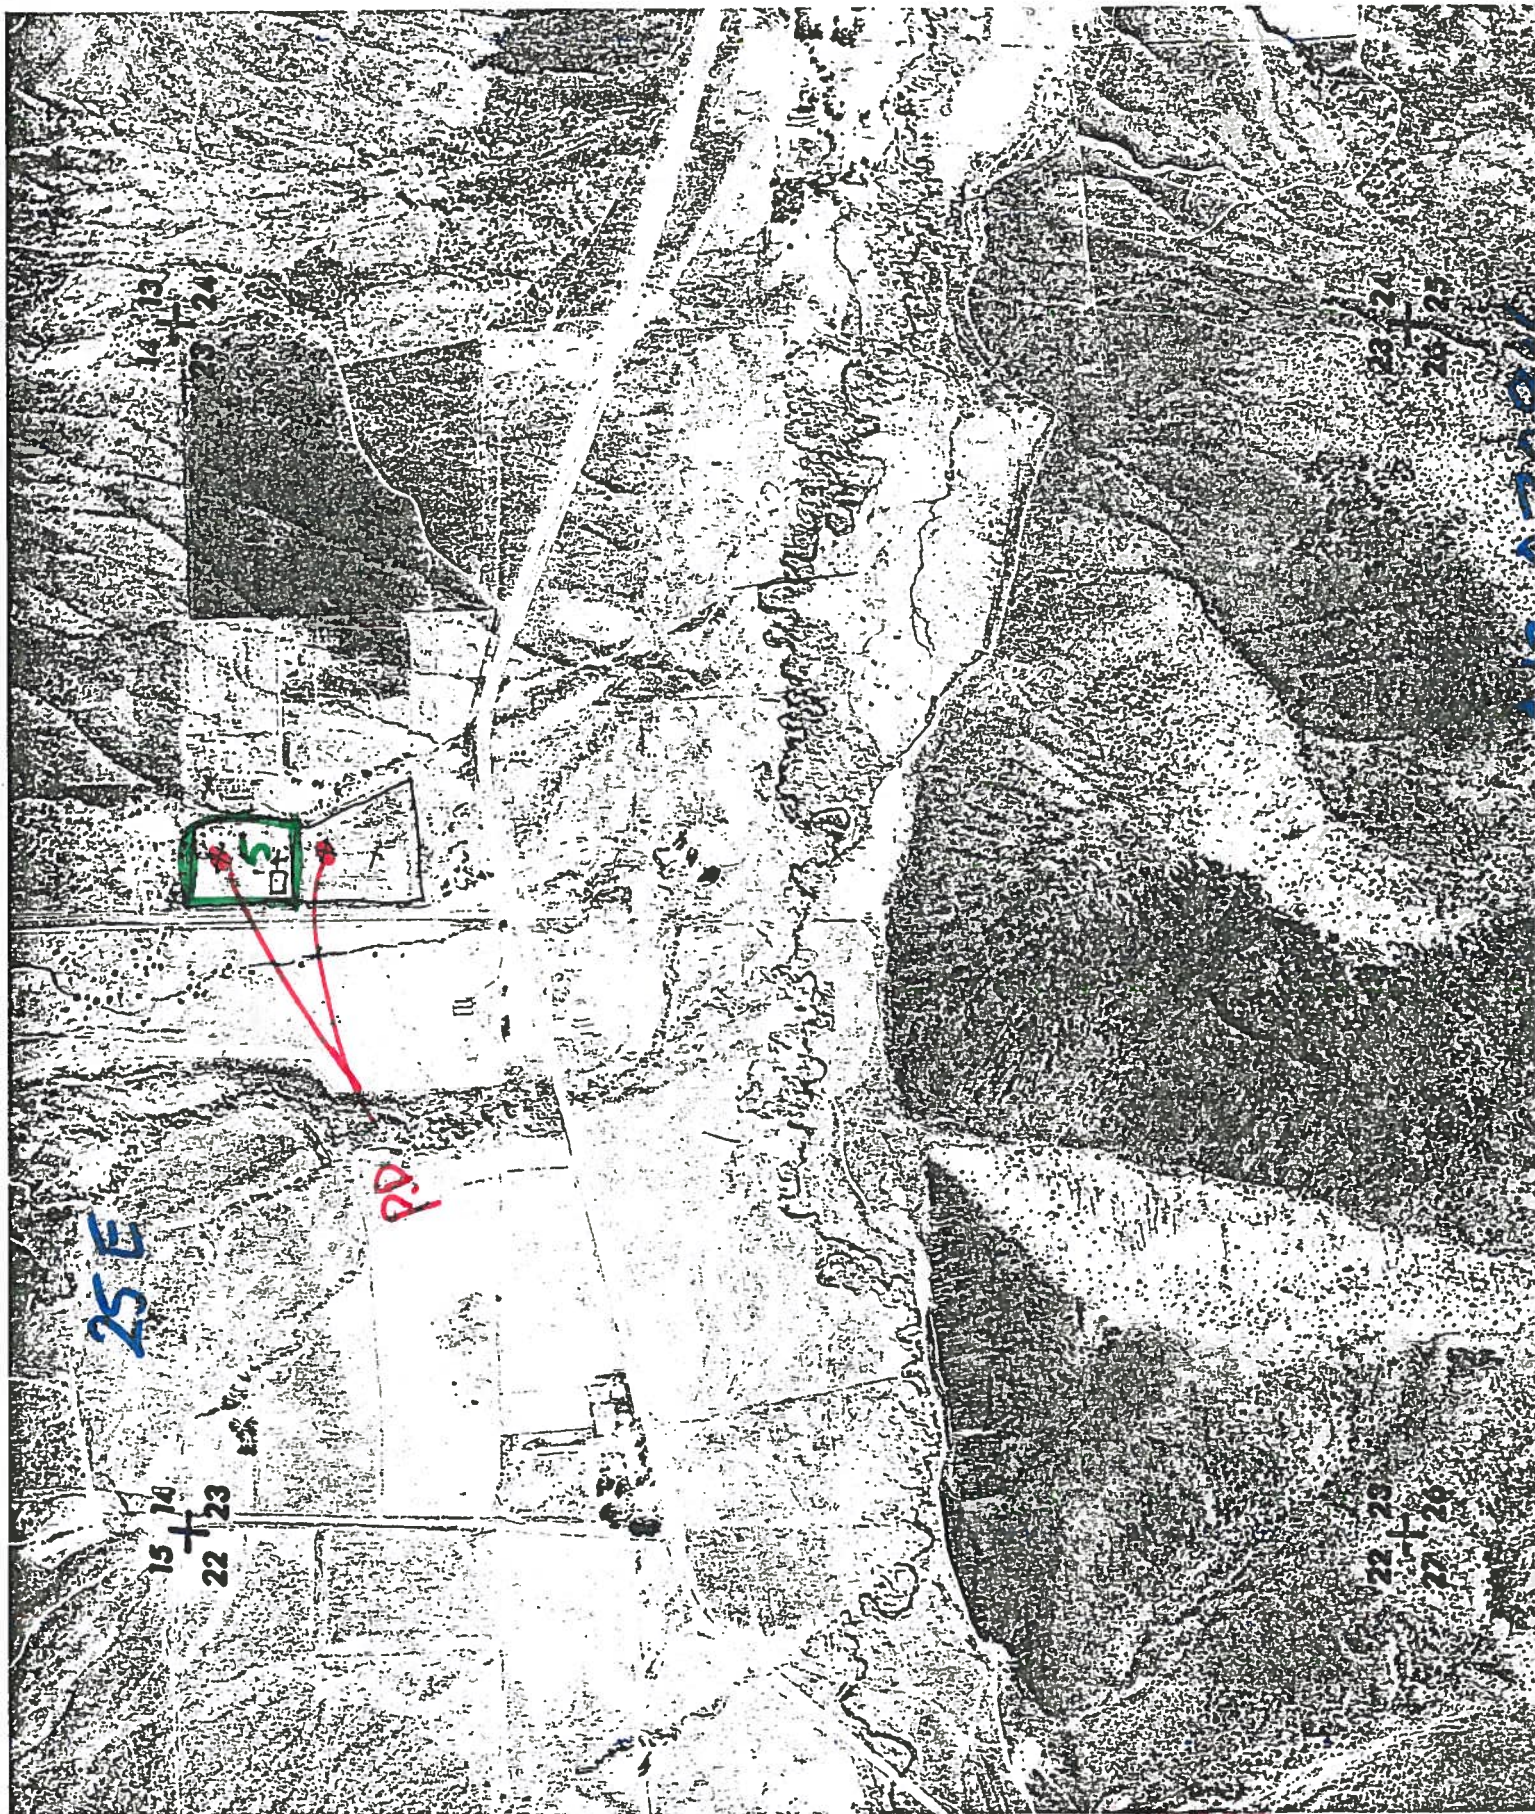

135

MICROFILMED
MAR 04 1993

Water Right Number - 43-07094

Prefix Translation:

WATER RIGHT

Old (D) Number -

+ - - - - Last Name - - - - + + - First Name - - + + - - - - - Address - - - - -
 *** C - CURRENT OWNER ***
 WARD, JR.

GEORGE O.

1 - 710 WEST 20TH ST.

2 -

3 -

City- BURLEY

State- ID Zip- 83318

Phone -

+ - - Priority Date - - + + - - - Region - - - + + - - - Stage - - - + + - - - Status - - - +
 07/22/1977 17 SOUTHERN L - LICENSE

+ - - - - Source - - - - - + + - - - - Tributary - - - - -
 GROUNDWATER

Twn	Rng	Sec	Tract	Lot	Rflg	County	Point of Diversion	Stream Index (Blank if no Index Code)
13S	25E	23	NW NE			(31)	CASSIA	

Code	Description	Period From	Period To	Water Use	Diversion Rate	Diversion Volume
01	IRRIGATION	03/15	11/15		0.100	15.00

+ - Total Div. Rate - + + - Total Div. Volume - + + - Total Div. Capacity - +
 0.100 15.00

Twn	Rng	Sec	Tract	Lot	Acres	Code	Description	County
13S	25E	23	NW NE		5.0	01	IRRIGATION	(31) CASSIA

Total Acres: 5.0

+ - - Diversion Means - WELL, PUMP & SPRINKLERS.

+ - - Non-Irrigation Use -

+ - - Other Rights for Same Use -

+ - - - - Remarks - - - - -
 No Remarks found.

+ - - - - Old Water Right Numbers - - - - -
 No Old Water Right Numbers found.

+ - - - - Conditions of Approval - - - - -
 No Conditions of Approval found.

+ - - - - Decree Plaintiff - - - - + + - - - - Decree Defendant - - - - + + - Decree Date - +
 00/00/0000

MICROFILMED
 MAR 04 1993

WATER RIGHT

No Comments Found

+ - - - - - Water Rights Dates and Flags Area

Proof Due Date	- 09/01/1983	Field Exam Made	- 00/00/0000	Field Exam Fee	-
Approved/Denied	- 08/02/1978	Protested Date	- 00/00/0000	Swan Falls	-
Proof Made Date	- 01/01/1900	Hearing Date	- 00/00/0000	Temporary Right	-
Exam to S.O. Date	- 00/00/0000	Verified Date	- 01/28/1985	DLE/Carrey Act	-
Order Show Cause	- 00/00/0000	Receipt Number	-	Water District	-
Licensed Date	- 04/19/1982	Appl Received	- 00/00/0000	Transfer/Amended	-
Decree Date	- 00/00/0000	Presumption Flag	-		

MAR 04 1993

05/09/2001

**NOTICE OF ERROR
REPLY**

Please type or print clearly, fill out this form completely and mail.

Return this reply form to IDWR by the deadline date printed below if you want IDWR to change your recommendation or you want to let IDWR know that you agree with its recommendation.

YOUR DEADLINE FOR RETURNING A NOTICE OF ERROR REPLY IS: June 15, 2001

Water right number: 43-7094

PATSY ANN GOODRICH

HC 61 BOX 1260

MALTA ID 83342

Telephone Number: (208)638-5545

EDWARD GOODRICH

HC 61 BOX 1260

MALTA ID 83342

Telephone Number: (208)638-5545

1. Describe the portion of the proposed recommendation with which you disagree (e.g. priority date, period of use, source):

2. Describe the changes you wish to make in the proposed recommendation:

3. Give a brief explanation as to why you disagree with these portions:

 I AGREE with this proposed recommendation: no changes need to be made.

DATE: 5-30-01

SIGNATURE: 

Please print your name: Edward Goodrich

IDWR Regional Office, 1341 Fillmore St, Suite 200, Twin Falls, ID 83301, 2087363033

10/26/2000

IDAHO DEPARTMENT OF WATER RESOURCES
PRELIMINARY RECOMMENDATION OF WATER RIGHTS ACQUIRED UNDER STATE LAW

RIGHT NUMBER: 43-7094

NAME AND ADDRESS: EDWARD GOODRICH
PATSY ANN GOODRICH
HC 61 BOX 1260
MALTA, ID 83342

SOURCE: GROUND WATER

VERIFIED BY KKC
10-26-00

QUANTITY: 0.1 CFS

USE OF THIS RIGHT WITH RIGHT NO. 43-7099A IS LIMITED TO A
TOTAL COMBINED ANNUAL DIVERSION VOLUME OF 33 AF.

PRIORITY DATE: 07/22/1977

POINT OF DIVERSION:	T13S R25E S23	NWNWNE	Within CASSIA County
	T13S R25E S23	NWNWNE	Within CASSIA County

PURPOSE AND
PERIOD OF USE:

<u>PURPOSE OF USE</u>	<u>PERIOD OF USE</u>	<u>QUANTITY</u>
IRRIGATION	03-15 11-15	0.10 CFS

PLACE OF USE:

IRRIGATION Within CASSIA County
T13S R25E S23 NWNE 9.7
9.7 ACRES TOTAL


THIS RIGHT IS LIMITED TO THE IRRIGATION OF 5 ACRES WITHIN
THE PLACE OF USE DESCRIBED ABOVE IN A SINGLE IRRIGATION
SEASON.

OTHER PROVISIONS NECESSARY FOR DEFINITION OR ADMINISTRATION OF THIS WATER RIGHT:

THIS PARTIAL DECREE IS SUBJECT TO SUCH GENERAL PROVISIONS
NECESSARY FOR THE DEFINITION OF THE RIGHTS OR FOR THE
EFFICIENT ADMINISTRATION OF THE WATER RIGHTS AS MAY BE
ULTIMATELY DETERMINED BY THE COURT AT A POINT IN TIME NO LATER
THAN THE ENTRY OF A FINAL UNIFIED DECREE. SECTION 42-1412(6),
IDAHO CODE.

EXPLANATORY MATERIAL: BASIS OF CLAIM - License


Idaho Department of Water Resources
RECOMMENDED PLACE OF USE FOR
43-7094 AND 43-7099A

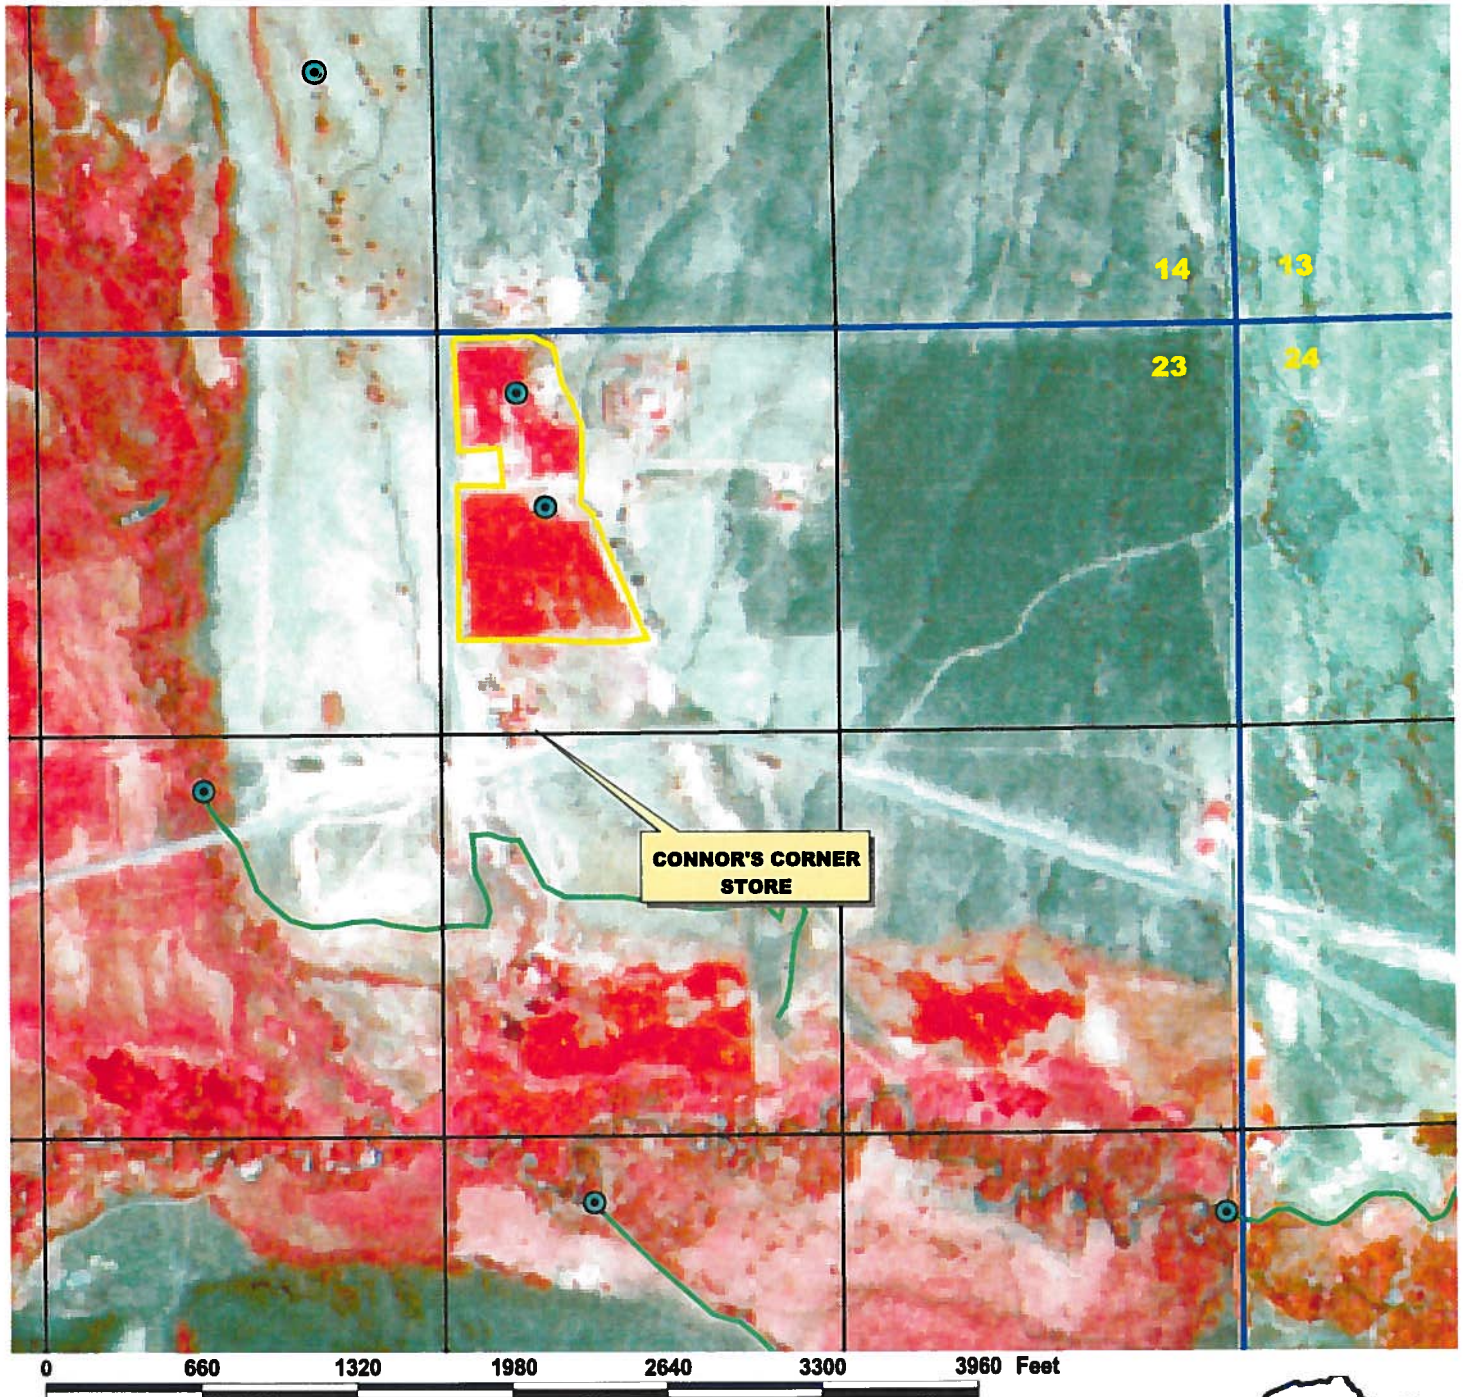

PLACE OF USE
TWP 13S, RNG 25E, SEC 23
Data entry on October 25, 2000

GIS PLACE OF USE PRESENTATION
1987/1988 NAPP AERIAL PHOTOGRAPHY
DATA ENTRY BY KELLY K CHRISTENSEN

-  **RECOMMENDED POINT OF DIVERSION**
-  **RECOMMENDED PLACE OF USE**
-  **SECTION LINES**
-  **QUARTER/QUARTER LINES**

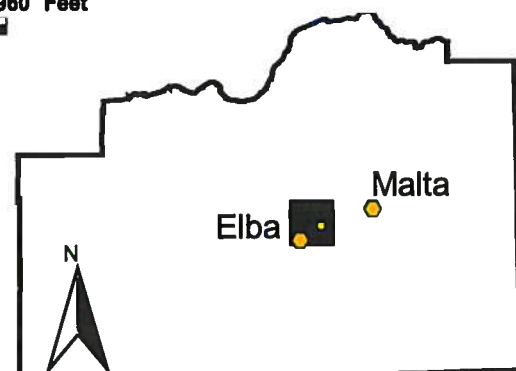

Idaho Dept of Water Resources
Claims review notes and narrative

Date: 10-25-2000

File: 43-7094 7099A GOODRICH SYS ANALYSIS

Prepared by Kelly K Christensen

SYSTEM ANALYSIS FOR 43-7094 AND 43-7099A

Each right was developed and licensed from separate wells. The well licensed under 43-07094 apparently dropped off on production sometime near the mid 1980s. The claims indicate that the two systems were tied together with the well licensed under 43-7099A being the primary source.

I am recommending these rights as a permissible place of use and identifying both wells for each right. Using arcview I found a combined place of use of 9.7 acres. 43-07094 was licensed for 5 acres and 43-7099A was licensed for 6 acres. Using arcview I could find approximately 6 acres in the southern portion of the combined place of use but I could only find approximately 3.7 acres in the north portion. It appears that either the irrigated place of use was reduced or that the license identified a larger place of use than was actually irrigated. I am recommending each right with the original licensing acre limitation within the PP/U even though their total would exceed the PP/U.

43-7094 was licensed for 0.10 cfs and 43-7099A was licensed for 0.08 cfs or a total of 0.18 cfs. This rate is $\approx$ one inch per acre. I am recommending each right at its licensed rate with no combined rate limits. I am, however, recommending a combined volume limit of 15 AF from 43-7094 and 18 AF from 43-7099A for a combined total of 33afa. The licensing exams for the rights indicated that the permits were issued at 3 af per acre rather than the current standard.

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

License of Water Right No. 43-7094 Priority July 22, 1977 Amount 0.10 cfs

THIS IS TO CERTIFY that George O. Ward, Jr.
of Burley, Idaho, has complied with the terms and conditions of Permit
No. 43-7094 issued pursuant to Application for Permit dated July 22, 1977
and has submitted proof to the Department of Water Resources on January 28, 1981
that he has applied water to a beneficial use; an examination by the Department indicates that the works have a
capacity for the diversion of 0.10 cfs of water from a groundwater source
tributary to _____ and that the permit holder has applied to a beneficial use and
established a right to use water as follows:

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
<u>Irrigation</u>	from <u>March 15</u> to <u>November 15</u> at <u>0.10</u> cfs and <u>15.0 acre feet</u>		
	from _____ to _____ at _____ cfs and _____		
	from _____ to _____ at _____ cfs and _____		

(both dates inclusive)

Subject, however, to the condition that no more than 0.10 cfs of water be diverted at any one time, and
that the amount of water so diverted and to which such right is entitled and confirmed is for the purpose
aforementioned and is limited to the amount which can actually be beneficially used and shall not exceed
15.0 acre feet per year, and waters to be diverted within the NW 1/4, Section 23,
Twp. 13S, Rge. 25E in the County of Cassia

Description and location of place of use:

Twp.	Range	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
13S	25E	23	5																5

Total number of acres irrigated 5

NOTE: Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law. This right may be forfeited by five years of non-use.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands or place of use herein described, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho, this 24 day of
December, 1981

Director

State of Idaho
DEPARTMENT OF WATER RESOURCES
FIELD REPORT

43-2079
Permit No.

CONTACT WITH PERMIT HOLDER

	DATE	INITIALS	REMARKS
☒ Appointment letter mailed:	3-6-81	FLF	
☐ Telephone call made: (List Telephone No. used)			
☐ Appointment scheduled for: (Date, time, location)			

EXAMINATION

Date 8-18-81 Accompanied by — Total Q measured 0.10 cfs
 If source is surface water, estimate total flow of source
 Methods of measurement Pressure gauge, bucket Meets Permit requirements? ✓

Measurement calculations:
 Measured 11 lbs at 28 psi = 41 gpm; 3 gal/91 sec = 4.9 gpm + 41 gpm = 45.9 gpm / 448.8 gpm/cfs = 0.10 cfs
 Volume: 3 ac = 3.0 AFA/ac = 9.0 AFA
 SAC 3.0 = 15.0 AFA

WELL/DIVERSION NO.	HP	MOTOR MAKE	MOTOR SERIAL NO.	PUMP MAKE	PUMP SERIAL NO.	MEASURING DEVICE TYPE	CONDITION OF MEAS. DEV.	REMARKS

System Description Well, submersible pump, plastic & rubber lines to Rainbird heads, one line open discharge into ditch for irrigation of fruit trees (will be replaced by sprinklers when trees have developed). Line with automatic shutoff to stock tank.

*Code with map on reverse side. Disregard code if only one.

RECOMMENDED AMOUNTS

USE <u>irrigation</u>	Irrigation requirement =	<u>3.0</u>	AFA/Acre	
	Q (cfs)	<u>0.09</u> ✓	V (afa)	FROM TO
	<u>0.10</u>	<u>15.0</u>	<u>3-15</u>	<u>11-15</u>


Remarks * let at 3.0 AFA on approved permit.

* The owner of the system has been advised that the system is not to be used for any other purpose than the one for which it was approved. The permit holder is responsible for ensuring the proper use of the system.

No Overlapping rights


JRM 11/7/81

MAP (Attach Aerial Photo)

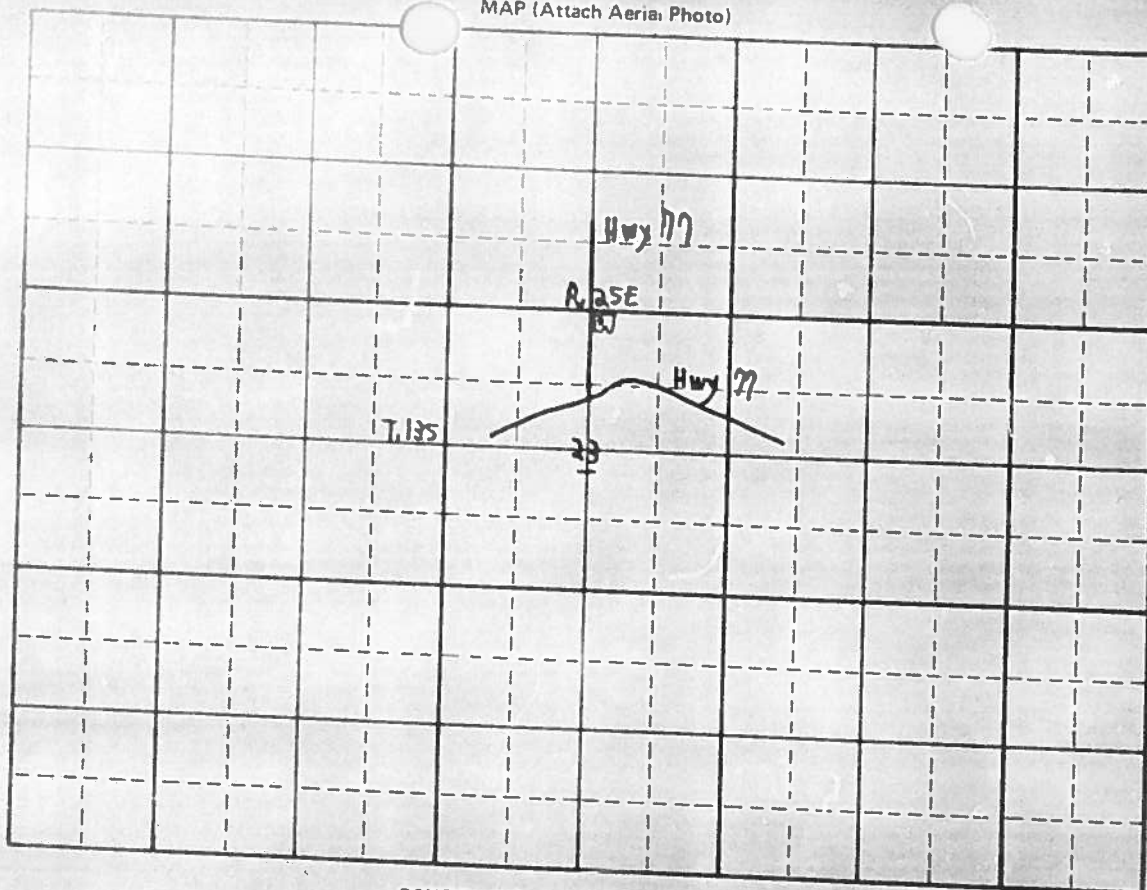

SCHEMATIC DIAGRAM OF SYSTEM

(Include distance from pump to measuring device, if applicable.)



Point(s) of diversion: NW 1/4 NE 1/4 Sec. 23 T. 13S R. 25E

Place(s) of Use:

TWP.	RGE.	SEC.	NEX				NW				SW				SE				TOTALS
			NEX	NW	SW	SE	NEX	NW	SW	SE	NEX	NW	SW	SE	NEX	NW	SW	SE	
13S	25E	23		2															5
				5															5

Recommended Amendments:

- ☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

Examiner's Signature

Checked by

Approved by

J.F. Stanton
John J. Smith
Raymond

Date

Day

Year

8-27-81

10/2/81

11/10/81