


6 should be stock water
T.C.

94-7994 CHRISTENSEN KOOTENAI PARCEL 47N03W-09-4600 (2009)

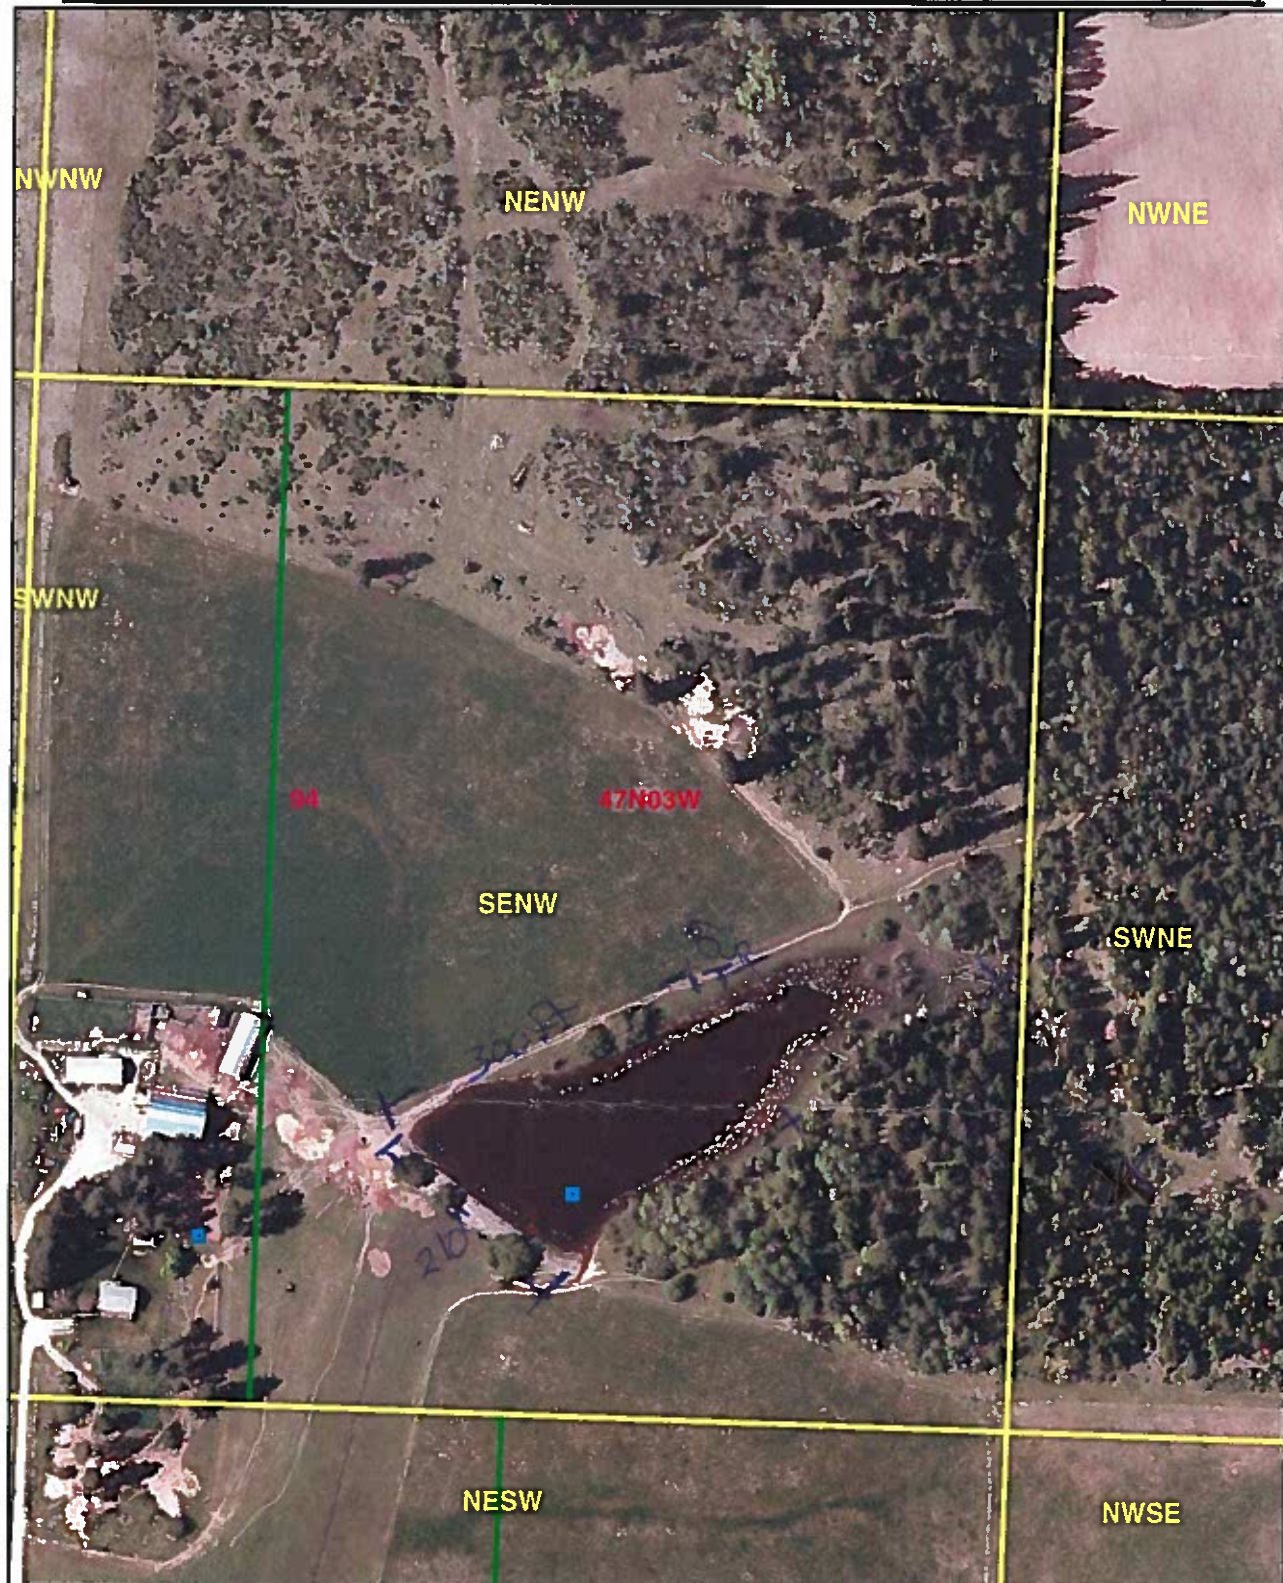

SCANNED

MAR 28 2014