

IN THE DISTRICT COURT OF THE FIFTH JUDICIAL DISTRICT OF THE STATE OF IDAHO,
IN AND FOR THE COUNTY OF TWIN FALLS

IN RE THE GENERAL ADJUDICATION
OF RIGHTS TO THE USE OF WATER FROM
THE SNAKE RIVER BASIN WATER SYSTEM.

CIVIL CASE NUMBER: 39576

Ident. Number: A37-07527

Date Received: 10/18/1989

Receipt No: 1004958

Received By: JRC

NOTICE OF CLAIM TO A WATER RIGHT
ACQUIRED UNDER STATE LAW

1. Name: SIMON FARMS INC. 208-764-2324
Address: P.O. BOX 364
FAIRFIELD, ID 83327

2. Date of Priority: SEP 21, 1976

3. Source: GROUNDWATER Trib. to:

4. Point of Diversion:

Township	Range	Section	1/4 of	1/4 of	1/4 of	Lot	County
01S	15E	17	SE	NE	SE		CAMAS

5. Description of diverting works:
250 HP MOTOR 260' DEEP WITH 16" CASING.

6. Water is used for the following purposes:

Purpose	From	To	C.F.S.	(or)	A.F.A.
IRRIGATION	04/01	11/01	6.710		

7. Total Quantity Appropriated is:
6.710 C.F.S. (and/or) A.F.A.

8. Total consumptive use is 1025.0 Acre Feet Per Annum.

9. Non-irrigation uses:
NONE

10. Place of Use:

Township	Range	Section	1/4 of	1/4 of	Lot	Use	Acres
01S	15E	4	SW	NW		IRR	11.0
			SE	NW		IRR	11.0
			NE	SW		IRR	40.0

A37-07527

Page 1

Date: 10/18/89

MICROFILMED
FEB 24 1993

10. Place of Use: Continued

Township	Range	Section	1/4 of	1/4	Lot	Use	Acres
01S	15E	4	NW	SW		IRR	39.0
			SW	SW		IRR	39.0
			SE	SW		IRR	40.0
						Section Acres	180.0
		9	NE	NW		IRR	40.0
			NW	NW		IRR	39.0
			NE	SW		IRR	40.0
			NW	SW		IRR	39.0
			SW	SW		IRR	36.0
			SE	SW		IRR	36.0
						Section Acres	230.0
						Total Acres	410.0

11. Place of use in counties: CAMAS

12. Do you own the property listed above as place of use? YES

13. Other Water Rights Used:
NONE

14. Remarks:

THIS RT. WHEN COMBINED WITH RT. 37-7289 SHALL NOT EXCEED
6.71 CFS.

15. Basis of Claim: LICENSE

16. Signature(s)

(a.) By signing below, I/We acknowledge that I/We have received, read and understand the form entitled "How you will receive notice in the Snake River Basin Adjudication." (b.) I/We do _____ do not ☒ wish to receive and pay a small annual fee for monthly copies of the docket sheet.

Number of attachments: _____

For Organizations:

I do solemnly swear or affirm that I am President of Simon Farms Inc., that I have signed the foregoing document in the space below as President of Simon Farms Inc. and that the statements contained in the foregoing document are true and correct.

William A. Simon
Signature of Authorized Agent

Pres. Simon Farms Inc.
Title and Organization

Oct 18, 1989
Date

State of Idaho)
County of Cambo) SS.

Subscribed and sworn (or affirmed) before me this 18 day
of Oct 19 89

John Dale Carter
Notary Public

Seal

Residing at Boise Id

My Commission Expires 4/2/94

08/09/2007

IDAHO DEPARTMENT OF WATER RESOURCES
RECOMMENDED WATER RIGHTS ACQUIRED UNDER STATE LAW

RIGHT NUMBER: 37-22187

NAME AND ADDRESS: SIMON FARMS INC
PO BOX 403
FAIRFIELD ID 83327

SOURCE: GROUND WATER

TRIBUTARY:

QUANTITY: 0.630 CFS
115.20 AFY

This right when combined with all other rights shall provide no more than 0.02 cfs per acre nor more than 3.5 afa per acre at the field headgate for irrigation of the lands above.

Rights 37-22185, 37-22187, and 37-22189 when combined shall not exceed a total diversion rate of 0.63 cfs, a total annual maximum diversion volume of 279.7 af.

Rights 37-21724, 37-22185, 37-22187, and 37-22189 when combined shall not exceed a total diversion rate of 4.99 cfs, a total annual maximum diversion volume of 1385.7 af.

Rights 37-22187 and 37-22189 when combined shall not exceed a total diversion rate of 0.63 cfs, a total annual maximum diversion volume of 141.1 af.

PRIORITY DATE: 09/21/1976

POINT OF
DIVERSION:

T01S R15E S21 SWSENE Within CAMAS County

PURPOSE AND
PERIOD OF USE:

<u>PURPOSE OF USE</u>	<u>PERIOD OF USE</u>	<u>QUANTITY</u>
IRRIGATION	04/01 11/01	0.630 CFS 115.20 AFY

PLACE OF USE: IRRIGATION in CAMAS County

T01S R15E S21	NENE	34.00	T01S R15E S21	NWNE	34.00
T01S R15E S21	SWNE	34.00	T01S R15E S21	SENE	34.00
T01S R15E S21	NESE	34.00	T01S R15E S21	SESE	34.00
T01S R15E S22	NENW	34.00	T01S R15E S22	NWNW	34.00
T01S R15E S22	SWNW	34.00	T01S R15E S22	SENW	34.00
T01S R15E S22	NWSW	34.00	T01S R15E S22	SWSW	34.00

408 ACRES TOTAL

Rights 37-22187 and 37-22189 when combined shall not exceed a total irrigation of 45.8 acres.

The rights listed below are limited to the irrigation of a combined total of 408 acres in a single irrigation season. Combined Right Nos.: 37-21724, 37-22185, 37-22187 and 37-22189.

Rights 37-22185, 37-22187 and 37-22189 when combined shall not exceed a total irrigation of 92 acres.

This right is limited to the irrigation of 38.4 acres within the place of use described above in a single irrigation season.

OTHER PROVISIONS NECESSARY FOR DEFINITION OR ADMINISTRATION OF THIS WATER RIGHT:

Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.

Pursuant to Section 42-1412(6), Idaho Code, this water right is subject to such general provisions necessary for the definition of the rights or for the efficient administration of water rights as may be determined by the Snake River Basin Adjudication court at a point in time no later than the entry of the final unified decree.

EXPLANATORY MATERIAL: BASIS OF CLAIM - License

After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.

Right No. 37-22189 is an enlargement of this right pursuant to Section 42-1426, Idaho Code.

This right is a split from former right 37-7527.

Clelland, Steve

From: Skinner, Corey
Sent: Wednesday, January 17, 2007 4:40 PM
To: Kelly, Vicki
Cc: Clelland, Steve
Subject: 37-7289, 37-7527, and 37-13130 Objections

Vicki,

Bill Simon of Simon Farms was in my office today to discuss a couple of proposed water right transfers. During our review of his rights, we discovered that there appears to be an error in a condition limiting the volume between rights 37-7289, 37-7527, and 37-13130. Also it appears that the individual volume limit for right 37-13130 could be larger than what was recommended and reported to the court. Anyways, Mr. Simon will be filing some SF1 Objections to rights 37-7289, 37-7527, and 37-13130. The issues are specifically....

The volume for enlargement right 37-13130 should be 276.5 afa rather than 198.0 afa (79 enlargement acres times the IDWR current standard of 3.5 afa per acre)

The condition on rights 37-7289, 37-7527, and 37-13130 that states....

The rights listed below are limited to a total combined diversion rate of 6.71 cfs and to a total combined annual diversion volume of **1,230 AF**. Combined Right Nos.: 37-7289, 37-7527, and 37-13130.

Should read...

The rights listed below are limited to a total combined diversion rate of 6.71 cfs and to a total combined annual diversion volume of **2454.5 AF**. Combined Right Nos.: 37-7289, 37-7527, and 37-13130.

This would reflect the summation of the individual volumes of the three rights rather than the 1230 afa which is just the volume for right 37-7527. The original water right records for the licensed rights have no combined volume limits.

If possible, it would be nice to get these resolved ASAP so Mr. Simon could file his transfers with the correct volumes listed on his rights. I touched base with Steve on these earlier this afternoon, and talked to Nick Spencer also. I believe that these should be easily corrected and resolved, so if possible could you watch for the Simon Farms objections to come in and get them resolved relatively soon?

Thanks,

Corey

10/18/2006

IDAHO DEPARTMENT OF WATER RESOURCES
PRELIMINARY RECOMMENDATION OF WATER RIGHTS ACQUIRED UNDER STATE LAW

RIGHT NUMBER: 37-7527

NAME AND ADDRESS: SIMON FARMS INC
PO BOX 364
FAIRFIELD ID 83327

SOURCE: GROUND WATER

TRIBUTARY:

QUANTITY: 6.710 CFS
1,230.000 AFY

The rights listed below are limited to a total combined diversion rate of 6.71 cfs and to a total combined annual diversion volume of 1,230 AF. Combined Right Nos.: 37-7289, 37-7527, and 37-13130.

PRIORITY DATE: 09/21/1976

POINT OF DIVERSION:

T01S R15E S17 SENESE Within CAMAS County

PURPOSE AND
PERIOD OF USE:

PURPOSE OF USE

PERIOD OF USE

QUANTITY

IRRIGATION

04/01 11/01

6.710 CFS
1,230.00 AFY

PLACE OF USE:

IRRIGATION Within CAMAS County

T01S R15E S04	SWNW	11.00	T01S R15E S04	SENW	11.00
T01S R15E S04	NESW	40.00	T01S R15E S04	NWSW	39.00
T01S R15E S04	SWSW	39.00	T01S R15E S04	SESW	40.00
T01S R15E S09	NENW	40.00	T01S R15E S09	NWNW	39.00
T01S R15E S09	SWNW	39.00	T01S R15E S09	SENW	40.00
T01S R15E S09	NESW	40.00	T01S R15E S09	NWSW	39.00
T01S R15E S09	SWSW	36.00	T01S R15E S09	SESW	36.00

489 ACRES TOTAL

This right is limited to the irrigation of 410 acres within the place of use described above in a single irrigation season.

The rights listed below are limited to the irrigation of a combined total of 489 acres in a single irrigation season. Combined Right Nos.: 37-7527 and 37-13130.

OTHER PROVISIONS NECESSARY FOR DEFINITION OR ADMINISTRATION OF THIS WATER RIGHT:

This partial decree is subject to such general provisions necessary for the definition of the rights or for the efficient administration of the water rights as may be ultimately determined by the Court at a point in time no later than the entry of a final unified decree. Section 42-1412(6), Idaho Code.

EXPLANATORY MATERIAL: BASIS OF CLAIM - License

Right No. 37-13130 is an enlargement of this right pursuant to Section 42-1426, Idaho Code.



Idaho Department of Water Resources


SRBA Recommendation:

37-7527


37-13130

Legend

-  Point of Diversion
-  Place of Use
-  Townships
-  PLS Sections
-  Quarter Quarters

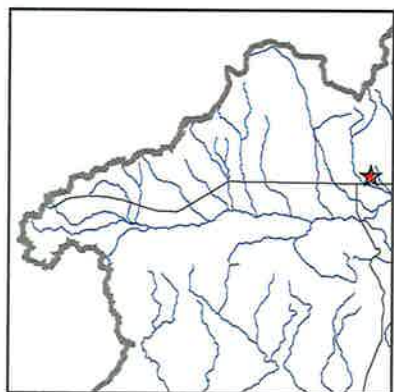

Camas County
IDWR Basin 37

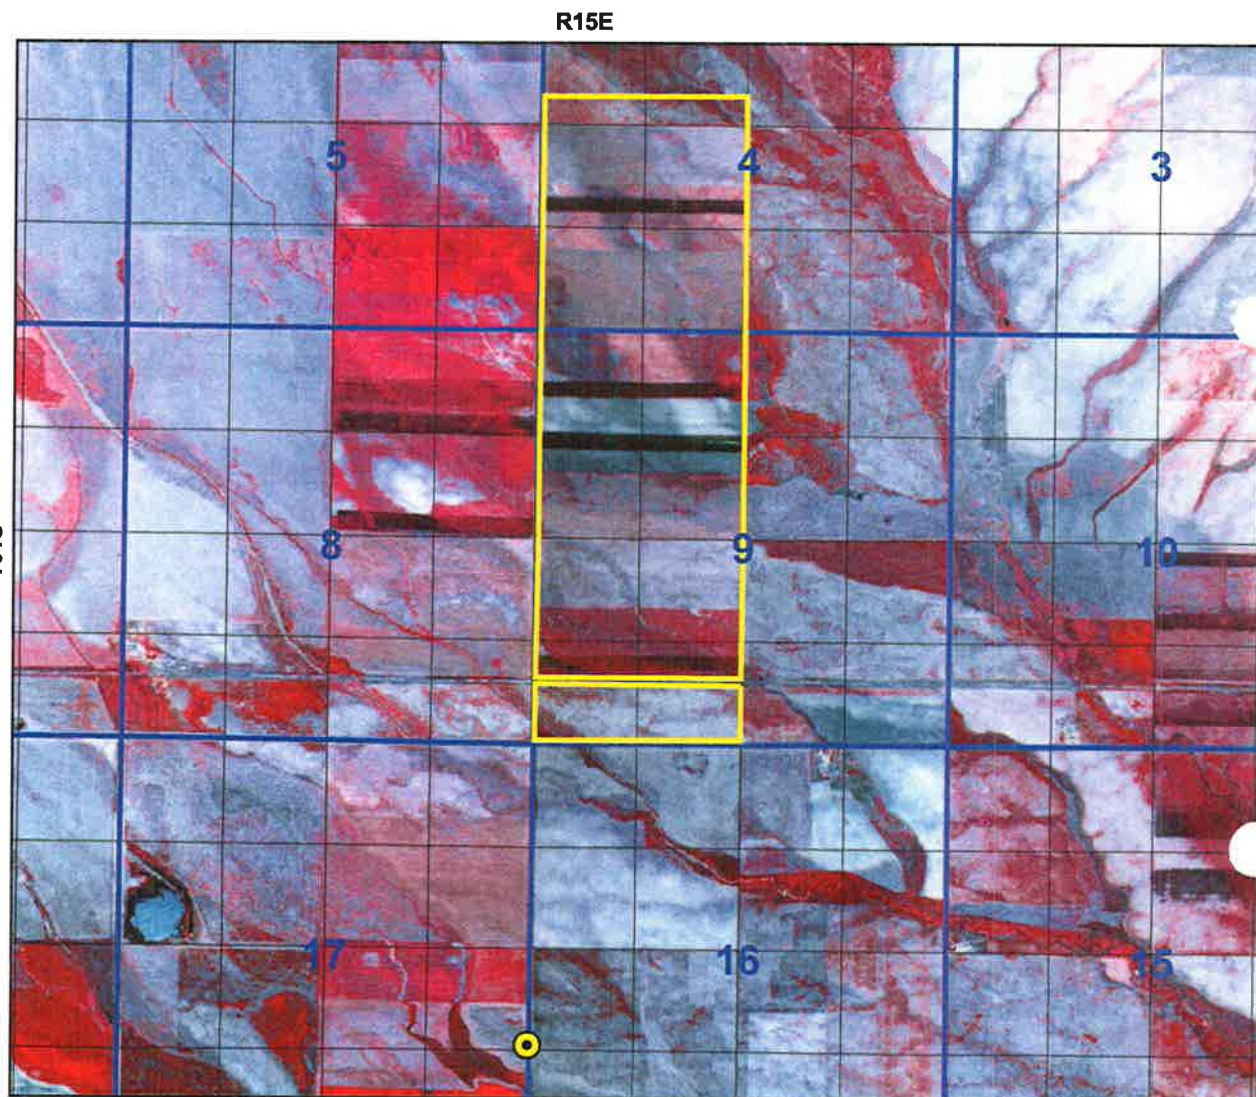

0 0.25 0.5 Miles



Prepared by M. Anders
On Wednesday, October 18, 2006
1987/88 Aerial Photography

11/01/2006

**NOTICE OF ERROR
REPLY**

Please type or print clearly, fill out this form completely and mail.

Return this reply form to IDWR by the deadline date printed below if you want IDWR to change your recommendation or you want to let IDWR know that you agree with its recommendation.

YOUR DEADLINE FOR RETURNING A NOTICE OF ERROR REPLY IS: November 21, 2006

Water right number: 37-7527

SIMON FARMS INC

PO BOX 364

FAIRFIELD ID 83327

Telephone Number: (208)764-2324

1. Describe the portion of the proposed recommendation with which you disagree (e.g. priority date, period of use, source):

2. Describe the changes you wish to make in the proposed recommendation:

3. Give a brief explanation as to why you disagree with these portions:

☒ I AGREE with this proposed recommendation: no changes need to be made.

DATE:

11/14/06

SIGNATURE:

Simon Farms Inc.
William O. Simon

Please print your name:

Simon

IDWR State Office, 322 E Front St
PO Box 83720, Boise, ID 83720-0098, (800)451-4129

Adjudication Claim Notes

Claim(s): 37-7527, 37-13130

Background Data

37-7527

- Source is Groundwater
- Licensed for 6.71 cfs on 410 acres
- Claimed for 6.71 cfs on 410 acres


37-13130

- Beneficial Use Claim
- Source is Groundwater
- Claimed for 1.58 cfs on 79 acres

Place Of Use Data

Yellow line is the draft Place of Use created by IDWR based on historical data and records.
Yellow dot is draft Point of Diversion created by IDWR based on historical data and records.
Green line is decreed/licensed POU (this may only represent the Quarter-Quarter sections of the decree/license)

1987 Aerial Photo

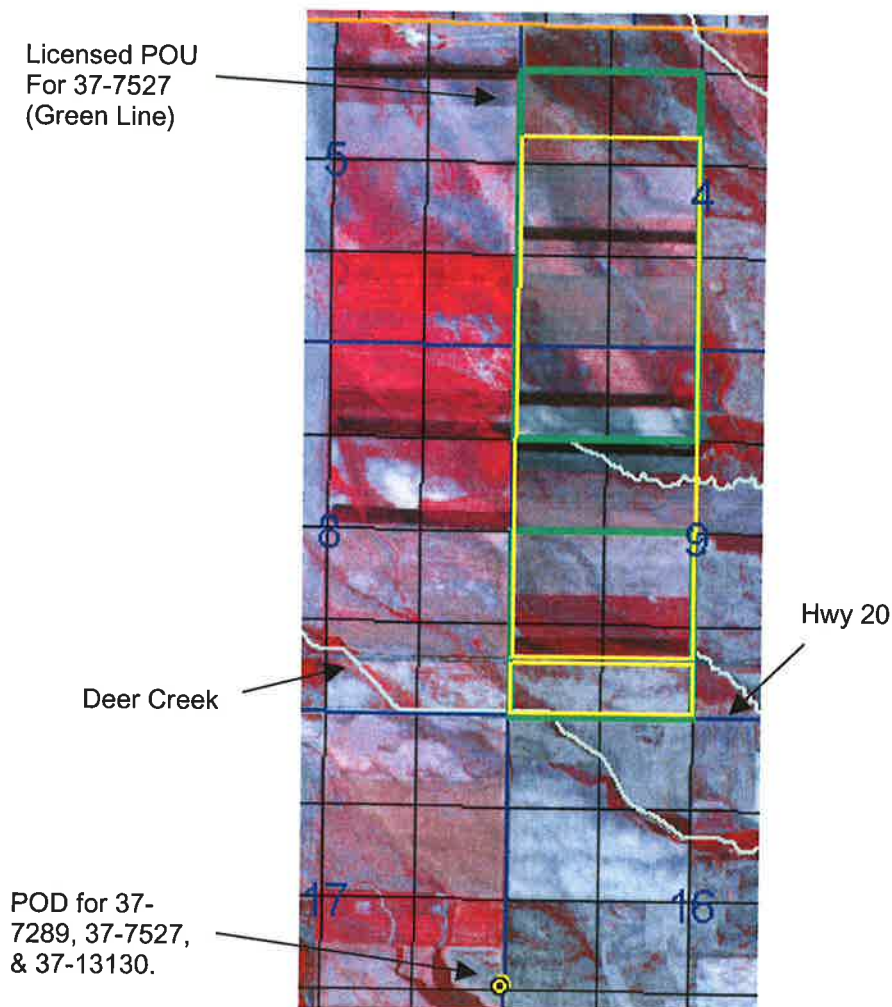

Notes

T1S R15E Sections 4 & 9

- Found 489 acres
- POD digitized base on license documents and USGS 24K map
- The POD is shared for 37-7289, 37-7527, & 37-13130. Add condition that combined diversion rate shall not exceed 6.71 cfs.
- 37-13130 is an enlargement of 37-7527.
- Duty of water for enlargement:
 - $6.71 \text{ cfs} / 489 \text{ acres} = 0.014 \text{ cfs/acre}$
 - $1230 \text{ AF} / 489 \text{ acres} = 2.5 \text{ AF/acre}$
- Recommendations:
 - 489-acre PPU
 - 37-7527 – 6.71 cfs and 1230 AF for Irrigation of 410 acres within PPU
 - 37-7527 – 1.11 cfs and 198 AF for Irrigation of 79 acres within PPU
- Data used for review: 1987, 1992, & 2004 aerial photos, Camas Co Tax Records, Idaho Ownership (idown.shp), & USGS 1:24,000 Topo

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

License of Water Right No. 37-7527 Priority September 21, 1976 Amount 6.71 cfs

THIS IS TO CERTIFY, that Simon Farms, Inc.
of Fairfield, Idaho, has complied with the terms and conditions of Permit
No. 37-7527 issued pursuant to Application for Permit dated September 21, 1976,
and has submitted proof to the Department of Water Resources on August 19, 1981,
that he has applied water to a beneficial use; an examination by the Department indicates that the works have a
capacity for the diversion of 6.71 cfs of water from a groundwater source,
tributary to _____, and that the permit holder has applied to a beneficial use and
established a right to use water as follows:

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
<u>Irrigation</u>	from <u>April 1</u> to <u>November 1</u>	at <u>6.71</u> cfs and	<u>1230.0</u> acre feet
	from _____ to _____	at _____ cfs and	
	from _____ to _____	at _____ cfs and	

(both dates inclusive)

Subject, however, to the condition that no more than 6.71 cfs of water be diverted at any one time, and
that the amount of water so diverted and to which such right is entitled and confirmed is for the purpose
aforementioned and is limited to the amount which can actually be beneficially used and shall not exceed
1230.0 acre feet per year, said waters to be diverted within the SE 1/4 Section 17,
Twp 1S, Rge 15E in the County of Caras


Description and location of place of use:

Twp.	Range	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
1S	15E	4							11	11	40	39	39	40					180
		9					40	39			40	39	36	36					230

Total number of acres irrigated 410


MICROFILMED

MAP (Attach Aerial Photo)

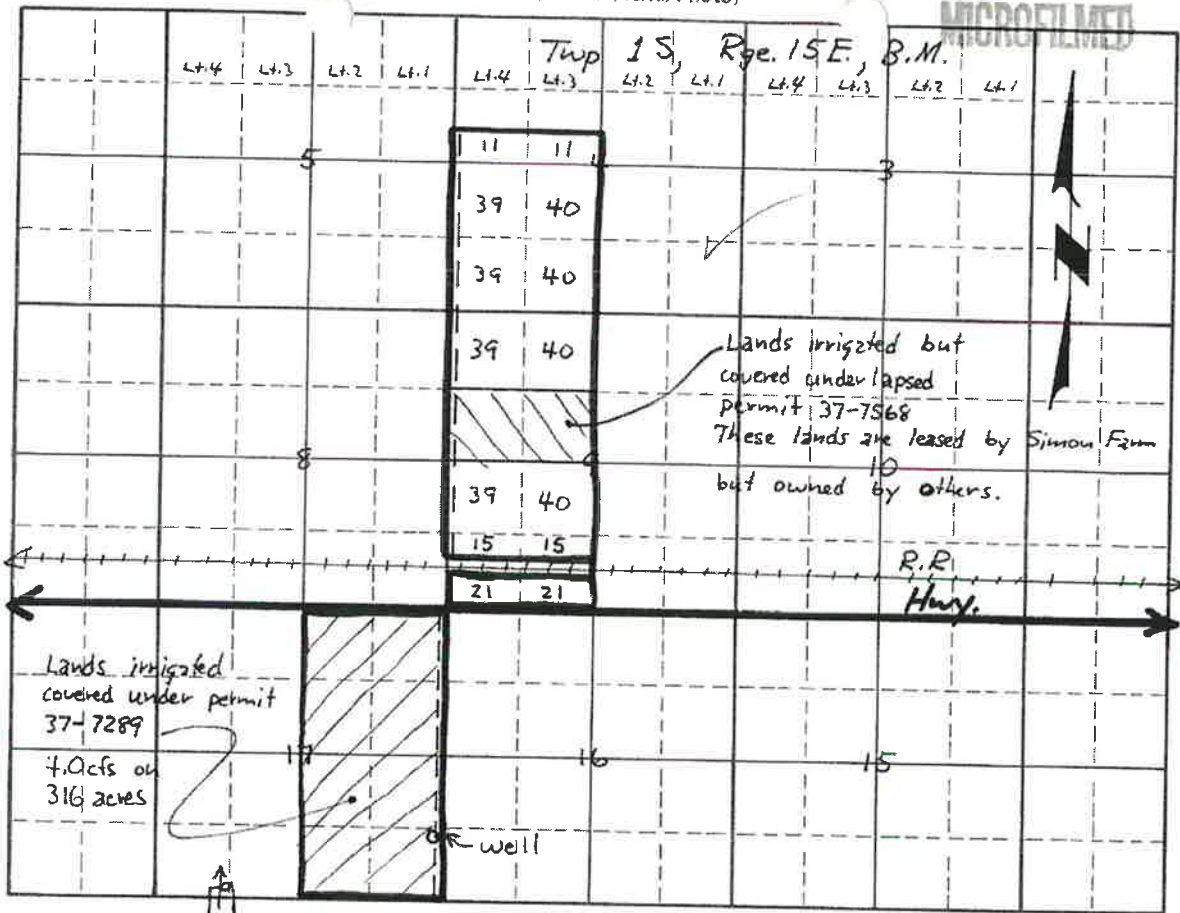

SCHEMATIC DIAGRAM OF SYSTEM

(Include distance from pump to measuring device, if applicable.)

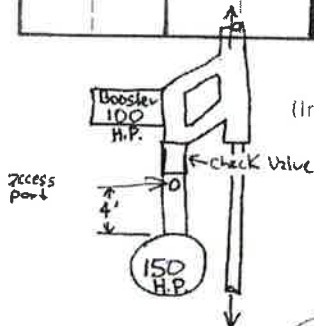

Point(s) of diversion: SE 1/4 SE 1/4 Sec. 17, Twp 1S., Rge 15E., B.M.

Place(s) of Use read across

TWP.	RGE.	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
1S.	15E.	4							11	11	40	39	39	40					180 ✓
1S.	15E.	9					40	39			40	39	36	36					230 ✓

Recommended Amendments:

☐ Change P.D. as reflected above

☐ Add P.D. as reflected above

☒ None

☐ Change P.U. as reflected above

☐ Add P.U. as reflected above

☐ Other

Examiner's Signature


Checked by

Approved by

Date 12/10/82

Date 2/15/83

Date 10-16-84

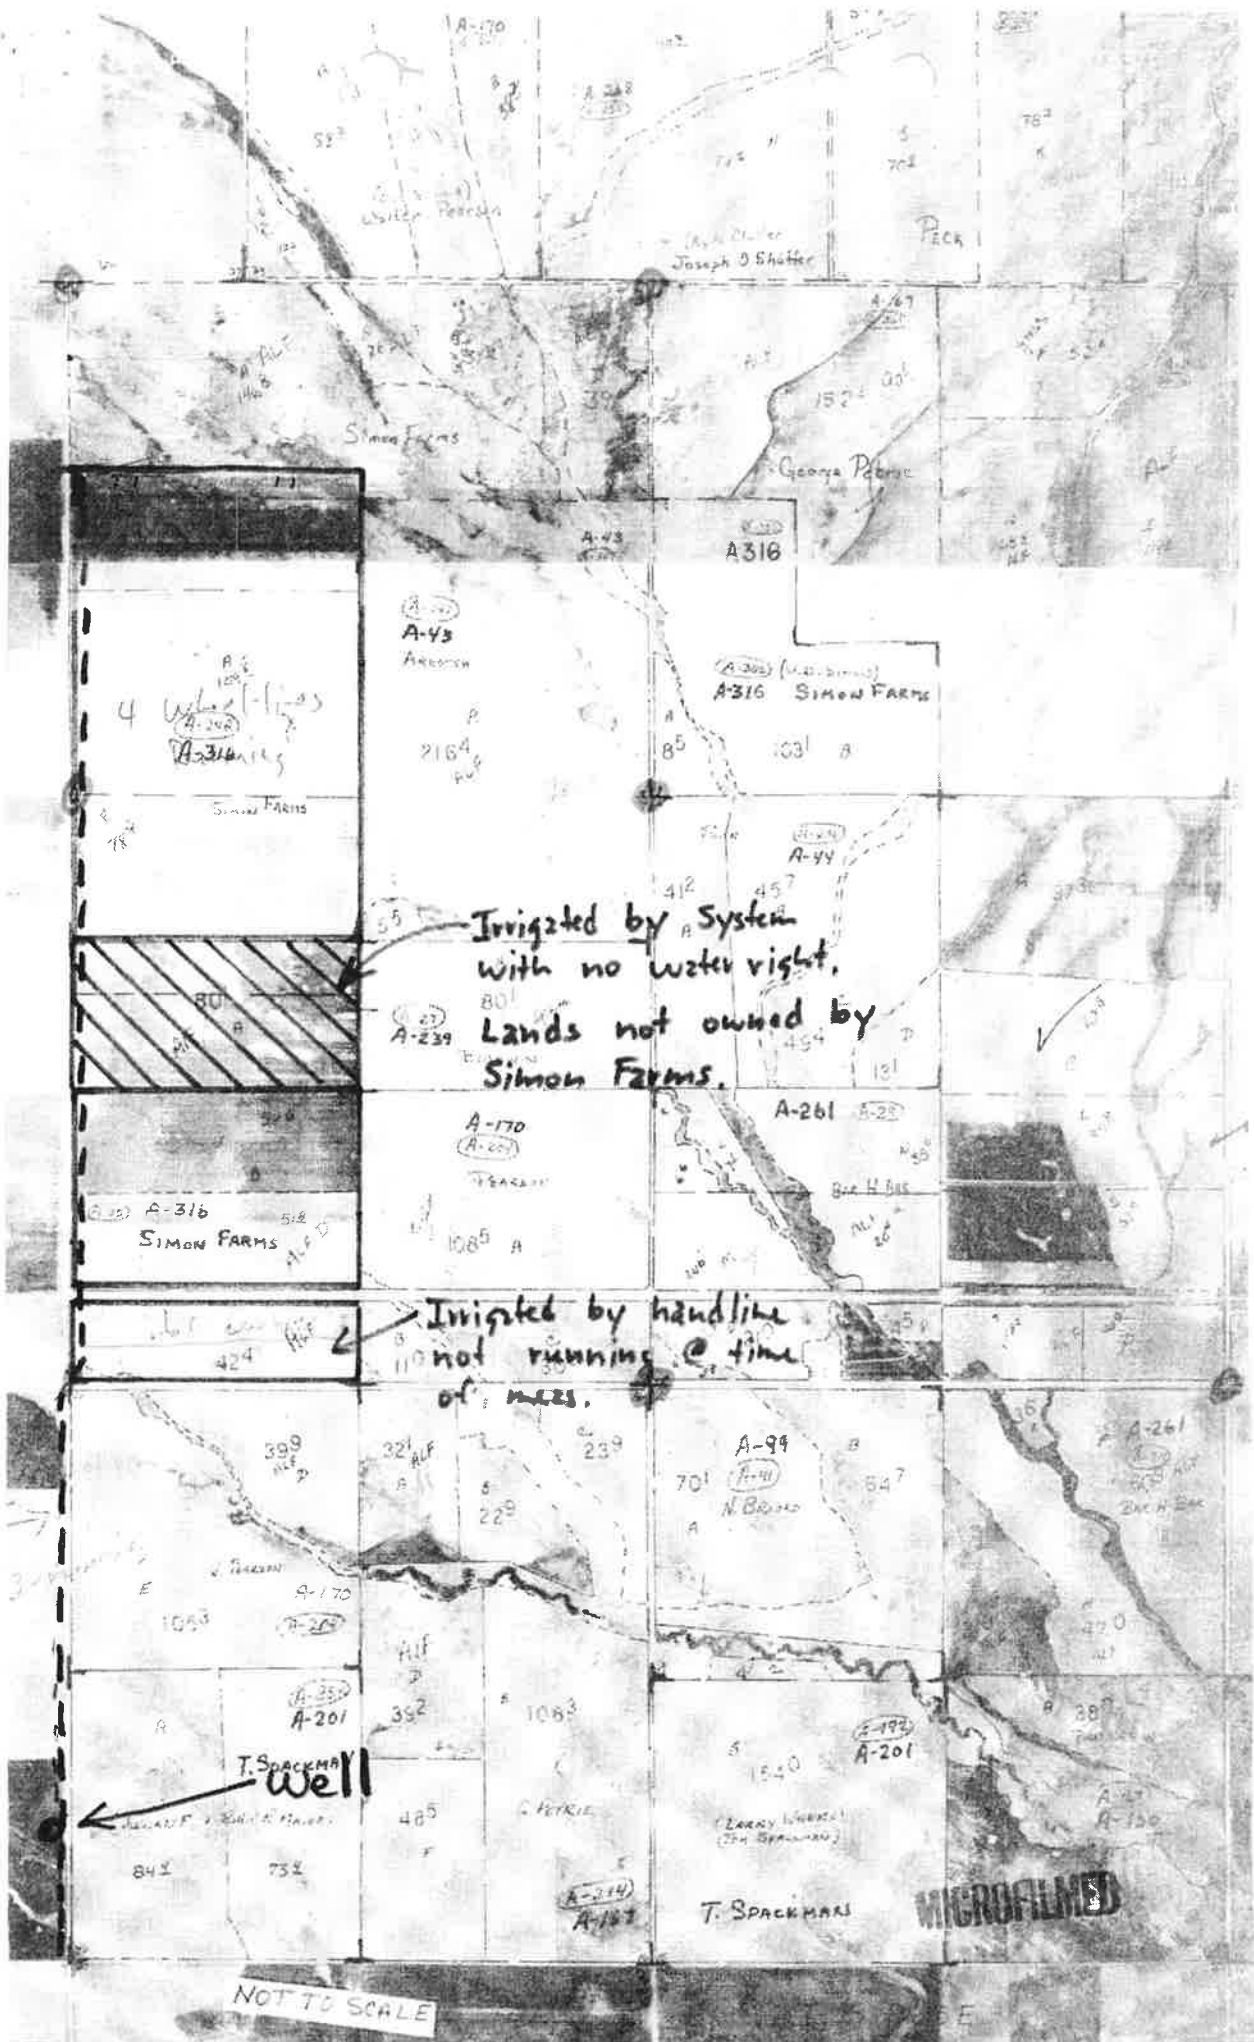

Irrigated by System
with no water right.
Lands not owned by
Simon Farms.

Irrigated by handline
not running @ time
of map.

T. SPACKMAN
well

NOT TO SCALE

MICROFILMED

1963

37-7527

Permit No.

CONTACT WITH PERMIT HOLDER

DATE	INITIALS	REMARKS
------	----------	---------

- ☐ Appointment letter mailed:
- ☐ Telephone call made:
(List Telephone No. used)
- ☐ Appointment scheduled for
(Date, time, location)

EXAMINATION

Date 7/22/82 Accompanied by William Simon Total Q measured Pressure Gage 6.71 cfs^{sec}
If source is surface water, estimate total flow of source Annular
Methods of measurement (1) Pressure Gage Meets Permit requirements? Yes

Measurement calculations:
 10.02" Annubar Reading, 44" H₂O on meter 091474 $\Rightarrow Q_{meas} = \frac{3.85(10.02)^2 \sqrt{44}}{448.8} = 5.71 \text{ cfs}$
 Pressure gauge yielded 6.71 cfs (See Attached sheets) Allow ~~6.71 cfs~~ 6.71
 Volume = (3.0 A.F./Ann./Acu)(410 acres) = 1230 A.F./Ann. ✓
 $V = 6.71 \times 1.9835 \times 214 = 2848.2 \text{ AE}$ $3.64 \times 1.9835 \times 214 = 1545.1$

[illegible]

System Description Well & pump with booster delivers to 2½ mile main line which supplies water to 7 ½ mile wheel-lines and occasionally a ½ mile hand line.

**Code with map on reverse side. Disregard code if only one.*

RECOMMENDED AMOUNTS

	USE	Q (cfs)	V (afa)	FROM	TO
Irrigation ✓		~~6.77~~ ✓	1230.0 ✓	4/1 ✓	11/1 ✓
		~~3.64~~			214 days
		6.71 cfs			
		6.71 cfs			
		~~3.64~~			
Total		~~6.77~~ cfs ✓	1230.0 ✓		


MICROFILMED

Remarks After well was measured at full capacity with 7, 1/2 mile wheel-lines operating Mr. Simon indicated that he thought the measurement was low with the meas. & calculation he has made. Because of the location of access port between the booster and the pump and the possibility of turbulence I checked the lines with a pressure gauge. Based on the measurements made with the pressure gauge it was calculated that the system capacity was 6.71 cfs (See Attached Sheets)

When this permit is combined with Lic. 37-7289 the system capacity shall not exceed 671 cfs. ~~and no more than 671 cfs.~~


MAP (Attach Aerial Photo)

MICROFILMED

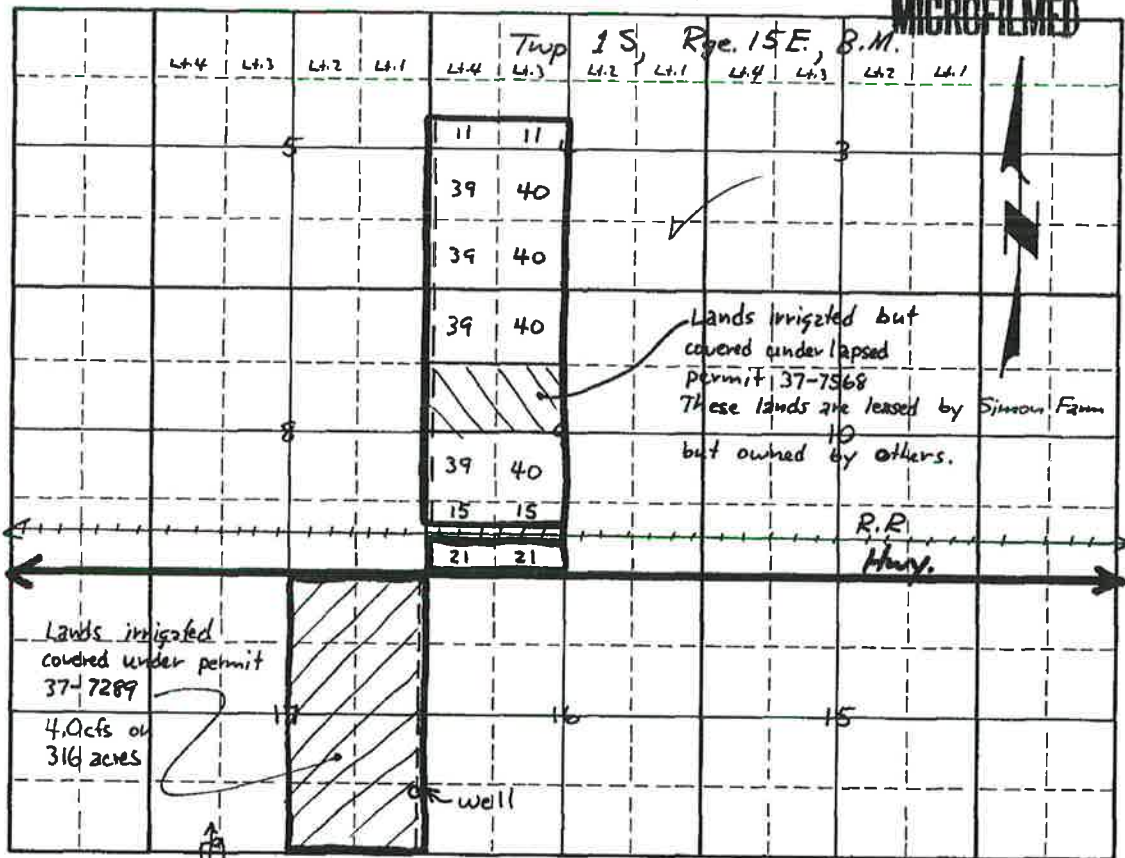

SCHEMATIC DIAGRAM OF SYSTEM

(Include distance from pump to measuring device, if applicable.)

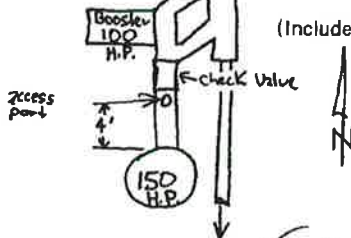

Point(s) of diversion: SE 1/4 SE 1/4 Sec. 17, Twp 1S., Rge 15E., B.M.

Place(s) of Use Lead across

TWP.	RGE.	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
1S.	15E.	4							11	11	40	39	39	40					180 ✓
1S.	15E.	9					40	39			40	39	36	36					230 ✓

410 ✓

Recommended Amendments:

- ☐ Change P.D. as reflected above
☐ Change P.U. as reflected above

- ☐ Add P.D. as reflected above
☐ Add P.U. as reflected above

- ☒ None
☐ Other

Examiner's Signature

Checked by

Approved by

John D. Martin
Larry S. Blum
Ray Walker

Date

Date

Date

12/10/82

2/15/83

10-16-84

Supplemental Sheet
Field Exam Report
37-7527
37-7528

On 7/22/82 Field Exams for Permit Nos. 37-7527 and 37-7528 were completed. Because of poor locations of access ports pressure gauge readings were taken at the beginning and end of each wheel-line in an attempt to determine the discharge rate for each system. It was noted that all wheel-lines had 5" alum. pipe and that all lines had 63 sprinklers. All sprinklers had 1/64" nozzles and the sprinklers were spaced at 40'.

The following equations and methodology was used to reconcile the observed readings and calculate the system capacities:

From published tables of performance of sprinklers it was observed that this data fits the equation

$$gpm = C \sqrt{\text{pressure in psi}}$$

where C is dependant on nozzle size. For common nozzle sizes the following "C" values were determined.

$$9/64" - 0.58$$

$$5/32 - 0.70$$

$$11/64 - 0.85$$

$$3/16 - 1.01$$

It is also recognized that the pressure in the sprinkler lines is dependant on the elevation of the line as well as the friction loss in the pipe. Friction loss by the Hazen-Williams formula is:

$$f = 0.2083 \left(\frac{100}{C} \right)^{1.85} \frac{q^{1.85}}{d^{4.8655}}$$

where: f = friction loss per 100' of pipe in feet of Head

d = diameter of pipe in inches

q = flow in pipe in gpm

C = pipe roughness constant (For Alum. C = 120)

MICROFILMED

The above equations were reduced and utilized in the following HP-25 program. The solution of the problem is trial and error. The initial variables are the end pressure and the "slope decrease psi". Output of the program is beginning pressure and total discharge of sprinkler line. The program is ran while holding the end pressure constant and assuming various "slope decrease psi" values until the observed beginning pressure is obtained. The total discharge last calculated is then the proper answer.

H.P.-25 Program

Calculation of Sprinkler Line Discharge from End Pressures.



Registers Used	Input	Not Used	Output
0	End Pressure (psi)		Beginning Pressure (psi)
1	Decrease in psi/joint due to slope		
2	Initialize = 0		Total gpm in line
3	C value for nozzles		
4	(Friction Factor)		
5	Number of sprinklers in line		
6	Counter, Initialize = 0		
7			

Friction Factor

$$= \frac{0.2083 \left(\frac{100}{C} \right)^{1.85}}{d^{4.8655} \cdot 2.306 \cdot L}$$

where: C = pipe roughness

L = Length of joint
or sprinkler spacing
ft.

d = diameter pipe (in.)

Program

Rcl 1
f JX
Rcl 4
X
Stor +3
Rcl 3
1
.
8
5
f yX
Rcl 5
X
Rcl 1
+
Rcl 2
+
Stor 1
Rcl 7
1
+
Stor 7
Rcl 6
X=y
Goto 00
Goto 01


Assumptions

- All sprinklers have same nozzle size
- Entire line has same size pipe
- Slope of pipeline is constant over length.


The attached sheets are the results for the observed pressures for the systems under permits 37-7527 & 37-7528.

MICROFILMED

Permit 37-7527

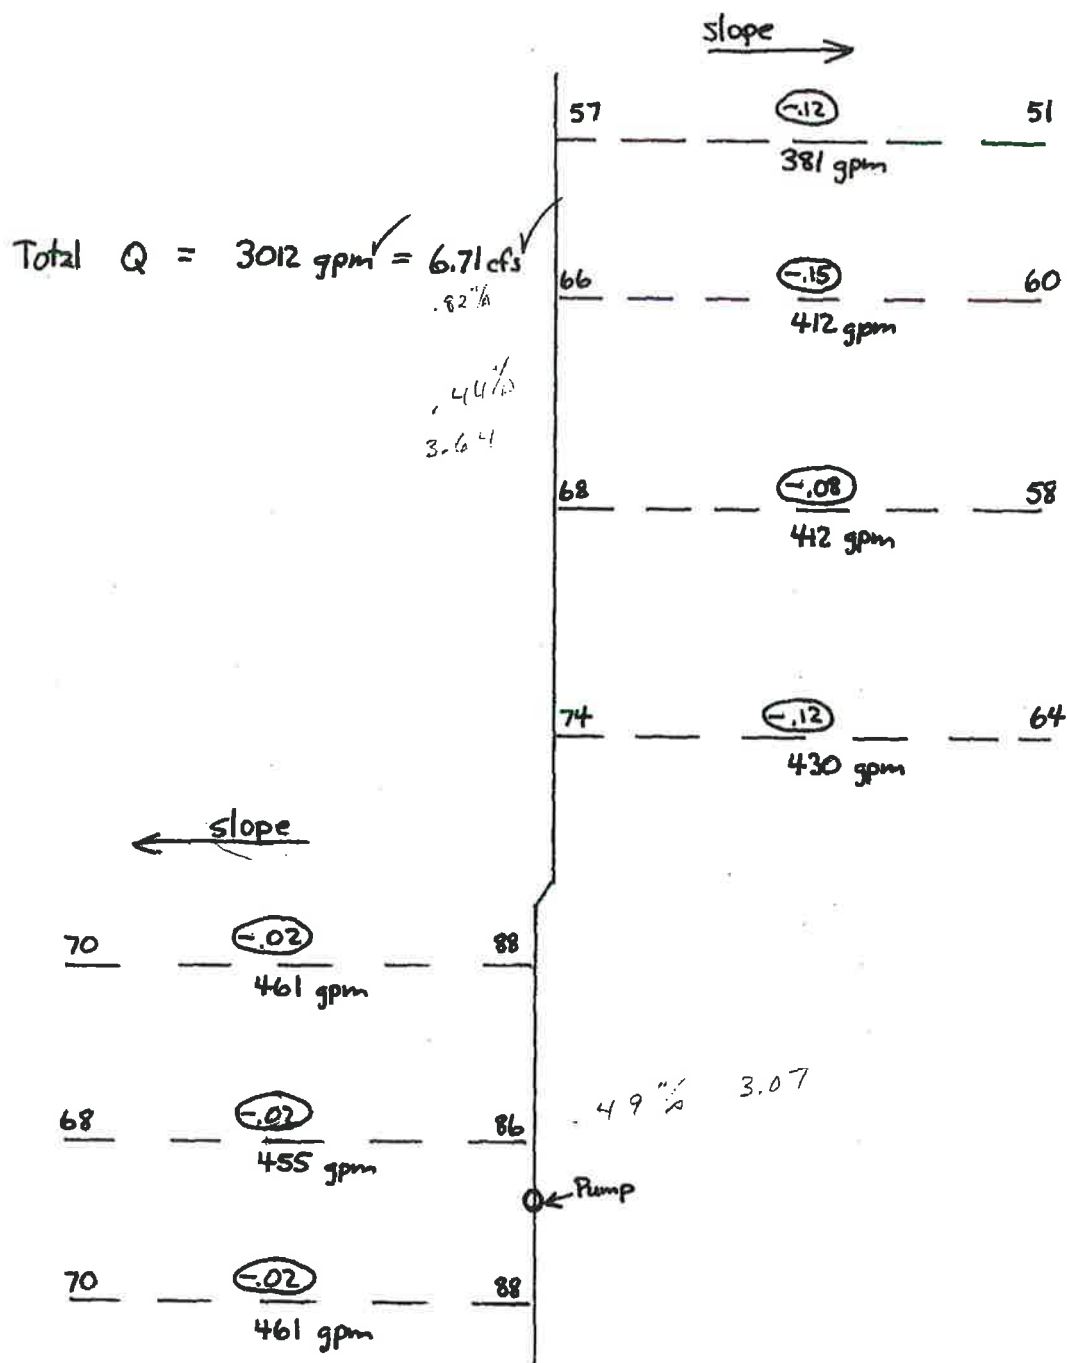

MICROFILMED

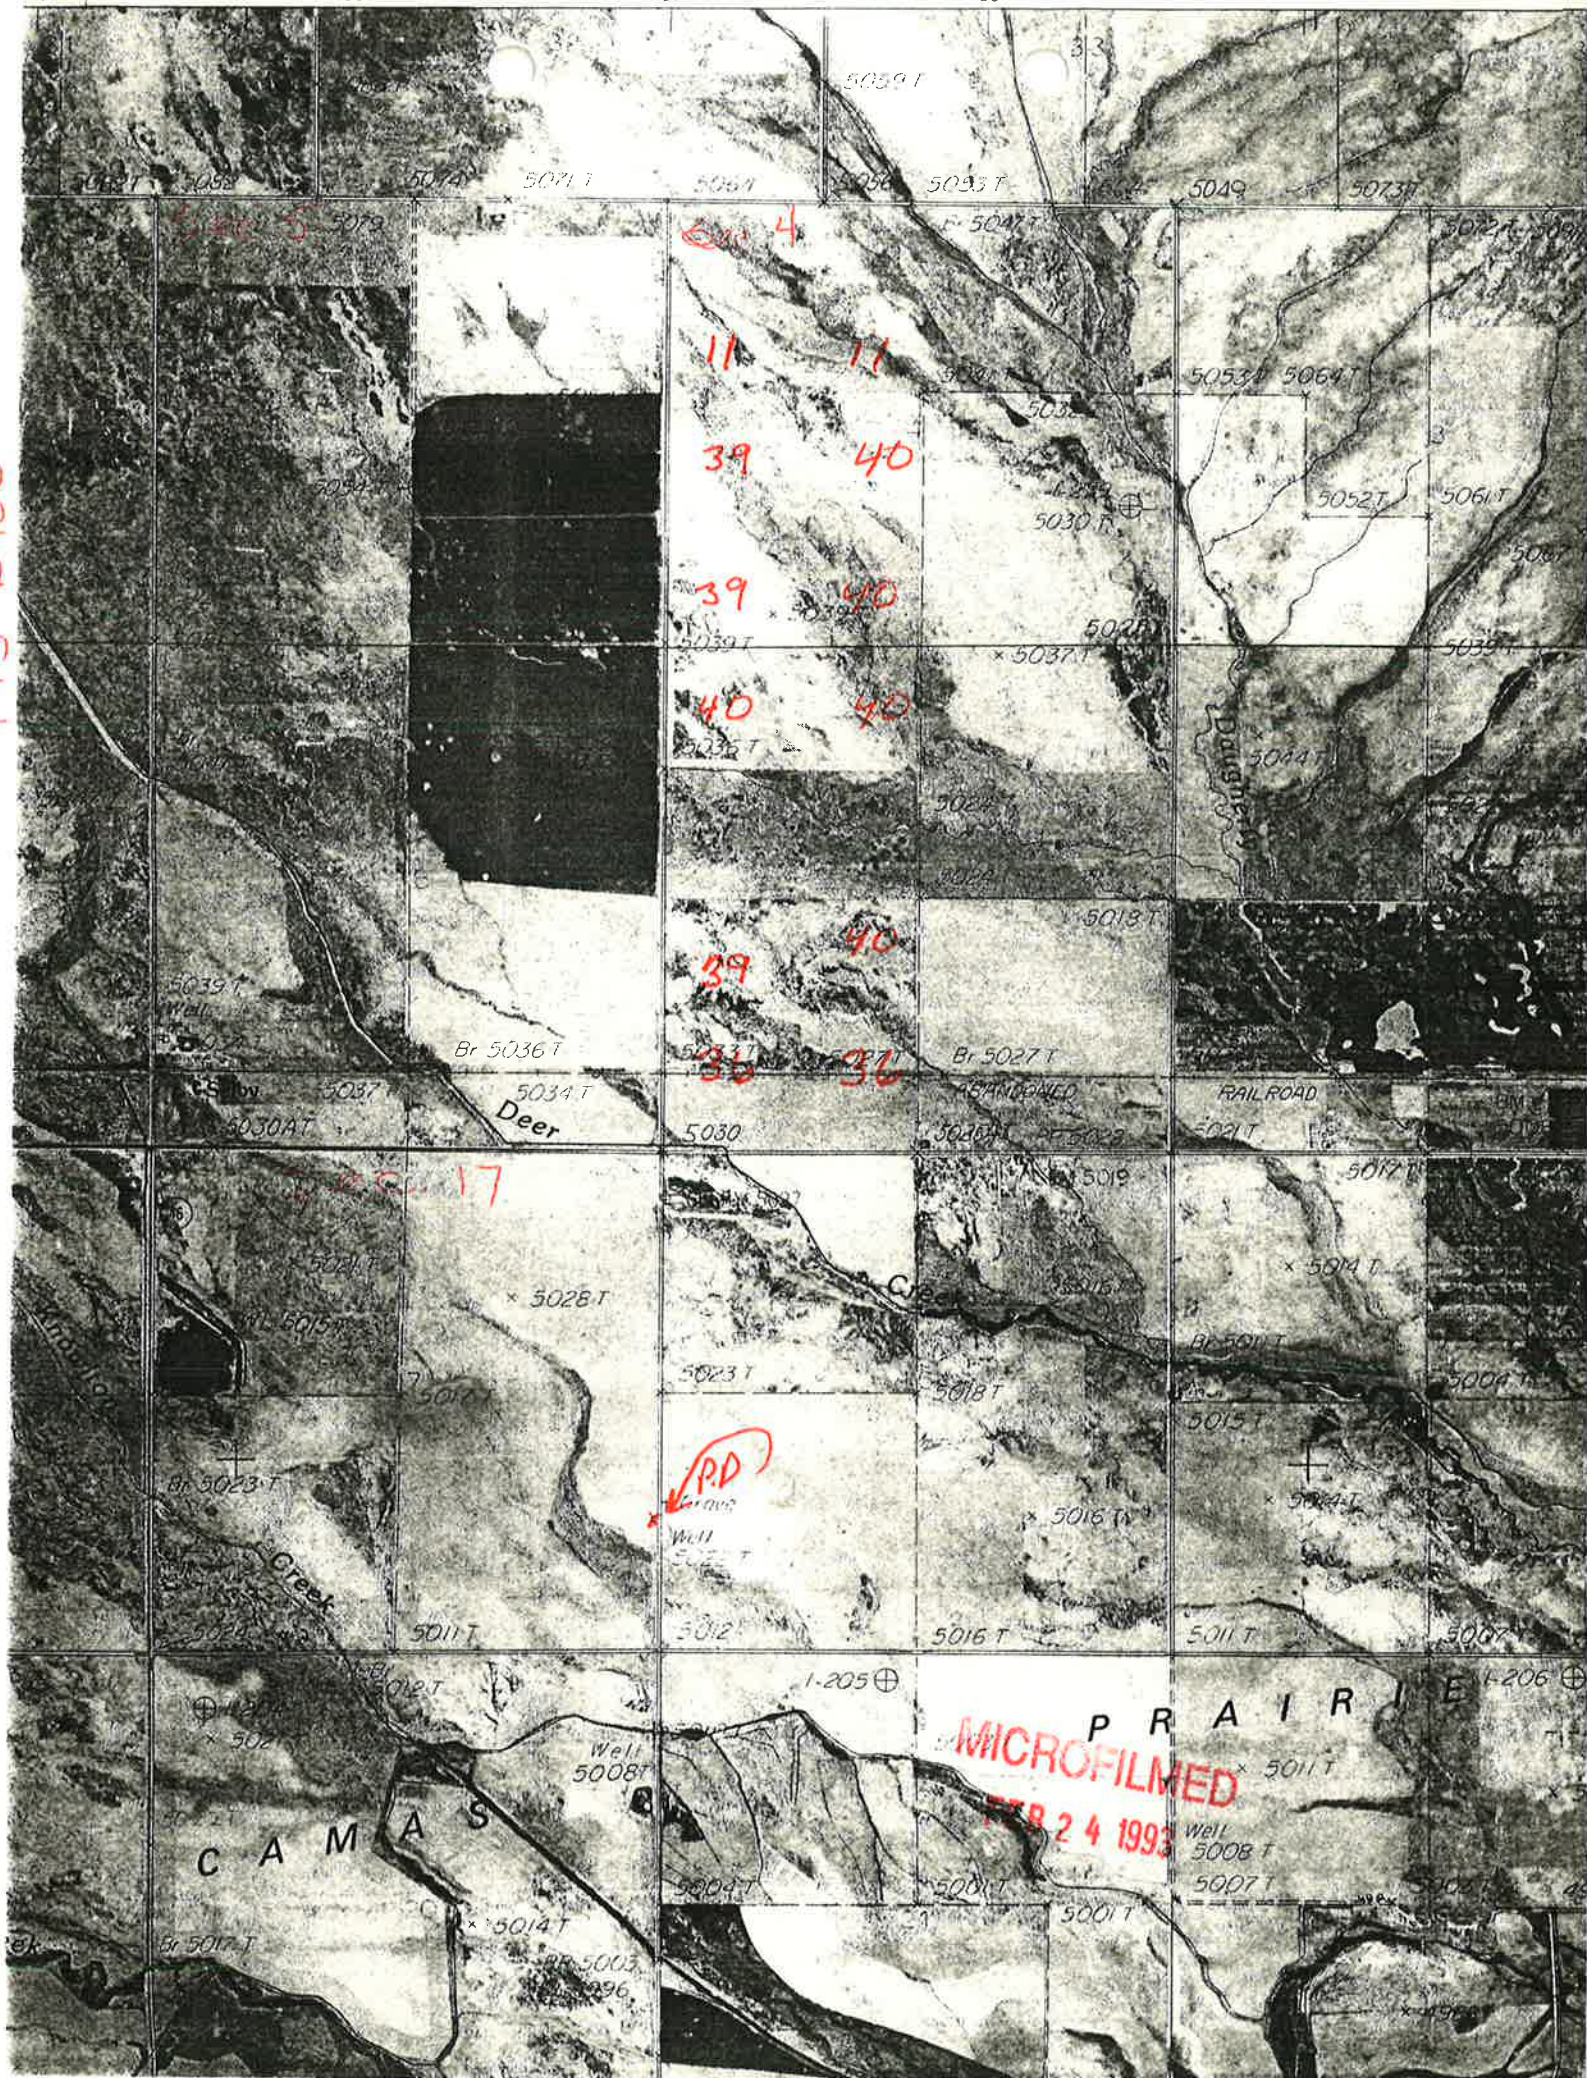

Water Right Number - 37-07527

Adj. Flag Translation: Standard Water Right Number

Old (D) Number -

+ - - - - Last Name - - - - + + - First Name - - + + - - - - - Address - - - - - +

*** C - CURRENT OWNER ***
SIMON FARMS INC.

1 - P.O. BOX 364
2 -
3 -
City- FAIRFIELD State- ID Zip- 83327
Phone - 208-000-0000

+ - - Priority Date - - + + - - - Region - - - + + - - - Stage - - - + + - - - Status - - - - +
09/21/1976 17 L - LICENSE

+ - - - - - Source - - - - - + + - - - - - Tributary - - - - - +
GROUNDWATER

+ - - - - - Point of Diversion - - - - - +
Twn Rng Sec Tract Lot RFlg County Stream Index (Blank if no Index Code)
01S 15E 17 SE SE (25) CAMAS

+ - - - - Water Use - - - - - +
Code Description Period From Period To Diversion Rate Diversion Volume
- 01 - IRRIGATION 04/01 11/01 6.710 1230.00

+ - Total Div. Rate - + + - Total Div. Volume - + + - Total Div. Capacity - + + - Total Consumptive Use - + + - KW Usage - +
6.710 1230.00 6.710

Twn	Rng	Sec	Tract	Lot	Acres	Place of Use Code	Description	County
01S	15E	4	SW NW		11.0	01	IRRIGATION	(25) CAMAS
01S	15E	4	SE NW		11.0	01	IRRIGATION	(25) CAMAS
01S	15E	4	NE SW		40.0	01	IRRIGATION	(25) CAMAS
01S	15E	4	NW SW		39.0	01	IRRIGATION	(25) CAMAS
01S	15E	4	SW SW		39.0	01	IRRIGATION	(25) CAMAS
01S	15E	4	SE SW		40.0	01	IRRIGATION	(25) CAMAS
01S	15E	9	NE NW		40.0	01	IRRIGATION	(25) CAMAS
01S	15E	9	NW NW		39.0	01	IRRIGATION	(25) CAMAS
01S	15E	9	NE SW		40.0	01	IRRIGATION	(25) CAMAS
01S	15E	9	NW SW		39.0	01	IRRIGATION	(25) CAMAS
01S	15E	9	SW SW		36.0	01	IRRIGATION	(25) CAMAS
01S	15E	9	SE SW		36.0	01	IRRIGATION	(25) CAMAS

Total Acres: 410.0

+ - Diversion Means - WELL, PUMP & SPRINKLERS.
+ - Non-Irrigation Use -
+ - Other Rights for Same Use -

MICROFILMED
FEB 24 1993

Water right number - 37-07527 Adj. flag translation: Standard Water Right Number

+ - - - - Remarks - - - - -
THIS RT. WHEN COMBINED WITH RT. 37-7289 SHALL NOT EXCEED
6.71 CFS.

+ - - - - Conditions of Approval - - - - -
016 - See remarks for additional conditions of approval.

+ - - - - Decree Plaintiff - - - + + - - - - Decree Defendant - - - + + - Decree Date - +
00/00/0000

+ - - Audit Fields - 02/19/86 05/28/88 CONVERT 08/01/89 CURTIS

+ - - - - Water Rights Dates and Flags Area - - - - -

Proof Due Date - 10/01/1981	Field Exam Made - 00/00/0000	Field Exam Fee -
Approved/Denied - 10/27/1976	Protested Date - 00/00/0000	Swan Falls - Z
Proof Made Date - 01/01/1900	Hearing Date - 00/00/0000	Temporary Right - P
Start Work Date - 00/00/0000	Verified Date - 00/00/0000	DLE/Carey Act -
Order Show Cause - 00/00/0000	Receipt Number -	Water District -
Licensed Date - 11/01/1985	Appl Received - 00/00/0000	Transfer/Amended -
Decree Date - 00/00/0000		

MICROFILMED
FEB 24 1993