



IDAHO DEPARTMENT OF
WATER RESOURCES

322 E Front Street, Suite 648, Boise ID 83702 • PO Box 83720, Boise ID 83720-0098
Phone: 208-287-4800 • Fax: 208-287-6700 • Email: idwrinfo@idwr.idaho.gov • Website: idwr.idaho.gov

Governor Brad Little
November 9, 2021

Director Gary Spackman

IDAHO FOREST GROUP LLC
687 W CANFIELD AVE STE 100
COEUR D ALENE ID 83815-5335

PROOF WITHDRAWAL ACKNOWLEDGEMENT LETTER

RE: Permit No. 96-9498

Dear Permit Holder:

On November 3, 2021, the Department received your request to withdraw the Statement of Completion (proof) form for permit 96-9498 that was received on January 20, 2021.

I am returning the proof. The Department will send a Proof Due notice 60 days before the proof due date of **May 1, 2023**.

If you have any questions concerning this matter, please contact me at (208) 287-4920 or debby.judd@idwr.idaho.gov.

Sincerely,

Debbi Judd
Technical Records Specialist

Enclosure

c. Clive Strong – *via email*
Ryan Fobes – *via email*

Judd, Debbi

From: clivejstrong@gmail.com
Sent: Wednesday, November 3, 2021 3:48 PM
To: Judd, Debbi
Cc: 'Ryan Fobes'; Bates, Luke
Subject: Request to Withdraw Proof of Beneficial Use for 96-09498

Debbi, IFG respectfully requests that its proof of beneficial use for permit no. 96-09498 be withdrawn and that IDWR reinstate the original proof of beneficial use date of May 1, 2023. The reason for this request is that at the time of submission of the proof of beneficial use, IFG reasonably believed its power records would be sufficient to establish the extent of beneficial use. Based upon conversations between Ryan Fobes, IFG's consulting engineer, and Luke Bates, IDWR Water Resource Agent, however, it was determined that the power records were not sufficient to capture volume data required to establish an annual diversion volume.

IFG has an operating measuring device that will provide the required volume data to meet the original proof of beneficial use date.

Regards,

Clive J Strong
Attorney at Law
6244 S Survival Place
Boise, ID 83716
(208)850-7792
clivejstrong@gmail.com

RECEIVED

JAN 20 2021

DEPARTMENT OF
WATER RESOURCESSTATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
STATEMENT OF COMPLETION
FOR SUBMITTING PROOF OF BENEFICIAL USE

FOR OFFICE USE ONLY	
Amt. of Fee \$	225.00
Receipt No.	C109821
Received By	Ku
Date Received	1.20.21

The Idaho Department of Water Resources considers this form a statement by the permit holder(s) that development of a water right has been **completed** and that water has been applied to beneficial use to the extent described below. **This form must be accompanied by an examination fee, when necessary, or by a completed Beneficial Use Field Report prepared by a certified water right examiner.** Please refer to the instructions and fee schedule for this form. If ownership of the permit has changed, contact any Department office or visit the Department's website at idwr.idaho.gov for an *Assignment of Permit* form. If you wish to relinquish your permit because you have not established the authorized use of the water and are not applying for an extension, please notify the Department in writing.

- Permit No. 96-09498 Telephone No. 208-762-2900
- Name of Permit Holder(s) Idaho Forest Group, LLC
- Mailing Address 687 Canfield Ave. Suite 100 City Coeur d'Alene
State Idaho Zip 83716 Email tom.schultz@idfg.com
- Source of Water Pend Oreille River If **GROUND WATER** (well), Date Drilled mo. ____ / yr. ____
Well Driller _____ Drilling Permit Number _____
- Extent of use(s) completed as authorized by the water right permit:
Domestic (No. of households) _____ Stockwater (No. and type of stock) _____
Irrigation (No. of acres) 120 Other Irrigation 1.2 cfs; Industrial 0.22 cfs; Fire Protection 1.2 cfs
- Total rate of diversion or storage volume for which proof is submitted 1.2 cfs OR 104.4 acre-feet.
- Compliance with a measuring device requirement, lockable controlling device requirement, and/or other conditions of permit:
Refer to the approval conditions on your permit and respond accordingly.
The Department will not issue a license if permit conditions are not met.

Measuring Device	Is a measuring device required?	Yes ☐	No ☒
	If yes, has the measuring device been installed?	Yes ☐	No ☐
Lockable Controlling Device	Is a lockable device required to control the diversion?	Yes ☐	No ☒
	If yes, has the lockable device been installed?	Yes ☐	No ☐
Fish Screen	Is a fish screen required?	Yes ☒	No ☐
	If yes, has the fish screen been installed?	Yes ☒	No ☐

Other Conditions of Permit

Do the approval conditions on your permit require you to submit additional information in connection with your proof of beneficial use? If yes, list the conditions below and attach documents with the required information.

_____ Completed? Yes ☐ No ☒

- Fee Enclosed \$ 225.00 or not applicable ☐. See fee schedule on page 2 of the instructions.
Proof statements filed without an appropriate fee, will be considered incomplete.
- Person to contact to accompany the Department representative during field examination of the water system.
Name Mike Henley Telephone Number 208-255-3238
Mailing Address 4447 E. Chilco Rd. City Athol
State Idaho Zip 83801 Email mhenley@idfg.com

The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted and applied to a beneficial use. I understand that any undeveloped portion of the permit is relinquished to the State of Idaho.

Signature of Permit Holder

Tom Schultz
(Include your title, if on behalf of company or organization)

Date

1/20/2021

WITHDRAWN

SCANNED

JAN 26 2021



FORESITE
ENGINEERING

January 19th, 2021

Idaho Department of Water Resources (IDWR)
7600 Mineral Drive, Suite 100
Coeur d'Alene, Idaho 83815

RE: STATEMENT OF COMPLETION 96-09498 STATEMENT OF COMPLETION

Dear IDWR,

Attached is a Statement of Completion for permit number 96-09498 associated with Idaho Forest Group's Laclede Mill Facility. There are two points of diversion for the facility; one in the northwest corner and the second at the Laclede boat launch southeast of the facility.


The northwest point of diversion has been metered since 2015. The annual average water usage is 82 acre-feet. This northwestern point of diversion is capable of pumping 450 gpm or 1.0 cfs. See attached 40 horsepower pump curve for reference.

The Laclede boat launch point of diversion does not have a flow meter. However, it does have a dedicated power meter. The attached pump curve has been utilized to estimate the annual usage based on power records from 2019 and 2020. The annual average water usage is 22.4 acre-feet. This southeastern point of diversion has two pumps capable of pumping 50 gpm or 0.1 cfs each for a total of 0.2 cfs. See attached 10 horsepower pump curve for the two pumps.

The total composite facility annual average water diversion is approximately 104 acre-feet at a maximum rate of 1.2 cfs.

Please contact me if you have any questions.

Thank you,

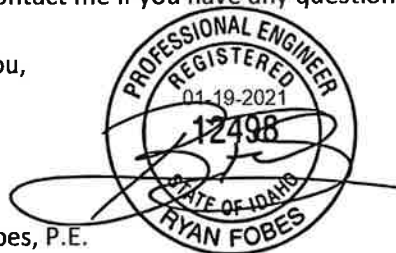

Ryan Fobes, P.E.
FORESITE ENGINEERING



SCANNED
JAN 26 2021



Franklin Electric

Bluffton, Indiana 46714 • www.franklin-electric.com

180 STS 5" Pump Performance

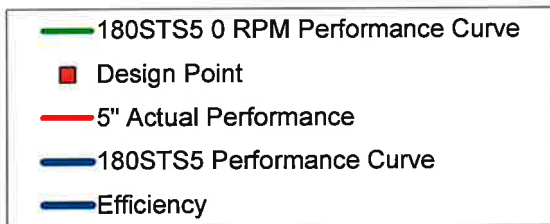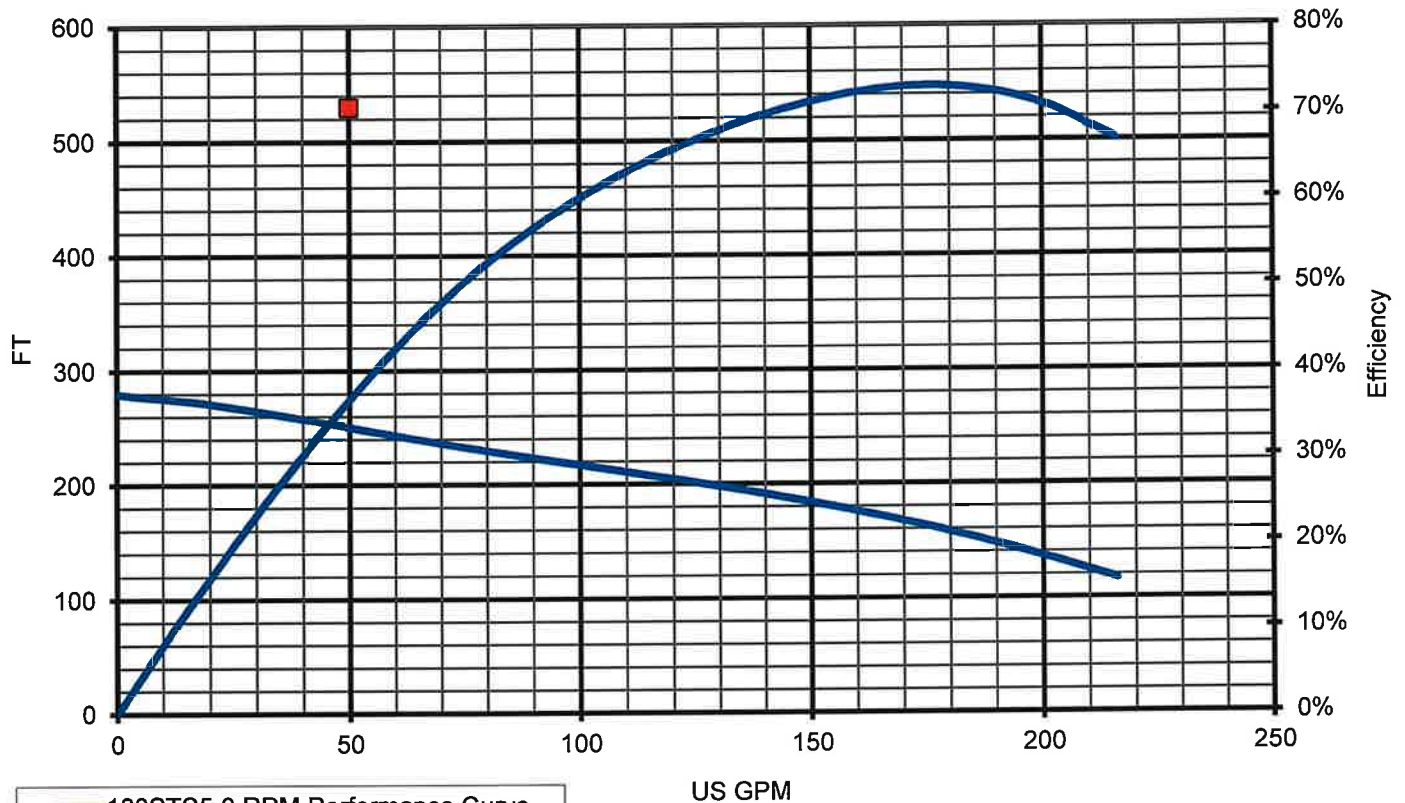


Max Power on Curve: **9.9 HP**

Motor Selection: **6in 5-40HP**

4 A trim impellers
0 B trim impellers
1 C trim impellers

Power Required

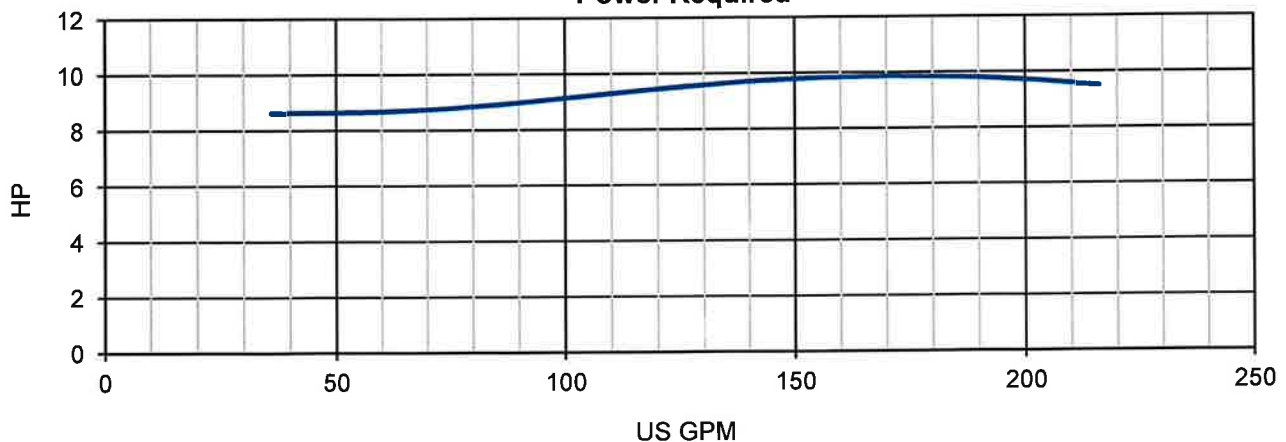

SCANNED
JAN 7 6 2021

GOULDS WATER TECHNOLOGY a xylem brand	Mod. VIS-BAT Speed Variable	Size 6DHHC Frequency 60Hz
Purchaser End User Item No. ITEM 001 Service Certified By	Liquid Nom. Temperature 70.0 deg F Spec. Gravity 1.000 Viscosity 1.000 cp Vapor Press Solids% / Size	Date 03/02/2012 Issued by: Tony McBride Quotation No. TM12-03-02 01 Job/Inq.No. Order No.
Rated Operating Point		
Capacity 450.0 gpm Head 250.0 ft NPSHa NPSHr 26.1 ft Rated Efficiency 72.3 % Suction Spec. Speed 6,631 gpm(US) ft	Power - Pump 40.53 hp Power - Loss 0.00 hp Power - Others Power - Totals 40.53 hp Power - max. 43.1 hp	No. of Stages 1 Imp. Dia. 1st Stg: 3.7500 in Imp. Dia. Adl Stg: Min. Hydraulic Flow 125.7 gpm Min. Thermal Flow N/A
Notes: 1. Bowl Performance Curve based on Pumping Clear, non-Aerated Water. Rated Point only is guaranteed.		

