

FEB 22 2021

DEPARTMENT OF
WATER RESOURCES

Form 219 07/11

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A Beneficial Use Field Report is prepared by a water right examiner as the result of an examination to clearly confirm and establish the extent of the beneficial use of water established in connection with a permit during the development period authorized by the permit and any extensions of time previously approved.

A. GENERAL INFORMATIONPermit No. 63-34104

1. Owner Kelly Fulfer and Brenda Fulfer Phone No. 208-870-5991
 Current address PO Box 455, Meridian, ID 83680
2. Examiner's name Terry Scanlan CWRE 129 EXAM DATE January 8, 2021
3. Accompanied by Ron Wyatt Email gravel@superioridaho.com
 Address 2350 West McMillan Road, Meridian, ID 83680
 Relationship to permit holder Foreman for owner's construction company Phone No. 208-890-5501
4. Source Ground Water tributary to _____

B. OVERLAP REVIEW

1. Other water rights with the same place of use 63-31631, 63-31724
2. Other water rights with the same source and point of diversion _____

C. DIVERSION AND DELIVERY SYSTEM


1. Point(s) of Diversion:

Ident. No.	Gov't Lot	¼	¼	¼	Sec	Twp	Rge	County	Method of Determination/Remarks
			NE	NW	24	2N	1E	Ada	GIS, GPS

2. Place(s) of Use: Method of determination GIS, I = Industrial Use

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
2N	1E	24					I	I											

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe diameter (inside), as applicable. Use the space provided or ☒ see attached.

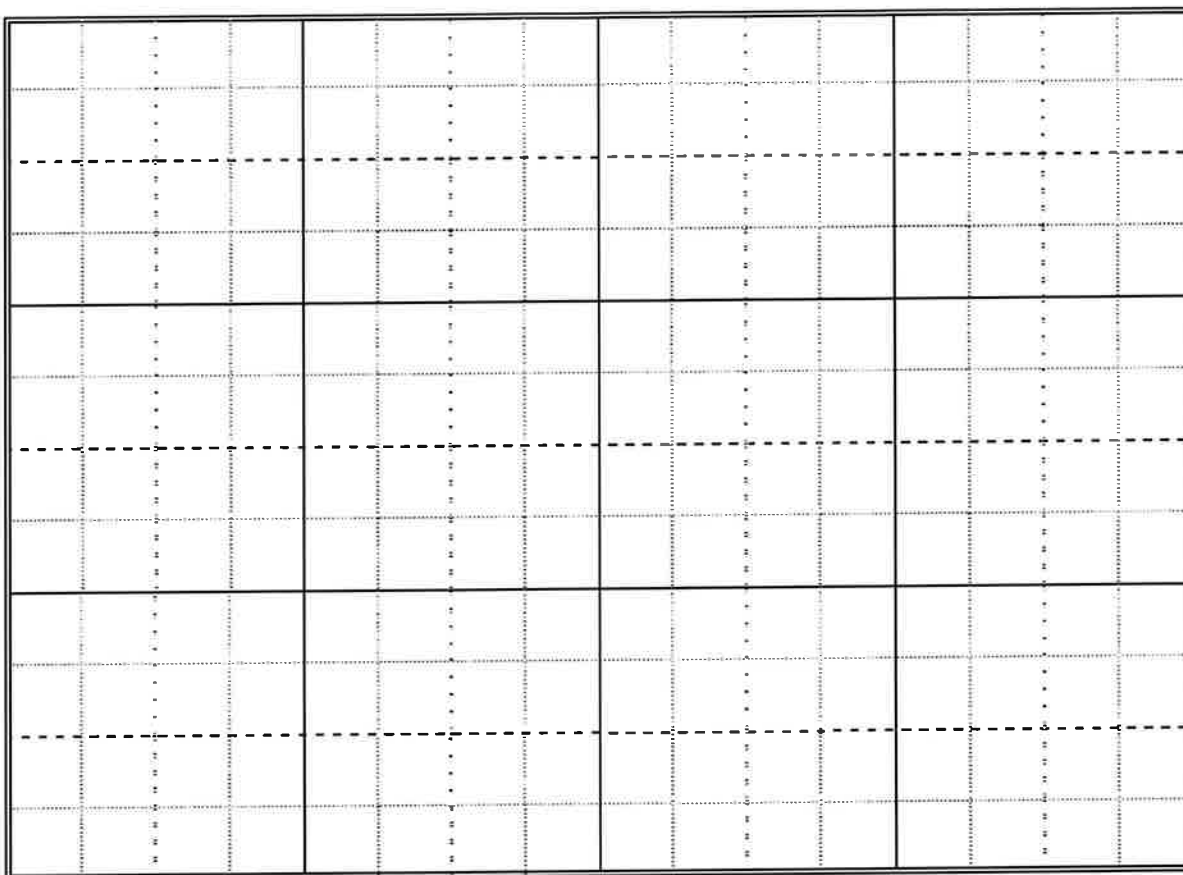

Scale: 1" = _____

- ☒ Copy of USGS Quadrangle attached showing location(s) of point(s) of diversion and place(s) of use (required)
☒ Aerial photo attached (required for irrigation of 10+ acres)
☒ Photo of diversion and system attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
D0070139	Hitachi submers.	50	G28039E	Goulds 7CHC	unknown (submersible)
				4-stage	
				4.8125-inch trim	

*Code to correspond with no. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
container and stop watch	trash can	Rubbermd			27 gal	2/9/2021

2. **Measurements:** _____

Two successful measurements were made to fill a 27-gpm container from a fire hose. 27 gallons in 4.0 seconds = 0.9 cfs. The flow and pressure from the fire hose was very strong, making measurement difficult. A more precise measurement was deemed unnecessary because the measured rate was more than 4 times the permit rate.

E. NARRATIVE/REMARKS/COMMENTS

An 8-inch diameter well equipped with a 50-hp submersible pump supplies water to a gravel pit and gravel washing operation. The place of use and general purposes of use are shared with water rights 63-31631 and 63-31724. Those rights are authorized for diversion from the 8-inch well and from a separate 6-inch well, and include uses at the gravel pit office and scale house. The 6-inch well has a capacity of 0.13 cfs (63-31724 exam). The piping systems from the two wells are not interconnected. The purpose of permit 63-34104 is to allow diversion of additional ground water (rate and volume) for gravel washing and dust abatement uses.

The system consists of approximately 300 feet of 4-inch (?) diameter buried pipe from a pitless unit at the well to a fire hose connection for a wash plant and truck fill. A single yard hydrant is also connected to the pipeline.

The place of use is owned by Fulfer Properties LLC. Kelly Fulfer is listed as the sole member on the 2021 Annual Report. The place of use is operated by Superior Construction. Kelly Fulfer and Brenda Fulfer are president and vice president, respectively, of Superior Construction.

Attachment A: Permit and proof of beneficial use

Attachment B: Topographic map, aerial photo map, system diagram, and property ownership map

Attachment C: Well drillers report and well pump curve

Attachment D: Photos

Has the permit holder met all conditions of permit approval, including any mitigation requirements and/or measuring device installation requirements? ☒ Yes ☐ No If no, what must be done to meet the permit requirements?

F. FLOW CALCULATIONS☒ Additional computation sheets attached

Measured Method:

Timing of filling 27-gallon container. 4 seconds for 27 gallons = 405 gpm = 0.90 cfs

Theoretical based on horsepower = 50 hp x 3960 x 0.78 / 400 feet TDH = 386 gpm = 0.86 cfs

Pump curve design point 454 gpm (1.01 cfs) at 356 feet TDH. The permit limits diversion to 0.20 cfs

There is no need for a combined flow rate limit with 63-31631 and 63-31724 because the source capacity (0.90 + 0.13 = 1.03 cfs) is far greater than the sum of this permit and the two licenses (0.04 + 0.06 + 0.20 = 0.30 cfs)

G. VOLUME CALCULATIONS**1. Volume Calculations for Irrigation:**

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{n/a}$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{0.2 \times 365 \times 1.9835 = 145 \text{ afa}}$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}}$$

2. Volume Calculations for Other Uses:

Wash plant, 0.2 cfs, 6 hrs/day, 3 days/week, 9 months (39.3 weeks)/yr = 11.7 afa

Water truck, 4000 gallons/load, 2 loads/day, 5 days/week, 9 months/yr = 4.8 afa

Miscellaneous wash down water, 1000 gal/day, 5 days/week, 9 months/yr = 0.6 afa

Total = 11.7 + 4.8 + 0.6 = 17.1 afa

Annual volume not to exceed 17.1 afa in combination with 63-31724 and 63-31631.

H. RECOMMENDATIONS**1. Recommended Amounts**

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Industrial	1/1	12/31	0.2 cfs	17.1 af
Totals:			0.2 cfs	

2. Recommended Amendments☐ Change P.D. as reflected on page 1☐ Add P.D. as reflected on page 1☒ None☐ Change P.U. as reflected on page 1☐ Add P.U. as reflected on page 1☐ Other**I. AUTHENTICATION**

Field Examiner's Signature

Terry M. Scanlan

Date

February 18, 2021

Reviewer

Date



ATTACHMENT A

PERMIT RECORD AND PROOF OF BENEFICIAL USE



BRAD LITTLE
Governor

State of Idaho

DEPARTMENT OF WATER RESOURCES

322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098

Phone: (208) 287-4800 • Fax: (208) 287-6700 • Website: www.idwr.idaho.gov

GARY SPACKMAN
Director

January 8, 2021

KELLY FULFER
BRENDA FULFER
PO BOX 455
MERIDIAN ID 83680

LAPSE NOTICE

RE: PERMIT NO. 63-34104

IMPORTANT: This permit has lapsed because no written response was received from you by the IDWR. Development and/or use must cease.

Dear Permit Holders:

You are hereby notified that under the provisions of Idaho Code § 42-218a, the above referenced permit has lapsed and is of no further force nor effect. The Department provided the proper forms to you in the proof due notice dated October 30, 2020. No further construction or additional development is authorized under this permit.

If water was put to beneficial use prior to the date proof of beneficial use was due, you may file the Statement of Completion (proof) now, or if you or a previous owner of this permit have not received a prior extension of time, you may file the Request for Extension of Time (extension request) if the delay is for reasonable cause as provided in Idaho Code § 42-204. You may also request an extension of time if you have been delayed by a government agency, or by litigation that brings title to the water in question.

Either an acceptable proof or an acceptable extension request must be received by this Department within sixty (60) days of the mailing of this lapse notice in order to reinstate this permit.

Please contact Debbi Judd at 208-287-4920, if you need additional assistance.

Sincerely,

Angie Grimm, Manager
Water Rights Section

CERTIFICATION OF MAILING

I hereby certify that on 1-8-21
a copy/an original of this document was
deposited in the United States mail, postage
prepaid addressed to the individual(s)
named above.

c: SPF WATER ENGINEERING LLC – via email

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
STATEMENT OF COMPLETION
FOR SUBMITTING PROOF OF BENEFICIAL USE

FOR OFFICE USE ONLY	
Amt. of Fee \$ _____	Receipt No. _____
Received By _____	Date Received _____

The Idaho Department of Water Resources considers this form a statement by the permit holder(s) that development of a water right has been **completed** and that water has been applied to beneficial use to the extent described below. **This form must be accompanied by an examination fee, when necessary, or by a completed Beneficial Use Field Report prepared by a certified water right examiner.** Please refer to the instructions and fee schedule for this form. If ownership of the permit has changed, contact any Department office or visit the Department's website at idwr.idaho.gov for an *Assignment of Permit* form. If you wish to relinquish your permit because you have not established the authorized use of the water and are not applying for an extension, please notify the Department in writing.

1. Permit No. 63-34104 Telephone No. 208-870-5991
2. Name of Permit Holder(s) Kelly and Brenda Fulfer
3. Mailing Address PO Box 455 City Meridian
State ID Zip 83680 Email kelly@superioridaho.com March 2004
4. Source of Water Ground Water If **GROUND WATER** (well), Date Drilled mo. August / yr. 2015
Well Driller SOS & Stevens & Sons, Drilling Permit Number 2004 Well: 880965-810422
2015 Well: 970155-876212
5. Extent of use(s) completed **as authorized by the water right permit:**
Domestic (No. of households) _____ Stockwater (No. and type of stock) _____
Irrigation (No. of acres) _____ Other Industrial Use

6. Total rate of diversion or storage volume for which proof is submitted 0.2 cfs **OR** _____ acre-feet.
7. Compliance with a measuring device requirement, lockable controlling device requirement, and/or other conditions of permit:
Refer to the approval conditions on your permit and respond accordingly.

The Department will not issue a license if permit conditions are not met.

Measuring Device	Is a measuring device required?	Yes ☐	No ☒
	If yes, has the measuring device been installed?	Yes ☐	No ☐
Lockable Controlling Device	Is a lockable device required to control the diversion?	Yes ☐	No ☒
	If yes, has the lockable device been installed?	Yes ☐	No ☐
Fish Screen	Is a fish screen required?	Yes ☐	No ☒
	If yes, has the fish screen been installed?	Yes ☐	No ☐

Other Conditions of Permit


Do the approval conditions on your permit require you to submit additional information in connection with your proof of beneficial use? If yes, list the conditions below and attach documents with the required information.

_____ Completed? Yes ☐ No ☐

8. Fee Enclosed \$ n/a or not applicable ☐. See fee schedule on page 2 of the instructions.
Proof statements filed without an appropriate fee, will be considered incomplete.
9. Person to contact to accompany the Department representative during field examination of the water system.

Name n/a - exam conducted by SPF Telephone Number _____
Mailing Address _____ City _____
State _____ Zip _____ Email _____

The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted and applied to a beneficial use. I understand that any undeveloped portion of the permit is relinquished to the State of Idaho.

Signature of Permit Holder  Date 2-11-2007
(Include your title, if on behalf of company or organization)

Mail to: Idaho Department of Water Resources, PO Box 83720, Boise, ID 83720-0098

State of Idaho
Department of Water Resources
Permit to Appropriate Water

NO. 63-34104

Priority: July 06, 2015

Maximum Diversion Rate: 0.20 CFS

This is to certify, that KELLY FULFER And/Or
BRENDA FULFER
PO BOX 455
MERIDIAN ID 83680

has applied for a permit to appropriate water from:

Source: GROUND WATER

and a permit is APPROVED for development of water as follows:

BENEFICIAL USE

INDUSTRIAL

PERIOD OF USE

01/01 to 12/31

RATE OF DIVERSION

0.20 CFS

LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER NE1/4NW1/4 Sec. 24, Twp 02N, Rge 01E, B.M. ADA County

GROUND WATER NE1/4NW1/4 Sec. 24, Twp 02N, Rge 01E, B.M. ADA County

PLACE OF USE: INDUSTRIAL

Twp Rge Sec	NE				NW				SW				SE				Totals
	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
02N 01E 24					X	X											

CONDITIONS OF APPROVAL

1. Proof of application of water to beneficial use shall be submitted on or before **January 01, 2021**.
2. Subject to all prior water rights.
3. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code and applicable Well Construction Rules of the Department.
4. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which the permit holder had no control.
5. The Director retains jurisdiction to require the right holder to provide purchased or leased natural flow or stored water to offset depletion of Lower Snake River flows if needed for salmon migration purposes. The amount of water required to be released into the Snake River or a tributary, if needed for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this permit.
6. Commercial use is for gravel washing and dust abatement.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.

Signed this 6th day of January, 2016.



Nick Miller

Manager, IDWR Western Region

State of Idaho
Department of Water Resources

Attachment to Permit to Appropriate Water
63-34104

This map depicts the INDUSTRIAL place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.

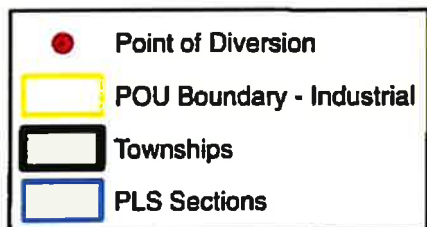


0 0.075 0.15 0.3 Miles





ATTACHMENT B

**TOPOGRAPHIC MAP, 2018 AERIAL PHOTO,
PROPERTY OWNERSHIP MAP, AND SYSTEM DIAGRAM**

Path: S:\PROJECTS\IE thru H\Projects\IE\Projects\Fulfer, Kelly_11940010_Gravel Pit Property\PROJECT\GIS\AerialMap_Properties\BUFE Map.mxd

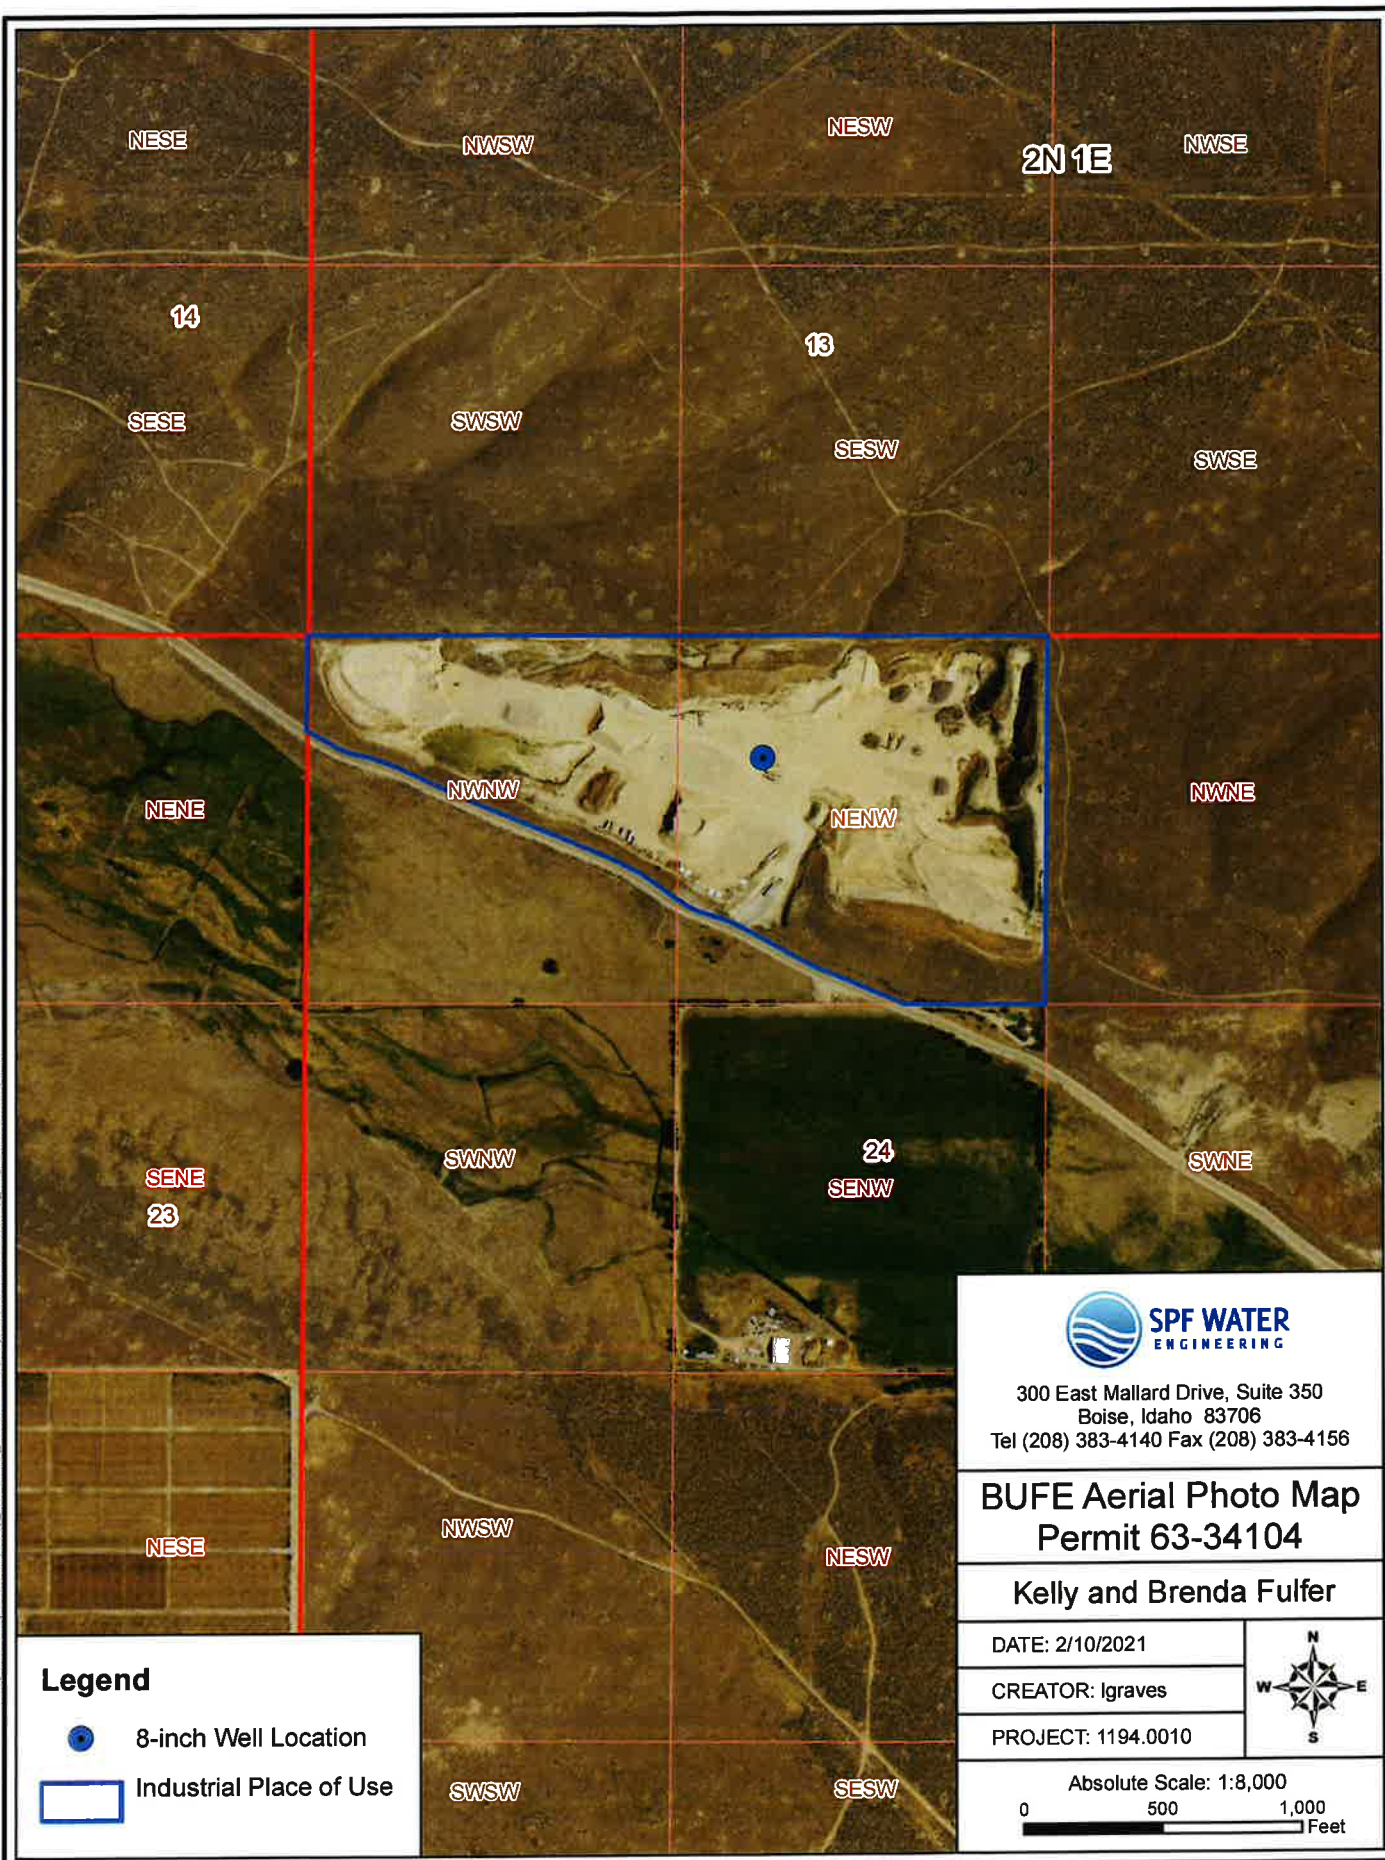

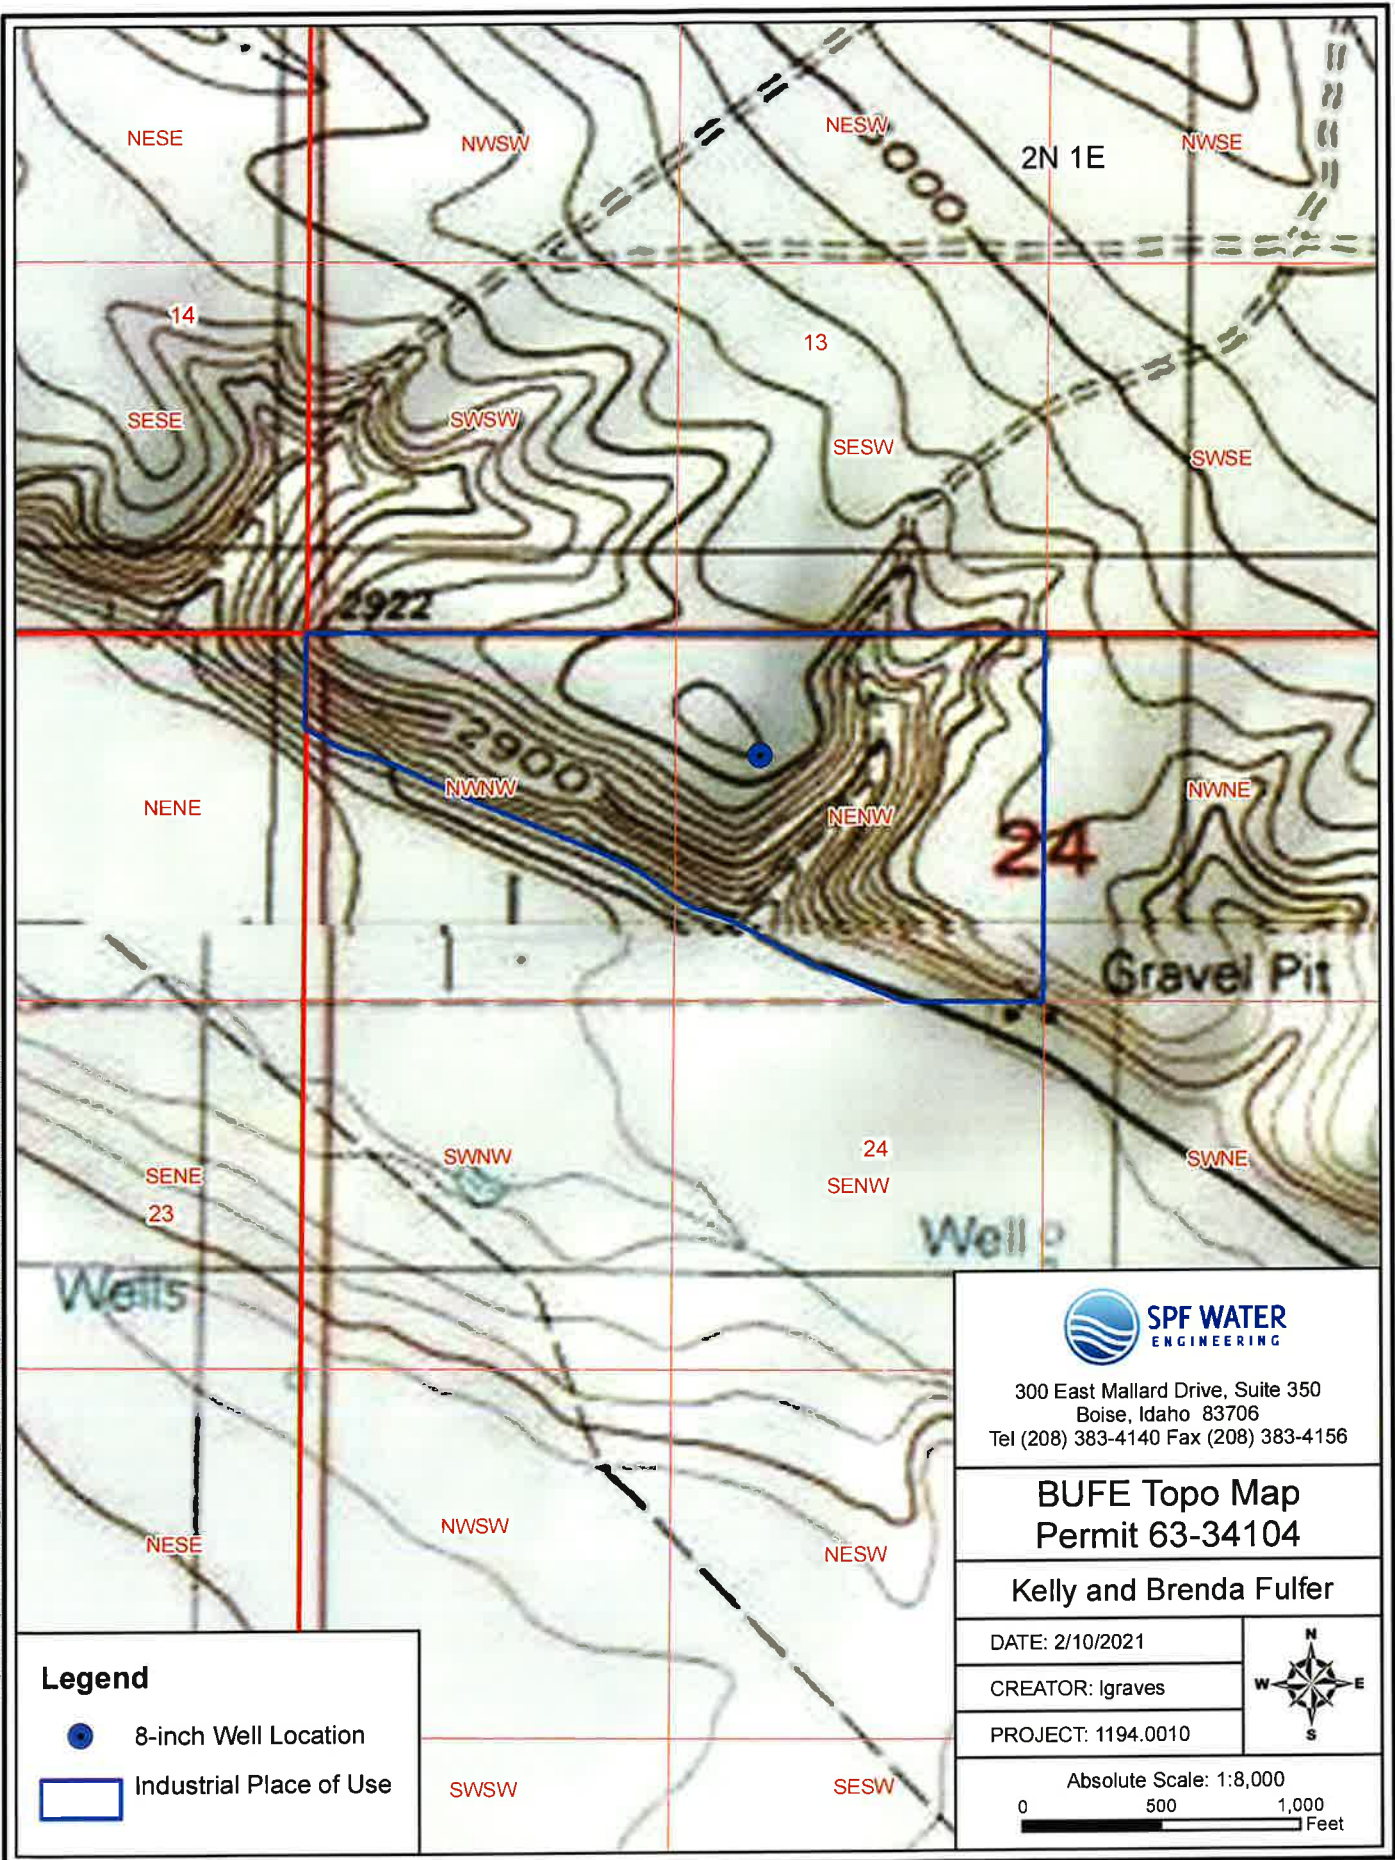

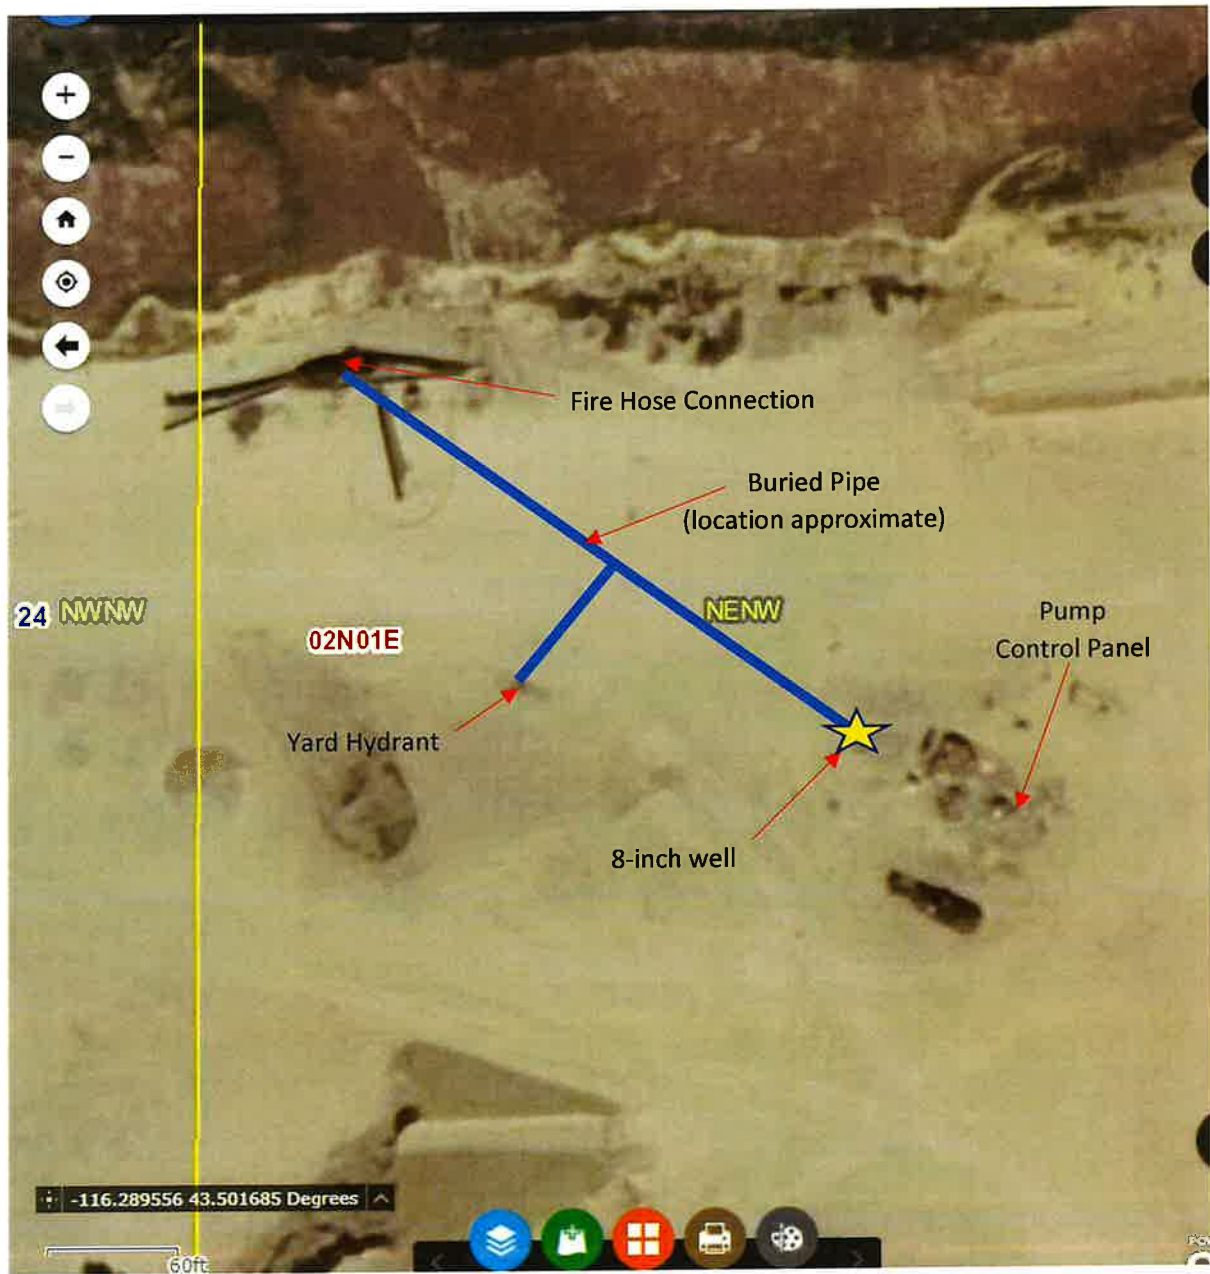

System Schematic


Ada County Assessor
Land Records/GIS

2021 Property Details for Parcel S1424210000
2021 [Change Year](#) [Need Help? Email the Appraiser Assigned to this Parcel](#)
[Print View](#)

[Home](#)
[Assessor Main Page](#)
[Help Index](#)
[FAQ](#)
[About Us](#)
[Contact Us](#)
[Disclaimer](#)

Property Search
[Search by Parcel](#)
[Search by Address](#)
[Search by Subdivision](#)
[Online Documents](#)
[Interactive Map](#)

Details | **Valuation** | **Tax Districts** | **Taxes** | **Characteristics** | **Sketch**
Parcel: S1424210000
Year: 2021
Parcel Status: Active in 2021
Primary Owner:
FULFER PROPERTIES LLC
Zone Code: RP
Total Acres: 80
Tax Code Area: 234
Instrument Number:
107052073
Property Description:
N2NW4
SEC 24 2N 1E

[View Interactive Map of this Parcel](#)
Address: W TENMILE CREEK RD KUNA, ID 83634
Subdivision: 2N 1E 24
Land Group Type: SECT
Township/Range/Section: 2N1E24
[Contact Us](#) | [Disclaimer](#)



Property Ownership – Fulfer Properties LLC (Kelly Fulfer – Member)



0004128816

**STATE OF IDAHO***Office of the secretary of state, Lawrence Denney***ANNUAL REPORT**

Idaho Secretary of State

PO Box 83720

Boise, ID 83720-0080

(208) 334-2301

Filing Fee: \$0.00

For Office Use Only

-FILED-

File #: 0004128816

Date Filed: 1/11/2021 11:30:41 AM

Entity Name and Mailing Address:

Entity Name:

FULFER PROPERTIES, LLC

The file number of this entity on the records of the Idaho Secretary of State is: 0000189865

Address

PO BOX 488
MERIDIAN, ID 83680-0488

Entity Details:

Entity Status

Active-Existing

This entity is organized under the laws of:

IDAHO

If applicable, the old file number of this entity on the records of the Idaho Secretary of State was: W59527

The registered agent on record is:

Registered Agent

KELLY G FULFER

Registered Agent

Physical Address

2350 W. MCMILLAN RD.

MERIDIAN, ID 83646

Mailing Address

Limited Liability Company Managers and Members

Name	Title	Business Address
 Kelly G Fulfer	Member	2350 W. MCMILLAN RD. MERIDIAN, ID 83646

The annual report must be signed by an authorized signer of the entity.

Job Title: Single Member

Kelly Fulfer

Sign Here

01/11/2021

Date

B0567-6773 01/11/2021 11:30 AM Received by ID Secretary of State Lawrence Denney

ATTACHMENT C

**WELL DRILLER'S REPORT AND
WELL PUMP CURVE**

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

1. WELL TAG NO. D 0070139
Drilling Permit No. 970155-876212
Water right or injection well # 63-31724

2. OWNER:
Name Kelly Fulfer
Address 2350 W. McMillan
City Meridian State Id. Zip 83642

3. WELL LOCATION:
Twp. 2 North ☒ or South ☐ Rge. 1 East ☒ or West ☐
Sec. 24 1/4 N.E. 1/4 N.W. 1/4

Gov't Lot _____ County Ada
Lat. 43 30.100 (Deg. and Decimal minutes)
Long. 116 17.293 (Deg. and Decimal minutes)
Address of Well Site 8445 Ten Mile Creek Road
City Kuna

(Give street name of road - Distance to Road or Landmark)
Lot _____ Blk. _____ Sub. Name _____

4. USE:
☐ Domestic ☐ Municipal ☐ Monitor ☒ Irrigation ☐ Thermal ☐ Injection
☒ Other Industrial

5. TYPE OF WORK:
☒ New well ☐ Replacement well ☐ Modify existing well
☐ Abandonment ☐ Other _____

6. DRILL METHOD:
☒ Air Rotary ☒ Mud Rotary ☐ Cable ☐ Other _____

7. SEALING PROCEDURES:
Seal material From (ft) To (ft) Quantity (lbs or ft³) Placement method/procedure
Bentonite chips 0' 21' 600 lbs Poured

8. CASING/LINER:
Diameter (nominal) From (ft) To (ft) Gauge/Schedule Material Casing Liner Threaded Welded
8" +2'6" 400' .250 Steel ☒ ☐ ☐ ☒

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) 400'

9. PERFORATIONS/SCREENS:
Perforations ☐ Y ☒ N Method _____
Manufactured screen ☒ Y ☐ N Type Johnson Vee Wire
Method of installation Mud drilled & lowered

From (ft)	To (ft)	Slot size	Number/ft	Diameter (nominal)	Material	Gauge or Schedule
404'	444'	.025		5"	Steel	

Length of Headpipe 15' Length of Tailpipe 0'

Packer ☒ Y ☐ N Type Figure K

10. FILTER PACK:
Filter Material From (ft) To (ft) Quantity (lbs or ft³) Placement method

11. FLOWING ARTESIAN:
Flowing Artesian? ☐ Y ☒ N Artesian Pressure (PSIG) _____
Describe control device _____

12. STATIC WATER LEVEL and WELL TESTS:
Depth first water encountered (ft) 276' Static water level (ft) 276'
Water temp. (°F) 62 Bottom hole temp. (°F) _____

Describe access port _____
Well test: Test method:
Drawdown (feet) Discharge or yield (gpm) Test duration (minutes) Pump Boiler Air Flowing artesian
☐ ☐ ☐ ☐ ☐ ☐

Water quality test or comments: _____

13. LITHOLOGIC LOG and/or repairs or abandonment:

Bore Dia. (in)	From (ft)	To (ft)	Remarks, lithology or description of repairs or abandonment, water temp.	Water	
				Y	N
12"	0'	21'	Sand		X
8"	21'	30'	Sand		X
	30'	95'	Lightly cemented sand & gravel		X
	95'	108'	Mostly sand		X
	108'	112'	Clay streak		X
	112'	122'	Cemented sand, some gravel		X
	122'	126'	Clay		X
	126'	188'	Sand & gravel		X
	188'	195'	Clay		X
	195'	444'	Sand some gravel with cemented streaks	X	

RECEIVED

SEP 02 2015

WATER RESOURCES
WESTERN REGION

Completed Depth (Measurable): 444'
Date Started: Aug 6, 2015 Date Completed: Aug 20, 2015

14. DRILLER'S CERTIFICATION:
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Stevens & Sons Co. No. 153
*Principal Driller Date Aug 21, 2015
*Driller Date Aug 21, 2015
*Operator II Date _____
Operator I Date _____

* Signature of Principal Driller and rig operator are required.

Done

STEVENS 7C 50HP.PDF



Pump Data Sheet

Company:
Name:
Date: 02/11/2021

Customer:



Pump:
 Size: 7CHC (stages: 4)
 Type: Submersible
 Suction: ---
 Synch Speed: 3600 rpm
 Dia: 4 @ 125 mm
 Discharge: ---
 Vertical Turbine
 Svc Area:
 Bowl Size: 7.13 in
 Max Lift: 6.5 in
 Thrust K Factor: 3.5 in/lb

Fluid:
 Name: Water
 SG: 1
 Density: 62.4 lb/ft³
 Viscosity: 1.1 cP
 Temperature: 60 °F
 Vapor Pressure: 0.256 psi a
 Alt Pressure: 14.7 psi a
 Margin Ratio: 1

Pump Limits:
 Temperature: ---
 Wdg Pressure: ---
 Sphere Size: 0.56 in

Search Criteria:


Flow: 450 US gpm
 Head: 350 ft
 Near Max
 Static Head: 0 ft

Motor:
 Standard: NEMA
 Enclosure: SUD
 Frame: 8 inch
 Size: 50 hp
 Speed: 3600 rpm
 Max Power on Design Curve

Pump Selection Warnings:

None

--- Duty Point ---	
Flow:	454 US gpm
Head:	356 ft
Eff:	78.1%
Power:	62.3 hp
NPSh:	17.8 ft
Speed:	3600 rpm
--- Design Curve ---	
Shutoff Head:	400 ft
Shutoff dP:	199 psi
Min Flow:	101 US gpm
SEP:	79.9% @ 405 US gpm
NOL Power:	58.5 hp @ 540 US gpm
--- Max Curve ---	
Max Power:	75.1 hp @ 638 US gpm

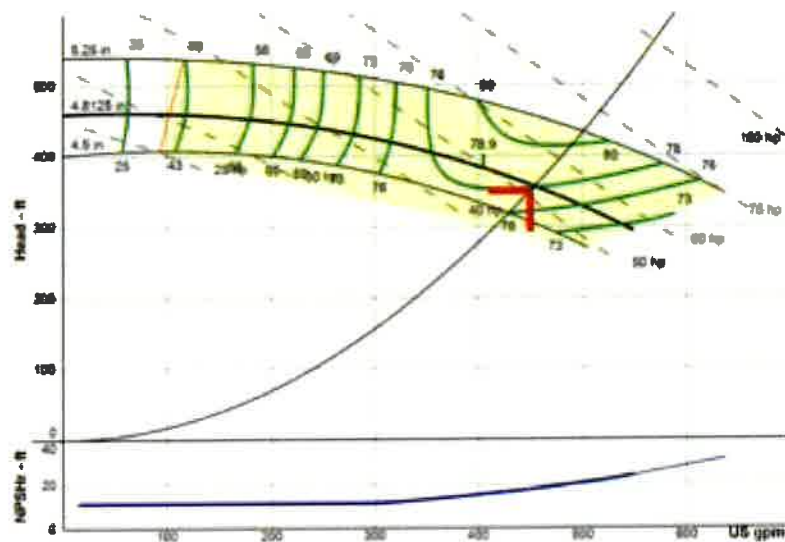

Performance Evaluation:

Flow US gpm	Speed rpm	Head ft	Efficiency %	Power hp	NPSh ft
540	3600	300	72.7	58.3	23
450	3600	359	76.2	52.1	17.3
360	3600	403	78.1	46.9	13.2
270	3600	434	72.3	41	11.3
180	3600	453	58.3	35.3	11.3

ATTACHMENT D
PHOTOS




Office at entrance to gravel pit place of use. Office is served from a separate well under right 63-31631 and 63-31724.




8-inch well head with pitless unit for submersible pump.



VFD control panel for 50-hp submersible pump

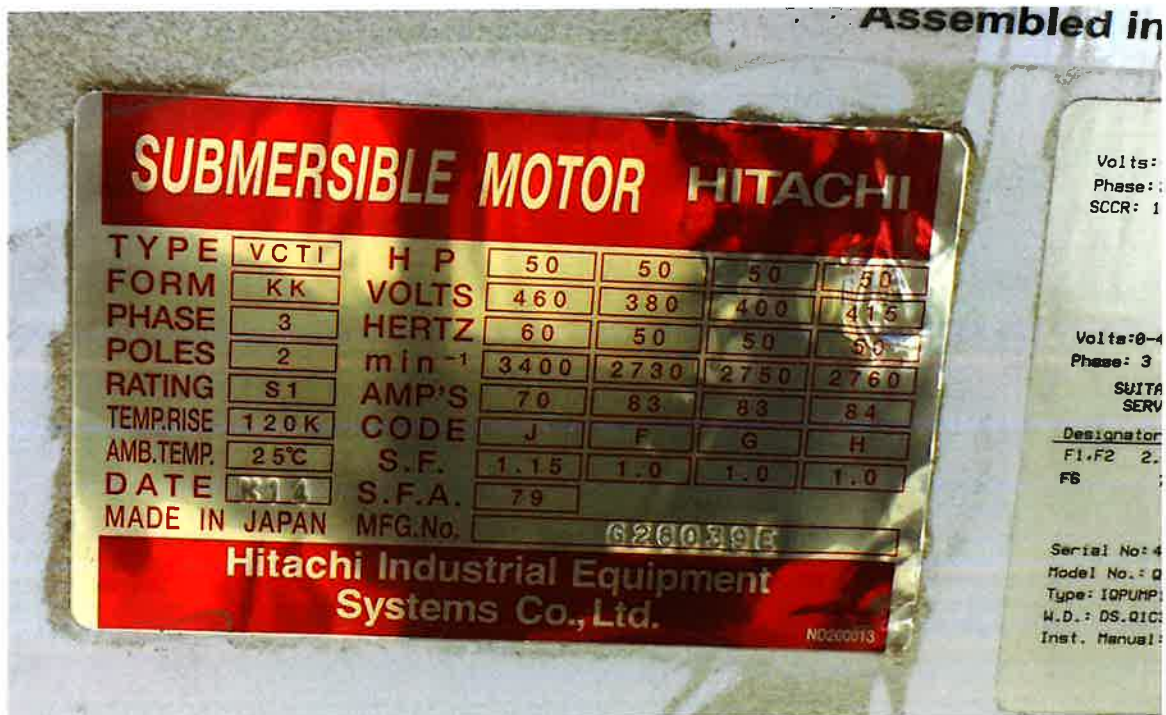

Submersible pump motor sticker inside of VFD control panel

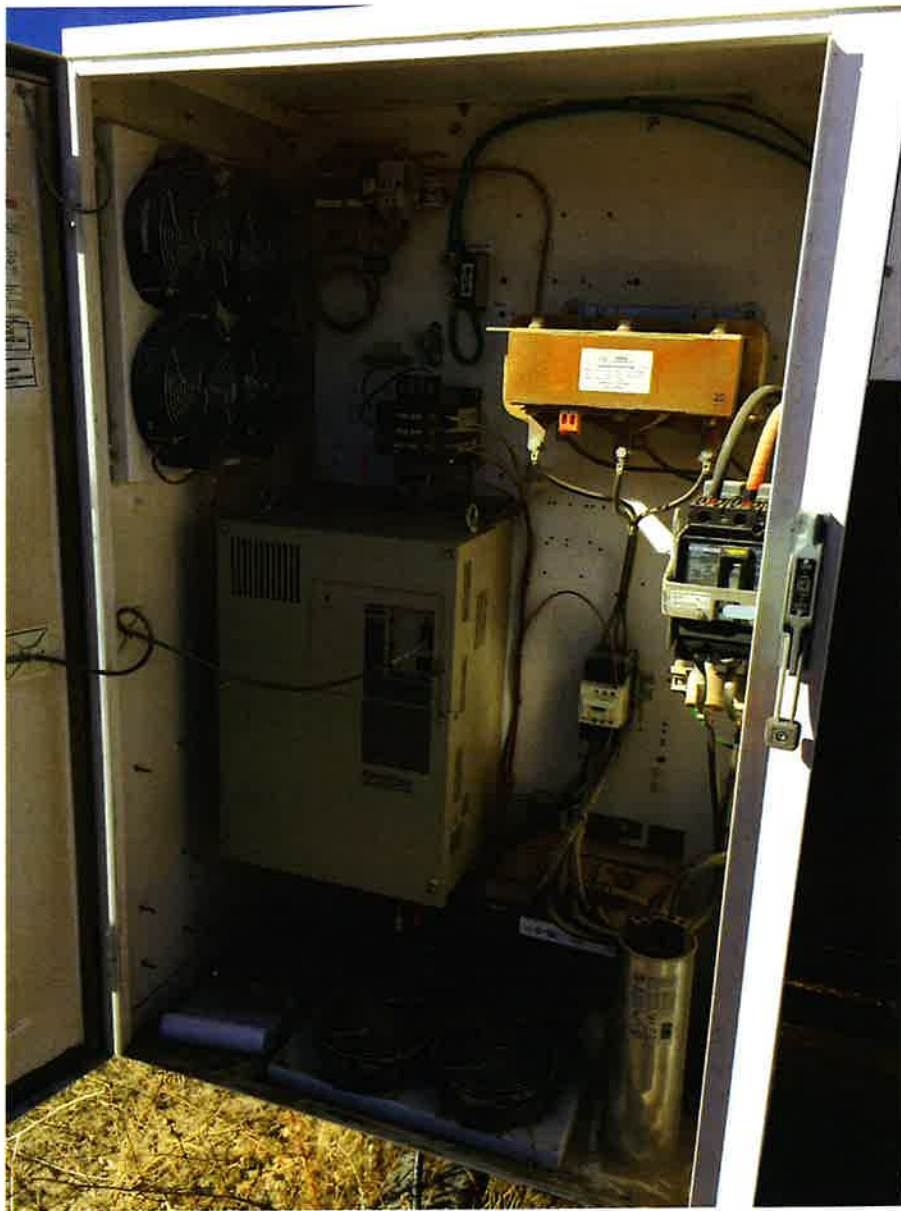

Inside of pump control panel with VFD, harmonic mitigation, and circuit breaker.



Terminus of pipeline from well. Shut-off valve handles for 4-inch pipeline and for pipeline to yard hydrant.



Fire hose discharge used for flow measurement



Yard hydrant.



Gravel washing plant



SPF WATER
ENGINEERING

RECEIVED

FEB 22 2021

DEPARTMENT OF
WATER RESOURCES

February 18, 2021

Angela Grimm, P.G.
Idaho Department of Water Resources
322 East Front Street
Boise, ID 83702-7371

Subject: 63-34104 – Proof of Beneficial Use and Beneficial Use Field Report

Dear Angie:

Enclosed on behalf of Kelly and Brenda Fulfer are a completed Beneficial Use Field Report and a signed Statement of Completion for permit 63-34104.

Permit 63-34104 lapsed on January 2, 2021. A letter notifying the permit holder of the lapse was sent by you on January 8, 2021. As demonstrated by the enclosed Beneficial Use Field Report, the permit was developed and beneficial use established. In accordance with Idaho Code 42-218a(2), the permit holders now request that the permit be reinstated and licensed, with the priority date advanced by the number of days since the permit lapsed.

Please contact me with any questions.

Sincerely,

Terry M. Scanlan

Terry M. Scanlan, P.E., P.G.
CWRE No. 129

Cc: Kelly Fulfer (kelly@superioridaho.com)

Enclosures

SPF file number: 1194.0010