

MINIMUM REQUIREMENTS CHECKLIST
TO BE SUBMITTED WITH APPLICATION FOR TRANSFER

An application for transfer must be prepared in accordance with the minimum requirements listed below to be acceptable for processing by the Department. Incomplete applications will be returned. The instructions, fee schedule, Part 2A reports and additional Part 2B forms are available from any Department office or on the Department's website at idwr.idaho.gov.

Name of Applicant(s) Todd Campbell Construction Inc

Check whether each item below is *attached* (Yes) or *not applicable* (N/A) for the proposed transfer.

Yes N/A * Means the item is always required and must be included with the application.

- ☒ * Completed Application for Transfer of Water Right form, Part 1.
- ☒ * Signature of applicant(s) or applicant's authorized representative on Application for Transfer Part 1. Include evidence of authority labeled Attachment #3 (see below) if signed by representative.
- ☒ * Application for Transfer Part 2A. Attach a Part 2A report describing each water right in the transfer as currently recorded.
- ☐ ☒ Complete and attach an Application for Transfer Part 2B for each water right for which only a portion is proposed to be changed through this transfer application.
- ☒ * Application for Transfer Part 3A is always required (see Attachment #7a below); Parts 3B and 3C must be completed for transfer applications proposing to change the nature of use of the water right(s) or proposing changes to supplemental right(s).
- ☒ * Correct fee submitted with transfer application form. (Fee schedule is on website and instructions for application for transfer.)

Attachments to Application - Label each attachment with the corresponding number shown below as Attachment #1-10.

- ☐ ☒ #1 If the applicant is a business, partnership, organization, or association, and not currently registered in the State of Idaho as a business entity, attach documentation identifying officers authorized to sign or act on behalf of right holder. (See Part 1.)
- ☐ ☒ #2a Water Right ownership documentation if Dept. records do not show the applicant as the current water right owner. **
- ☒ ☐ #2b If the ownership of the water right will change as a result of the proposed transfer to a new place of use, attach documentation showing land and water right ownership at the new place of use. Include documentation for all affected land and owner(s). **
** Additional fee(s) required for water right ownership changes; see fee schedule.
- ☐ ☐ #3 Documentation of authority to make the change if the applicant is not the water right owner.
- ☐ ☒ #4 Power of Attorney or documentation providing authority to sign or act on the applicant's behalf. (See Part 1.)
- ☐ ☒ #5 If the transfer application proposes to change the point of diversion for a water right affecting the Eastern Snake Plain Aquifer (ESPA), attach the results of an ESPA analysis and a detailed mitigation plan to offset any depletions to hydraulically connected reaches of the Snake River. ESPA transfer spreadsheet and model grid labeled cells are available on the Department's website at idwr.idaho.gov/water-rights/transfers/resources.html.
- ☐ ☒ #6 Notarized statement of agreement or a statement on official letterhead signed by an authorized representative from each lien holder or other entity with financial interest in the water right(s) or land affected by the proposed transfer. (See Part 1.5.c.)
- ☒ * #7a Attach a map identifying the proposed point(s) of diversion, place(s) of use, and water diversion and distribution system details as described on the application. Include legal description labels. If only a portion of the right is proposed to be changed, identify the current location of the part of the existing right(s) proposed to be changed. (See Part 3A.)
- ☒ ☐ #7b If the transfer application proposes to change the place or purpose of use of an irrigation right attach a Geographic Information System (GIS) shape file, or an aerial photo or other image clearly delineating the location and extent of existing acres and changes to the place of use. If some or all of any right is leased to the Water Supply Bank, you must also show the the specific location and/or acres to be idled at the new, proposed place of use to satisfy lease requirements.
- ☐ ☒ #8a If the transfer application proposes to change the nature of use or period of use for one or more rights, provide documentation describing the extent of historic beneficial use for the water rights proposed to be transferred and document how enlargement will be avoided. (See Part 3B.) Additional fee required for proposed changes to nature of use; see fee schedule.
- ☒ ☐ #8b If the transfer application proposes to change the place of use of a supplemental irrigation right, provide documentation regarding the historic use of the supplemental right(s) and availability or reliability of the primary right(s) being supplemented, both before and after the proposed change. (See Part 3C.)
- ☐ ☒ #9 Water Supply Bank information for all rights proposed for transfer and currently leased to the Bank. (Attachment WSB)
- ☐ ☒ #10 Other. Please describe: _____

RECEIVED**MAR 22 2021****WATER RESOURCES
WESTERN REGION****STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES****APPLICATION FOR TRANSFER OF WATER RIGHT
PART 1**

Name of Applicant(s) Todd Campbell Construction Inc Phone (208) 941-8607
 Mailing address PO Box 140298 Boise, ID 83714-0298 Email tddcampbell@gmail.com

- ☐ If applicant is not an individual and not registered to do business in the State of Idaho, attach documentation identifying officers authorized to sign or act on behalf of the applicant. Label it **Attachment #1**.
- ☐ Attach water right ownership documentation if Department records do not show the transfer applicant as the current water right owner. Label it **Attachment #2a**.
- ☒ If the ownership of the water right will change as a result of the proposed transfer to a new place of use, attach documentation showing land and water right ownership at the new place of use. Include documentation for all affected land and owner(s). Label it **Attachment #2b**.
- ☐ Attach documentation of authority to make the proposed change if the applicant is not the water right owner. Label it **Attachment #3**.


Provide contact information below if a consultant, attorney, or any other person is representing the applicant in this transfer process.

☒ No Representative

Name of Representative _____ Phone _____
 Mailing address _____ Email _____

- ☐ Send all correspondence for this application to the representative and not to the applicant.
OR
☐ Send original correspondence to the applicant and copies to the representative.
- ☐ The representative may submit information for the applicant but is not authorized to sign for the applicant.
OR
☐ The representative is authorized to sign for the applicant. Attach a Power of Attorney or other documentation providing authority to sign for the applicant and label it **Attachment #4**.

I hereby assert that no one will be injured by the proposed changes and that the proposed changes do not constitute an enlargement in use of the original right(s). The information contained in this application is true to the best of my knowledge. I understand that any willful misrepresentations made in this application may result in rejection of the application or cancellation of an approval.

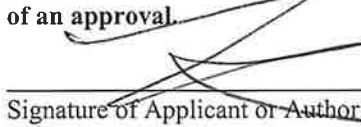 Todd Campbell, Owner 3/19/2021
 Signature of Applicant or Authorized Representative Print Name and Title if applicable Date

 Signature of Applicant or Authorized Representative Print Name and Title if applicable Date

A. PURPOSE OF TRANSFER

- ☒ Change point of diversion ☐ Add diversion point(s) ☒ Change place of use
☐ Change nature of use ☐ Change period of use ☐ Other _____
- Is this a transfer for changes pursuant to Idaho Code § 42-221.O.8?
 If yes, ☐ attach an explanation and any supporting documentation labeled as **Part1A.2**.
- Describe your proposal in narrative form, including a detailed description of non-irrigation uses to justify amounts transferred (i.e. number of stock, etc.), and provide additional explanation of any other items on the application. Attach additional pages if necessary and label it **Part 1A.3**.

Parent water right was 63-4690. Change of ownership and split was submitted on 4/20/2020. This transfer is necessary to change the POD to the NESW QQ and move the POU from the NWSW to the NESE QQ. The intent of the transfer is to irrigate 7 acres within a new developing Schreiner Subdivision. New split water right is 63-34904.

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR TRANSFER OF WATER RIGHT
PART 1 Continued

B. DESCRIPTION OF RIGHTS AFTER THE REQUESTED CHANGES. IF THE RIGHTS ARE BEING SPLIT, DESCRIBE PORTIONS TO BE CHANGED AS THEY WOULD APPEAR AFTER THE REQUESTED CHANGES.

	1.	Right Number	Amount (cfs/ac-ft)	Nature of Use	Period of Use	Source & Tributary
All or Part ☒ ☐		63-34904	0.14 cfs	Irrigation	03/01 to 11/15	Ground Water
☐ ☐					to	
☐ ☐					to	
☐ ☐					to	
☐ ☐					to	
☐ ☐					to	
☐ ☐					to	
☐ ☐					to	
☐ ☐					to	

Total authorized under rights 0.14 cfs and/or 31 acre-feet.

2. Total amount of water proposed to be transferred or changed 0.14 cubic feet per second and/or 31 acre-feet per year.

3. Point(s) of Diversion:

- ☐ No changes to point(s) of diversion are proposed - the following chart is therefore not completed. (Proceed to #4.)
- ☐ Attach Eastern Snake Plain Aquifer analysis if this transfer proposes to change a point of diversion affecting the ESPA. Label it **Attachment #5**.

New ?	Lot	¼	¼	¼	Sec	Twp	Rge	County	Source	Local name or tag #
Y			NE	SW	4	04N	01W	ADA	Ground Water	D0088979

4. Place of use: (If irrigation, identify with number of acres irrigated per ¼ ¼ tract.)

- ☐ No changes to place of use are proposed - the following chart is therefore not completed. (Proceed to #5.)

Twp	Rge	Sec	NE ¼				NW ¼				SW ¼				SE ¼				Acre Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
04N	01W	4									15								15
Total Acres (for irrigation use)																			15

*7 total acre
within a 15 acres
ppu

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR TRANSFER OF WATER RIGHT PART 1 Continued

5. General Information:

- a. Describe the complete diversion system, including how you will accommodate a measuring device and lockable controlling works should they be required now or in the future:

None- served for secondary ground water right.

-Data logger/meter for well driller.

- b. Who owns the property at the point(s) of diversion? Todd Campbell Construction Inc

If other than the applicant, describe the arrangement enabling the applicant to access the property for the diversion system:

N/A

- c. Are the lands from which you propose to transfer the water right subject to any liens, deeds of trust, mortgages, or contracts?

If yes, ☐ attach a notarized statement from the holder of the lien, deed of trust, mortgage or contract agreeing to the proposed changes on official letterhead signed by an authorized representative. Label it **Attachment #6**. List the name of the entity and type of lien: NO

It is the applicant's responsibility to provide notice to lien holder, trustee, mortgagor, or contract holder of the proposed changes that may impact or change the value of the water rights or affected real property. Any misrepresentation of legal encumbrance on this application may result in rejection of the application or cancellation of an approval.

- d. Are any of the water rights proposed for transfer currently leased to the Water Supply Bank?

If yes, ☐ complete Attachment WSB.

- e. Describe the effect on the land now irrigated if the place or purpose of use is changed pursuant to this transfer:

- f. Describe the use of any other water right(s) for the same purpose or land, or the same diversion system as right(s) proposed to be transferred at both the existing and proposed point(s) of diversion and place(s) use:

Old well replaced with new for supplemental to surface water rights for P.I. system on Iron Mountain Estates residential subdivision.

- g. To your knowledge, has/is any portion of the water right(s) proposed to be changed:

Yes No

- | | | |
|--------------------------|-------------------------------------|---|
| ☐ | ☒ | undergone a period of five or more consecutive years of non-use, |
| ☐ | ☒ | currently leased to the Water Supply Bank, |
| ☐ | ☒ | currently used in a mitigation plan limiting the use of water under the right, or |
| ☐ | ☒ | currently enrolled in a Federal set-aside program limiting the use of water under the rights? |

If yes, describe:

APPLICATION FOR TRANSFER OF WATER RIGHT

PART 2

A. DESCRIPTION OF RIGHT(S) AS RECORDED

For each water right listed in Part 1B.1 of the application, attach a **Part 2A** report obtained from any Department office or from the Department's website @ idwr.idaho.gov, Water Right Transfers, Step 1.
Insert Part 2A reports into the application following Part 1.

B. IF ONLY A PORTION OF THE RIGHT IS PROPOSED TO BE CHANGED, DESCRIBE THE PORTION BEING CHANGED AS IT APPEARS BEFORE THE REQUESTED CHANGES

- ☐ Complete and attach one copy of Part 2B for each right for which only a portion is proposed to be changed. If the entire right is proposed to be changed, Part 2B is not applicable. Additional copies of the **Part 2B** form can be obtained from any Department office or from the Department's website @ idwr.idaho.gov, Water Right Transfers, Step 3, or Water Right Forms, Changes in Use. Insert completed Part 2B forms into the application following Part 2A of the same water right.

Right Number: N/A

1. amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
amount _____ (cfs/ac-ft) for _____ purposes from _____ to _____
2. Lands irrigated or place of use: (If irrigation, identify with number of acres irrigated per ¼ ¼ tract.)

[illegible]

IDAHO DEPARTMENT OF WATER RESOURCES
Proof Report

11/6/2020

Water Right 63-34904

Owner Type **Name and Address**
 Current Owner TODD CAMPBELL CONSTRUCTION INC
 PO BOX 140298
 BOISE, ID 83714-0298
 (208) 631-5052

Previous Owner RONALD L SCHREINER
 1995 N POLLARD LN
 STAR, ID 83669
 (208) 286-7028

Previous Owner NORMAL SCHREINER
 1995 N POLLARD LN
 STAR, ID 83669
 (208) 286-7028

Priority Date: 4/17/1958

Basis: Decreed

Status: Active

Source
 GROUND WATER

Tributary

<u>Beneficial Use</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Volume</u>
IRRIGATION	03/01	11/15	0.140 CFS	31.0 AF
	<u>Total Diversion</u>		0.140 CFS	31.0 AF

Source and Point(s) of Diversion

GROUND WATER NENWSW Sec. 4, Twp 04N, Rge 01W, ADA County

Place Of Use

IRRIGATION within ADA County

			NE				NW				SW				SE				Totals
Twp.	Rng	Sec.	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
04N	01W	4										7.0							7.0

POU Total Acres: 7.0

Conditions of Approval:

1. C18 This partial decree is subject to such general provisions necessary for the definition of the rights or for the efficient administration of the water rights as may be ultimately determined by the Court at a point in time no later than the entry of a final unified decree. Section 42-1412(6), Idaho Code.

Dates and Other Information

Decreed Date: 2/16/2007

Civil Case Number: 39576

IDAHO DEPARTMENT OF WATER RESOURCES
Proof Report

11/6/2020

Judicial District: FIFTH
State or Federal: S
Water District Number: 63
Mitigation Plan: False

Combined Use Limits
N/A

Verification Log

SubCase:
N/A

Water Supply Bank:
N/A

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR TRANSFER OF WATER RIGHT PART 3

A. PLAT MAP (See Part 3A of Instructions for application for transfer for complete requirements.)

- ☒ Attach a map of the diversion, measurement, control, and distribution system. Label it **Attachment #7a**.
- ☐ If the transfer application proposes to change the place or purpose of use of an irrigation right attach a Geographic Information System (GIS) shape file, or an aerial photo or other image clearly delineating the location and extent of existing acres and changes to the place of use. Label it **Attachment #7b**.

If the place of use currently consists of a permissible place of use, then the attachment is not required if the application contains a clear statement that the boundaries for the place of use are not proposed to be changed by the transfer and the total number of irrigated acres within the place of use before and after the transfer is clearly stated.

If any part of the irrigation water right is leased to the Water Supply Bank, you must also specify the location and number of acres that will remain idled for the duration of the lease contract at the new, proposed place of use.

B. CHANGES IN NATURE OF USE (Water Balance)

- ☐ If you propose to change the nature of use or period of use of all or part of the rights(s) listed in this application, attach documentation describing the extent of historic beneficial use of the portion of the right(s) proposed to be changed. Also attach documentation showing that the portion of the right(s) to be changed will not be enlarged in rate, volume, or consumptive use through the proposed change. Label it **Attachment #8a**.

C. PLACE OF USE CHANGES TO SUPPLEMENTAL IRRIGATION RIGHTS

- ☒ If you propose to change the place of use of a supplemental irrigation right, answer below and attach supporting documentation. Label it **Attachment #8b**.

Describe how the supplemental water rights have been used historically in conjunction with other water rights at the existing place of use. Describe the time during the irrigation season that the supplemental rights have been used. Include information about the availability or reliability of the primary right(s) being supplemented, both before and after the change. If the applicant is proposing to change a supplemental irrigation right to a primary right, provide the information required on Part 3B above:

40 acres of the west to the east. This is strictly a diversion point change of location. It is the same water right and the same use.

FOR DEPARTMENT USE ONLY

Transfer contains 10 pages and 1 attachments.

Received by CJ Date 03/22/2021 Preliminary check by AK Date 3-30-2021

Fee paid \$200⁰⁰ Date 03/22/2021 Received by CJ Receipt # W049217

Add'l fee paid _____ Date _____ Received by _____ Receipt # _____

Check all that apply: Attachment WSB ☐ (copy sent to state office) Lessor Designation form ☐ &/or W-9 ☐ (originals to state office)

State of Idaho
Department of Water Resources

Proposed Place of Use and Well Location

WR No. 63-34904



0 0.025 0.05 0.1 Miles



Well_Location



Irrigation_Place_of_Use




State of Idaho
Department of Water Resources

Proposed Place of Use and Well Location

WR No. 63-34904



0 0.025 0.05 0.1 Miles

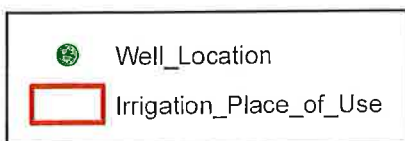

84839

PUMP STATION NOTES

- ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST ISWPC, AND ANY OTHER APPLICABLE PLUMBING OR ELECTRICAL CODES.
- PUMP CONTROL PANEL SHALL BE CONSTRUCTED TO NEMA 3R STANDARDS AND INCLUDED COMPONENTS, BUT ARE NOT LIMITED TO THE FOLLOWING:
 - LOW/HIGH VOLTAGE PROTECTION,
 - MAIN LINE FAILURE WITH MANUAL RESET.
 - PHASE FAILURE AND PHASE REVERSAL PROTECTION,
 - MOTOR RATED CIRCUIT PROTECTION,
 - LINE SIDE POWER MONITORING,
 - LOW WATER / PRESSURE EMERGENCY SHUTOFF,
 - DISCONNECT SWITCH.
- THE COMPLETED ELECTRICAL SYSTEM SHALL BE A COMPLETE PACKAGE AND OPERATIONAL COMPONENT OF THE PUMPING SYSTEM. THE ELECTRICAL SHALL ALSO INCLUDE A 110V, 30AMP CONVENIENCE OUTLET, TRANSFORMER, AND AN OVERHEAD LIGHT WITH LIGHT SWITCHES LOCATED BY ACCESS DOORS.
- PUMP CONTRACTOR SHALL PROVIDE THE OWNER AND ENGINEER AN O&MM FOR THE PUMPS, CONTROL PANEL, AND ALL PUMP STATION APPURTENANCES. THE O&MM SHALL INCLUDE SERIAL NUMBERS OF ALL COMPONENTS.
- PUMP CONTRACTOR SHALL PROVIDE START-UP, SHUT-DOWN, AND WARRANTY ON THE PUMP STATION THROUGH THE FIRST FULL IRRIGATION SEASON. START-UP AND SHUT-DOWN PROCEDURES SHALL BE INCLUDED IN THE O&MM.
- PUMP CONTRACTOR IS REQUIRED TO PROVIDE SHOP DRAWINGS OF PUMP CONFIGURATION, INCLUDING ELECTRICAL AND PLUMBING.
- PUMP CONTRACTOR IS REQUIRED TO PROVIDE REDLINED PLANS FOR AS-BUILT CONDITIONS OF THE PUMP STATION.
- CONTRACTOR SHALL PROVIDE A PUMP STATION ENCLOSURE OVER THE PUMP STATION CONCRETE FLOOR.
- AREA SURROUNDING PUMP STATION SHALL BE LANDSCAPED AND MAINTAINED BY HOA.
- DRAINAGE AROUND PUMP STATION PERIMETER SHALL BE GRADED AWAY FROM THE CONCRETE FLOOR FOOTINGS.
- ALL PIPING SHALL HAVE DRAIN PLUGS FOR WINTERIZATION.
- CONTRACTOR TO VERIFY ALL ELEVATIONS PRIOR TO CONSTRUCTION.
- ALL PIPING PASSING THROUGH CONCRETE SHALL BE GROUTED AND BONDED TO ENSURE WATERTIGHT CONNECTION.
- CONTRACTOR TO SUBMIT COMPLETE MOTOR & PUMP SPECS WITH PERFORMANCE CURVES AND DATA TO ENGINEER FOR VERIFICATION THAT PUMPS WILL MEET DESIGN CRITERIA PRIOR TO PLACING ORDER FOR ANY EQUIPMENT.
- THE PUMP STATION SHALL BE OPERATED BY VFD (VARIABLE FREQUENCY DRIVE). A SMALLER JOCKEY TURBINE PUMP SHALL BE SIZED TO PROVIDE FLOW BELOW THE OPERATING RANGE OF THE VFD PUMPS.

GRAVITY IRRIGATION NOTES







- ALL PIPE SHALL BE ASSEMBLED AND INSTALLED IN ACCORDANCE WITH THE PIPE MANUFACTURER'S RECOMMENDATIONS AND AS SHOWN ON THE PROJECT ENGINEERING PLANS/DRAWINGS. ALL GRAVITY IRRIGATION MAINS SHALL BE INSTALLED WITH THE BELL END UPSTREAM AND SPIGOT END DOWNSTREAM.
- PIPE JOINTS SHALL BE WIPED CLEAN OF ALL DIRT, GREASE, AND FOREIGN MATTER. WHEN WORK IS HALTED, ALL OPEN ENDS OF THE INSTALLED PIPE SHALL BE SEALED TO PREVENT MATERIAL FROM ENTERING THE PIPE.
- FIELD CUT PIPE ENDS SHALL BE BEVELED TO MATCH FACTORY-FINISHED BEVELED PIPE ENDS.
- WHEN ASSEMBLING GASKETED PVC PIPE, CLEAN AND INSPECT GASKETS, PIPE BELLS, AND SPIGOTS THOROUGHLY. USE ONLY LUBRICANT FURNISHED OR SPECIFIED BY THE PIPE MANUFACTURER AND APPLY AS SPECIFIED BY THE MANUFACTURER.
- UTILITIES ENCOUNTERED WITHIN THE PIPE ZONE SHALL BE RELOCATED BELOW THE PIPE ZONE. TOPSOIL SHALL BE STOCKPILED AND USED FOR THE TOP LAYER DURING BACKFILL. THE PIPE ZONE SHALL BE DEFINED AS ANY AREA WITHIN 12 INCHES OF THE OUTSIDE EDGE OR BELL OF THE PIPE.
- WATERMAN C-10 CANAL GATES OR APPROVED EQUAL SHALL BE USED. GATES SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS. CANAL GATE WHEEL HEIGHT SHALL BE A MINIMUM OF 2-7/8 INCHES ABOVE STRUCTURE AND A MAXIMUM OF 6 INCHES ABOVE STRUCTURE.
- PIPES SHALL BE INSTALLED FLUSH WITH THE INSIDE CONCRETE WALL. STRUCTURES SHALL BE CONSTRUCTED WITHOUT Sumps. WATER STOP SHALL BE INSTALLED AT ALL COLD JOINTS. BENTONITE ROPE SHALL BE PLACED AROUND ALL PIPE PENETRATIONS PRIOR TO CONCRETE PLACEMENT. STRUCTURE TOP SHALL BE A MINIMUM OF 1-FOOT ABOVE AND A MAXIMUM OF 4 FEET ABOVE FINISHED GRADE. POLYPROPYLENE COATED MAINHOLE STEPS MAY BE REQUIRED AND, IF REQUIRED, SHALL BE INSTALLED ON THE UPSTREAM SIDE OF THE GRAVITY IRRIGATION STRUCTURES.
- ALL JOINTS SHALL BE WATERTIGHT AND BACKFILL SHALL BE COMPACTED TO 95% OF STANDARD PROCTOR AS DETERMINED BY ASTM T99 METHOD A. COMPACTION EFFORT SHALL MEET THE REQUIREMENTS OF ISWPC DIVISION 200 SECTION 202 CLASS A COMPACTION. SOIL BACKFILL MATERIALS SHALL MEET THE REQUIREMENTS OF ISWPC DIVISION 200 SECTION 203 - SOIL MATERIALS SUBSOIL TYPES S3 OR S4. PREFERABLY S4 IF IT IS AVAILABLE ON-SITE. MATERIALS SHALL BE PLACED AND COMPACTED IN 6-INCH LIFTS.
- NATIVE TRENCH MATERIALS FREE FROM CINDERS, ASHES, REFUSE, ORGANIC AND FROZEN MATERIALS, COBBLES OR ROCKS NOT LARGER THAN SIX (6) INCHES MAY BE USED. TRENCH BACKFILL ABOVE THAT REQUIRED TO PROTECT THE PIPE SHALL BE PLACED IN TWO (2) LIFTS AND COMPACTED SUFFICIENTLY TO PRECLUDE SETTLEMENT. MECHANICAL COMPACTION AND/OR WATER SETTLING SHALL BE USED TO COMPACT BACKFILL. TOPSOIL SHALL THEN BE PLACED, COMPACTED AND GRADED.
- SILT OR BENTONITE BACKFILL MATERIALS MAY BE REQUIRED WITHIN THE TRENCH BACKFILL ABOVE THE PIPE ZONE TO PREVENT WATER MIGRATION INTO THE PIPE BEDDING ADJACENT TO HEADWALLS AND IN CRITICAL OPEN CHANNEL LOCATIONS.
- PIPE BEDDING AND ZONE MATERIAL SHALL BE INCLUDED IN THE FULL WIDTH OF THE TRENCH FROM FOUR (4) INCHES BELOW THE BOTTOM OF THE PIPE TO SIX (6) INCHES ABOVE THE TOP OF THE PIPE. PIPE BEDDING SYSTEM SHALL BE CLASS A-1 WITHIN PUBLIC RIGHT-OF-WAY, WHICH INCLUDES TYPE I BEDDING MATERIALS IN THE UPPER AND LOWER BEDDING ZONES. PIPE BEDDING SYSTEM SHALL BE CLASS A-2 FOR ALL AREAS OUTSIDE OF RIGHT-OF-WAYS, WHICH INCLUDES TYPE I BEDDING MATERIALS IN THE LOWER BEDDING ZONE AND TYPE II OR III BEDDING MATERIALS IN THE UPPER PIPE ZONE. SEE DIVISION 300 OF THE ISWPC FOR PIPE BEDDING SYSTEM REQUIREMENTS.
- SILT OR BENTONITE BACKFILL MATERIALS MAY BE REQUIRED WITHIN THE PIPE ZONE TO PREVENT WATER MIGRATION INTO THE PIPE BEDDING ADJACENT TO HEADWALLS AND IN CRITICAL OPEN CHANNEL LOCATIONS.
- ALL BENTONITE BACKFILL MATERIALS SHALL BE 50% BENTONITE WITH 50% FINE GRAINED NATIVE MATERIALS. IF NATIVE MATERIALS ARE SANDS AND GRAVELS, FINE GRAINED MATERIALS SHALL BE IMPORTED FROM OFF SITE AND BE MIXED TO THE PERCENTAGE ABOVE.

WELL NOTES

- WELL CASING SHALL BE LOCATED 5.0' FROM PROPERTY/BOUNDARY LINES; 10.0' FROM PUMP STATION/PERMANENT BUILDINGS; 25.0' FROM CANALS, IRRIGATION DITCHES OR LATERAL; 50.0' FROM SURFACE WATER; 50.0' FROM GRAVITY SEWER LINE; 25.0' FROM OTHER EXISTING WELL.
- CONTRACTOR TO COORDINATE WITH DRILLER FOR EXACT LOCATION.
- WELL CONSTRUCTION SHALL BE IN ACCORDANCE WITH IDAPA 37.03.09 WELL CONSTRUCTION STANDARDS RULES AND OTHER APPLICABLE CODES.
- COMPLETE WELL SHALL MEET ALL REQUIRED STANDARDS INCLUDING APPROPRIATE DIAMETER STEEL CASING, WELL SCREEN, ACCESS PORT, WELL CAP, ISOLATION VALVE, PITLESS ADAPTERS, SUBMERSIBLE PUMP TO DELIVER REQUIRED FLOW OF 63 GPM, AND REQUIRED CONDUITS FOR POWER AND VFD CONTROLS FROM WELL PUMP TO MAIN PUMP STATION.

WELL PUMP CONTROL NOTES

- COORDINATE WITH PRECISION PUMPING SYSTEMS (PPS). PPS TO CONFIRM WELL PUMP HP AND SIZE APPROPRIATE VFD CONTROLS FOR THE WELL PUMP.
- PPS TO UPGRADE THE PUMP STATION CONTROL PANEL TO ACCEPT CONTROLS FOR THE WELL PUMP UP TO 7.5 HP.
- COORDINATE WITH PPS AND DRILLER TO ENSURE NUMBER AND SIZE OF CONDUITS NECESSARY TO CONNECT POWER AND CONTROL WIRING FROM WELL PUMP TO PUMP STATION CONTROL PANEL.
- PPS SHALL UPGRADE THE PUMP STATION CONTROLS TO INCLUDE A LEVEL SENSOR AND RELATED PROGRAMMING TO CONTROL THE WELL PUMP BASED ON SUPPLEMENT WET WELL WATER LEVEL.

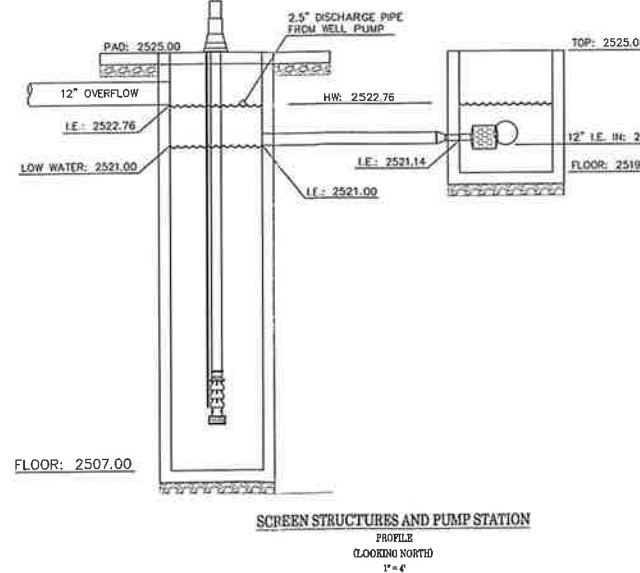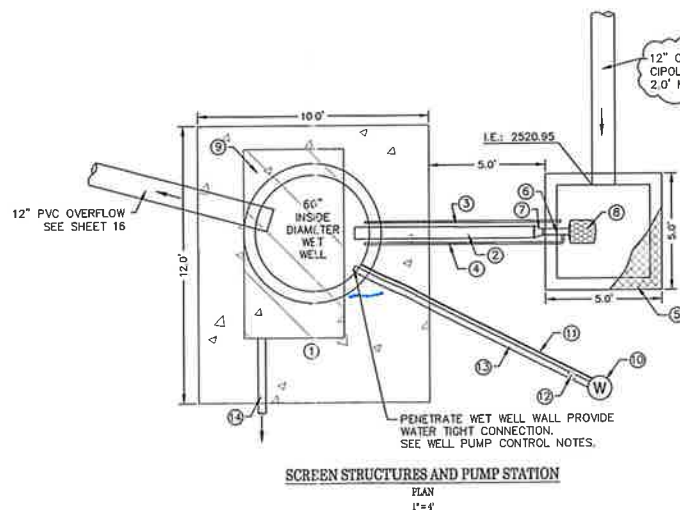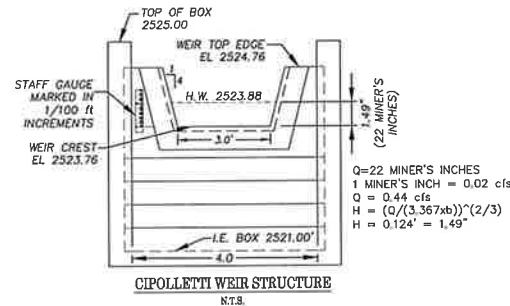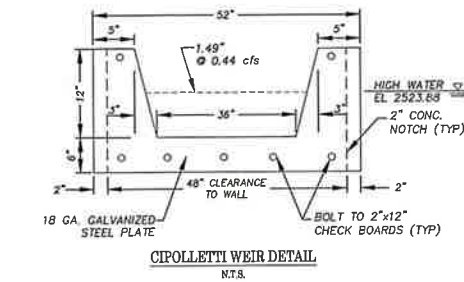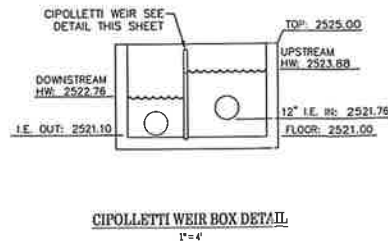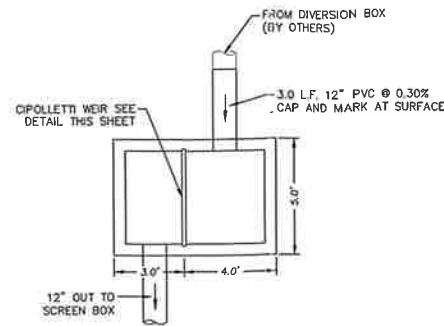

- 10.0' x 12.0' CONCRETE SLAB COORDINATE WITH OWNER FOR STRUCTURE DETAILS. COORDINATE WITH PUMP MANUFACTURER FOR PAD SIZE AND SKID LAYOUT FOR PUMP ENCLOSURE
- 9 LF, 12\"/>
- 2\"/>
- 1\"/>
- REINFORCED EXPANDED METAL COVER W/ LOCKABLE HINGED ACCESS TO SCREEN
- COUPLE 4\"/>
- 4\"/>
- CLEMONS CW200 (16\"/>
- PPS PUMP SKID - (97.5\"/>
- IRRIGATION WELL CASING AND PUMP BY OTHERS. EXACT LOCATION TO BE CONFIRMED BY DRILLER. SEE WELL NOTES ON SHEET 19 FOR REQUIRED SETBACKS
- CONDUIT FROM WELL CASING TO WET WELL
- ISOLATION VALVE AND VALVE BOX AS NEEDED
- 2.5\"/>
- PPS 4\"/>

SCALE IN FEET
1"=4'


PUMP STATION SPECS	
MODEL	SUBMIT FOR REVIEW
PUMP	SUBMERSIBLE TURBINE PUMP
HORSEPOWER	20.0 HP
AVAILABLE VOLTAGE	277/480V
REQUIRED POWER	3-PHASE
SKID SIZE	SUBMIT FOR REVIEW
PACKAGED PUMP SYSTEM	
PUMP STATIONS MUST HAVE A VFD, MEET THE MINIMUM PRESSURE, HEAD, & FLOW REQUIREMENTS (PUMPING STATION SHALL BE BY PRECISION PUMPING SYSTEMS OR EQUIVALENT)	

WELL PUMP SPECS	
MODEL	DRILLER TO SUBMIT
WELL	6\"/>

PUMP STATION DESIGN REQUIREMENTS	
SURFACE WATER FLOW	198 GPM
WELL WATER FLOW	63 GPM
DESIGN PUMP FLOW	260 GPM
ADDITIONAL FLOW FOR CLEMONS SCREEN	20 GPM
TOTAL (COMBINED) DESIGN PUMP FLOW	280 GPM
TOTAL DYNAMIC HEAD	198 FEET
ENCLOSURE	PER MANUFACTURER
MAINLINE DIAMETER	6\"/>

IRRIGATION SERVICE AREA	
IRON MOUNTAIN ESTATES	
PRE DEVELOPMENT AREA:	15.49 ACRES
BUNDABLE LOTS:	43
COMMON LOTS:	8

IRRIGATION SERVICE AREA	
WORSLEY SUBDIVISION (FUTURE)	
PRE DEVELOPMENT AREA:	16.46 ACRES
BUIDABLE LOTS:	51
COMMON LOTS:	5

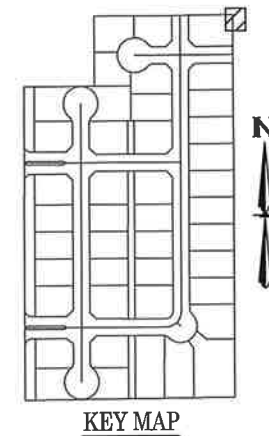

Revisions

Date	Description
1/29/21	IRRIGATION PUMP STATION REVISIONS
2	
3	
4	

ROCK SOLID CIVIL
Civil Engineering and Land Development Consulting
270 North 27th Street, Boise, ID 83702
Office Phone: 208.342.3277
www.rocksolidcivil.com

THIS DOCUMENT AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE IS THE PROPERTY OF ROCK SOLID CIVIL LLC AND IS NOT TO BE USED IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE EXPRESS WRITTEN AUTHORIZATION OF ROCK SOLID CIVIL LLC.

Project Name
IRON MOUNTAIN ESTATES SUBDIVISION

Sheet Name
PUMP STATION DETAILS



Project No. RSC 19-41

Drawn By: JEC

Date: January 29, 2021

Sheet No. 19

19 of 20



CALL BEFORE YOU DIG!
CALL DIGLINE INC.
PRIOR TO COMMENCING
UNDERGROUND WORK
208-342-1585

84839



State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN Region • 2735 W AIRPORT WAY • BOISE, ID 83705-5082

Phone: (208)334-2190 • Fax: (208)334-2348 • Website: www.idwr.idaho.gov

Brad Little
Governor

Gary Spackman
Director

June 10, 2021

TODD CAMPBELL CONSTRUCTION INC
PO BOX 140298
BOISE, ID 83714-0298

RE: Transfer No. 84839
Water Right No. 63-34904

Dear Applicant:

The Department of Water Resources has received your water right transfer application. Please refer to the transfer number referenced above in all future correspondence regarding this transfer.

A legal notice of the application has been prepared and is scheduled for publication in the IDAHO STATESMAN on 6/17/2021 and 6/24/2021. Protests to this application may be submitted for a period ending ten (10) days after the second publication.

If the application is protested, you will be sent a copy of each protest. All protests must be resolved before the application can be considered for approval. If the protest(s) cannot be resolved voluntarily, the Department will conduct a conference and/or hearing on the matter.

If the application is not protested, the Department will process your application and notify you of any action taken on the application. If your application is approved, the Department will send you a copy of the approval document.

Please contact this office if you have any questions regarding the application.

Sincerely,

A handwritten signature in blue ink that reads "Denise Lauerman". The signature is fluid and cursive, with the first name "Denise" and last name "Lauerman" clearly distinguishable.

Denise Lauerman
Administrative Assistant



State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN Region • 2735 W AIRPORT WAY • BOISE, ID 83705-5082

Phone: (208)334-2190 • Fax: (208)334-2348 • Website: www.idwr.idaho.gov

Brad Little
Governor

Gary Spackman
Director

June 10, 2021

FARMERS UNION DITCH CO LTD
109 S PLYMOUTH AVE
PO BOX 2106
NEW PLYMOUTH, ID 83655

RE: Application for Transfer No. 84839

Dear Interested Party:

The Idaho Department of Water Resources (IDWR) is seeking written comment and/or recommendations from your organization regarding the above referenced water right application. You can find a copy of the application at: <https://idwr.idaho.gov/apps/ExtSearch/WRAJSearch/WRADJSearch.aspx>. Please review the application, complete the enclosed recommendation form, and submit it to this office within 21 days of the date of this letter.

IDWR can finish reviewing an unprotested application as soon as the protest period has past. Therefore, your prompt response to this request is appreciated. If your organization desires to formally protest the approval of this application, you may do so after the notice is published by filing a written protest along with a \$25.00 filing fee within 10 days after final publication.

Please contact this office if you have any questions regarding the application.

Sincerely,


Denise Lauerman
Administrative Assistant

Enclosure

State of Idaho
Department of Water Resources
RECOMMENDATION FORM

RE: Application for Transfer No. 84839

New Appropriation Applicant's
Name:

TODD CAMPBELL CONSTRUCTION INC
PO BOX 140298
BOISE, ID 83714-0298

Recommendation:

- a) _____ I do not oppose approval of this application.
- b) _____ I do not oppose approval of this application if it is conditioned
as follows:
- c) _____ I oppose approval of this application for the following reasons:
- d) _____ Additional comments:

Dated this _____ day of _____.

Signature

Lauerman, Denise

From: Lauerman, Denise
Sent: Thursday, June 10, 2021 12:45 PM
To: BOI Legals
Subject: ADA COUNTY Legal Notice - Inject. Well, Application for Permit No. 63-35052, 63-35055, 63-35056, 63-35059, Transfer No. 84839; Water Right No. 63-34904
Attachments: UIC legal notice - Idaho Statesman.docx; Ada County Cover Letter TR84839, 63-35052, 63-35055, 63-35056, 63-35059.....docx; Ada County Legal Notice TR84839, 63-35052, 63-35055, 63-35056, 63-35059.....docx

Good afternoon,

Please see the attached ad for publication on 06/17/2021 and 06/24/2021.

Please publish the enclosed legal notice on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 07/05/2021. Your cooperation is appreciated.

Please confirm this is okay to publish as shown and send confirmation and all other correspondence to this email.

Thanks much!
Denise

Denise Lauerman | *Administrative Assistant*
Idaho Dept. of Water Resources - Western Region
2735 W Airport Way, Boise ID 83705
(208) 334.2190 | denise.lauerman@idwr.idaho.gov



Brad Little
Governor

State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN Region • 2735 W AIRPORT WAY • BOISE, ID 83705-5082

Phone: (208)334-2190 • Fax: (208)334-2348 • Website: www.idwr.idaho.gov

Gary Spackman
Director

June 10, 2021

LEGAL NOTICE DEPARTMENT
IDAHO STATESMAN
PO BOX 40
BOISE, ID 83707

RE: Application for Permit No. 63-35052, 63-35055, 63-35056, 63-35059
Transfer No. 84839
Water Right No. 63-34904

Dear Legal Notice Department:

Please publish the enclosed legal notice on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 7/5/2021. Your cooperation is appreciated.

Sincerely,

Denise Lauerman
Administrative Assistant

Enclosures

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-35052

TEMIRLAN AKKAZAKOV

10903 W COLUMBIA RD

BOISE, ID 83709-6913

Point of Diversion NENE S10 T02N R01E ADA County Source GROUND WATER

Use: DOMESTIC 01/01 to 12/31 0.11 CFS

Use: IRRIGATION 03/01 to 11/15 0.3 CFS

Total Diversion: 0.41 CFS

Date Filed: 04-30-2021

Place Of Use: DOMESTIC, IRRIGATION

T02N R01E S10 NENE, SENE

Total Acres: 15

Water bearing zone to be appropriated is from 38 to 300 feet.

63-35055

MARK PATORAY

SHEILA PATORAY

8152 STEWART RD

MERIDIAN, ID 83642-7226

Point of Diversion NENE S9 T02N R01E ADA County Source GROUND WATER

Use: IRRIGATION 01/01 to 12/31 0.14 CFS

Total Diversion: 0.14 CFS

Date Filed: 05-18-2021

Place Of Use: IRRIGATION

T02N R01E S9 NENE

Total Acres: 4.8

Water bearing zone to be appropriated is from 220 to 300 feet.

63-35056

DON NEWELL

PO BOX 1939

EAGLE, ID 83616

Point of Diversion NENW S28 T02N R01E ADA County Source GROUND WATER

Use: IRRIGATION 03/01 to 11/15 0.59 CFS

Total Diversion: 0.59 CFS

Date Filed: 05-13-2021

Place Of Use: IRRIGATION

T02N R01E S28 NENW

Total Acres: 29.4

Water bearing zone to be appropriated is from 260 to 295 feet.

63-35059

ALEX BABCOCK

JENNI BABCOCK

4720 N CURLEW LN

EAGLE, ID 83616-1848

Point of Diversion SESW S30 T05N R01E ADA County Source GROUND WATER

Use: IRRIGATION 03/01 to 11/15 0.2 CFS

Total Diversion: 0.2 CFS

Date Filed: 05-20-2021

Place Of Use: IRRIGATION

T05N R01E S30 SESW

Total Acres: 9

Water bearing zone to be appropriated is from 340 to 350 feet.

NOTICE OF PROPOSED CHANGE OF WATER RIGHT

TRANSFER NO. 84839

TODD CAMPBELL CONSTRUCTION INC, PO BOX 140298, BOISE, ID 83714-0298 has filed Application No. 84839 for changes to the following water rights within ADA County(s): Right No(s). 63-34904; to see a full description of these rights and the proposed transfer, please see <https://research.idwr.idaho.gov/apps/waterrights/querynewtransfers>. The purpose of the transfer is to change a portion of the above rights as follows:

The purpose of the transfer is to move the POD and POU of water right 63-34904 to a neighboring parcel and establish a 15-acre permissible place of use. Water will be used for a parcel adjacent to the current place of use located on the east side of N Pollard Ln. Groundwater irrigation at the proposed POU will be supplemental to water supplied by Farmers Union Ditch Co

Permits will be subject to all prior water rights. For additional information concerning the property location, contact the Western office at (208)334-2190; or for a full description of the right(s), please see <https://idwr.idaho.gov/apps/ExtSearch/WRAApplicationResults/>. Protests may be submitted based on the criteria of Idaho Code Sec. Code § 42-203A or 42-222. Any protest against the approval of this application or proposed change must be filed with the Director, Department of Water Resources, Western Region, 2735 W AIRPORT WAY, BOISE ID 83705-5082 together with a protest fee of \$25.00 for each application on or before 7/5/2021. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Director

Published on 6/17/2021 and 6/24/2021

Kaiser, Anna

From: Kaiser, Anna
Sent: Tuesday, March 30, 2021 3:40 PM
To: 'tddcampbell@gmail.com'
Subject: Transfer Application No. 84839
Attachments: POU & POD MAP.PDF

Good Afternoon,

On March 22, 2021, the Idaho Department of Water Resources (Department) received your application to transfer the place of use (POU) and point of diversion (POD) of water right 63-34904. The right allows seven acres of irrigation which matches the proposed POU described in your transfer application. However, the map enclosed with your application outlines a fifteen-acre parcel. Please use the attached "POU & POD MAP" to outline the 7 acres you propose to irrigate within the fifteen-acre parcel and send a scanned copy to me at anna.kaiser@idwr.idaho.gov or submit a hard copy to the office addressed below.

Please contact me at (208)-334-2190 if you have any questions.

You may seek additional time to provide the information by making a written request to interrupt processing for up to six months. The application will be returned and refunded without a timely reply within the next thirty (30) days.

Thank you,
Anna

Anna Kaiser | Water Resource Agent
IDWR-Western Region
2735 W Airport Way, Boise ID 83705
(208).334.2190 | anna.kaiser@idwr.idaho.gov