

RECEIVED

MAR 30 2020

WATER RESOURCES
WESTERN REGION

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT
To appropriate the public waters of the State of Idaho

Ident. No. _____

1. Name of applicant(s) GO Investment Idaho, LLC Phone 208-573-3054
 Name connector (check one): ☐ and ☐ or ☐ and/or
 Mailing address 26358 Sand Road City Parma
 State ID ZIP 83660 Email n/a
2. Name of representative, if any Honsinger Law, PLLC Phone 208-863-6106
 Mailing address P.O. Box 517 City Boise
 State ID ZIP 83701 Email honsingerlaw@gmail.com
- a. ☐ Send all correspondence for this application to the representative and not to the applicant OR
☒ Send original correspondence to the applicant and copies to the representative.
- b. ☒ The representative may submit information for the applicant but is not authorized to sign for the applicant OR
☐ The representative is authorized to sign for the applicant. Attach a Power of Attorney or other documentation.
3. Source of water supply Groundwater which is a tributary of n/a

4. Location of point(s) of diversion:

Twp	Rge	Sec	Govt Lot	1/4	1/4	1/4	County	Source	Local name or tag #
05N	05W	36			SW	NW	Canyon	Groundwater	Gravel Pond

5. Water will be used for the following purposes:

Amount 24 AFA for Aesthetic Storage purposes from 1/1 to 12/31 (both dates inclusive)
 (cfs or acre-feet per year)

Amount 24 AFA for Wildlife Storage purposes from 1/1 to 12/31 (both dates inclusive)
 (cfs or acre-feet per year)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per year)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per year)

6. Total quantity to be appropriated is (a) _____ cubic feet per second (cfs) and/or (b) 24 acre-feet per year (af).

7. Proposed diverting works:

- a. Describe type and size of devices used to divert water from the source. Existing pond.
- b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet. If the reservoir will be filled more than once each year, describe the refill plan in item 12. For dams 10 feet or more in height AND having a storage capacity of 50 acre-feet or more, submit a separate [Application for Construction or Enlargement of a New or Existing Dam](#). Application required? ☐ Yes ☐ No
- c. Proposed well diameter is _____ inches; proposed depth of well is _____ feet.
- d. Is ground water with a temperature of greater than 85°F being sought? ☐ Yes ☐ No
- e. If well is already drilled, when? _____; drilling firm _____;
 well was drilled for (well owner) _____; Drilling Permit No. _____

For Department Use

Received by LT Date 3/30/2020 Time 11:44am Preliminary check by _____
 Fee \$ 250.00 Receipted by LT Receipt No. W048152 Date 3/30/2020

8. Description of proposed uses (if irrigation only, go to item 9):

- Hydropower; show total feet of head and proposed capacity in kW. _____
- Stockwatering; list number and kind of livestock. _____
- Municipal; must complete and attach the [Municipal Water Right Application Checklist](#).
- Domestic; show number of households _____
- Other; describe fully. Existing pond used for aesthetic and wildlife storage purposes.

9. Description of place of use:

- If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
05N	05W	36							St.										

Total number of acres to be irrigated: _____

10. Describe any other water rights used for the same purposes as described above. Include water delivered by a municipality, canal company, or irrigation district. If this application is for domestic purposes, do you intend to use this water, water from another source, or both, to irrigate your lawn, garden, and/or landscaping? None

11. a. Who owns the property at the point of diversion? Applicant

b. Who owns the land to be irrigated or place of use? Applicant

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Describe your proposal in narrative form, and provide additional explanation for any of the items above. Attach additional pages if necessary. Existing pond with capacity of 24 acre-feet diverts groundwater as a result of it being below water table. Evaporation losses calculated to be 8.2 AFA.

13. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year).

14. **MAP OF PROPOSED PROJECT REQUIRED** - Attach an 8½" x 11" map or maps clearly identifying the proposed point of diversion, place of use, section #, township & range. The map scale shall not be less than two (2) inches equal to one (1) mile.

The information contained in this application is true to the best of my knowledge. I understand that any willful misrepresentations made in this application may result in rejection of the application or cancellation of an approval.

Signature of Applicant


Greg Obendorf, Member

Print Name (and title, if applicable)

Signature of Applicant


Print Name (and title, if applicable)

Application for Water Right

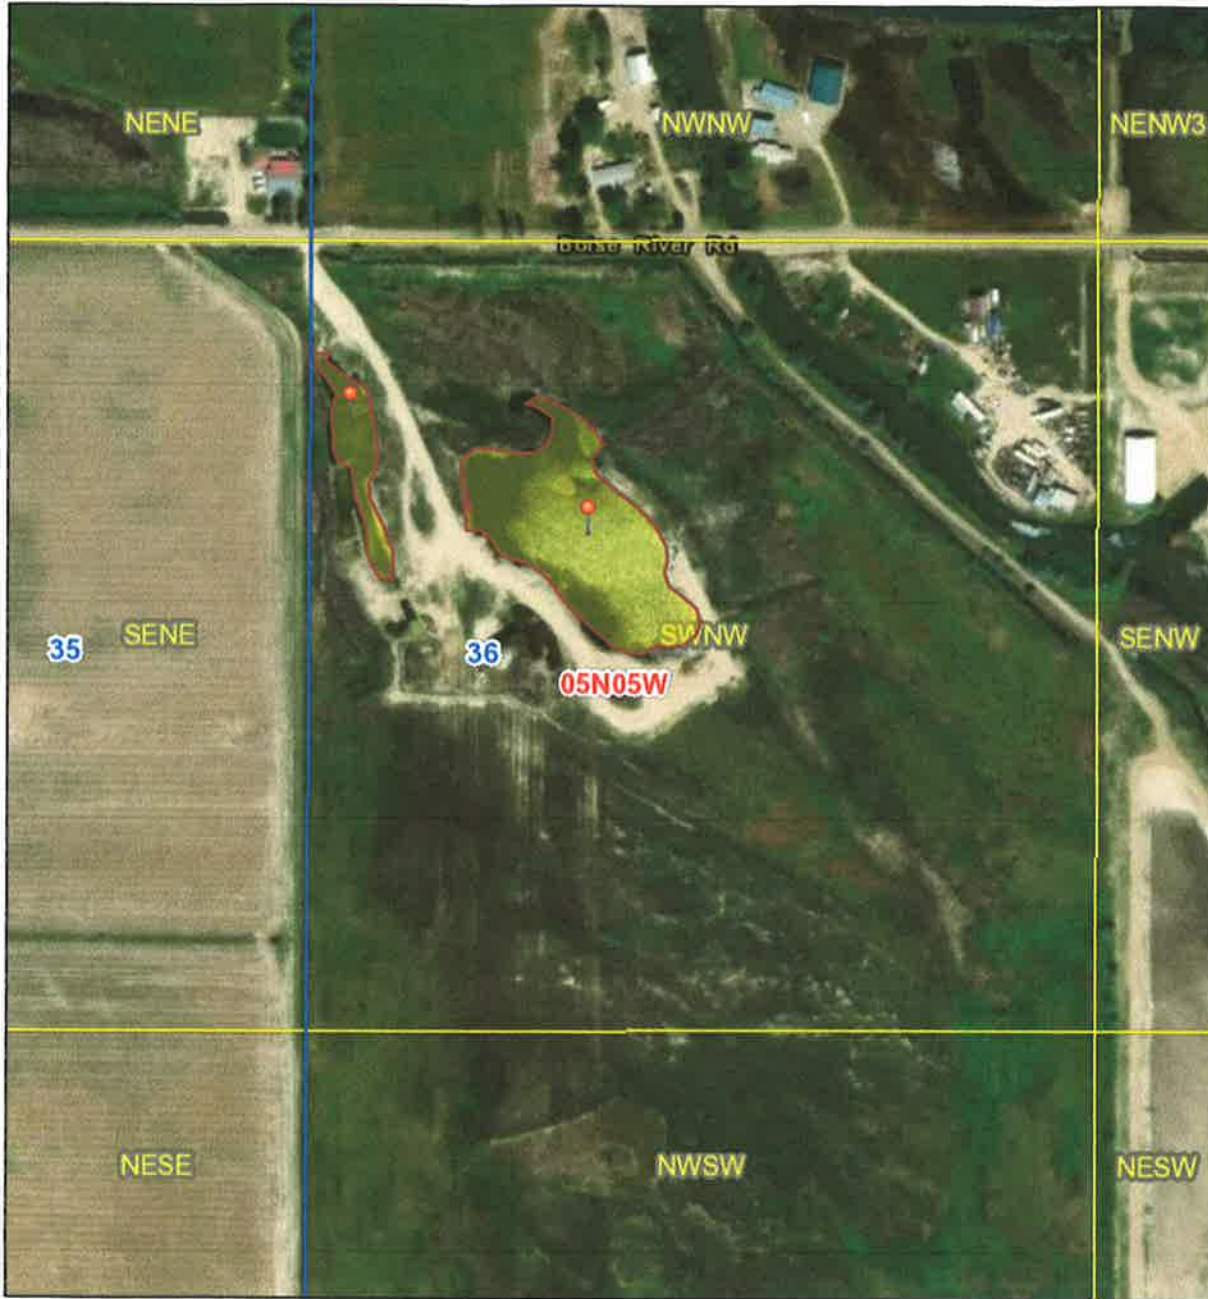

3/25/2020, 4:07:34 PM

-  Override 1
-  Section
-  Override 1
-  Township/Range
-  Counties
-  Idaho Outline
-  Quarter Quarter
-  Idaho Mask



Esri, HERE, Garmin, (c) OpenStreetMap contributors, Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community, Created by NRCS from 1:24,000 scale USGS topographic maps., Idaho Department of Water

Idaho Department of Water Resources

USDA FSA, GeoEye, Maxar | Created by NRCS from 1:24,000 scale USGS topographic maps. | Idaho Department of Water Resources | USDA Natural Resources Conservation Services | State of



State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN Region • 2735 W AIRPORT WAY • BOISE, ID 83705-5082

Phone: (208)334-2190 • Fax: (208)334-2348 • Website: www.idwr.idaho.gov

Brad Little
Governor

Gary Spackman
Director

September 25, 2020

GO INVESTMENT IDAHO, LLC
26538 SAND RD
PARMA, ID 83660

RE: Application for Permit No. 63-34957

Dear Applicant(s):

The Department of Water Resources has received your water right application. Please refer to the number referenced above in all future correspondence regarding this application.

A legal notice of the application has been prepared and is scheduled for publication in the PRESS TRIBUNE on 10/1/2020 and 10/8/2020. Protests to this application may be submitted for a period ending ten (10) days after the second publication.

If the application is protested, you will be sent a copy of each protest. All protests must be resolved before the application can be considered for approval. If the protest(s) cannot be resolved voluntarily, the Department will conduct a conference and/or hearing on the matter.

If the application is not protested, the Department will process your application and notify you of any action taken on the application. If your application is approved, the Department will send you a copy of the permit.

Please contact this office if you have any questions regarding the application.

Sincerely,

A handwritten signature in blue ink, appearing to read 'Kensie Thorneycroft'.

Kensie Thorneycroft
Administrative Assistant

CC:
HONSINGER LAW, PLLC

Thorneycroft, Kensie

From: Thorneycroft, Kensie
Sent: Friday, September 25, 2020 10:14 AM
To: 'legals@idahopress.com'
Subject: Canyon Legal Notice
Attachments: CoverLetter.docx; LegalNotice.docx

Follow Up Flag: Follow up
Flag Status: Flagged

Good Morning Legal Clerk,

I am sending you the new legal notices, please send confirmation to my email.

Please see the attached ad for publication on 10/1/2020 and 10/8/2020.

Please confirm these are okay to publish as shown.

Kensie Thorneycroft
Administrative Assistant
IDWR Western Region
208-334-2190



State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN Region • 2735 W AIRPORT WAY • BOISE, ID 83705-5082

Phone: (208)334-2190 • Fax: (208)334-2348 • Website: www.idwr.idaho.gov

Brad Little
Governor

Gary Spackman
Director

September 25, 2020

LEGAL NOTICE DEPARTMENT
PRESS TRIBUNE
PO BOX 9399
NAMPA, ID 83652

RE: Application for Permit No. 63-34905, 63-34952, 63-34956, 63-34957

Dear Legal Notice Department:

Please publish the enclosed legal notice on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 10/19/2020. Your cooperation is appreciated.

Sincerely,

Kensie Thorneycroft
Administrative Assistant

Enclosure(s)

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-34905

OBENDORF HOP, INC.
24034 BATT CORNER RD
PARMA, ID 83660-7308

Point of Diversion SWNW S36 T05N R05W CANYON County Source DIXIE SLOUGH Tributary BOISE RIVER

Use: DIVERSION TO STORAGE 01/01 to 12/31 0.8 CFS

Use: AESTHETIC STORAGE 01/01 to 12/31 24 AF

Use: WILDLIFE STORAGE 01/01 to 12/31 24 AF

Use: IRRIGATION 03/01 to 11/15 0.8 CFS

Use: WILDLIFE 01/01 to 12/31 0.52 CFS

Use: AESTHETIC 01/01 to 12/31 0.52 CFS

Total Diversion: 0.8 CFS, 24 AF

Date Filed: 05-11-2020

Place Of Use: AESTHETIC, AESTHETIC STORAGE, DIVERSION TO STORAGE, IRRIGATION, WILDLIFE, WILDLIFE STORAGE
T05N R05W S36 SWNW

Place Of Use: IRRIGATION

T05N R05W S36 NWSW

Total Acres: 40

63-34952

EDWARD LODGE
18500 SYMMS RD
CALDWELL, ID 83607-9512

Point of Diversion SWNW S13 T03N R04W CANYON County Source GROUND WATER

Use: IRRIGATION 03/01 to 11/15 0.38 CFS

Use: STOCKWATER 01/01 to 12/31 0.04 CFS

Total Diversion: 0.42 CFS

Date Filed: 08-25-2020

Place Of Use: IRRIGATION, STOCKWATER

T03N R04W S13 SWNW

Total Acres: 19

Water bearing zone to be appropriated is from 100 to 200 feet.

63-34956

WILLOW CREEK WHOLESALE NURSERY, LLC
25455 LANSING LN
MIDDLETON, ID 83644-5326

Point of Diversion NESE S28 T05N R02W CANYON County Source GROUND WATER

Point of Diversion SENE S28 T05N R02W CANYON County Source GROUND WATER

Use: IRRIGATION 03/01 to 11/15 1.66 CFS

Total Diversion: 1.66 CFS

Date Filed: 09-08-2020

Place Of Use: IRRIGATION

T05N R02W S28 NESW, NESE, NWSE, SENE

Total Acres: 83

Water bearing zone to be appropriated is from 100 to 400 feet.

63-34957

GO INVESTMENT IDAHO, LLC
26538 SAND RD
PARMA, ID 83660

Point of Diversion SWNW S36 T05N R05W CANYON County Source GROUND WATER

Use: AESTHETIC STORAGE 01/01 to 12/31 24 AF

Use: WILDLIFE STORAGE 01/01 to 12/31 24 AF

Total Diversion: 24 AF

Date Filed: 03-30-2020

Place Of Use: AESTHETIC STORAGE, WILDLIFE STORAGE

T05N R05W S36 SWNW

Water bearing zone to be appropriated is from 0 feet to 15 feet for the ponds.

Permits will be subject to all prior water rights. For additional information concerning the property location, contact the Western office at (208)334-2190; or for a full description of the right(s), please see <https://idwr.idaho.gov/apps/ExtSearch/WRAApplicationResults/>. Protests may be submitted based on the criteria of Idaho Code § 42-203A. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 W AIRPORT WAY, BOISE ID 83705-5082 together with a protest fee of \$25.00 for each application on or before 10/19/2020. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Director

Published on 10/1/2020 and 10/8/2020

Miller, Nick

From: Charles Honsinger <honsingerlaw@gmail.com>
Sent: Friday, August 28, 2020 1:51 PM
To: Miller, Nick
Subject: GO Investments, LLC application for permit to divert from groundwater for gravel pit ponds

Dear Nick: As we discussed by telephone earlier today, I am requesting on behalf of GO Investments, LLC that IDWR begin processing the permit application filed by GO Investments on or about March 25, 2020. You will recall that pursuant to an agreement with IDWR staff, we had requested that the permit be held for processing until a companion Dixie Slough permit application was processed. Now that the Dixie Slough permit application is being processed, it is appropriate to begin processing the groundwater application as well.

Please let me know of any questions or concerns. Thank you.

Sincerely,

Charles L. Honsinger
Honsinger Law, PLLC
P.O. Box 517
Boise, ID 83701
Phone: (208)863-6106
Fax: (208)908-6085
honsingerlaw@gmail.com

CONFIDENTIALITY NOTICE: This message is intended for the use of the individual or entity to which it is addressed and may contain information that is privileged, confidential and exempt from disclosure under applicable law. If the reader of this message is not the intended recipient, you are hereby notified that any dissemination or distribution of this communication to other than the intended recipient is strictly prohibited. If you have received this communication in error, please notify us immediately. Thank you.



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region • 2735 W Airport Way • Boise ID 83705-5082

Phone: (208) 334-2190 • Fax: (208) 334-2348

Website: idwr.idaho.gov • Email: westerninfo@idwr.idaho.gov

BRAD LITTLE
Governor

GARY SPACKMAN
Director

April 17, 2020

GO Investments Idaho, LLC
26358 Sand Road
Parma, Idaho, 83660

RE: Application for Permit Extension Granted

Dear Applicant,

On March 30, 2020 the Idaho Department of Water Resources (Department) received a letter requesting IDWR hold off processing the application in the name of GO Investments to allow the Dixie Slough application to be processed. An extension to hold processing for a period of 6 months was granted April 17, 2020.

Water Appropriation Rules (IDAPA 37.03.08) state that an applicant may request processing be interrupted for a period not to exceed six months. The department may renew the request as long as others will not be injured by the delay or that the applicant is not seeking delay for the purpose of speculation.

Thank you for your attention to this matter and hope you and your family are staying well during these times.

Sincerely,

Kate Hulse
Water Rights Agent

Honsinger Law, PLLC
Charles L. Honsinger
(208) 863-6106

March 25, 2020

RECEIVED

MAR 30 2020

WATER RESOURCES
WESTERN REGION

Mr. Nick Miller
Western Regional Office Manager
Idaho Department of Water Resources
2735 Airport Way
Boise, ID 83705-5082

Re: Application for Permit in the Name of GO Investments, LLC

Dear Mr. Miller:

Pursuant to the February 19, 2020 discussion between IDWR staff (yourself, Cherie Palmer, and Rob Whitney) and my client Greg Obendorf and I, enclosed please find the following:

1. An original application for a permit to appropriate groundwater for gravel ponds located on property owned by GO Investments, LLC.
2. A copy of the application to be conformed and returned to this office in the enclosed self-addressed and stamped envelope.
3. A check payable to the Idaho Department of water Resources in the amount of \$250 to cover processing fees.

As you are aware, Mr. Obendorf's son will also be filing an application for water in these ponds related to his proposed use of Dixie Slough water for irrigation purposes. Accordingly, and as agreed in our February 19, 2020 meeting, I am requesting that IDWR hold off processing this application for a period of six months to allow the Dixie Slough application to be processed, and likely resolve the issue of existing ponds without water rights.

Please contact me with any questions or concerns.

Sincerely,



Charles L. Honsinger

cc: Client

Miller, Nick

From: Palmer, Cherie
Sent: Monday, February 24, 2020 4:52 PM
To: Charles Honsinger
Cc: Whitney, Rob; Miller, Nick
Subject: Obendorf Pond Calcs
Attachments: Copy of pond-loss-calculation.pdf

Charles,

Attached are a few worksheets and a map of Mr. Obendorf's ponds. It looks like evaporation is 8.2 af per year and a capacity of 24 af. You may get in touch with me if you would like to discuss these items; otherwise please contact Western regional office since this is where the application will be processed.

Cherie Palmer | Enforcement Coordinator | Compliance Bureau

Idaho Dept. of Water Resources | 322 E Front St., Boise (Front & Broadway)

208-287-4944 | Mail: PO BOX 83720 Boise, ID 83720-0098

email: cherie.palmer@idwr.idaho.gov

Evaporation Loss Calculations

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the annual evaporation losses from a pond.

FILE NUMBER	New Application
REVIEWER	Obendorf
DATE	2/24/2020

User Input
Calculated value
Formula Explanations

The acronyms used on the Kimberly Research Center website are defined below:

P = Precipitation
ET= Evapotranspiration
P _d = Precipitation deficit
P _d =ET-P

USING THIS SPREADSHEET

Use the link below to access the Kimberly Research Center website. This website provides the Precipitation Deficit for a station most representative of the pond under examination. The Precipitation Deficit is the total amount of free water surface evaporation minus the precipitation for a given area, which gives the total amount of evaporative losses incurred by the pond. There are several weather sites that are used throughout the state. IDWR staff can find the nearest site using Arc Map. The shape file containing the sites can be found at X:/Spatial/Climate/ETIdahostations.shp.

Instructions:

1. Use the link below to navigate to ET Idaho 2012.
2. Select the station which is most representative to your pond location.
3. Click Submit Query.
4. Under "Land Covers with Evapotranspiration Estimates," select "Open Water - Shallow Systems (ponds, streams)" or "Open Water - small stock ponds" depending on the pond size.
5. Click the link to "Precipitation Deficit."
6. Reference and copy (ctrl + C) the first subheading "Mean" values.
7. Click the "Paste Values from ET Idaho" button. The table will automatically enter a zero (0) for any negative precipitation deficit values.

Found at: <http://data.kimberly.uidaho.edu/ETIdaho/>

Precipitation Deficit

Station: Twin Falls 2 NNE (NWS -- 109294)

Month	mm/day ¹	Days per month	mm/Month
Jan	0.00	31	0.00
Feb	0.08	28	2.24
March	0.91	31	28.21
April	2.06	30	61.80
May	2.55	31	79.05
June	3.38	30	101.40
July	4.10	31	127.10
August	3.61	31	111.91
September	2.46	30	73.80
October	1.20	31	37.20
November	0.00	30	0.00
December	0.00	31	0.00

PLEASE NOTE: The seasonal average for precipitation deficit should not be used for calculations because precipitation often exceeds evaporation during wetter months of the year. If the pond is kept full, excess precipitation during wetter months does not serve to refill the pond during drier months.

For example, see Sandpoint KSPT (NWS -- 108137), the annual precipitation deficit is -106 mm. However, April through September have positive precipitation deficit values. To properly estimate the annual volume of water necessary to refill a pond due to evaporation losses, the table will automatically enter a zero (0) for each month that the precipitation value is reported as a negative value.

As described above, precipitation offsets evaporation in winter months, so the net effect is that wintertime precipitation deficit is usually zero.

Total mm/year = 622.71

$[(\text{mm/yr}) \div (\text{convert to feet})] \times (\text{Surface area of pond, in acres}) = \text{Evaporation Loss in Acre Feet}$

$$(622.71 \div 304.8) \times 4.00 = 8.2 \text{ AFA}$$

Total Storage Calculations

FILE NUMBER	New Application
REVIEWER	Obendorf
DATE	2/24/2020

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the total seepage, evaporation and fill capacity required for a pond.

User Input
Calculated value
Formula Explanations

Surface Area (AC.)	4	"Surface Area" is automatically carried over from the "Seepage Loss" sheet.
Average Pond Depth (FT.)	6	"Average Pond Depth" depicts the actual depth of the pond either measured or estimated. Note: If you know the maximum depth and not the average depth, the Field Examiner's Handbook suggests multiplying the maximum depth by 0.4 to get the average depth, or you can use any method that seems reasonable to attain average depth.
Pond Capacity (AF)	24	Pond Capacity is calculated by multiplying the Pond Surface Area by the Average Pond Depth. If you know the capacity, divide the capacity by surface area and enter the average pond depth in the space above. Note: If pond capacity is determined using a method shown on the "Pond Capacity" sheet, the user may need to modify the value of "Pond Capacity" (cell B9) manually. Note that if the value is modified manually, the formula will be altered for future use.
Multiple Fill Volume Above Initial Fill to Fulfill From Storage Needs- "Multiple Fills" (AF)	1	The "Multiple Fill Volume Above Initial Fill" is the acre-feet of water required to meet a <i>from storage</i> component if the <i>from storage</i> component exceeds a one time fill. This section should not include the amount of water needed to fill the pond initially or the amount of water needed to maintain the pond level due to evaporation or seepage. For example: if a pond has a capacity of 5 acre feet and 2.5 acre feet of seepage and evaporation, but the pond is used for irrigation that requires 10 acre feet of from storage for the irrigation use, then you would insert 5 acre feet into this location (10 acre feet needed - 5 acre feet from the initial fill = 5 acre feet of additional storage needed). Note: You must have a "From Storage" component exceeding the initial fill on the permit to include a volume in this space.
Estimated Seepage Loss (AF)	0.0	The "Estimated Seepage Loss" is automatically carried over from the "Seepage Loss" sheet.
Estimated Evaporation Loss (AF)	8.2	The "Estimated Evaporation Loss" is automatically carried over from the "Evaporation Loss" sheet.
Total Volume Required (AF)	33.2	The "Total Volume Required" is calculated by adding the Pond Capacity, Multiple Fills, Seepage Loss, and Evaporation Loss amounts to determine the total amount of storage required.


Pond Capacity Determination

Cylinder Shaped

$$\text{Volume} = \pi \cdot (\text{radius})^2 \cdot \text{height}$$

OR



$$\text{Volume} = \text{circular surface area} \cdot \text{depth}$$

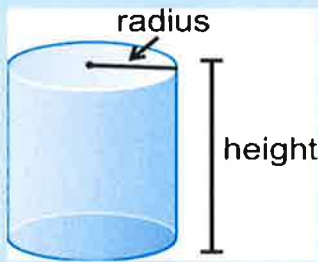

Truncated Cone Shaped


$$\text{Volume} = (1/3) \cdot \pi \cdot (r_1^2 + r_1 \cdot r_2 + r_2^2) \cdot h$$

where h = water depth
 r_1 = radius at top of basin
 r_2 = radius at bottom of basin





Freeform Polygon with Sloped Sides and Bottom

$$\text{Volume} = \text{surface area} \cdot (2/5) \cdot \text{maximum depth}$$



Freeform Polygon with Vertical Sides and Flat Bottom

$$\text{Volume} = \text{surface area} \cdot \text{maximum depth}$$

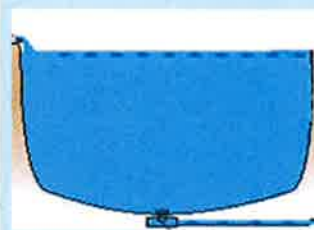

The surface area of a freeform polygons should be measured using aerial photography and ArcGIS.

For ponds with an unusual shape and inconsistent depth, the reviewer may be able to combine different shapes to calculate a total pond volume.

Obendorf Ponds

