

RECEIVED

42-222 POD - 07/18

JUN 24 2020

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

JUN 12 2020

IDWR / NORTH

IDWR / NORTH

APPLICATION FOR TRANSFER OF WATER RIGHT – POINT(S) OF DIVERSION

This form may be used to apply to change and/or add points of diversion for existing water rights and to report an ownership change for a water right(s) in connection with the proposed point of diversion change(s). Do not use this form to apply for changes to other elements of a water right. See the Application for Transfer Instructions for help completing this form and for mailing addresses of Department offices where your application can be submitted.

Check all that apply:

- ☒ Change diversion point(s) ☒ Add diversion point(s) ☒ Ownership change ☐ Ownership split
☐ Transfer is for changes pursuant to Idaho Code § 42-221.O.8. Attach an explanation and any supporting documentation.

1. **APPLICANT(S)** Gem State Water Company, LLC Phone (877) 755-9287
 2. **MAILING ADDRESS** P.O. Box 3388 City Coeur d'Alene
 State Idaho Zip 83816 Email leslie@gemstate-water.com

- ☐ If the applicant is not an individual and not registered to do business in the State of Idaho, attach documentation identifying officers authorized to sign for the applicant.
☐ If the applicant is not the current water right(s) owner, attach documentation of authority to file the application.
☒ If the application includes a change in ownership of water right(s), attach a copy of the conveyance document, such as a warranty deed, court decree, contract of sale, etc. The conveyance document must include a legal description of the property conveyed or description of the water right if no land is conveyed. Additional fee(s) are required for water right ownership changes; see Item 9 for the fee schedule.

If the ownership change resulted in the water right(s) being split, how did the division occur? Mark one:

- ☐ The water rights or claims were divided as specifically identified in a deed, contract, or other conveyance document.
☐ The water rights or claims were divided proportionately based on the portion of their place(s) of use acquired by the new owner.
☐ If the application is not signed by the applicant, attach a Power of Attorney or other documentation providing authority to sign for the applicant.

3. **LIST WATER RIGHT NUMBER(S)** 95-10068

- ☒ Attach a copy of the water right(s) as recorded, available at idwr.idaho.gov, Water Right Transfers, Step 1, or by contacting any Department office.

4. **TOTAL AMOUNT OF WATER** transferred is 2.70 cubic feet per second and/or 869.00 acre-feet per annum.
 (diversion rate) (storage volume)

5. **POINT OF DIVERSION** – Describe all the point(s) of diversion to be included on the water right(s) after the proposed change.

- ☐ Attach Eastern Snake Plain Aquifer (ESPA) analysis if this transfer proposes to change a point of diversion affecting the ESPA. ESPA analysis information is available at idwr.idaho.gov, Water Rights, Water Right Transfers, Modeling Resources.

New?	Lot	¼	¼	¼	Sec	Twp	Rge	County	Source	Local name or tag #
N	2	NW	NE		03	51N	04W	Kootenai	Well #1	276739
Y	2	NW	NE		03	51N	04W	Kootenai	Well #2	Proposed

6. GENERAL INFORMATION

- a. Describe the complete diversion system, including how you will accommodate a measuring device and lockable controlling works should they be required now or in the future:

Existing Well #1 is 16" diameter; proposed Well #2 is 12" diameter. Flow meters for the wells will be located inside the wellhouse, on the well lot. All well pump control equipment is located inside the locked wellhouse.

- b. Who owns the property at the point(s) of diversion? Gem State Water Company, LLC

If other than the applicant, describe the arrangement enabling the applicant to access the property for the diversion system:

- c. To your knowledge, has/is any portion of the water right(s) proposed to be changed:

Yes No

- ☐ ☒ undergone a period of five or more consecutive years of non-use,
☐ ☒ currently used in a mitigation plan limiting the use of water under the right(s), or
☐ ☒ currently enrolled in a Federal set-aside program limiting the use of water under the right(s)?


If yes, describe:

- d. Is any portion of the water right(s) proposed to be changed currently leased to the Water Supply Bank? ☐ Yes ☒ No

- ☐ If yes and there are multiple owners, attach a Lessor Designation form.
☐ If yes, the individual owner or designated lessor must complete, sign and attach an IRS Form W-9.
(Disregard if these items are on file and ownership has not changed.)

7. **MAP** – ☒ Attach a map of the diversion, measurement, control and distribution system. Include the place of use if a split of the water right occurred. Clearly label the map with township, range, section and ¼ ¼ of section information. You may create a map at idwr.idaho.gov, *Water Rights, Water Right Transfers, File a Transfer Application, Step 2C*.

8. **SIGNATURE** – The information in this application is true to the best of my knowledge. I understand any willful misrepresentations in this application may result in rejection of the application or cancellation of an approval.


Signature of applicant or authorized agent

Leslie Rayner / General Manager 6/12/20
Print name and title if applicable Date

Signature of applicant or authorized agent

Print name and title if applicable

Date

9. **FEE** – ☒ The application filing fee provided in Idaho Code § 42-221.O, must be submitted with the application for transfer. Applications for changes pursuant to Idaho Code § 42-221.O.8, require a filing fee of \$50 per water right. All other application fees are based on the total amount of water proposed for transfer in Item 4: the larger fee for either cubic feet per second (diversion rate) or acre-feet per annum (storage volume). The Fee Schedule is available at www.idwr.idaho.gov, *Water Right Transfers, Step 4* and in the Application for Transfer Instructions.

FOR DEPARTMENT USE ONLY

Transfer includes _____ pages of attachments. Received by _____ Date _____
Fee paid 685.00 Date 6-30-2020 Received by Je Receipt # 15036168 N036202
Preliminary review by _____ Date _____ Active in the Water Supply Bank? Yes ☐ No ☐
W-9 received? Yes ☐ No ☐ Name on W-9 _____ W-9 forwarded to fiscal? Yes ☐ No ☐

660.00 Transfer
25.00 Ownership Change
(Do NOT scan the W-9 – confidential information is held by fiscal only)

DISTRICT COURT - CSRBA
DISTRICT OF Fifth Judicial District
TWIN FALLS County of Twin Falls - State of Idaho

NOV - 8 2019

By _____ Clerk

Deputy Clerk

In Re CSRBA

Case No. 49576

PARTIAL DECREE PURSUANT TO
I.R.C.P. 54 (b) FOR
Water Right 95-10068

NAME AND ADDRESS: DIAMOND BAR ESTATES LLC
ROBERT N TURNIPSEED
PO BOX 971
HAYDEN, ID 83835

SOURCE: GROUND WATER

QUANTITY: 2.70 CFS
869.00 AFY

PRIORITY DATE: 11/29/1965

POINT OF DIVERSION: T51N R04W S03 LOT 4 (NWNW) Within Rootenai County
LOT 2 (NWNE)

PURPOSE AND PERIOD OF USE:	PURPOSE OF USE	PERIOD OF USE	QUANTITY
	Municipal	01-01 TO 12-31	2.70 CFS
			869.00 AFY

PLACE OF USE:

Place of use is within the area served by the public water supply system of the Diamond Bar Estates.

OTHER PROVISIONS NECESSARY FOR DEFINITION OR ADMINISTRATION OF THIS WATER RIGHT:

To the extent necessary for administration between points of diversion for ground water, and between points of diversion for ground water and hydraulically connected surface sources, ground water was first diverted under this right from Diamond Bar Estates Well No. 1 located in T51N, R04W, S03, Lot 2 (NWNE).

THIS PARTIAL DECREE IS SUBJECT TO SUCH GENERAL PROVISIONS NECESSARY FOR THE DEFINITION OF THE RIGHTS OR FOR THE EFFICIENT ADMINISTRATION OF THE WATER RIGHTS AS MAY BE ULTIMATELY DETERMINED BY THE COURT AT A POINT IN TIME NO LATER THAN THE ENTRY OF A FINAL UNIFIED DECREE. I. C. SECTION 42-1412(6).


RULE 54 (b) CERTIFICATE

With respect to the issues determined by the above judgment or order, it is hereby CERTIFIED, in accordance with Rule 54(b), I.R.C.P., that the court has determined that there is no just reason for delay of the entry of a final judgment and that the court has and does hereby direct that the above judgment or order shall be a final judgment upon which execution may issue and an appeal may be taken as provided by the Idaho Appellate Rules.

Eric J. Wildman
Presiding Judge of the
Coeur d'Alene-Spokane River Adjudication

Transfer of Water Right - Points of Diversion

95-10068

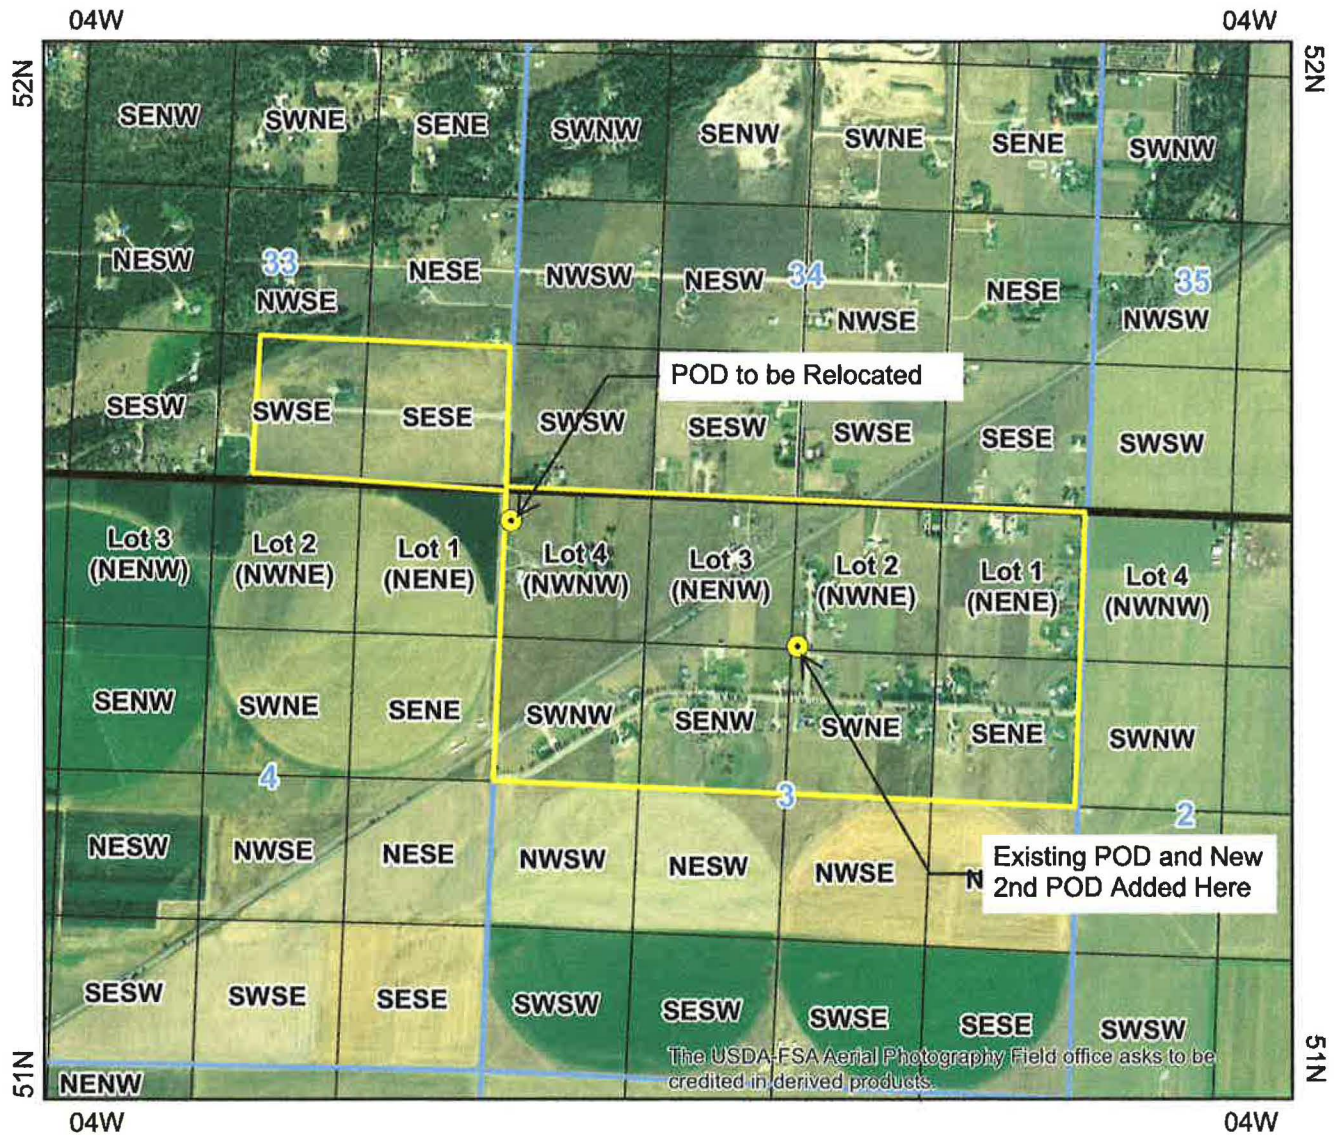

● Point of Diversion

Water Service Area Boundary

Townships

PLS Sections

Quarter Quarters

0 0.2 0.4 0.8 Miles



[illegible]

When recorded return to:

Gem State Water Company, LLC
220 NW Second Avenue
Portland, OR 97209

Space above this line reserved for recorder's use only

GRANT DEED

For value received, Diamond Bar Estates, L.L.C., an Idaho limited liability company (also appearing of record as Diamond Bar Estates, LLC, an Idaho limited liability company) ("Grantor"), does hereby grant, bargain, sell and convey to Gem State Water Company, LLC, an Idaho limited liability company ("Grantee"), whose address is 220 NW Second Avenue, Portland, Oregon, 97205, that real certain real property described on Exhibit A, Exhibit B, and Exhibit C (collectively, the "Property"), attached hereto and incorporated herein.

TOGETHER WITH all and singular the tenements, hereditaments, and appurtenances thereunto belonging, or otherwise appertaining, and all estate, right, title and interest in and to the Property.

TO HAVE AND TO HOLD the Property unto Grantee and Grantee's heirs, successors and assigns forever. Grantor does hereby covenant to and with Grantee that Grantor is the owner in fee simple of the Property and that the Property is free of encumbrances created or suffered by Grantor, and Grantor will warrant and defend the same from all lawful claims whatsoever, subject to, and excepting and excluding from the covenants and warranties described herein, the matters set forth on attached Exhibit D.

In witness whereof, Grantor has executed this Grant Deed this 30th day of September 2019.


DIAMOND BAR ESTATES, L.L.C.,
an Idaho limited liability company

By: Robert N. Turminski
Name: ROBERT N. TURMINSKI
Its: CEO

[Acknowledgement on following page.]

STATE OF IDAHO)
)
County of Kootenai)

This record was acknowledged before me on September 30 2019, by Robert P. Turnipseed
as manager of Diamond Bar Estates, L.L.C.



Notary Public for Idaho

My commission expires: 9-3-24



EXHIBIT A

Legal Description

Lot 999, also known as "Pump House Lot," Block 1, DIAMOND BAR ESTATES, according to the plat recorded in the office of the County Recorder in Book G of Plats at Page 164, records of Kootenai County, Idaho.

EXHIBIT B

Description of Additional Easements

1. Any and all easements that benefit the utility system operated by Diamond Bar Estates, LLC, that are disclosed on the plat that was recorded on August 17, 1994 at Book G of Plats at Page 164 in the official records of Kootenai County, Idaho.

EXHIBIT C

Description of Water Rights

1. Water Right No. 95-10068

EXHIBIT D

Exceptions to Title

1. Assessments of the Diamond Bar Water Association.
2. Assessments of the Diamond Bar Estates Homeowners Association.
3. Restrictions, conditions, dedications, notes, easements and provisions delineated and/ or described on the plat recorded in Book G of Plats at Page 164, Diamond Bar Estates, records of Kootenai County, Idaho.
4. Covenants, conditions and restrictions as set forth in the document, but omitting any covenant or restriction based on race, color, religion, sex, sexual orientation, familial status, marital status, disability, handicap, national origin, ancestry, or source of income, as set forth in applicable state or federal laws, except to the extent that said covenant or restriction is permitted by applicable law.

Recorded: August 17, 1994

Instrument No.: 1366723, records of Kootenai County, Idaho

Amendment to said covenants, conditions and restrictions

Recorded: September 8, 1994

Instrument No.: 1369315, records of Kootenai County, Idaho.



State of Idaho
Department of
Environmental Quality

2110 Ironwood Parkway • Coeur d'Alene, ID 83814 • (208) 769-1422

Brad Little, Governor
John H. Tippetts, Director

March 10, 2020

Leslie Rayner
Gem State Water
leslie@gemstate-water.com

Subject: PWS ID1280268 Diamond Bar Estates, Well Site Evaluation Report
DEQ Approval

Dear Ms. Rayner:

On March 10, 2020, the Idaho Department of Environmental Quality (DEQ) met with Tom Mullen of Northwest Groundwater Consultants, Rob Turnipseed and you to evaluate a proposed well site for the Diamond Bar Estates water system. The well site is located off N. Rodeo Rd. in Rathdrum, Kootenai County, Idaho (47°47'56.91"N, 116°49'6.98"W).

A well site evaluation report was submitted to DEQ on February 21, 2020. The proposed location appears to meet all setback requirements as identified in the Idaho Rules for Public Drinking Water Systems (Rules) Section 900.01 Table 1 – *Minimum Distances from a Public Water System Well*. This letter is to confirm that DEQ has reviewed and has approved the proposed well site evaluation report in accordance with the Rules.

The following requirements must be met for the well site to be approved for a public drinking water source:

Well Construction Preliminary Engineering Report – A preliminary engineering report (PER) stamped by an Idaho licensed Professional Engineer for the well must be approved by DEQ prior to drilling. The well PER needs to incorporate the well site evaluation requirements and findings. The well PER also needs to incorporate test pumping procedures. For additional information and guidance on test pumping, please refer to the *Guidance for New Source Water Testing Procedures for Public Drinking Water Systems* which is available online at:

http://www.deq.idaho.gov/media/515237-source_water_testing_procedures_guidance.pdf

Well Construction Plans and Specifications – Construction plans and specifications (P&S) prepared by an Idaho licensed Professional Engineer for the well must be approved by DEQ prior to drilling. The well P&S may be submitted with the well PER, simultaneously. The well P&S need to incorporate the well site evaluation requirements and findings. Well P&S must demonstrate compliance with the Rules; Sections 510.03, 511, and 513 of the Rules are specific to well construction. Well drilling must be completed in accordance with the approved P&S. In addition,

there may be other applicable rules and laws administered by the Idaho Department of Water Resources (IDWR).

Setbacks – Please observe the following setbacks and restrictions, as per Section 510.02 of the Rules, the well must be located in excess of:

- 1,000 feet from biosolids land application sites
- Required distance for reclamation and reuse of municipal and industrial wastewater sites as per IDAPA 58.01.17
- 500 feet from municipal or industrial wastewater plants
- 100 feet from all septic tanks
- 100 feet from all individual home disposal fields
- 100 feet from all individual home seepage pits
- 100 feet from all privies
- 100 feet from all pressure sewer lines
- 100 feet from all standard subsurface disposal drainfields
- 150-300 feet from all large soil absorptions systems
- 50 feet from all gravity wastewater/sewer lines
- 50 feet from all livestock
- 50 feet from canals, streams, rivers, ditches, lakes, and ponds
- 50 feet from storm water facilities disposing storm water originating off well lot
- 50 feet from all tanks used to store non-potable substances
- 50 feet from all potential sources of contamination

Control of Site – Public drinking water wells must be sited on a well lot owned or controlled by the water system. If the well lot is not owned in fee simple, the property must be controlled by a lease or easement. The well lot must extend a minimum of 50 feet in all directions from the well. All other requirements for well lots as noted in Section 512 of the Rules must be adhered to as well.

Well Completion Report – Upon completion of the well drilling, record drawings, test pumping data, and initial source monitoring must be submitted to DEQ for review prior to utilizing the source. Information must meet the requirements of Section 510.05 & 510.06 of the Rules and Idaho Code 39-118. Record drawings must be prepared by an Idaho licensed Professional Engineer and submitted to our office within thirty (30) days of completion of construction

As the project is proposed for a community system, the following monitoring results will need to be provided upon completion of the well:

- | | |
|-----------------------------|-------------------------------|
| • Total coliform | • Iron |
| • Inorganic contaminants | • Manganese |
| • Organic contaminants | • Corrosivity (as alkalinity) |
| • Radionuclide contaminants | |

Ms. Rayner – Diamond Bar Estates Well Site Evaluation Report Approval
March 10, 2020
Page 3

If the potential exists for the proposed well to be under the direct influence of surface water, at least two microscopic particulate analyses (MPA) will be required in order to assess the potential impacts of ground water under the direct influence of surface water. This is often most easily conducted during the 24 hour pump test.

Should you have any questions or require additional information, please do not hesitate to contact me at (208) 666-4634 or via e-mail at Taylor.Enos@deq.idaho.gov.

Regards,



Taylor Enos
Water Quality Engineer

Ec: Rob Turnipseed, Diamond Bar Estates, avondalecon@frontier.com
Tom Mullen, Northwest Groundwater Consultants, LLC, tfmullen@northwestgroundwater.com
Matthew Plaisted, P.E., DEQ Engineering Manager, matthew.plaisted@deq.idaho.gov
Anna Moody, DEQ DW Supervisor, anna.moody@deq.idaho.gov
Suzanne Scheidt, DEQ DW Compliance Officer, suzanne.scheidt@deq.idaho.gov
Adam Frederick, IDWR, adam.frederick@idwr.idaho.gov
EDMS: ID1280268 : 2020AGD821 : 2020AGD1133 (P&S 44720)



State of Idaho

DEPARTMENT OF WATER RESOURCES

NORTHERN Region • 7600 N MINERAL DR STE 100 • COEUR D ALENE, ID 83815-7763
Phone: (208)762-2800 • Fax: (208)769-2819 • Website: www.idwr.idaho.gov

Brad Little
Governor

Gary Spackman
Director

July 7, 2020

GEM STATE WATER CO LLC
PO BOX 3388
COEUR D ALENE, ID 83816

RE: Transfer No. 84200
Water Right No. 95-10068

Dear Applicant(s):

The Department of Water Resources has received your water right transfer application. Please refer to the transfer number referenced above in all future correspondence regarding this transfer.

A legal notice of the application has been prepared and is scheduled for publication in the COEUR D ALENE PRESS on 7/16/2020 and 7/23/2020. Protests to this application may be submitted for a period ending ten (10) days after the second publication.

If the application is protested, you will be sent a copy of each protest. All protests must be resolved before the application can be considered for approval. If the protest(s) cannot be resolved voluntarily, the Department will conduct a conference and/or hearing on the matter.

If the application is not protested, the Department will process your application and notify you of any action taken on the application. If your application is approved, the Department will send you a copy of the approval document.

Please contact this office if you have any questions regarding the application.

Sincerely,

Tammy Alleman
Administrative Assistant

Alleman, Tammy

From: Alleman, Tammy
Sent: Thursday, July 9, 2020 4:22 PM
To: 'Chantilly.Higbee@deq.idaho.gov'; 'Anna.Moody@deq.idaho.gov'
Subject: Request for Comments on Transfer #84200 WR# 95-10068

Dear Interested Agencies:

The Department of Water Resources is seeking written comment and/or recommendations from your agency regarding the above referenced Water Right applications. You can find copies of the applications at: <http://www.idwr.idaho.gov/apps/ExtSearch/WRAJSearch/WRADJSearch.aspx>.

This office can publish notice of the application as soon as the initial review is completed; therefore, your prompt response to this request is appreciated. If your agency desires to formally protest the approval of the application(s), you may do so after the notice is published by filing a written protest along with a \$25.00 filing fee within 10 days after final publication. The deadline for comments on the applications is August 3, 2020.

Please contact the Northern Region Office at (208) 762-2800 if you have any questions regarding the applications.

Thank you,

Tammy

*Tammy Alleman
Administrative Assistant
Idaho Department of Water Resources
7600 N Mineral Drive, Suite 100
Coeur d'Alene, ID 83815-7763
Phone: (208) 762-2800
Fax (208) 762-2819*

Alleman, Tammy

From: Alleman, Tammy
Sent: Tuesday, July 7, 2020 2:38 PM
To: 'LEGALS@CDAPRESS.COM'
Subject: Legal Notice
Attachments: Legal Notice for 84200, 95-17902, 95-17958, 95-17960, 95-17961, 95-17963 to 95-17965, 95-17967.docx

Please publish the enclosed legal notice in the **Coeur d'Alene Press** on the dates indicated **July 16th & June 23rd, 2020** (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately. Please send a proof once you have the article ready for print for our review.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before **August 3, 2020**. Your cooperation is appreciated.

Thank you,

Tammy

*Tammy Alleman
Administrative Assistant
Idaho Department of Water Resources
7600 N Mineral Drive, Suite 100
Coeur d'Alene, ID 83815-7763
Phone: (208) 762-2800
Fax (208) 762-2819*

NOTICE OF PROPOSED CHANGE OF WATER RIGHT
TRANSFER NO. 84200

GEM STATE WATER CO LLC, PO BOX 3388, COEUR D ALENE, ID 83816 has filed Application No. 84200 for changes to the following water right within KOOTENAI County: Right No. 95-10068; to see a full description of these rights and the proposed transfer, please see <https://research.idwr.idaho.gov/apps/waterrights/querynewtransfers>. The purpose of the transfer is to change a portion of the above rights as follows:

The applicant proposes to move a point of diversion from L4(NWNW) of Section 3, Twp 51N, Rge 04W to L2(NWNE) of Section 3, Twp 51N, Rge 04W.

For additional information concerning the property location, contact Northern Region office at (208)762-2800. Protests may be submitted based on the criteria of Idaho Code Sec. 42-222. Any protest against the proposed change must be filed with the Department of Water Resources, Northern Region, 7600 N MINERAL DR STE 100, COEUR D ALENE ID 83815-7763 together with a protest fee of \$25.00 for each application on or before 8/3/2020. The protestant must also send a copy of the protest to the applicant.

The following applications have been filed to appropriate the public waters of the State of Idaho:

95-17602

SETH ESTATES WATER ASSOCIATION
2964 E OBADIAH CT
ATHOL, ID 83801-7201
Point of Diversion NENE
S30 T53N R03W
KOOTENAI County
Source GROUND WATER
Use: STOCKWATER
01/01 to 12/31 0.02 CFS
Use: DOMESTIC
01/01 to 12/31 0.13 CFS
Total Diversion: 0.15 CFS
Date Filed: 07-23-2018
Place Of Use: DOMESTIC, STOCKWATER
T53N R03W S30
NENE, NWNE

95-17958

ASPEN HOMES AND DEVELOPMENT LLC
1831 N LAKEWOOD DR STE A
COEUR D ALENE, ID 83814-2669
Point of Diversion NWSW
S8 T52N R04W
KOOTENAI County
Source GROUND WATER
Point of Diversion SWSW
S8 T52N R04W
KOOTENAI County
Source GROUND WATER
Use: DOMESTIC
01/01 to 12/31
Total Diversion: 0.13 CFS
Date Filed: 06-18-2020
Place Of Use: DOMESTIC
T52N R04W S17
NENW, L3(NENW), L3(NWNW)
Place Of Use: DOMESTIC
T52N R04W S18 NENE
Place Of Use: DOMESTIC
T52N R04W S8
NESW, NWSW, L6(NWSW), SWSW, L5(SWSW), SESW, L5(ESW)

95-17960

JARED D ANDERSON
910 N B ST
COEUR D ALENE, ID 83814-2214
Point of Diversion SENW
S5 T49N R04W
KOOTENAI County
Source GROUND WATER
Use: DOMESTIC
01/01 to 12/31 0.1 CFS

Use: STOCKWATER
01/01 to 12/31 0.02 CFS
Total Diversion: 0.12 CFS
Date Filed: 06-23-2020
Place Of Use: DOMESTIC, STOCKWATER
T49N R04W S5 SENW

95-17961

KATHERINE CAMPBELL
KENT DURAND
2376 S KINDRED TRL
COEUR D ALENE, ID 83814-7173
Point of Diversion NENE
S26 T50N R05W
KOOTENAI County
Source GROUND WATER
Use: DOMESTIC
01/01 to 12/31
Total Diversion: 0.04 CFS
Date Filed: 06-25-2020
Place Of Use: DOMESTIC
T50N R05W S26
NENE, SENE

95-17963

RONALD & MAUREEN PAYNE LIVING TRUST
16546 N SALEM RD
HAYDEN, ID 83835-9869
Point of Diversion NESE
S28 T52N R03W
KOOTENAI County
Source GROUND WATER
Use: DOMESTIC
01/01 to 12/31
Total Diversion: 0.04 CFS
Date Filed: 06-24-2020
Place Of Use: DOMESTIC
T52N R03W S28 NESE

95-17964

DANIEL GARN
SHELECE GARN
7642 E GEM SHORES RD
HAYDEN, ID 83835-7143
Point of Diversion SWNE
S10 T51N R03W
KOOTENAI County
Source HAYDEN LAKE
Tributary SINKS
Use: DOMESTIC
01/01 to 12/31 0.04 CFS
Use: IRRIGATION
03/15 to 11/15 0.09 CFS
Total Diversion: 0.13 CFS
Date Filed: 06-26-2020
Place Of Use: DOMESTIC
T51N R03W S10
L5(NENE), L5(NWNE), L5(SWNE), L5(SENE)
Place Of Use: IRRIGATION
T51N R03W S10
L1(NENE), L2(NWNE), L5(SWNE), L5(SENE)
Total Acres: 2.9

95-17965

JOSEPH BOWEN
JANA BOWEN
6744 E GRETA AVE
POST FALLS, ID 83854-8003
Point of Diversion NESE
S9 T51N R03W

KOOTENAI County
Source HAYDEN LAKE
Tributary SINKS
Use: DOMESTIC
01/01 to 12/31
Total Diversion: 0.04 CFS
Date Filed: 06-26-2020
Place Of Use: DOMESTIC
T51N R03W S9 L3(NESE)

95-17967

ROBERT P PARKER
SHARRON A PARKER
2105 E CHERRY TREE LN
SPOKANE, WA 99203-5019
Point of Diversion SENE
S14 T53N R05W
KOOTENAI County
Source SPIRIT LAKE
Tributary SPIRIT CREEK
Use: DOMESTIC
01/01 to 12/31
Total Diversion: 0.04 CFS
Date Filed: 07-02-2020
Place Of Use: DOMESTIC
T53N R05W S14
SENE,L1(SENE)

Permits will be subject to all prior water rights. For additional information concerning the property location, contact the Northern office at (208)762-2800; or for a full description of the right(s), please see <https://idwr.idaho.gov/apps/ExtSearch/WRAApplicationResults/>. Protests may be submitted based on the criteria of Idaho Code § 42-203A. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Northern Region, 7600 N MINERAL DR STE 100, COEUR D ALENE ID 83815-7763 together with a protest fee of \$25.00 for each application on or before 8/3/2020. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Director

Published on 7/16/2020 and 7/23/2020