

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
APR 19 2019
DEPARTMENT OF
WATER RESOURCES

A Beneficial Use Field Report is prepared by a water right examiner as the result of an examination to clearly confirm and establish the extent of the beneficial use of water established in connection with a permit during the development period authorized by the permit and any extensions of time previously approved.

A. GENERAL INFORMATIONPermit No. 57-11834

1. Owner CAL LOW & SUSIE LOW Phone No. _____
Current address 21101 OREANA LOOP RD
2. Examiner's name SCOTT N. KING, P.E. EXAM DATE 5/18/2017 & 4/17/2019
3. Accompanied by CAL LOW Email _____
Address see above
- Relationship to permit holder PERMIT OWNER Phone No. _____
4. Source CASTLE CREEK tributary to SNAKE RIVER

B. OVERLAP REVIEW

1. Other water rights with the same place of use 57-220A & 57-10478
2. Other water rights with the same source and point of diversion 57-220A, 57-10478, 57-123, 57-220B

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident. No.	Gov't Lot	¼	¼	¼	Sec	Twp	Rge	County	Method of Determination/Remarks
1			NW	SW	35	4S	1E	OWYHEE	GPS, SITE VISIT

2. Place(s) of Use: Method of determination SITE VISIT, 2017 NAIP IMAGERY

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
4S	1E	35	40	39															79
					IS					IS									

IS = IRRIGATION STORAGE

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe diameter (inside), as applicable. Use the space provided or ☒ see attached.

Scale: 1" = _____

- ☒ Copy of USGS Quadrangle attached showing location(s) of point(s) of diversion and place(s) of use (**required**)
☒ Aerial photo attached (required for irrigation of 10+ acres)
☒ Photo of diversion and system attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size

*Code to correspond with no. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Flowmeter	Magnetic	Growsmar	IM3000	GT16120161	12"	3/10/2016

2. **Measurements:** _____

Permanent flowmeter installed in diversion pipeline.

E. NARRATIVE/REMARKS/COMMENTS

Water is diverted from Castle Creek from the same point of diversion authorized for water rights 57-123, 57-220B, 57-220A, and 57-10478 where it is piped to a recently constructed storage pond for storage under this permit. At the northeast corner of the pond, a 40-hp vertical turbine pump sends the water to the irrigated place of use in the NWNE and NENE of Section 35. Irrigation water is applied with a part-circle center pivot and K-Line Pods for the corners. Per Mr. Low, the Buss rights 57-123, 57-220B haven't been diverted at this location per many years.

Lockable control works and a measuring device have been installed. The Growsmart magnetic flowmeter was used to measure flow. A lockable gate valve is located just downstream of the flowmeter with additional gate valves located upstream of the flowmeter.

The membrane lined pond is rectangular with dimensions of 465,350 square feet surface area, 15 feet deep with 1:3 bank slopes. Storage capacity is calculated at 135 af and evaporation at 27.5 afa (see the attached pond calculation sheets).

Irrigation Storage is recommended from 1/1 to 12/31 as this period of use should coincide with the Diversion to Storage period.

Has the permit holder met all conditions of permit approval, including any mitigation requirements and/or measuring device installation requirements? ☒ Yes ☐ No If no, what must be done to meet the permit requirements?

F. FLOW CALCULATIONS☒ Additional computation sheets attached

Measured Method:

Beginning reading: 62365.7 x 1000 gallons at 10.508 minutes

Ending reading: 62372.0 x 1000 gallons at 20.748 minutes

$$\text{Flow} = (62372000 - 62365700) / (20.748 - 10.508) = 615 \text{ gpm} = 1.37 \text{ cfs}$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 79 \text{ acres} \times 4.5 \text{ afa} = 355.5$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = 1.37 \text{ cfs} \times 260 \text{ days} \times 1.9835 = 707 \text{ afa}$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 355.5 \text{ afa}$$

2. Volume Calculations for Other Uses:

Pond capacity = 135 af

Seepage = 0 af

Evaporation Losses = 27.5 af

Total Storage = 162.5 afa (limited by permit to 98 afa)

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion	Annual Volume
	From	To	Q (cfs)	V (afa)
IRRIGATION FROM STORAGE	3/1	11/15		98 afa
IRRIGATION STORAGE	1/1	12/31		98 afa
DIVERSION TO STORAGE	11/16	2/28	1.37 cfs	
Totals:			1.37 cfs	98 afa

2. Recommended Amendments

☐ Change P.D. as reflected on page 1☐ Add P.D. as reflected on page 1☐ None☐ Change P.U. as reflected on page 1☒ Add P.U. as reflected on page 1☐ Other**I. AUTHENTICATION**

Field Examiner's Signature

Scott N. King

Date


4/18/2019


Reviewer

Date



Attachment A
Field Exam Maps

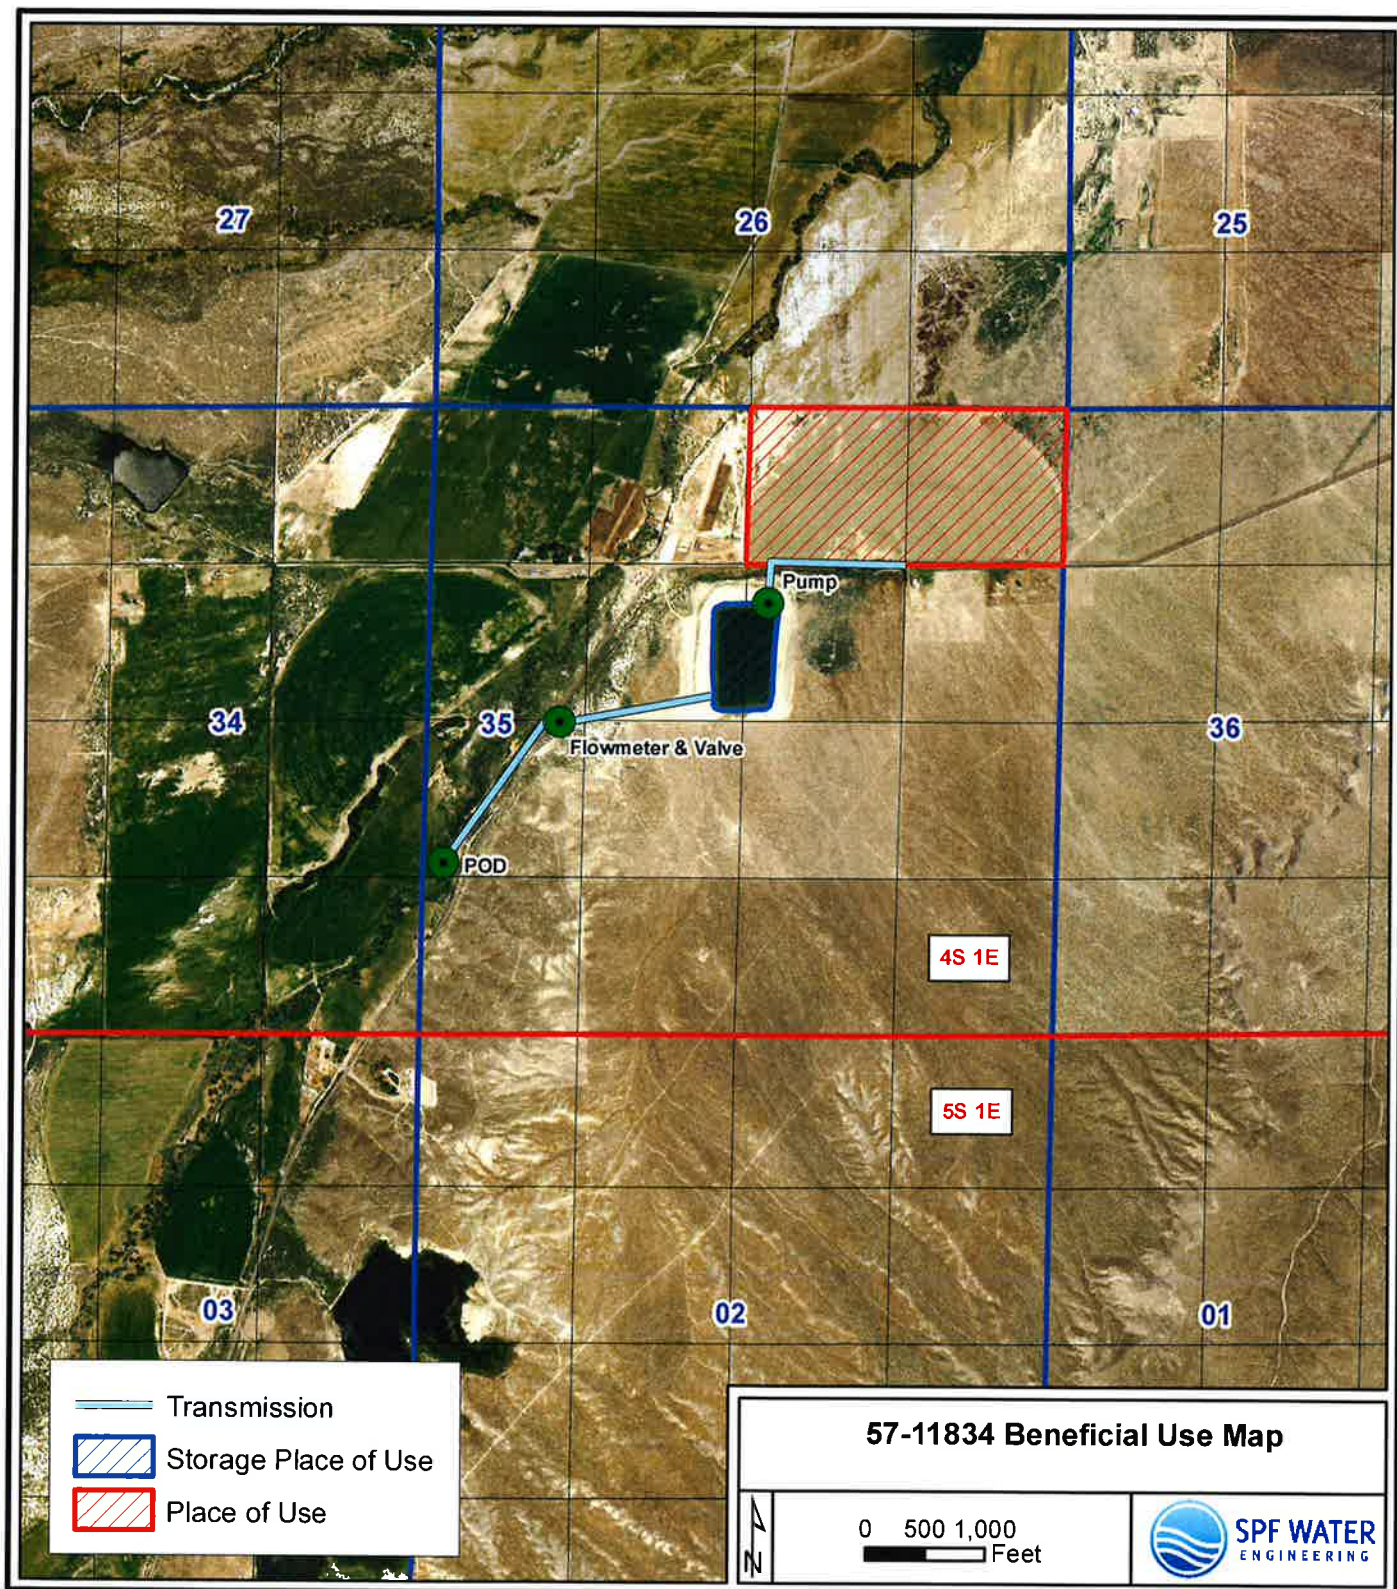

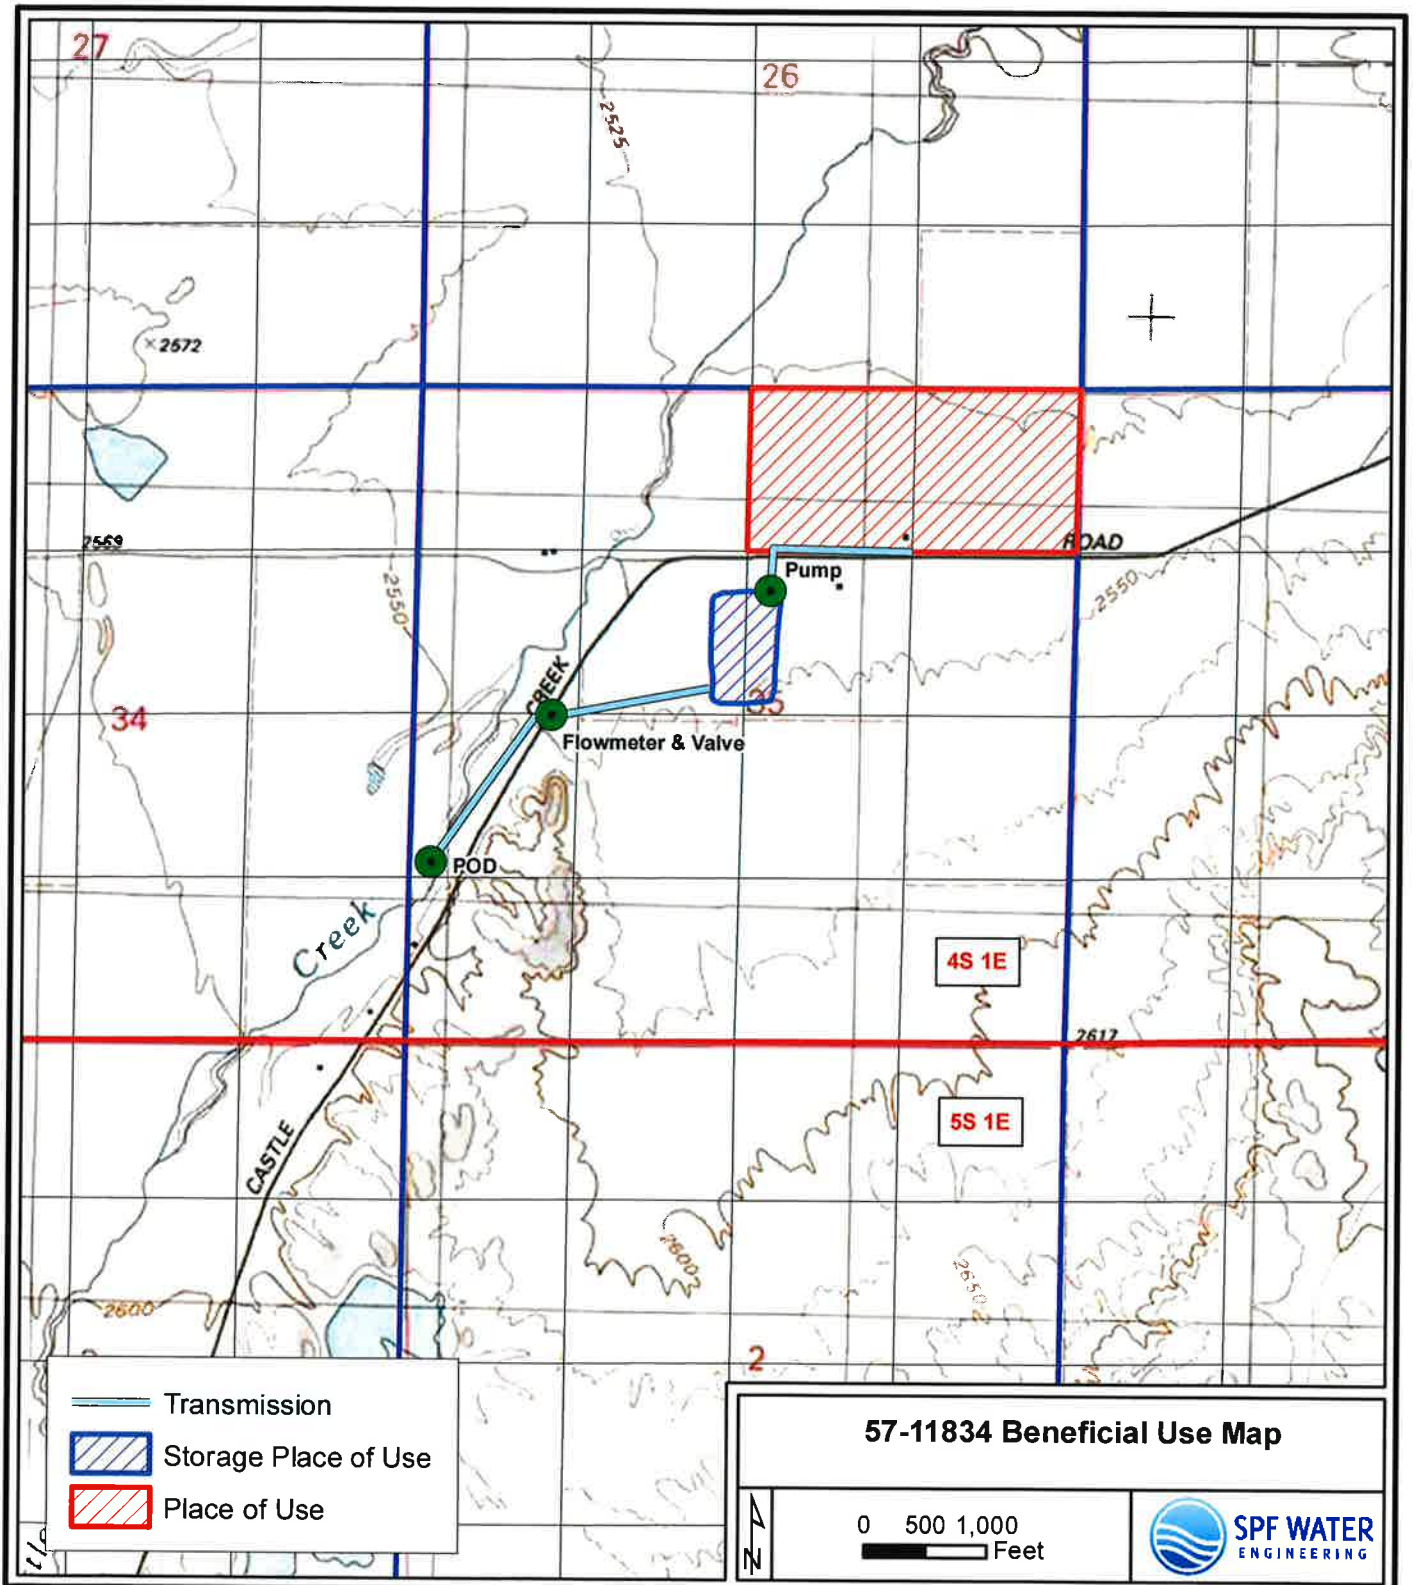

Attachment B
Pond Calculations

Seepage Loss Calculations

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the total annual seepage losses from a pond.

FILE NUMBER	57-11834
REVIEWER	Scott King
DATE	4/17/2019

User Input
Calculated value
Formula Explanations

INPUTS

Pond Surface Area (AC.)	10.6	AC.
-------------------------	------	-----

Pond Surface Area (SQ. FT.)	461736	SQ. FT.
-----------------------------	--------	---------

I used the following method to obtain my Soil Classification information:	NRCS Web Soil Survey	
My Soil Classification is	Lined	
Suggested Seepage Rate (FT./DAY)	0.0000	FT./DAY

Formula: (Surface Area X Seepage Rate) X 7.48 = Gallons Per Day Loss
--

Convert to GPD	0	GPD
----------------	---	-----

Total Seepage Loss (AFA)	0.0	AFA
--------------------------	-----	-----

Though sand and gravel seepage rates may actually be higher, the maximum allowable rate is 0.2 ft/day, pursuant to Administrative Memo "Seepage Loss Standards for Ponds and Reservoirs."

Suggested Seepage Rates for Different Soil Types:
GW, GP, GM, GC, SW, SP and SM (silty sand, sand silt mixtures and gravel mixtures) = 0.2 ft per day
OL and ML (inorganic silts - very fine sands, silty, or clayey fine sands) = 0.02 ft per day
SC (clayey sands, sand clay mixtures) = 0.007 ft per day
CL (Low to medium plasticity clays) = 0.003 ft per day
MH, OH, PT and CH (high plasticity clays) = 0.0003 ft per day
LINED PONDS (liners can be chemical, fabric, or bentonite) = 0 ft per day
Ponds Intercepting Groundwater (excavated ponds filled by ground water) = 0 ft per day

PLEASE NOTE: The initial basis for the Suggested Seepage Rates in the table above is found on Page 16 of Seepage from Fish Ponds, Bulletin 599, August 1989 Alabama Agricultural experiment Station, Auburn University, Auburn University Alabama. If you don't know the soil type, please refer to the map provided at the NRCS Web Soil Survey (Tab #1), an ArcMap Soil Classification Map (Tab #1.1), or published NRCS Soil Survey (Tab #1.2). Use "0" if the pond fill relies on the water table.

Evaporation Loss Calculations

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the annual evaporation losses from a pond.

FILE NUMBER	57-11834
REVIEWER	Scott King
DATE	4/17/2019

User Input
Calculated value
Formula Explanations

The acronyms used on the Kimberly Research Center website are defined below:
P = Precipitation
ET= Evapotranspiration
P _d = Precipitation deficit
P _d =ET-P

USING THIS SPREADSHEET

Use the link below to access the Kimberly Research Center website. This website provides the Precipitation Deficit for a station most representative of the pond under examination. The Precipitation Deficit is the total amount of free water surface evaporation minus the precipitation for a given area, which gives the total amount of evaporative losses incurred by the pond. There are several weather sites that are used throughout the state. IDWR staff can find the nearest site using Arc Map. The shape file containing the sites can be found at X:/Spatial/Climate/ETIdahostations.shp.

Instructions:

1. Use the link below to navigate to ET Idaho 2012.
2. Select the station which is most representative to your pond location.
3. Click Submit Query.
4. Under "Land Covers with Evapotranspiration Estimates," select "Open Water - Shallow Systems (ponds, streams)" or "Open Water - small stock ponds" depending on the pond size.
5. Click the link to "Precipitation Deficit."
6. Reference and copy (ctrl + C) the first subheading "Mean" values.
7. Click the "Paste Values from ET Idaho" button. The table will automatically enter a zero (0) for any negative precipitation deficit values.

Found at: <http://data.kimberly.uidaho.edu/ETIdaho/>

Precipitation Deficit

Station: Twin Falls 2 NNE (NWS -- 109294)

Month	mm/day ¹	Days per month	mm/Month
Jan	-0.05	31	0.00
Feb	0.50	28	14.00
March	1.59	31	49.29
April	2.81	30	84.30
May	3.25	31	100.75
June	4.15	30	124.50
July	4.71	31	146.01
August	4.05	31	125.55
September	2.82	30	84.60
October	1.73	31	53.63
November	0.29	30	8.70
December	-0.14	31	0.00

PLEASE NOTE: The seasonal average for precipitation deficit should not be used for calculations because precipitation often exceeds evaporation during wetter months of the year. If the pond is kept full, excess precipitation during wetter months does not serve to refill the pond during drier months.

For example, see Sandpoint KSPT (NWS -- 108137), the annual precipitation deficit is -106 mm. However, April through September have positive precipitation deficit values. To properly estimate the annual volume of water necessary to refill a pond due to evaporation losses, the table will automatically enter a zero (0) for each month that the precipitation value is reported as a negative value.

As described above, precipitation offsets evaporation in winter months, so the net effect is that wintertime precipitation deficit is usually zero.

Total mm/year = 791.33

$$[(\text{mm/yr}) \div (\text{convert to feet})] \times (\text{Surface area of pond, in acres}) = \text{Evaporation Loss in Acre Feet}$$

$$(791.33 \div 304.8) \times 10.60 = 27.5 \text{ AFA}$$

Total Storage Calculations

FILE NUMBER	57-11834
REVIEWER	Scott King
DATE	4/17/2019

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the total seepage, evaporation and fill capacity required for a pond.

User Input
Calculated value
Formula Explanations

Surface Area (AC.)	10.6	"Surface Area" is automatically carried over from the "Seepage Loss" sheet.
Average Pond Depth (FT.)	11.9	"Average Pond Depth" depicts the actual depth of the pond either measured or estimated. Note: If you know the maximum depth and not the average depth, the Field Examiner's Handbook suggests multiplying the maximum depth by 0.4 to get the average depth, or you can use any method that seems reasonable to attain average depth.
Pond Capacity (AF)	126.14	Pond Capacity is calculated by multiplying the Pond Surface Area by the Average Pond Depth. If you know the capacity, divide the capacity by surface area and enter the average pond depth in the space above. Note: If pond capacity is determined using a method shown on the "Pond Capacity" sheet, the user may need to modify the value of "Pond Capacity" (cell B9) manually. Note that if the value is modified manually, the formula will be altered for future use.
Multiple Fill Volume Above Initial Fill to Fulfill From Storage Needs- "Multiple Fills" (AF)	0	The "Multiple Fill Volume Above Initial Fill" is the acre-feet of water required to meet a <i>from storage</i> component if the <i>from storage</i> component exceeds a one time fill. This section should not include the amount of water needed to fill the pond initially or the amount of water needed to maintain the pond level due to evaporation or seepage. For example: if a pond has a capacity of 5 acre feet and 2.5 acre feet of seepage and evaporation, but the pond is used for irrigation that requires 10 acre feet of from storage for the irrigation use, then you would insert 5 acre feet into this location (10 acre feet needed - 5 acre feet from the initial fill = 5 acre feet of additional storage needed). Note: You must have a "From Storage" component exceeding the initial fill on the permit to include a volume in this space.
Estimated Seepage Loss (AF)	0.0	The "Estimated Seepage Loss" is automatically carried over from the "Seepage Loss" sheet.
Estimated Evaporation Loss (AF)	27.5	The "Estimated Evaporation Loss" is automatically carried over from the "Evaporation Loss" sheet.
Total Volume Required (AF)	153.7	The "Total Volume Required" is calculated by adding the Pond Capacity, Multiple Fills, Seepage Loss, and Evaporation Loss amounts to determine the total amount of storage required.

Flow Rate into Pond (CFS)	3.00	The "Flow Rate into Pond" depicts the actual flow, either measured or estimated, into the pond. For offstream facilities, this will be equivalent to "diversion to storage" rate.
Highest Daily Evaporation Rate From Evaporation Tab. (mm/Day)	4.71	This number is carried over from the "Evaporation Loss" sheet. It is the highest recorded number in the "Precipitation Deficit Table".
Required Daily Maintenance Volume (AF/Day)	0.16	"Required Daily Maintenance Volume" is the maximum volume of water needed on any given day during the year to maintain pond volume. It is calculated by adding the highest daily evaporation loss to the average daily seepage loss in acre feet. The average daily seepage loss is calculated by dividing the "Estimated Seepage Loss" by 365 days. This is acceptable, since the seepage rate shouldn't vary throughout the season unless the pond completely freezes over during the winter months. The highest daily evaporation loss is calculated by dividing the Highest Daily Evaporation Rate by the 304.8 conversion factor and multiplying this number by the pond surface area to attain a combined daily acre feet requirement.
Minimum Maintenance Flow (CFS)	0.08	The "Minimum Maintenance Flow" is the minimum amount of flow required to maintain the level of the pond. This number is determined by dividing the "Maximum Required Daily Maintenance Volume" by 1.9835. This flow can be used to determine if the flow rate into the pond is adequate to maintain the pond level.
Days Required to Fill the Pond	22	The "Days Required to Fill the Pond" is calculated by dividing the "Pond Capacity" by the "Flow Rate" minus "Minimum Maintenance Flow" multiplied by 1.9835. This section will assist you in determining if the flow rate being diverted to the pond is adequate to fill the pond while maintaining the pond level. The length of time to fill the pond will help determine if the flow rate is adequate for the size of pond being proposed. If this number is approximately 6 months (180 days) or more, the reviewer should have a discussion with the applicant to make sure he/she understands that it will take a significant length of time to fill the pond.
Days Required to Fill the Pond at 13,000 Gallons per Day	-1018	Some water users may want to fill a pond under the 13,000 gallons per day domestic exemption. The "Days Required to Fill the Pond at 13,000 Gallons per Day" is calculated by converting the "Pond Capacity" and the "Required Daily Maintenance Volume" to gallons. The "Pond Capacity" is then divided by 13,000 gallons minus the "Required Daily Maintenance Volume" in gallons to determine the number of days to fill pond. If this number is approximately 6 months (180 days) or more, the reviewer should have a discussion with the applicant to make sure he/she understands that it will take a significant length of time to fill the pond. Negative values indicate that the supply of 13,000 gallons per day is not enough volume to overcome the required daily maintenance volume; the pond will never fill.

Attachment C
Exam Photos



Figure 1: Point of diversion from Castle Creek. Diversion gate in left foreground.



Figure 2: Diversion with headgate in foreground and flume with trash rack in left background.



Figure 3: Irrigation storage reservoir south of Castle Creek Rd and 40-hp pump from pond to irrigation system north of Castle Creek Rd.



Figure 4: Place of use on north side of Castle Creek Rd as viewed from pump in previous figure.



Figure 5: Magnetic flowmeter installed in a concrete culvert vault.

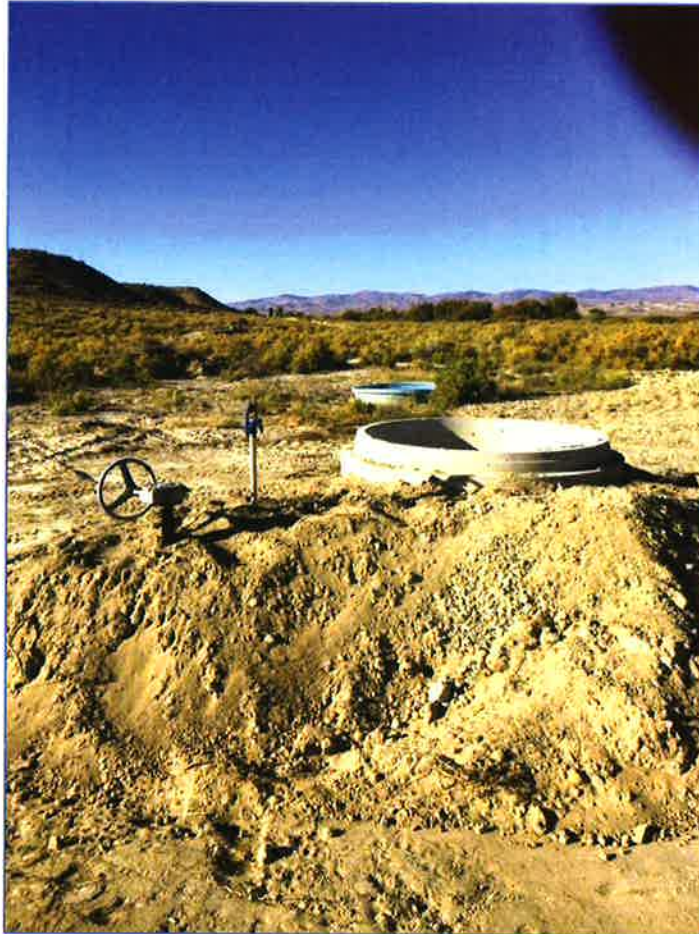


Figure 6: Flowmeter vault and control valve.