

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 65-23509
Exam Date: 11/8/2018

1. Current Owner:
H DEWEY FISHER PO BOX 577 GARDEN VALLEY ID 83622 (208) 859-1920
2. Accompanied by: DEWEY FISHER
Phone No: (208) 859-1920
Address: PO BOX 577 GARDEN VALLEY ID 83622
Relationship to Permit Holder: OWNER

3. **SOURCE:**
SPRING

TRIBUTARY:
MIDDLE FORK PAYETTE RIVER

B. OVERLAP REVIEW

1. Other water rights with the same place of use: NONE
2. Other water rights with the same point-of-diversion: NONE

C. DIVERSION AND DELIVERY SYSTEM1. LOCATION OF POINT(S) OF DIVERSION:

SPRING SE¼NW¼NE¼ Sec. 15, Twp 09N, Rge 04E, B.M. BOISE County

Method of Determination: Field exam, aerial imagery, and ArcMap tools.

2.

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
09N	04E	15		X															

Method of Determination: Field exam, aerial imagery, and ArcMap tools.

3.

☒ Delivery System Diagram Attached (required). Indicate all major components and distances between components.
☐ Indicate weir size/pipe as applicable.

☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.

☒ Aerial Photo Attached (required for irrigation of 10+ acres).

☒ Photo of Diversion and System Attached

4.

Diversion ID No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Discharge Size
927257	N/A	N/A	N/A	N/A	N/A


D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
5 gallon bucket	Bucket Test	N/A	N/A	N/A	N/A	N/A

2. Measurements: It took 4 minutes to fill a 5 gallon bucket.

State of Idaho
Department of Water Resources
System Diagram
WR Permit No. 65-23509

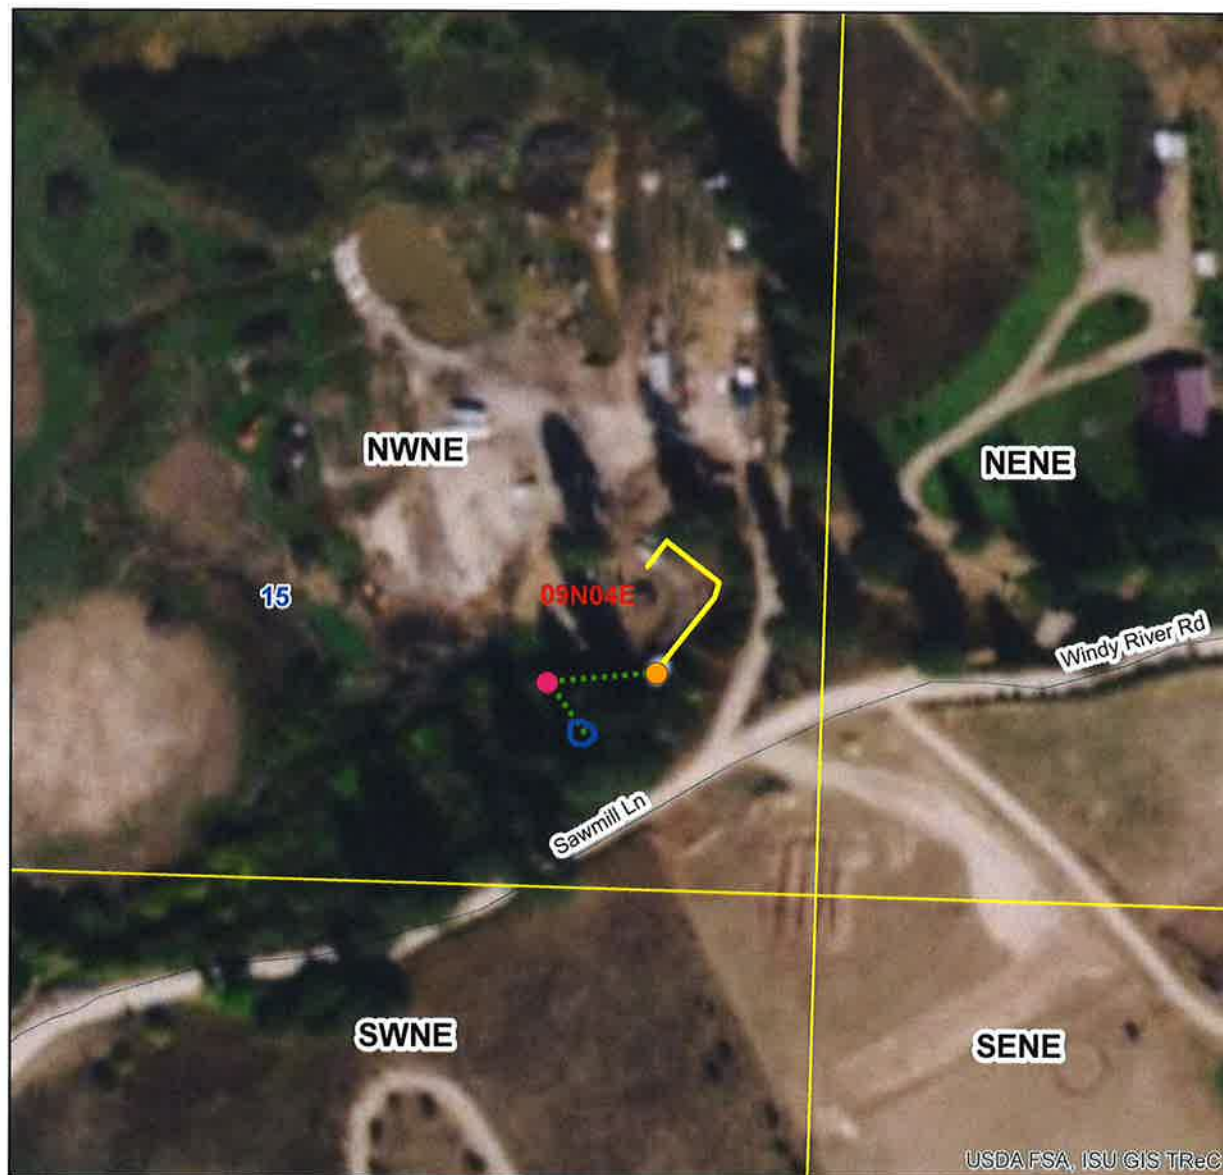


0 0.0175 0.035 0.07 Miles

Legend

-  Spring Pond
-  Storage Tank House
-  Ram Pump House
-  1/2" Buried Pipe
-  1" Buried Pipe



State of Idaho
Department of Water Resources
Place of Use and Point of Diversion
WR Permit No. 65-23509

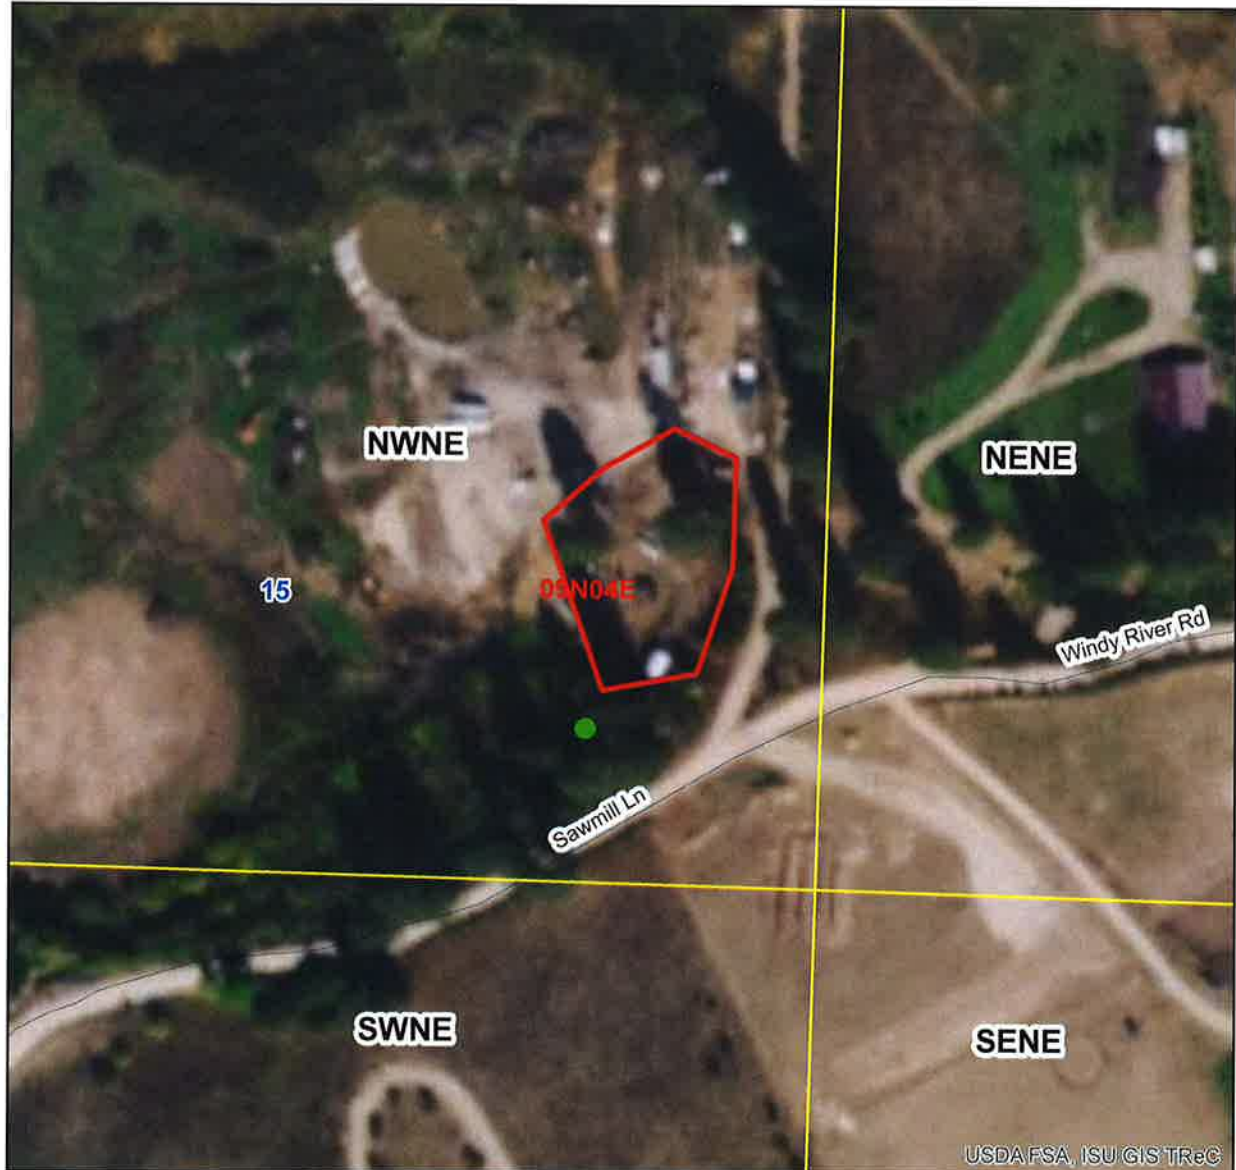

0 0.0175 0.035 0.07 Miles

Legend

- POD
- Domestic POU





Spring that is dammed up with two ½" perforated pipes that feed the ram pump four vertical feet below.



½" pipe that discharges overflow into the unnamed stream.



Closer look at the overflow discharge back into the unnamed spring.



Ram pump house.



Ram pump that generates about 3-4.5 gpm from the four feet of vertical drop and roughly 24 feet horizontal distance from the pond.



Storage tank house. About 40-50 feet horizontal distance and 12 feet of vertical lift from the pump house.



1,300 gallon tank.
At 0.01 cfs, the
tank refills every
17 hours.



A 1" line feed the
water to the
garage to a
pressure pump.



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region • 2735 Airport Way • Boise, Idaho 83705-5082

Phone: (208) 334-2190 • Fax: (208) 334-2348 • Website: www.idwr.idaho.gov

C.L. "BUTCH" OTTER
Governor

GARY SPACKMAN
Director

October 12, 2018

COPY

H DEWEY FISHER
PO BOX 577
GARDEN VALLEY, ID 83622

RE: Scheduling Field Exam for Water Right Permit No. 65-23509

Dear Permit Holder:

We are planning to conduct water right examinations in the vicinity of the above-referenced permit **this season**. An examination is needed to verify the water use in order to issue a water right license.

The above-referenced permit authorizes **0.20 cfs** from a **SPRING** for **DOMESTIC** and **AESTHETIC** uses. **If you have developed a beneficial use and still own the place of use property, please contact me at your earliest convenience to schedule an examination.**

If you did not develop a beneficial use of water under the permit during the beneficial use period, a license cannot be issued and the permit should be relinquished. If that use was developed, but have ceased using the water and you currently carry no interest in it, please relinquish the permit by submitting the enclosed Relinquishment of Permit form (no fee required).

Please contact me within the next thirty (30) days at (208) 334-2190 to either schedule an examination or submit a relinquishment form. If the Department does not received a response by November 15, 2018 your permit will become void. Thank you for your attention to this matter.

Sincerely,

Aaron Skinner
Water Resource Agent, Sr.
Idaho Department of Water Resources
Phone: (208) 334-2190
Email: aaron.skinner@idwr.idaho.gov

Enclosures: Relinquishment of Permit form
Water Permit Report and Map