

42-222 POB - 09/14

JUL 18 2018

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

MAY 03 2018

RECEIVED

WATER RESOURCES
WESTERN REGION

APPLICATION FOR TRANSFER OF WATER RIGHT – POINT(S) OF DIVERSION 0 2018

WATER RESOURCES

WESTERN REGION

DEPARTMENT OF

This form may be used to apply to change and/or add points of diversion for existing water rights and to report a water right change for a water right(s) in connection with the proposed point of diversion change(s). Do not use this form to apply for changes to other elements of a water right. See the [Application for Transfer Instructions](#) for help completing this form and for mailing addresses of Department offices where your application can be submitted.

Check all that apply:

- ☐ Change diversion point(s) ☒ Add diversion point(s) ☐ Ownership change ☐ Ownership split

1. **APPLICANT(S)** City of Donnelly Phone 208-325-8859

2. MAILING ADDRESS P.O. Box 725 City Donnelly RECEIVED

State Idaho Zip 83615 Email chedges@cityofdonnelly.org

- ☐ If the applicant is not an individual and not registered to do business in the State of Idaho, attach documentation identifying officers authorized to sign for the applicant.
- ☐ If the applicant is not the current water right(s) owner, attach documentation of authority to file the application.
- ☐ If the application includes a change in ownership of water right(s), attach a copy of the conveyance document, such as a warranty deed, court decree, contract of sale, etc. The conveyance document must include a legal description of the property conveyed or description of the water right if no land is conveyed. Additional fee(s) are required for water right ownership changes; see Item 9 for the fee schedule.

If the ownership change resulted in the water right(s) being split, how did the division occur? Mark one:

- ☐ The water rights or claims were divided as specifically identified in a deed, contract, or other conveyance document.
- ☐ The water rights or claims were divided proportionately based on the portion of their place(s) of use acquired by the new owner.

- ☐ If the application is not signed by the applicant, attach a Power of Attorney or other documentation providing authority to sign for the applicant.

3. LIST WATER RIGHT NUMBER(S) 65-3847, 65-12511, 65-13362 65-13362 is a

- ☒ Attach a copy of the water right(s) as recorded, available at www.idwr Step 1, or by
contacting any Department office. 1.5 c/d

4. **TOTAL AMOUNT OF WATER** transferred is $\frac{0}{(\text{diversion rate})}$ cubic feet per second et per annum.

5. **POINT OF DIVERSION** – Describe all the point(s) of diversion to be included on the water right(s) after the proposed change.

- ☐ Attach Eastern Snake Plain Aquifer (ESPA) analysis if this transfer proposes to change a point of diversion affecting the ESPA. ESPA analysis information is available at www.idwr.idaho.gov, *Water Right Transfers, Online Resources*.

[illegible]

MAY 08 2018 RECEIVED

WATER RESOURCES
WESTERN REGION MAY 0 2018

DEPARTMENT OF
WATER RESOURCES

APPLICATION FOR TRANSFER OF WATER RIGHT – POINT(S) OF DIVERSION

This form may be used to apply to change and/or add points of diversion for existing water rights and to report ownership change for a water right(s) in connection with the proposed point of diversion change(s). Do not use this form to apply for changes to other elements of a water right. See the [Application for Transfer Instructions](#) for help completing this form and for mailing addresses of Department offices where your application can be submitted.

Check all that apply:

- ☐ Change diversion point(s) ☒ Add diversion point(s) ☐ Ownership change ☐ Ownership split

1. **APPLICANT(S)** City of Donnelly Phone 208-325-8859

2. MAILING ADDRESS P.O. Box 725 City Donnelly

State Idaho Zip 83615 Email chedges@cityofdonnelly.org

- ☐ If the applicant is not an individual and not registered to do business in the State of Idaho, attach documentation identifying officers authorized to sign for the applicant.
- ☐ If the applicant is not the current water right(s) owner, attach documentation of authority to file the application.
- ☐ If the application includes a change in ownership of water right(s), attach a copy of the conveyance document, such as a warranty deed, court decree, contract of sale, etc. The conveyance document must include a legal description of the property conveyed or description of the water right if no land is conveyed. Additional fee(s) are required for water right ownership changes; see Item 9 for the fee schedule.

If the ownership change resulted in the water right(s) being split, how did the division occur? Mark one:

- ☐ The water rights or claims were divided as specifically identified in a deed, contract, or other conveyance document.
- ☐ The water rights or claims were divided proportionately based on the portion of their place(s) of use acquired by the new owner.

- ☐ If the application is not signed by the applicant, attach a Power of Attorney or other documentation providing authority to sign for the applicant.

3. LIST WATER RIGHT NUMBER(S) 65-3847, 65-12511, 65-13362

- ☒ Attach a copy of the water right(s) as recorded, available at www.idwr.idaho.gov, *Water Right Transfers, Step 1*, or by contacting any Department office.

4. **TOTAL AMOUNT OF WATER** transferred is 0 cubic feet per second and/or 0 acre-feet per annum.
(diversion rate) (storage volume)

5. **POINT OF DIVERSION** – Describe all the point(s) of diversion to be included on the water right(s) after the proposed change.

- ☐ Attach Eastern Snake Plain Aquifer (ESPA) analysis if this transfer proposes to change a point of diversion affecting the ESPA. ESPA analysis information is available at www.idwr.idaho.gov, *Water Right Transfers, Online Resources*.

[illegible]

6. GENERAL INFORMATION

- a. Describe the complete diversion system, including how you will accommodate a measuring device and lockable controlling works should they be required now or in the future:

Diversion consists of new 8-inch well and well house adjacent to existing well. Both wells will be piped to common well house with locked doors and instantaneous and totalizing flow meter.

- b. Who owns the property at the point(s) of diversion? City of Donnelly
If other than the applicant, describe the arrangement enabling the applicant to access the property for the diversion system:

- c. To your knowledge, has/is any portion of the water right(s) proposed to be changed:

Yes No

☐☒

undergone a period of five or more consecutive years of non-use,

☐☒

currently used in a mitigation plan limiting the use of water under the right(s), or

☐☒

currently enrolled in a Federal set-aside program limiting the use of water under the right(s)?

If yes, describe:

- d. Is any portion of the water right(s) proposed to be changed currently leased to the Water Supply Bank? ☐ Yes ☒ No

☐ If yes and there are multiple owners, attach a Lessor Designation form.

☐ If yes, the individual owner or designated lessor must complete, sign and attach an IRS Form W-9.

(Disregard if these items are on file and ownership has not changed.)

7. **MAP** - ☒ Attach a map of the diversion, measurement, control and distribution system. Include the place of use if a split of the water right occurred. Clearly label the map with township, range, section and $\frac{1}{4}$ $\frac{1}{4}$ of section information. The Map Tool, available at maps.idwr.idaho.gov/TransferApplicationLayouts/ provides a satisfactory template for creating the required map.

8. **SIGNATURE** - The information in this application is true to the best of my knowledge. I understand any willful misrepresentations in this application may result in rejection of the application or cancellation of an approval.

Cami Hedges
Signature of applicant or authorized agent

City Clerk Treasurer
Print name and title if applicable

05/07/2018
Date

Signature of applicant or authorized agent

Print name and title if applicable

Date

9. **FEE** - ☒ The application filing fee provided in Section 42-221, Idaho Code, must be submitted with the application for transfer. The Application fee is based on the total amount of water proposed for transfer in Item 4: the larger fee for either cubic feet per second (diversion rate) or acre-feet per annum (storage volume). The Fee Schedule is available at www.idwr.idaho.gov, Water Right Transfers, Step 4 and in the Application for Transfer Instructions.

FOR DEPARTMENT USE ONLY

Transfer includes _____ pages of attachments.

Received by _____ Date _____

Fee paid \$200⁰⁰ Date 5/8/18

Received by CS Receipt # W046318

Preliminary review by 380 Date 7/18/11

Date _____ Active in the Water Supply Bank? Yes ☐ No ☐

W-9 received? Yes ☐ No ☐

Name on W-9 _____

W-9 forwarded to fiscal? Yes ☐ No ☐

(Do NOT scan the W-9 - confidential information is held by fiscal only)

Close

IDAHO DEPARTMENT OF WATER RESOURCES
Water Right Report

5/8/2018

WATER RIGHT NO. 65-3847

<u>Owner Type</u>	<u>Name and Address</u>
Current Owner	CITY OF DONNELLY PO BOX 365 DONNELLY, ID 83615 2083258390

Priority Date: 09/01/1913
Basis: Decreed
Status: Active

<u>Source</u>	<u>Tributary</u>
GROUND WATER	

<u>Beneficial Use</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Volume</u>
MUNICIPAL	1/01	12/31	1 CFS	
Total Diversion			1 CFS	

Location of Point(s) of Diversion:

GROUND WATER|SESW|Sec. 10|Township 16N|Range 03E|VALLEY County

Place(s) of use: Large POU Info

Conditions of Approval:

1. PLACE OF USE IS WITHIN CITY LIMITS OF DONNELLY
THIS PARTIAL DECREE IS SUBJECT TO SUCH GENERAL PROVISIONS NECESSARY FOR THE
DEFINITION OF THE RIGHTS OR FOR THE EFFICIENT ADMINISTRATION OF THE WATER
2. C18 RIGHTS AS MAY BE ULTIMATELY DETERMINED BY THE COURT AT A POINT IN TIME NO
LATER THAN THE ENTRY OF A FINAL UNIFIED DECREE. SECTION 42-1412(6), IDAHO
CODE.

82532

Dates:

Licensed Date:

Decreed Date: 10/31/2000

Enlargement Use Priority Date:

Enlargement Statute Priority Date:

Water Supply Bank Enrollment Date Accepted:

Water Supply Bank Enrollment Date Removed:

Application Received Date:

Protest Deadline Date:

Number of Protests: 0

Other Information:

State or Federal: S

Owner Name Connector:

Water District Number: 65

Generic Max Rate per Acre:

Generic Max Volume per Acre:

Civil Case Number:

Old Case Number:

Decree Plaintiff:

Decree Defendant:

Swan Falls Trust or Nontrust:

Swan Falls Dismissed:

DLE Act Number:

Cary Act Number:

Mitigation Plan: False

Close

82532

Close

IDAHO DEPARTMENT OF WATER RESOURCES
Water Right Report

5/8/2018

WATER RIGHT NO. 65-12511

<u>Owner Type</u>	<u>Name and Address</u>
Current Owner	CITY OF DONNELLY PO BOX 365 DONNELLY, ID 83615 2083258390

Priority Date: 04/08/1982

Basis: Decreed

Status: Active

<u>Source</u>	<u>Tributary</u>
GROUND WATER	

<u>Beneficial Use</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Volume</u>
MUNICIPAL	1/01	12/31	0.5 CFS	
Total Diversion			0.5 CFS	

Location of Point(s) of Diversion:

GROUND WATER	SESW	Sec. 10	Township 16N	Range 03E	VALLEY County
GROUND WATER	SWSE	Sec. 10	Township 16N	Range 03E	VALLEY County

Place(s) of use: Large POU Info

Conditions of Approval:

1. 2 POINTS OF DIVERSION LOCATED IN T16N, R03E, S10, SESW.
2. THE MUNICIPAL USE IS WITHIN THE CITY OF DONNELLY.
3. PLACE OF USE IS WITHIN THE CITY OF DONNELLY
4. C18 THIS PARTIAL DECREE IS SUBJECT TO SUCH GENERAL PROVISIONS NECESSARY FOR THE DEFINITION OF THE RIGHTS OR FOR THE EFFICIENT ADMINISTRATION OF THE WATER

82532

RIGHTS AS MAY BE ULTIMATELY DETERMINED BY THE COURT AT A POINT IN TIME NO
LATER THAN THE ENTRY OF A FINAL UNIFIED DECREE. SECTION 42-1412(6), IDAHO
CODE.

Dates:

Licensed Date:

Decreed Date: 11/03/2000

Permit Proof Due Date: 5/1/1987

Permit Proof Made Date: 3/11/1987

Permit Approved Date: 5/15/1982

Permit Moratorium Expiration Date:

Enlargement Use Priority Date:

Enlargement Statute Priority Date:

Water Supply Bank Enrollment Date Accepted:

Water Supply Bank Enrollment Date Removed:

Application Received Date: 04/08/1982

Protest Deadline Date:

Number of Protests: 0

Other Information:

State or Federal: S

Owner Name Connector:

Water District Number:

Generic Max Rate per Acre:

Generic Max Volume per Acre:

Civil Case Number:

Old Case Number:

Decree Plaintiff:

Decree Defendant:

Swan Falls Trust or Nontrust:

Swan Falls Dismissed:

DLE Act Number:

Cary Act Number:

Mitigation Plan: False

Close

82532

Close

IDAHO DEPARTMENT OF WATER RESOURCES
Water Permit Report

5/8/2018

WATER RIGHT NO. 65-13362

<u>Owner Type</u>	<u>Name and Address</u>
Current Owner	CITY OF DONNELLY PO BOX 725 DONNELLY, ID 83615 2083258859

Priority Date: 11/09/1993
Status: Active

<u>Source</u>	<u>Tributary</u>
GROUND WATER	

<u>Beneficial Use</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Volume</u>
MUNICIPAL	1/01	12/31	0.31 CFS	
Total Diversion			0.31 CFS	

Location of Point(s) of Diversion:

GROUND WATER|SESW|Sec. 10|Township 16N|Range 03E|VALLEY County

Place(s) of use: Large POU Info

Conditions of Approval:

1. 01G Prior to the diversion of water under this right a flow measurement port or other device as specified by the Department shall be installed to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department.
2. 004 The issuance of this right does not grant any right-of-way or easement across the land of another.
3. Place of use is within the city limits of Donnelly.
4. 046 Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.

82532

Dates:

Proof Due Date: 05/03/1993

Proof Made Date: 11/09/1993

Approved Date: 04/01/1992

Moratorium Expiration Date:

Enlargement Use Priority Date:

Enlargement Statute Priority Date:

Application Received Date: 01/09/1992

Protest Deadline Date:

Number of Protests: 0

Field Exam Date: 9/13/2001

Date Sent to State Off: 10/1/2001

Date Received at State Off: 10/2/2001

Field Exam Remark:

Other Information:

State or Federal:

Owner Name Connector:

Water District Number:

Generic Max Rate per Acre:

Generic Max Volume per Acre:

Swan Falls Trust or Nontrust:

Swan Falls Dismissed:


DLE Act Number:

Cary Act Number:

Mitigation Plan: False

Close

Path: B:\Projects\A-D\Donnelly_126\0030 FPIC\SD\Well Fig.dwg File Name: Well Fig.dwg Plot Date: 5/23/2017 2:17 PM Duce

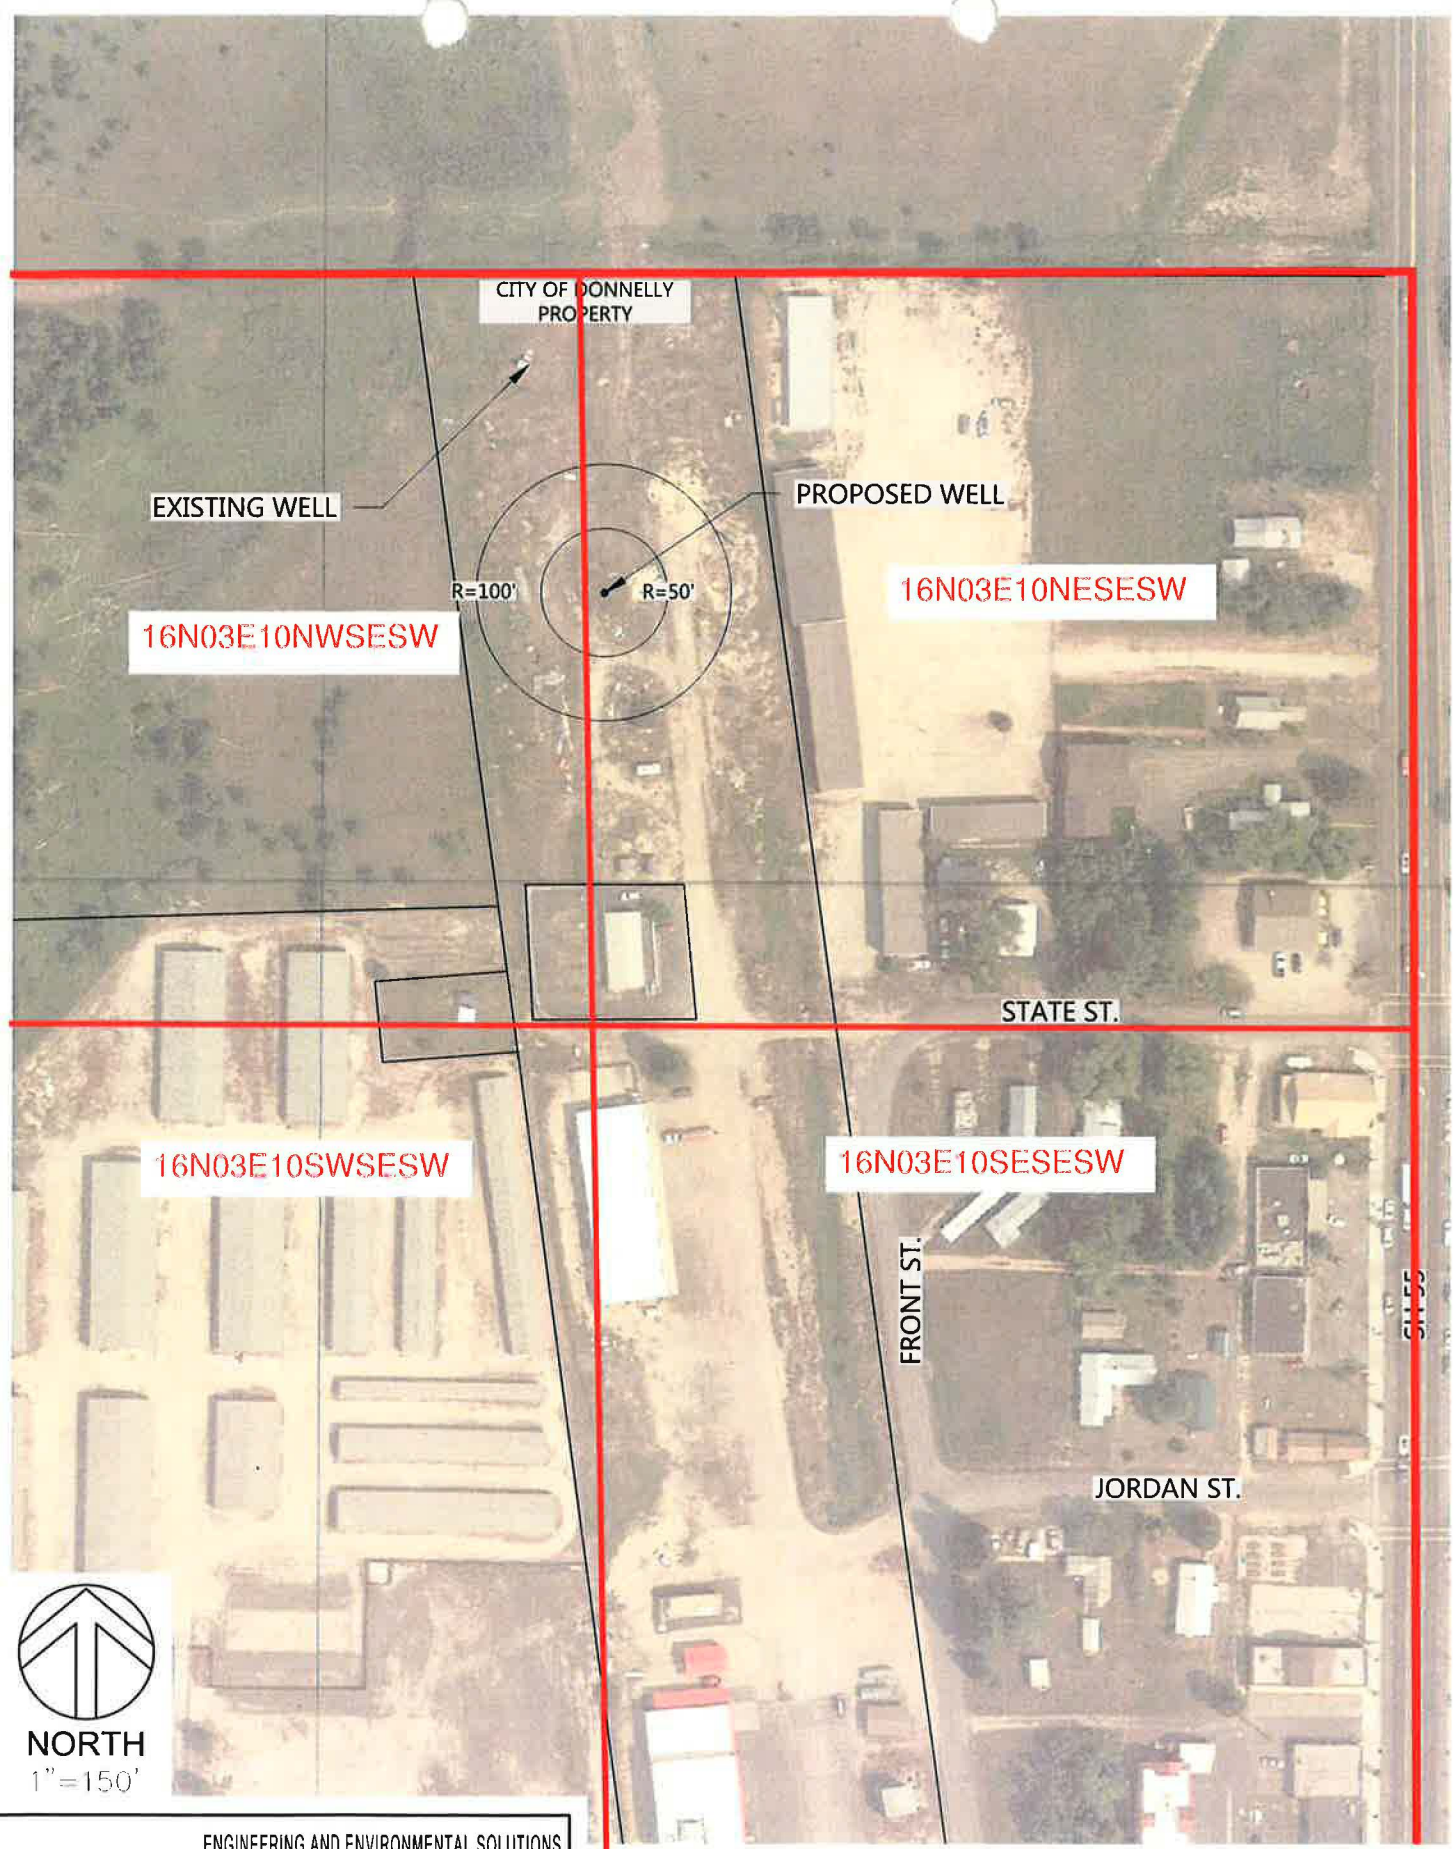


ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3981

IDAHO OFFICES
BOISE • LEWISTON • COEUR D'ALENE

CITY OF DONNELLY
82532 PROPOSED WELL SITE

PROJECT NO.:	126.0030.02
SHEET NO.	FIGURE 1

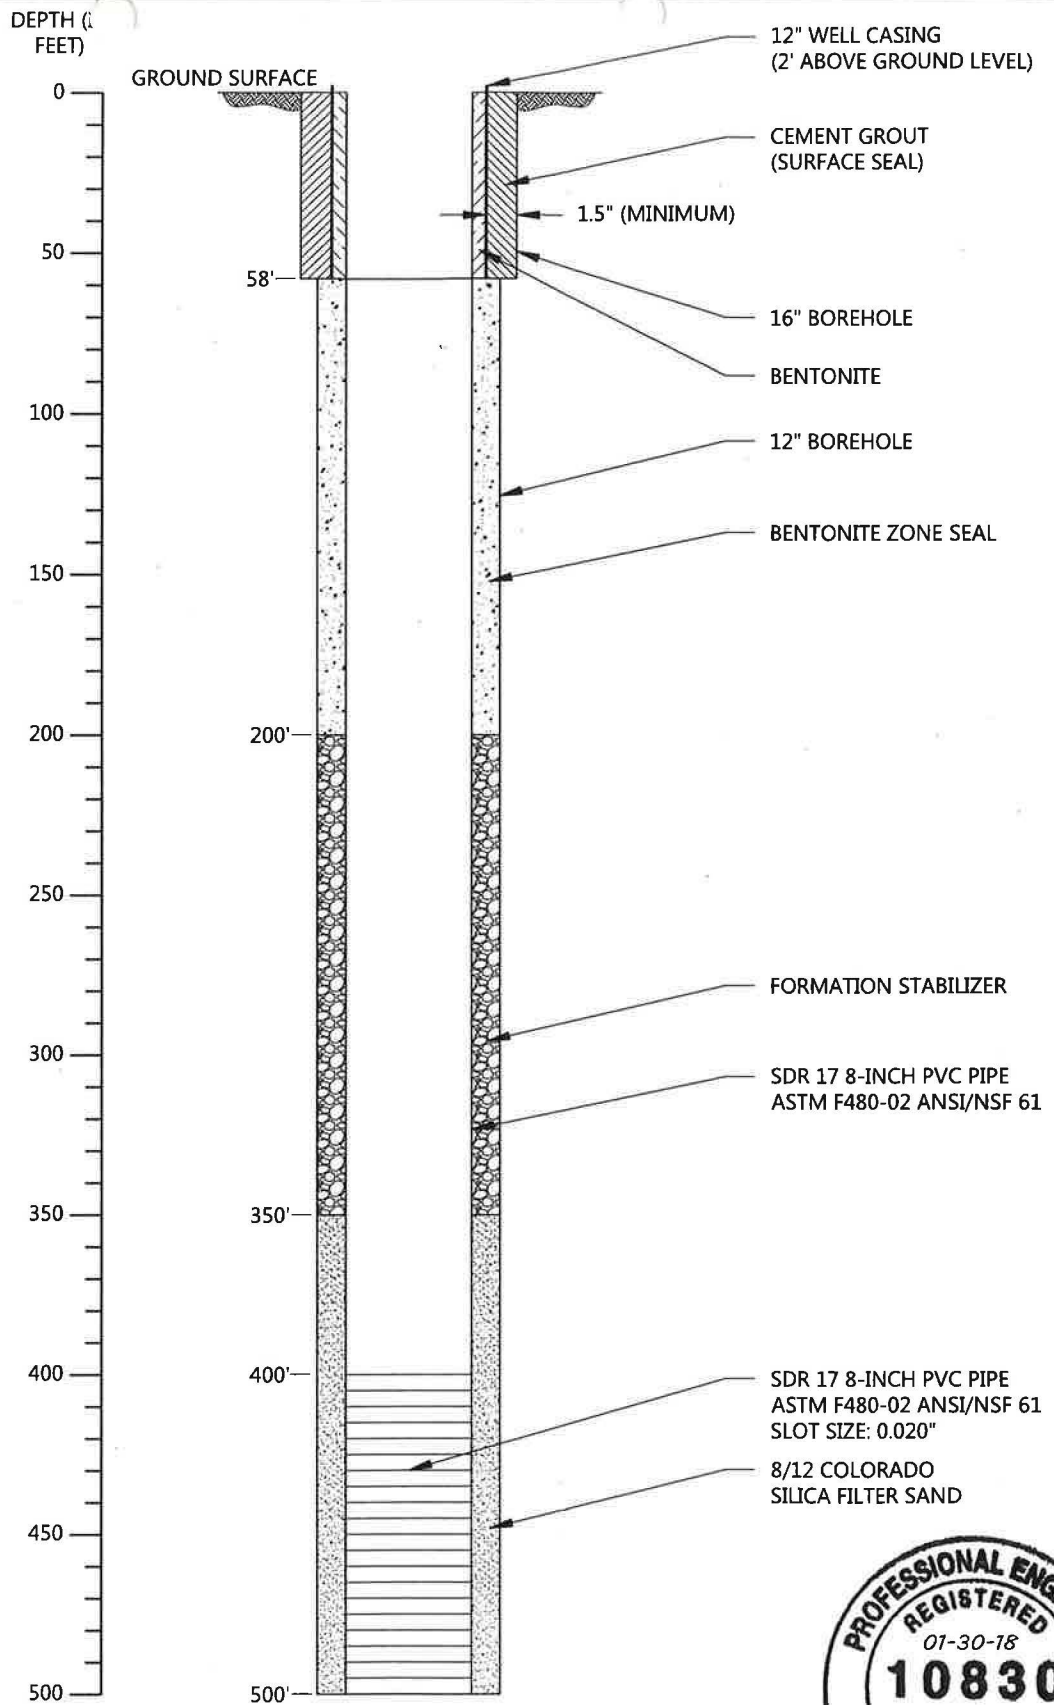

82532



ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990

IDAHO OFFICES
BOISE · McCALL · COEUR D'ALENE

CITY OF DONNELLY - WELL DESIGN

WATER REDUNDANCY PROJECT

PROJECT NO.:
126.0060.01

SHEET NO.
FIGURE 4


CITY OF DONNELLY

Donnelly , IDAHO

CITY OF DONNELLY WATER UPGRADES WELL HOUSE NO. 5 AND BOOSTER STATION UPGRADES MAY 2018

DRAWING INDEX

1	G1.0	TITLE SHEET
2	G2.0	GENERAL NOTES
3	G3.0	LINE LEGEND / PIPE SCHEDULE
4	C1.0	OVERALL SITE PLAN - WELL HOUSE
5	C1.1	WELL HOUSE YARD PIPING PLAN
6	C1.2	WELL HOUSE GRADING PLAN
7	C2.0	JORDAN STREET BOOSTER STATION PIPING PLAN
8	M1.0	JORDAN STREET BOOSTER STATION DEMOLITION PLAN AND PHOTOS
9	M1.1	JORDAN STREET BOOSTER STATION DEMOLITION SECTION AND PHOTOS
10	M2.0	JORDAN STREET BOOSTER STATION PLAN
11	M2.1	JORDAN STREET BOOSTER STATION SECTION
12	M3.0	WELL HOUSE PLAN
13	M3.1	WELL HOUSE SECTIONS
14	TD1.0	TYPICAL CIVIL DETAILS
15	TD2.0	TYPICAL MECHANICAL DETAILS
16	TD3.0	TYPICAL PIPING AND STRUCTURAL DETAILS

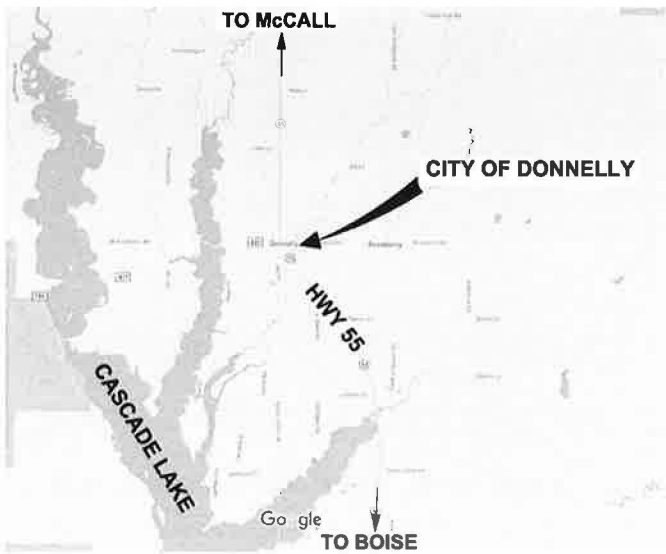

LOCATION MAP



VICINITY MAP

Path: B:\Projects\City of Donnelly\1260060\WSP\CD\G1.0 Title.dwg File Name: G1.0 Title.dwg Plot Date: 5/22/2018 5:02 PM User: jberniet

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED



ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990

IDAHO OFFICES
BOISE • LEWISTON • COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS

TITLE SHEET

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING 1"	
PROJECT :	126.0060.02
DATE :	9/20/2017
DRAWING NO.	SHEET NO.
G1.0	1

Path: B:\Projects\A-D\Donnelly\11610060 WSC\CD\G20 General Notes.dwg Plot Date: 5/3/2018 5:02 PM User: eshennett File Name: G2.0 General Notes.dwg

GENERAL NOTES:

1. ALL CONSTRUCTION WORK WILL CONFORM TO THE LATEST EDITION OF THE IDAHO STANDARDS FOR PUBLIC WORKS CONSTRUCTION 2015 EDITION AND THE AMENDMENTS INCLUDED IN THESE PLANS AND SPECIFICATIONS.
2. ALL APPROVALS AND PERMITS REQUIRED BY THE CITY OF DONNELLY AND IDAHO DEPARTMENT OF TRANSPORTATION SHALL BE OBTAINED BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION.
3. EXISTING SITE INFORMATION INCLUDING THE LOCATION OF EXISTING SITE CONDITIONS, SURFACE TOPOGRAPHY AND PROJECT BENCHMARKS AS SHOWN ON THESE PLANS HAVE BEEN PROVIDED BY SAWTOOTH LAND SURVEYING THROUGH FIELD WORK PERFORMED IN 2017. THE EXISTING SITE INFORMATION IS PROVIDED FOR THE CONVENIENCE OF THE CONTRACTOR AND SHALL BE FIELD VERIFIED BY CONTRACTOR CONSTRUCTION SURVEY PRIOR TO THE START OF ANY PROJECT CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL CONSTRUCTION STAKING.
4. THE TYPES, LOCATIONS, SIZES AND/OR DEPTHS OF EXISTING UNDERGROUND UTILITIES AS SHOWN ON THESE DRAWINGS WERE OBTAINED FROM SOURCES OF VARYING RELIABILITY. THE CONTRACTOR IS CAUTIONED THAT ONLY ACTUAL EXCAVATION WILL REVEAL THE TYPES, EXTENT, SIZES, LOCATIONS AND DEPTHS OF SUCH UNDERGROUND UTILITIES. THE PROJECT ENGINEER ASSUMES NO RESPONSIBILITY FOR THE COMPLETENESS OR ACCURACY OF THE DELINEATION OF SUCH UNDERGROUND UTILITIES, OR THE EXISTENCE OF OTHER BURIED OBJECTS OR UTILITIES WHICH MAY BE ENCOUNTERED, BUT WHICH ARE NOT SHOWN ON THESE DRAWINGS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO IDENTIFY EXACT LOCATIONS OF EXISTING UTILITIES PRIOR TO THE START OF ANY PROJECT CONSTRUCTION. ANY LOCATION WHICH MAY POSE A CONFLICT WITH THE PROPOSED CONSTRUCTION MUST BE REPORTED TO THE PROJECT ENGINEER PRIOR TO THE START OF ANY PROJECT CONSTRUCTION.
5. WATER MAINS AND NON-POTABLE MAINS (SEWER, STORM DRAIN AND IRRIGATION) SHALL HAVE A MINIMUM HORIZONTAL SEPARATION OF 10 FEET AND A MINIMUM VERTICAL SEPARATION OF 18 INCHES. REFER TO ISPPWC SD-407 "NON-POTABLE WATER LINE (NPWL) SEPARATION" FOR ADDITIONAL INFORMATION.
6. UNLESS DETAILED, SPECIFIED, OR OTHERWISE INDICATED ON THE DRAWINGS, CONSTRUCTION SHALL BE AS INDICATED ON THE APPLICABLE TYPICAL DETAILS AND GENERAL NOTES. TYPICAL DETAILS SHALL APPLY EVEN THOUGH NOT REFERENCED AT SPECIFIC LOCATIONS ON DRAWINGS.
7. WHERE NO CONSTRUCTION DETAILS ARE SHOWN OR NOTED FOR ANY PART OF WORK, DETAILS SHALL BE THE SAME AS FOR OTHER SIMILAR WORK.
8. ANY CHANGES TO THE DESIGN AS SHOWN IN THESE CONSTRUCTION DRAWINGS MUST BE REVIEWED AND APPROVED BY THE PROJECT ENGINEER BEFORE CHANGES ARE MADE. THIS INCLUDES CHANGES REQUESTED BY THE OWNER AND SUBCONTRACTORS.
9. COAT ALL WALL THIMBLES WITH COAL TAR EPOXY.
10. ALL BURIED PIPE FITTINGS AND VALVES SHALL BE MECHANICALLY RESTRAINED OR HAVE THRUST BLOCKS INSTALLED FOR TRUST RESTRAINT.
11. CONTRACTOR SHALL MAINTAIN A COPY OF THE IDAHO DEPARTMENT OF ENVIRONMENTAL QUALITY APPROVED PLANS AND SPECIFICATIONS ON-SITE AT ALL TIMES.
12. THE CONTRACTOR SHALL CALL DIG LINE (800-342-1585) TO LOCATE ALL EXISTING UTILITIES AT LEAST THREE (3) DAYS PRIOR TO CONSTRUCTION.
13. THE CONTRACTOR SHALL NOTIFY THE CITY OF DONNELLY A MINIMUM OF SEVENTY-TWO (72) HOURS PRIOR TO DISRUPTING WATER SERVICE.
14. CONTRACTOR SHALL PROTECT ALL EXISTING MONUMENTS, SURVEY MARKERS, STREET SIGNS, UTILITIES, IRRIGATION LINES, PAVEMENT, TREES, FENCES, AND ANY OTHER IMPORTANT OBJECTS ON OR ADJACENT TO THE JOB SITE FROM DAMAGE AND REPAIR OR REPLACE DAMAGED FACILITIES AS REQUIRED BY THE OWNER AND THE PROJECT ENGINEER.
15. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS BEFORE STARTING WORK AND SHALL IMMEDIATELY NOTIFY THE PROJECT ENGINEER OF ANY DISCREPANCIES.
16. CONTRACTOR SHALL PROVIDE THE PROJECT ENGINEER WITH ONE COPY OF REDLINED AS-BUILT DRAWINGS PRIOR TO PROJECT ACCEPTANCE.

17. THE CONTRACTOR SHALL INSTALL NO. 12 COPPER LOCATOR WIRE IN THE TRENCH WITH ALL WATER LINES. LOCATOR WIRE SHALL BE BROUGHT UP TO THE TOP OF ALL VALVE BOXES, FIRE HYDRANTS AND SERVICES. BLUE TAPE MARKED "WATER" SHALL BE INSTALLED APPROXIMATELY TWO (2) FEET ABOVE ALL WATER MAIN LINES.
18. THE CONTRACTOR WILL BE RESPONSIBLE FOR ALL TRAFFIC CONTROL REQUIREMENTS AS REQUIRED BY CITY OF DONNELLY OR THE IDAHO DEPARTMENT OF TRANSPORTATION.
19. CONTRACTOR IS RESPONSIBLE FOR COMPLIANCE WITH ALL APPLICABLE SAFETY LAWS OF ANY JURISDICTIONAL BODY INCLUDING, BUT NOT LIMITED TO, SAFE WORKING PRACTICES WITHIN AND AROUND THE CONSTRUCTION AREA. IN ADDITION, JURISDICTIONAL AGENCIES, THE OWNER AND THE PROJECT ENGINEER SHALL NOT BE RESPONSIBLE FOR ENFORCING SAFETY REGULATIONS.
20. CONTRACTOR IS REQUIRED TO PAY FOR ALL COMPACTION TESTING, INCLUDING NUCLEAR DENSITY TESTING OF THE SUBGRADE, SUBBASE, BASE COURSE AND ASPHALT, AND THE COST ASSOCIATED WITH PROCTORS FOR THE BASE COURSE MATERIAL AND ASPHALT PAVEMENT. TESTING SHALL BE CONDUCTED BY AN INDEPENDENT THIRD PARTY.
21. CONDUCT WORK IN A MANNER THAT WILL NOT IMPAIR THE OPERATIONAL CAPABILITIES OF ESSENTIAL ELEMENTS OF THE DISTRIBUTION SYSTEM.
22. LIMIT THE DURATION OF DISTRIBUTION SYSTEM DISRUPTION TO INDIVIDUAL USER TO A SINGLE DAY DURING APPROVED WORK HOURS.
23. NO CITY USER WILL BE WITHOUT WATER SERVICE LONGER THAN PERMITTED WORK HOURS OR 10 HOURS IN ANY GIVEN DAY BETWEEN THE HOURS OF 8:00 AM AND 6:00 PM. IF CONSTRUCTION REQUIRES LONGER DISRUPTION OF SERVICE THE CONTRACTOR WILL COORDINATE WITH THE CITY AND ENGINEER 48 HOURS IN ADVANCE. THE CONTRACTOR WILL INSTALL TEMPORARY FACILITIES TO PROVIDE WATER SERVICE TO INDIVIDUAL RESIDENCES DURING NON-PERMITTED WORK HOURS.
24. THE WATER SERVICE LOCATIONS WILL BE FIELD FIT ON AN AS NEED BASIS. THE LOCATIONS SHOWN ON THE DRAWING ARE GENERAL AND SUBJECT TO CHANGE. THE LOCATIONS ARE BASED ON INFORMATION FROM THE HOME OWNERS AND OPERATIONS STAFF.

EROSION AND SEDIMENT CONTROL NOTES:

1. PRIOR TO START OF CONSTRUCTION, A STORM WATER POLLUTION PREVENTION PLAN (SWPPP) SHALL BE PREPARED BY THE CONTRACTOR. ALL SUBCONTRACTORS WILL BE REQUIRED TO ADOPT AND FOLLOW ALL REQUIREMENTS SET FORTH IN THE SWPPP. THE SWPPP WILL BE SUBMITTED TO THE OWNER AND ENGINEER FOR REVIEW.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR PROPER INSTALLATION AND MAINTENANCE OF ALL EROSION AND SEDIMENT CONTROL MEASURES/STORMWATER BEST MANAGEMENT PRACTICES (BMP'S) IN ACCORDANCE WITH LOCAL, STATE, AND FEDERAL REQUIREMENTS.
3. THE IMPLEMENTATION OF THESE EROSION AND SEDIMENT CONTROL MEASURES INCLUDING CONSTRUCTION, MAINTENANCE, REPLACEMENT AND UPGRADING OF THIS PLAN IS THE RESPONSIBILITY OF THE CONTRACTOR UNTIL ALL PROJECT CONSTRUCTION IS COMPLETED AND APPROVED BY THE OWNER. THE OWNER SHALL BE RESPONSIBLE FOR ALL MAINTENANCE AFTER THE PROJECT IS APPROVED.
4. ALL EROSION CONTROL BMP'S SHALL BE INSTALLED PRIOR TO THE START OF ANY EARTH DISTURBING ACTIVITIES AND SHOULD REMAIN IN PLACE UNTIL ALL DISTURBED/EXPOSED AREAS HAVE BEEN STABILIZED AND/OR REVEGETATED.
5. ALL STORMWATER, EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE REGULARLY INSPECTED AND MAINTAINED BY THE CONTRACTOR DURING CONSTRUCTION.
6. WORK ACTIVITIES SHALL TAKE PLACE IN GRADING LIMITS AS SHOWN ON THESE PLANS. CONTRACTOR SHALL PRESERVE NATURAL LANDSCAPE OUTSIDE OF CONSTRUCTION LIMITS.
7. DURING CONSTRUCTION CONTRACTOR SHALL SPRINKLE ALL DISTURBED AREAS AS NECESSARY FOR DUST ABATEMENT.
8. ALL SLOPE AND OUTLET PROTECTION SHALL BE INSTALLED IMMEDIATELY AFTER GRADING.

ASBESTOS CEMENT (AC) OR TRANSITE PIPE NOTES:

1. IF ANY AC PIPE IS ENCOUNTERED DURING CONSTRUCTION, WHETHER IDENTIFIED ON THE DRAWINGS OR NOT, IT IS THE CONTRACTOR'S RESPONSIBILITY TO CONDUCT NECESSARY DISTURBANCE, REMOVAL, DISPOSAL, OR CUTTING OF ASBESTOS CONTAINING PIPE IN ACCORDANCE WITH, BUT NOT LIMITED TO, THE FOLLOWING REGULATIONS:

UNITED STATES ENVIRONMENTAL PROTECTION AGENCY (EPA) ASBESTOS NATIONAL EMISSION STANDARDS FOR HAZARDOUS AIR POLLUTANTS (ASBESTOS NESHA) REGULATION AT 40 CFR PART 61;
2. THE APPLICABLE UNITED STATES OCCUPATIONAL SAFETY & HEALTH ACT (OSHA) STANDARDS AT 29 CFR 1910 & 1926.

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED



ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990

IDAHO OFFICES
BOISE · LEWISTON · COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS


GENERAL NOTES

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING 0 1"	
PROJECT :	126.0060.02
DATE :	9/20/2017
DRAWING NO.	SHEET NO.
G2.0	2


Path: B:\Projects\A-Donnelly\126.0060 WSC\CD\G3.0 Line Legend.dwg Plot Date: 5/3/2018 5:32 PM User: benewett

LINE LEGEND

SECTION LINE (SURVEYED)	
EXISTING DEED OR LOT LINE (SURVEYED)	
CENTERLINE	
RIGHT OF WAY	
EASEMENT	
SILT FENCE	
EXISTING BUILDING	
EXISTING EDGE OF CONCRETE	
EXISTING EDGE OF PAVEMENT	
EXISTING EDGE OF GRAVEL	
EXISTING UNDERGROUND GAS LINE	
EXISTING WATER LINE AND SIZE	
EXISTING SEWER LINE	
PROPOSED SEWER LINE	
EXISTING STORM DRAIN	
EXISTING OVERHEAD POWER	
EXISTING UNDERGROUND POWER	
EXISTING UNDERGROUND TELEPHONE	
EXISTING FLOW LINE	
EXISTING PRESSURE IRRIGATION LINE	
EXISTING GRAVITY IRRIGATION LINE	
EXISTING FIBER OPTIC	
EXISTING CHAIN LINK FENCE	
EXISTING WOOD FENCE	
EXISTING VINYL FENCE	
EXISTING WIRE FENCE	
EXISTING 1' CONTOUR	
EXISTING 5' CONTOUR	
EXISTING DRAINAGE PIPE	

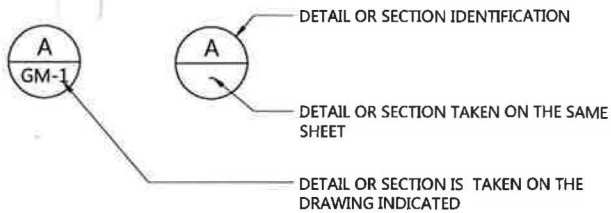

AT TITLE

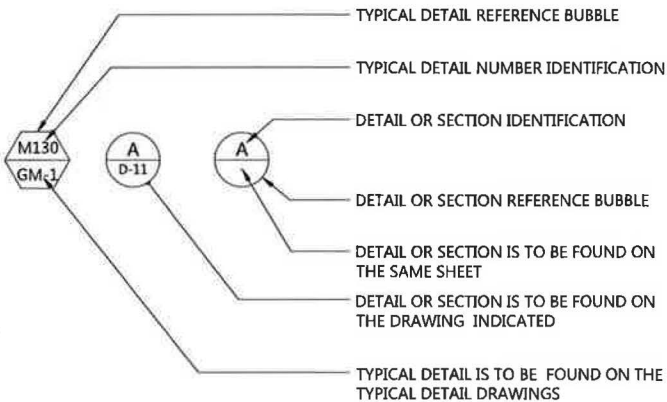

AT CROSS REFERENCE

DRAWING CROSS REFERENCE



CROSS SECTION

	BOLLARD
	EXISTING MANHOLE
	NEW MANHOLE
	EXISTING WATER MANHOLE
	EXISTING WATER METER
	EXISTING WATER SERVICE
	EXISTING WATER VALVE
	EXISTING TREE, BUSH
	WATER SURFACE ELEVATION
	EXISTING CLEANOUT
	EXISTING UTILITY POLE
	UTILITY POLE ANCHOR
	EXISTING FIRE HYDRANT
	EXISTING LIGHT POLE
	EXISTING ELECTRICAL BOX
	EXISTING GAS METER/RISER
	EXISTING POWER METER
	EXISTING STORM MANHOLE
	EXISTING STORM DRAIN CATCH BASIN
	EXISTING MONITORING WELL
	EXISTING TELEPHONE RISER
	EXISTING TELEPHONE JUNCTION BOX
	FINISHED ELEVATION
	EXISTING ELEVATION
	BREAK LINE
	DRAINAGE FLOW OR PIPE FLOW DIRECTION
	SURVEY MONUMENT
	BENCH MARK (BM)
	REVISION NUMBER
	BOREHOLE
	SURVEY CONTROL POINT
	KEY NOTE
	COORDINATE NUMBER
	CONCRETE (PLAN AND SECTION)
	EARTH
	GRAVEL/DRAINROCK/AGGREGATE BASE
	AC PAVEMENT
	REVISION CLOUD

TYPE OF JOINT OR COUPLER

FLANGED JOINT

MECHANICAL JOINT

PUSH-ON JOINT

RESTRAINED PUSH-ON JOINT

GROOVED COUPLING

RESTRAINED FLANGED COUPLING ADAPTER


FLEXIBLE COUPLING

RESTRAINED FLEXIBLE COUPLING FOR STEEL PIPE

DISMANTLING JOINT

PIPE SUPPORT (CALL OUT DETAIL)

THREE LINE PIPE

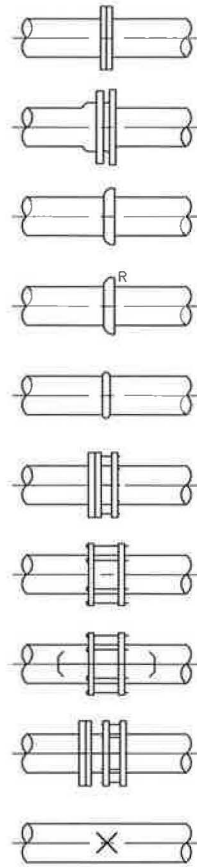

THREE LINE VALVES

GATE

BUTTERFLY


SILENT GLOBE CHECK

CHECK

BALL

PLUG

FLANGED JOINT

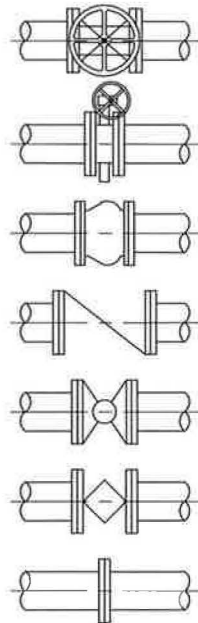

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED



ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990
IDAHO OFFICES
BOISE · LEWISTON · COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS

LINE LEGEND/LEGEND AND SYMBOLS

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING 1"	
PROJECT :	126.0060.02
DATE :	9/20/2017
DRAWING NO.	SHEET NO.
G3.0	3

PROJECT INFORMATION

LOCATION: TBD FRONT STREET
PARCEL RPD00000106624
DONNELLY, IDAHO 83615



OWNER: CITY OF DONNELLY

NOTES:


1. REFER TO SHEETS C1.1 AND C1.2 FOR DETAILS.
2. EXISTING UTILITY LOCATIONS APPROXIMATE.

LEGEND:

- FENCE
EXISTING CONTOURS
EXISTING WATER MAIN
PROPOSED WATER MAIN

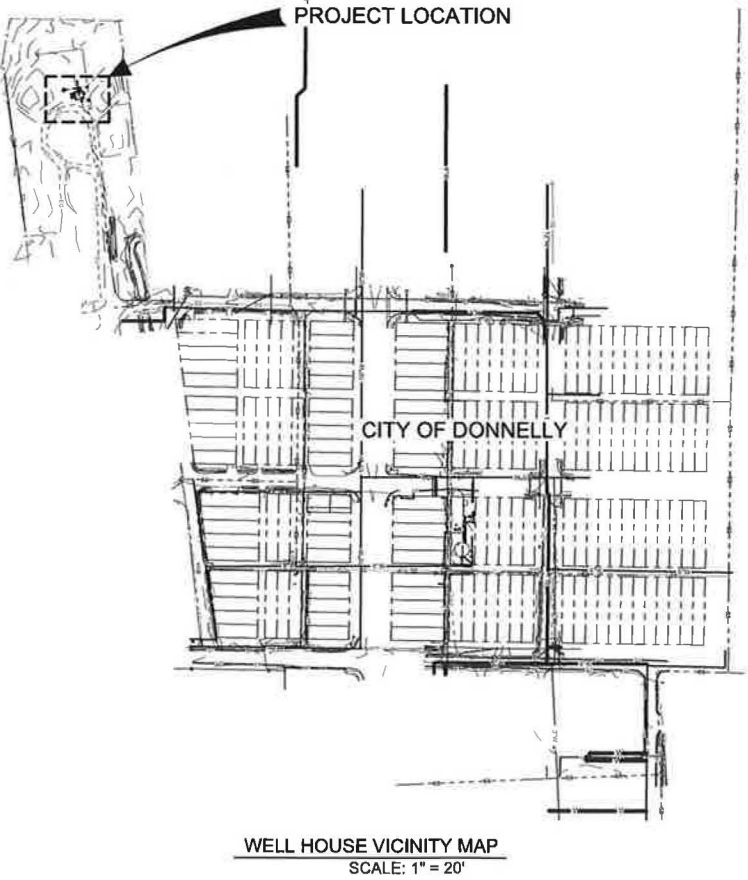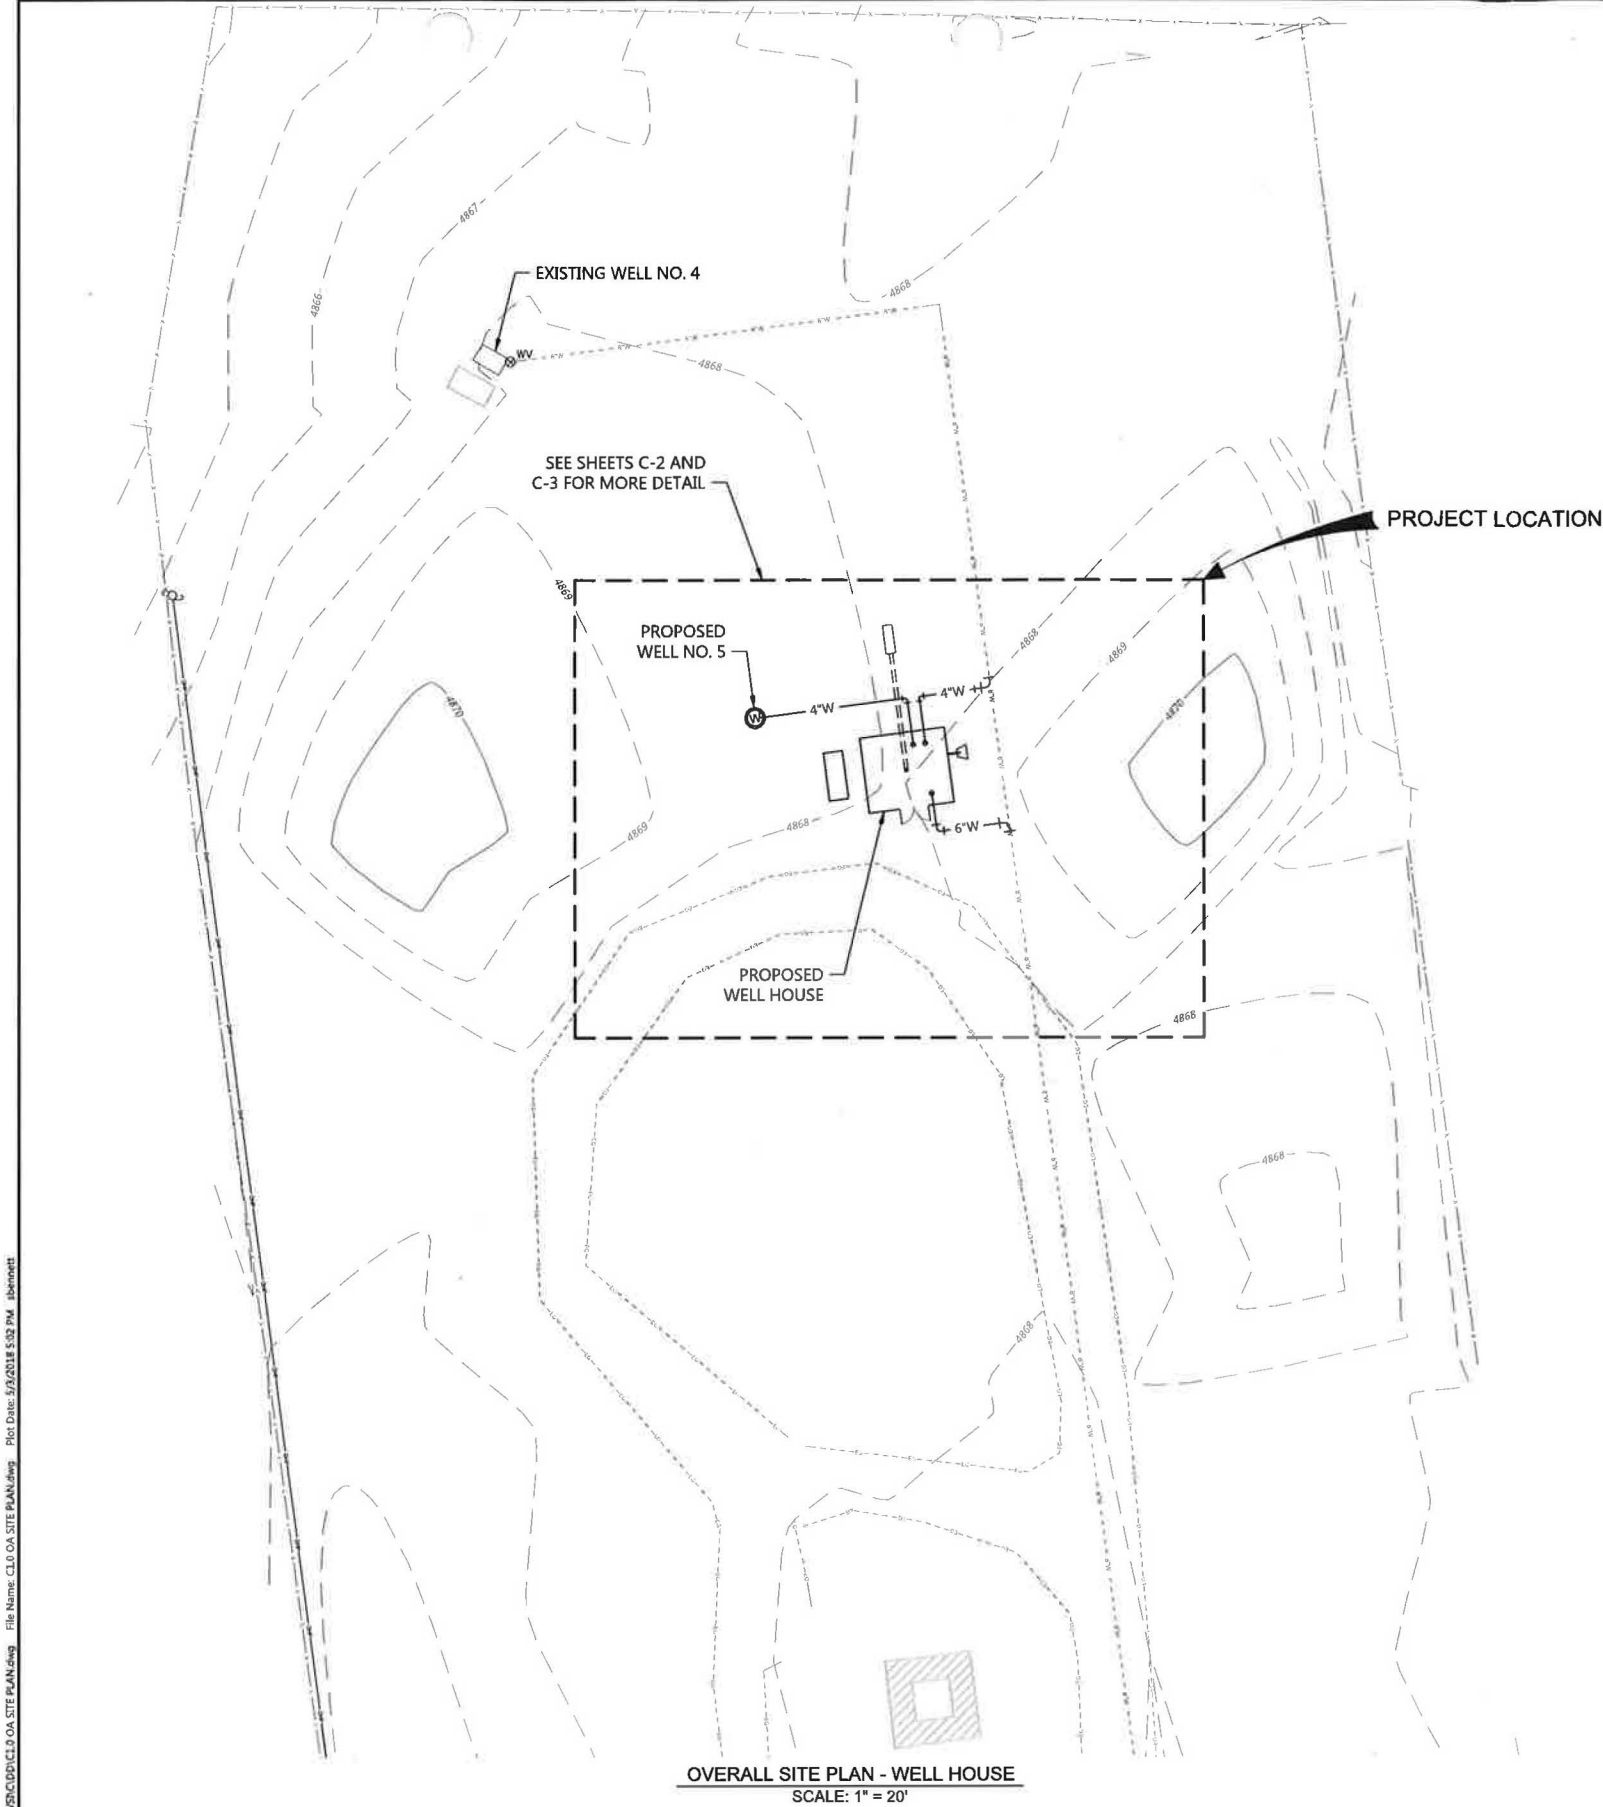

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED



ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990

IDAHO OFFICES
BOISE · LEWISTON · COEUR D'ALENE


CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS

OVERALL SITE PLAN - WELL HOUSE

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING	
PROJECT	126.0060.02
DATE	9/20/2017
DRAWING NO.	SHEET NO.
C1.0	4


- NOTES:
1. ALL MATERIALS AND EQUIPMENT COMING IN CONTACT WITH POTABLE WATER, INCLUDING PUMP AND MOTOR, MUST BE ANSI/NSF STANDARD 61 COMPLIANT.
 2. ALL CHEMICALS UTILIZED DURING INSTALLATION, LUBRICATION, TESTING, AND DISINFECTION OF POTABLE FACILITIES MUST BE ANSI/NSF 60 COMPLIANT.
 3. WELL CONSTRUCTION, SUBMERSIBLE PUMP, AND PITLESS ADAPTER REFER TO SHEET TD1.0.
 4. EXISTING UTILITY LOCATIONS APPROXIMATE. CONTRACTOR TO VERIFY LOCATIONS PRIOR TO CONSTRUCTION.

- LEGEND:
- 8"W --- EXISTING WATER MAIN (LOCATION APPROX.)
 - 6"W --- PROPOSED WATER MAIN
 - EG --- EDGE OF GRAVEL (EXISTING)
 - EG --- EDGE OF GRAVEL (PROPOSED)

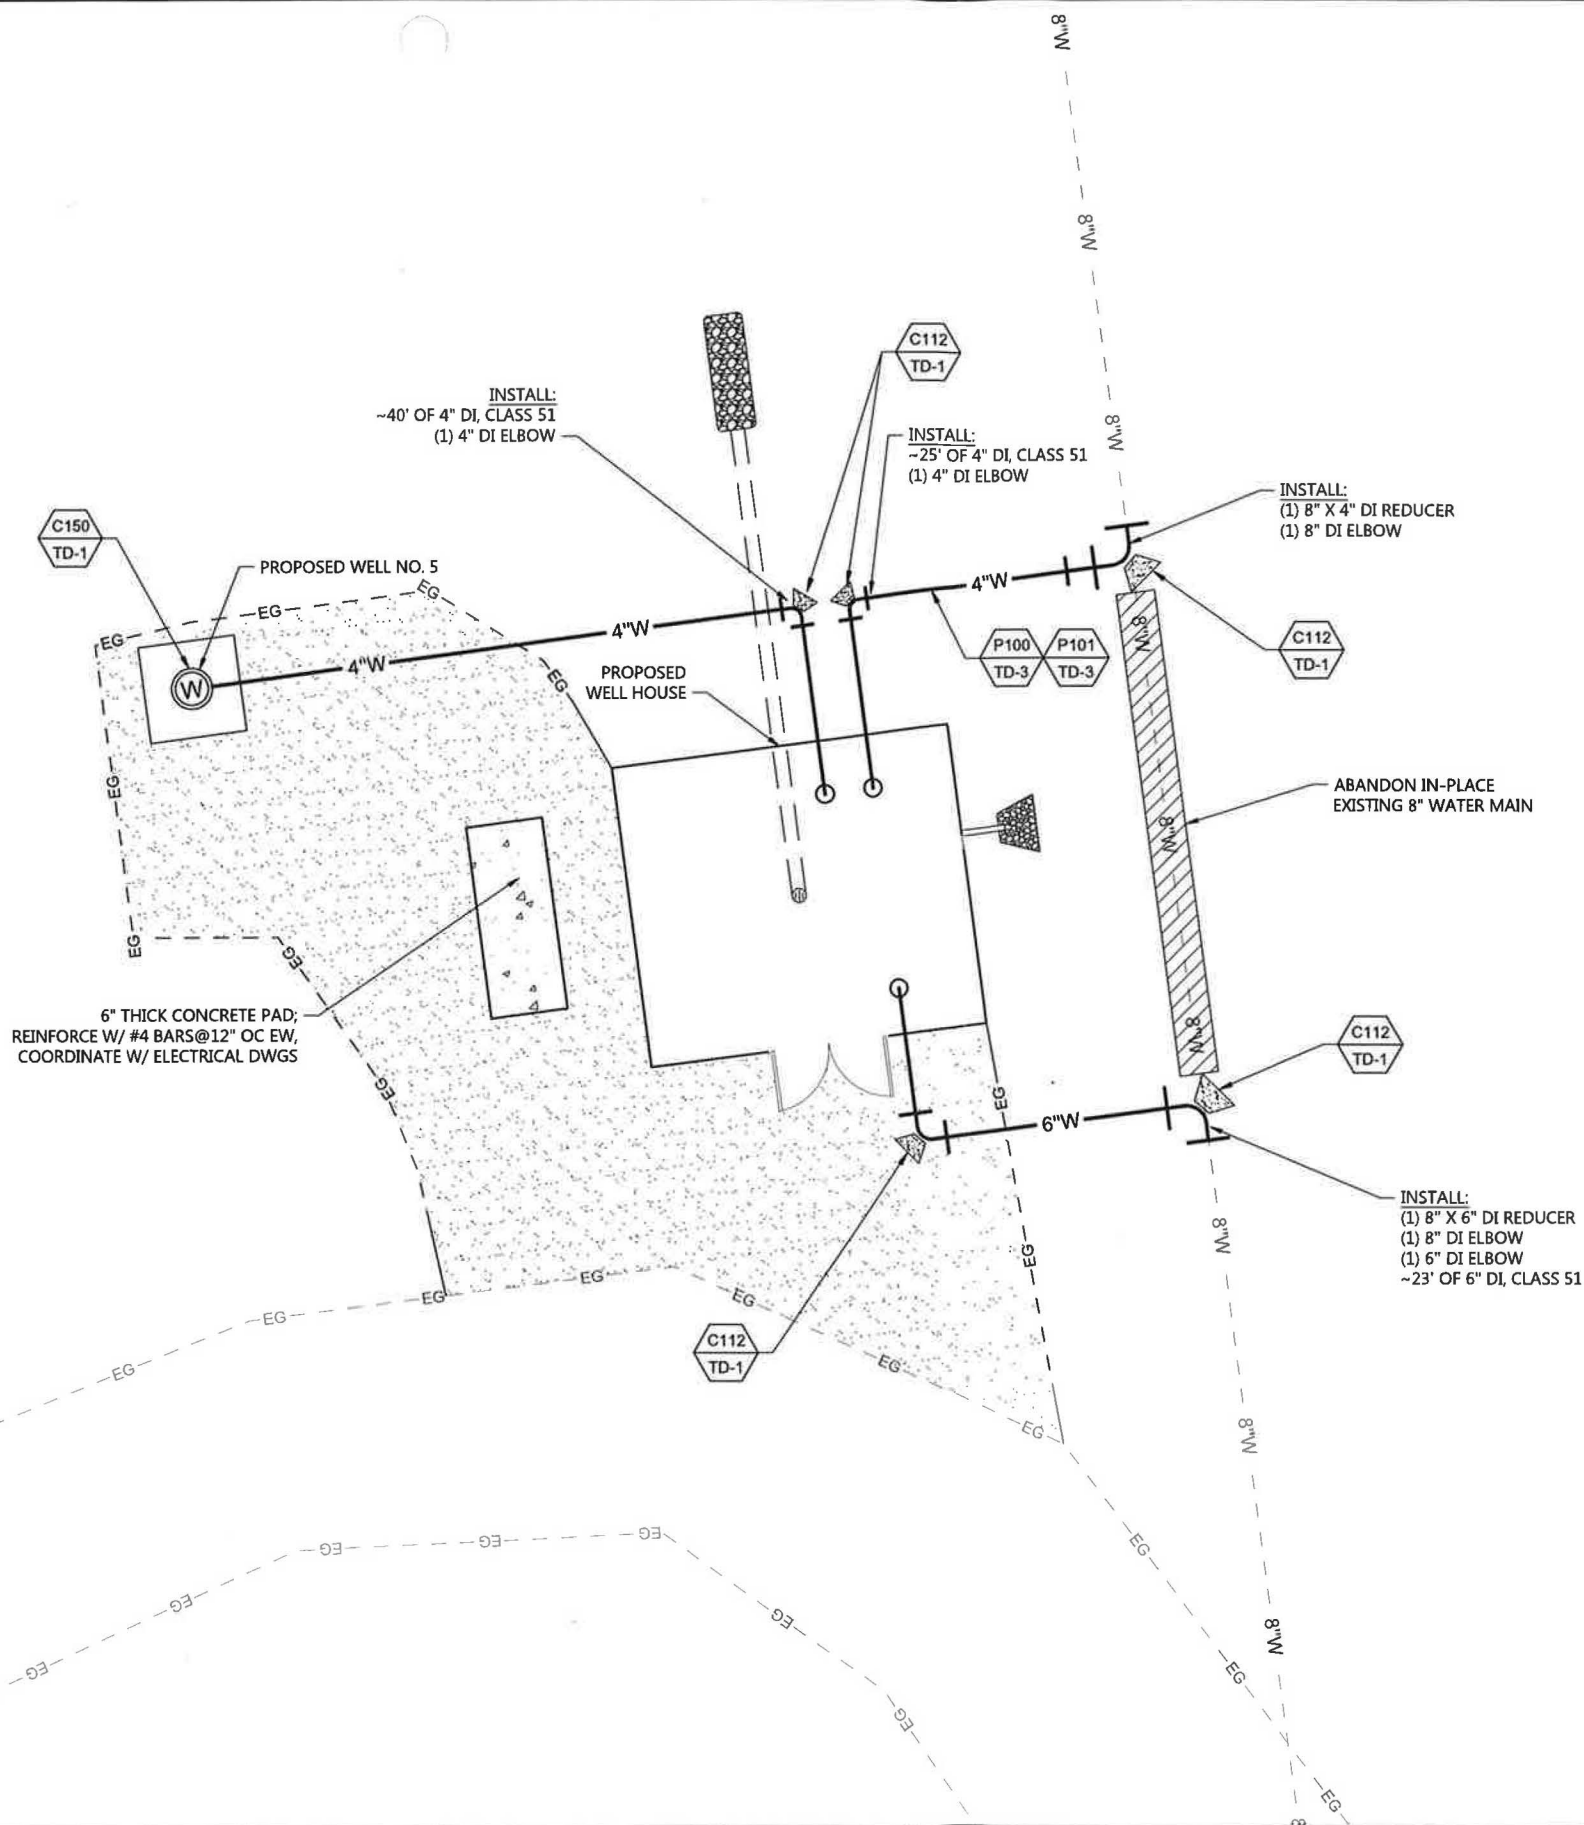

Path: \\Project\A-D\Donnelly\126.0060 WSI\CD\CD1.C1.2.dwg File Name: C1.2.dwg Plot Date: 5/9/2018 5:02 PM stewart

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED




ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990

IDAHO OFFICES
BOISE · LEWISTON · COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY		VERIFY SCALE	
WATER SYSTEM IMPROVEMENTS		BAR IS ONE INCH ON FULL SIZE DRAWING	
WELL HOUSE YARD PIPING PLAN		PROJECT :	126.0060.02
		DATE :	9/20/2017
DRAWING NO.	SHEET NO.		
C1.1	5		

1. PROVIDE EROSION CONTROL MEASURES TO PREVENT SEDIMENT TRANSPORT OFF-SITE.
2. ELEVATIONS BASED ON NAVD88.
3. FINISHED GRADE TO SLOPE MINIMUM OF 5 PERCENT AWAY FROM BUILDING FOR MINIMUM OF 10 FEET.

--- 8"W --- EXISTING WATER MAIN (LOCATION APPROX.)
 ————— 6"W ————— PROPOSED WATER MAIN
 ---|--- EG --- EDGE OF GRAVEL (EXISTING)
 ---|--- EG --- EDGE OF GRAVEL (PROPOSED)
 → FLOW DIRECTION



NORTH
APPROXIMATE SCALE: 1" = 5'
(NOTE: VERIFY SCALE IN TITLE BLOCK)

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED




ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990

IDAHO OFFICES
BOISE • LEWISTON • COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS

WELL HOUSE GRADING PLAN

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING	
	
PROJECT :	126.0060
DATE :	9/20/20
DRAWING NO.	SHEET NO.
C1.2	6

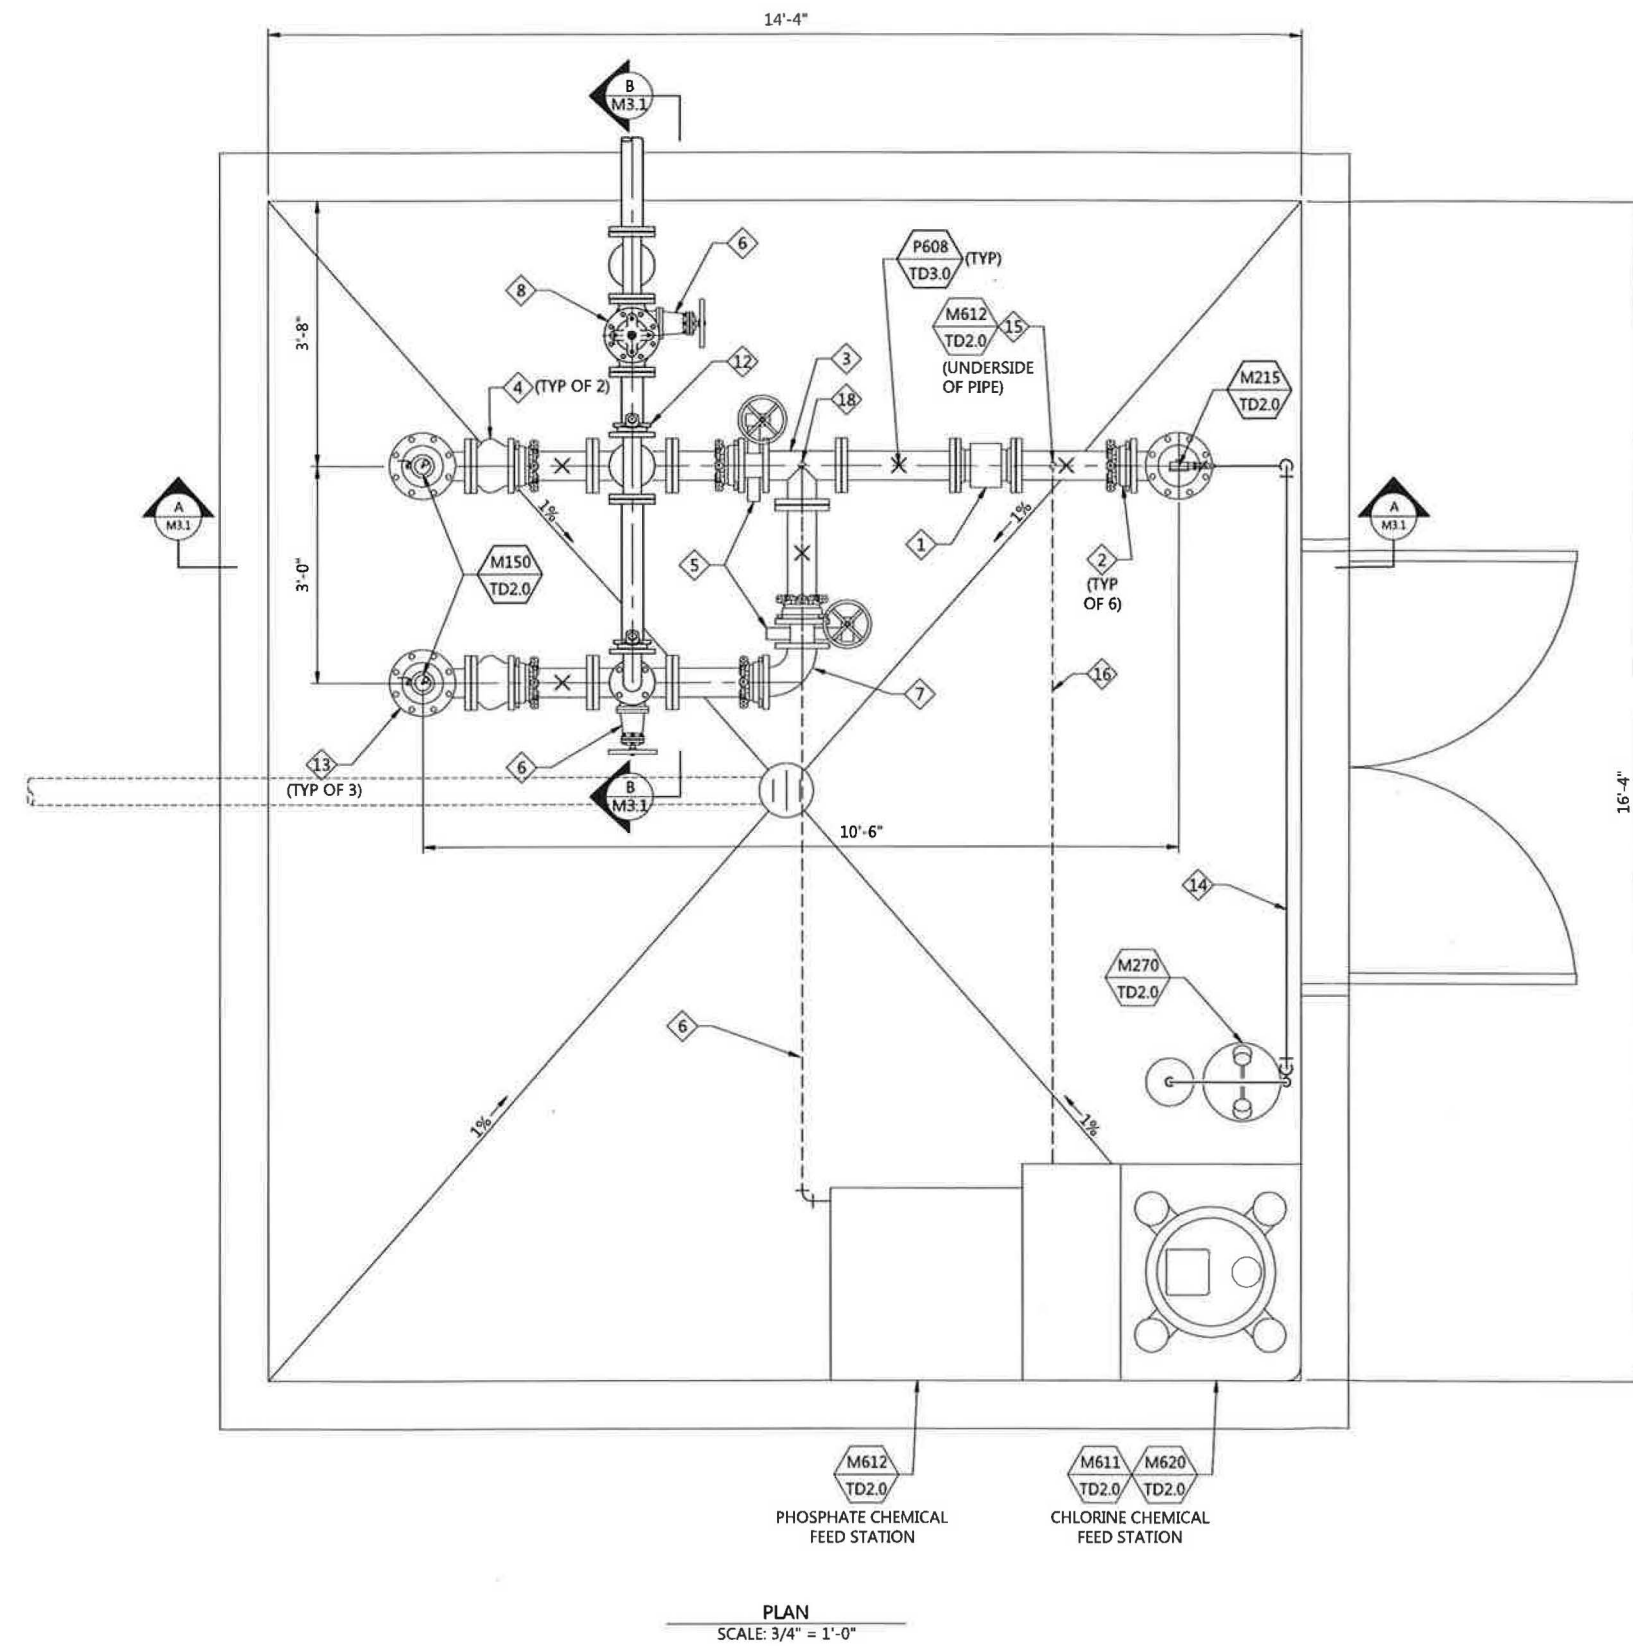

NOTE:

- ALL VALVES, PIPING, AND APPURTENANCES WHICH COME INTO CONTACT WITH POTABLE WATER SHALL BE NSF COMPLIANT.

KEY NOTES

- 4-INCH MAGNETIC FLOWMETER
- 4-INCH RFCA (6)
- 4-INCH TEE (1)
- 4-INCH CHECK VALVE (2)
- 4-INCH BUTTERFLY VALVE (4)
- 3-INCH GATE VALVE (3)
- 4-INCH ELBOW (1)
- 3-INCH PRESSURE RELIEF VALVE (1)
- 4-INCH BY 3-INCH REDUCING TEE (2)
- 3-INCH TEE (3)
- 3-INCH ELBOW (2)
- 3-INCH RFCA (3)
- 6-INCH BY 4-INCH REDUCING TEE (3)
- 1" NPT GALVANIZED PIPE TO EYEWASH STATION (NEAR CEILING)
- CHLORINE INJECTION
- 3/8" CHEMICAL FEED TUBING, BELOW SLAB
- SERVICE SADDLE FOR EYEWASH
- PHOSPHATE INJECTION

Path: B:\Projects\A-D\Donnelly_1260060\WSP\CLD\M3.0 Well House Mech Plan.dwg File Name: M3.0 Well House Mech Plan.dwg Plot Date: 5/3/2018 5:02 PM sennett

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN
				SCB
				CHECKED
				MGW
				APPROVED




ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990


IDAHO OFFICES
BOISE · LEWISTON · COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS
WELL HOUSE MECHANICAL PLAN

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING	
PROJECT :	126.0060.02
DATE :	9/20/2017
DRAWING NO.	SHEET NO.
M3.0	12

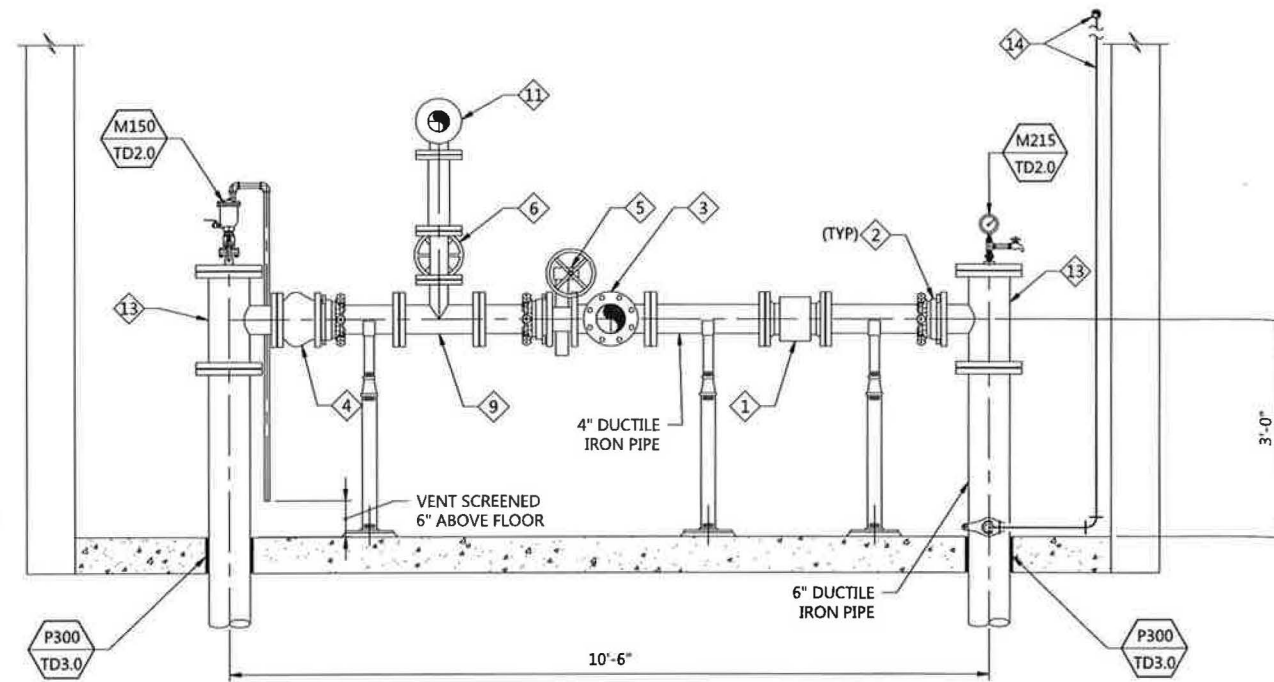

A SECTION
M3.0 SCALE: 3/4" = 1'-0"

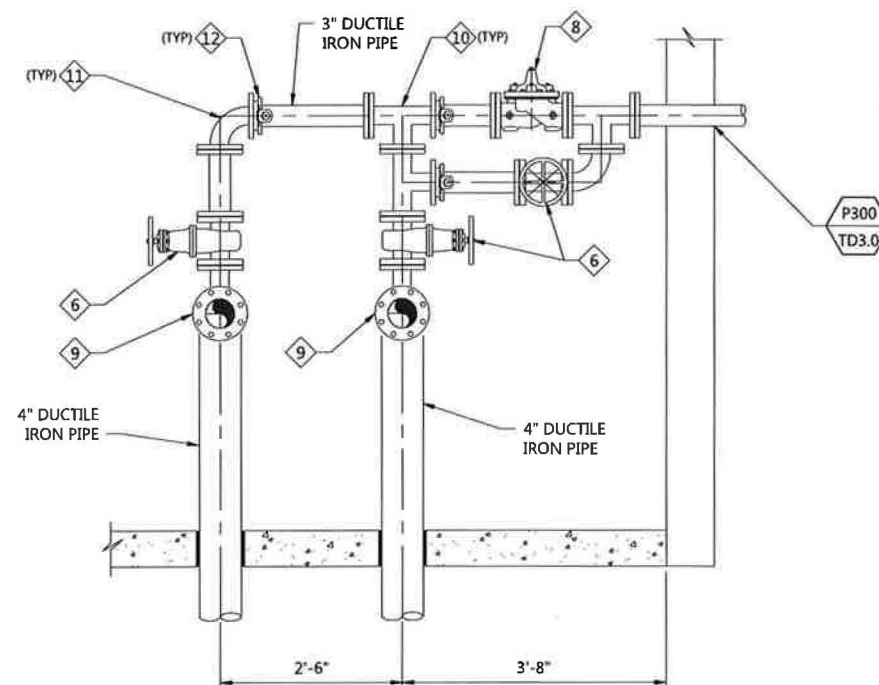

B SECTION
M3.0 SCALE: 3/4" = 1'-0"

NOTE:

1. ALL VALVES, PIPING, AND APPURTENANCES WHICH COME INTO CONTACT WITH POTABLE WATER SHALL BE NSF COMPLIANT.

KEY NOTES

1. 4-INCH MAGNETIC FLOWMETER
2. 4-INCH RFCA (6)
3. 4-INCH TEE (1)
4. 4-INCH CHECK VALVE (2)
5. 4-INCH BUTTERFLY VALVE (4)
6. 3-INCH GATE VALVE (3)
7. 4-INCH ELBOW (1)
8. 3-INCH PRESSURE RELIEF VALVE (1)
9. 4-INCH BY 3-INCH REDUCING TEE (2)
10. 3-INCH TEE (3)
11. 3-INCH ELBOW (2)
12. 3-INCH RFCA (3)
13. 6-INCH BY 4-INCH REDUCING TEE (3)
14. 1" NPT GALVANIZED PIPE TO EYEWASH STATION (NEAR CEILING)
15. CHLORINE INJECTION
16. 3/8" CHEMICAL FEED TUBING, BELOW SLAB
17. SERVICE SADDLE FOR EYEWASH
18. PHOSPHATE INJECTION

Path: S:\Projects\A-Donnelly\1260060 WRS\CD\03\1 Well House Mech Sects.dwg File Name: M3.1 Well House Mech Sects.dwg Plot Date: 5/3/2018 5:02 PM sbennett

NO.	REVISION	BY	DATE	DESIGN
1	30 PERCENT DESIGN	MGW	1/29/18	BH
2	DEQ SUBMITTAL	MGW	5/3/18	DRAWN SCB
				CHECKED MGW
				APPROVED



ENGINEERING AND ENVIRONMENTAL SOLUTIONS
1161 W. RIVER ST. SUITE 130
BOISE, IDAHO 83702
208.780.3990
IDAHO OFFICES
BOISE · LEWISTON · COEUR D'ALENE

CITY OF DONNELLY IDAHO, VALLEY COUNTY
WATER SYSTEM IMPROVEMENTS
WELL HOUSE SECTIONS

VERIFY SCALE	
BAR IS ONE INCH ON FULL SIZE DRAWING	
PROJECT :	126.0060.02
DATE :	9/20/2017
DRAWING NO.	SHEET NO.
M3.1	13

Hersley, Jean

From: Hersley, Jean
Sent: Wednesday, August 29, 2018 10:15 AM
To: 'STARCLASS@FRONTIER.COM'
Subject: Legal Notice For your Paper

August 29, 2018

Legal Notice Department

The Star News
1000 1st St
McCall ID 83638

RE: Legal Ad for your paper

Dear LEGAL NOTICE DEPARTMENT:

Enclosed you will find a legal notices which we wish to have published in your newspaper on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office, PO Box 83720, Boise, Idaho, 83720-0098 before September 24, 2018. Your cooperation is appreciated.

Sincerely

Jean Hersley
Technical Records Specialist II
IDWR State Office
322 E Front St
Boise ID 83720
208-287-4942
jean.hersley@idwr.idaho.gov

**NOTICE OF PROPOSED CHANGE OF WATER RIGHT
TRANSFER NO. 82532**

CITY OF DONNELLY, PO BOX 725, DONNELLY, ID 83615; has filed Application No. 82532 for changes to the following water rights within VALLEY County(s): Right No(s). 65-12511, 65-3847; The purpose of the transfer is to change a portion of the above rights as follows: add 2nd municipal well located in the SESW, S10, T16N, R3E, B.M., on City of Donnelly property near the end of N J Corbet Lane and 0.1 mile east of State Hwy 55.

For additional information concerning the property location, contact IDWR State office at (208) 287-4800; or for a full description of the transfer, please see

<http://www.idwr.idaho.gov/water-rights/transfers/search.html>

Protests may be submitted based on the criteria of Idaho Code Sec. 42-222.

Any protest against the proposed change must be filed with the Department of Water Resources, 322 E Front St, PO Box 83720, Boise ID 83720-0098 together with a protest fee of \$25.00 for each application on or before 9/24/2018. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Director

Published on 9/6/2018 and 9/13/2018



State of Idaho

DEPARTMENT OF WATER RESOURCES

322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098

Phone: (208) 287-4800 • Fax: (208) 287-6700 • Web Site: www.idwr.idaho.gov

GARY SPACKMAN
Director

C.L. "BUTCH" OTTER
Governor

August 29, 2018

CITY OF DONNELLY
PO BOX 725
DONNELLY, ID 83615

RE: Transfer No. 82532
Water Right No(s). 65-12511, 65-3847

Dear Applicant(s):

The Department of Water Resources has received your water right transfer application. Please refer to the transfer number referenced above in all future correspondence regarding this transfer.

A legal notice of the application has been prepared and is scheduled for publication in the STAR NEWS on 9/6/2018 and 9/13/2018. Protests to this application may be submitted for a period ending ten (10) days after the second publication.

If the application is protested, you will be sent a copy of each protest. All protests must be resolved before the application can be considered for approval. If the protest(s) cannot be resolved voluntarily, the Department will conduct a conference and/or hearing on the matter.

If the application is not protested, the Department will process your application and notify you of any action taken on the application. If your application is approved, the Department will send you a copy of the approval document.

Please contact this office if you have any questions regarding the application.

Sincerely,

Jean Hersley
Technical Records Specialist

CC: MOUNTAIN WATER WORKS
MIKE WOODWORTH
1161 W RIVER ST STE 130
BOISE, ID 83702

MEMORANDUM

Date: August 20, 2018
To: Transfer 82532
From: David Betts
Re: Review & Evaluation of Sufficiency of Information

Background:

The City of Donnelly submitted an Application for Transfer of Water Right - Point(s) of Diversion for water rights 65-3847 and 65-12511 which was received on May 08, 2018. 65-3847 and 65-1211 are decreed groundwater rights for municipal use. 65-3847 is the most senior water right within the nearby quarter-quarters, with a diversion rate limited to 1.00 cfs. 65-1211 is limited to 0.50 cfs.

ArcGIS lists the same well as the point of diversion for both water rights, which the City of Donnelly identified as "Well No. 4". The application proposes that a new well ("Well No. 5") would serve as an additional point of diversion for both water rights. The original and the proposed PODs are in the SESW quarter-quarter of Section 10, Township 16 North, Range 03 E. A second point of diversion for 65-1211 within the SWSE quarter-quarter of Section 10 will be abandoned with the transfer.

The applicant requested that Permit 65-13362 be included, but permits cannot be part of a transfer. The applicant was notified of the exclusion of 65-13362 on July 02, 2018. After review, Permit 65-13362 was voided on the same date based on information from the field examiner indicating that the diversion for beneficial use had not been developed.

The map of the proposed POD in the application for transfer corresponds with the information from the Well Driller's Report for Well Tag No. D00078479. The construction of the well for the proposed POD was completed in July of 2018.

Authority to File:

The form was signed by Cami Hedges, City Clerk Treasurer, who is listed as such in the City's directory (www.cityofdonnelly.org).

The City of Donnelly paid a filing fee of \$580 for the combined diversion rate of 1.50 cfs from both water rights.

Water Right Validity:

Rights are presumed to be valid. Both rights were decreed in 2000, and the water has been in use by the City of Donnelly.

Injury to Other Water Rights:

Although there are 10 other groundwater PODs in the same quarter-quarter section, it is assumed that the additional well (POD) will not cause injury to the other water rights. The proposed POD is approximately 115 feet to the south of the original POD. The new POD would be at most 115 feet closer than the original POD to any other POD in the surrounding area.

The demands of the other water rights in the same quarter-quarter section are relatively low. The other PODs are for domestic uses, with 9 out of the 10 being limited to the standard diversion rate of 0.04 cfs for domestic use.

All of the water rights in the quarter-quarter section were reviewed during the SRBA adjudication, with time

allowed for protests. If the transfer is approved, the water rights will maintain the same diversion rates and nature of use as their decrees.

Enlargement of Use:

Both water rights are for municipal use for the same place of use. The applicant stated that the water from the original PODs and the proposed POD will be "piped to a common well house with locked doors and instantaneous and totalizing flow meter". The shared measuring device would allow for the monitoring and regulation of both water rights within their diversion limits.

The proposed POD is likely to divert from the same groundwater source as the original PODs, because of the short distance between the wells.

Beneficial Use/Conservation of Water Resources:

The application proposes beneficial uses consistent with conservation of water resources in Idaho.

The proposed PODs are not within a groundwater management area.

The transfer would not change the quantity of water or nature of use of the decreed water rights. The assessments of beneficial use and conservation of water resources for the original decrees still stand.

Effect on Economy the Local Area:

The additional POD will allow the City of Donnelly to more efficiently provide water for the municipal uses authorized by these two water rights.

Effect on Agricultural Base of the Local Area:

It is assumed that the addition of a POD in the same quarter-quarter of the original PODs will have no additional impact on the agriculture in the area than the original water rights. Irrigation in the surrounding area is primarily provided for by surface and waste water supplies. The nearest irrigation from groundwater is limited to 5 acres between two properties, with water rights that include domestic uses.

Review of the application finds there is no clear inconsistency with criteria set forth in Section 42-222 Idaho Code preventing processing of this application.



State of Idaho

DEPARTMENT OF WATER RESOURCES

322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098

Phone: (208) 287-4800 • Fax: (208) 287-6700 • Web Site: www.idwr.idaho.gov

GARY SPACKMAN
Director

C.L. "BUTCH" OTTER
Governor

July 2, 2018

CITY OF DONNELLY
PO BOX 725
DONNELLY ID 83615

RE: Application for Transfer for Water Rights 65-3847 & 65-12511

Dear Applicant,

The Department of Water Resources received an application for Transfer for Water Rights 65-3847 & 65-12511 on May 8, 2018. A letter was sent on May 24, 2018 requesting additional information. As of today, no information has been received.

The transfer you submitted proposes to add a point of diversion to three (3) water rights and remove a point of diversion from 65-12511. The issue was that one of the water rights you included in the transfer was a permit. Permits cannot be a part of a transfer. However, this permit has been voided so this is not an issue.

Another issue was the total amount of water you proposed to be transferred. The two licensed water rights authorize a total diversion rate of 1.5 cfs. You can identify all or part of the rate as being transferred. Diversion from the new well will be limited based on the rate you chose and the fee paid. The application fee is based on the total rate being transferred. The \$200 fee already submitted would limit diversion from the new well to 0.2 cfs. If you want the ability to divert the entire rate of 1.5 cfs from the proposed new well, the transfer fee is \$580 (additional \$380 required). You could also identify a rate between 0.21 to 1.0 cfs for a fee of \$500 (additional \$300 required).

I am enclosing another copy of page 1 of the application for you to **complete #4, date and initial the change, then return the page to the Department with any additional fee required within 30 days or the application will be return to you unprocessed.**

Please contact Pam Skaggs at (208) 287-4951 if you have any questions regarding this matter.

Sincerely,

Jean Hersley
Technical Records Specialist II

c: Mountain Waterworks, Inc.



State of Idaho

DEPARTMENT OF WATER RESOURCES

322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098

Phone: (208) 287-4800 • Fax: (208) 287-6700 • Web Site: www.idwr.idaho.gov

GARY SPACKMAN
Director

C.L. "BUTCH" OTTER
Governor

May 24, 2018

CITY OF DONNELLY
PO BOX 725
DONNELLY, ID 83615

Re: Application for Transfer of Water Right(s)

Dear Applicant(s):

The Department of Water Resources has received your Application for Transfer. Preliminary review of the application indicates that additional information is needed before we can process this application.

You propose to add a point of diversion to three (3) water rights and remove a point of diversion located in SWSE of Section 10, Township 16N, Range 03E from Right 65-12511.

Permit 65-13362 has not been licensed and cannot be included in this transfer as a permit.

- If you want to include the permit, you will need to withdraw the transfer and wait for the license to be issued.
- If you want to pursue adding the additional well to the other two (2) water rights at this time, we will process the application for transfer without Permit 65-13362.

It's possible the additional point of diversion could be added to the permit through a licensing amendment (\$100 fee) along with any other necessary changes to elements of the right to reflect actual development of the permit. **Please advise us if you propose to withdraw the transfer application.**

Item # 4 on the application is the total amount of water transferred. The two licensed water rights authorize a total diversion rate of 1.50 cfs. You can identify all or part of the rate as being transferred. Diversion from the new well will be limited based on the rate you choose and the fee paid. The application fee is based on the total rate being transferred. The \$200 fee already submitted would limit diversion from the new well to 0.20 cfs. If you want the ability to divert the entire rate of 1.50 cfs from the proposed new well, the transfer fee is \$580 (additional \$380 required). You could also identify a rate between 0.21 to 1.00 cfs for a fee of \$500 (additional \$300 required). I am enclosing a copy of page 1 of the application for you to **complete #4, date and initial the change, then return the page to the Department with any additional fee required.**

Please contact this office if you have any questions regarding this matter.

Sincerely,

Jean Hersley
Technical Records Specialist II

Enclosure



State of Idaho

DEPARTMENT OF WATER RESOURCES

322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098

Phone: (208) 287-4800 • Fax: (208) 287-6700 • Website: www.idwr.idaho.gov

C.L. "BUTCH" OTTER
Governor

GARY SPACKMAN
Director

May 29, 2018

CITY OF DONNELLY
PO BOX 725
DONNELLY ID 83615

Notice of Intent to Void Permit

RE: Water Appropriation Permit No. 65-13362

Dear Sirs:

COPY

The Department of Water Resources (Department) is reviewing the above referenced permit to determine if a license can be issued. In order for a permit to be licensed, the permit holder must show that a beneficial use has been developed in excess of existing water rights on the property.

A field examination to verify the water use for permit 65-13362 (Permit) was performed on the City of Donnelly (City) water system on September 13, 2001. The field examiner described the City's water system diverted ground water from an older well located in the SE $\frac{1}{4}$ SW $\frac{1}{4}$ of Section 10 in Township 16 North, Range 3 East, and a newer well drilled in 1993 also located in the SESW $\frac{1}{4}$ of Section 10 in Township 16 North, Range 3 East. The field examiner stated that at one time there were three older wells supplying the City's water system, but two of the older wells were abandoned, and only the two wells in the SE $\frac{1}{4}$ SW $\frac{1}{4}$ of Section 10 were in service. The field examiner went on to say that the 1993 well was the main source of water and the older well was only used for backup purposes. The field examiner stated that the older well has a capacity of 0.09 cfs, while the newer well had a capacity of 0.60 cfs. The total system capacity from both wells was 0.69 cfs.

The City has two existing water rights. Water right 65-3847 authorizes a diversion rate of 1.00 cfs for a single well in the SE $\frac{1}{4}$ SW $\frac{1}{4}$ of Section 10 in Township 16 North, Range 3 East. Water right 65-12511 authorizes a diversion rate of 0.50 cfs from 2 wells in the SE $\frac{1}{4}$ SW $\frac{1}{4}$ of Section 10 in Township 16 North, Range 3 East and a single well in the SW $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 10 in Township 16 North, Range 3 East. Water rights 65-3847 and 65-12511 have a combined diversion rate of 1.50 cfs that can be diverted from 2 wells in the SE $\frac{1}{4}$ SW $\frac{1}{4}$ of Section 10 in Township 16 North, Range 3 East.

According to Department policy, a water right transfer or water right permit amendment is not needed to replace a point of diversion in the original 40 acre tract if the original point of diversion will be abandoned. According the field examiner, one of the two points of diversion located in the SE ¼ SW ¼ of Section 10 in Township 16 North, Range 3 East was abandoned, and there are currently only 2 wells in SE ¼ SW ¼ of Section 10 in Township 16 North, Range 3 East. Therefore, there is no need to file a new water right permit to replace a well that has been abandoned. Furthermore, the total amount of water being diverted to the city at the time of the field examination was 0.69 cfs, which is less than the 1.50 cfs authorized to be diverted in the SE ¼ SW ¼ of Section 10 in Township 16 North, Range 3 East.

From the information supplied in the field report, the total system capacity in 2001 was limited to less than the diversion rate authorized by the existing water rights from 2 wells in the SE ¼ SW ¼ of Section 10 in Township 16 North, Range 3 East. Therefore, it does not appear as though an additional increment of beneficial use was developed under permit 65-13362 that was not already authorized by water rights 65-3847 and 65-12511.

Unless you supply information within thirty days or by June 26, 2018, demonstrating that you have developed a beneficial use of water under Permit 65-13362 that exceeds the water use allowed by water right licenses 65-3847 and 65-12511, I will take action to void your permit. If you are no longer interested in your permit, you can shorten the voiding process by signing and returning the enclosed relinquishment form.

If you have any questions in regard to this matter, please do not hesitate to contact me.

Sincerely,



Daniel A. Nelson

Analyst 3

Idaho Department of Water Resources

Telephone # (208) 287-4856

Fax (208) 287-6700 (C/O Dan Nelson)

Email dan.nelson@idwr.idaho.gov

Enclosure – Relinquishment of Permit Form
Computer Proof Report of Permit 65-13362
Computer Proof Reports of Water Right License 65-6847 and 65-12511

Mike Woodworth

From: Miller, Nick <Nick.Miller@idwr.idaho.gov>
Sent: Tuesday, November 14, 2017 2:44 PM
To: Mike Woodworth; Tim Farrell
Cc: Grimm, Angie
Subject: RE: Water Rights Discussion

Mike and Tim,

I looked into a contact for the Lewiston Orchards area GW issues and you would be best contacting Allen Beardslee at our Northern Regional Office (208-762-2800) and Ken Neely at our State Office in Boise (208-287-4800). Allen has been involved at the region for quite some time and Ken was the one who worked on the contract with Dale Ralston.

I also reviewed our transfer memo regarding the backup well for Donnelly. Since the new well is not intended to replace the existing well, and you intend to keep both wells (even if you do not intend to use them simultaneously), the second well should be recorded on the water right, so a transfer is required. As we discussed, we would be willing to issue a drilling permit before the transfer is approved, so it shouldn't affect your construction schedule significantly.

Let me know if you have any further questions,

Nick.

From: Mike Woodworth [mailto:Mwoodworth@mountainwtr.com]
Sent: Tuesday, November 07, 2017 1:08 PM
To: Miller, Nick <Nick.Miller@idwr.idaho.gov>
Subject: Water Rights Discussion

Hi Nick,

Regarding our discussion next Tuesday, we wanted to cover the following topics:

1. Transfer of City of Crouch water permit 65-23158 to municipal and discuss Reasonably Anticipated Future Need (RAFN).
2. Status of the Shekinah water right transfer and the impact of future changes to use going from Irrigation to municipal, specifically the reduction in water right.
3. Status of Orchard Ranch, LLC water right transfer (73855 – 11.36 cfs)
4. Status of Water Right 63-32703-9.6 cfs.

Thanks,

Mike

Mike Woodworth, P.E. | Mountain Waterworks, Inc.
SENIOR PROJECT MANAGER
Boise - Coeur d'Alene - Lewiston - McCall
P 208.780.3982
C 208.954.7965
E mwoodworth@mountainwtr.com