

Permit No. 24-10784
Name Scarlett

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
In-Office Beneficial Use Examination

1. ☒ Copy of Permit
2. ☒ Copy of proof of beneficial use
3. ☒ Copies of amendments/orders
4. ☒ Qualifies under Rule 35.01.r (IDAPA 37.03.02)
5. ☒ Point of Diversion

Township 04S, Range 46E, Section 31, QQ SESE

Method used to determine POD: GPS - site visit

6. ☒ Place of Use

Township 04S, Range 46E, Section 31, QQ SESE

Method used to determine POU: GPS - site visit

7. Y POD and POU match Permit Approval
8. ☒ Aerial photo of place of use
9. N/A Well driller's report
10. No Within a water district? (WD#)
11. ☒ Volume Calculation

$$165 \text{ stock} \times 183 \text{ days} \times 12 \text{ gpd} = 362,340 \text{ gal} = 1.11 \text{ af} \Rightarrow 1.2 \text{ af}$$


12. ☒ Other information

Spring also supplies water to trough on USFS land -
no recorded water right for USFS use

Examiner Name James Cefalo Date 8/18/17



Reviewer _____ Date _____



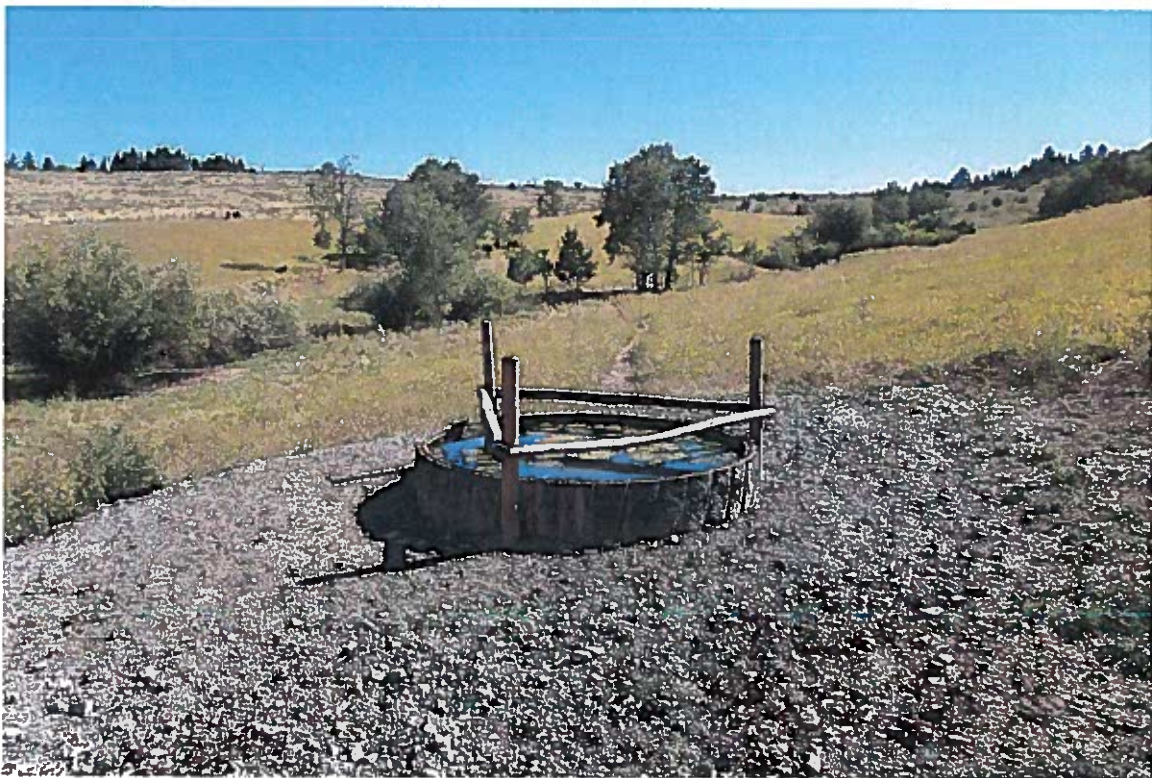

buried pipeline path visible in the background

Water Right License 24-10784

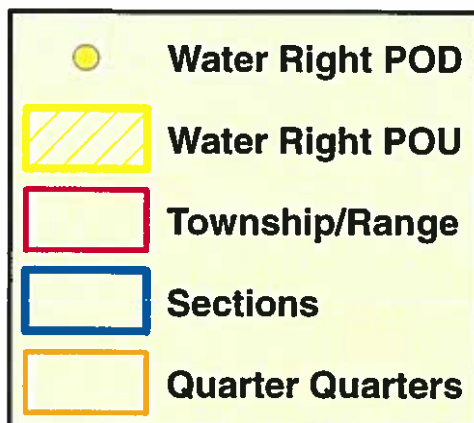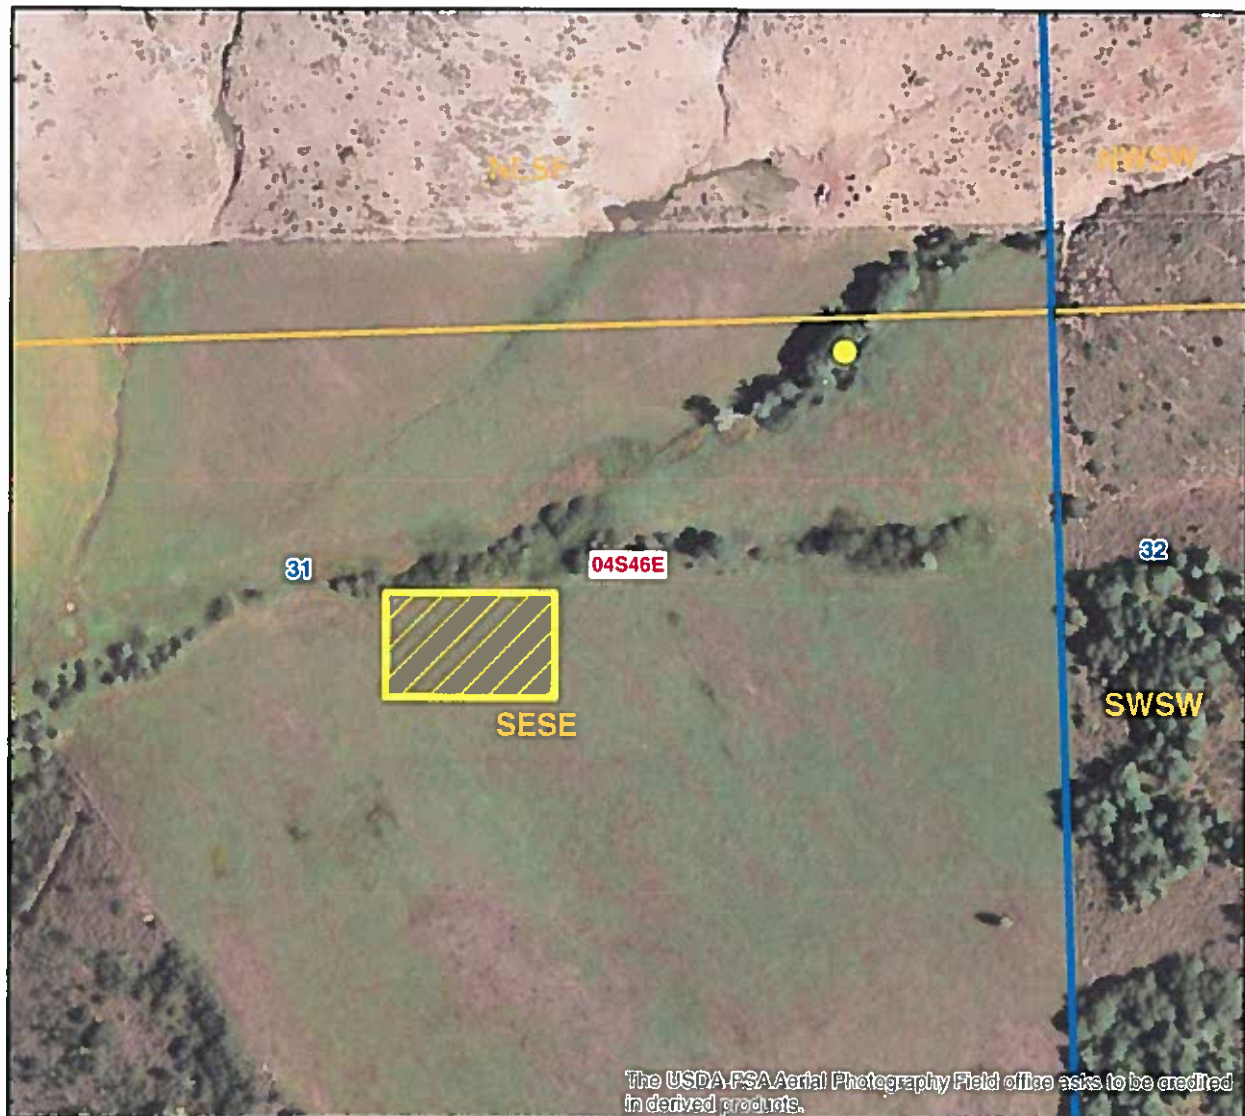

0 250 500 Feet

