

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

TRANSFER OF WATER RIGHT
TRANSFER NO. 81729

This is to certify that: KELLY KRAMER OR
VICKY KRAMER
1286 SOUTHSIDE BLVD
MELBA, ID 83641

has requested a change to the water right(s) listed below. This change in water right(s) is authorized pursuant to the provisions of Section 42-222, Idaho Code. A summary of the changes is also listed below. The authorized change for each affected water right, including conditions of approval, is shown on the following pages of this document.

Summary of Water Rights Before the Proposed Changes

<u>Water Right</u>	<u>Origin/Basis</u>	<u>Priority Date</u>	<u>Diversion Rate</u>	<u>Diversion Volume</u>	<u>Acre Limit</u>	<u>Total Acres</u>	<u>Source</u>
63-10403	WR/DECREED	12/7/1970	1.220 cfs	310.0 af	N/A	62.0	GROUND WATER

Purpose of Transfer (Changes Proposed)

<u>Current Number</u>	<u>Split</u>	<u>POD</u>	<u>POU</u>	<u>Add POD</u>	<u>Period of Use</u>	<u>Nature of Use</u>
63-10403	NO	NO	NO	YES	NO	NO

Summary Of Water Rights After the Approved Change

<u>Existing Right</u>	<u>New No. (Changed Portion)</u>	<u>Transfer Rate</u>	<u>Transfer Volume</u>	<u>Acre Limit</u>	<u>Total Acres</u>	<u>New No. (remaining portion)</u>	<u>Remaining Rate</u>	<u>Remaining Volume</u>	<u>Remaining Acre Limit</u>	<u>Remaining Total Acres</u>
63-10403	63-10403	1.220 cfs	310.0 af	N/A	62.0	N/A	N/A	N/A	N/A	N/A
COMBINED TOTALS		1.220 cfs	310.0 af	62.0	62.0		N/A	N/A	N/A	N/A

This water right(s) is subject to all prior water rights and shall be administered in accordance with Idaho law and applicable rules of the Department of Water Resources. Detailed Water Right Description(s) attached.

Dated this 28th day of June, 2017.



Chief, Water Allocation Bureau

WATER RIGHT NO. 63-10403**As Modified by Transfer No. 81729**

In accordance with the approval of Transfer No. 81729, Water Right No. 63-10403 is now described as follows:

Right Holder: KELLY KRAMER OR
VICKY KRAMER
1286 SOUTHSIDE BLVD
MELBA, ID 83641

Priority Date: 12/7/1970

Source: GROUND WATER

<u>BENEFICIAL USE</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Diversion Volume</u>
IRRIGATION	3/15	to 11/15	1.220 cfs	310.0 af
			1.220 cfs	310.0 af

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER	SENW	Sec 18 Twp 01S Rge 01W ADA County
GROUND WATER	SENW	Sec 18 Twp 01S Rge 01W ADA County
GROUND WATER	NESW	Sec 18 Twp 01S Rge 01W ADA County

PLACE OF USE: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
01S	01W	18								29.0	33.0								62.0

POU Total Acres: 62.0

CONDITIONS OF APPROVAL

1. This right when combined with all other rights shall provide no more than 0.02 cfs per acre nor more than 4.5 afa per acre at the field headgate for irrigation of the place of use.
2. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
3. The original point of diversion under this right is in the SENW of Section 18, Township 01S, Range 01W. Transfer 81729 authorizes one additional point of diversion near the boundary between the SENW and the NESW of Section 18, Township 01S, Range 01W.
4. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code and applicable Well Construction Rules of the Department.

Transfer No. 81729

WATER RIGHT NO. 63-10403



As Modified by Transfer No. 81729

CONDITIONS OF APPROVAL

5. The period of use for the irrigation described in this approval may be extended to a beginning date of 3/1 provided that beneficial use of the water can be shown and other elements of the right are not exceeded. The use of water before 3/15 is subordinate to all water rights having no subordinated early irrigation use and a priority date earlier than 2/16/2007.
6. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.
7. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.
8. Pursuant to Section 42-1412(6), Idaho Code, this water right is subject to such general provisions necessary for the definition of the rights or for the efficient administration of water rights as determined by the Snake River Basin Adjudication court in the final unified decree entered 08/26/2014.

State of Idaho
Department of Water Resources
Attachment to Transfer No. 81729
Water Right(s): 63-10403

This map depicts the IRRIGATION place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.

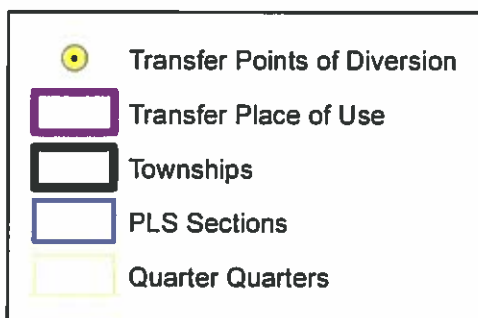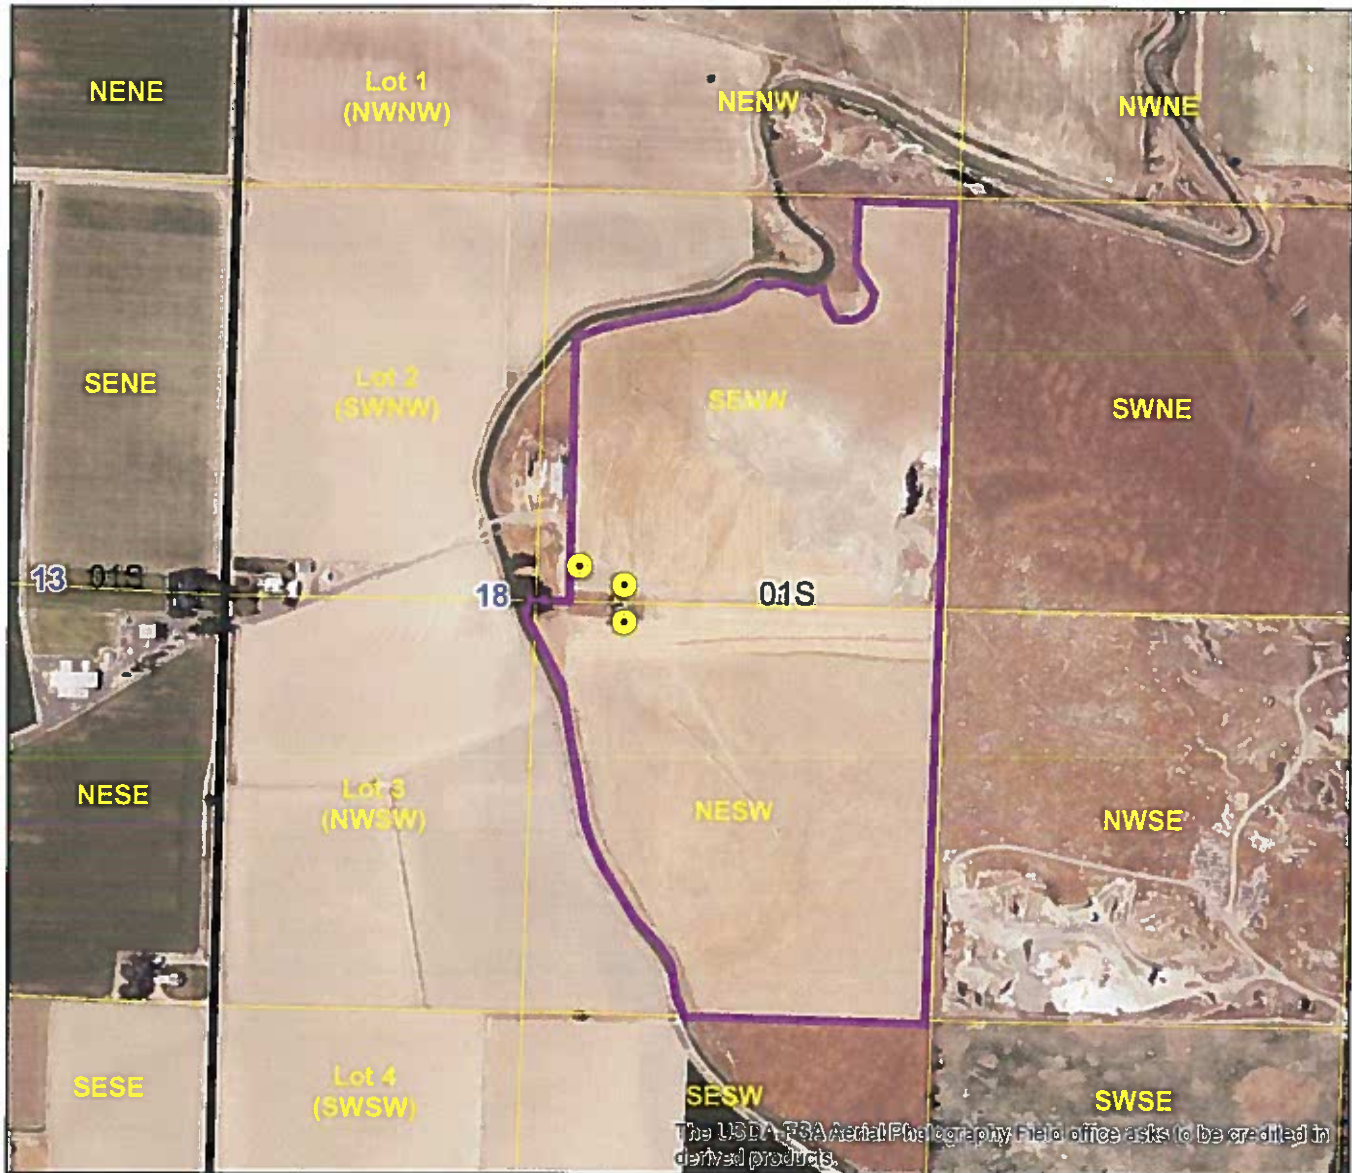

0 0.075 0.15 0.3 Miles



JUN 07 2017

APPLICATION FOR TRANSFER OF WATER RIGHT – POINT(S) OF DIVERSION

WATER RESOURCES
WESTERN REGION

This form may be used to apply to change and/or add points of diversion for existing water rights and to report an ownership change for a water right(s) in connection with the proposed point of diversion change(s). Do not use this form to apply for changes to other elements of a water right. See the [Application for Transfer Instructions](#) for help completing this form and for mailing addresses of Department offices where your application can be submitted.

Check all that apply:

- ☒ Change diversion point(s) ☒ Add diversion point(s) ☐ Ownership change ☐ Ownership split

1. APPLICANT(S) KELLY OR VICKY KRAMER Phone 208-495-2635-H
 2. MAILING ADDRESS 1286 SOUTHSIDE BLVD City MELBA
 State ID Zip 83641 Email _____

- ☐ If the applicant is not an individual and not registered to do business in the State of Idaho, attach documentation identifying officers authorized to sign for the applicant.
- ☐ If the applicant is not the current water right(s) owner, attach documentation of authority to file the application.
- ☐ If the application includes a change in ownership of water right(s), attach a copy of the conveyance document, such as a warranty deed, court decree, contract of sale, etc. The conveyance document must include a legal description of the property conveyed or description of the water right if no land is conveyed. Additional fee(s) are required for water right ownership changes; see Item 9 for the [fee schedule](#).

If the ownership change resulted in the water right(s) being split, how did the division occur? Mark one:

- ☐ The water rights or claims were divided as specifically identified in a deed, contract, or other conveyance document.
- ☐ The water rights or claims were divided proportionately based on the portion of their place(s) of use acquired by the new owner.

- ☐ If the application is not signed by the applicant, attach a Power of Attorney or other documentation providing authority to sign for the applicant.

3. LIST WATER RIGHT NUMBER(S) 63-10403

- ☒ Attach a copy of the water right(s) as recorded, available at www.idwr.idaho.gov, *Water Right Transfers, Step 1*, or by contacting any Department office.

4. TOTAL AMOUNT OF WATER transferred is 1.22 cubic feet per second and/or _____ acre-feet per annum.
 (diversion rate) (storage volume)

5. POINT OF DIVERSION – Describe all the point(s) of diversion to be included on the water right(s) after the proposed change.

- ☐ Attach Eastern Snake Plain Aquifer (ESPA) analysis if this transfer proposes to change a point of diversion affecting the ESPA. ESPA analysis information is available at www.idwr.idaho.gov, *Water Right Transfers, Online Resources*.

New?	Lot	¼	¼	¼	Sec	Twp	Rge	County	Source	Local name or tag #
N			SE	NW	18	01S	01W	ADA	GROUND WATER	ID 373796
Y			SE	NW	18	01S	01W	ADA	GROUND WATER	N/A
Y			NE	SW	18	01S	01W	ADA	GROUND WATER	N/A

6. GENERAL INFORMATION

- a. Describe the complete diversion system, including how you will accommodate a measuring device and lockable controlling works should they be required now or in the future:

PROPOSE TO USE EXISTING WELL IN SENW AND ONE MORE WELL EITHER LOCATED IN THE SENW OR NESW TO IRRIGATE 62 ACRES.

- b. Who owns the property at the point(s) of diversion? APPLICANTS

If other than the applicant, describe the arrangement enabling the applicant to access the property for the diversion system:

- c. To your knowledge, has/is any portion of the water right(s) proposed to be changed:

Yes No

- ☐ ☒ undergone a period of five or more consecutive years of non-use,
☐ ☒ currently used in a mitigation plan limiting the use of water under the right(s), or
☐ ☒ currently enrolled in a Federal set-aside program limiting the use of water under the right(s)?

If yes, describe:

- d. Is any portion of the water right(s) proposed to be changed currently leased to the Water Supply Bank? ☐ Yes ☒ No

- ☐ If yes and there are multiple owners, attach a Lessor Designation form.
☐ If yes, the individual owner or designated lessor must complete, sign and attach an IRS Form W-9.
(Disregard if these items are on file and ownership has not changed.)

7. **MAP** - ☒ Attach a map of the diversion, measurement, control and distribution system. Include the place of use if a split of the water right occurred. Clearly label the map with township, range, section and $\frac{1}{4}$ $\frac{1}{4}$ of section information. The Map Tool, available at maps.idwr.idaho.gov/TransferApplicationLayouts/ provides a satisfactory template for creating the required map.

8. **SIGNATURE** - The information in this application is true to the best of my knowledge. I understand any willful misrepresentations in this application may result in rejection of the application or cancellation of an approval.

Kelly Kramer
Signature of applicant or authorized agent

KELLY KRAMER
Print name and title if applicable

6-7-17
Date

Vicky Kramer
Signature of applicant or authorized agent

VICKY KRAMER
Print name and title if applicable

6-7-17
Date

9. **FEE** - ☐ The application filing fee provided in Section 42-221, Idaho Code, must be submitted with the application for transfer. The Application fee is based on the total amount of water proposed for transfer in Item 4: the larger fee for either cubic feet per second (diversion rate) or acre-feet per annum (storage volume). The Fee Schedule is available at www.idwr.idaho.gov, Water Right Transfers, Step 4 and in the Application for Transfer Instructions.

FOR DEPARTMENT USE ONLY

Transfer includes 3 pages of attachments.

Received by CS

Date 6/7/17

Fee paid \$580⁰⁰ Date 6/7/17

Received by CS

Receipt # W045358

Preliminary review by RS

Date 6-8-17


Active in the Water Supply Bank? Yes ☐ No ☒

W-9 received? Yes ☐ No ☒

Name on W-9 X

W-9 forwarded to fiscal? Yes ☐ No ☐

(Do NOT scan the W-9 – confidential information is held by fiscal only)

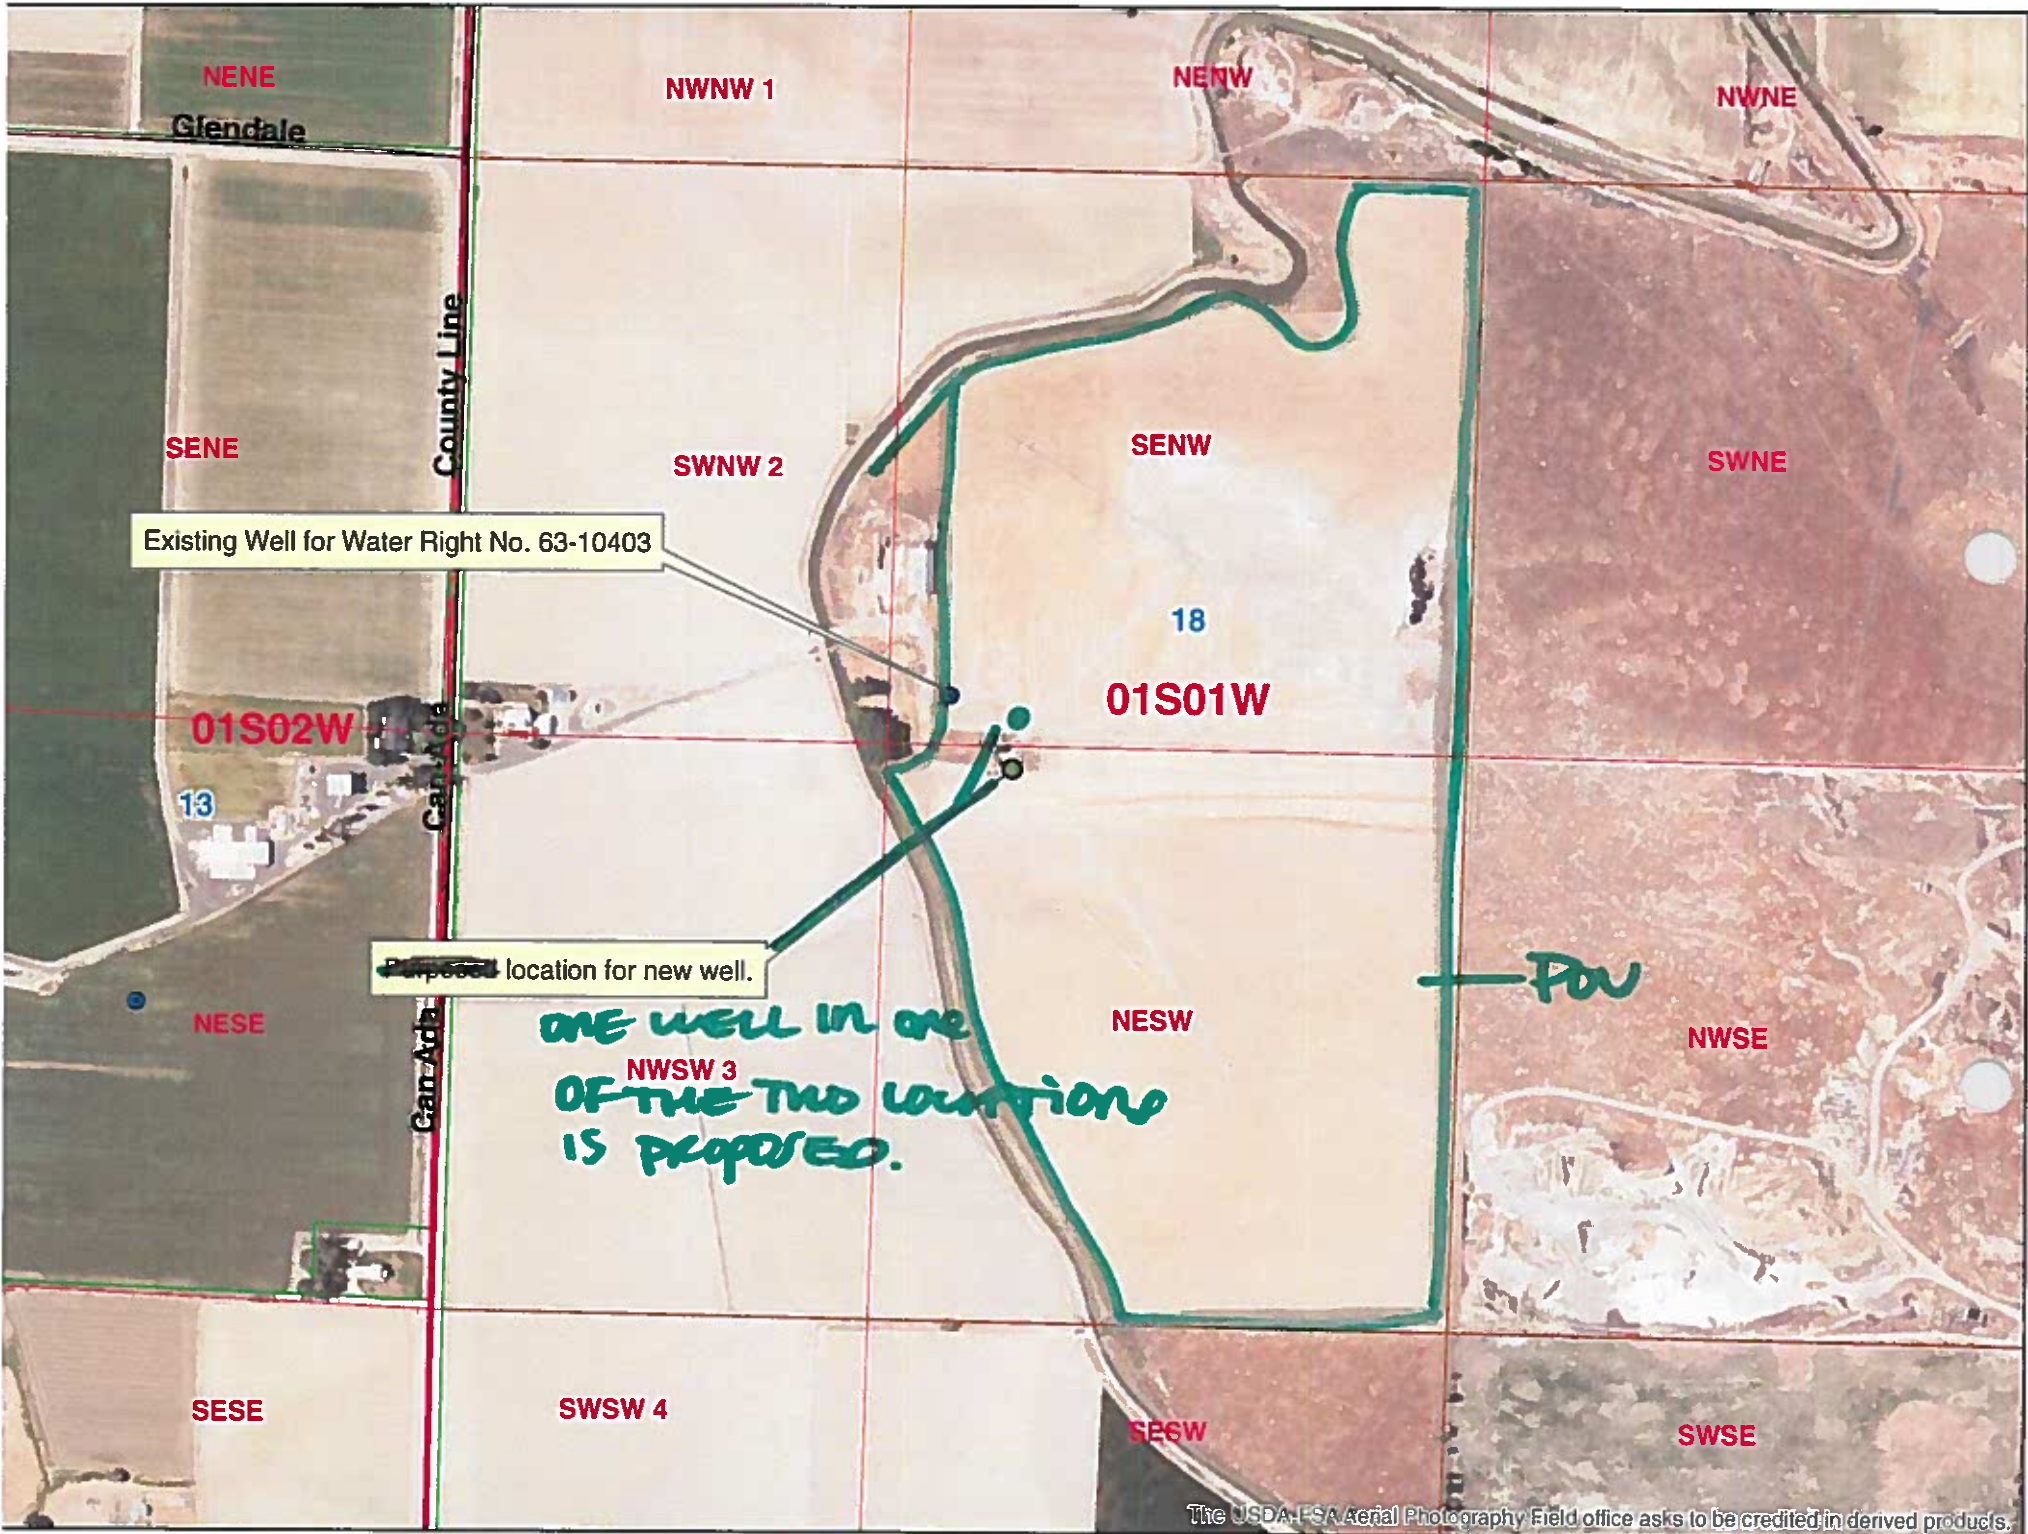

81729

6/7/2017

<u>Owner Type</u>	<u>Name and Address</u>
Current Owner	KELLY KRAMER 1288C SOUTHSIDE BLVD MELBA, ID 83641 (208)495-2635

81729

USE TYPEWRITER OR
BALL POINT PEN


State of Idaho
Department of Water Administration

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Administration within 30 days after the completion or abandonment of the well.

ID 373796

Received 30-73
6-30-73
D 9/11

1. WELL OWNER Name <u>Mark Hoagland</u> Address <u>Route 1 Melba</u> Owner's Permit No. _____		7. WATER LEVEL Static water level <u>150</u> feet below land surface Flowing? ☐ Yes ☒ No G.P.M. flow _____ Temperature _____ ° F. Quality _____ Artesian closed-in pressure _____ p.s.i. Controlled by ☐ Valve ☐ Cap ☐ Plug																																																																																																																																			
2. NATURE OF WORK ☒ New well ☐ Deepened ☐ Replacement ☐ Abandoned (describe method of abandoning) _____		8. WELL TEST DATA ☐ Pump ☐ Bailer ☒ Other Discharge G.P.M. <u>700</u> Draw Down <u>61'</u> Hours Pumped <u>14 hr.</u>																																																																																																																																			
3. PROPOSED USE ☐ Domestic ☒ Irrigation ☐ Test ☐ Municipal ☐ Industrial ☐ Stock		9. LITHOLOGIC LOG 34179																																																																																																																																			
4. METHOD DRILLED ☒ Cable ☐ Rotary ☐ Dug ☐ Other		<table border="1"><thead><tr><th rowspan="2">Hole Diam.</th><th colspan="2">Depth</th><th rowspan="2">Material</th><th colspan="2">Water</th></tr><tr><th>From</th><th>To</th><th>Yes</th><th>No</th></tr></thead><tbody><tr><td>24"</td><td>0</td><td>5</td><td>top soil</td><td></td><td>+</td></tr><tr><td>24"</td><td>5</td><td>10</td><td>hard pan</td><td></td><td>x</td></tr><tr><td>24"</td><td>10</td><td>15</td><td>sand</td><td></td><td>x</td></tr><tr><td>24"</td><td>15</td><td>20</td><td>sandy clay</td><td></td><td>x</td></tr><tr><td>16"</td><td>20</td><td>115</td><td>clay</td><td></td><td>x</td></tr><tr><td>16"</td><td>115</td><td>135</td><td>sand stone</td><td></td><td>x</td></tr><tr><td>16"</td><td>135</td><td>165</td><td>clay</td><td></td><td>+</td></tr><tr><td>16"</td><td>165</td><td>180</td><td>tight sand</td><td>+</td><td></td></tr><tr><td>16"</td><td>180</td><td>230</td><td>sand + clay layers</td><td>+</td><td></td></tr><tr><td>16"</td><td>230</td><td>245</td><td>limestone band</td><td>+</td><td></td></tr><tr><td>16"</td><td>245</td><td>255</td><td>tight sand (brown)</td><td>+</td><td></td></tr><tr><td>16"</td><td>255</td><td>270</td><td>clay</td><td></td><td>+</td></tr><tr><td>12"</td><td>270</td><td>290</td><td>blue clay</td><td></td><td>x</td></tr><tr><td>12"</td><td>290</td><td>305</td><td>tight sand (brown)</td><td>+</td><td></td></tr><tr><td>12"</td><td>305</td><td>308</td><td>blue clay</td><td></td><td>x</td></tr><tr><td>12"</td><td>308</td><td>326</td><td>sand (blue)</td><td>+</td><td></td></tr><tr><td>12"</td><td>326</td><td>330</td><td>blue sandy clay</td><td></td><td>+</td></tr><tr><td>12"</td><td>330</td><td>385</td><td>limestone sand</td><td>+</td><td></td></tr><tr><td>12"</td><td>385</td><td>390</td><td>blue sand stone</td><td>+</td><td></td></tr><tr><td>12"</td><td>390</td><td>400</td><td>blue clay</td><td></td><td>+</td></tr></tbody></table>		Hole Diam.	Depth		Material	Water		From	To	Yes	No	24"	0	5	top soil		+	24"	5	10	hard pan		x	24"	10	15	sand		x	24"	15	20	sandy clay		x	16"	20	115	clay		x	16"	115	135	sand stone		x	16"	135	165	clay		+	16"	165	180	tight sand	+		16"	180	230	sand + clay layers	+		16"	230	245	limestone band	+		16"	245	255	tight sand (brown)	+		16"	255	270	clay		+	12"	270	290	blue clay		x	12"	290	305	tight sand (brown)	+		12"	305	308	blue clay		x	12"	308	326	sand (blue)	+		12"	326	330	blue sandy clay		+	12"	330	385	limestone sand	+		12"	385	390	blue sand stone	+		12"	390	400	blue clay		+
Hole Diam.	Depth		Material		Water																																																																																																																																
	From	To		Yes	No																																																																																																																																
24"	0	5	top soil		+																																																																																																																																
24"	5	10	hard pan		x																																																																																																																																
24"	10	15	sand		x																																																																																																																																
24"	15	20	sandy clay		x																																																																																																																																
16"	20	115	clay		x																																																																																																																																
16"	115	135	sand stone		x																																																																																																																																
16"	135	165	clay		+																																																																																																																																
16"	165	180	tight sand	+																																																																																																																																	
16"	180	230	sand + clay layers	+																																																																																																																																	
16"	230	245	limestone band	+																																																																																																																																	
16"	245	255	tight sand (brown)	+																																																																																																																																	
16"	255	270	clay		+																																																																																																																																
12"	270	290	blue clay		x																																																																																																																																
12"	290	305	tight sand (brown)	+																																																																																																																																	
12"	305	308	blue clay		x																																																																																																																																
12"	308	326	sand (blue)	+																																																																																																																																	
12"	326	330	blue sandy clay		+																																																																																																																																
12"	330	385	limestone sand	+																																																																																																																																	
12"	385	390	blue sand stone	+																																																																																																																																	
12"	390	400	blue clay		+																																																																																																																																
5. WELL CONSTRUCTION Diameter of hole <u>20"</u> inches Total depth <u>400</u> feet Casing schedule: ☒ Steel ☐ Concrete Thickness <u>.250W</u> inches Diameter <u>12</u> inches From <u>172</u> feet To <u>326</u> feet <u>.250W</u> inches <u>20</u> inches <u>1 1/2</u> feet <u>20</u> feet _____ inches _____ inches _____ feet _____ feet _____ inches _____ inches _____ feet _____ feet _____ inches _____ inches _____ feet _____ feet Was a packer or seal used? ☐ Yes ☒ No Perforated? ☒ Yes ☐ No How perforated? ☒ Factory ☐ Knife ☐ Torch Size of perforation <u>3/16</u> inches by <u>3</u> inches Number <u>1580</u> From <u>169</u> feet To <u>315</u> feet _____ perforations _____ feet _____ feet _____ perforations _____ feet _____ feet _____ perforations _____ feet _____ feet Well screen installed? ☐ Yes ☒ No Manufacturer's name _____ Type _____ Model No. _____ Diameter _____ Slot size _____ Set from _____ feet to _____ feet Diameter _____ Slot size _____ Set from _____ feet to _____ feet Gravel packed? ☒ Yes ☐ No Size of gravel <u>5/8</u> - Placed from <u>0</u> feet to <u>315</u> feet Surface seal? ☒ Yes ☐ No To what depth <u>20</u> feet Material used in seal ☐ Cement grout ☒ Puddling clay		10. Work started <u>1-19-73</u> finished <u>2-8-73</u>																																																																																																																																			
6. LOCATION OF WELL Sketch map location must agree with written location.  County <u>Ada</u> <u>SE</u> 1/4 <u>NW</u> 1/4 Sec. <u>18</u> , T. <u>1</u> N/S, R. <u>1</u> E/W		11. DRILLER'S CERTIFICATION USGS This well was drilled under my supervision and this report is true to the best of my knowledge. <u>Bill Doty Well Drilling & Development 42</u> Driller's or firm's Name Number <u>Route 7 Caldwell</u> Address <u>Bill Doty</u> <u>6-13-73</u> Signed By Date																																																																																																																																			

USE ADDITIONAL SHEETS IF NECESSARY

FORWARD THE WHITE, BLUE, AND PINK COPIES TO THE DEPARTMENT

81729



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region • 2735 Airport Way • Boise, Idaho 83705-5082

Phone: (208) 334-2190 • Fax: (208) 334-2348 • Website: www.idwr.idaho.gov

C.L. "BUTCH" OTTER
Governor

GARY SPACKMAN
Director

June 28, 2017

KELLY KRAMER
VICKY KRAMER
1286 SOUTHSIDE BLVD
MELBA ID 83641

Re: Transfer No: 81729
Water Right No(s): 63-10403

Transfer Approval Notice

Dear Water Right Holder:

The Department of Water Resources has issued the enclosed approved Transfer of Water Right(s). Please be sure to thoroughly review the conditions of approval and remarks listed on the approval document.

The Transfer of Water Right(s) is a PRELIMINARY ORDER issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless the APPLICANT petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

ANY PERSON aggrieved by any decision, determination, order or action of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Department and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

If the transfer approval includes a condition requiring measuring and recording devices, such devices shall comply with specifications established by the Department. Detailed specifications are available on the Department's home page on the Internet, or you can request a copy by contacting any office of the Department. Please be sure to thoroughly review the specifications to avoid unnecessary costs for reinstallation or modification due to non-conforming or improperly installed devices.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at (208) 334-2190.

Sincerely,

 Rachel Neely for:

Nick Miller
Regional Manager

Enclosure

CERTIFICATE OF SERVICE

I hereby certify that on June 28, 2017 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved Transfer) to the person(s) listed below:

Re: Transfer No.: 81729
Water Right No(s): 63-10403

KELLY KRAMER
VICKY KRAMER
1286 SOUTHSIDE BLVD
MELBA ID 83641



Rachel Neely
Administrative Assistant

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was not held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its service date if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) The petition for reconsideration is disposed of; or
- (b) The petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held.
- ii. The final agency action was taken.
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MEMORANDUM

TO: Transfer No. 81729
FROM: Rachel Sommer
DATE: June 22, 2017
RE: Evaluation of Application

Summary of Application Proposal

Kelly and Vicky Kramer submitted a transfer proposing to add a second point of diversion to right 63-10403 because the existing well will not produce enough water to fulfill the right (see letter dated 6/22/17). The new well location borders the SENW and NESW boundary, therefore, the application proposes one well in either quarter-quarter.

Location of Application Proposal

The proposal is located west of S Robinson BLVD, east of S Can Ada Rd / County Line Rd, and n of W Warren Spur Rd in Melba Id.

Summary of Information Submitted

Authority to File:

The department's records reflect the ownership of right 63-10403 in the name of Kelly and Vicky Kramer.

Water Right Validity/ Historical Beneficial Use:

Water Right 63-10403 has a priority date of 12/7/1970 and was decreed on 2/16/2007. On May 15, 2012 IDWR approved an extension of time to avoid forfeiture of the right and on June 7, 2017 Kramer submitted a Resumption of Beneficial Use. The right is considered valid because the transfer was filed prior to the resumption of use due date of 7/1/2017.

Water Supply Bank:

No portions of the right within this transfer are leased to the Water Supply Bank.

Overlapping POU/POD:

None.

Associated Rights:

None.

Injury to Other Water Rights:

There should be no injury to other water rights under this transfer as long as the new right holder abides by the amount of water that is authorized under this right.

Enlargement of Use:

Adding an additional well should help the right holders accomplish full appropriation of the water right; new irrigation water is not being sought. No enlargement should occur under the proposed transfer application.

Local Public Interest:

It is within the local public interest to allow property owners to develop their property as long as the application is processed without issues.

Beneficial Use/Conservation of Water Resources:

The application proposes beneficial use consistent with conservation of water resources in Idaho.

Legal Notice:

Pursuant to Section 42-222, Idaho Code, the Department has discretion to provide public notice as deemed appropriate. The water right changes proposed through this transfer application do not appear to change the effect on the original or hydraulically connected water source or affect other water rights. Therefore, staff review of the transfer application found no cause to require public notice. This application will continue processing without advertisement and be forwarded for approval consideration.

Summary of Application Approval / Denial

Because the existing well on the Kramer's property can and does produce water towards the irrigation of this right, we can/should approve the transfer to add an additional POD so that the applicants may accomplish full appropriation of the water right.

The application is consistent with criteria of I. C. § 42-222 and should be processed. Assuming protests are not filed and/or other information does not contradict the above analysis, the application can be approved as reflected by the draft approval.

RECEIVED

JUN 22 2017

WATER RESOURCES
WESTERN REGION

June 22, 2017

To Whom It May Concern:

Water right # 63-10403 will produce enough water to operate one small three tower pivot but not two.

Regards,

Kelly Kramer
Kelly Kramer

6-22-17
Date