



RECEIVED

MAR 14 2017

DEPARTMENT OF
WATER RESOURCES

March 8, 2017

CERTIFIED MAIL # 7012 2210 0000 6048 9763

Mr. Jeff Peppersack
Bureau Chief, Water Allocations
Idaho Department of Water Resources
P.O. Box 83720
Boise, Idaho 83720-0098

RE: Water Right Permit 63-31183 Annual Report – 2016
Micron Technology, Inc. – Boise Site

Dear Mr. Peppersack,

To fulfill the annual report requirements of Condition 9 of Water Right Permit 63-31183, Micron Technology, Inc. (MTI) is submitting (1) a chart that depicts monthly recharge volumes, monthly diversion volumes, and local area water-level hydrographs and (2) a chart that depicts net annual diversion volumes (i.e., MTI diversions minus recharge) and local area water-level hydrographs. The period for the charts is 2002 through 2016, which corresponds to the development period for Water Right Permit 63-31183.


The charts indicate continued stabilization and improvement in the deep aquifer water level as a result of Micron's efforts to reduce net diversions. If you have any questions regarding this submittal, please contact Laura Nielsen at (208) 368-2603.

Sincerely,


A handwritten signature in black ink that reads "Ann Dickey". The signature is written in a cursive, flowing style.

Ann Dickey
Environmental Compliance Manager
Micron Technology, Inc.

Micron Technology, Inc. Hydrograph (1)
2016 Annual Report (Water Right Permit 63-31183)

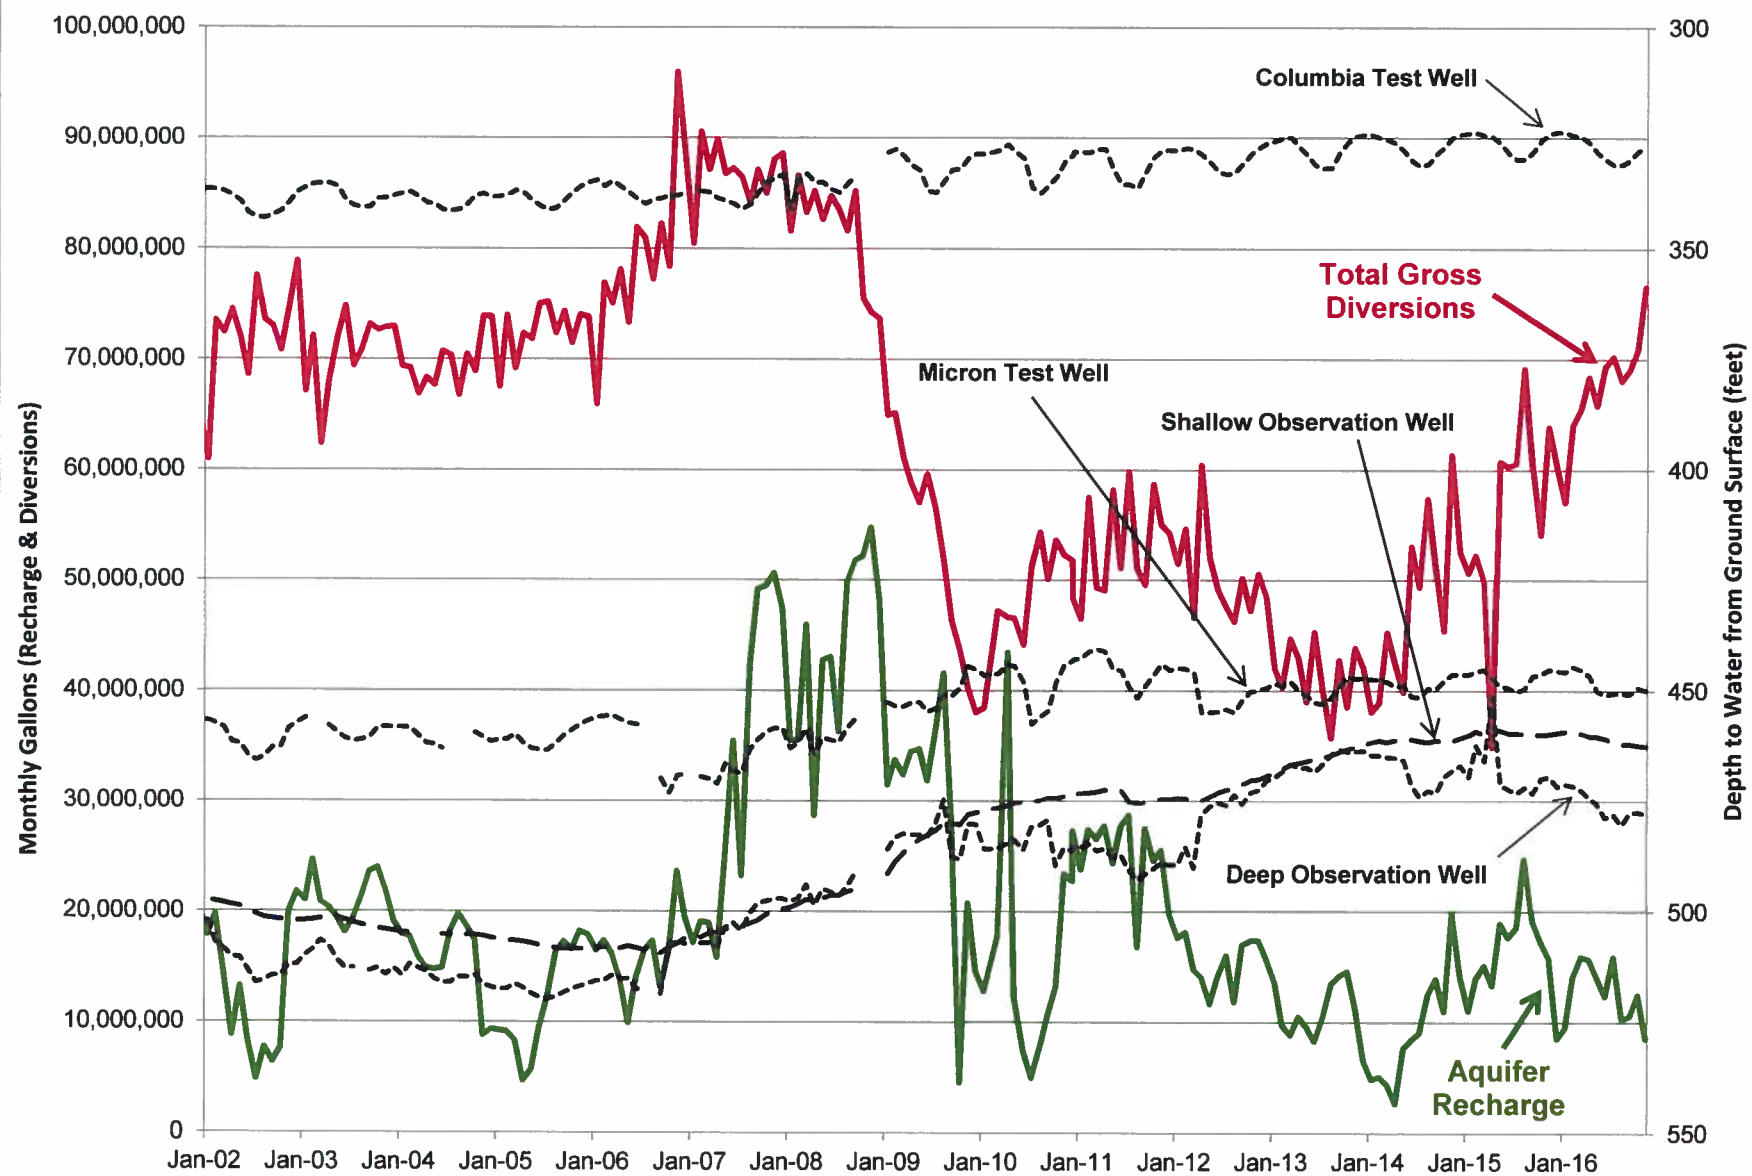

Micron Technology, Inc. Hydrograph (2)
2016 Annual Report (Water Right Permit 63-31183)

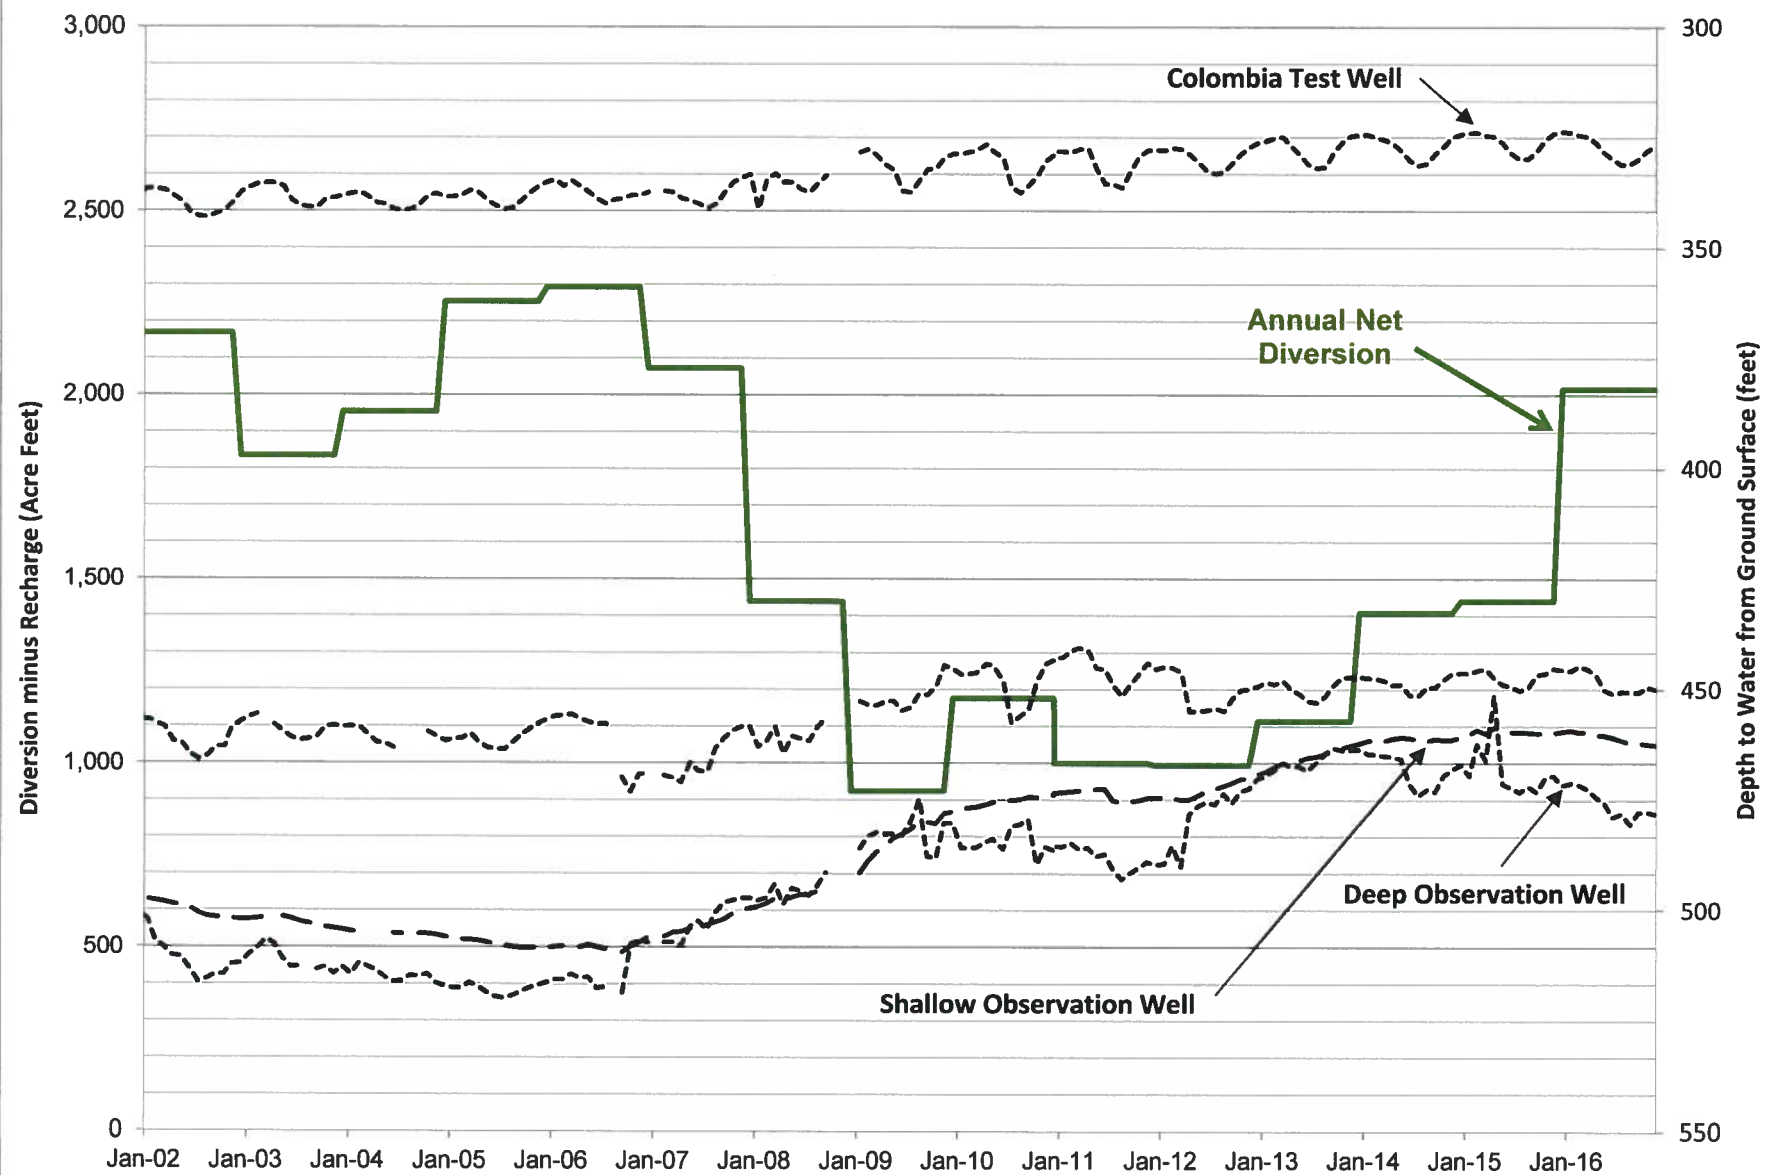

**Micron Technology, Inc. Hydrograph Notes
2016 Annual Report (Water Right Permit 63-31183)**

Description	Date
Started recharging	3/01
Started Well 6	11/06
Started Stage 200 Ultrafiltration skid	6/07
Started Fab 1 shutdown activities	11/08
Shutdown Well 3	2/09
Shutdown Well 6	10/09
Halted recharge for repairs to injection well control valve	10/23/09 – 11/24/09
Shutdown Stage 200 Ultrafiltration skid to replace feed water control valve positioners	2/19/10 – 3/24/10
Shutdown Stage 200 Ultrafiltration skid to replace modules due to fiber breakage	4/23/10 – 10/27/10
Temporarily restarted Well 6	7/23/10 – 10/20/10
Well 3 and 6 off for the entire year.(Well 6 ran for 2.25 hrs on 5/3/2011)	5/3/2011
Well 3 started to meet increased demand	4/24/2012
Well 3 shut down due to declining pump output.	5/21/2012
Started Well 6 5/23/12 to meet increased demand	5/23/2012
Well 4 off for repair (replaced casing and pump)	5/8/2015 – 6/7/2015