

RECEIVED

JUL 01 2015

WATER RESOURCES
WESTERN REGION

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT
To appropriate the public waters of the State of Idaho

Ident. No. 65-23618

1. Name of applicant(s) Shawn Moss and Trina Moss Phone 559-706-3785
 Name connector (check one): ☒ and ☐ or ☐ and/or
 Mailing address P.O. Box 434 City McCall
 State ID Zip 83638 Email thefarmerandwife@aol.com

2. Source of water supply ground water which is a tributary of Lake Fork Creek

3. Location of point(s) of diversion:

TWP	RGE	SEC	Govt Lot	1/4	1/4	1/4	County	Source	Local name or tag #
17N	3E	14			SW	SW	Valley	ground water	

4. Water will be used for the following purposes:

Amount 12 acre feet for aesthetic storage purposes from 1/1 to 12/31 (both dates inclusive)
 (cfs or acre-feet per year)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per year)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per year)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per year)

5. Total quantity to be appropriated is (a) _____ cubic feet per second (cfs) and/or (b) 12 acre feet per year (af).

6. Proposed diverting works:

a. Describe type and size of devices used to divert water from the source. excavated pond with a capacity of 10 acre feet, surface area of approximately 1 acre and maximum depth of 20 feet

b. Height of storage dam 0 feet; active reservoir capacity 0 acre-feet; total reservoir capacity 10 acre-feet. If the reservoir will be filled more than once each year, describe the refill plan in item 11. For dams 10 feet or more in height OR reservoirs with a total storage capacity of 50 acre-feet or more, submit a separate Application for Construction or Enlargement of a New or Existing Dam. Application required? ☐ Yes ☒ No

c. Proposed well diameter is _____ inches; proposed depth of well is _____ feet.

d. Is ground water with a temperature of greater than 85°F being sought? ☐ Yes ☒ No

e. If well is already drilled, when? _____; drilling firm _____; well was drilled for (well owner) _____; Drilling Permit No. _____.

7. Description of proposed uses (if irrigation only, go to item 8):

a. Hydropower; show total feet of head and proposed capacity in kW. _____

b. Stockwatering; list number and kind of livestock. _____

c. Municipal; complete and attach the Municipal Water Right Application Checklist.

d. Domestic; show number of households _____

e. Other; describe fully. Aesthetic storage pond

8. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below.
See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
17N	3E	14											J						

Total number of acres to be irrigated: _____

9. Describe any other water rights used for the same purposes as described above. Include water delivered by a municipality, canal company, or irrigation district. If this application is for domestic purposes, do you intend to use this water, water from another source, or both, to irrigate your lawn, garden, and/or landscaping?

none


10. a. Who owns the property at the point of diversion? _____ applicants
- b. Who owns the land to be irrigated or place of use? _____ applicants
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing:

11. Describe your proposal in narrative form, and provide additional explanation for any of the items above. Attach additional pages if necessary.


A pond with a surface area of approximately 1 acre will be created by excavating below the water table to a maximum depth of 20 feet. Estimated pond volume will be 10 acre feet. Mitigation for impacts to Lake Fork Creek will be accomplished through non use of 12 acre feet (includes 2 af evaporation) of right 65-2932B, as described on the attached mitigation plan. The pond will be used for 24-hour irrigation storage of irrigation water rights 65-22967 and 65-22969. Irrigation from the pond will not occur when these irrigation rights are not in priority and being delivered.

12. Time required for completion of works and application of water to proposed beneficial use is 5 years (minimum 1 year).
13. **MAP OF PROPOSED PROJECT REQUIRED** - Attach an 8½" x 11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.

The information contained in this application is true to the best of my knowledge. I understand that any willful misrepresentations made in this application may result in rejection of the application or cancellation of an approval.

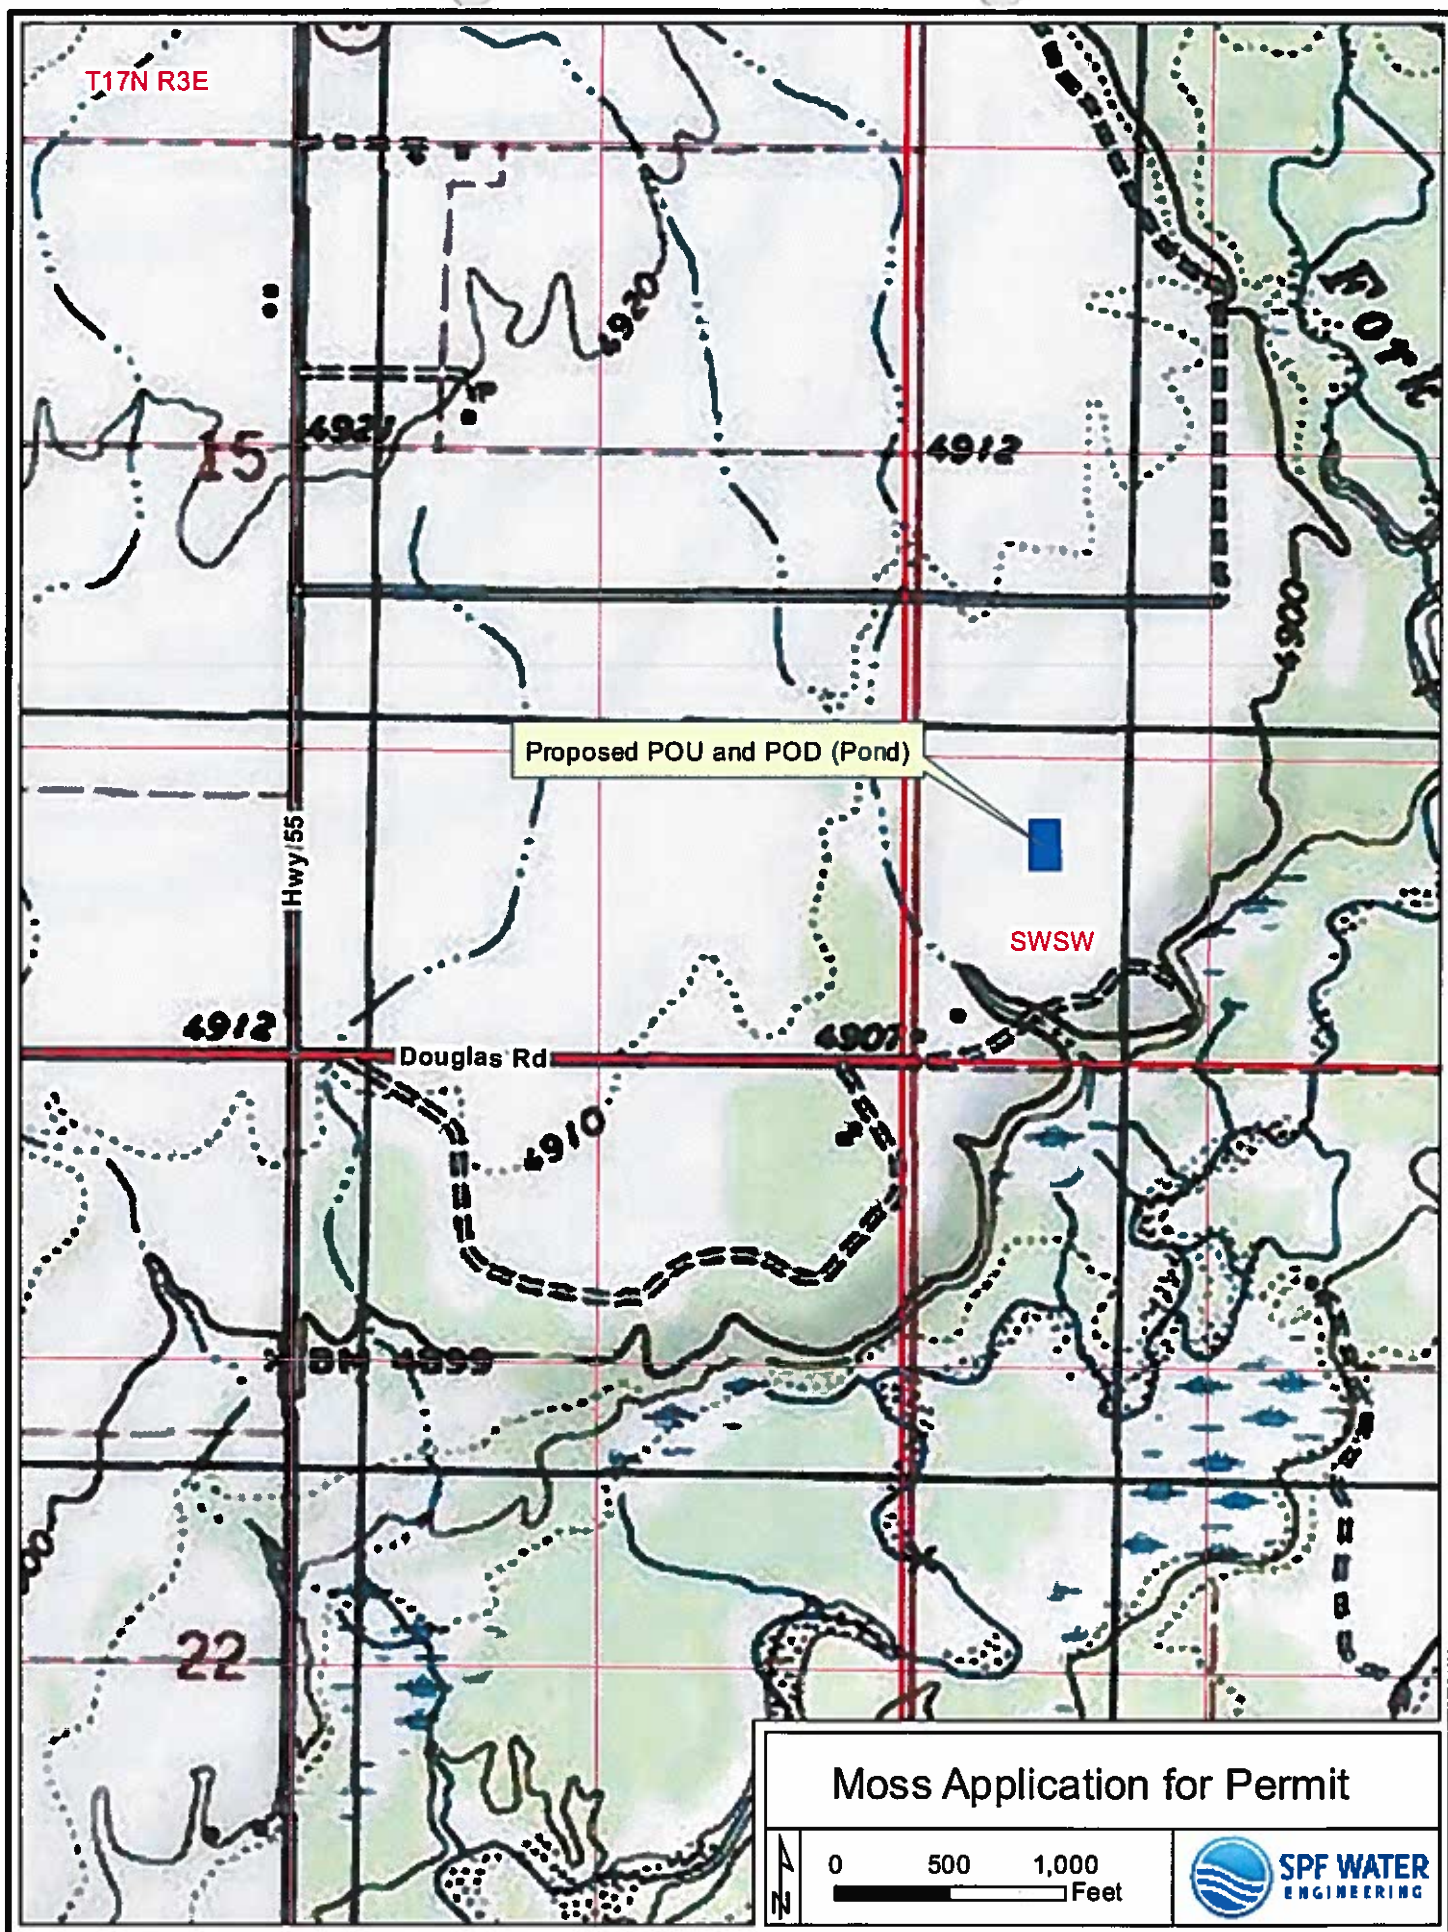

Signature of Applicant

Trina Moss
Print Name (and title, if applicable)

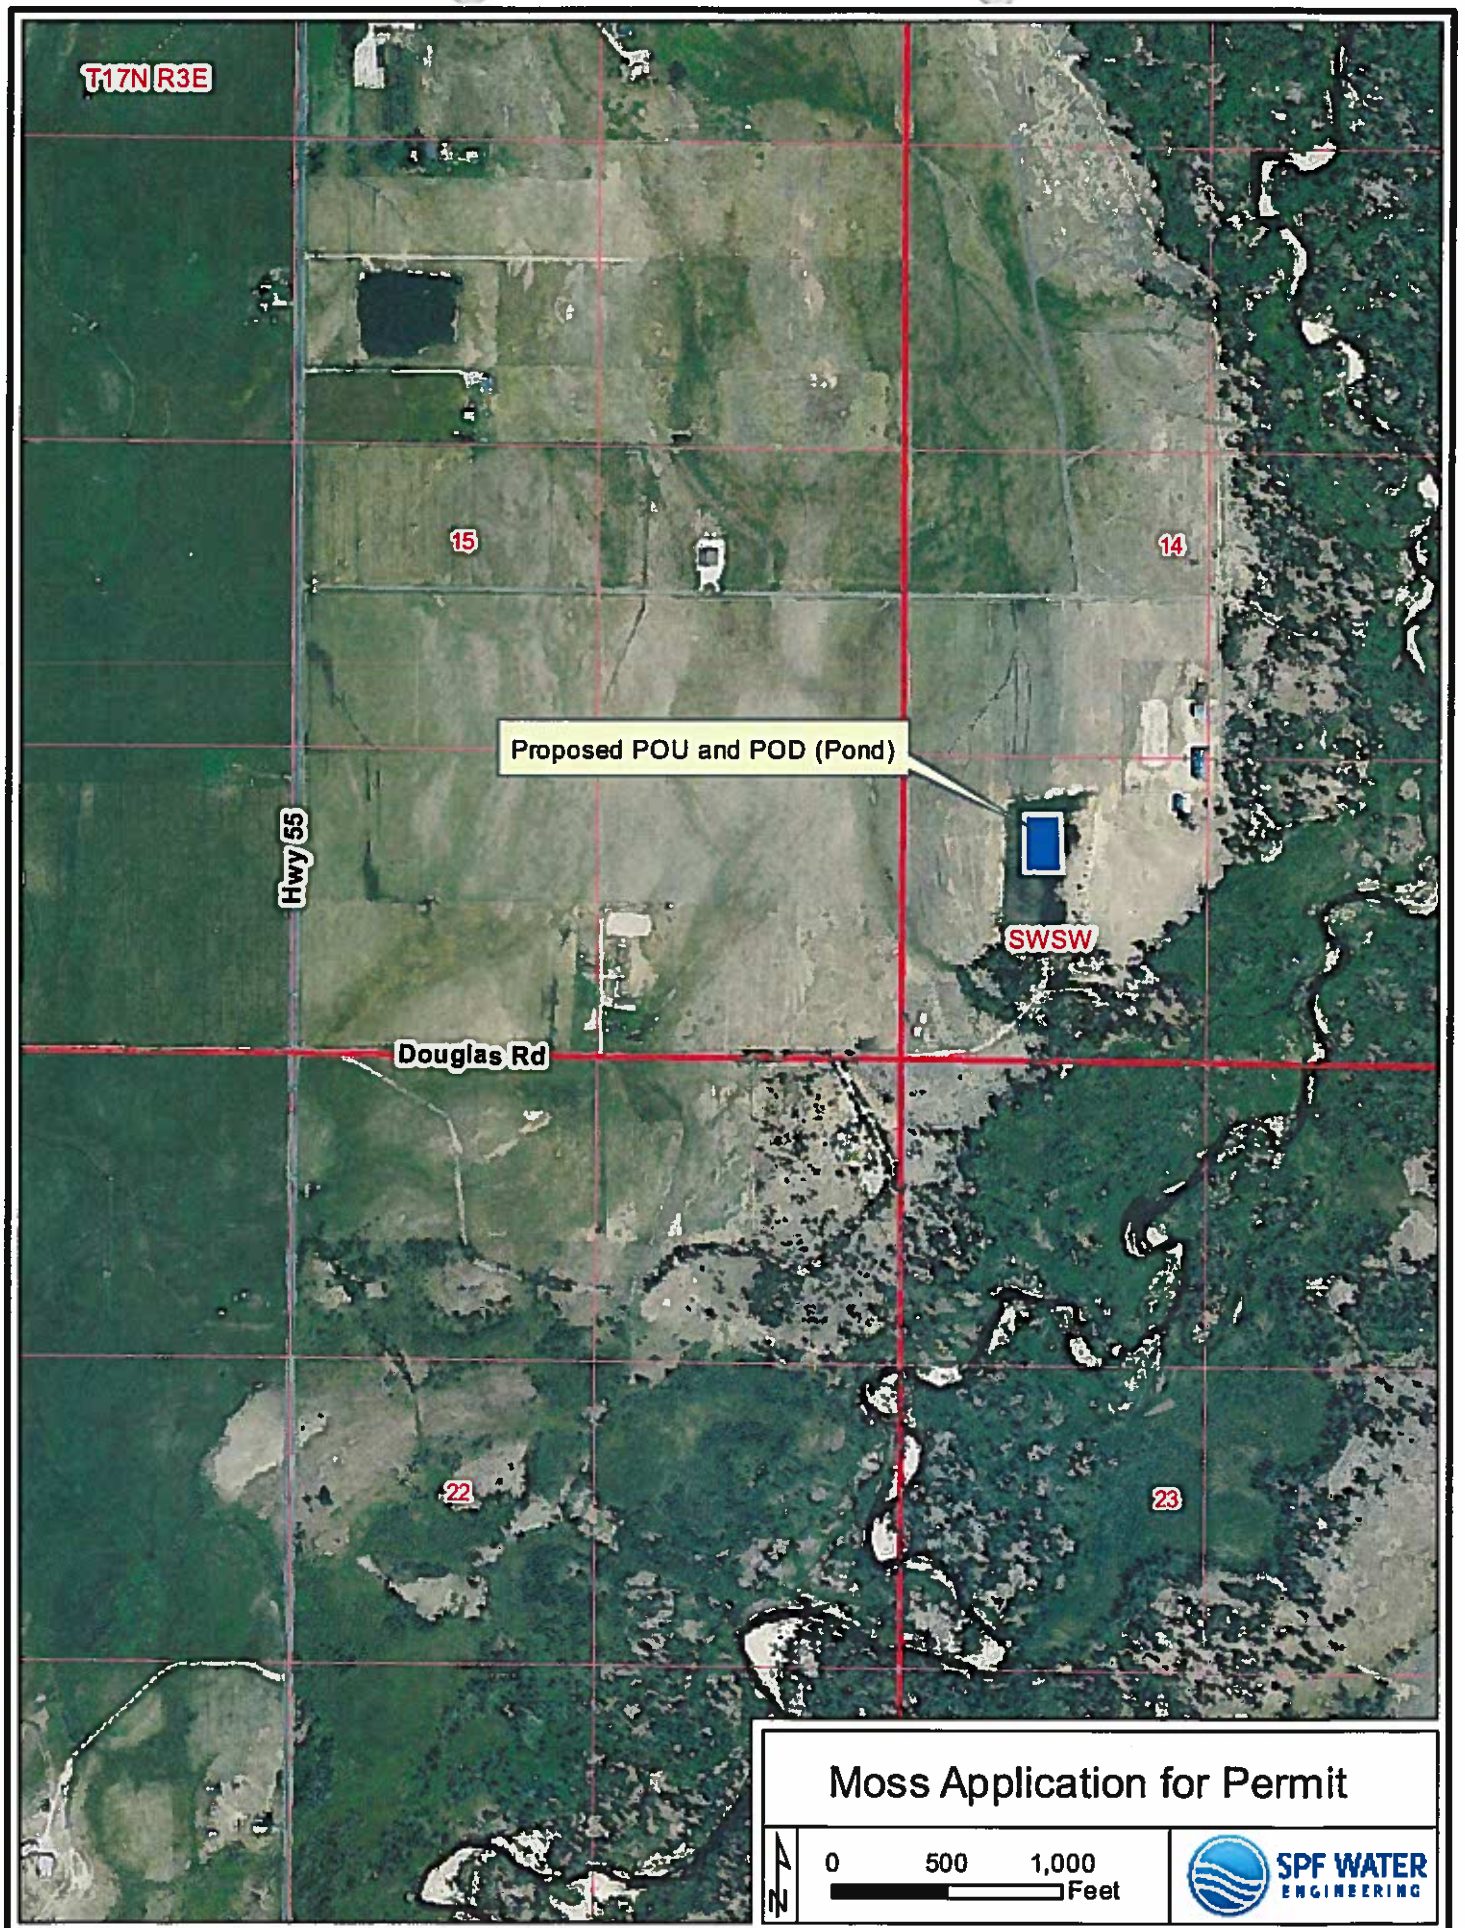

Signature of Applicant

Shawn Moss
Print Name (and title, if applicable)

Received by  Date 7/1/15 Time 1:45 Preliminary check by PK
Fee \$ 100⁰⁰ Received by  Receipt No. W043243 Date 7/1/15



65-23618



PROPOSED MITIGATION PLAN FOR WATER RIGHT APPLICATION

To the Idaho Department of Water Resources (IDWR):

Shawn Moss and Trina Moss agree to permanently retire 12 acre feet authorized for storage under Water Right No. 65-2932B to mitigate use of water proposed by application for permit 65- 23618.


Shawn Moss and Trina Moss agree to this mitigation plan as follows:

1. The 12 acre feet of storage will no longer be stored at Browns Pond, the authorized place of use for 65-2932B. A reduction of 12 acre feet of storage at Browns Pond will offset depletions to stream flows within the Lake Fork Creek drainage basin that may occur as a result of permit 65- 23618.
2. Shawn Moss and Trina Moss will purchase the 12 acre feet of storage water right from Diane DeBoer. A change of ownership for the 12 acre feet of water right will be submitted to IDWR following the application protest period, but prior to permit approval. The 12 acre feet of water right 65-2932B will be formally abandoned as a condition of permit approval.

Signature:


Shawn Moss

Signature:


Trina Moss

Date:

6-18-15

65-23618

Seepage Loss Calculations

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the total annual seepage losses from a pond.

FILE NUMBER	XX-XXXXX
REVIEWER	
DATE	5/23/2015

User Input
Calculated value
Formula Explanations

INPUTS

Pond Surface Area (AC.)	1	AC.
-------------------------	---	-----

Pond Surface Area (SQ. FT.)	43560	SQ. FT.
-----------------------------	-------	---------

I used the following method to obtain my Soil Classification Information:	NRCS Web Soil Survey	
My Soil Classification is	GP	
Suggested Seepage Rate (FT./DAY)	0.0000	FT./DAY

Formula: (Surface Area X Seepage Rate) X 7.48 = Gallons Per Day Loss
--

Convert to GPD	0	GPD
----------------	---	-----

Total Seepage Loss (AFA)	0.0	AFA
--------------------------	-----	-----

Though sand and gravel seepage rates may actually be higher, the maximum allowable rate is 0.2 ft/day, pursuant to Administrative Memo "Seepage Loss Standards for Ponds and Reservoirs."

Suggested Seepage Rates for Different Soil Types:
GW, GP, GM, GC, SW, SP and SM (silty sand, sand silt mixtures and gravel mixtures) = 0.2 ft per day
OL and ML (Inorganic silts - very fine sands, silty, or clayey fine sands) = 0.02 ft per day
SC (clayey sands, sand clay mixtures) = 0.007 ft per day
CL (Low to medium plasticity clays) = 0.003 ft per day
MH, OH, PT and CH (high plasticity clays) = 0.0003 ft per day
LINED PONDS (liners can be chemical, fabric, or bentonite) = 0 ft per day
Ponds Intercepting Groundwater (excavated ponds filled by ground water) = 0 ft per day

PLEASE NOTE: The initial basis for the Suggested Seepage Rates in the table above is found on Page 16 of Seepage from Fish Ponds, Bulletin 599, August 1989 Alabama Agricultural Experiment Station, Auburn University, Auburn University Alabama. If you don't know the soil type, please refer to the map provided at the NRCS Web Soil Survey (Tab #1), an ArcMap Soil Classification Map (Tab #1.1), or published NRCS Soil Survey (Tab #1.2). Use "0" if the pond fill relies on the water table.

65-23618

Evaporation Loss Calculations

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the annual evaporation losses from a pond.

FILE NUMBER	xx-xxxxx
REVIEWER	
DATE	5/23/2015

User Input
Calculated value
Formula Explanations

The acronyms used on the Kimberly Research Center website are defined below:

P = Precipitation
ET= Evapotranspiration
P _d = Precipitation deficit
P _d =ET-P

USING THIS SPREADSHEET

Use the link below to access the Kimberly Research Center website. This website provides the Precipitation Deficit for a station most representative of the pond under examination. The Precipitation Deficit is the total amount of free water surface evaporation minus the precipitation for a given area, which gives the total amount of evaporative losses incurred by the pond. There are several weather sites that are used throughout the state. IDWR staff can find the nearest site using Arc Map. The shape file containing the sites can be found at X:/Spatial/Climate/ETIdahostations.shp.

Instructions:

1. Use the link below to navigate to ET Idaho 2012.
2. Select the station which is most representative to your pond location.
3. Click Submit Query.
4. Under "Land Covers with Evapotranspiration Estimates," select "Open Water - Shallow Systems (ponds, streams)" or "Open Water - small stock ponds" depending on the pond size.
5. Click the link to "Precipitation Deficit."
6. Reference and copy (ctrl + C) the first subheading "Mean" values.
7. Click the "Paste Values from ET Idaho" button. The table will automatically enter a zero (0) for any negative precipitation deficit values.

Found at: <http://data.kimberly.uidaho.edu/ETIdaho/>

Precipitation Deficit

Station: McCall

Month	mm/day ¹	Days per month	mm/Month
Jan	-1.98	31	0.00
Feb	-1.57	28	0.00
March	-0.90	31	0.00
April	0.39	30	11.70
May	0.88	31	27.28
June	1.82	30	54.60
July	3.44	31	106.64
August	2.88	31	89.28
September	1.49	30	44.70
October	0.20	31	6.20
November	-2.07	30	0.00
December	-2.53	31	0.00

PLEASE NOTE: The seasonal average for precipitation deficit should not be used for calculations because precipitation often exceeds evaporation during wetter months of the year. If the pond is kept full, excess precipitation during wetter months does not serve to refill the pond during drier months.

For example, see Sandpoint KSPT (NWS -- 108137), the annual precipitation deficit is -106 mm. However, April through September have positive precipitation deficit values. To properly estimate the annual volume of water necessary to refill a pond due to evaporation losses, the table will automatically enter a zero (0) for each month that the precipitation value is reported as a negative value.

As described above, precipitation offsets evaporation in winter months, so the net effect is that wintertime precipitation deficit is usually zero.

Total mm/year = 340.40

$$[(\text{mm/yr}) \div (\text{convert to feet})] \times (\text{Surface area of pond, in acres}) = \text{Evaporation Loss in Acre Feet}$$

$$(\text{340.40}) \div (\text{304.8}) \times (\text{1.00}) = (\text{1.1 AFA})$$

65-23618

Total Storage Calculations

FILE NUMBER	XX-XXXXX
REVIEWER	
DATE	5/23/2015

This spreadsheet has been designed by Idaho Department of Water Resources to estimate the total seepage, evaporation and fill capacity required for a pond.

User Input
Calculated value
Formula Explanations

Surface Area (AC.)	1	"Surface Area" is automatically carried over from the "Seepage Loss" sheet.
Average Pond Depth (FT.)	10	"Average Pond Depth" depicts the actual depth of the pond either measured or estimated. Note: If you know the maximum depth and not the average depth, the Field Examiner's Handbook suggests multiplying the maximum depth by 0.4 to get the average depth, or you can use any method that seems reasonable to attain average depth.
Pond Capacity (AF)	10	Pond Capacity is calculated by multiplying the Pond Surface Area by the Average Pond Depth. If you know the capacity, divide the capacity by surface area and enter the average pond depth in the space above. Note: If pond capacity is determined using a method shown on the "Pond Capacity" sheet, the user may need to modify the value of "Pond Capacity" (cell B9) manually. Note that if the value is modified manually, the formula will be altered for future use.
Multiple Fill Volume Above Initial Fill to Fulfill From Storage Needs- "Multiple Fills" (AF)	0	The "Multiple Fill Volume Above Initial Fill" is the acre-feet of water required to meet a <i>from storage</i> component if the <i>from storage</i> component exceeds a one time fill. This section should not include the amount of water needed to fill the pond initially or the amount of water needed to maintain the pond level due to evaporation or seepage. For example: If a pond has a capacity of 5 acre feet and 2.5 acre feet of seepage and evaporation, but the pond is used for irrigation that requires 10 acre feet of from storage for the irrigation use, then you would insert 5 acre feet into this location (10 acre feet needed - 5 acre feet from the initial fill = 5 acre feet of additional storage needed). Note: You must have a "From Storage" component exceeding the initial fill on the permit to include a volume in this space.
Estimated Seepage Loss (AF)	0.0	The "Estimated Seepage Loss" is automatically carried over from the "Seepage Loss" sheet.
Estimated Evaporation Loss (AF)	1.1	The "Estimated Evaporation Loss" is automatically carried over from the "Evaporation Loss" sheet.
Total Volume Required (AF)	11.1	The "Total Volume Required" is calculated by adding the Pond Capacity, Multiple Fills, Seepage Loss, and Evaporation Loss amounts to determine the total amount of storage required.

65-23618

Flow Rate into Pond (CFS)	0.10	The "Flow Rate into Pond" depicts the actual flow, either measured or estimated, into the pond. For offstream facilities, this will be equivalent to "diversion to storage" rate.
Highest Daily Evaporation Rate From Evaporation Tab. (mm/Day)	3.44	This number is carried over from the "Evaporation Loss" sheet. It is the highest recorded number in the "Precipitation Deficit Table".
Required Daily Maintenance Volume (AF/Day)	0.01	"Required Daily Maintenance Volume" is the maximum volume of water needed on any given day during the year to maintain pond volume. It is calculated by adding the highest daily evaporation loss to the average daily seepage loss in acre feet. The average daily seepage loss is calculated by dividing the "Estimated Seepage Loss" by 365 days. This is acceptable, since the seepage rate shouldn't vary throughout the season unless the pond completely freezes over during the winter months. The highest daily evaporation loss is calculated by dividing the Highest Daily Evaporation Rate by the 304.8 conversion factor and multiplying this number by the pond surface area to attain a combined daily acre feet requirement.
Minimum Maintenance Flow (CFS)	0.01	The "Minimum Maintenance Flow" is the minimum amount of flow required to maintain the level of the pond. This number is determined by dividing the "Maximum Required Daily Maintenance Volume" by 1.9835. This flow can be used to determine if the flow rate into the pond is adequate to maintain the pond level.
Days Required to Fill the Pond	53	The "Days Required to Fill the Pond" is calculated by dividing the "Pond Capacity" by the "Flow Rate" minus "Minimum Maintenance Flow" multiplied by 1.9835. This section will assist you in determining if the flow rate being diverted to the pond is adequate to fill the pond while maintaining the pond level. The length of time to fill the pond will help determine if the flow rate is adequate for the size of pond being proposed. If this number is approximately 6 months (180 days) or more, the reviewer should have a discussion with the applicant to make sure he/she understands that it will take a significant length of time to fill the pond.
Days Required to Fill the Pond at 13,000 Gallons per Day	350	Some water users may want to fill a pond under the 13,000 gallons per day domestic exemption. The "Days Required to Fill the Pond at 13,000 Gallons per Day" is calculated by converting the "Pond Capacity" and the "Required Daily Maintenance Volume" to gallons. The "Pond Capacity" is then divided by 13,000 gallons minus the "Required Daily Maintenance Volume" in gallons to determine the number of days to fill pond. If this number is approximately 6 months (180 days) or more, the reviewer should have a discussion with the applicant to make sure he/she understands that it will take a significant length of time to fill the pond. Negative values indicate that the supply of 13,000 gallons per day is not enough volume to overcome the required daily maintenance volume; the pond will never fill.

Neely, Rachel

From: Neely, Rachel
Sent: Wednesday, September 23, 2015 4:10 PM
To: 'The Star-News'
Subject: Valley Legal Ad
Attachments: Valley Cover Letter.docx; Valley Legal Ad.docx

Good Afternoon Legal Clerk,

Please see the attached ads for publication on 10/1/15 & 10/8/15.

Please confirm these are okay to publish as shown.

Thank you,

Rachel Neely

Administrative Assistant I
IDWR-Western Region
2735 Airport Way Boise, ID 83705
Rachel.Neely@idwr.idaho.gov

September 23, 2015

LEGAL NOTICE DEPARTMENT
STAR NEWS
1000 1ST ST
MC CALL, ID 83638

RE: Application for Permit No. 77-14342
 Application for Permit No. 65-23614
 Application for Permit No. 65-23618

Dear Legal Notice Department:

Please publish the enclosed legal notices on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notices on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 10/19/2015. Your cooperation is appreciated.

Sincerely,

Rachel Neely
Administrative Assistant

Enclosure(s)

The following applications have been filed to appropriate the public waters of the State of Idaho:

77-14342

DARREN K VAUGHN

JENNIFER VAUGHN

PO BOX 190694

BOISE, ID 83719

Point of Diversion NESW S2 T20N R09E VALLEY County Source LICK CREEK Tributary BIG CREEK

Use: DOMESTIC 01/01 to 12/31 0.04 CFS

Total Diversion: 0.04 CFS

Date Filed: 11/22/2010

Place of Use: DOMESTIC

T20N R09E S2 L5(NENW)

This application proposes the diversion and use of water tributary to a federally designated Wild & Scenic River. The decreed minimum stream flow rights for the federal Wild & Scenic Rivers are subordinate to certain categories of water use and to specific amounts of water use established after the minimum stream flow. The water use proposed in this application will benefit from the subordination provision because it is for domestic purposes.

65-23614

DEVON MC DONALD

JAMIE MC DONALD

5700 N WILLOW CREEK

EAGLE, ID 83616

Point of Diversion SESE S32 T12N R04E VALLEY County Source GROUND WATER

Use: IRRIGATION 04/15 to 10/31 1.44 CFS

Total Diversion: 1.44 CFS

Date Filed: 8/21/2015

Place of Use: IRRIGATION

T12N R04E S32 SWSE SESE

Total Acres: 72

65-23618

SHAWN MOSS

TRINA MOSS

PO BOX 434

MC CALL, ID 83638

Point of Diversion SWSW S14 T17N R03E VALLEY County Source GROUND WATER Tributary LAKE FORK CREEK

Use: AESTHETIC STORAGE 01/01 to 12/31 12 AF

Total Diversion: 12 AF

Date Filed: 7/1/2015

Place of Use: AESTHETIC STORAGE

T17N R03E S14 SWSW

Mitigation is proposed for consumptive use.

Permits will be subject to all prior water rights. For additional information concerning the property location, contact Western Region office at (208) 334-2190; or for a full description of the right(s), please see www.idwr.idaho.gov/WaterManagement/WaterRights. Protests may be submitted based on the criteria of Idaho Code § 42-203A. Any protest against the approval of the application(s) must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise ID 83705 together with a protest fee of \$25.00 for each application on or before 10-19-15. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Director

Published on 10/1/2015 and 10/8/2015



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way • Boise, Idaho 83705-5082

Phone: (208) 334-2190 • Fax: (208) 334-2348 • Web Site: www.idwr.idaho.gov

C. L. "BUTCH" OTTER
Governor

GARY SPACKMAN
Director

September 23, 2015

SHAWN MOSS
TRINA MOSS
PO BOX 434
MC CALL, ID 83638

Application for Permit No. 65-23618

Dear Applicant(s):

The Department of Water Resources has received your water right application. Please refer to the number referenced above in all future correspondence regarding this application.

A legal notice of the application has been prepared and is scheduled for publication in the STAR NEWS on 10/1/2015 and 10/8/2015. Protests to this application may be submitted for a period ending ten (10) days after the second publication.

If the application is protested, you will be sent a copy of each protest. All protests must be resolved before the application can be considered for approval. If the protest(s) cannot be resolved voluntarily, the Department will conduct a conference and/or hearing on the matter.

If the application is not protested, the Department will process your application and notify you of any action taken on the application. If your application is approved, the Department will send you a copy of the permit.

Please contact this office if you have any questions regarding the application.

Sincerely,

Rachel Neely
Administrative Assistant

CC:

SPF WATER ENGINEERING LLC
C/O TERRY SCANLAN
300 E MALLARD DR STE 350
BOISE, ID 83706

Neely, Rachel

From: Neely, Rachel
Sent: Wednesday, September 23, 2015 4:19 PM
To: 'jleedom@frontiernet.net'
Subject: Application for Permit No. 65-23618
Attachments: Watermaster Recommendation Form.docx; Application for Permit No. 65-23618.pdf

September 23, 2015

JOHN LEEDOM
370 KNIGHTS RD
MCCALL ID 83638

RE: Application for Permit No. 65-23618

Dear Watermaster:

The Idaho Department of Water Resources (IDWR) is seeking written comment and/or recommendations from you regarding the above referenced water right application(s). A copy of the application(s) is enclosed with this email for your reference. Please review the application(s), complete the enclosed recommendation form, and submit your reply, if any, to this office by the protest deadline of October 19, 2015.

If your agency desires to formally protest approval of this application, you may do so by filing a written protest along with a \$25.00 filing fee for each protested application by the protest deadline..

IDWR will assume you do not object to this application(s) if a timely response is not received. Please contact me if you have any questions in this matter. Thank you for your help.

Sincerely,

Rachel Neely

Administrative Assistant I
IDWR-Western Region
2735 Airport Way Boise, ID 83705
Rachel.Neely@idwr.idaho.gov

Neely, Rachel

From: Neely, Rachel
Sent: Wednesday, September 23, 2015 4:19 PM
To: 'wd65@srvinet.com'
Subject: Application for Permit No. 65-23618
Attachments: Watermaster Recommendation Form.docx; Application for Permit No. 65-23618.pdf

September 23, 2015

RON SHURTLEFF
WATER DISTRICT #65
102 N MAIN
PAYETTE, ID 83661

RE: Application for Permit No. 65-23618

Dear Watermaster:

The Idaho Department of Water Resources (IDWR) is seeking written comment and/or recommendations from you regarding the above referenced water right application. A copy of the application is enclosed with this email for your reference. Please review the application, complete a recommendation form, and submit your reply, if any, to this office by October 19, 2015.

IDWR will assume you do not object to this application if a timely response is not received. Please contact me if you have any questions in this matter. Thank you for your help.

Sincerely,

Rachel Neely

Administrative Assistant I
IDWR-Western Region
2735 Airport Way Boise, ID 83705
Rachel.Neely@idwr.idaho.gov

Grimm, Angie

From: Hersley, Jean
Sent: Monday, August 03, 2015 2:01 PM
To: Grimm, Angie; Lori Graves; tscanlan@spfwater.com; jleedom@frontier.net
Subject: RE: Executed WSB Lease Contract for De Boer 65-2932B and 65-2952B
Attachments: DOC000.pdf

Attached

From: Hersley, Jean
Sent: Monday, August 03, 2015 2:00 PM
To: Grimm, Angie; 'Lori Graves'; 'tscanlan@spfwater.com'; 'jleedom@frontier.net'
Subject: Executed WSB Lease Contract for De Boer 65-2932B and 65-2952B

For your information.

*Jean Hersley
Idaho Dept Water Resources
Technical Records Specialist II
208-287-4942*



RECEIVED

JUL 01 2015

June 29, 2015

WATER RESOURCES
WESTERN REGION

Angela Grimm, P.G.
Water Rights Supervisor
Idaho Department of Water Resources
2735 Airport Way
Boise, ID 83706

Subject: Application for Permit – Shawn and Trina Moss

Dear Angie:

Enclosed on behalf of Shawn and Trina Moss, please find an application for permit proposing aesthetic storage in an excavated pond near Lake Fork. Included is a check for the \$100 application fee.

The proposed aesthetic pond will intercept shallow groundwater. Mitigation for impacts to Lake Fork Creek resulting from pond evaporation is proposed by an accompanying mitigation plan.

Please contact me with any questions or comments.

Sincerely,

A handwritten signature in black ink, appearing to read "Terry M. Scanlan", with a stylized flourish at the end.

Terry M. Scanlan, P.E., P.G.

Enclosures: Application for Permit with Mitigation Plan

Cc: Sam Larrondo – Crestline Engineers

File: 1172.0010