

[illegible]

Method of Determination: Aerial photography, Bing Maps and Arc Map Data.

4.

Well or Diversion Information not needed.

D. FLOW MEASUREMENTS

Flow measurement not required as per IDAPA RULE 37.03.02.035.01.r.iii.

E. FLOW CALCULATIONS

The diversion rate for this domestic right is limited to 0.02 cfs or 9 gpm.

F. VOLUME CALCULATIONS

The annual volume for this domestic right is limited to 1.2 AF.

G. NARRATIVE/REMARKS/COMMENTS

This office exam is conducted in accordance with IDAPA RULE 37.03.02.035.01. The verification for this right is based upon the following:

1. Statement of completion
2. Tax Lot information
3. Aerial photography, Bing Maps and Arc Map Data

Have conditions of permit approval been met? ☒ Yes ☐ No

H. RECOMMENDATIONS

1. Recommended Amounts

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.020 CFS	1.20 AF
<u>Totals:</u>		0.020 CFS	1.20 AF

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None


☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name Eric Plummer Date 1-2-2014

Reviewer Beeth E. Frankham Date 1/9/2014

State of Idaho
Department of Water Resources
Water Right License
96-9287

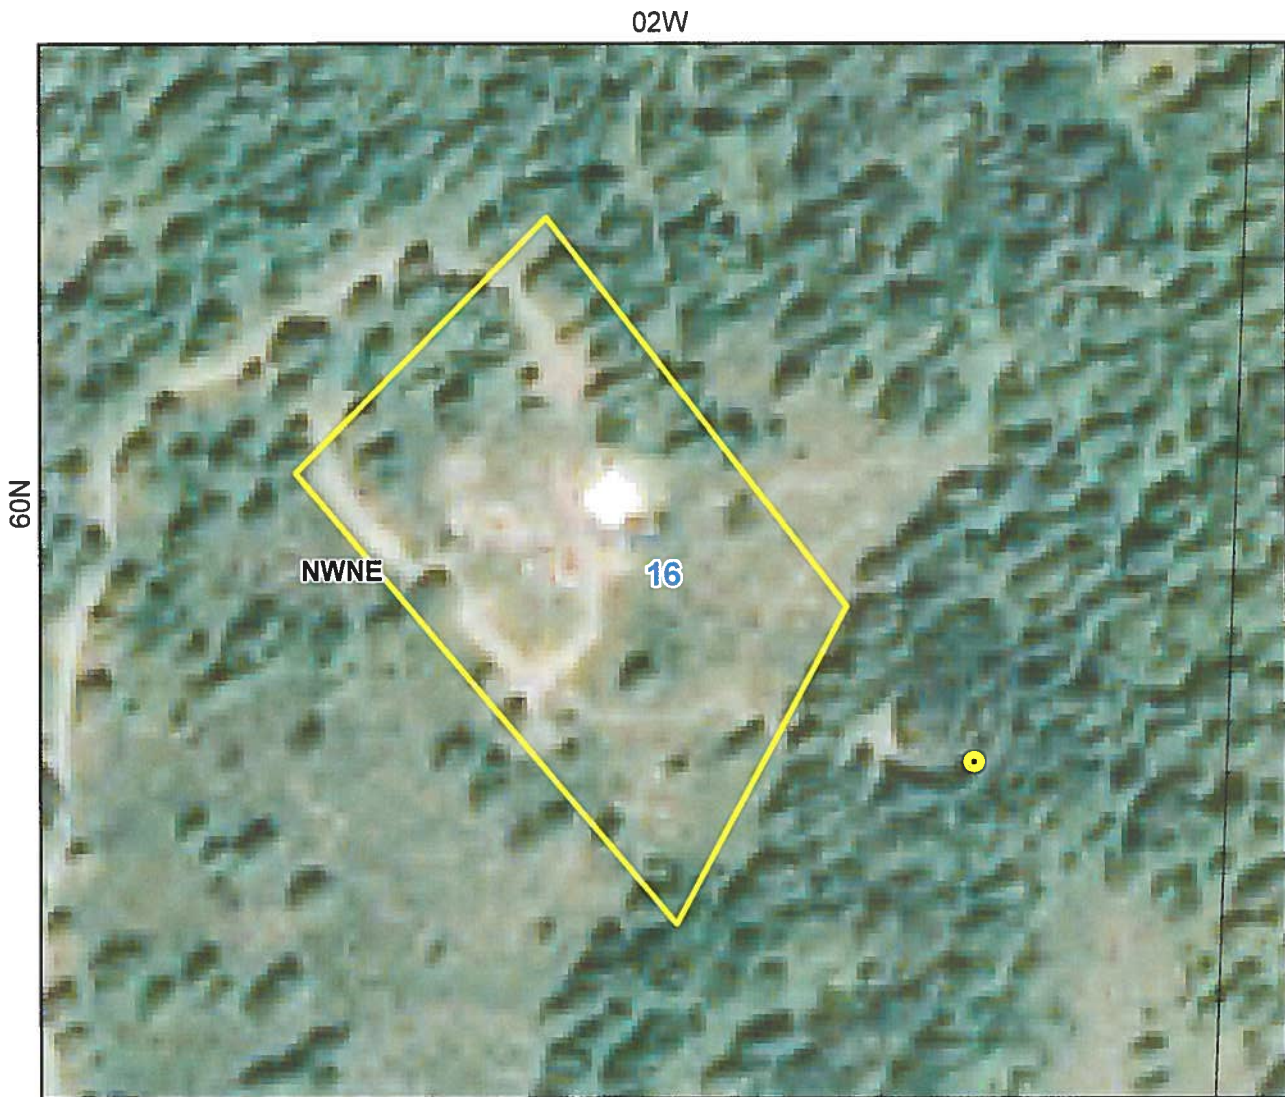

-  Point of Diversion
-  Place Of Use Boundary
-  Townships
-  PLS Sections
-  Quarter Quarters

0 0.0125 0.025 0.05 Miles

