

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 98-7841

Exam Date: 7/31/2012

1. Current Owner: WILLIAM ELAM And DONNA ELAM
186 ROSS RD
BONNERS FERRY ID 83805

2. Accompanied by: WILLIAM ELAM

Phone No: SAME

Address: SAME

Relationship to Permit Holder: OWNER

3. SOURCE

UNNAMED SPRINGS

TRIBUTARY

SINKS

B. OVERLAP REVIEW

1. Other water rights with the same place of use: NONE

2. Other water rights with the same point of diversion: NONE

C. DIVERSION AND DELIVERY SYSTEM1. LOCATION OF POINT(S) OF DIVERSION:

UNNAMED SPRINGS SW1/4NW1/4SE1/4 Sec. 25, Twp 65N, Rge 01E, B.M. BOUNDARY County

Method of Determination: GPS AND MAP

2.

PLACE OF USE: WILDLIFE STORAGE

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
65N	01E	25															X		

PLACE OF USE: FIRE PROTECTION STORAGE

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
65N	01E	25															X		

PLACE OF USE: STOCKWATER STORAGE

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
65N	01E	25															X		

Method of Determination:

3. ☒ Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
- ☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
- ☒ Aerial Photo Attached (required for irrigation of 10+ acres).
- ☒ Photo of Diversion and System Attached

4.

Well or DiversionID No:

NO DIVERSION ID.

D. FLOW MEASUREMENTS: SPRING IN POND

F. VOLUME CALCULATIONS:

POND IS 105 FT X 97 FT DEPTH 12FT = 2.80 AF, 10185 SQFT + EVAPORATION 0.7AF
(TOTAL POND USE IS 3.5AF/Y)

G. NARRATIVE/REMARKS/COMMENTS: The pond is feed by a spring, and in the spring of the year water will flow to the lower field through a stand up pipe / outlet pipe and sinks in the east side of the field a bought 100 yards from the pond .

Have conditions of permit approval been met? ☒ Yes ☐ No

H. RECOMMENDATIONS

H. RECOMMENDATIONS

1. Recommended Amounts

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
WILDLIFE STORAGE	01/01 to 12/31		3.50 AF
FIRE PROTECTION STORAGE	01/01 to 12/31		3.50 AF
STOCKWATER STORAGE	01/01 to 12/31		3.70 AF
<u>Totals:</u>			3.70 AF

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name *E. J. Davis* Date 11-29-2012

Reviewer *S. Taylor* Date 12/28/12



PIPE OUTLET.JPG



DAM, .JPG



POND.JPG



POD INLET.JPG







State of Idaho
Department of Water Resources
Water Right License

98-7841

Water Service Area Boundary for William Elam

R01E

T65N

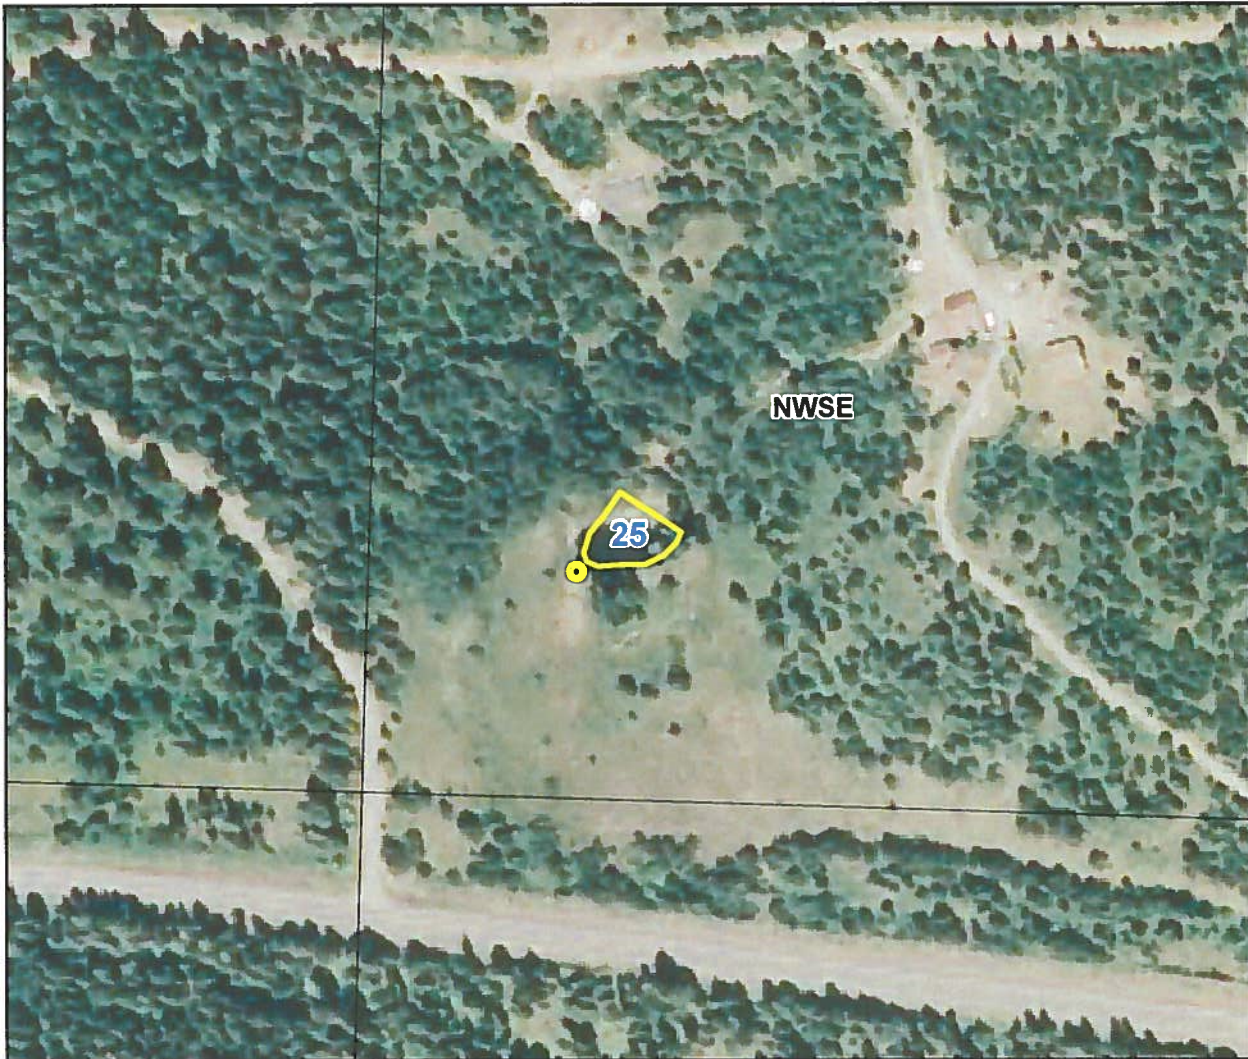

-  Point of Diversion
-  Place Of Use Boundary
-  Townships
-  PLS Sections
-  Quarter Quarters

