

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 11-7367

Exam Date: 10/29/2012

1. Current Owner: COPENHAGEN HILLS ASSN
CO JOHN P NELSON
24 W 200 N
HYDE PARK UT 84318
(801)770-1919

2. Accompanied by: N/A

3. **SOURCE**

SPRING

TRIBUTARY

COPENHAGEN CREEK

B. OVERLAP REVIEW

1. Other water rights with the same place of use: No overlapping domestic rights.
2. Other water rights with the same point of diversion: None.

C. DIVERSION AND DELIVERY SYSTEM1. **LOCATION OF POINT(S) OF DIVERSION:**

SPRING NW1/4SW1/4SW1/4 Sec. 25, Twp 12S, Rge 42E, B.M. BEAR LAKE County

Method of Determination: GPS

2. **PLACE OF USE:** DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				
			<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>Totals</u>
12S	42E	25										X	X	X					

Method of Determination: Site visit and aerial photography.

3. ☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use.
☒ Aerial Photo Attached (required for irrigation of 10+ acres).
☒ Photo of Diversion and System Attached

D. FLOW MEASUREMENTS

No measurement required. De minimus use.

E. VOLUME CALCULATIONS

12 Recreation Properties x 0.6 af/year x 0.5 (seasonal use / limited supply) = 3.6 af/year

F. NARRATIVE/REMARKS/COMMENTS

Water right backfile contains many photos relating to development of the spring. Water diverted in a buried collection system and stored in a 3,000 gallon concrete holding tank. Water is pumped from the tank uphill for cabin lots to the south and is gravity fed to cabin lots to the north. Overflow from storage tank flows into Copenhagen Creek.

Spoke with two of the lot owners. They said that water from the spring declines in the late summer, limiting its usefulness for domestic purposes. According to an agreement, all lot owners are entitled to a 1/12th share of the water regardless of the supply. Only about half of the cabin lots appear to have an existing structure. Other lots have entrance roads and may be used for camping or for recreational vehicles.

Permit was issued after a contested case hearing. License issued consistent with September 12, 1989 Order.

Have conditions of permit approval been met? ☒ Yes ☐ No

G. RECOMMENDATIONS**1. Recommended Amounts**

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.160 CFS	3.60 AF
	<u>Totals:</u>	0.160 CFS	3.60 AF

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

H. AUTHENTICATION

Field Examiner's Name James Cefalo Date Nov 8, 2012


Reviewer _____ Date _____

State of Idaho
Department of Water Resources
Water Right License

11-7367

Water Service Area Boundary for Copenhagen Hills Assn

November 08, 2012

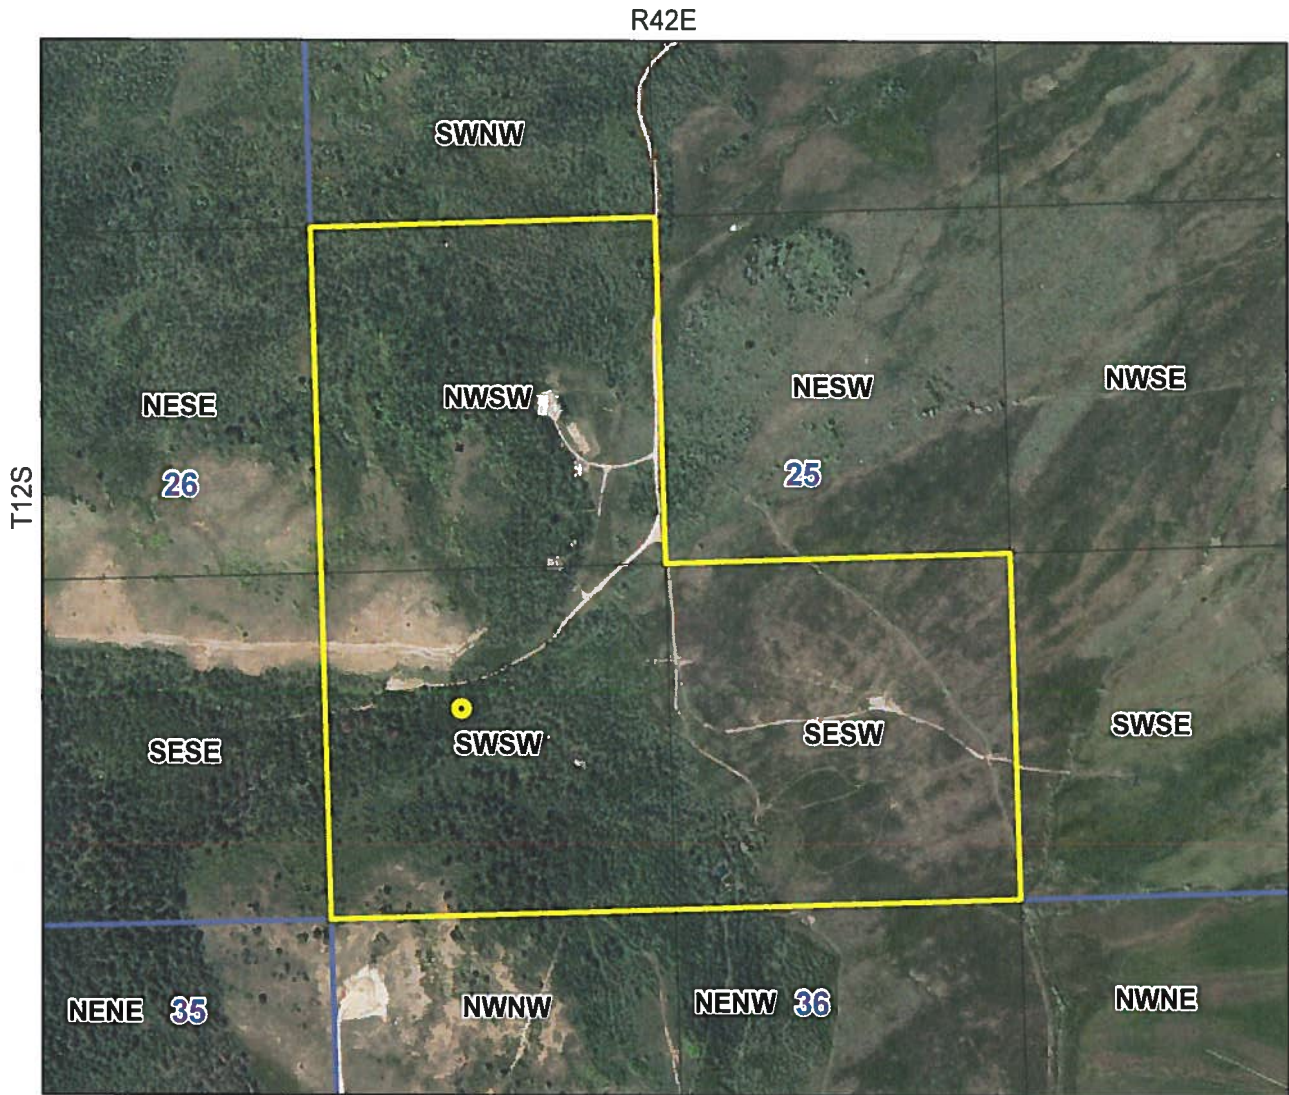

0 0.075 0.15 0.3 Miles

- Point of Diversion
- Place Of Use Boundary
- Townships
- PLS Sections
- Quarter Quarters



