

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 96-9468

Exam Date: 5/15/2012

1. Current Owner: RAFFAT SAIED
1601 NORTHSORE DR
SANDPOINT ID 83864
(208) 255-7700

And

MUZNA SAIED
1601 NORTHSORE DR
SANDPOINT ID 83864
(208) 255-7700

2. Accompanied by: In office exam

3. SOURCE

PEND OREILLE LAKE

TRIBUTARY

PEND OREILLE RIVER

B. OVERLAP REVIEW

1. Other water rights with the same place of use: None
2. Other water rights with the same point of diversion: None

C. DIVERSION AND DELIVERY SYSTEM1. LOCATION OF POINT(S) OF DIVERSION:

PEND OREILLE LAKE
BONNER County

L2 SW1/4NE1/4

Sec. 28, Twp 57N, Rge 02W, B.M.

Method of Determination: Application and Aerial Photograph

2.

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
57N	02W	28	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	
					X														
					L 2														

Method of Determination: Aerial photography, Bing Maps and Arc Map Data

3. N/A Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
Yes Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
Yes Aerial Photo Attached (required for irrigation of 10+ acres).
N/A Photo of Diversion and System Attached

4.

Well or Diversion Information Not Needed.**D. FLOW MEASUREMENTS**

Flow measurements not needed as per IDAPA RULE 37.03.02.035.01rili

E. FLOW CALCULATIONS

The diversion rate for this Domestic Right is limited to 0.04 cfs or 18 gpm.

F. VOLUME CALCULATIONS

The annual volume for this domestic right is limited to 1.2 acft.

G. NARRATIVE/REMARKS/COMMENTS

This office exam is conducted in accordance with IDAPA RULE 37.03.02.035.01. The verification for this right is based upon the following;

1. Statement of completion
2. Tax lot information
3. Aerial photography, Bing Maps, Arc Map Data

The exam review found the place of use is within Government Lot 2 of the SWNE of Section 28 only. The license will not include Government Lot 1 of the SENE as shown on the permit.

Have conditions of permit approval been met? ☒ Yes ☐ No**H. RECOMMENDATIONS****1. Recommended Amounts**

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.040 CFS	1.20 AF
	<u>Totals:</u>	0.040 CFS	1.20 AF

2. Recommended Amendments☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other**I. AUTHENTICATION**


Field Examiner's Name

Date

Reviewer

Date

Kathy L. Farnsworth Date 5/16/12
Shelly W. Ren Date 5/13/2012

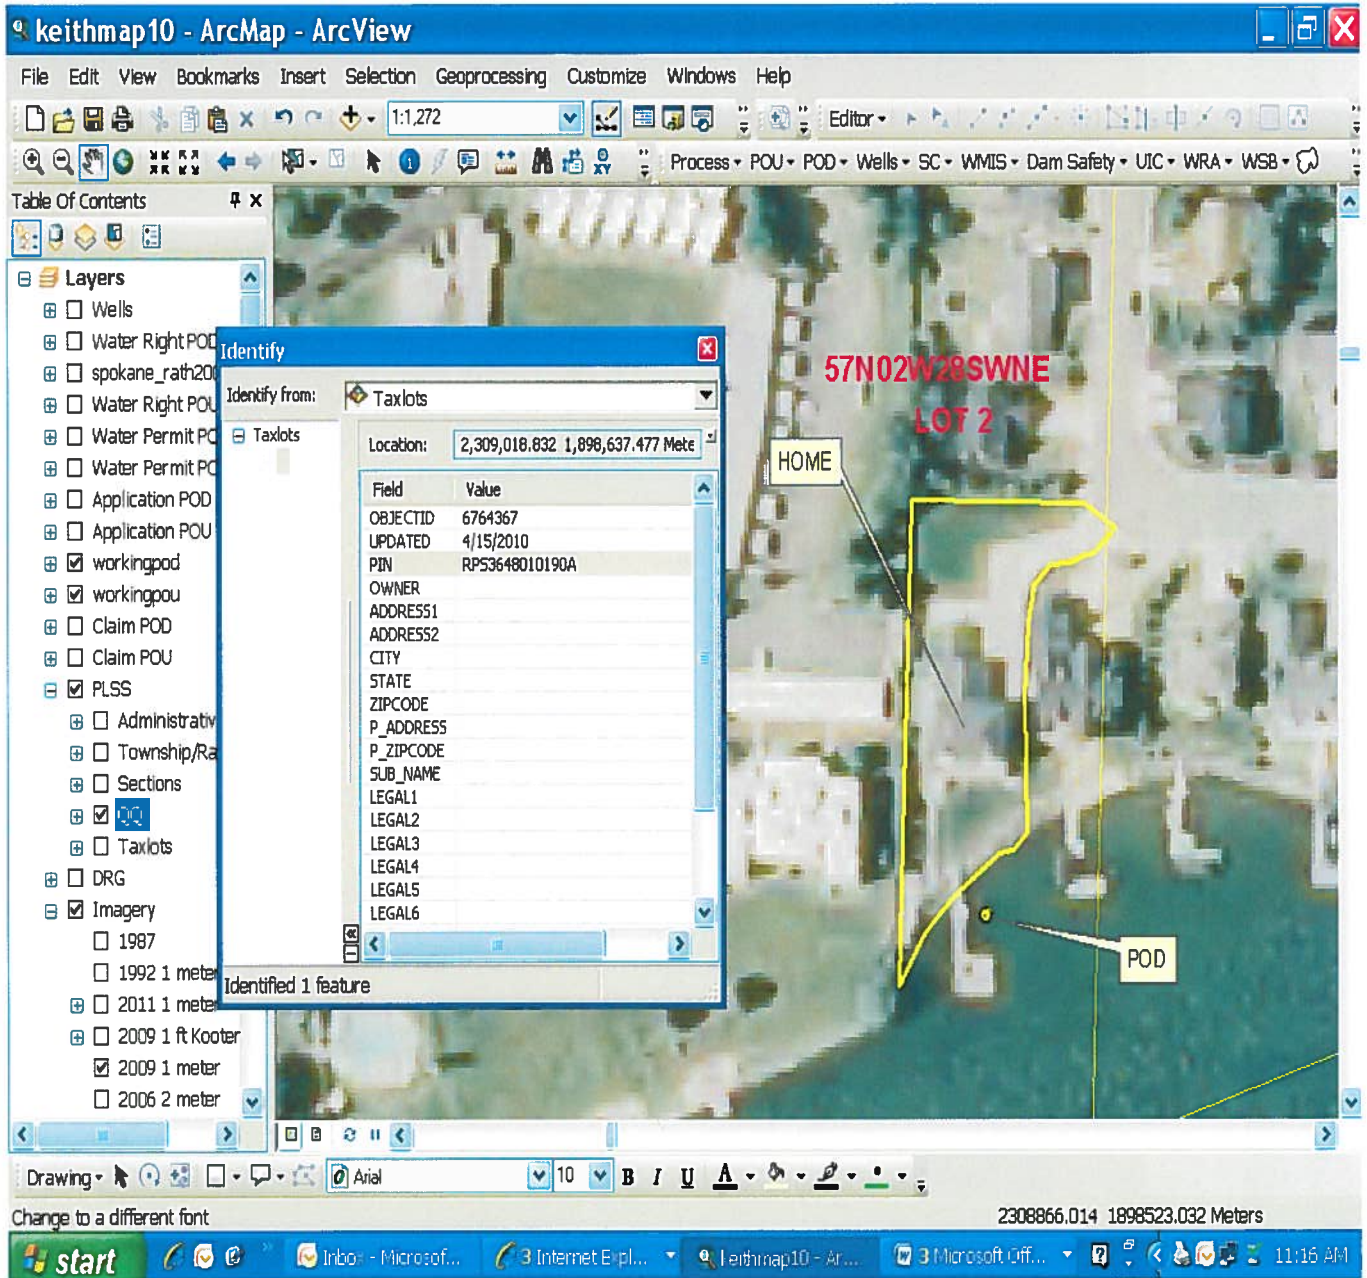

1601 S Northshore Dr, Sandpoint, ID 83864 Map - Bing Maps - Windows Internet Explorer

<http://www.bing.com/maps/default.aspx?encType=1&where=1601+S+Northshore+Dr%2c+> Live Search

File Edit View Favorites Tools Help

★ Favorites ★ Free Hotmail

1601 S Northshore Dr, Sandpoint, ID 83864 ...

Page Safety Tools

WEB IMAGES VIDEOS MAPS MORE



1601 S Northshore Dr, Sandpoint, ID 83864



Sign in
21

Road Aerial Traffic

Print Share



Internet

100%

start

Inbox - Microsoft...

3 Internet Expl...

Feithmap10 - Arc...

Document1 - Mic...

11