

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 47-8423

Exam Date: 4/30/2012

1. Current Owner: SHANE SURBER Or NICOLE SURBER
4806 RIVER RD
BUHL ID 83316
(208)543-5083
2. Accompanied by: Field exam done in house.

3. **SOURCE**

GROUND WATER

B. OVERLAP REVIEW

1. Other water rights with the same place of use: 47-7577 (Heating)
2. Other water rights with the same point of diversion: 47-7577 and 47-7278 (Heating for homes and greenhouses)

C. DIVERSION AND DELIVERY SYSTEM1. **LOCATION OF POINT(S) OF DIVERSION:**

GROUND WATER	L7 SW1/4SW1/4	Sec. 33,	Twp 08S,	Rge 14E, B.M.
TWIN FALLS County				
GROUND WATER	L7 SW1/4SW1/4	Sec. 33,	Twp 08S,	Rge 14E, B.M.
TWIN FALLS County				

Method of Determination: Existing water rights 47-7577 and 47-7278

2.

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
08S	14E	33											X						
													L 7						

Method of Determination: Domestic use if for in-house only POU was identified as home and garage.

3. ☐ Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
☐ Aerial Photo Attached (required for irrigation of 10+ acres).
☐ Photo of Diversion and System Attached

4.

Well or Diversion

Permit uses two existing wells that are marked with tags A0003135 and A0003136.

D. FLOW MEASUREMENTS
N/A**E. FLOW CALCULATIONS**
N/A**F. VOLUME CALCULATIONS**
N/A**G. NARRATIVE/REMARKS/COMMENTS**

Permit 47-8423 proposes an in-house domestic use be added to existing hot water wells within the Banbury GWMA. The Domestic in-house use is for a home that is heated by WR 47-7577. The irrigation use on the property is from shares in the Banbury Pipeline Co.

The license is conditioned to reflect the in-house use allowance. It is recommended that the Water Right be licensed at 0.02 cfs with an annual volume of 0.6 AF.

Have conditions of permit approval been met? ☒ Yes ☐ No

H. RECOMMENDATIONS**1. Recommended Amounts**

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.020 CFS	0.60 AF
<u>Totals:</u>		0.020 CFS	0.60 AF

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name Matthew Erickson Date 5/1/12

Reviewer Andrew Merwin Date 5/25/12


State of Idaho
Department of Water Resources
Water Right License

47-8423

Water Service Area Boundary for Shane Surber

April 30, 2012

R14E

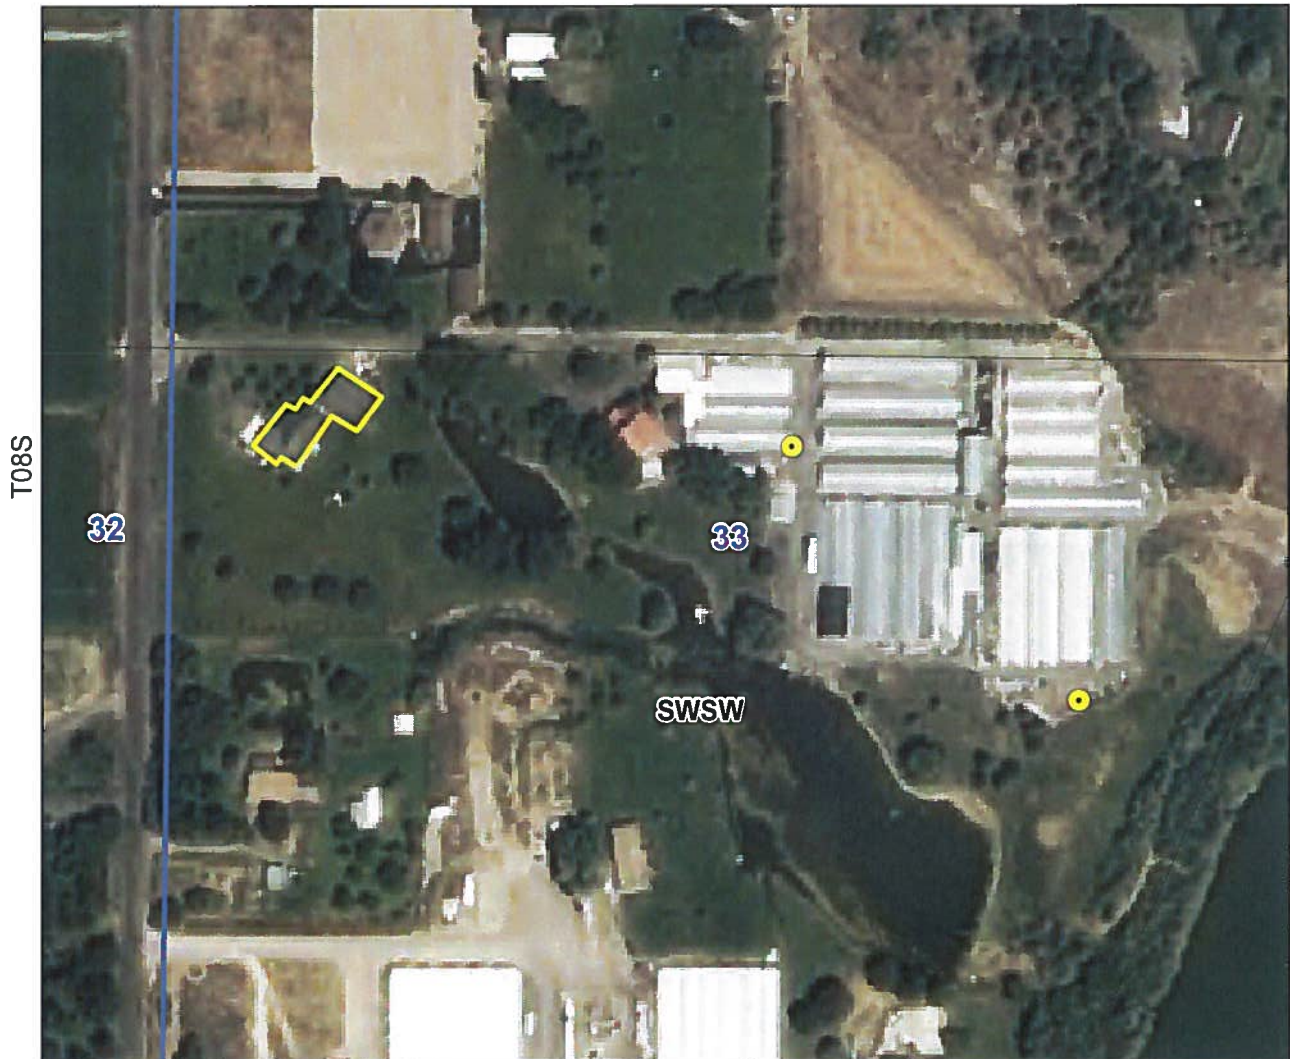

0 0.025 0.05 0.1 Miles

-  Point of Diversion
-  Place Of Use Boundary
-  Townships
-  PLS Sections
-  Quarter Quarters

