

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 47-8424

Exam Date: 4/30/2012

1. Current Owner: JAMES W COOK and/or GREG HEIDEMAN and/or JOY HEIDEMAN and/or ROBERTA COOK
3125 N 3500 E
KIMBERLY ID 83341
(208)423-6439
2. Accompanied by: Field exam done in house.
3. **SOURCE**
GROUND WATER

B. OVERLAP REVIEW

1. Other water rights with the same place of use: N/A
2. Other water rights with the same point of diversion: N/A

C. DIVERSION AND DELIVERY SYSTEM**1. LOCATION OF POINT(S) OF DIVERSION:**

GROUND WATER NE1/4SE1/4 Sec. 20, Twp 11S, Rge 18E, B.M.
TWIN FALLS County

Method of Determination: Well inspection for new well in 2005, location was digitized.

2.

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	<u>NE</u>	<u>NW</u>	<u>SW</u>	<u>SE</u>	
11S	18E	20													X				X

Method of Determination:

3. ☐ Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
- ☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
- ☐ Aerial Photo Attached (required for irrigation of 10+ acres).
- ☐ Photo of Diversion and System Attached

4.

Well or Diversion

Well was drilled under permit #835538 in 2005, 6" domestic well that is 120' deep.

D. FLOW MEASUREMENTS

N/A

E. FLOW CALCULATIONS

N/A

F. VOLUME CALCULATIONS

N/A

G. NARRATIVE/REMARKS/COMMENTS

Application for permit was filed for a domestic well that was originally a shared well with a neighboring property. However in 2005 the owners filed for a domestic drilling permit (#835538) and drilled a new well. The new well is on the property associated with this permit and is expected to be the source for this water right. It is recommended that the right be licensed with a flow rate of 0.04 cfs. Ownership has changed on the property, but the address is the same.

Have conditions of permit approval been met? ☒ Yes ☐ No

H. RECOMMENDATIONS**1. Recommended Amounts**

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>
DOMESTIC	1/01 to 12/31	0.040 CFS
<u>Totals:</u>		0.040 CFS

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name

Date

Reviewer

Date

Matthew E. Smith
Chris Smith

4/30/12


5/1/12

State of Idaho
Department of Water Resources
Water Right License

47-8424

Water Service Area Boundary for James W Cook

April 30, 2012

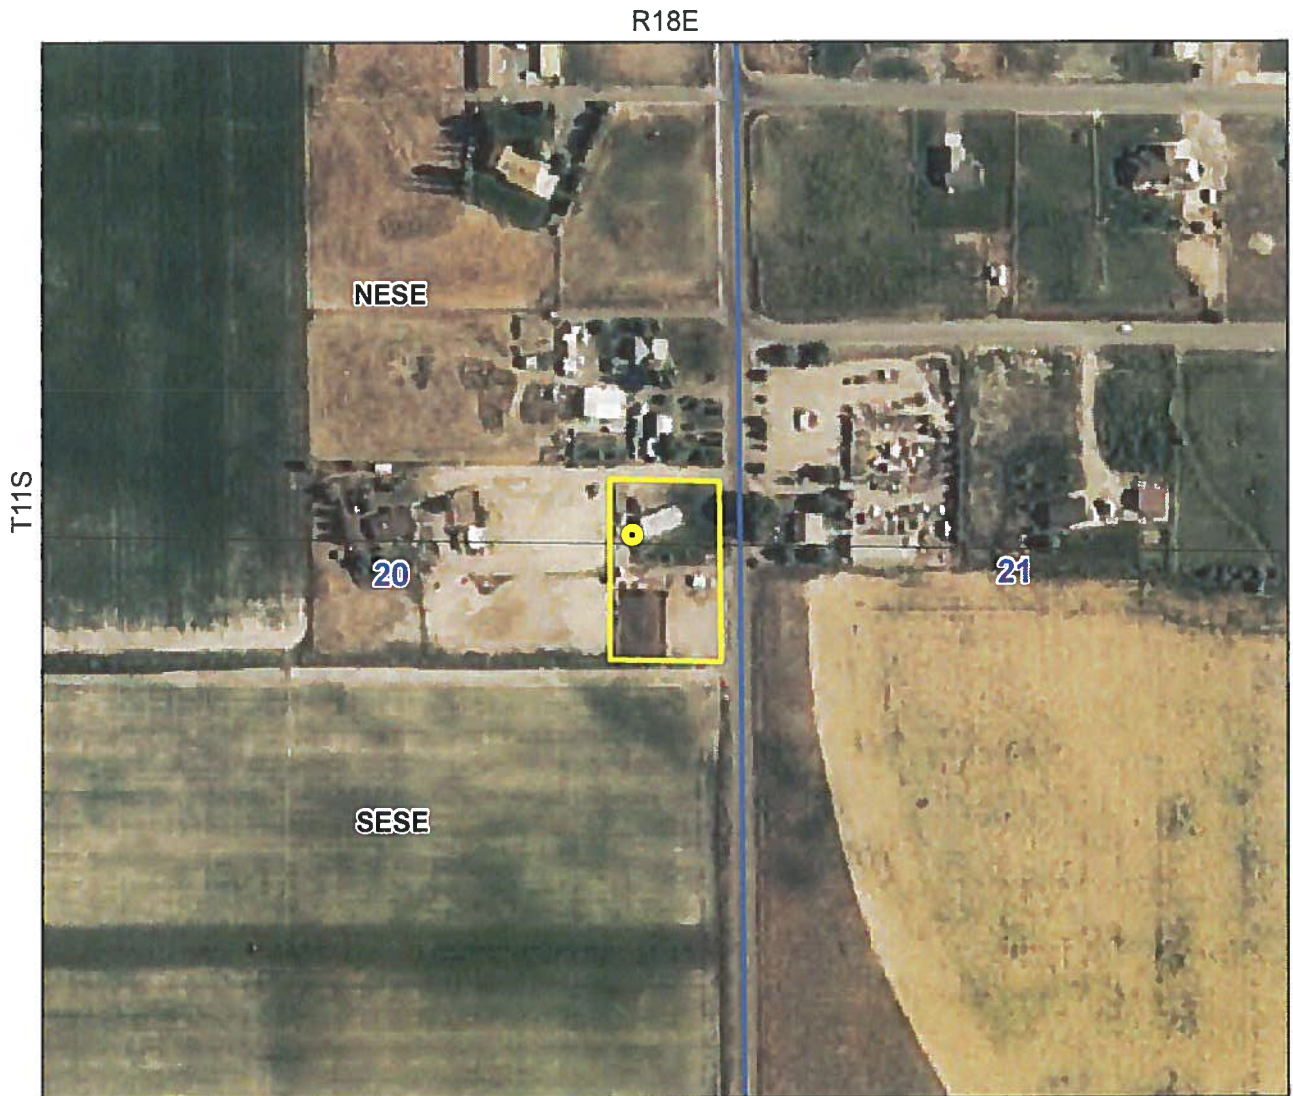

0 0.0325 0.065 0.13 Miles

-  Point of Diversion
-  Place Of Use Boundary
-  Townships
-  PLS Sections
-  Quarter Quarters

