



BROCKWAY
ENGINEERING
P.L.L.C.

Hydraulics

Hydrology

Water Resources

March 2, 2012

RECEIVED

MAR 08 2012

DEPARTMENT OF
WATER RESOURCES

Mr. Craig Saxton
Idaho Department of Water Resources
1341 Fillmore Street, Suite 200
Twin Falls, ID 83301

Re: Changes to Beneficial Use Field Report for Water Right 45-14107

Dear Craig:

Here is our amended application as per our conversation with you and Chuck Brockway Sr., this morning. We have agreed with and accepted your recommendations as to the place of use changes. These changes are represented on the page one of the Beneficial Use Field Report and new map for Water Right 45-14107 enclosed.

Please contact me with any questions you may have.

Sincerely,

Charles E. Brockway, P.E.

Enclosures:

Page One - Beneficial Use Field Report for 45-14107
Map of POU for water right 45-14107
Application for Amendment
Check \$100 # 10631

Cc: Craig Searle

CHARLES E.
BROCKWAY,
PH.D., P.E.

CHARLES G.
BROCKWAY,
PH.D., P.E.

2016 NORTH
WASHINGTON
STREET • SUITE 4

TWIN FALLS,
IDAHO 83301

208•736•8543

FAX: 736•8506

RECEIVED

MAR 08 2012

DEPARTMENT OF
WATER RESOURCES

A Beneficial Use Field Report is prepared by a water right examiner as the result of an examination to clearly confirm and establish the extent of the beneficial use of water established in connection with a permit during the development period authorized by the permit and any extensions of time previously approved.

A. GENERAL INFORMATION

Permit No. 45-14107

1. Owner MVCP LLC Phone No. 208-678-1599
Current address 474 E 550 S Burley, ID 83318
2. Examiner's name Charles E. Brockway EXAM DATE September 9, 2011
3. Accompanied by Craig Searle Email _____
Address member LLC
Relationship to permit holder _____ Phone No. _____
4. Source Lunch Creek, Dayley Creek, Antelope Springs Creek tributary to Sinks

B. OVERLAP REVIEW

1. Other water rights with the same place of use 45-691, 45-14182
2. Other water rights with the same source and point of diversion _____


C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

[illegible]

2. **Place(s) of Use:** Method of determination Aerial photo-2011

[illegible]

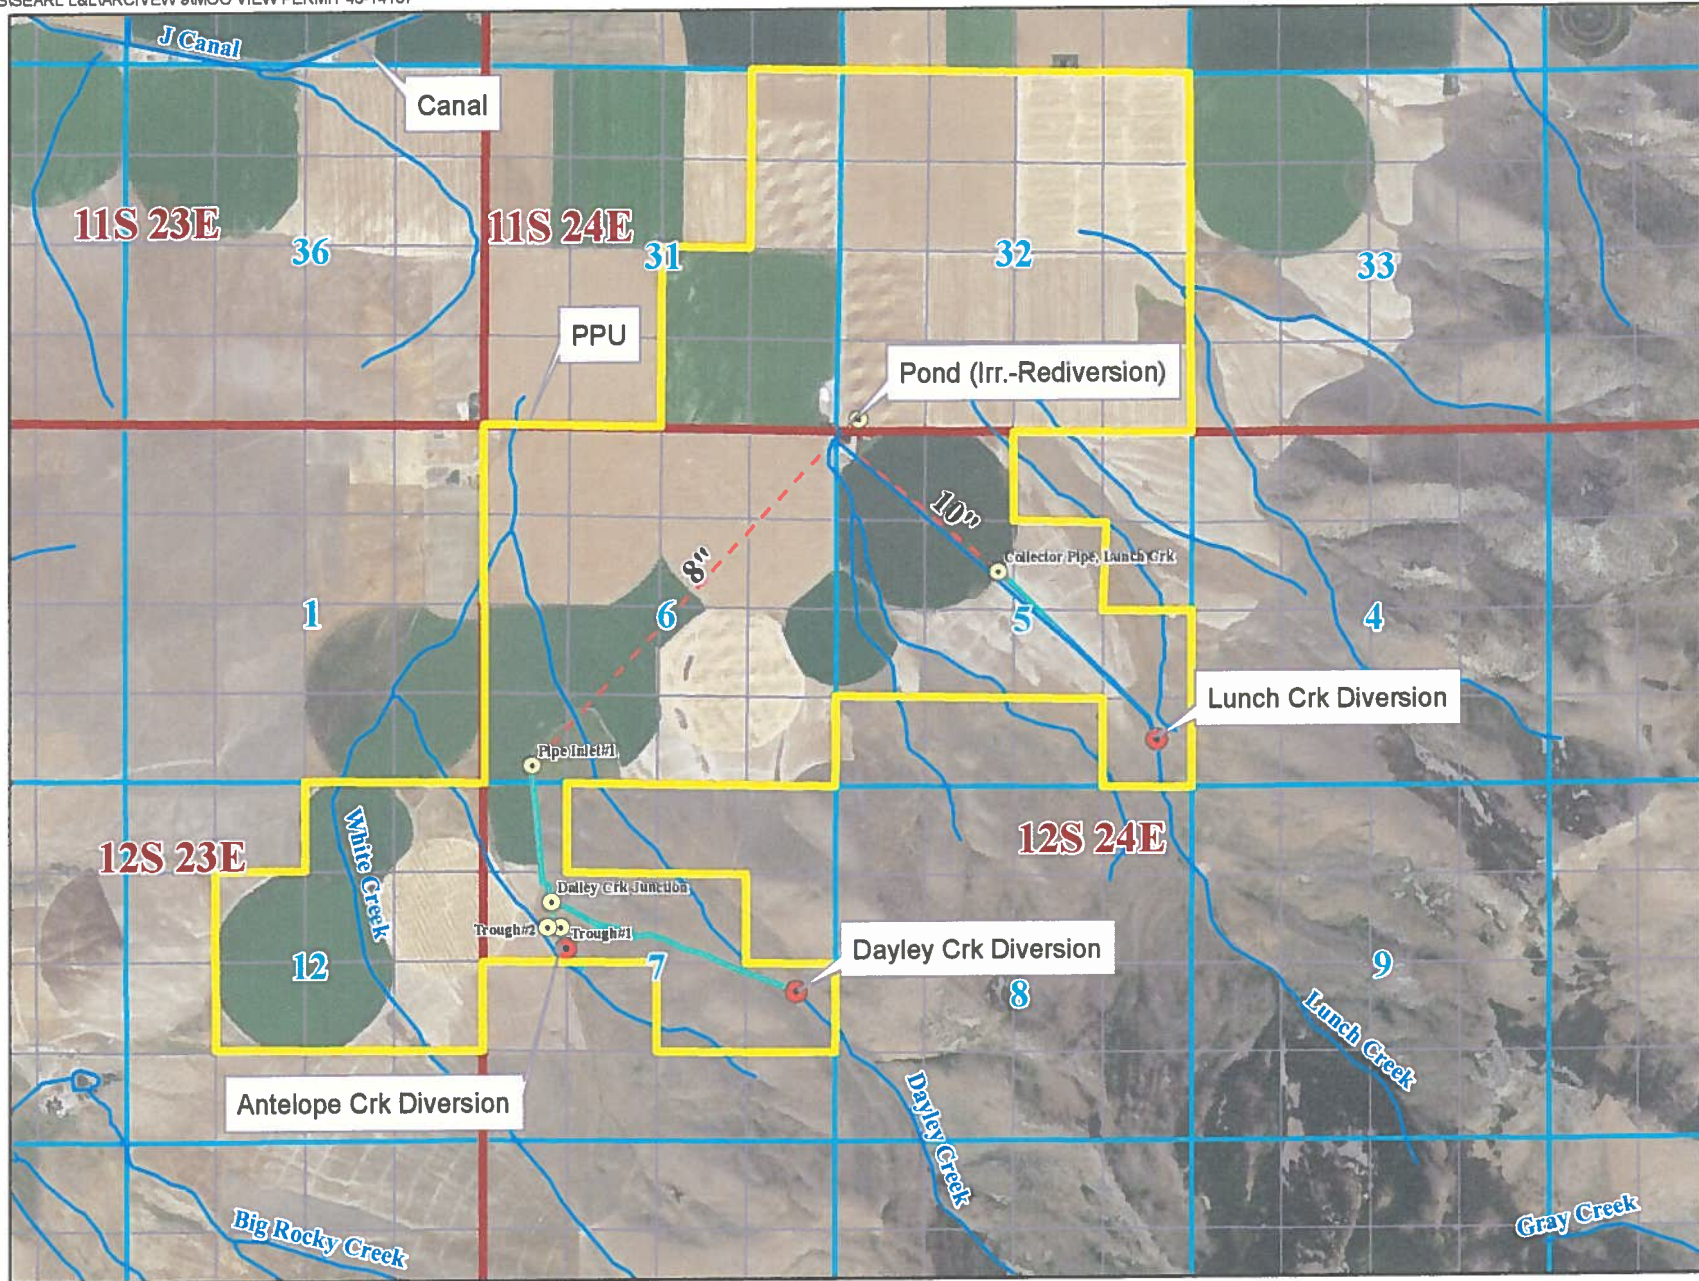

0 1,450 2,900 5,800 Feet

MVCP, LLC.
PERMIT EXAM FOR 45-14107
NAIP 2011 AERIAL

FIGURE 1

Legend

- POU 45-14107
- Diversions
- Permit GPS Points
- Waterways
- Ditch
- Pipeline
- twship
- Sections
- QQ lines

