

MEMO

To: Tim Luke & Michele Edl

From: Mat Weaver 

Date: February 10, 2011

Cc: Rex Barrie, Tom Arkoosh

RE: Riverside Village Subdivision, Garden City, ID - Water Right and Water Measurement Device Review and Recommendations

Introduction

This memo is response to a request by Tim Luke to review the existing Riverside Village Subdivision water rights and irrigation and aesthetic pond system and present design recommendations regarding lockable diversion control devices and water measurement devices.

Water Rights

In discussions with Michele Edl and my own review of the water right records I have identified two water rights in association with the Riverside Village Subdivision. The first water right, 63-9718, is for irrigation (0.44 CFS (cubic feet per second)), aesthetic storage (78 AF (acre feet)), and diversion to storage (3.21 CFS)¹. The point of diversion (POD) for this water right is located at the west end of Glenwood Lake. This water right (WR) currently has a place of use (POU) that encompasses Glenwood Lake and a region of riparian habitat that skirts the north shore of the Boise River from the Glenwood Bridge west to the western end (downstream end) of Long Lake². Refer to Figure 1 for a depiction of this water right. This water right was partially decreed in the Snake River Basin Adjudication (SRBA) on February 16, 2007.

The second water right, 63-9751, is for aesthetic flow (3.21 CFS). The POD for this WR is located at the east end of Westmorland Park approximately 0.2 miles upstream of the Glenwood Bridge. This water right currently has a place of use that encompasses Glenwood Lake and six of the 12 ponds located within the Riverside Village Subdivision (RSV). Refer to Figure 1 for a depiction of this water right. This water right was partially decreed in the SRBA on January 27, 2010.

¹ The diversion rate of 3.21 cfs associated with the diversion to storage component is solely to support an annual filling or topping-off of the pond system. Assuming the ponds were empty a rate of 3.21 cfs can fill a volume of 78 AF in approximately 294 hours or 12.25 days.

² The region of riparian habitat identified as an irrigated area is more than likely derived from the Beneficial Use Field Report dated July 28, 1988 conducted by Department staff in association with WR 63-9718. However, the verbal description from the field report of the irrigated area ("strip of land about 20 feet wide around each lake") does not match either the graphical depiction in the Field Report or the current POU shape file.

Analysis of System

Water is initially diverted into the system at a POD, consisting of a 30-inch diameter pipe and headwall, located at the east end of Westmorland Park approximately 0.2 miles upstream of the Glenwood Bridge (Point 1 on Figure 2). There is no control device on the existing head works. The 30-inch diameter pipe traverses approximately 630 feet to the west before discharging into the east end of Westmorland Lake. Between the POD and the discharge into Westmorland Lake the gravity irrigation line passes through three concrete junction structures (approximately 4 ft x 4 ft). Backwater analysis of this system at minimum design flow indicates that the only section of pipe flowing full was the downstream-most section. This analysis was consistent with observed field conditions during the site visit. Water discharges from Westmorland Lake via a square concrete structure located on the west end of the lake (Point 2 on Figure 2). Three sides of the structure have screened rectangular openings that pass water into the downstream diversion pipe. The elevation of the rectangular openings dictates the maximum water surface elevation (WSE) of Westmorland Lake.

From the outlet box on Westmorland Lake approximately 415 linear feet (LF) of 30-inch diameter pipe conveys water to an overflow structure located near the paved greenbelt path on the west side of Glenwood Bridge (Point 3 on Figure 2). This overflow structure is in approximately the same location as the original POD of water from the Boise River into Glenwood Lake. Discharging into the overflow structure is the 30-inch diameter pipe that drains Westmorland Lake. Discharging out of the overflow structure is 24-inch diameter pipe, which supplies water to the east end of Glenwood Lake. A screened rectangular opening is located in the west face of the overflow structure that allows water to overflow out of the device and back into the Boise River. The elevation of this rectangular opening dictates the maximum WSE of Glenwood Lake. At the time of the site visit the conveyance line from Westmorland Lake to Glenwood Lake was flowing full under modest head. An outlet out of Glenwood Lake is located at the west end of the lake (Point 4 on Figure 2). This outlet consists of a head wall and lockable canal gate that allows for the regulation and control of discharges out of Glenwood Lake and into the RSV Subdivision pond system.

From the outlet of Glenwood Lake water is conveyed via 24-inch gravity irrigation pipe approximately 1,056 LF to the west/southwest where it discharges into the uppermost pond in the RSV Subdivision. At the time of the site visit the conveyance line from Glenwood Lake to the uppermost RSV Subdivision pond was flowing full under modest head. This pond is in hydrologic equilibrium with a second pond located across Riverside Drive to the north. From the uppermost pond(s) water is conveyed downstream, to the west, through a series of ten sequential ponds, bringing the total number of ponds within RSV Subdivision to 12. Each pond is connected to the pond immediately downstream and upstream by a 15-inch diameter concrete culvert. Water discharges from the lowermost pond in the subdivision under Riverside Drive and into another pond located within the Woods at Riverside No. 3 Subdivision (Point 5 on Figure 2).

Two irrigation pump stations divert water from the series of 12 ponds located within the RSV Subdivision. The first pump station (Rivercove PS; Point 6 on Figure 2) diverts water from a 0.8-acre pond located at the head of the system. This pump station was acknowledged in the Beneficial Use Field Report conducted by the Department. Irrigation associated with this pump station was also identified in the Field Report. The second pump station (Lakeview PS; Point 7 on Figure 2) diverts water from another 0.8-acre pond located near the middle of the pond system. This pump station was not constructed at the time the field exam was conducted.

A third irrigation pump station (Long Lake PS; Point 8 on Figure 2) is located near the east end of Long Lake on the south side or river side of the lake. This was the second pump station identified in the Beneficial Use Field Report and the irrigation associated with this pump station was also acknowledged in the report. Water is diverted from the Boise River into Long Lake at an uncontrolled diversion located approximately 0.1 miles upstream of Long Lake (Point 9 on Figure 2). Water is conveyed from the point of diversion via approximately 597 LF of 24-inch diameter PE pipe passing through two irrigation junction structures before discharging into the east end of Long Lake. Water flows out of the west end of Long Lake at two points, one point discharges over a concrete check dam and directly into the Boise River, the second discharge point is into Riverside Creek, which itself eventually drains back into the Boise River.

Analysis of System Losses

A portion of water diverted under WRs 63-9718 and 63-9751 is lost to the Boise River in the form of evaporation from water surfaces and evapotranspiration (ET) associated with irrigation. I have assumed that seepage from any of the ponds or lakes previously described returns in short order to the Boise River and is therefore not lost from the system or responsible for injury to senior WRs on the Boise River.

Annual and monthly evaporation loss can be estimated by utilizing evaporation rates obtained from ETIdaho³. Table 1 is a summary of monthly volumetric evaporative losses from the 12 ponds located within the RSV Subdivision, not including Long Lake.

Table 1 - Summary of Monthly Evaporative Losses

Description	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Mean Actual Evaporation (AF)	0.21	0.44	0.98	1.48	1.92	2.24	2.47	2.13	1.57	1.10	0.40	0.20

Evaporative Rates obtained from ETIdaho for "Open Water - Shallow Systems (ponds, streams) for the NWS - Boise WSFO Airport

The annual evaporative loss from 4.8 acres of pond surface area associated with the diversion of 3.21 cfs continuously under water right 63-9751 is 15.11 AF. If we assume the water right is out of priority by July 1 in the best of water years, as indicated by Watermaster Rex Barrie, the minimum volume of evaporative loss would be 7.27 AF.

ET losses associated with irrigation of RSV Subdivision common areas can be estimated utilizing ET rates obtained from ETIdaho. Table 2 is a summary of monthly volumetric ET losses from 11 acres of irrigated area associated with WR 63-9718.

Table 2 - Summary of Monthly ET Losses from 11 acres of Irrigated Landscaping

Description	Apr	May	Jun	Jul	Aug	Sep	Oct
Mean Actual Evaporation (AF)	4.31	6.13	7.02	7.70	6.69	4.99	3.22

Evaporative Rates obtained from ETIdaho for "Grass - Turf (lawns) - Irrigated for the NWS - Boise WSFO Airport

³ ETIdaho by Allen, Richard G. and Clarence W. Robison, 2009. Evapotranspiration and Consumptive Irrigation Water Requirements for Idaho: Supplement updating the Time Technical Completion Report, Kimberly Research and Extension Center, University of Idaho, Moscow, ID.

The total loss of water due to ET from a single irrigation season is 40.06 AF. If we again assume the water right is out of priority by July 1 in the best of water years the minimum volume of ET loss would be 22.6 AF. Therefore, due to the junior priority date associated with these water rights, in order to avoid curtailment, RSV Subdivision will need to find a source of mitigation water to alleviate the combined loss of at least 29.87 AF from the Boise River. In years when the water rights go out of priority prior to the start of July more water will be required.

Recommendations

Water Right 63-9718

1. Keep existing POD location where it is at the west end of Glenwood Lake.
2. Install measurement device on trunk line that discharges water from Glenwood Lake into the RSV Subdivision.
3. Install staff gage in the N. Rivercove Place catch basin.
4. Modify POU
 - a. Pond POU: Eliminate Glenwood Lake and include all twelve lakes currently existing in the RSV Subdivision, refer to Figure 2 for graphical depiction of all RSV ponds.
 - b. Irrigation POU: Modify irrigation POU to depict irrigation as it actually occurs today. Irrigation has been described as the north and east shores of Long Lake, a 20-foot buffer around all 12 lakes, irrigation of club house lot, and irrigation of subdivision entrance open space lot, refer to figure 2 for graphical depiction. Note this POU should be verified at the time of transfer.
5. Beneficial Use
 - a. Eliminate the use of the Long Lake pump station in support of irrigation. Since water is diverted from the Boise River into Long Lake, the Boise River is the source of any irrigation water used by this pump station. However, water right 63-9718 only recognizes Village Lake as a source of water.
 - b. Ignore condition on water right that states, *"The place of use for irrigation is a greenbelt"*. This is no longer accurate. The greenbelt is now owned by Garden City and it is not clear if it is still irrigated. As of the SRBA partial decree this condition is "explanatory" and therefore is no longer administrable.
6. Mitigation: When this water right is out of priority (typically a minimum of 123 days a year), the irrigation use under this right must be curtailed or mitigated. Consumptive water use associated with the irrigation of 11 acres under this right from 7/1-10/31 is 22.6 AF. Conditional language recognizing the ability to mitigate in association with the right should be included as part of the transfer.
 - a. Rather than rely on a theoretical calculation, RSV subdivision could install flow meters on each pump station. The metered volume provides more accurate and perhaps lower determination of irrigation use than the theoretical calculation. This may benefit RSV in determining mitigation or replacement water supply costs.

Water Right 63-9751

1. Keep existing POD location where it is on the Boise River near the east end of Westmorland Park approximately 0.2 miles upstream of Glenwood Bridge.
2. Install measurement device on trunk line that discharges water from Glenwood Lake into the RSV Subdivision.
3. Install staff gage in the N. Rivercove Place catch basin.
4. Modify POU to eliminate Glenwood Lake and include all 12 lakes currently existing in the RSV Subdivision, refer to Figure 2 for graphical depiction of all RSV ponds.
5. Mitigation: When this water right is out of priority (typically a minimum of 123 days a year), the aesthetic use under this right must be curtailed or mitigated. An estimate of the evaporative loss of water associated with the ponds under this right from 7/1-10/31 is 7.3 AF. Conditional language recognizing the ability to mitigate in association with the right should be included as part of the transfer.

Control Devices

1. My research indicates no additional control devices are required.
 - a. WR 63-9718: The confirmed POD for this water right is on the west end of Glenwood Lake. This POD already has a suitable canal gate in place that offers working control of the diversion and the capability to be locked by the Watermaster.
 - b. WR 63-9751: The POD for this water right does not currently have a control device associated with it. However, since any water that is not diverted downstream into the RSV Subdivision returns directly to the Boise River a device is not warranted at this time.
 - c. Long Lake: A POD from the Boise River diverts water into Long Lake. This POD does not have a control device associated with it. At this time I have assumed that Long Lake is a relic river channel and therefore a natural extension of the river beneficial to the system for its flood storage capabilities⁴. As such, the control of water into Long Lake by the Watermaster is not warranted at this time.

Measurement Devices


1. From my investigations I have concluded that much of the conveyance system from the POD on the Boise River downstream to the discharge of water into the uppermost RSV pond is flowing full under modest head even at minimum river flow conditions. At high flows the system is likely completely submerged and potentially flowing under a substantial head. For this reason I did not pursue the design of a gravity flow measurement device such as a weir or submerged orifice.
2. Downstream of the POD of WR 63-9718 from Glenwood Lake I recommend installing either an insert-type Doppler flow meter (DFM) or insert-type magnetic flow meter to measure the diversion of water into the RSV Subdivision under both water rights.
 - a. I recommend installing the device immediately upstream of the catch basin in N. Rivercove Place in the open space common lot.

⁴ This understanding was conveyed to me by Tom Arkoosh and other members of the RSV Subdivision HOA. This understanding is potentially a subject open for further interpretation; however, I did not investigate it in association with this memo.

- b. I received a quote of \$3,738 dollars from Searle Technologies (telephone: 801.423.2013) for a MACE AgriFlo insert-type Doppler flow meter, complete with batteries, data logger, enclosure, laptop connection, mounting kit, 12 volt/5 watt solar panel, and velocity sensor.
 - c. I received a quote of \$3,199 dollar from Flosonics Inc. (telephone 541.561.5269) for a GF Signet magmeter inert-type flow meter, complete with sensor (model 2552) and digital display (model 8550-1).
- 3. I recommend installing a staff gage in the storm water runoff catch basin located in the east curb line of N. Rivercove Place. The 24-inch gravity line conveying water from Glenwood Lake to the RSV Subdivision passes through or daylights in this structure. In conjunction with the flow meter a relationship between stage (in the catch basin) and flow rate (in the pipe) might exist, such that in the future, flow rate might be reliably estimated by a visual reading of stage in the catch basin. This would be an inexpensive means of providing measurement redundancy and could serve as a backup in the event of meter failure.
- 4. I recommend installing 2-inch diameter magnetic flow meters on each irrigation pump station to accurately gage how much water is actually used for irrigation by RSV Subdivision. The volume of actual irrigation is potentially less than a theoretical estimation of consumptive losses thereby leading to a reduction in the volume of water required for mitigation.
 - a. I recommend installing the devices on existing free and clear runs of pipe (~24 inches in length) downstream of the filtration devices as observed on both the Rivercove and Lakeview pump stations.
 - b. I received a quote of \$759 dollars from Searle Technologies (telephone: 801.423.2013) for a single 2" magmeter (WMP101-200) flow meter by Global Water, complete with meter, totalizer, digital read out, external power cable (20 feet), and fitting kit. Note this price is for a system capable of metering one pump station.

Miscellaneous

- 1. Long Lake has a check dam structure at the outlet that artificially elevates the water surface of the lake. The potential exists that an aesthetic water right should be required to facilitate the current operation of the lake. To my knowledge no existing water rights are associated with Long Lake. This issue was not pursued as a part of the investigations summarized in this memo.
- 2. While on site in 2010 and 2011 Department staff observed a number of small pump stations located on individual residential lots throughout the subdivision. These small pump station likely serve for the irrigation of individual lots. These pump station are not to be confused with the Rivercove, Lakeview, and Long Lake pump stations discussed in this memo. These additional pump stations on private lots may be considered unauthorized diversions and subject to enforcement action by IDWR.
- 3. While on site in 2010 and 2011 Department staff observed a number of aesthetic diversions of water from the RSV Subdivision pond system into private water features located on individual residential lots. These features may potentially increase the consumptive use under the water rights and/or may not be consistent with the uses authorized by the rights.

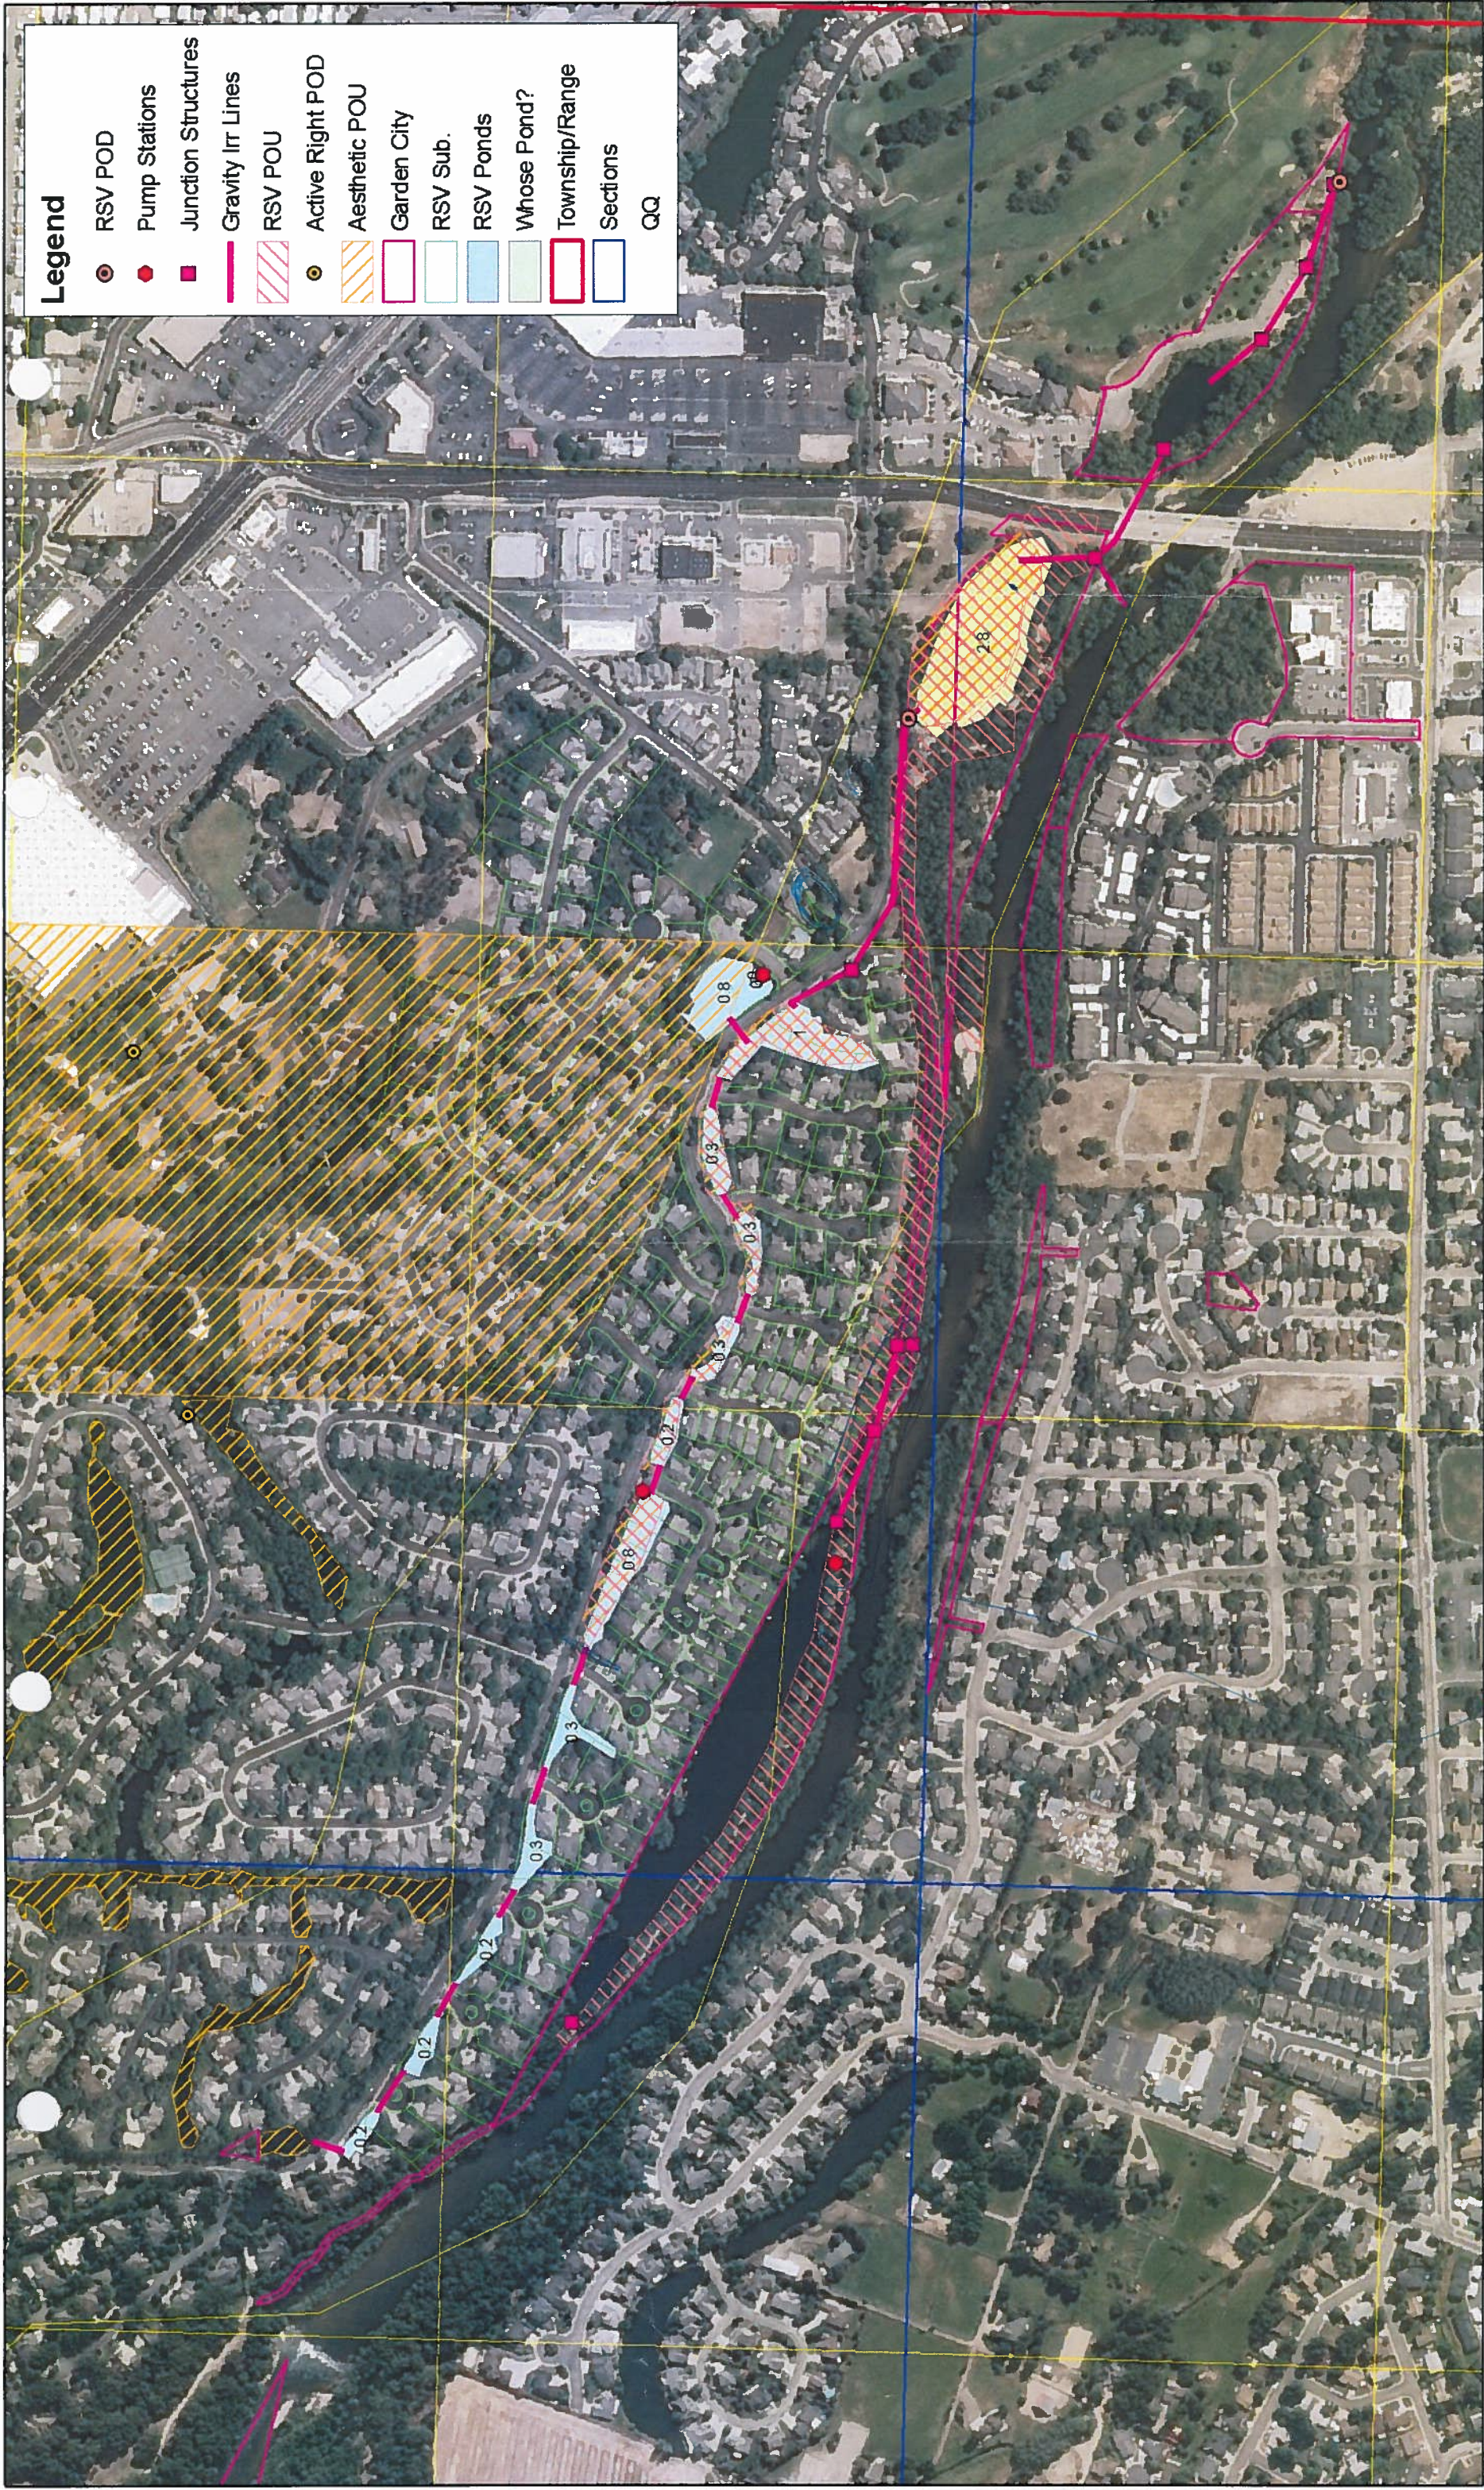


Riverside Village Exhibit Map

CITY OF BOISE
GIS MAP SS
2-2-11



ACHD GIS UTIL. MAP

2-1-11

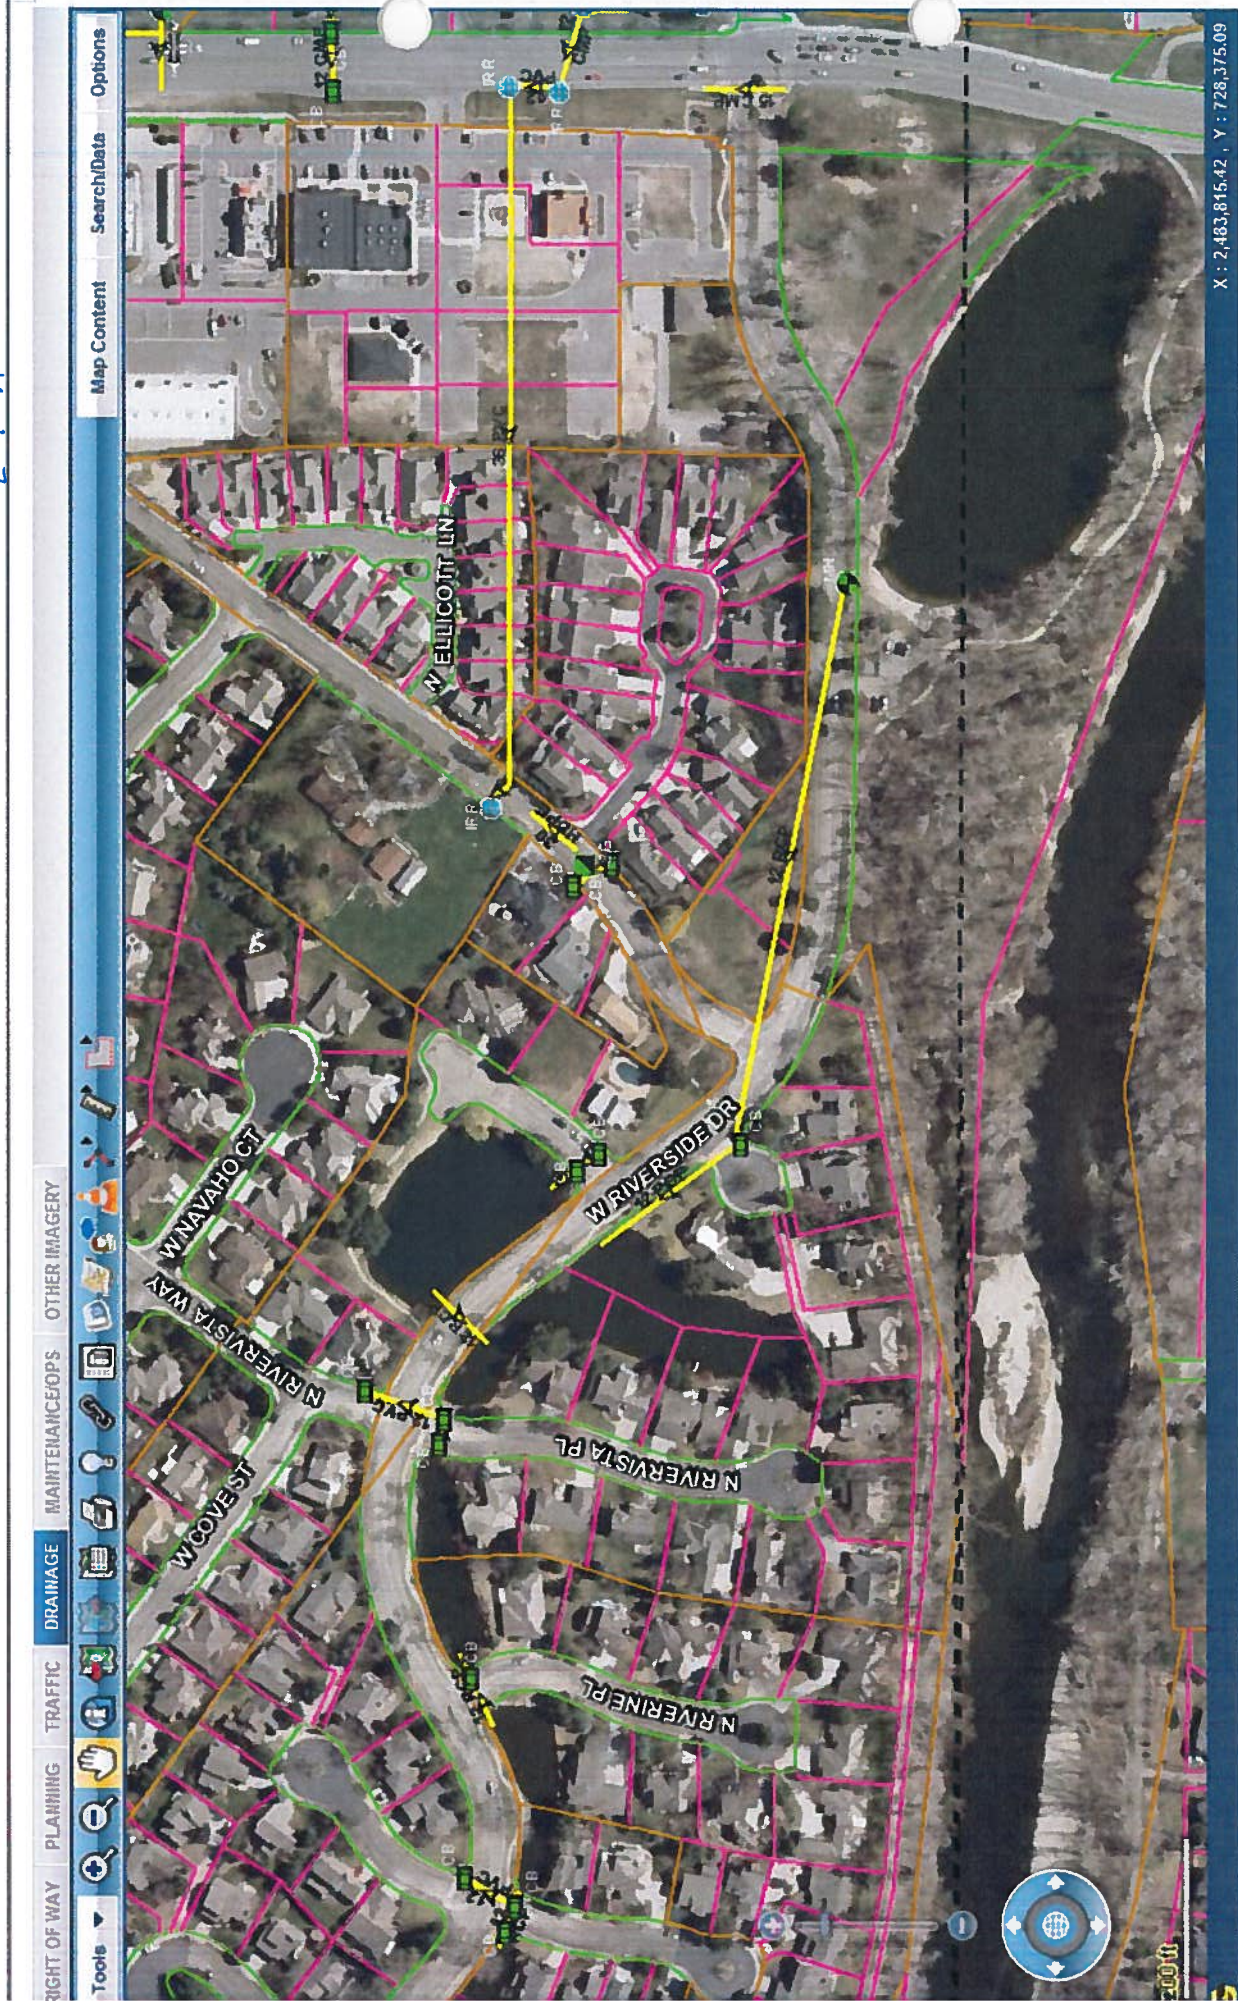

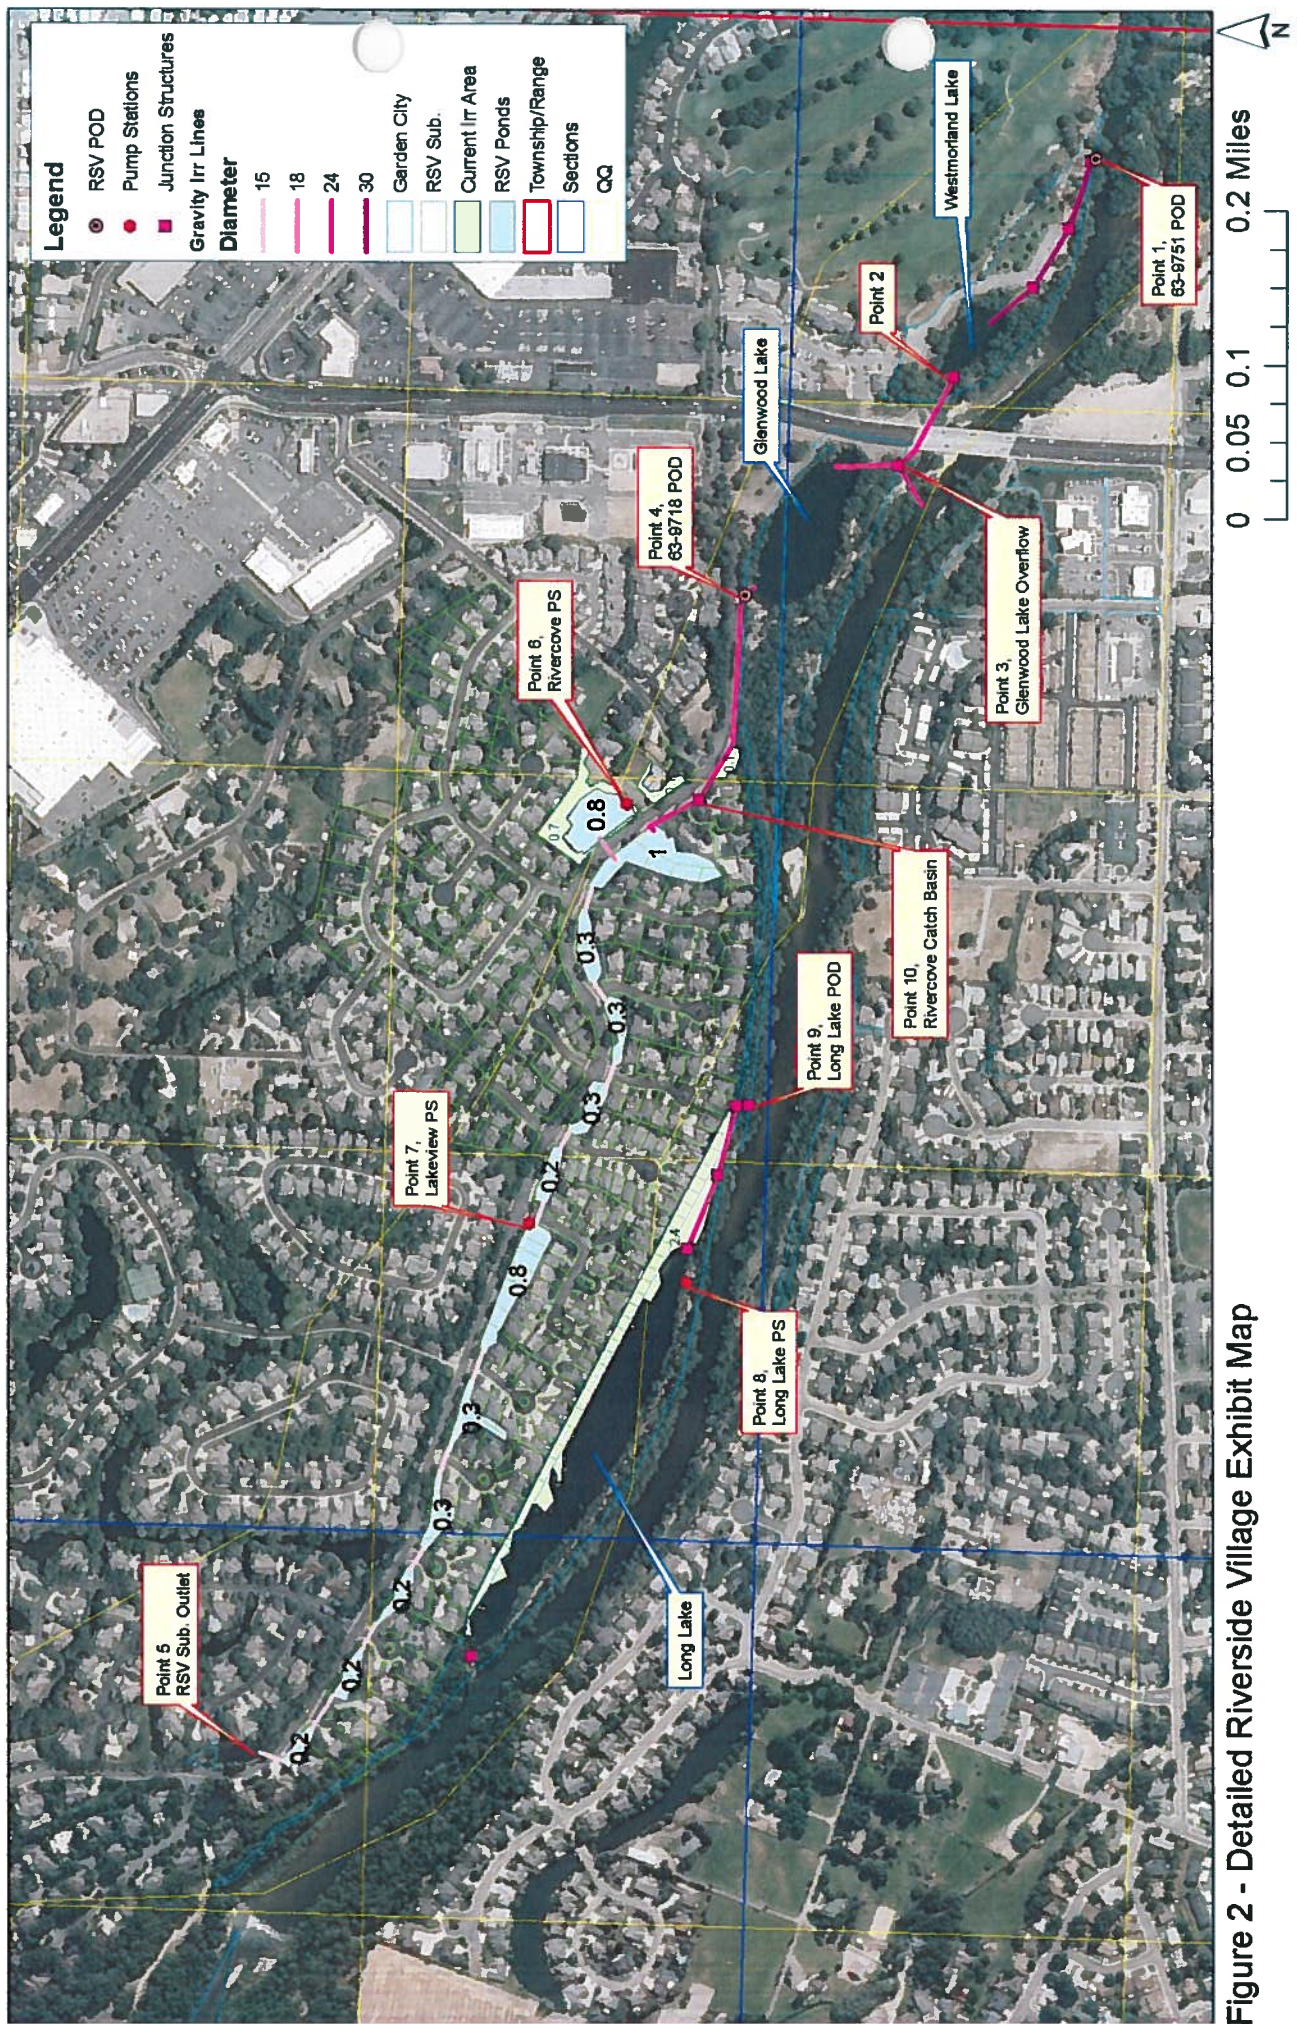


Figure 2 - Detailed Riverside Village Exhibit Map

	Pond Dimension Summary Table				
	Pond	Surface Area (ac)	Pond Vol. (af)*	Pond Vol. (af)**	Decreed Vol. (af)***
					Desc.
	1	2.8	42.0	42.0	--
	2	1.0	15.0	12.0	--
	3	0.8	12.0	9.6	--
	4	0.3	4.5	3.6	--
	5	0.3	4.5	3.6	--
	6	0.3	4.5	3.6	--
	7	0.2	3.0	2.4	--
	8	0.8	12.0	9.6	--
	9	0.3	4.5	3.6	--
	10	0.3	4.5	3.6	--
	11	0.2	3.0	2.4	--
	12	0.2	3.0	2.4	--
	13	0.1	1.5	1.2	--
	Total:	7.6	114.0	99.6	78.0
	RSV Total:	4.8	72.0	57.6	78.0
	*Assumes an average pond depth of 15 feet as reported from the 63-9718 Beneficial Use Field Exam.				
	**Assumes an average pond depth of 12 feet as reported by Don Anton in verbal correspondence that occurred in 2011. Glenwood Lake still uses 15 foot depth in this calculation.				
	***As decreed in water right 63-9718.				

ETIDAHO 2009: ET and Consumptive Irrigation Water Requirement Parameters for Boise WSFO Airport (NWS - 101022)

Description	Apr	May	Jun	Jul	Aug	Sep	Oct	Land Cover Desc.
Mean Actual ET (mm/day)	3.98	5.48	6.48	6.88	5.98	4.61	2.88	Grass - Turf (lawns) - Irrigated
Mean Actual ET (in/day)	0.16	0.22	0.26	0.27	0.24	0.18	0.11	Grass - Turf (lawns) - Irrigated

Allen, Richard G. and Clarence W. Robison, 2009. *Evapotranspiration and Consumptive Irrigation Water Requirements for Idaho: Supplement updating the Time Series through December 2008*. Resear

Technical Completion Report, Kimberly Research and Extension Center, University of Idaho, Moscow, ID.

Month	Apr	May	Jun	Jul	Aug	Sep	Oct
No. of Days	30	31	30	31	31	30	31

Mean Actual ET (ft/month)	0.39	0.56	0.64	0.70	0.61	0.45	0.29
Mean Actual ET (AF)	4.31	6.13	7.02	7.70	6.69	4.99	3.22

Table 2 - Summary of Monthly ET Losses from 11 acres of Irrigated Landscaping

Description	Apr	May	Jun	Jul	Aug	Sep	Oct
Mean Actual Evaporation (AF)	4.31	6.13	7.02	7.70	6.69	4.99	3.22


Evaporative Rates obtained from ETIdaho for "Grass - Turf (lawns) - Irrigated for the NWS - Boise WSFO Airport

Seasonal Volume:	40.06	af
Out of Priority Volume:	22.60	af


ET and Consumptive Irrigation Water Requirement Parameters for Idaho																																																																																
Pond	Surface Area (ac)	Water Consumption Parameter	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Land Cover Description																																																																	
1	2.8	Mean Actual ET (mm/day)	0.42	0.99	1.99	3.12	3.9	4.71	5.02	4.33	3.3	2.24	0.84	0.4	Open Water - Shallow systems (ponds, streams)																																																																	
2	1.0	Mean Potential ET (mm/day)	0.42	0.99	1.99	3.12	3.9	4.71	5.02	4.33	3.3	2.24	0.84	0.4	Open Water - Shallow systems (ponds, streams)																																																																	
3	0.8	Mean Actual ET (mm/day)	0.71	1.16	1.45	1.82	2.06	2.37	2.33	2.09	1.99	2.26	1.21	0.76	Open water - deep systems (lakes, reservoirs)																																																																	
4	0.3	Mean Potential ET (mm/day)	0.71	1.16	1.45	1.82	2.06	2.37	2.33	2.09	1.99	2.26	1.21	0.76	Open water - deep systems (lakes, reservoirs)																																																																	
5	0.3	Mean Actual ET (mm/day)	0.49	1.16	2.32	3.64	4.55	5.49	5.85	5.05	3.85	2.61	0.98	0.47	Open water - small stock ponds																																																																	
6	0.3	Mean Potential ET (mm/day)	0.49	1.16	2.32	3.64	4.55	5.49	5.85	5.05	3.85	2.61	0.98	0.47	Open water - small stock ponds																																																																	
7	0.2	Mean Actual ET (mm/day)	0.51	0.94	1.83	4.55	6.59	7.93	8.43	7.32	5.56	3.65	1.05	0.48	Alfalfa - peak (no cutting effects)																																																																	
8	0.8	Mean Potential ET (mm/day)	0.52	1.02	2.02	4.56	6.59	7.93	8.43	7.32	5.56	3.65	1.08	0.49	Alfalfa - peak (no cutting effects)																																																																	
9	0.3	Allen, Richard G. and Clarence W. Robison, 2009. Evapotranspiration and Consumptive Irrigation Water Requirements for Idaho: Supplement updating the Time Series through December 2008, Research Technical Completion Report, Kimberly Research and Extension Center, University of Idaho, Moscow, ID.																																																																														
10	0.3																																																																															
11	0.2																																																																															
12	0.2																																																																															
13	0.1																																																																															
Total:	7.6																																																																															
RSV Total:	4.8																																																																															
		Monthly Evaporation Volume Loss from Riverside Village Ponds																																																																														
		Water Consumption Parameter	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Land Cover Description																																																																	
		Mean Actual ET (AF)	0.21	0.44	0.98	1.48	1.92	2.24	2.47	2.13	1.57	1.10	0.40	0.20	Open Water - Shallow systems (ponds, streams)																																																																	
		Mean Actual ET (AF)	0.35	0.51	0.71	0.86	1.01	1.13	1.14	1.03	0.95	1.11	0.57	0.37	Open water - deep systems (lakes, reservoirs)																																																																	
		Mean Actual ET (AF)	0.24	0.51	1.14	1.73	2.23	2.61	2.87	2.48	1.83	1.28	0.47	0.23	Open water - small stock ponds																																																																	
		Mean Actual ET (AF)	0.25	0.42	0.90	2.16	3.24	3.77	4.14	3.59	2.64	1.79	0.50	0.24	Alfalfa - peak (no cutting effects)																																																																	
		Riverside Village - Monthly Pond Surface Evaporation (AF) <table><thead><tr><th>Month</th><th>Open Water - Shallow</th><th>Open Water - Deep</th><th>Open Water - Stock Pond</th><th>Alfalfa Peak</th></tr></thead><tbody><tr><td>Jan</td><td>0.21</td><td>0.35</td><td>0.24</td><td>0.25</td></tr><tr><td>Feb</td><td>0.44</td><td>0.51</td><td>0.51</td><td>0.42</td></tr><tr><td>Mar</td><td>0.98</td><td>0.71</td><td>1.14</td><td>0.90</td></tr><tr><td>Apr</td><td>1.48</td><td>0.86</td><td>1.73</td><td>2.16</td></tr><tr><td>May</td><td>1.92</td><td>1.01</td><td>2.23</td><td>3.24</td></tr><tr><td>Jun</td><td>2.24</td><td>1.13</td><td>2.61</td><td>3.77</td></tr><tr><td>Jul</td><td>2.47</td><td>1.14</td><td>2.87</td><td>4.14</td></tr><tr><td>Aug</td><td>2.13</td><td>1.03</td><td>2.48</td><td>3.59</td></tr><tr><td>Sep</td><td>1.57</td><td>0.95</td><td>1.83</td><td>2.64</td></tr><tr><td>Oct</td><td>1.10</td><td>0.57</td><td>1.28</td><td>1.79</td></tr><tr><td>Nov</td><td>0.40</td><td>0.37</td><td>0.47</td><td>0.50</td></tr><tr><td>Dec</td><td>0.20</td><td>0.23</td><td>0.24</td><td>0.24</td></tr></tbody></table>														Month	Open Water - Shallow	Open Water - Deep	Open Water - Stock Pond	Alfalfa Peak	Jan	0.21	0.35	0.24	0.25	Feb	0.44	0.51	0.51	0.42	Mar	0.98	0.71	1.14	0.90	Apr	1.48	0.86	1.73	2.16	May	1.92	1.01	2.23	3.24	Jun	2.24	1.13	2.61	3.77	Jul	2.47	1.14	2.87	4.14	Aug	2.13	1.03	2.48	3.59	Sep	1.57	0.95	1.83	2.64	Oct	1.10	0.57	1.28	1.79	Nov	0.40	0.37	0.47	0.50	Dec	0.20	0.23	0.24	0.24
Month	Open Water - Shallow	Open Water - Deep	Open Water - Stock Pond	Alfalfa Peak																																																																												
Jan	0.21	0.35	0.24	0.25																																																																												
Feb	0.44	0.51	0.51	0.42																																																																												
Mar	0.98	0.71	1.14	0.90																																																																												
Apr	1.48	0.86	1.73	2.16																																																																												
May	1.92	1.01	2.23	3.24																																																																												
Jun	2.24	1.13	2.61	3.77																																																																												
Jul	2.47	1.14	2.87	4.14																																																																												
Aug	2.13	1.03	2.48	3.59																																																																												
Sep	1.57	0.95	1.83	2.64																																																																												
Oct	1.10	0.57	1.28	1.79																																																																												
Nov	0.40	0.37	0.47	0.50																																																																												
Dec	0.20	0.23	0.24	0.24																																																																												
		<table><thead><tr><th>Annual</th><th>Vol.</th><th>Land Cover Description</th></tr></thead><tbody><tr><td>15.1</td><td>15.1</td><td>Open Water - Shallow systems (ponds, streams)</td></tr><tr><td>9.8</td><td>9.8</td><td>Open water - deep systems (lakes, reservoirs)</td></tr><tr><td>17.6</td><td>17.6</td><td>Open water - small stock ponds</td></tr><tr><td>23.6</td><td>23.6</td><td>Alfalfa - peak (no cutting effects)</td></tr></tbody></table>														Annual	Vol.	Land Cover Description	15.1	15.1	Open Water - Shallow systems (ponds, streams)	9.8	9.8	Open water - deep systems (lakes, reservoirs)	17.6	17.6	Open water - small stock ponds	23.6	23.6	Alfalfa - peak (no cutting effects)																																																		
Annual	Vol.	Land Cover Description																																																																														
15.1	15.1	Open Water - Shallow systems (ponds, streams)																																																																														
9.8	9.8	Open water - deep systems (lakes, reservoirs)																																																																														
17.6	17.6	Open water - small stock ponds																																																																														
23.6	23.6	Alfalfa - peak (no cutting effects)																																																																														
		Table 1a - Summary of Monthly Evaporative Losses from 7.6 acres of Pond Surfaces (Includes Glenwood Lake)																																																																														
		Description	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec																																																																		
		Mean Actual Evaporation (AF)	0.33	0.70	1.55	2.35	3.03	3.54	3.90	3.37	2.48	1.74	0.63	0.31																																																																		
		Evaporative Rates obtained from ETIdaho for "Open Water - Shallow Systems (ponds, streams) for the NWS - Boise WSFO Airport																																																																														
		Table 1 - Summary of Monthly Evaporative Losses from 4.8 acres of Pond Surfaces (Excludes Glenwood Lake)																																																																														
		Description	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec																																																																		
		Mean Actual Evaporation (AF)	0.21	0.44	0.98	1.48	1.92	2.24	2.47	2.13	1.57	1.10	0.40	0.20																																																																		
		Evaporative Rates obtained from ETIdaho for "Open Water - Shallow Systems (ponds, streams) for the NWS - Boise WSFO Airport																																																																														
										Annual Volume:	15.11	af																																																																				
										Seasonal Volume:	12.90	af																																																																				
										Out of Priority Volume:	7.26	af																																																																				

PLAN	DATE	BY
SURVEYED PLATTED ALIGNED CHECKED BY DATE		


PROFILE	DATE	BY
SURVEYED PLATTED CHECKED BY DATE		

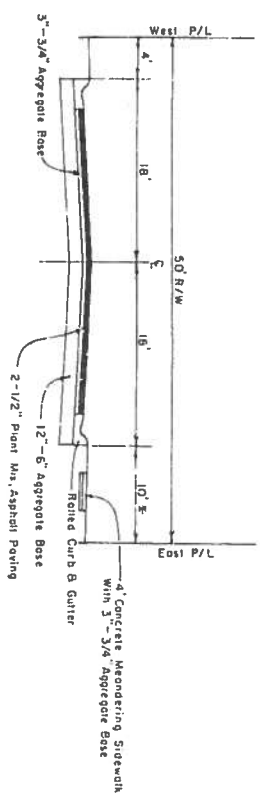

TYPICAL SECTION
RIVERVISTA PLACE
RIVERFRONT PLACE
LAKE'S ESCAPE PLACE
Side-slopes to be Mandrel Between Back of Curb and P/L. Actual Location is to be Field Located and Approved by A.C.H.D. Before Construction.

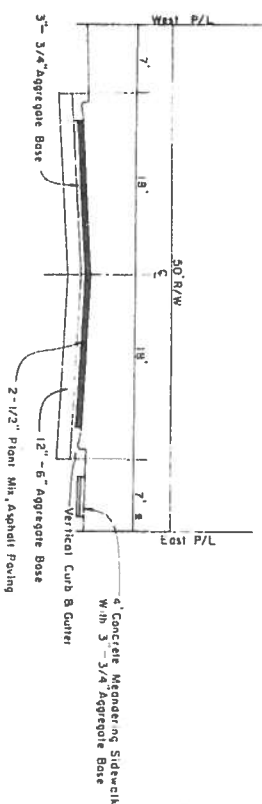

TYPICAL SECTION
STRAWBERRY GLENN ROAD

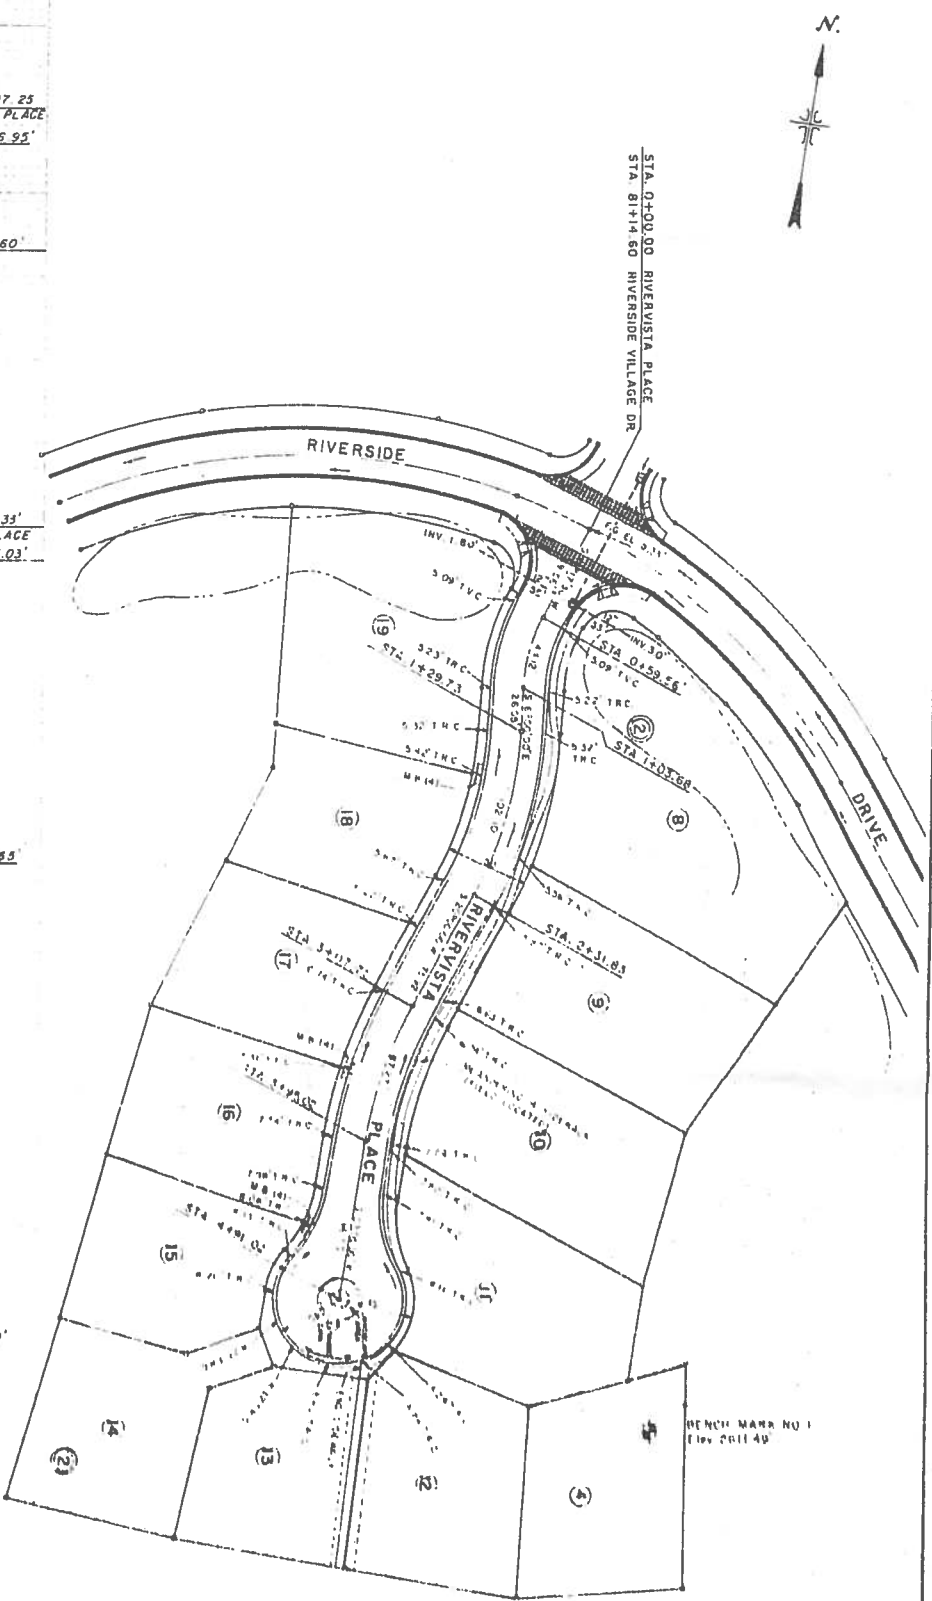

STA. 87+77.97 FG EL. 2608.55'
STA. 0+00.00 STRAWBERRY GLENN RD
STA. 0+20.00 FG EL. 2608.15'
CONSTRUCT CROSS DRAIN

STA. 2+13.93 FG EL. 2609.51'

STA. 86+52.48 FG EL. 2607.25
STA. 0+00.00 RIVERCOVE PLACE
STA. 0+13.00 FG EL. 2606.95'

STA. 0+85.00 FG EL. 2609.60
CENTER OF CULDESAC

STA. 81+14.60 FG EL. 2609.35'
STA. 0+00.00 RIVERVISTA PLACE
STA. 0+12.50 FG EL. 2609.03'

STA. 2+00.00 FG EL. 2609.65

STA. 41+10.00 FG EL. 2609.65
CENTER OF CULDESAC

STRAWBERRY GLENN ROAD

RIVERCOVE PLACE

RIVERVISTA PLACE

RIVERSIDE VILLAGE



RECORD DRAWINGS
DATE SOURCE

JOHNSON
ENGINEERING

ENGINEERING

PLAN	DATE	BY	CHKD
3/10/77	3/10/77	3/10/77	3/10/77
NOTE: 1. 10' WIDE			
2. 10' WIDE			
3. 10' WIDE			
4. 10' WIDE			
5. 10' WIDE			
6. 10' WIDE			
7. 10' WIDE			
8. 10' WIDE			
9. 10' WIDE			
10. 10' WIDE			
11. 10' WIDE			
12. 10' WIDE			
13. 10' WIDE			
14. 10' WIDE			
15. 10' WIDE			
16. 10' WIDE			
17. 10' WIDE			
18. 10' WIDE			
19. 10' WIDE			
20. 10' WIDE			
21. 10' WIDE			
22. 10' WIDE			
23. 10' WIDE			
24. 10' WIDE			
25. 10' WIDE			
26. 10' WIDE			
27. 10' WIDE			
28. 10' WIDE			
29. 10' WIDE			
30. 10' WIDE			
31. 10' WIDE			
32. 10' WIDE			
33. 10' WIDE			
34. 10' WIDE			
35. 10' WIDE			
36. 10' WIDE			
37. 10' WIDE			
38. 10' WIDE			
39. 10' WIDE			
40. 10' WIDE			
41. 10' WIDE			
42. 10' WIDE			
43. 10' WIDE			
44. 10' WIDE			
45. 10' WIDE			
46. 10' WIDE			
47. 10' WIDE			
48. 10' WIDE			
49. 10' WIDE			
50. 10' WIDE			
51. 10' WIDE			
52. 10' WIDE			
53. 10' WIDE			
54. 10' WIDE			
55. 10' WIDE			
56. 10' WIDE			
57. 10' WIDE			
58. 10' WIDE			
59. 10' WIDE			
60. 10' WIDE			
61. 10' WIDE			
62. 10' WIDE			
63. 10' WIDE			
64. 10' WIDE			
65. 10' WIDE			
66. 10' WIDE			
67. 10' WIDE			
68. 10' WIDE			
69. 10' WIDE			
70. 10' WIDE			
71. 10' WIDE			
72. 10' WIDE			
73. 10' WIDE			
74. 10' WIDE			
75. 10' WIDE			
76. 10' WIDE			
77. 10' WIDE			
78. 10' WIDE			
79. 10' WIDE			
80. 10' WIDE			
81. 10' WIDE			
82. 10' WIDE			
83. 10' WIDE			
84. 10' WIDE			
85. 10' WIDE			
86. 10' WIDE			
87. 10' WIDE			
88. 10' WIDE			
89. 10' WIDE			
90. 10' WIDE			
91. 10' WIDE			
92. 10' WIDE			
93. 10' WIDE			
94. 10' WIDE			
95. 10' WIDE			
96. 10' WIDE			
97. 10' WIDE			
98. 10' WIDE			
99. 10' WIDE			
100. 10' WIDE			

PROFILE	DATE	BY	CHKD
3/10/77	3/10/77	3/10/77	3/10/77
NOTE: 1. 10' WIDE			
2. 10' WIDE			
3. 10' WIDE			
4. 10' WIDE			
5. 10' WIDE			
6. 10' WIDE			
7. 10' WIDE			
8. 10' WIDE			
9. 10' WIDE			
10. 10' WIDE			
11. 10' WIDE			
12. 10' WIDE			
13. 10' WIDE			
14. 10' WIDE			
15. 10' WIDE			
16. 10' WIDE			
17. 10' WIDE			
18. 10' WIDE			
19. 10' WIDE			
20. 10' WIDE			
21. 10' WIDE			
22. 10' WIDE			
23. 10' WIDE			
24. 10' WIDE			
25. 10' WIDE			
26. 10' WIDE			
27. 10' WIDE			
28. 10' WIDE			
29. 10' WIDE			
30. 10' WIDE			
31. 10' WIDE			
32. 10' WIDE			
33. 10' WIDE			
34. 10' WIDE			
35. 10' WIDE			
36. 10' WIDE			
37. 10' WIDE			
38. 10' WIDE			
39. 10' WIDE			
40. 10' WIDE			
41. 10' WIDE			
42. 10' WIDE			
43. 10' WIDE			
44. 10' WIDE			
45. 10' WIDE			
46. 10' WIDE			
47. 10' WIDE			
48. 10' WIDE			
49. 10' WIDE			
50. 10' WIDE			
51. 10' WIDE			
52. 10' WIDE			
53. 10' WIDE			
54. 10' WIDE			
55. 10' WIDE			
56. 10' WIDE			
57. 10' WIDE			
58. 10' WIDE			
59. 10' WIDE			
60. 10' WIDE			
61. 10' WIDE			
62. 10' WIDE			
63. 10' WIDE			
64. 10' WIDE			
65. 10' WIDE			
66. 10' WIDE			
67. 10' WIDE			
68. 10' WIDE			
69. 10' WIDE			
70. 10' WIDE			
71. 10' WIDE			
72. 10' WIDE			
73. 10' WIDE			
74. 10' WIDE			
75. 10' WIDE			
76. 10' WIDE			
77. 10' WIDE			
78. 10' WIDE			
79. 10' WIDE			
80. 10' WIDE			
81. 10' WIDE			
82. 10' WIDE			
83. 10' WIDE			
84. 10' WIDE			
85. 10' WIDE			
86. 10' WIDE			
87. 10' WIDE			
88. 10' WIDE			
89. 10' WIDE			
90. 10' WIDE			
91. 10' WIDE			
92. 10' WIDE			
93. 10' WIDE			
94. 10' WIDE			
95. 10' WIDE			
96. 10' WIDE			
97. 10' WIDE			
98. 10' WIDE			
99. 10' WIDE			
100. 10' WIDE			

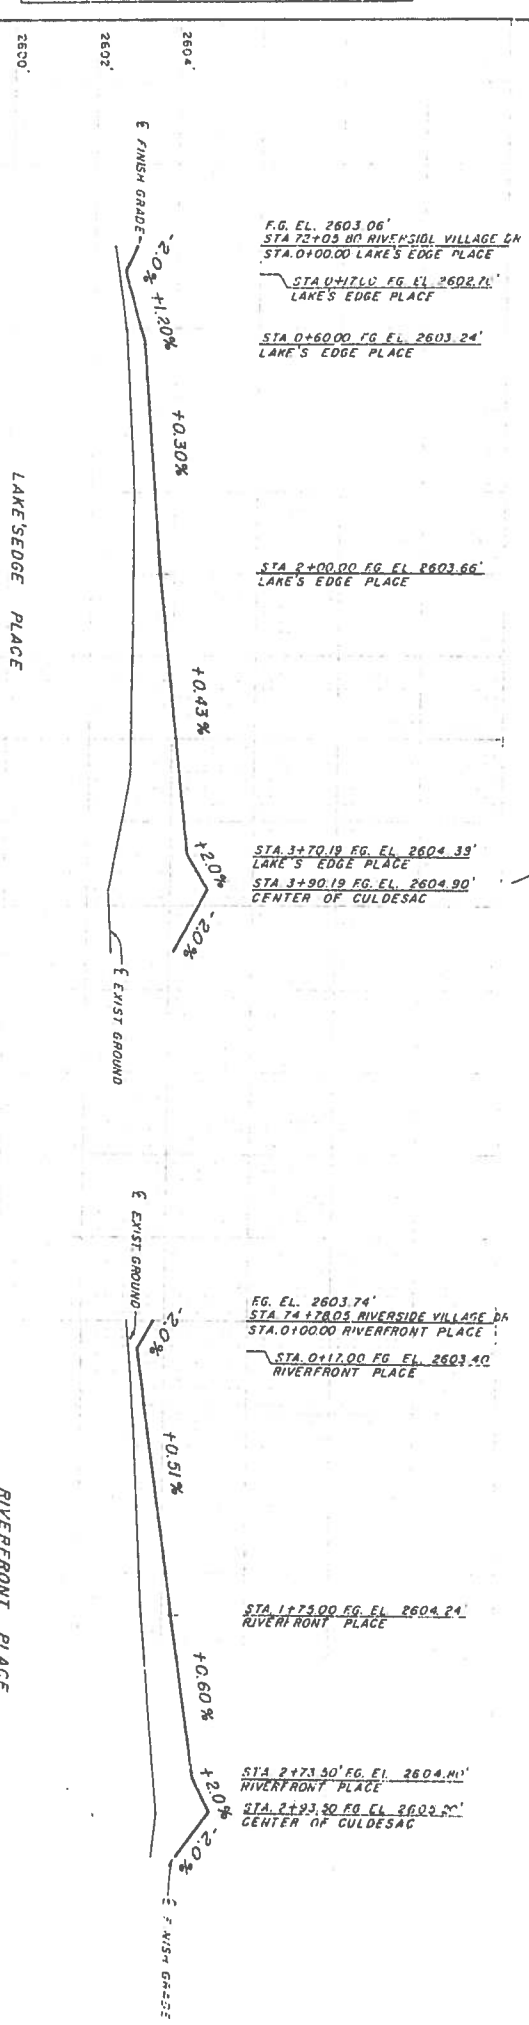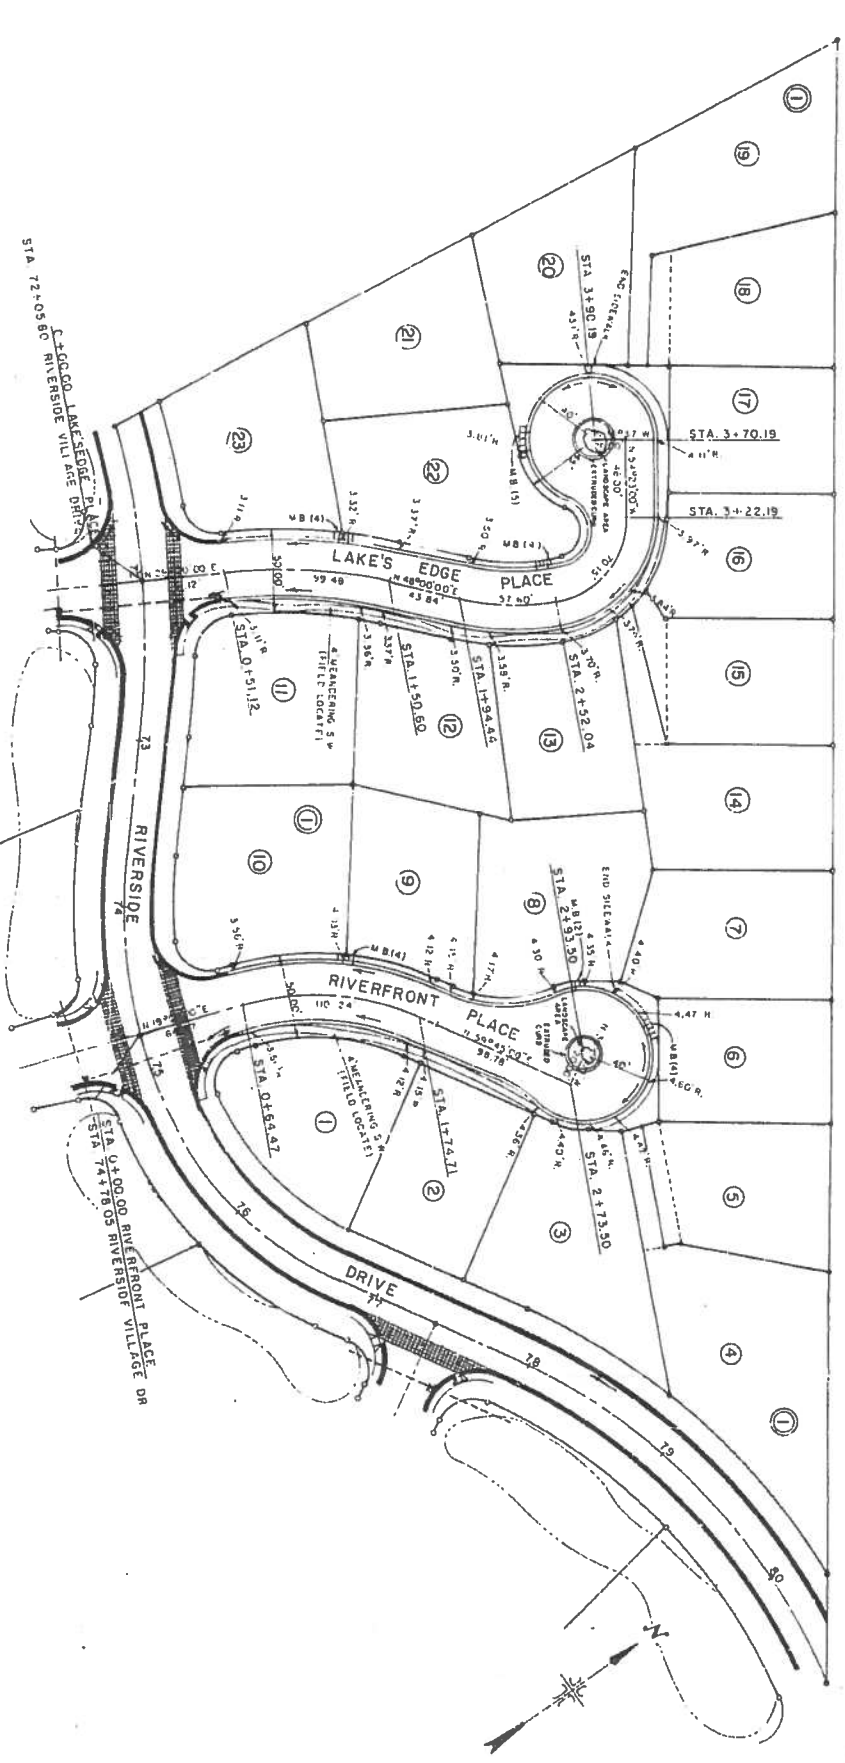


RECORD DRAWINGS
DATE SOURCE *Ro*

RIVERSIDE VILLAGE

JOHNSON ENGINEERING	DATE	BY	CHKD
3/10/77	3/10/77	3/10/77	3/10/77
NOTE: 1. 10' WIDE			
2. 10' WIDE			
3. 10' WIDE			
4. 10' WIDE			
5. 10' WIDE			
6. 10' WIDE			
7. 10' WIDE			
8. 10' WIDE			
9. 10' WIDE			
10. 10' WIDE			
11. 10' WIDE			
12. 10' WIDE			
13. 10' WIDE			
14. 10' WIDE			
15. 10' WIDE			
16. 10' WIDE			
17. 10' WIDE			
18. 10' WIDE			
19. 10' WIDE			
20. 10' WIDE			
21. 10' WIDE			
22. 10' WIDE			
23. 10' WIDE			
24. 10' WIDE			
25. 10' WIDE			
26. 10' WIDE			
27. 10' WIDE			
28. 10' WIDE			
29. 10' WIDE			
30. 10' WIDE			
31. 10' WIDE			
32. 10' WIDE			
33. 10' WIDE			
34. 10' WIDE			
35. 10' WIDE			
36. 10' WIDE			
37. 10' WIDE			
38. 10' WIDE			
39. 10' WIDE			
40. 10' WIDE			
41. 10' WIDE			
42. 10' WIDE			
43. 10' WIDE			
44. 10' WIDE			
45. 10' WIDE			
46. 10' WIDE			
47. 10' WIDE			
48. 10' WIDE			
49. 10' WIDE			
50. 10' WIDE			
51. 10' WIDE			
52. 10' WIDE			
53. 10' WIDE			
54. 10' WIDE			
55. 10' WIDE			
56. 10' WIDE			
57. 10' WIDE			
58. 10' WIDE			
59. 10' WIDE			
60. 10' WIDE			
61. 10' WIDE			
62. 10' WIDE			
63. 10' WIDE			
64. 10' WIDE			
65. 10' WIDE			
66. 10' WIDE			
67. 10' WIDE			
68. 10' WIDE			
69. 10' WIDE			
70. 10' WIDE			
71. 10' WIDE			
72. 10' WIDE			
73. 10' WIDE			
74. 10' WIDE			
75. 10' WIDE			
76. 10' WIDE			
77. 10' WIDE			
78. 10' WIDE			
79. 10' WIDE			
80. 10' WIDE			
81. 10' WIDE			
82. 10' WIDE			
83. 10' WIDE			
84. 10' WIDE			
85. 10' WIDE			
86. 10' WIDE			
87. 10' WIDE			
88. 10' WIDE			
89. 10' WIDE			
90. 10' WIDE			
91. 10' WIDE			
92. 10' WIDE			
93. 10' WIDE			
94. 10' WIDE			
95. 10' WIDE			
96. 10' WIDE			
97. 10' WIDE			
98. 10' WIDE			
99. 10' WIDE			
100. 10' WIDE			


PROFILE	BY	DATE
SURVEYED PLOTTED CHECKED 8-11-1978 10-11-1978 11-11-1978		

PLAN	BY	DATE
SURVEYED PLOTTED CHECKED 8-11-1978 10-11-1978 11-11-1978		

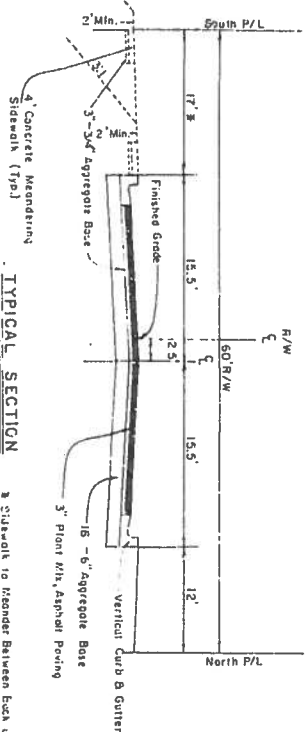

TYPICAL SECTION
RIVERSIDE VILLAGE DRIVE

3' Sub-base to be placed between each of Curb and P/L. Actual Location to be Field Located and Approved by A.C.H.D. Before Construction.

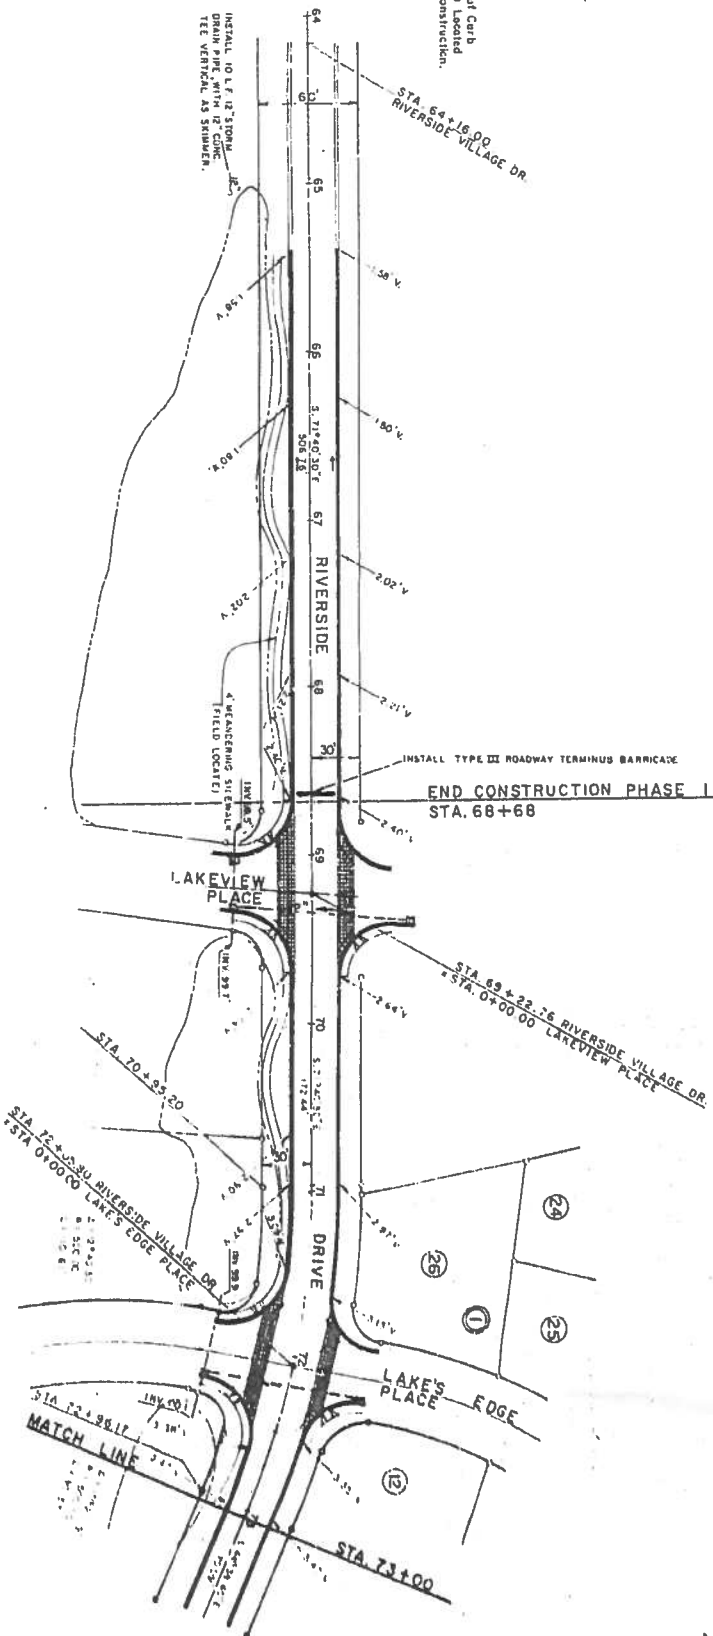

FINISH GRADE AT E

STA. 64+00.00 FG. EL. 2601.05
RIVERSIDE VILLAGE DR.

B.M. No. 1
Elev. 2614.9

END PHASE I CONSTRUCTION
STA. 68+68

RIVERSIDE VILLAGE DR.
STA. 69+22.76 FG. EL. 2602.36
STA. 0+00.00 LAKEVIEW PLACE
INSTALL 70' L.F. 12" STORM DRAIN PIPE, 45' RT.
STA. 69+37 CONST. 2 STD. DROP INLETS - 45' LT. & 45' RT., - INSTALL 90' L.F. 12" STORM DRAIN PIPE, GRATE EL. 67.8 RT. 1.94' PIPE INV. LT. 99.6', INV. RT. 99.6'

RIVERSIDE VILLAGE DR.
STA. 72+03.80 FG. EL. 2603.08
STA. 0+00.00 LAKE'S EDGE PLACE
INSTALL 75' L.F. 12" STORM DRAIN PIPE
STA. 72+18 CONST. 2 STD. DROP INLETS - 45' LT. & 45' RT.
INSTALL 95' L.F. 12" STORM DRAIN PIPE, GRATE EL. LT. & RT. 2.64', PIPE INV. LT. 0.00, INV. RT. 0.00
RIVERSIDE VILLAGE DR.
STA. 73+00.00 FG. EL. 2603.30
MATCH LINE

RECORD DRAWINGS
DATE SOURCE *EC*

RIVERSIDE VILLAGE


STREETS

JOHNSON
ENGINEERING

ENGINEER


10-11-1978

PLAN
DATE 08/07/00
BY
SHEET 1



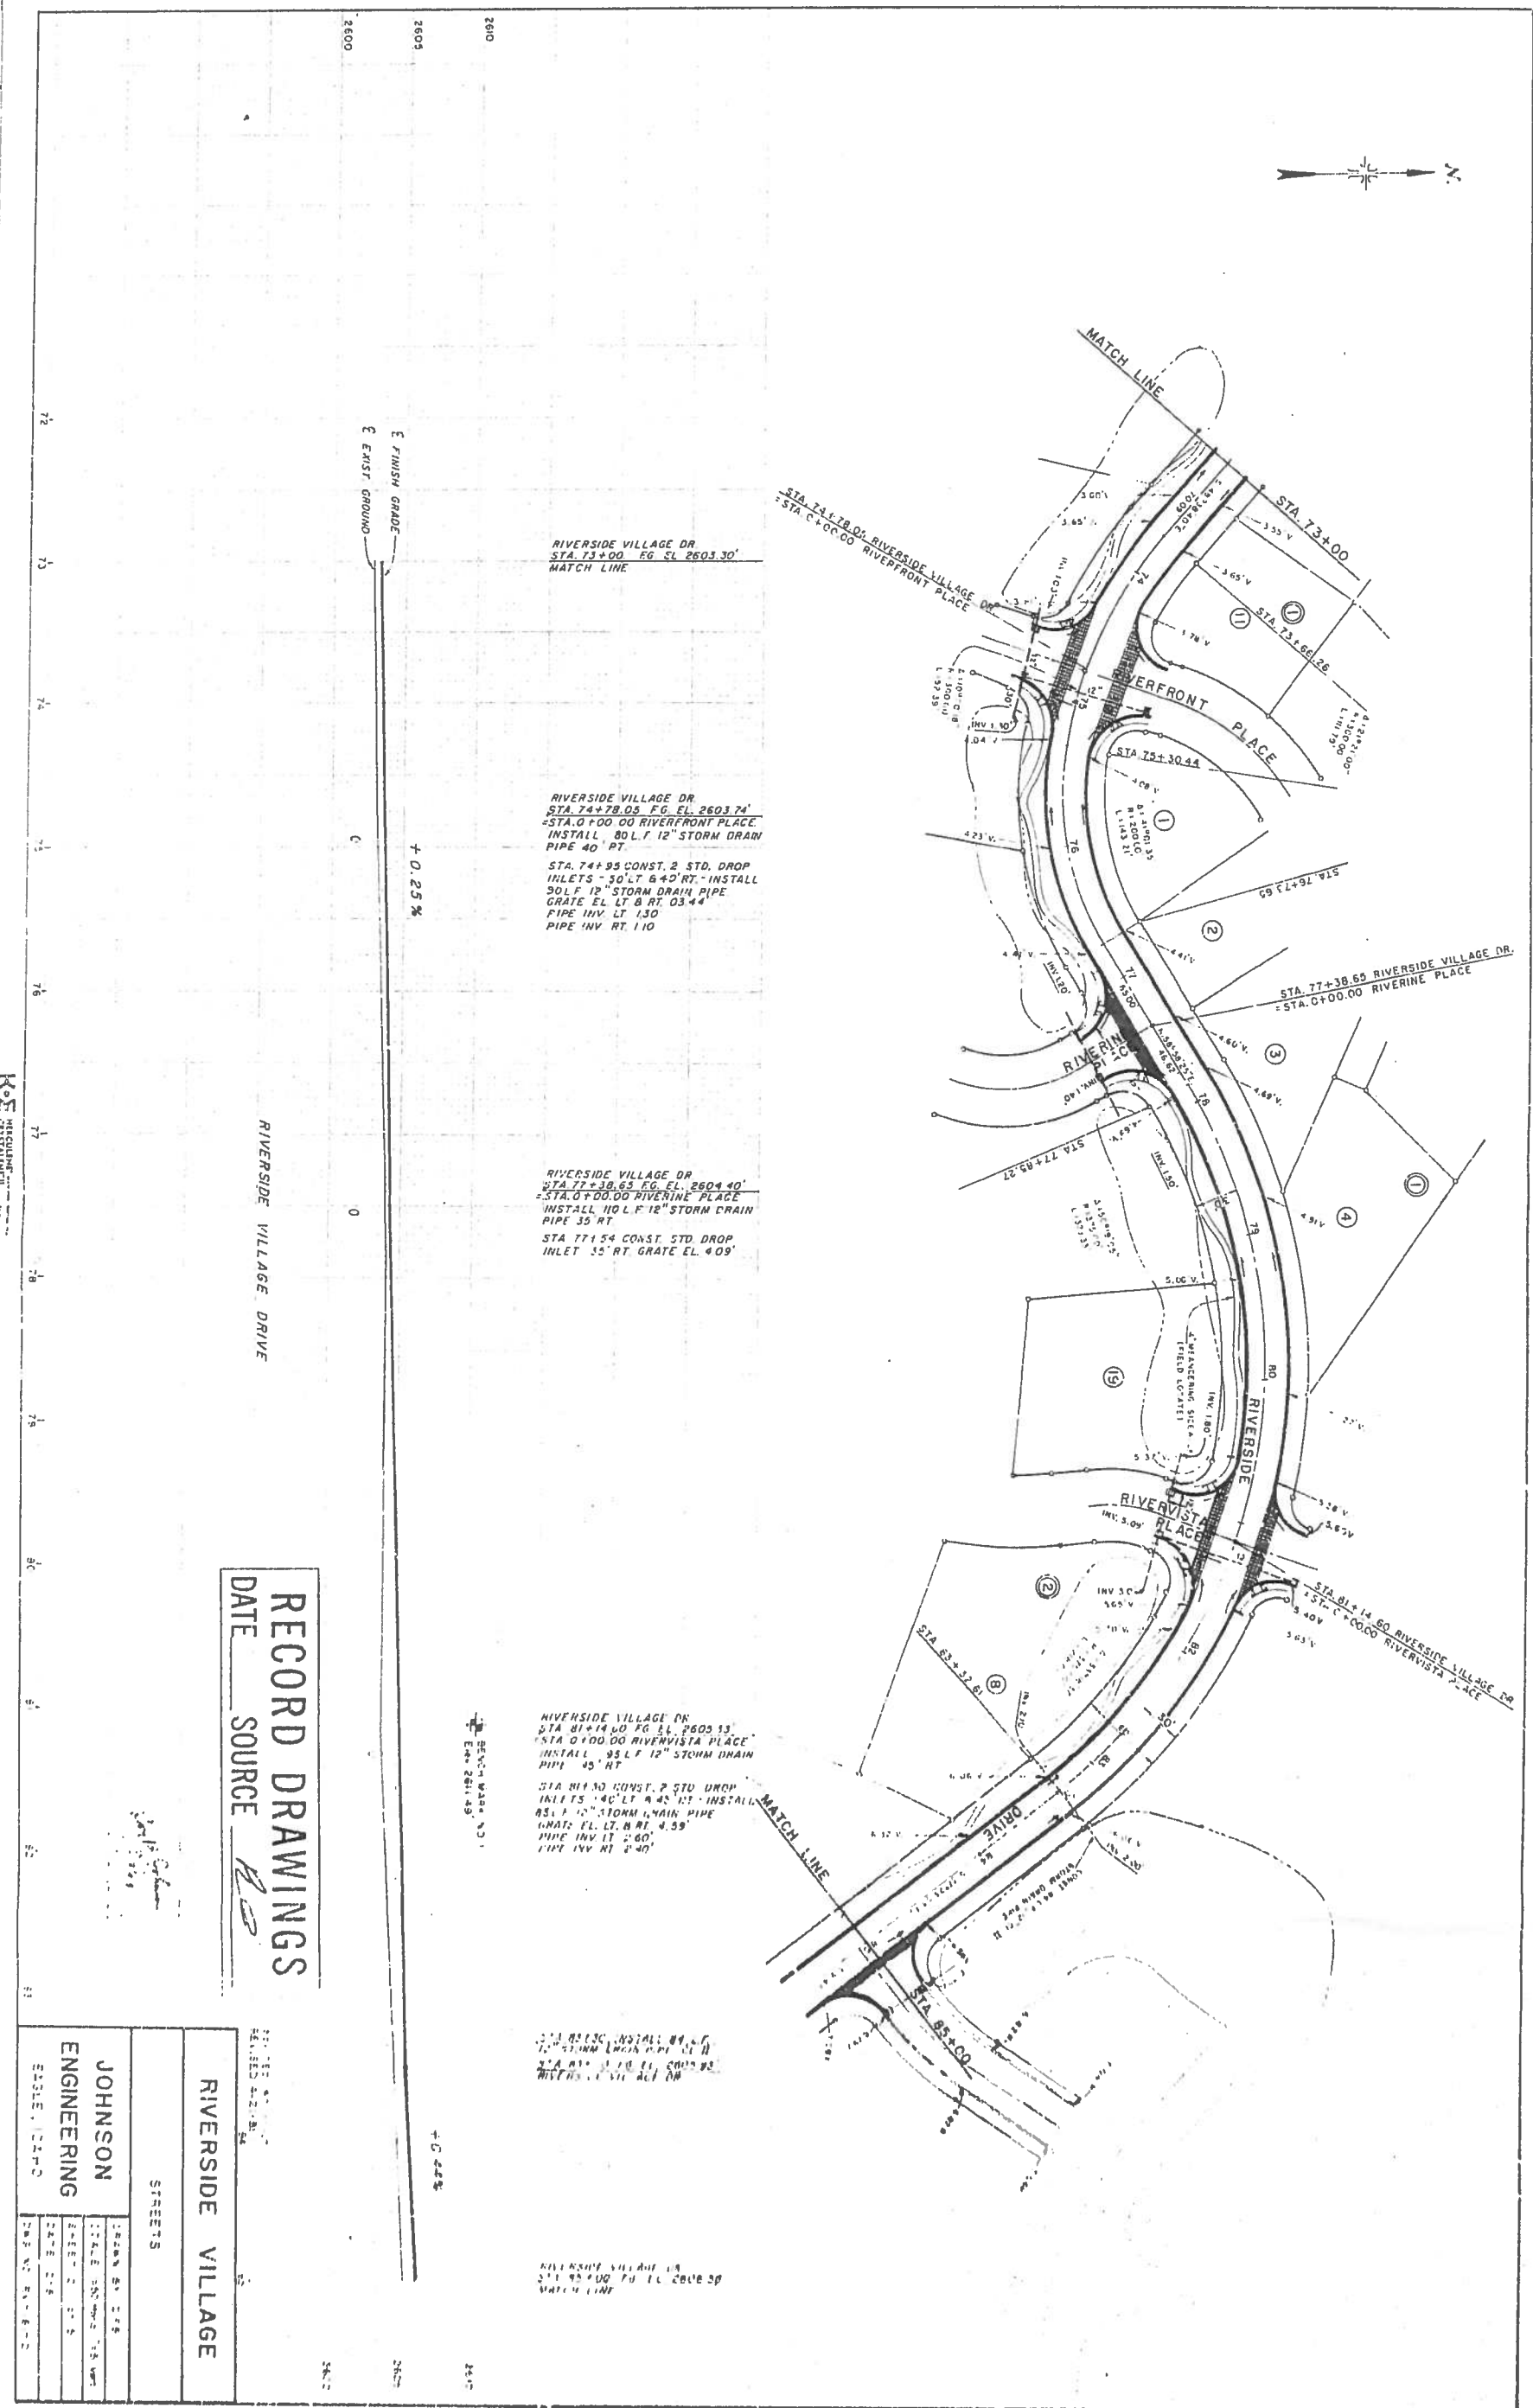


919 GROVE STREET
BOISE, IDAHO 83726
S & A ENGINEERS, INC.
LIC. IN IDAHO 23824, T.A.N. R.I.E. 584.
LIC. IN SECTIONS 23 & 24, T.4N. R.1E. S.34.
SOUTH CO. 2ND 2ND, 1900A.
DATE: 11/15/87



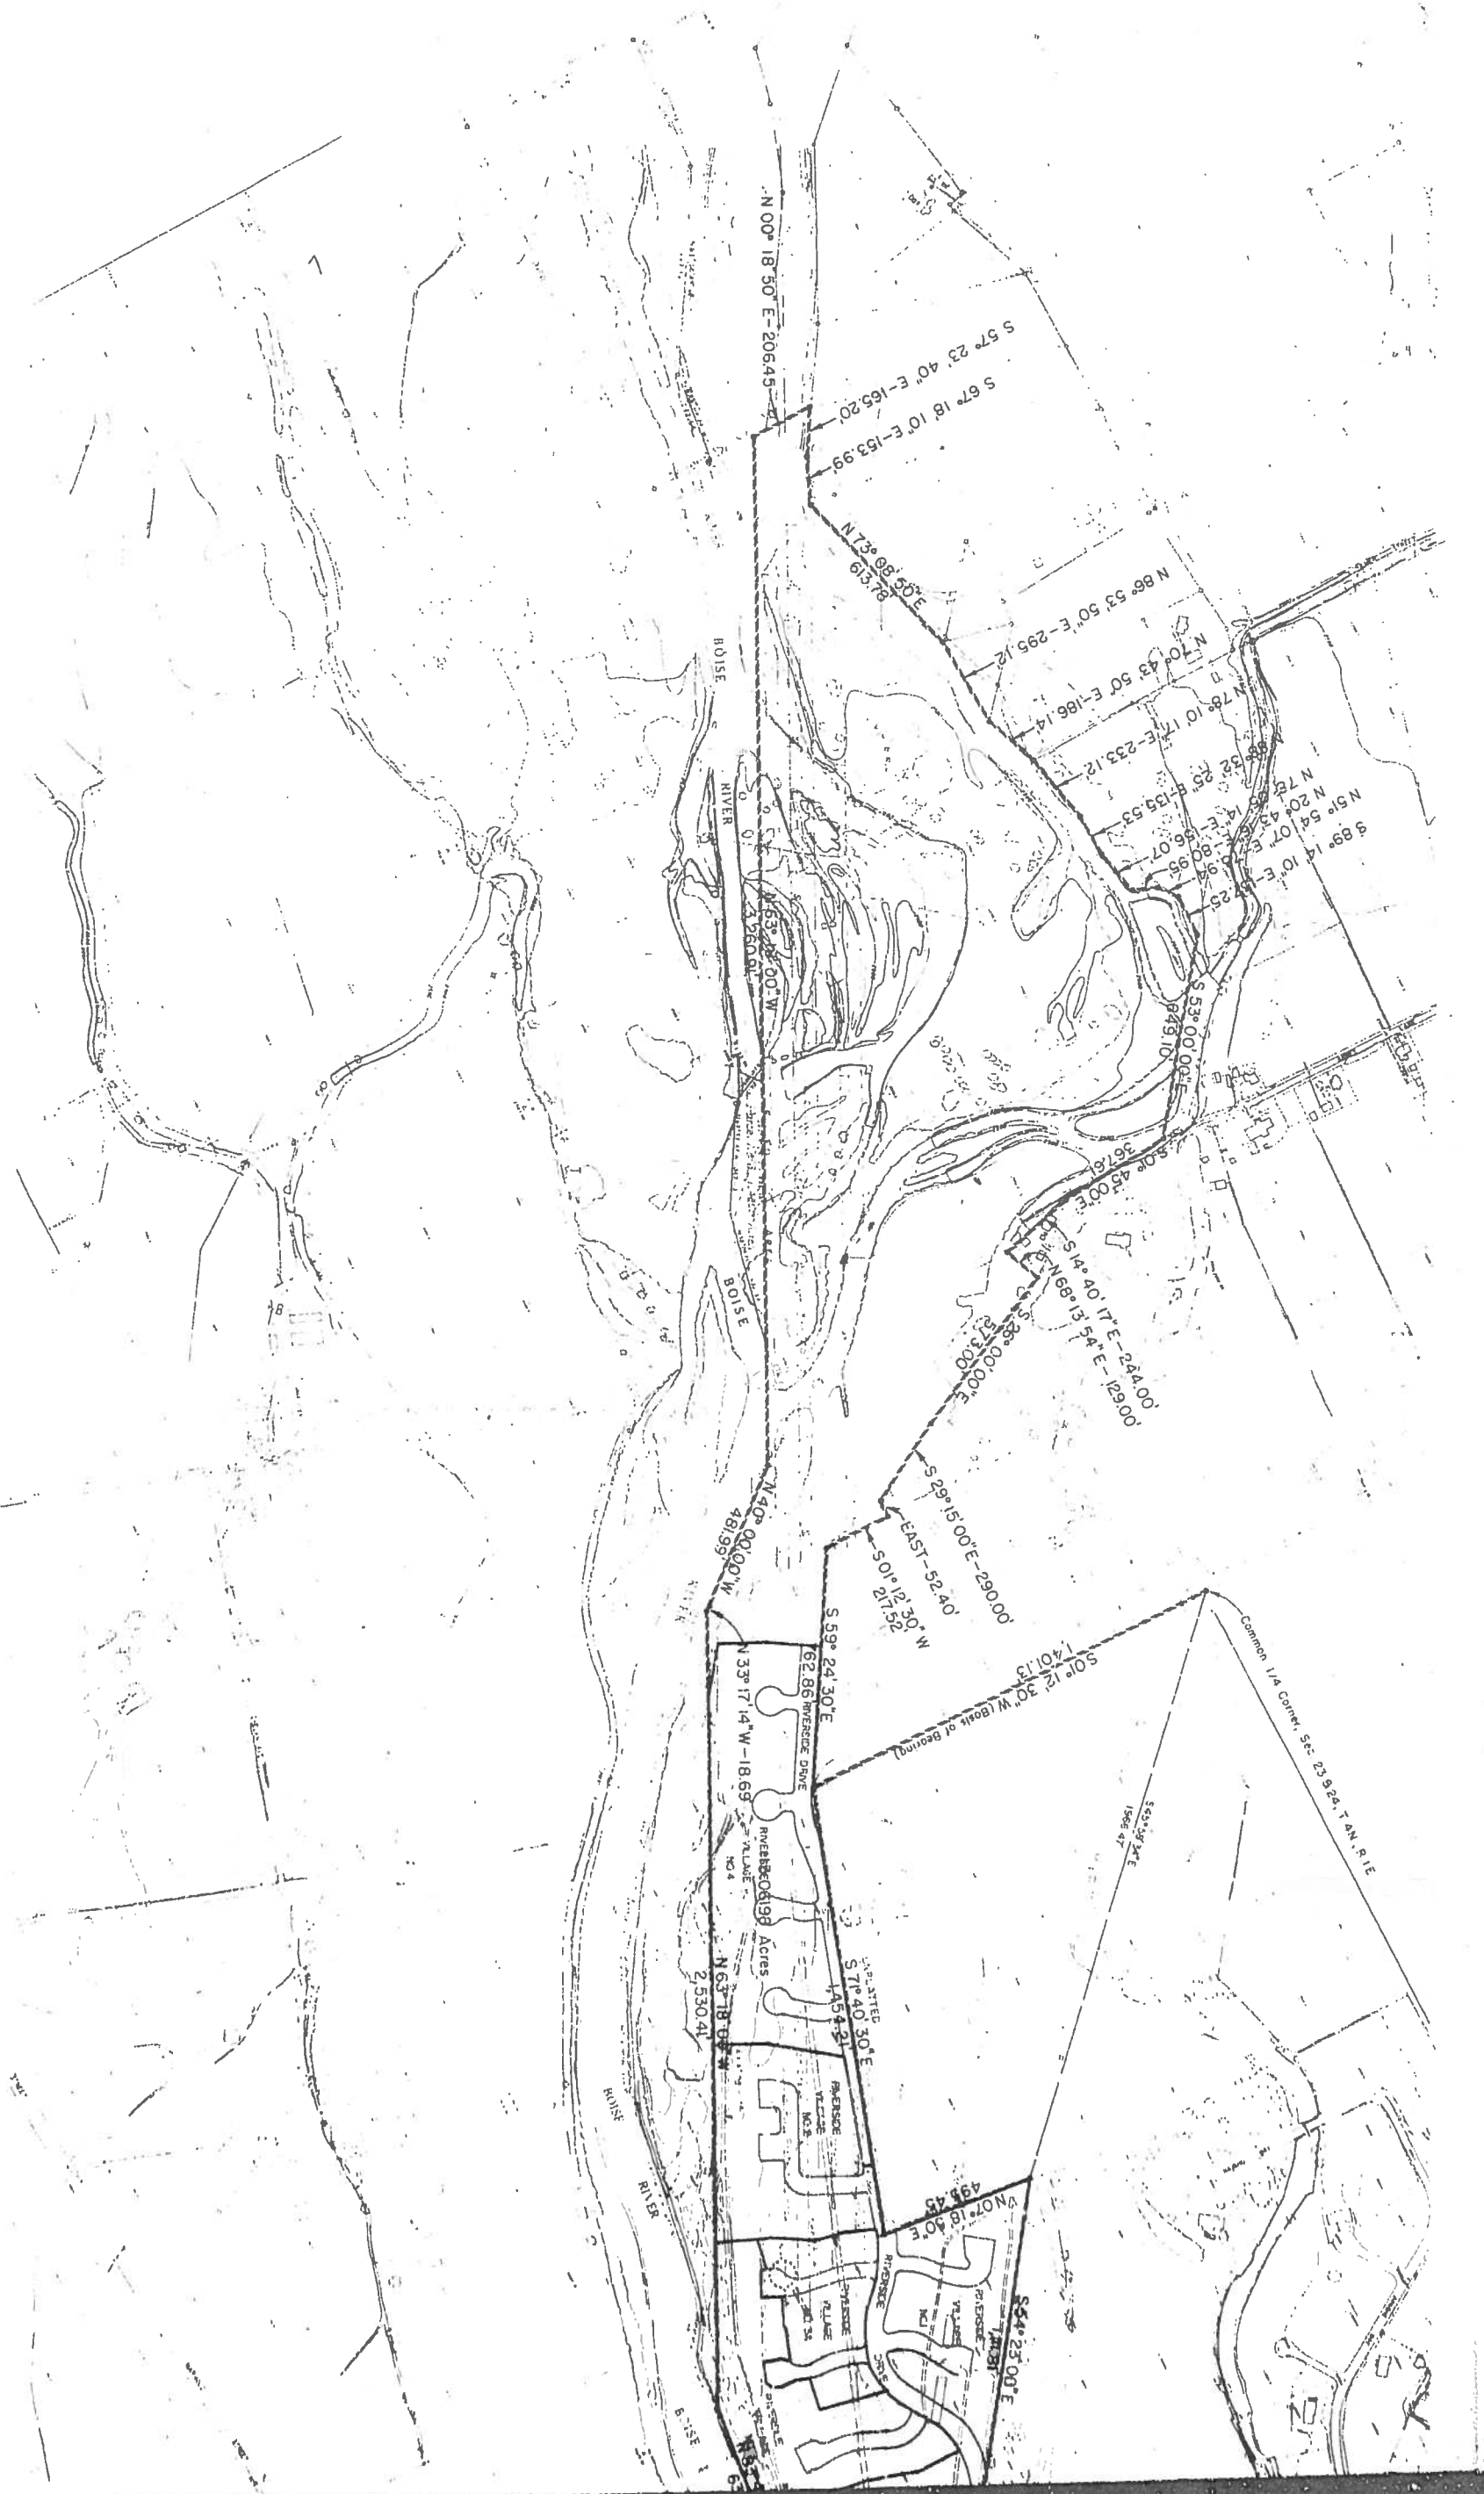

DIVERSION SITE PLAN FOR
RIVERSIDE VILLAGE DIVERSION
A PORTION OF THE NE 1/4 OF SECTION 26
TOWNSHIP 4 NORTH, RANGE 1 EAST,
ADA COUNTY, IDAHO
2000

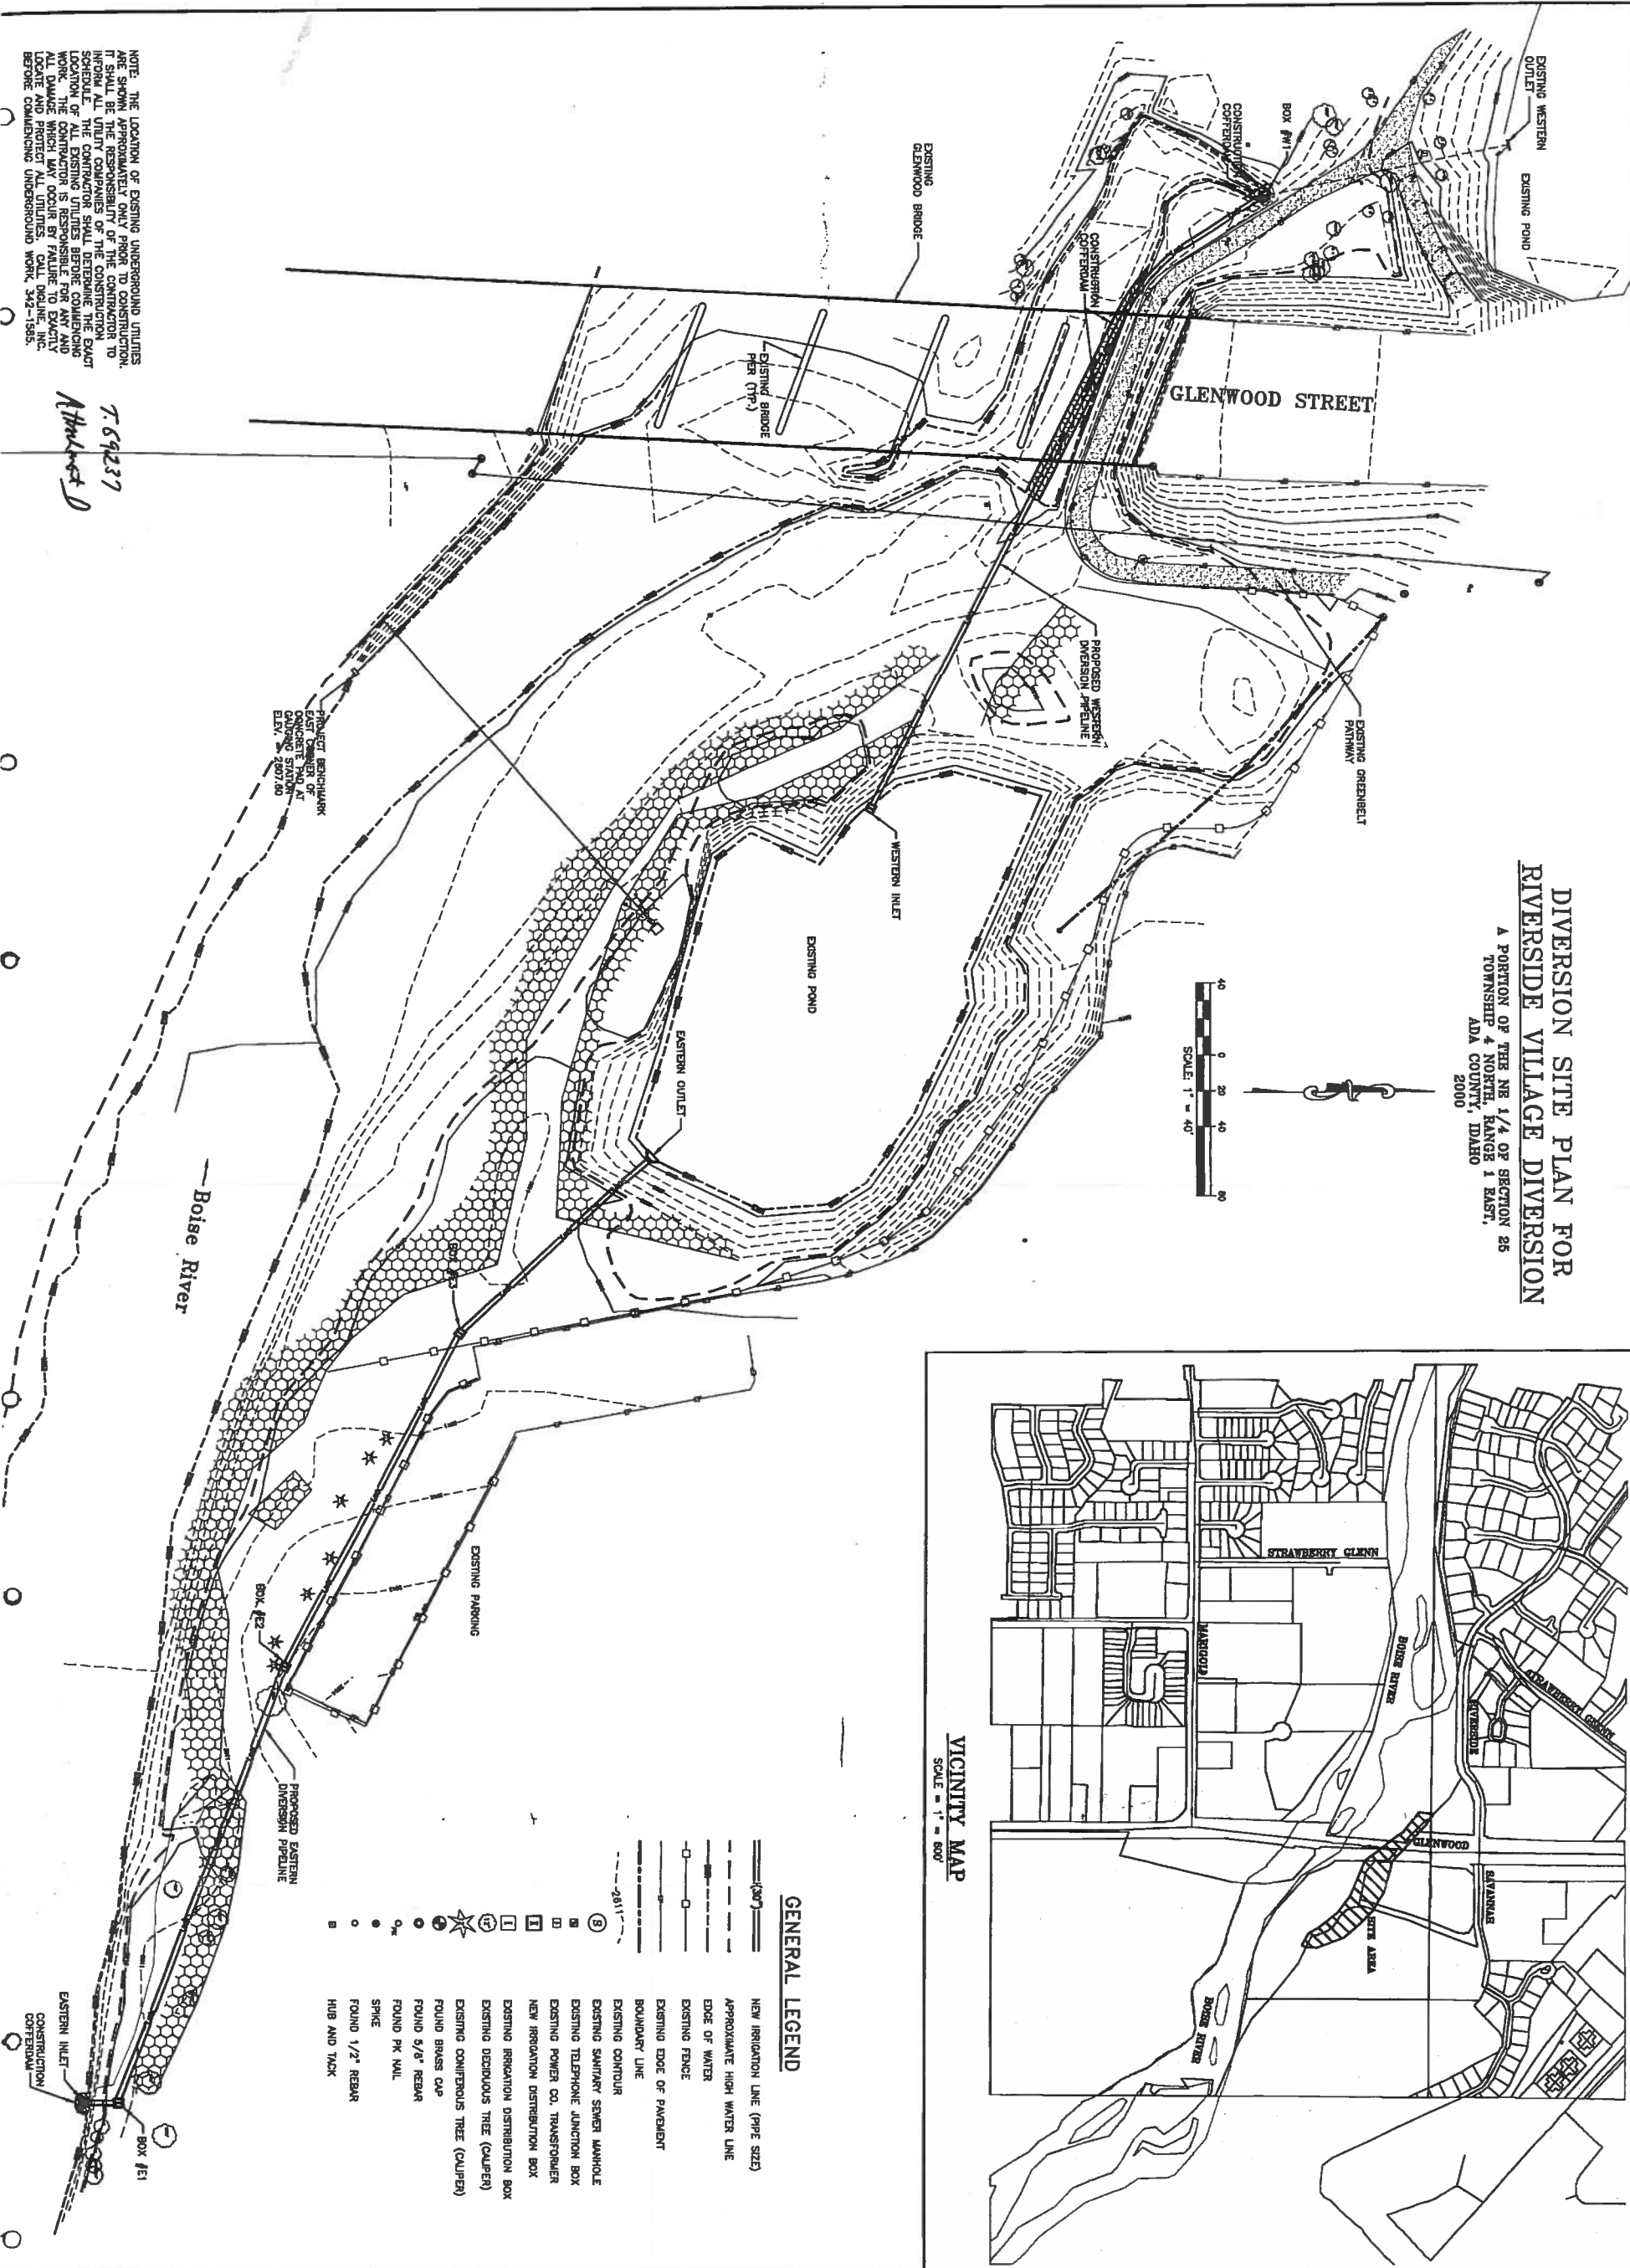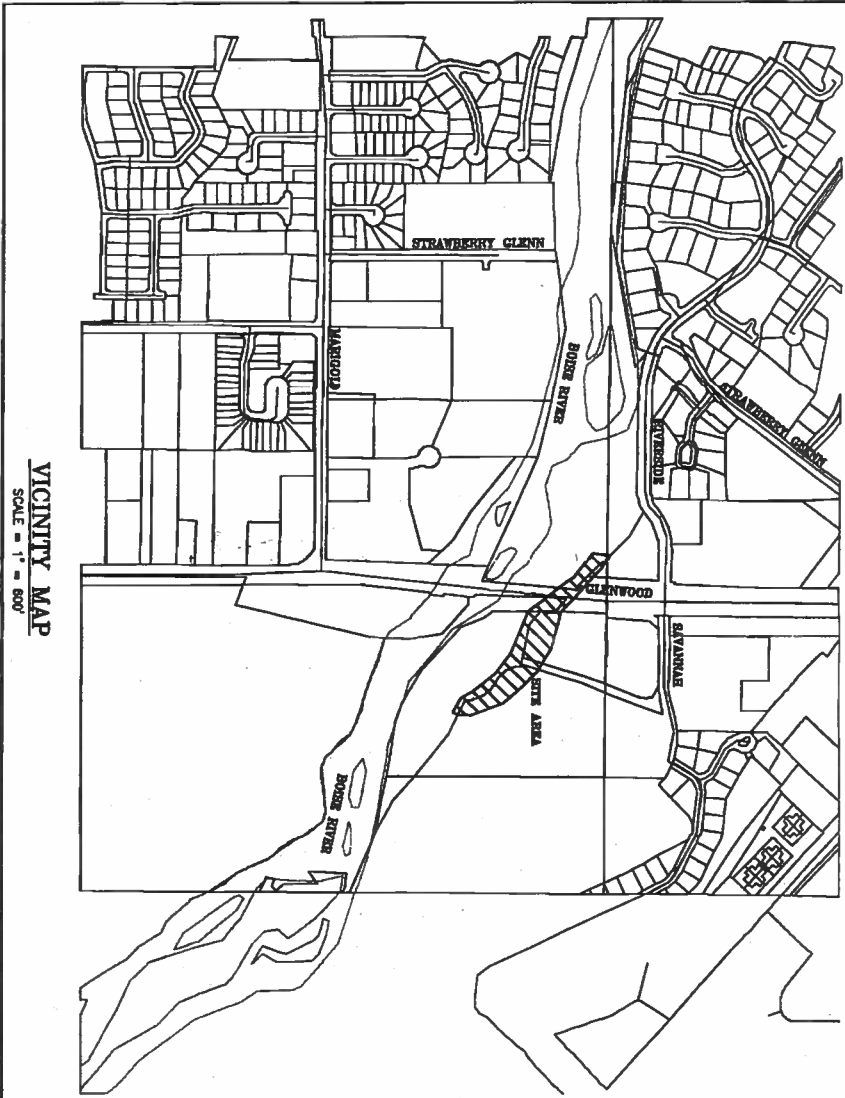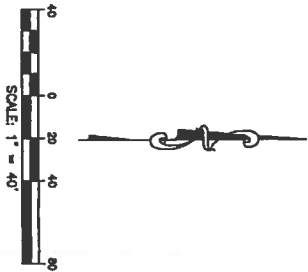

GENERAL LEGEND

- NEW IRRIGATION LINE (PIPE SIZE)
- APPROXIMATE HIGH WATER LINE
- EDGE OF WATER
- EXISTING FENCE
- EXISTING EDGE OF PAVEMENT
- BOUNDARY LINE
- EXISTING CONTOUR
- EXISTING SANITARY SEWER MANHOLE
- EXISTING TELEPHONE JUNCTION BOX
- EXISTING POWER CO. TRANSFORMER
- NEW IRRIGATION DISTRIBUTION BOX
- EXISTING IRRIGATION DISTRIBUTION BOX
- EXISTING DECIDUOUS TREE (CALIFERN)
- EXISTING CONIFEROUS TREE (CALIFERN)
- FOUND BRASS CAP
- FOUND 5/8" REBAR
- FOUND PK NAIL
- SPRINKLER
- FOUND 1/2" REBAR
- HUB AND TACK

NOTE: THE LOCATION OF EXISTING UNDERGROUND UTILITIES ARE SHOWN APPROXIMATELY BY SYMBOLS. THE EXACT LOCATION OF THE UTILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR TO INQUIRE ALL UTILITY COMPANIES OF THE CONSTRUCTION SCHEDULE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR IS RESPONSIBLE FOR ANY AND ALL DAMAGE WHICH MAY OCCUR BY FAILURE TO LOCATE AND MARK ALL UTILITIES BEFORE COMMENCING UNDERGROUND WORK. 342-1585.

7.64237
Attached

DATE
01-14-00

DRAWN BY:
JLT

CHECKED BY:
ROGER L. SMITH, P.E.

PROJECT NO.
018003

REVISION
NO. DATE DESCRIPTION

RIVERSIDE VILLAGE DIVERSION

DIVERSION SITE PLAN

BOISE RIVER

PROFESSIONAL ENGINEER

IDAHO

ROGER L. SMITH

01-14-00

PINNACLE

Engineers, Inc.

870 N. Under Suite B, Meridian, Idaho 83642

(208) 687-7760

SCANNED

EASTERN INLET STRUCTURE
TOP OF STRUCTURE = 07.00
INLET INVERT = 02.00
STRUCTURE INVERT = 02.00

TREES OF VARYING
SIZE WEST OF THIS
LINE

EXISTING WOOD FENCE

BOX #2
TOP OF BOX = 11.50
INLET INVERT = 02.00
BOX INVERT = 02.00
REPAIR OR REPLACE
EXISTING WOOD
FENCE AT CROSSING

TREES OF VARYING SIZE
SOUTH OF THIS LINE

EXISTING PARKING

REMAIN AND PROTECT
EXISTING FENCE

EXISTING WOOD FENCE

BOX #3
TOP OF BOX = 13.50
INLET INVERT = 02.50
BOX INVERT = 02.50
REMOVE EXISTING TREE

8.32

26.0

8.0

623' East Phase

TREES OF VARYING SIZE
SOUTH OF THIS LINE

7.54

BOX #1
TOP OF BOX = 11.50
INLET INVERT = 03.00
BOX INVERT = 03.00

EDGE OF WATER AT APPROX. 100 CFS

EASTERN INLET STRUCTURE
TOP OF STRUCTURE = 07.50
INLET INVERT = 03.00
BOX INVERT = 03.00
CONSTRUCTION COTTEDAM
- SEE NOTE 1

72.0

NOTES: 1) CONSTRUCT COTTEDAM PER DETAIL 7 SHEET C1.3. DRAINAGE SHALL BE
DISCHARGED TO THE DOWNSTREAM POND AND MAY NOT BE PUMPED
DIRECTLY TO THE RIVER.

EAST DIVERSION PIPING PLAN FOR
RIVERSIDE VILLAGE DIVERSION
A PORTION OF THE NE 1/4 OF SECTION 25
TOWNSHIP 4 NORTH, RANGE 1 EAST,
ADA COUNTY, IDAHO
2000



RIVERSIDE VILLAGE DIVERSION
EAST DIVERSION PIPING PLAN
BOISE RIVER



PINNACLE
Engineers, Inc.
870 N. Lamar Suite B, Meridian, Idaho 83642
(208) 887-7780

SCANNED
APP 2 0 2004

DATE: 01-14-00
DRAWN BY: [Signature]
CHECKED BY: ROBERT A. SMITH, P.E.
PROJECT NO. C1.1
SHEET

C1.1

