


MEMORANDUM

Date: November 17, 2011
To: Water Right File 29-13155 and 29-13784
From: Michele Edl
Re: system schematic

I met with Raida and Richard Jensen today.

The attached diagram was constructed by Richard Jensen to show the diversion and distribution systems which have been developed through the two water rights listed above.

Harkness Canyon Hydro and Domestic Springs

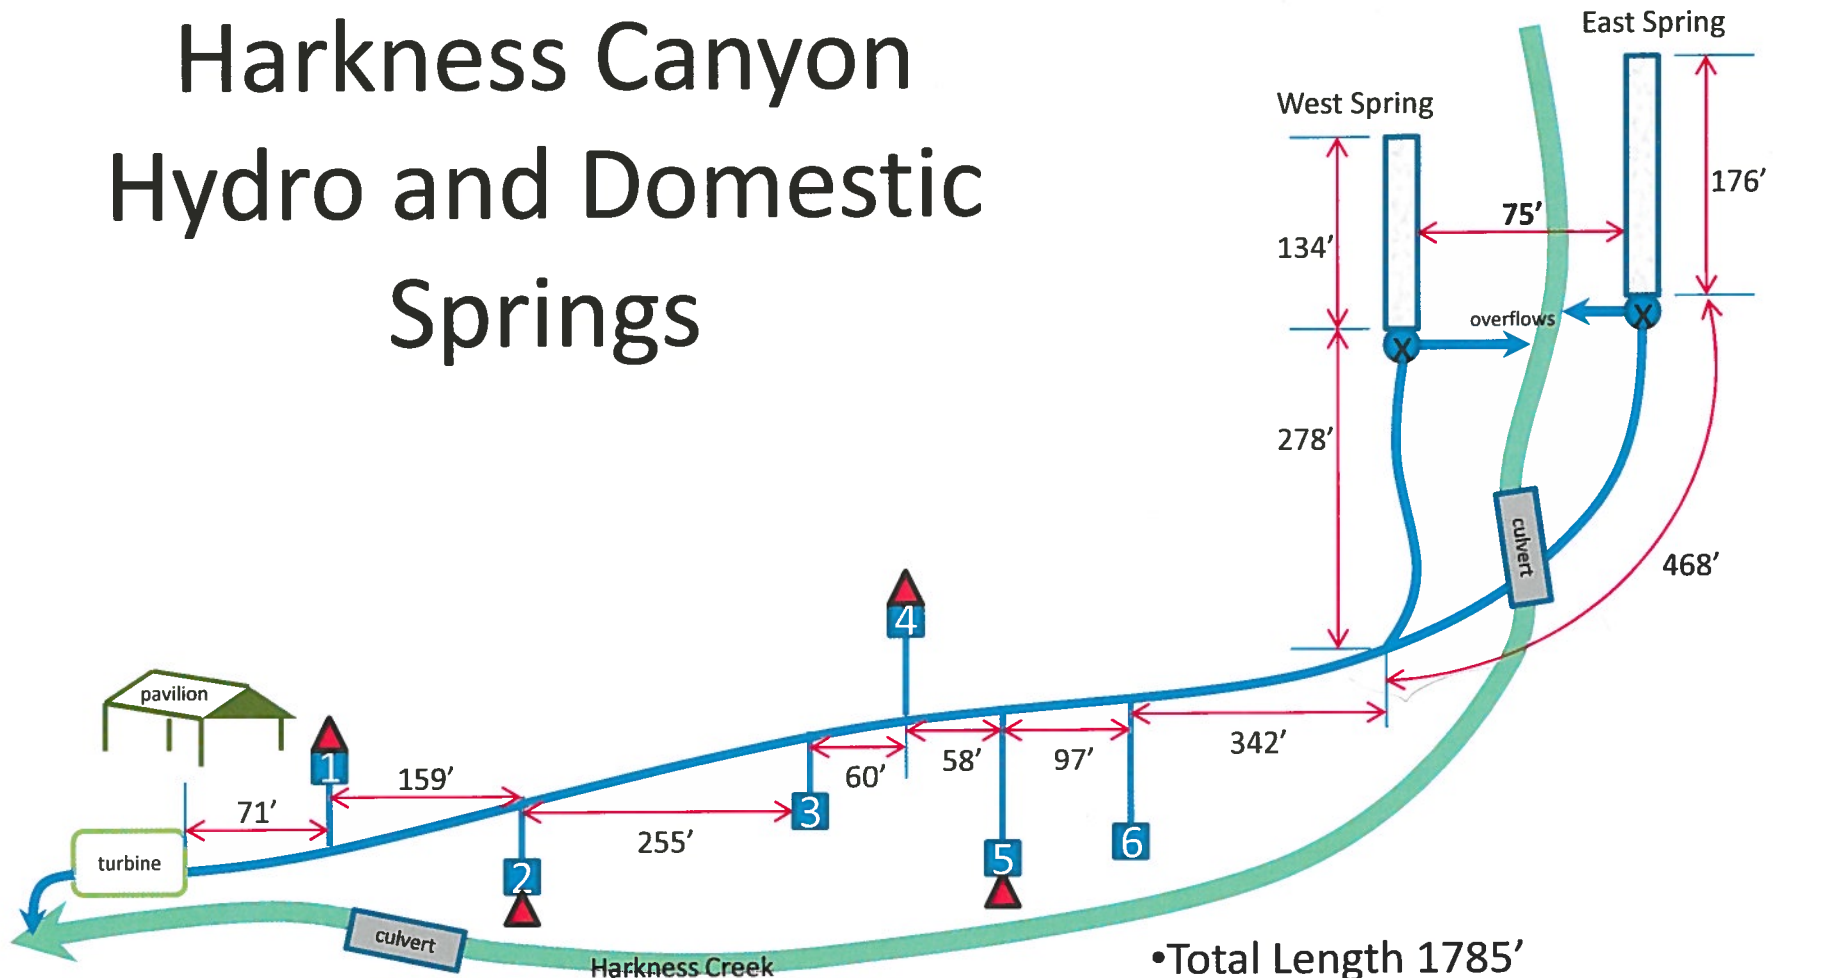

-  Electrical Outlet
-  Water Faucet

- Total Length 1785'
- Turbine 4 each ¼" nozzles 30gpm
- Head 90'
- Pressure 42 PSI
- Turbine 90 Amps DC
- Voltage 24VDC
- Voltage 120VAC