

RECEIVED

DEC 23 2009

DEPARTMENT OF
WATER RESOURCES

LAKEVIEW ESTATES
WATER DISTRICT

4129 Eureka Ridge
Orofino, Idaho 83544

December 02, 2009

Mathew Weaver, PE
Idaho Department of Water Resources
322 East Front Street
P.O. Box 83720
Boise, Idaho 83706-0098

Re: Water Permits 83-7118 (well #3), 83-7136 (well #4), and 83-11931 (well #5 ?)

Dear Mr. Weaver:

In response to your letter dated December 31, 2008 in chronically order.

Permit 83-11931 Owner name change:

The board of directors voted not to expend the \$25.00 fee on 09-11-09 for the name change.

Information requested:

- Number of homes served:
 - August 09, 1998 15
 - May 23, 2002 14
 - October 24, 2006 12
- Historical Data (diversion volumes & run times): Earlies records found were 2000.
 - July 2000 78,560 gallons produced & 22,000 gallons hauled from Orofino.
Three wells ran 455.05 hours.
 - Aug. 2000 83,190 gallons produced & 5,000 gallons hauled from Orofino.
Three wells ran 447.18 hours.
 - Nov. 2000 36,950 gallons produced. Three wells ran 116.66 hours.
 - Dec. 2000 41,770 gallons produced. Three wells ran 194.28 hours.

 - July 2002 61,730 gallons produced. Three wells ran 257.62 hours.
 - Aug. 2002 51,760 gallons produced. Three wells ran 234.61 hours.
 - Nov. 2002 47,930 gallons produced. Three wells ran 56.86 hours & Well #4
unknown hours.
 - Dec. 2002 64,300 gallons produced. Three wells ran 138.18 hours Well #4
unknown hours.


- o July 2006 119,530 gallons produced. Three wells ran 125.33 hours.
- o Aug. 2006 87,870 gallons produced. Three wells ran 68.32 hours.
- o Nov. 2006 67,920 gallons produced. Three wells ran 96.75 hours
- o Dec. 2006 71,560 gallons produced. Three wells ran 110.45hours.

Enclosure

FLOW RANGE: 5 -14 GPM

OUTLET SIZE: 1 1/4 " NPT

NOMINAL DIA.

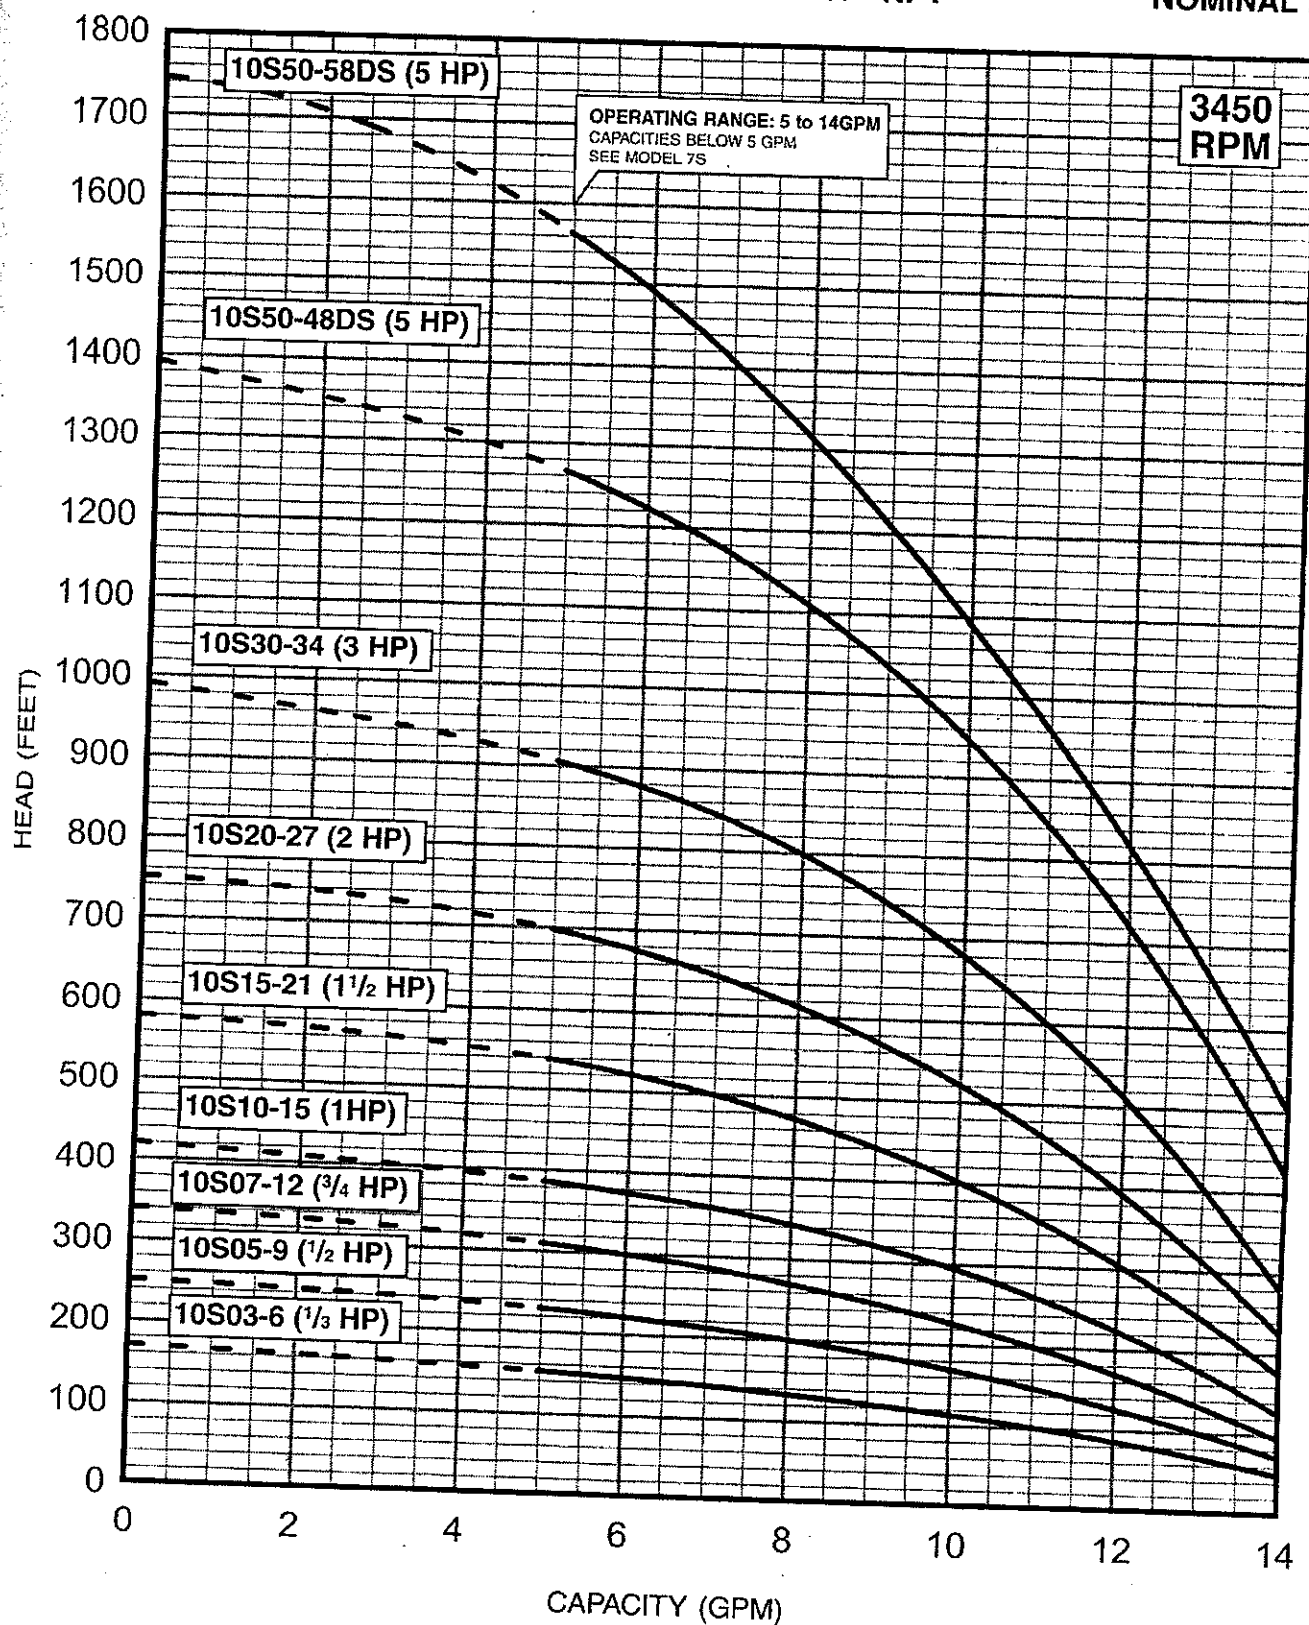

SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE.
4" MOTOR STANDARD, 3450 RPM.

Performance conforms to ISO 9906, 1999 (E) Annex A
Minimum submergence is 2 feet.