

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

SEP 02 2010

DEPARTMENT OF
WATER RESOURCES

A. GENERAL INFORMATION

Permit No. 21-12857

1. Owner Henry's Fork Village Water Co. c/o William B Galbraith

Phone No. (208) 558-7049

Current address PO Box 543, Island Park, ID 83429

2. Examiner's name Paul Scoresby, PE

EXAM DATE 12/04/2009

3. Accompanied by Richard Barber

Email smilingwetman@yahoo.com

Address PO Box 543, Island Park, ID 83429

Relationship to permit holder Water System Operator

Phone No. (208) 403-5021

4. Source GROUND WATER

tributary to _____

B. OVERLAP REVIEW

1. Other water rights with the same place of use 21-7446

2. Other water rights with the same point of diversion 21-7446

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident. No.	Gov't Lot	1/4	1/4	1/4	Sec	Twp	Rge	County	Method of Determination/Remarks
1	L-5		SW	SE	8	12N	43E	FREMONT	On Site/Plat Map
3	L-5		SW	SE	8	12N	43E	FREMONT	NEW Well - On Site/Plat Map
2	L-9		NE	SW	8	12N	43E	FREMONT	On Site/Plat Map

2. Place(s) of Use:

Method of determination On site/Plat map/Fremont County Online Property Records

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
12N	43E	8									M			M		M	M		

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe diameter (inside), as applicable. Use the space provided or ☐ see attached.

[illegible]

Scale: 1" =

- ☒ Copy of USGS Quadrangle attached showing location(s) of point(s) of diversion and place(s) of use (required)
☐ Aerial photo attached (required for irrigation of 10+ acres)
☐ Photo of diversion and system attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well #1	Franklin	5	09F19-15-6004	Goulds	09G19155043
Well #3	Franklin	25	09E19-18-6062	Goulds	30053250-6
Well #2**	Unknown	3**	-----	-----	-----

*Code to correspond with no. on map and aerial photo

**Information on Well #2 from Field Exam 21-7446

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Flow meter	Electromagnetic	McCrometer	UM-06R	UM20090514	4"	08/19/2009

2. Measurements:

Well #3 - 332.0 gpm = 0.74 cfs @ 49 psi Operating Pressure

Well #1 - 75.0 gpm = 0.17 cfs @ 52 psi Operating Pressure

Information for Well #2 from the Field Exam of 21-7446

E. NARRATIVE/REMARKS/COMMENTS

The system consists of three wells with mainlines. Well #1 and Well #3 pump through the well house with Well #2 pumping directly into distribution system. System measuring device is located in the well house and consists of an electromagnetic flowmeter with a 4 - 20 mA analog output to a wall-mounted LCD output box that gives instantaneous flow readings in gpm and cumulative readings in million gallons.

Wells #1 & #3 located in Lot 15, Block 1, Robbins Subdivision

Well #2 located in Lot 62, Block3, Robbins Subdivision - No measurement of Well #2


Applicants request that the Nature of Use be changed to Municipal.


Please see attached letter from applicant that requests that both permit 21-7746 and 21-12857 be licensed with a change of the nature of use from Domestic to Municipal Use.


Please consider this Beneficial Use Field Report as Proof of Beneficial Use.

Has the permit holder met all conditions of permit approval, including any mitigation requirements and/or measuring device installation requirements? ☒ Yes ☐ No If no, what must be done to meet the permit requirements?

Henry's Fork Village Water Co. Service Area

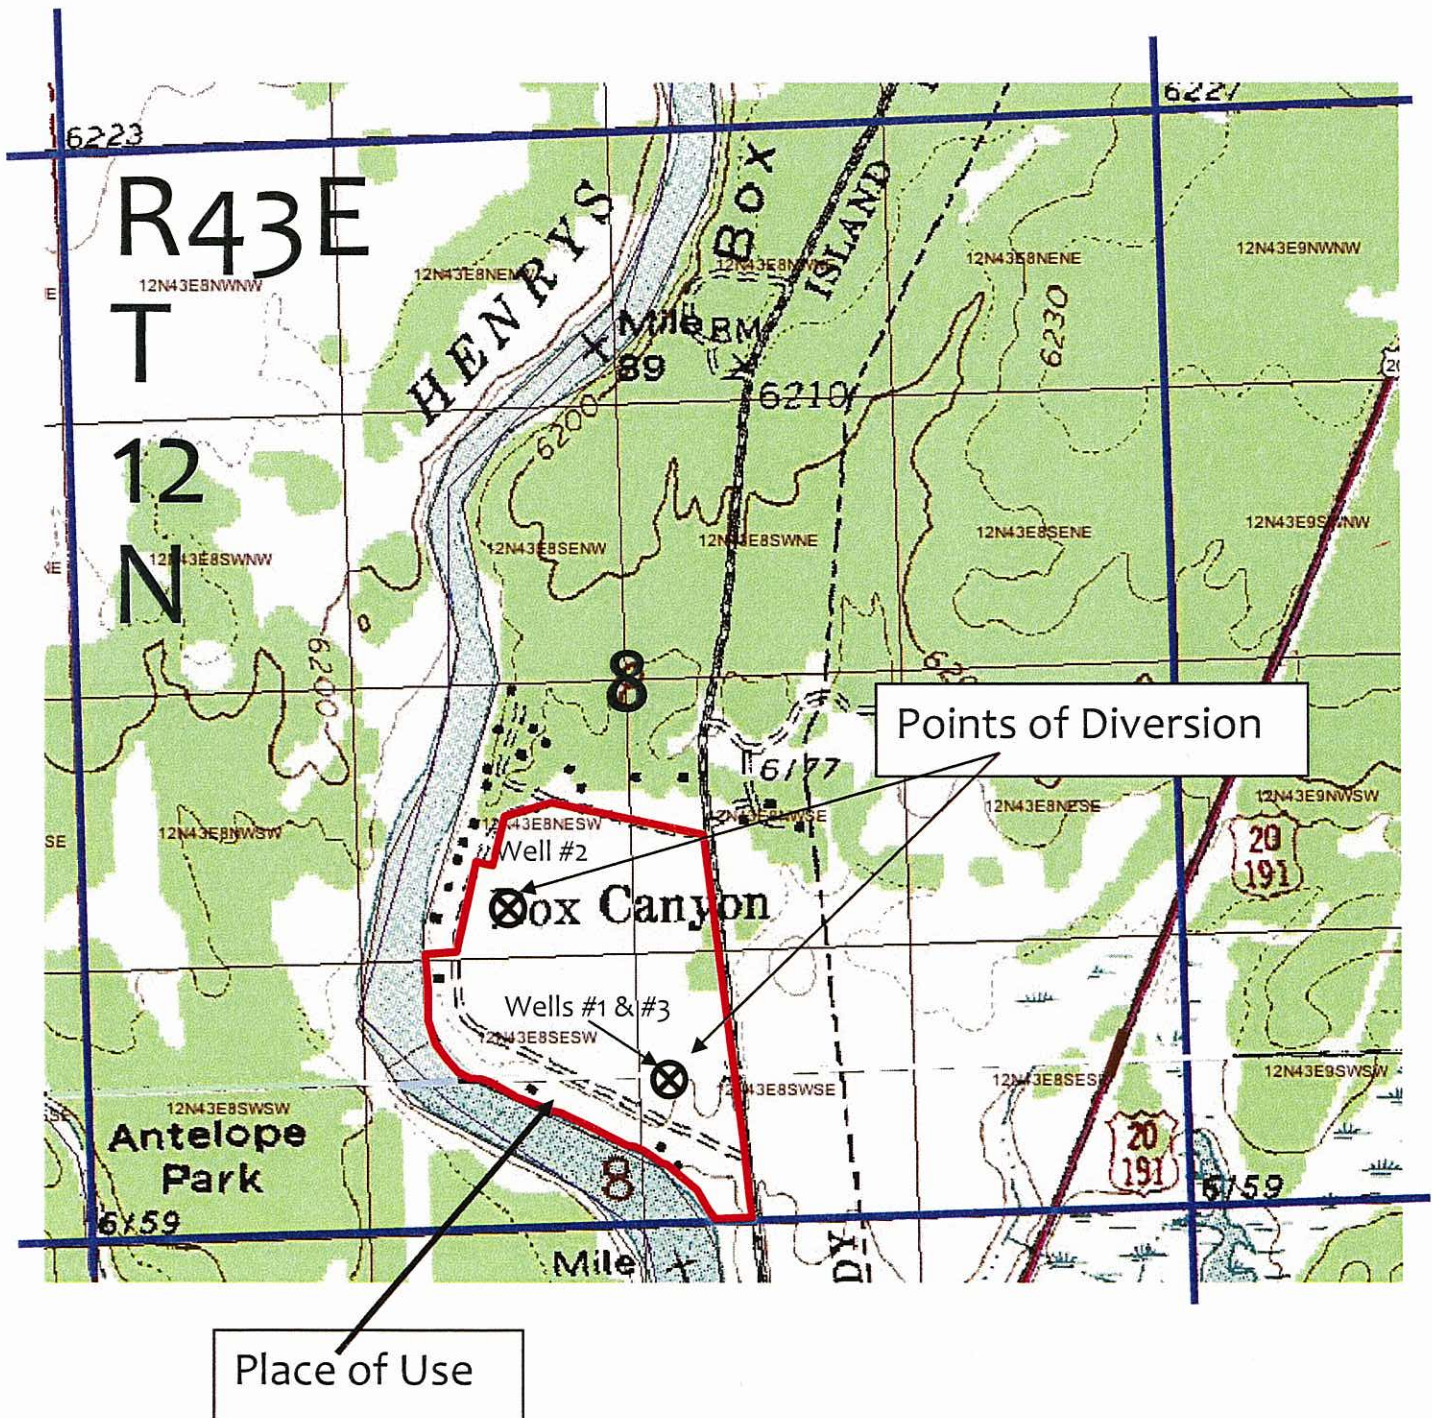

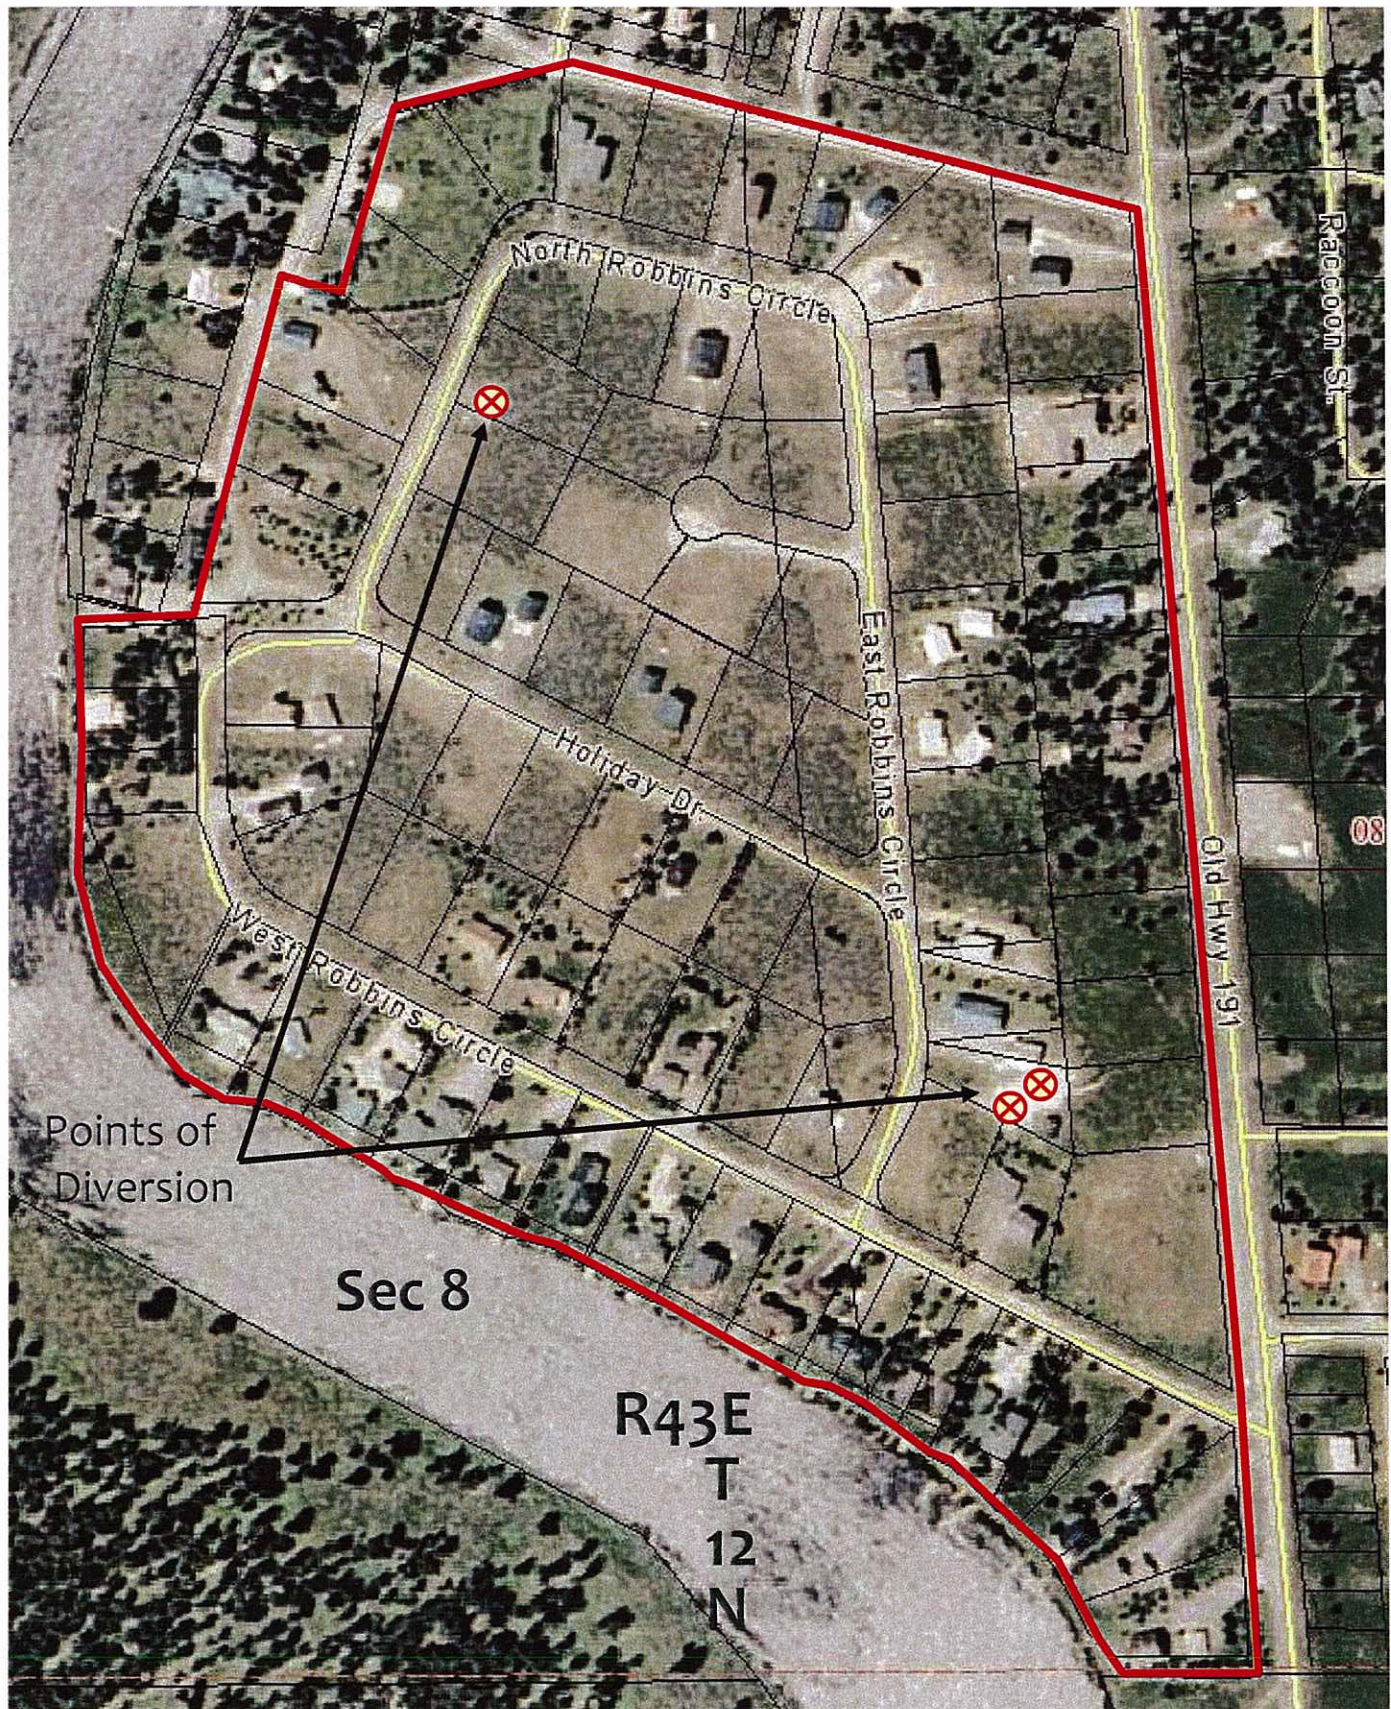

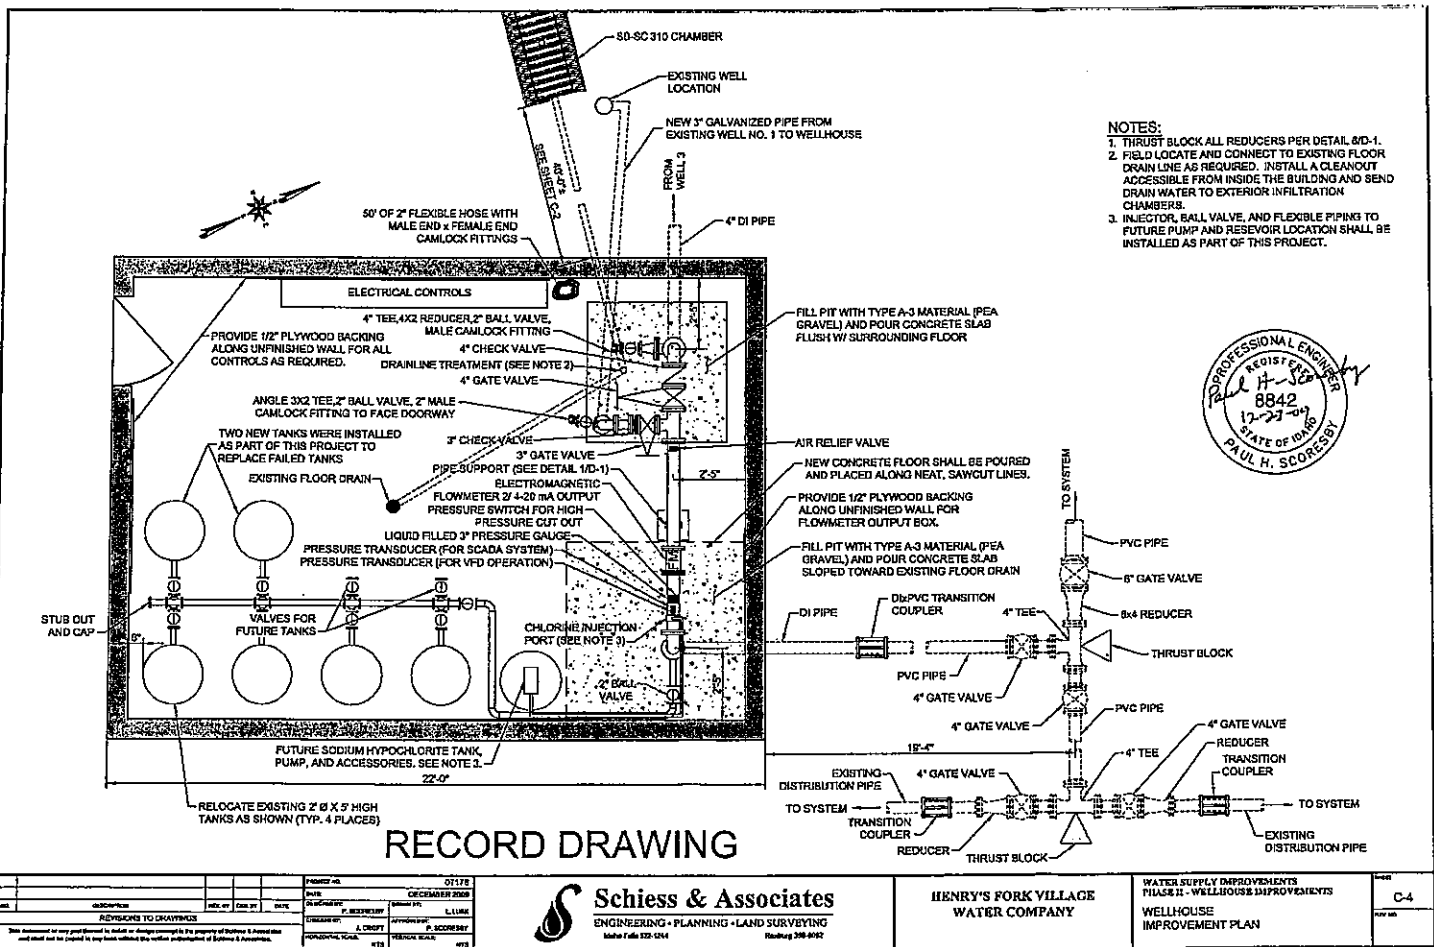

RECEIVED

SEP 02 2010

DEPARTMENT OF
WATER RESOURCES

 Schless & Associates
CONSULTING ENGINEERS

7103 SOUTH 45th WEST
IDAHO FALLS, ID 83402
(208) 522-1244

TO:

IDWR
Attn: Shelley Keen
P.O. Box 83720
Boise, ID 83720-0098