

RECEIVED

APR 23 2010

WATER RESOURCES
WESTERN REGIONSTATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name of Applicant CTI SSI Food Services LLC Phone 208-482-7844
Mailing address 22303 Hwy 95, Wilder, ID 83676 Email rshuman@ctifoods.com
Representative SPF Water Engineering LLC, 300 E. Mallard, Ste 350, Boise, ID 83706 208-383-4140
2. Source of water supply Ground Water which is a tributary of _____
3. Location of point of diversion is Township 4N Range 5W Sec. 10, in the _____ 1/4,
NE 1/4, SE 1/4, Govt. Lot _____, B.M., _____ Canyon _____ County;
additional points of diversion if any: 4 existing wells, 1 proposed well
4. Water will be used for the following purposes:
Amount 0.75 cfs for Industrial purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 0.75 and/or (b) _____
cubic feet per second acre feet per annum
6. Proposed diverting works:
 - a. Describe type and size of devices used to divert water from the source Four existing wells, one proposed well, pumps, buried pipes.
 - b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet;
total reservoir capacity _____ acre-feet
 - c. Proposed well diameter is 14 inches; proposed depth of well is 500 feet
 - d. Is ground water with a temperature of greater than 85°F being sought? No
 - e. If well is already drilled, when? See attached table; Drilling firm _____;
Well was drilled for (well owner) _____; Drilling Permit No. _____
7. Time required for completion of works and application of water to proposed beneficial use is 5 years (minimum 1 year)
8. Description of proposed uses (if irrigation only, go to item 9):
 - a. Hydropower; show total feet of head and proposed capacity in kW. _____
 - b. Stockwatering; list number and kind of livestock. _____
 - c. Municipal; show name of municipality. _____
 - d. Domestic; show number of households. _____
 - e. Other; describe fully. Industrial use for food processing plant

9. Description of place of use:

- If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
4N	5W	8																	
		10																	
		17																	

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. Include water delivered by a municipality, canal company, or irrigation district. If this application is for domestic purposes, do you intend to use this water, water from another source, or both, to irrigate your lawn, garden, and/or landscaping? 63-10727, 63-31640

- 11.a. Who owns the property at the point of diversion? Applicant
- b. Who owns the land to be irrigated or place of use? Applicant
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Describe your proposal in narrative form, and provide additional explanation for any of the items above. Attach additional pages if necessary. Additional flow rate and volume are proposed for increased production at the facility. The place of use for industrial use includes land upon which wastewater may be applied for irrigation purposes to satisfy water quality requirements. Water will not be diverted and used for irrigation unless first used in the industrial facility located in the NESE, S10.

13. **MAP OF PROPOSED PROJECT REQUIRED** - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)


BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.


Signature of Applicant

Randy SHUMAN VP ENGINEERING
Print Name (and title, if applicable)

For Department Use:

Received by SB Date 4.23.10 Time 1:44 PM Preliminary check by KW
 Fee \$ 250 Receipted by SB Receipt No. W038287 Date 4.23.10
 Publication prepared by DB Date 9/29/2010 Published in PRESS TRIBUNE
 Publication approved _____ Date _____ Dates Published OCTOBER 7 & 14, 2010

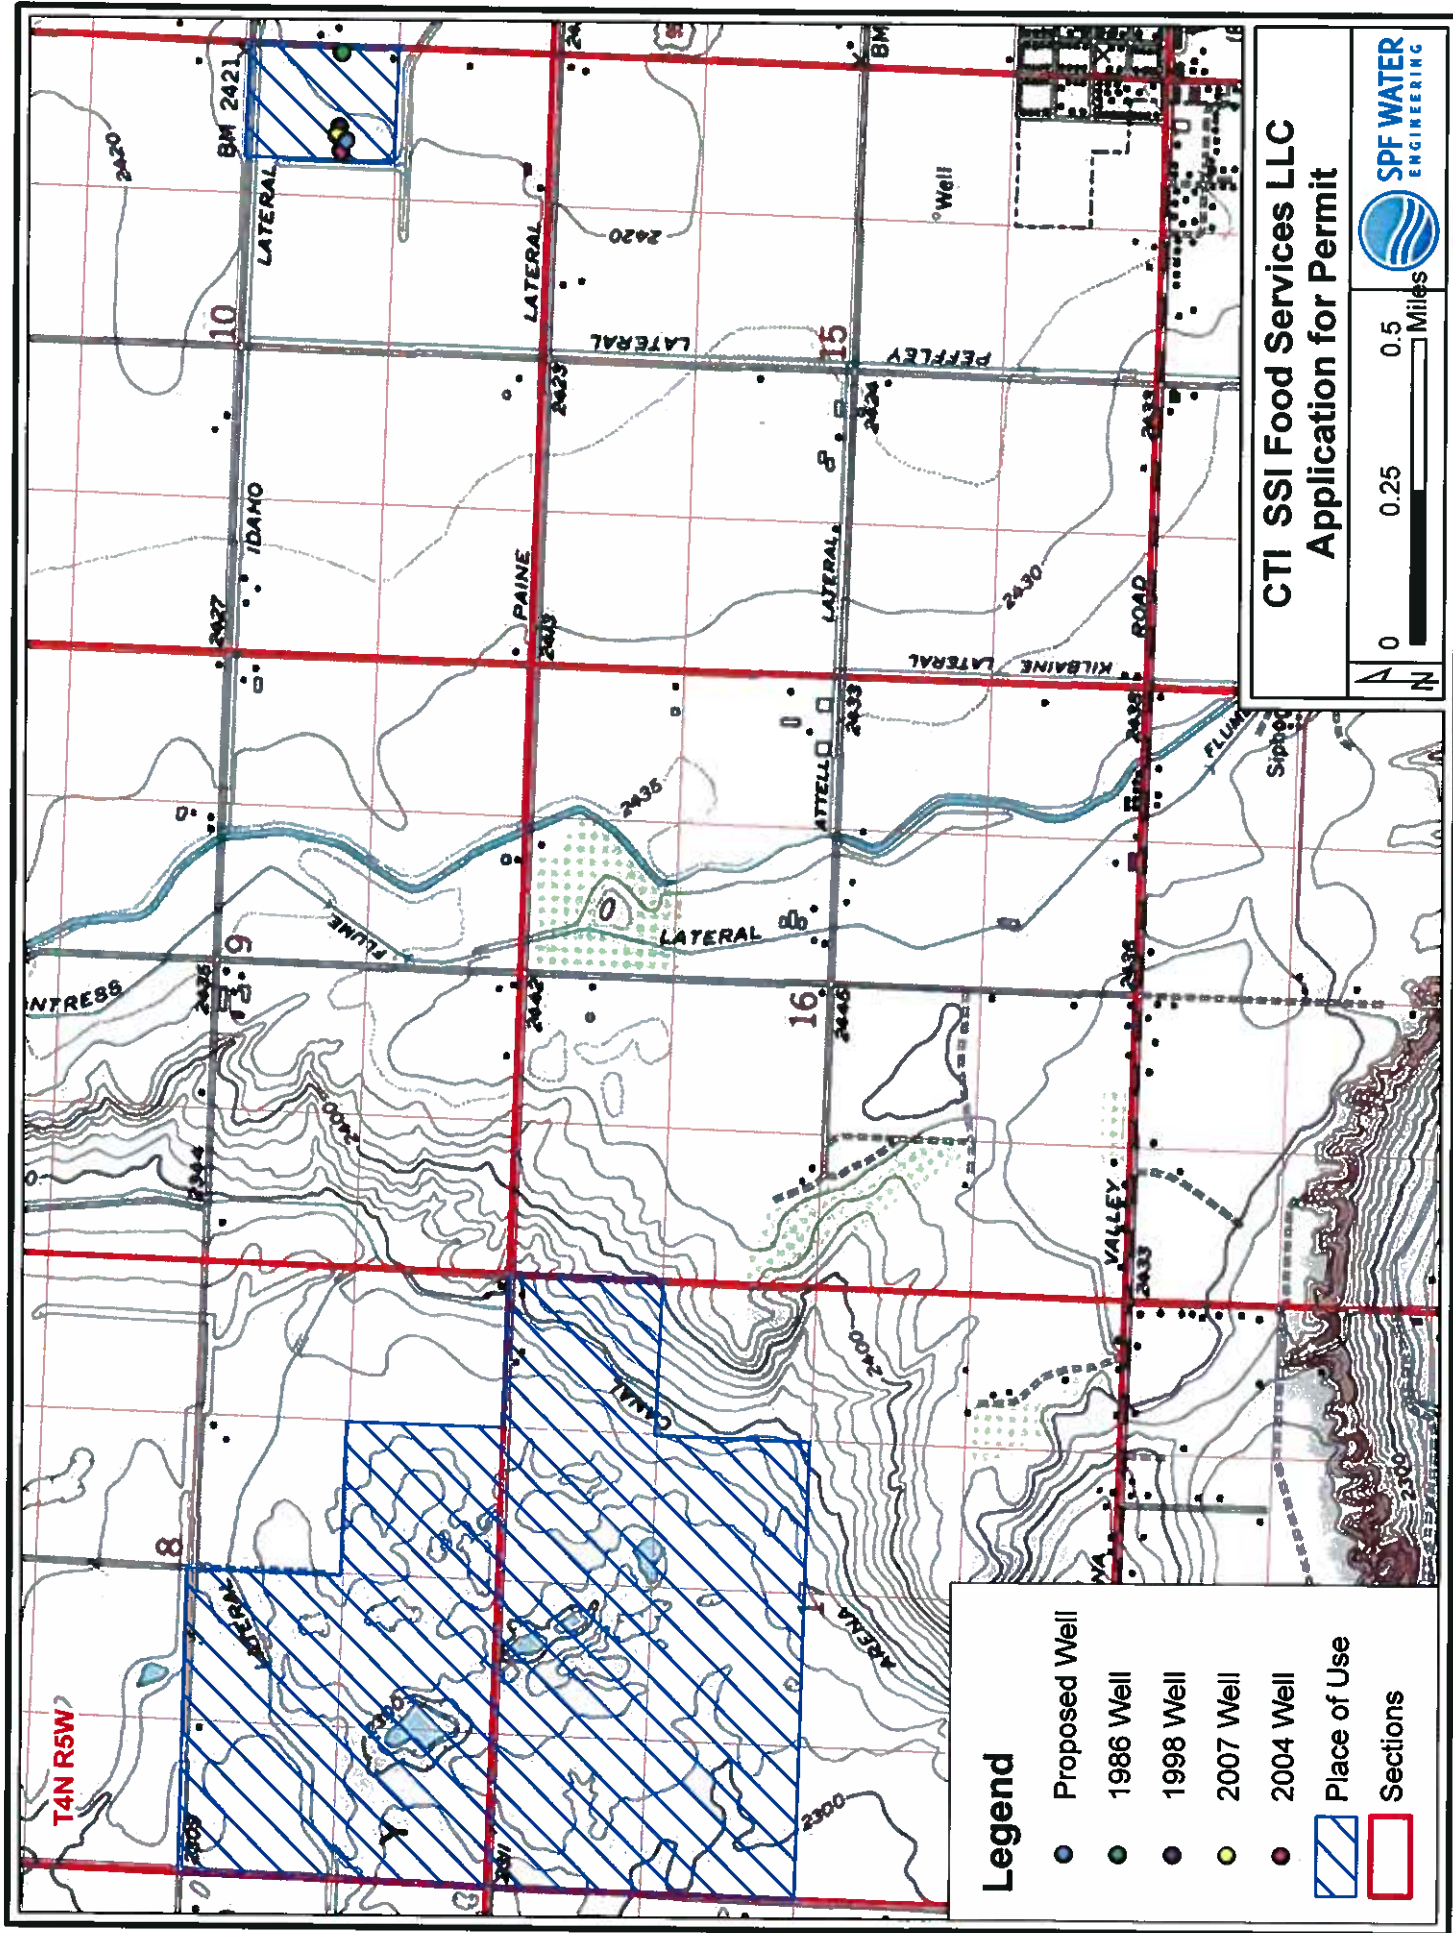

63-33366

Existing Wells

Date Drilled	Well Owner	Drilling Firm	Drilling Permit No.
12/28/1986	SSI	Daugherty Well Drilling#333	u/k
8/16/1998	SSI	Riverside Inc. #333	94479
7/15/2004	CTI-SSI	Riverside Inc. #333	817597
4/16/2007	CTI-SSI	Riverside Inc. #333	845499

Associated well Driller's reports are attached.

The well driller's report for the 1998 well describes a 14-inch cased well and an 8-inch cased well. The 14-inch cased well has been abandoned. The 8-inch cased well continues to be used.

RECEIVED

Page 1 of 2

Form 238-7
7/94

JAN 22 1999 IDAHO DEPARTMENT OF WATER RESOURCES

WELL DRILLER'S REPORT

Use Typewriter
or
Ball Point Pen

Department of Water Resources WR

94178

1. DRILLING PERMIT NO. 63-98-4-0503-200
Other IDWR No. Well Tag # D 000 73982. OWNER:
Name SST Food Services
Address 22303 Highway 95
City Wilder State ID Zip 83676

3. LOCATION OF WELL by legal description:

Sketch map location must agree with written location.

N		Twp. <u>4</u>		North ☒ or South ☐	
W		Rge. <u>5</u>		East ☐ or West ☒	
E		Sec. <u>10</u>		1/4 <u>NE</u> 1/4 <u>SE</u> 1/4	
S		Gov't Lot		County <u>Canyon</u> 10 acres 40 acres 160 acres	

Address of Well Site 22303Highway 95 City Wilder
(Give at least name of road + Distance to Road or Landmark)

Lt. _____ Blk. _____ Sub. Name _____

4. PROPOSED USE:

☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☒ Other Industrial

5. TYPE OF WORK

☐ New Well ☐ Modify or Repair ☒ Replacement ☐ Abandonment

6. DRILL METHOD

☐ Mud Rotary ☐ Air Rotary ☐ Cable ☒ Other Reverse Rotary

7. SEALING PROCEDURES

SEAL/FILTER PACK			AMOUNT		METHOD
Material	From	To	Sacks or Pounds		
Bentonite	0	275	42,000 LB	over bore	
Colarado sand	275	390	43,000 LB	over bore	
Bentonite	390	400	4,000 LB	over bore	
Colarado sand	400	460	4,700 LB	over bore	

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) _____Was drive shoe seal tested? ☐ Y ☐ N ☐ How? _____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
14"	±2	410	375	Steel	☒	☐	☒	☐
10"	392	412	365	Steel	☒	☐	☒	☐
10"	442	452	365	Steel	☒	☐	☒	☐

Length of Headpipe _____ Length of Tailpipe _____

9. PERFORATIONS/SCREENS

☐ Perforations Method _____☒ Screens Screen Type _____

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
412	432	.030		10"	SS	☒	☐
432	442	.035		10"	SS	☒	☐

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

88 ft. below ground Artesian pressure _____ lb.Depth flow encountered _____ ft. Describe access port or control devices: Baker Pit Loss Unit

11. WELL TESTS:

☐ Pump ☐ Baller ☐ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
400	126		6 hrs

Water Temp. 77.5° Bottom hole temp. _____

Water Quality test or comments: _____

12. LITHOLOGIC LOG: (Describe repairs or abandonment)

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Y	N
28	0	12	Top soil		☒
28	12	20	hard Pan		☒
11	20	32	Sandy Brown clay		☒
11	32	112	Brown clay		
11	112	118	Fine to coarse sand		
11	118	132	Brown clay		
11	132	142	Fine to coarse sand		
11	142	150	Brown clay		
11	150	186	Blue clay		
11	186	193	Fine Black sand		
28	193	217	gray clay		
11	217	219	Fine to coarse sand		
11	219	222	gray clay		
11	222	247	Fine sand		
11	247	249	gray clay		
11	249	253	Fine sand		
11	253	300	Gray clay		
11	300	310	Fine to med sand		
11	310	333	Gray clay		
11	333	340	Fine sand		
11	340	375	gray clay		
11	375	387	Fine to coarse sand		
11	387	412	gray clay		
11	412	420	Fine to med sand		
11	420	422	gray clay		
11	422	449	Fine to coarse sand		
11	449	550	Gray clay		
18	560	577	Gray clay		
18	577	589	Sand & clay mixed		
18	588	630	Gray clay		
MICROFILMED					
MAR 08 1999					

Completed Depth 452 (Measurable)
Date: Started 7-22-98 Completed 8-16-98

13. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Firm Name Riverside, Inc Firm No. 333

Firm Official _____ Date _____

and _____
Supervisor or Operator _____ Date 1-21-99

(Sign once if Firm Official & Operator)

FORWARD WHITE COPY TO WATER RESOURCES

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

Office Use Only		
Well ID No.	817597	
Inspected by		
Twp	Rge	Sec
1/4	1/4	1/4
Lat:	:	Long:

1. WELL TAG NO. D 0031658
 DRILLING PERMIT NO. 88346-817597
 Water Right or Injection Well No. 63-10222, 17-31640

2. OWNER:
 Name CTI-SST Food Services, LLC
 Address P.O. Box 700
 City Caldwell State ID Zip 83606

3. LOCATION OF WELL by legal description:

You must provide address or Lot, Blk, Sub. or Directions to well.

Twp. 4 North ☒ or South ☐
 Rge. 5 East ☐ or West ☒
 Sec. 10 1/4 NE 1/4 SE 1/4
 Gov't Lot _____ County Canyon
 Lat: _____ Long: _____
 Address of Well Site 22303 Hwy 95
 City Wilder

(Give at least one of: Lot, Blk, Sub. or Distance to Road or Landmark)
 Lt. _____ Blk. _____ Sub. Name _____
SST Food Services Plant

4. USE:

☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☐ Other Industrial

5. TYPE OF WORK check all that apply

☐ New Well ☐ Modify ☐ Abandonment ☐ Other Replacement

6. DRILL METHOD:

☐ Air Rotary ☐ Cable ☐ Mud Rotary ☐ Other Reverse

7. SEALING PROCEDURES

Seal Material	From	To	Weight / Volume	Seal Placement Method
<u>Bentonite Chips</u>	<u>0</u>	<u>377</u>	<u>40,000 lb</u>	<u>Dry Pour</u>

Was drive shoe used? ☐ Y ☒ N Shoe Depth(s) _____
 Was drive shoe seal tested? ☐ Y ☐ N How? _____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
<u>10"</u>	<u>73</u>	<u>400</u>	<u>36</u>	<u>Steel</u>	☒	☐	☒	☐

Length of Headpipe _____ Length of Tailpipe _____
 Packer ☐ Y ☒ N Type _____

9. PERFORATIONS/SCREENS PACKER TYPE

Perforation Method Wire Wrap Factory
 Screen Type & Method of Installation Johnson Wire Wrap

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
<u>400'</u>	<u>430'</u>	<u>.030</u>		<u>10"</u>	<u>S.S.</u>	☒	☐

10. FILTER PACK

Filter Material	From	To	Weight / Volume	Placement Method
<u>S.S. Sand</u>	<u>322'</u>	<u>444'</u>	<u>15,000 lbs</u>	<u>Dry Pour</u>

11. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

135 ft. below ground Artesian pressure _____ lb.
 Depth flow encountered _____ ft. Describe access port or control devices: _____
Baker Well Cap.

12. WELL TESTS:

☒ Pump ☐ Bailer ☐ Air ☐ Flowing Artesian

Yield gal/min.	Drawdown	Pumping Level	Time
<u>400</u>	<u>152'</u>	<u>280'</u>	<u>8 hrs</u>

Water Temp. 76.3°F Bottom hole temp. _____

Water Quality test or comments: EC 360 pH 8.15

13. LITHOLOGIC LOG: (Describe repairs or abandonment)

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Water
				Y N
	20"	0	11' Topsoil	
		11'	20' Clay	
		20'	23' Dark Clay	
		23'	34' Gravel River Rock	
		34'	82' Tan Clay	
		82'	84' Med Sand	
		84'	154' Brown Clay & Sand layers	
		154'	376' Blue Clay & Sand layers	
		376'	402' Blue Clay & Sand	
		402'	428' Fine to Coarse Sand	
		428'	444' Blue Clay sand (sh)	

RECEIVED

AUG 12 2004

WATER RESOURCES
WESTERN REGION

Completed Depth 430' (Measurable)
 Date: Started 6-22-04 Completed 7-15-04

14. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Riverside Inc. Firm No. 333

Principal Driller _____ Date _____
 and _____
 Driller or Operator II _____ Date 8-10-04
 Operator I _____ Date _____

Principal Driller and Rig Operator Required.
 Operator I must have signature of Driller/Operator II.

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

845499

Office Use Only
Well ID No. 415582
Inspected by _____
Twp _____ Rge _____ Sec _____
1/4 _____ 1/4 _____ 1/4 _____
Lat: _____ Long: _____

1. WELL TAG NO. D 0047903
DRILLING PERMIT NO. 898773-845499
Water Right or Injection Well No. 63-10727, 63-31640

2. OWNER:
Name CTI-SSI FOOD SERVICES
Address 22303 HIGHWAY 95
City WILDER State ID Zip 83676

3. LOCATION OF WELL by legal description:

You must provide address or Lot, Blk, Sub. or Directions to well.

Twp. 4 North ☒ or South ☐
Rge. 5 East ☐ or West ☒
Sec. 10 1/4 NE 1/4 SE 1/4
Gov't Lot _____
County CANYON 10 acres 40 acres 160 acres
Lat: _____ Long: _____

Address of Well Site 22303 HIGHWAY 96
City WILDER

City _____
Lt. _____ Blk. _____ Sub. Name _____

4. USE:

☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☒ Other INDUSTRIAL

5. TYPE OF WORK check all that apply

☐ New Well ☐ Modify ☐ Abandonment ☒ Other REPLACEMENT (Replacement etc.)

6. DRILL METHOD:

☐ Air Rotary ☐ Cable ☐ Mud Rotary ☒ Other REVERSE

7. SEALING PROCEDURES

Seal Material	From	To	Weight / Volume	Seal Placement Method
<u>BENTONITE</u>	<u>0</u>	<u>405</u>	<u>47,500</u>	<u>DRY POUR</u>

Was drive shoe used? ☐ Y ☒ N Shoe Depth(s) _____

Was drive shoe seal tested? ☐ Y ☒ N How? _____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
<u>14</u>	<u>+2</u>	<u>405</u>	<u>315</u>	<u>STEEL</u>	☒	☐	☒	☐
<u>6</u>	<u>401</u>	<u>411</u>	<u>280</u>	<u>STEEL</u>	☒	☐	☒	☐
<u>6</u>	<u>441</u>	<u>451</u>	<u>280</u>	<u>STEEL</u>	☒	☐	☒	☐

Length of Headpipe _____ Length of Tailpipe _____

Packer ☒ Y ☐ N Type K-PACKER

TOP K-PACKER 395'

9. PERFORATIONS/SCREENS PACKER TYPE

Perforation Method _____

Screen Type & Method of Installation JOHNSON WIRE WRAP

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
<u>411</u>	<u>441</u>	<u>.030</u>		<u>6</u>	<u>S.S.</u>	☒	☐

10. FILTER PACK

Filter Material	From	To	Weight / Volume	Placement Method
<u>3/8" PEA GRAVEL</u>	<u>391</u>	<u>455</u>	<u>6000</u>	<u>DRY POUR</u>

11. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

139 ft. below ground Artesian pressure _____ lb.
Depth flow encountered _____ ft. Describe access port or control devices: _____

BAKER MONITORING CAP

12. WELL TESTS:

☒ Pump ☐ Bailor ☐ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
<u>400 gpm</u>	<u>134</u>	<u>273</u>	<u>8 hrs</u>

Water Temp. _____

Bottom hole temp. _____

Water Quality test or comments: _____

Depth first Water Encounter _____

13. LITHOLOGIC LOG: (Describe repairs or abandonment)

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Y	N
<u>24</u>	<u>0</u>	<u>4</u>	<u>TOP SOIL</u>		
	<u>4</u>	<u>10</u>	<u>SANDY LOAM</u>		
	<u>10</u>	<u>15</u>	<u>DRY CLAY</u>		
	<u>15</u>	<u>17</u>			
	<u>17</u>	<u>24</u>	<u>BURNT CLAY</u>		
	<u>24</u>	<u>31</u>	<u>SAND, GRAVEL</u>		
	<u>31</u>	<u>33</u>	<u>BRN CLAY</u>		
	<u>33</u>	<u>37</u>	<u>FINE SAND</u>		
	<u>37</u>	<u>108</u>	<u>CLAY</u>		
	<u>108</u>	<u>118</u>	<u>FINE SAND, GRAVEL</u>		
	<u>118</u>	<u>134</u>	<u>BRN CLAY, SAND LAYERS</u>		
	<u>134</u>	<u>143</u>	<u>MED-COARSE SAND, PEA GRAVEL</u>		
	<u>143</u>	<u>188</u>	<u>CLAY</u>		
	<u>188</u>	<u>194</u>	<u>FINE SAND, SM GRAVEL</u>		
	<u>194</u>	<u>222</u>	<u>BLUE CLAY w/SM SAND LAYER</u>		
	<u>222</u>	<u>251</u>	<u>FINE BLACK SAND</u>		
	<u>251</u>	<u>299</u>	<u>BLUE/GREY CLAY w/SAND LAYERS</u>		
	<u>299</u>	<u>309</u>	<u>COARSE SAND</u>		
	<u>309</u>	<u>356</u>	<u>BLUE/GREY CLAY w/SAND LAYERS</u>		
	<u>356</u>	<u>379</u>	<u>FINE-COARSE SAND w/CLAY LAYER</u>		
	<u>379</u>	<u>411</u>	<u>BLUE/GREY CLAY</u>		
	<u>411</u>	<u>453</u>	<u>FINE-COARSE SAND w/SM CLAY LAYER</u>		
	<u>453</u>	<u>455</u>	<u>GREY CLAY</u>		

RECEIVED

MAY 15 2007

WATER RESOURCES
WESTERN REGION

Completed Depth 451' (Measurable)

Date: Started 3-1-07 Completed 4-16-07

14. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name RIVERSIDE INC Firm No. 333

Principal Driller [Signature] Date 5-14-07

and Driller or Operator II [Signature] Date 5-14-07

Operator I _____ Date _____

Principal Driller and Rig Operator Required.
Operator I must have signature of Driller/Operator II.

IDAHO PRESS TRIBUNE
AD AUTHORIZATION

Salesperson: KATHERINE HOLMQUIST

Printed at 09/30/10 10:53 by \$LOGIN

Acct#:	29512	Ad#:	313558	Status:	N
	1 IDAHO DEPT. OF WATER RESOURCES	Start:	10/07/10	Stop:	10/14/10
	2735 AIRPORT WAY	Times Ord:	2	Times Run:	****
	BOISE ID 83705	LEG	4.00 X	45.00 Words:	429
Contact:	DENISE BUFFINGTON	Rate:	L4	Cost:	286.79
Phone:	(208)334-2190	Class:	0001 LEGAL	NOTICES	
Fax#:		Descript:	63-33366		
Email:	Denise.Buffington@idwr.idaho	Given by:	*		
Agency:		Created:	kho14 09/30/10 10:50		
		Last Changed:	kho14 09/30/10 10:53		

PUB	ZONE	ED	TP	START	INS	STOP	SMTWTFs
IPT	A		96	S 10/07,14			

AUTHORIZATION

Under this agreement rates are subject to change with 30 days notice. In the event of a cancellation before schedule completion, I understand that the rate charged will be based upon the rate for the number of insertions used.

Name (print or type)

DBuffington
Name (signature)

(AD COPY ON NEXT PAGE)

Press Tribune →

63-33366

X-fee 76570

enj. wells 63-W-056-001
057-001

✓ OK (proofed) 9/30/2010 DB
e-mailed newspaper ↑

IDAHO PRESS TRIBUNE
AD AUTHORIZATION
(CONTINUED)

Salesperson: KATHERINE HOLMQUIST

Printed at 09/30/10 10:53 by \$LOGIN

Acct#: 29512

Ad#: 313558 Status: N

63-33366

CTI SSI FOOD SERVICES LLC

22303 HWY 95

WILDER, ID 83676

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Use: INDUSTRIAL 01/01 to 12/31 0.75 CFS

Total Diversion: 0.75 CFS

Date Filed: 4/23/2010

Place Of Use: INDUSTRIAL

T04N R05W S8 SW (ALL) SWSE

T04N R05W S10 NESE

T04N R05W S17 NENE NWNE SWNE NW (ALL)

Water bearing zone to be appropriated is from 125 to 460 feet.

Industrial use is for food processing plant.

PROPOSED CHANGE OF WATER RIGHT

A.B.L. Water Users of 17165 Elmcrest Dr., Caldwell, ID, 83607, filed Application No. 76570 to transfer one water right with a 1990 priority date from a ground water source totaling 0.03 cfs. The purpose of the transfer is to add a new point of diversion for four of the existing homes in

Elm Crest Subdivision. Water will be used at the current place of use south of Goodson Road and west of Wagner Road.

NOTICE OF DRAFT PERMIT

Notice is given of draft permit(s) allowing the operation of an injection well as per provisions of Title 42, Chapter 39, Idaho Code for the following injection well(s) listed in this format // Well Number, Location, Operator, Injectate //: // 63-W-056-001, T1N-R2W-S30-SESESE, C. Vanderstelt, Agricultural Runoff // 63-W-057-001, T1N-R2W-S30-SWSWSE, C. Vanderstelt, Agricultural Runoff. Copies can be requested from the Idaho Department of Water Resources at (208) 287-4800. Comments or requests for fact-finding hearings must be filed with the Department within

30 days of the initial publication date of this notice.

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Idaho Code § 42-211 / § 42-222. For specific details regarding the application, please contact the Idaho Department of Water Resources (IDWR) Western Region at 208-334-2190 or visit www.idwr.idaho.gov with details provided under "new water right applications." Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise ID 83705 together with a protest fee of \$25.00 for each application on or before October 25, 2010. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Interim Director
Published on 10/7 & 10/14/2010

October 7, 14, 2010

313558

✓ OK DB (proofed) 9/30/2010

Buffington, Denise

From: Buffington, Denise
Sent: Wednesday, September 29, 2010 2:24 PM
To: Press Tribune
Subject: LEGAL NOTICES - CANYON COUNTY
Attachments: Canyon County Ads - Cover Letter.Doc; Canyon County Ads - COMBINED.docx

Attached please find (1) legal notice being submitted for publication. Please contact me immediately if you have any questions, or if you are not able to publish the ad on the dates requested.

Thank you in advance,

*Denise Buffington
Administrative Assistant I
Dept of Water Resources
Western Region
(208) 334-2190*

September 29, 2010

LEGAL NOTICE DEPARTMENT

PRESS-TRIBUNE
PO BOX 9399
NAMPA, ID 83652

RE: Transfer No. 76570
Water Right No(s). 63-11229

RE: Application For Permit No(s).: 63-33366

RE: Injection Well No. 63-W-056-001 & 63-W-057-001

Dear Legal Notice Department:

Please publish the enclosed legal notice on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 10/25/2010. Your cooperation is appreciated.

Sincerely,

Denise Buffington
Administrative Assistant

Enclosure(s)

63-33366

CTISSI FOOD SERVICES LLC

22303 HWY 95

WILDER, ID 83676

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Point of Diversion NESE S10 T04N R05W CANYON County Source GROUND WATER Tributary

Use: INDUSTRIAL 01/01 to 12/31 0.75 CFS

Total Diversion: 0.75 CFS

Date Filed: 4/23/2010

Place Of Use: INDUSTRIAL

T04N R05W S8 SW (ALL) SWSE

T04N R05W S10 NESE

T04N R05W S17 NENE NWNE SWNE NW (ALL)

Water bearing zone to be appropriated is from 125 to 460 feet.

Industrial use is for food processing plant.

PROPOSED CHANGE OF WATER RIGHT

A.B.L. Water Users of 17165 Elmcree Dr., Caldwell, ID, 83607, filed Application No. 76570 to transfer one water right with a 1990 priority date from a ground water source totaling 0.03 cfs. The purpose of the transfer is to add a new point of diversion for four of the existing homes in Elm Crest Subdivision. Water will be used at the current place of use south of Goodson Road and west of Wagner Road.

NOTICE OF DRAFT PERMIT

Notice is given of draft permit(s) allowing the operation of an injection well as per provisions of Title 42, Chapter 39, Idaho Code for the following injection well(s) listed in this format // Well Number, Location, Operator, Injectate //: // 63-W-056-001, T1N-R2W-S30-SESESE, C. Vanderstelt, Agricultural Runoff // 63-W-057-001, T1N-R2W-S30-SWSWSE, C. Vanderstelt, Agricultural Runoff. Copies can be requested from the Idaho Department of Water Resources at (208) 287-4800. Comments or requests for fact-finding hearings must be filed with the Department within 30 days of the initial publication date of this notice.

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Idaho Code § 42-211 / § 42-222. For specific details regarding the application, please contact the Idaho Department of Water Resources (IDWR) Western Region at 208-334-2190 or visit www.idwr.idaho.gov with details provided under "new water right applications." Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise ID 83705 together with a protest fee of \$25.00 for each application on or before October 25, 2010. The protestant must also send a copy of the protest to the applicant.

GARY SPACKMAN, Interim Director

Published on 10/7 & 10/14/2010

Walker, Kay

From: Terry Scanlan [TScanlan@spfwater.com]
Sent: Thursday, September 23, 2010 8:19 PM
To: Walker, Kay
Subject: RE: Application for Permit 63-33366 - CTI SSI Food Services LLC

Kay –

I propose a water-bearing zone of 125 to 460 feet. Specific water-bearing zones by well are listed below.

1986 8-inch well – Cased to 125 feet, total depth 199 feet. Water-bearing zone 125 to 199 feet
1998 8-inch well – Cased to 298 feet, total depth 390 feet. Water-bearing zone 298 to 390 feet
2004 10-inch well – Cased to 400 feet. Total depth 430 feet. Water-bearing zone 400 to 430 feet
2007 14-inch well – Cased to 401 feet. Total depth 451 feet. Water-bearing zone 401 to 451 feet
Future well – Likely water bearing zone will be 400 to 450 feet.

Let me know if you need anything else. Thanks.

Terry

From: Walker, Kay [mailto:Kay.Walker@idwr.idaho.gov]
Sent: Thursday, September 23, 2010 1:40 PM
To: Terry Scanlan
Cc: Walker, Kay
Subject: Application for Permit 63-33366 - CTI SSI Food Services LLC

Hi, Terry.

In initial review of this application, we find that we need to have information concerning the water bearing zone to be appropriated for each of the wells to be utilized. Please submit this information so we can proceed with our review.

Thanks for your attention to this matter.

Kay Walker

Sr. Water Resource Agent



SPF WATER
ENGINEERING, LLC

April 21, 2010

RECEIVED

APR 23 2010

WATER RESOURCES
WESTERN REGION

John Westra
Idaho Department of Water Resources
2735 Airport Way
Boise, ID 83705

Subject: Application for Permit – CTI-SSI Food Services LLC

Dear John:

Enclosed on behalf of CTI-SSI Food Services is an Application for Permit seeking 0.75 cfs of ground water for industrial purposes at the CTI-SSI plant near Wilder. Included with the application is a check for the \$250 filing fee.

CTI-SSI currently has two existing water rights for industrial use at the facility that together authorize diversion of 1.34 cfs and an annual diversion volume of 439.4 acre feet. If approved, the proposed permit will increase the allowable diversion rate to 2.09 cfs, and the annual diversion volume to a maximum of 982 acre feet.

Please contact me with any questions or comments concerning this application.

Sincerely,

Terry M. Scanlan, P.E., P.G.

Enclosures

Cc: Randy Shuman – CTI-SSI Food Services

File: 277.0080