

AQUARIUS II AP SERIES




ur second generation Aquarius II Series brings you the highest efficiency series of geothermal units available on the market today.

A heat pump operates at full load less than 60% of the time so it is only logical to have a unit that can match the load profile of a building.

The Aquarius II Series features a state of the art two stage unloading scroll compressor which, when controlled by a multistage thermostat, stages the unit to match the demand for heating and cooling. The result, up to 70% lower energy bills, increased comfort and better humidity control.

All FHP's Aquarius II Series units come ready for operation in a geothermal application. Using the earth's energy to heat and cool your home not only makes economic sense but is good for the environment. No oil, natural gas or propane is used in the operation of a geothermal unit meaning no carbon dioxide emissions that may harm our environment. Increase your energy savings with an internally mounted heat recovery system providing much of your hot water needs at virtually no additional operating cost.

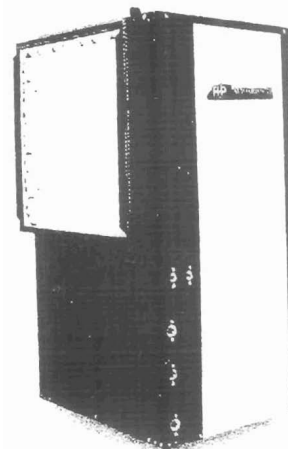

● Efficiency

The industry's highest rated series for efficiency. Our Aquarius II Series has two stages of control so you do not use more energy than you need.

● Quiet Operation

The Aquarius II Series has been designed to be quiet. FHP's unique floating compressor base pan and compressor blanket keep sound to an absolute minimum. The ECM motors are whisper quiet and can be adjusted to provide the proper air flow depending on the distribution layout.

● Environmentally Friendly

Geothermal systems are the most environmentally friendly way to heat and cool your home. No fossil fuels are consumed in the operation of the unit meaning no carbon dioxide or other emissions that could increase greenhouse gases that contribute to global warming. FHP's Aquarius II systems use refrigerant R-410A the industry's answer to R-22 helping to preserve the earth's ozone layer.


● FHP Quality and Reliability Since 1970

FHP's Aquarius II Series feature coated evaporator coils, stainless steel drain pans and a black vinyl coated cabinet as standard to ensure long trouble free life of the units. Rigorous factory testing of each unit ensures trouble free operation from the start.


heat pumps

AQUARIUS II AP SERIES

VERTICAL

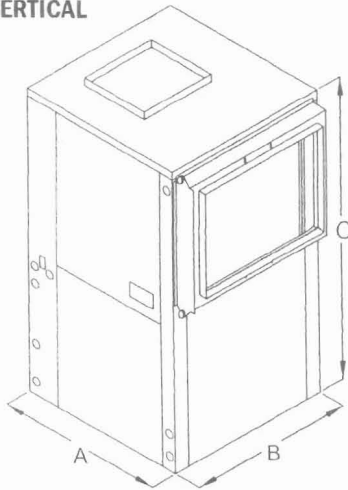


COUNTERFLOW

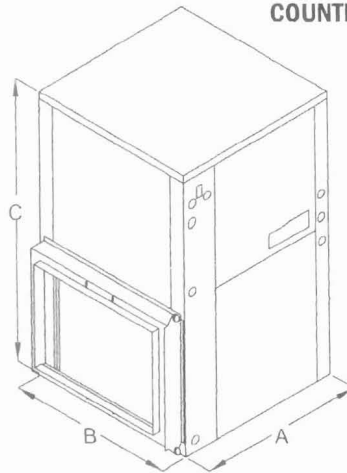

DIMENSIONS

MODEL	VERTICAL/C. FLOW			HORIZONTAL		
	WIDTH	DEPTH	HEIGHT	WIDTH	LENGTH	HEIGHT
	A	B	C	D	E	F
AP025	21.50	26.00	47.25	26.00	54.50	22.00
AP035	24.00	33.25	47.25	30.00	68.00	22.00
AP049	26.00	33.25	58.00	30.00	68.00	22.00
AP061	26.00	33.25	66.25	30.00	89.00	22.00
AP071	26.00	33.25	66.25	30.00	89.00	22.00

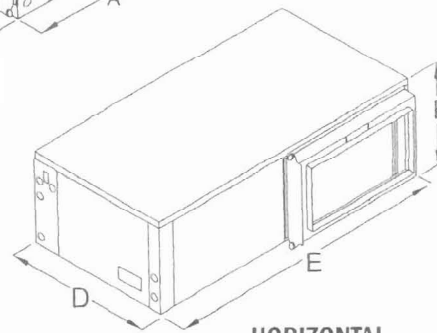

HORIZONTAL

All ratings & specifications are subject to change without notice.

MODEL	CFM	ARI / ISO 13256-1 PERFORMANCE DATA											
		ENTERING WATER TEMPERATURES											
		Water Loop				Ground Water				Ground Loop			
		86°F		68°F		59°F		50°F		77°F		32°F	
		CAPACITY AND EFFICIENCY DATA											
		COOLING CAPACITY (WLHP)	EER (WLHP)	HEATING CAPACITY (WLHP)	COP (WLHP)	COOLING CAPACITY (GWHP)	EER (GWHP)	HEATING CAPACITY (GWHP)	COP (GWHP)	COOLING CAPACITY (GLHP)	EER (GLHP)	HEATING CAPACITY (GLHP)	COP (GLHP)

AP025

Part Load	750	20,000	19.3	23,000	6.5	22,500	32.5	19,500	5.5	22,000	27.8	16,600	4.7
Full Load	950	27,000	16.2	32,500	5.3	31,000	25.1	26,500	4.8	28,500	19.2	20,400	4.1

AP035

Part Load	1000	25,700	19.8	29,500	6.3	29,500	34.0	24,300	5.3	28,200	28.5	22,000	4.8
Full Load	1200	36,600	16.0	43,000	5.1	41,200	23.5	36,200	4.7	38,200	18.4	28,200	4.1

AP049

Part Load	1300	37,000	20.0	38,500	5.9	41,200	32.5	31,500	5.0	40,200	28.0	28,000	4.6
Full Load	1700	50,000	16.9	53,000	5.2	56,000	24.0	45,500	4.8	52,000	19.0	38,000	4.1

AP061

Part Load	1500	47,000	19.0	56,500	6.2	53,000	33.0	45,000	5.2	51,000	27.7	39,000	4.6
Full Load	2000	64,000	16.2	78,500	5.4	71,000	23.8	65,000	5.0	67,000	18.5	49,000	4.1

AP071

Part Load	1500	53,000	18.2	65,800	5.2	59,000	28.8	53,700	4.6	57,500	25.2	47,000	4.1
Full Load	2300	72,000	16.0	89,000	5.2	78,000	21.8	73,000	4.7	74,000	18.0	58,000	4.1

Tabulated performance data is at noted entering water temperatures and entering air conditions of 80.6° F DB/66.2° F WB at ARI/ISO 13256-1 rated CFM



FHP MANUFACTURING COMPANY

661 NW 65TH COURT • FT. LAUDERDALE, FL 33309 • PHONE: (954) 776-5471 • FAX: (800) 776-5529

<http://www.fhp-mfg.com>

heat pumps

PERFORMANCE DATA



GUIDE SPECIFICATIONS *aquarius ii*

AP Series Two Stage R-410A

GENERAL

Units shall be performance certified to ISO standard 13256-1 for Water Loop Heat Pump, Ground Water Heat Pump and Ground Loop Heat Pump applications. Units shall be Underwriter Laboratories (UL and ULC) listed for safety on all models. Each unit shall be run tested at the factory. Each unit shall be pallet mounted and stretch wrapped. The units shall be manufactured in an ISO9001:2000 certified facility.

The units shall be warranted by the manufacturer against defects in materials and workmanship for a period of i) in the case of residentially sold units having the last digit of the serial number as a 'T'; five years on all parts and 10 years on the refrigerant circuit components ii) on all other units; five years on the compressor and one year on all other parts.

The units shall be designed to operate with entering fluid temperatures between 50°F (10°C) and 110°F (43.3°C) in cooling and temperatures between 20°F (-6.6°C) and 80°F (27°C) in heating as manufactured by FHP Manufacturing in Fort Lauderdale, Florida.

CASING & CABINET

The cabinet shall be fabricated from heavy-gauge steel finished with a vinyl coated black cabinet and decorative gold anodized aluminum front panel for corrosion protection. The interior shall be insulated with 1/2" (12.7mm) thick foil faced glass fiber. All units shall allow sufficient service access to replace the compressor without unit removal. One blower and two compressor compartment access panels shall be removable with supply and return ductwork in place. A duct collar shall be provided on the supply air opening. A filter rack with 2" (50.8 mm) thick disposable filters and a 1" (25.4mm) return air duct collar shall be provided with each unit. Air filters shall be MERV 11 rated. The units shall have an insulated divider panel between the air handling section and the compressor section to minimize the transmission of compressor noise, and to permit service testing without air bypass. Units shall have a stainless steel condensate drain pan. The compressor shall have a floating base pan to minimize noise transmissions.

REFRIGERATION CIRCUITS

All units shall contain a sealed refrigerant circuit including a two stage scroll compressor, bi-directional thermal expansion valve metering device, finned tube air-to-refrigerant heat exchanger, refrigerant reversing valve and service ports. Compressor shall be high efficiency two stage scroll type, designed for heat pump duty, quiet operation and mounted on rubber vibration isolators. Compressor motors shall be equipped with overload protection. Refrigerant reversing valves shall be pilot operated sliding piston type with replaceable encapsulated magnetic coils energized only during the cooling cycle. The finned tube coil shall be constructed of lanced aluminum fins not exceeding fourteen fins per inch bonded to rifled copper tubes in a staggered pattern not less than three rows deep and have a 450 PSIG (3100 kPa) working pressure. Coils shall have a baked polyester enamel coating for protection against most airborne chemicals. Coil end plates shall be aluminum. The coaxial water-to-refrigerant heat exchanger shall be constructed of a convoluted copper (optional cupronickel) inner tube and steel outer tube with a designed refrigerant working pressure of 450 PSIG (3100 kPa) and a designed water side working pressure of no less than 400 PSIG (2750 kPa). The water-to-refrigerant heat exchanger shall be insulated to prevent condensation at low fluid temperatures.

FAN MOTOR & ASSEMBLY

The fan shall be direct drive centrifugal forward curved type with a dynamically balanced wheel. The housing and wheel shall be designed for quiet low velocity operation. The fan housing shall be removable from the unit without disconnecting the supply air ductwork for servicing of

the fan motor. The fan motor shall be an ECM-2 microprocessor controlled DC type motor with internal programming factory set for the specific unit and featuring soft start/stop and a delay off feature for maximum efficiency and quiet operation. Air flow rates shall be varied according to the staging of the unit. There will further be provisions for adjusting the air delivery of the motor and blower by +/- 15% from rated air flow.

ELECTRICAL

Controls and safety devices will be factory wired and mounted within the unit. Controls shall include comfort alert module, compressor contactor, 24V transformer, reversing valve coil and solid state lock-out controller (UPM). The UPM controller shall include the following features: diagnostic LED's, low pressure bypass time delay (to prevent nuisance low pressure lock-outs during operation with low fluid temperatures), anti short cycle time delay, random start time delay and one time intelligent reset. When the safety controls are activated the lock-out circuit shall reset itself the first time. If the safety controls are subsequently activated within one hour, then the lock-out circuit shall disable the compressor until it is reset at the thermostat or main circuit breaker to prevent compressor operation during fault conditions. A lock-out indicating terminal shall be provided in the low voltage circuit. Safety devices include a low pressure cutout set at 40 PSIG (280 kPa) for loss of charge protection (freezestat and/or high discharge gas temperature sensor is not acceptable) and a high pressure cutout control set at 600 PSIG (4100 kPa).

The ECM motor interface board shall provide a screw type terminal block for thermostat connection, LED's to indicate thermostat status and air delivery. It shall also provide a means of changing the motor program to any of up to four pre-programmed options. Direct wiring of the motor control harness to the thermostat is not acceptable.

A terminal block with screw terminals shall be provided for control wiring. An optional condensate overflow device shall be factory installed to stop compressor operation if drain pan overflow is imminent. An optional energy management relay to allow unit control by an external source shall be factory installed.

PIPING

Supply, return water and condensate drain connections shall be brass female pipe thread fittings and mounted flush to cabinet exterior.

INTERNAL ELECTRIC HEAT

208/230-1-60 volt units shall be equipped with optional factory installed internal electric resistance heat for auxiliary and emergency heat. Electric heater must be Underwriter's Laboratories (UL and ULC) approved for safety when installed in the unit. External heater packages or heater packages not specifically listed for use with the unit are unacceptable. Electric heater packages shall include a heater collar mounted to the blower outlet, individual thermal overload protected heater elements no greater than 5kW each and magnetic contactors. Heater packages shall have a separate power supply connection from the compressor and this power supply shall also power the unit blower motor and control transformer for safe operation.

HEAT RECOVERY PACKAGE

208/230 volt units shall be equipped with an optional factory installed internal heat recovery kit for domestic hot water production. This kit shall include an internally protected pump, double walled coaxial water-to-refrigerant heat exchanger, 140°F (60°C) hot water temperature limit switch and an on/off switch/circuit breaker.



PACKAGED UNITS SPECIFICATION DATA SHEET

FHP MANUFACTURING HIGH-EFFICIENCY WATER SOURCE HEAT PUMPS

MAIN House 1
AP061
aquarius II

ELECTRICAL SPECIFICATIONS

Electrical Characteristics	Elect. Symbol	Compressor		Blower		Loop Pump		Min. Circuit Amps	Max. Fuse/Breaker
		RLA	LRA	FLA	HP	FLA	HP		
208/230-1-60	-1	25.7	118.0	6.8	3/4	-	-	41.0	60

MECHANICAL SPECIFICATIONS

Refrigerant: R-410A			
Air Coil			
Square Feet	Rows Deep	Tube O.D.	Fins/Inch
7.5	3	3/8	14
Water Coil			
Type		Work Press	
Coaxial		450 psig	
Blower Size		Compr Type	
11x 9 DD		Scroll	
Net Weight		Ship Weight	
390 lbs		415 lbs	

BLOWER PERFORMANCE

Available External Static Pressure (Inches of Water, Gauge. Wet Coil and Filter Included)

Blower Speed	0.10	0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	1.20
+						1725						
Norm						1500						
-						1275						



ISO 13256-1 CERTIFIED PERFORMANCE DATA Rated at 1500 CFM and 14.0 GPM

Water Loop				Ground Water				Ground Loop			
Cooling		Heating		Cooling		Heating		Cooling		Heating	
Capacity	EER	Capacity	COP	Capacity	EER	Capacity	COP	Capacity	EER	Capacity	COP
47,000	19.0	56,500	6.2	53,000	33.0	45,000	5.2	51,000	27.7	39,000	4.6

FLUID PRESSURE DROP

Fluid Flow (GPM)	Pressure Drop	
	(FOH)	(PSIG)
8	3.5	1.5
12	7.2	3.1
16	12.1	5.3
18	15.0	6.5
22	21.5	9.3

CAPACITY DATA - PART LOAD

COOLING All performance at 1500 CFM and 14.0 GPM EFT Range (Standard) 50°F to 100°F

Entering Fluid Temp. (°F)	Entering Air Temp. (°F)	Total Capacity (MBtuH)	Sensible Capacity (MBtuH)	Sensible to Total Ratio	Power Input (kW)	Heat of Reject (MBtuH)	EER
50°	70°db	47.18	30.54	0.65	1.27	51.51	37.3
60°		45.41	29.64	0.65	1.55	50.71	29.2
70°		43.64	28.84	0.66	1.84	49.92	23.7
85°		40.98	27.79	0.68	2.27	48.73	18.0
100°		38.32	26.89	0.70	2.70	47.55	14.2
50°	75°db	50.53	36.44	0.72	1.27	54.87	39.7
60°		48.63	35.37	0.73	1.56	53.96	31.1
70°		46.73	34.41	0.74	1.85	53.05	25.2
85°		43.89	33.17	0.76	2.28	51.69	19.2
100°		41.04	32.10	0.78	2.72	50.32	15.1
50°	80°db	55.42	40.19	0.73	1.28	59.80	43.2
60°		53.34	39.01	0.73	1.57	58.72	33.9
70°		51.26	37.96	0.74	1.87	57.63	27.5
85°		48.14	36.59	0.76	2.30	56.00	20.9
100°		45.02	35.40	0.79	2.74	54.38	16.4
50°	85°db	60.31	43.98	0.73	1.29	64.73	46.6
60°		58.05	42.69	0.74	1.59	63.47	36.6
70°		55.79	41.54	0.74	1.88	62.21	29.7
85°		52.40	40.04	0.76	2.32	60.32	22.6
100°		49.00	38.75	0.79	2.76	58.43	17.7

HEATING EFT Range (Standard) 25°F to 80°F

Entering Fluid Temp. (°F)	Entering Air Temp. (°F)	Total Capacity (MBtuH)	Power Input (kW)	Heat of Abs. (MBtuH)	COP
50°	60°	49.27	2.53	40.63	5.7
60°		54.35	2.59	45.50	6.1
70°		59.43	2.66	50.36	6.6
80°		64.51	2.72	55.22	6.9
50°	70°	46.56	2.58	37.77	5.3
60°		51.36	2.64	42.35	5.7
70°		56.16	2.71	46.92	6.1
80°		60.97	2.77	51.50	6.4
50°	80°	43.39	2.63	34.39	4.8
60°		47.86	2.70	38.64	5.2
70°		52.33	2.77	42.88	5.5
80°		56.80	2.83	47.12	5.9

LOW TEMP HEATING

Antifreeze Required

25°	60°	35.85	2.37	27.76	4.4
30°		38.34	2.40	30.14	4.7
40°		43.32	2.47	34.91	5.1
25°	70°	33.88	2.41	25.65	4.1
30°		36.24	2.45	27.89	4.3
40°		40.94	2.51	32.37	4.8
25°	80°	31.58	2.47	23.16	3.8
30°		33.77	2.50	25.23	4.0
40°		38.15	2.57	29.39	4.4

Units are complete packages containing compressor, reversing valve, expansion valve metering device, ECM fan motor and heat exchangers. Also included are safety controls. Overload protection for motors, high and low refrigerant pressure switches and solid state lock-out circuit. Optional UL approved internal electric heater. Factory installed with primary thermal overload protection and magnetic contactors (208/230-1-60 only) optional UL approved internal Heat Recovery Package and/or Ground Loop Pump with purge connections available

Performance based on ARI/ISO rated air flow, fluid flow and voltage. For conditions other than rated, consult the FHP EAD selection software. Due to variations in installation actual performance may vary marginally from tabulated values.

As a result of continuing research and development, specifications are subject to change without notice.
AP061 1IP60 Rev 1-08

FHP MANUFACTURING COMPANY
601 N.W. 65th Court - Fort Lauderdale, FL 33309
Phone: (954) 776-5471 - Fax: (800) 776-5529
<http://www.fhp-mfg.com>



PACKAGED UNITS SPECIFICATION DATA SHEET

FHP MANUFACTURING HIGH-EFFICIENCY WATER SOURCE HEAT PUMPS

AP049

aquarius ii

ELECTRICAL SPECIFICATIONS

Electrical Characteristics	Elect. Symbol	Compressor		Blower		Loop Pump		Min. Circuit Amps	Max. Fuse/Breaker
		RLA	LRA	FLA	HP	FLA	HP		
208/230-1-60	-1	21.2	96.0	6.8	3/4	-	-	35.1	50

MECHANICAL SPECIFICATIONS

Refrigerant: R-410A			
Air Coil			
Square Feet	Rows Deep	Tube O.D.	Fins/Inch
6	3	3/8	14
Water Coil			
Type	Work Press		
Coaxial	450 psig		
Blower Size	Compr Type		
10x 8 DD	Scroll		
Net Weight	Ship Weight		
318 lbs	348 lbs		

BLOWER PERFORMANCE

Available External Static Pressure (Inches of Water, Gauge. Wet Coil and Filter Included)												
Blower Speed	0.10	0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	1.20
+						1490						
Norm						1300						
-						110						

**ISO 13256-1 CERTIFIED PERFORMANCE DATA** Rated at 1300 CFM and 12.0 GPM

Water Loop				Ground Water				Ground Loop			
Cooling		Heating		Cooling		Heating		Cooling		Heating	
Capacity	EER	Capacity	COP	Capacity	EER	Capacity	COP	Capacity	EER	Capacity	COP
37,000	20	38,500	5.9	41,200	32.5	31,500	5.0	40,200	28.0	28,000	4.6

FLUID PRESSURE DROP

Fluid Flow (GPM)	Pressure Drop	
	(FOH)	(PSIG)
6.0	2.3	1.0
7.0	3.0	1.3
9.5	5.3	2.3
12.0	8.0	3.5
16.0	13.4	5.8

CAPACITY DATA - PART LOAD**COOLING** All performance at 1300 CFM and 12.0 GPM EFT Range (Standard) 80°F to 100°F

Entering Fluid Temp. (°F)	Entering Air Temp. (°F)	Total Capacity (MBtuH)	Sensible Capacity (MBtuH)	Sensible to Total Ratio	Power Input (kW)	Heat of Reject (MBtuH)	EER
50°	70°db 61°wb	37.65	28.42	0.75	1.17	41.65	32.1
60°		36.39	27.70	0.76	1.37	41.06	26.6
70°		35.12	27.08	0.77	1.57	40.47	22.4
85°		33.23	26.30	0.79	1.86	39.58	17.9
100°		31.34	25.67	0.82	2.15	38.69	14.6
50°	75°db 63°wb	40.35	33.98	0.84	1.18	44.37	34.2
60°		39.00	33.12	0.85	1.38	43.69	28.3
70°		37.65	32.38	0.86	1.57	43.02	23.9
85°		35.62	31.45	0.88	1.87	42.00	19.1
100°		33.59	30.71	0.91	2.16	40.98	15.5
50°	80°db 67°wb	44.30	37.52	0.85	1.19	48.35	37.3
60°		42.81	36.57	0.85	1.39	47.55	30.9
70°		41.33	35.76	0.87	1.59	46.74	26.1
85°		39.11	34.73	0.89	1.88	45.54	20.8
100°		36.89	33.91	0.92	2.18	44.33	16.9
50°	85°db 71°wb	48.24	41.10	0.85	1.20	52.32	40.3
60°		46.63	40.06	0.86	1.40	51.40	33.4
70°		45.02	39.16	0.87	1.60	50.47	28.2
85°		42.60	38.05	0.89	1.90	49.08	22.5
100°		40.19	37.15	0.92	2.20	47.69	18.3

Units are complete packages containing compressor, reversing valve, expansion valve metering device, ECM fan motor and heat exchangers. Also included are safety controls: Overload protection for motors, high and low refrigerant pressure switches and solid state lock-out circuit. Optional UL approved internal electric heater, factory installed with primary thermal overload protection and magnetic contactors (208/230-1-60 only) optional UL approved internal Heat Recovery Package and/or Ground Loop Pump with purge connections available.

Performance based on ARI/ISO rated air flow, fluid flow and voltage. For conditions other than rated, consult the FHP EAD selection software. Due to variations in installation actual performance may vary marginally from tabulated values.

As a result of continuing research and development, specifications are subject to change without notice.
AP049 11P60 Rev 1-05

HEATING EFT Range (Standard) 25°F to 80°F

Entering Fluid Temp. (°F)	Entering Air Temp. (°F)	Total Capacity (MBtuH)	Power Input (kW)	Heat of Abs. (MBtuH)	COP
50°	60°	36.30	1.93	29.72	5.5
60°		39.48	1.97	32.75	5.9
70°		42.66	2.02	35.78	6.2
80°		45.84	2.06	38.82	6.5
50°	70°	34.33	1.96	27.64	5.1
60°		37.34	2.01	30.49	5.5
70°		40.34	2.05	33.35	5.8
80°		43.35	2.10	36.20	6.1
50°	80°	32.02	2.00	25.19	4.7
60°		34.82	2.05	27.83	5.0
70°		37.62	2.09	30.47	5.3
80°		40.42	2.14	33.11	5.5

LOW TEMP HEATING

Antifreeze Required

25°	60°	27.79	1.82	21.59	4.5
30°		29.35	1.84	23.08	4.7
40°		32.47	1.88	26.04	5.1
25°	70°	26.29	1.85	19.99	4.2
30°		27.77	1.87	21.38	4.4
40°		30.71	1.92	24.18	4.7
25°	80°	24.53	1.89	18.09	3.8
30°		25.90	1.91	19.39	4.0
40°		28.65	1.96	21.97	4.3

FHP MANUFACTURING COMPANY

601 N.W. 65th Court - Fort Lauderdale, FL 33309

Phone: (954) 776-5471 - Fax: (800) 776-5529

<http://www.fhp-mfg.com>



PACKAGED UNITS SPECIFICATION DATA SHEET

FHP MANUFACTURING HIGH-EFFICIENCY WATER SOURCE HEAT PUMPS

Handwritten: KADAGLE
AP035
aquarius ii

ELECTRICAL SPECIFICATIONS

Electrical Characteristics	Elect. Symbol	Compressor		Blower		Loop Pump		Min. Circuit Amps	Max. Fuse/ Breaker
		RLA	LRA	FLA	HP	FLA	HP		
208/230-1-60	-1	16.7	82.0	4.3	1/2	-	-	27.0	40

MECHANICAL SPECIFICATIONS

Refrigerant: R-410A			
Air Coil			
Square Feet	Rows Deep	Tube O.D.	Fins/ Inch
4.5	3	3/8	14
Water Coil			
Type		Work Press	
Coaxial		450 psig	
Blower Size		Compr Type	
9 x 7 DD		Scroll	
Net Weight		Ship Weight	
290 lbs		315 lbs	

BLOWER PERFORMANCE

Available External Static Pressure (Inches of Water, Gauge. Wet Coil and Filter Included)												
Blower Speed	0.10	0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	1.20
+						1380						
Norm						1200						
-						1020						



ISO 13256-1 CERTIFIED PERFORMANCE DATA Rated at 1200 CFM and 9.0 GPM

Water Loop				Ground Water				Ground Loop			
Cooling		Heating		Cooling		Heating		Cooling		Heating	
Capacity	EER	Capacity	COP	Capacity	EER	Capacity	COP	Capacity	EER	Capacity	COP
36,600	16.0	43,000	5.1	41,200	23.5	36,200	4.7	38,200	18.4	28,200	4.1

FLUID PRESSURE DROP

Fluid Flow (GPM)	Pressure Drop	
	(FOH)	(PSIG)
5	2.0	0.9
7	3.6	1.6
9	5.7	2.5
11	8.2	3.5
13	11.1	4.8

CAPACITY DATA - FULL LOAD

COOLING All performance at 1200 CFM and 9.0 GPM EFT Range (Standard) 50°F to 100°F

Entering Fluid Temp. (°F)	Entering Air Temp. (°F)	Total Capacity (MBtuH)	Sensible Capacity (MBtuH)	Sensible to Total Ratio	Power Input (kW)	Heat of Reject (MBtuH)	EER
50°	70°db	36.10	23.53	0.65	1.67	41.81	21.6
60°		34.64	22.76	0.66	1.86	41.00	18.6
70°		33.18	22.08	0.67	2.05	40.19	16.2
85°		30.99	21.16	0.68	2.34	38.97	13.3
100°	75°db	28.80	20.36	0.71	2.62	37.75	11.0
50°		38.68	28.14	0.73	1.68	44.43	23.0
60°		37.12	27.23	0.73	1.87	43.52	19.8
70°		35.56	26.41	0.74	2.06	42.61	17.2
85°	63°wb	33.22	25.33	0.76	2.35	41.24	14.1
100°		30.87	24.37	0.79	2.64	39.87	11.7
50°		42.47	31.08	0.73	1.70	48.26	25.0
60°		40.75	30.08	0.74	1.89	47.20	21.6
70°	67°wb	39.04	29.17	0.75	2.08	46.14	18.8
85°		36.47	27.98	0.77	2.37	44.56	15.4
100°		33.91	26.92	0.79	2.66	42.97	12.8
50°	85°db	46.25	34.05	0.74	1.71	52.08	27.1
60°		44.39	32.95	0.74	1.90	50.88	23.3
70°		42.52	31.96	0.75	2.10	49.68	20.3
85°		39.73	30.65	0.77	2.39	47.88	16.6
100°	71°wb	36.94	29.49	0.80	2.68	46.08	13.8

HEATING EFT Range (Standard) 25°F to 80°F

Entering Fluid Temp. (°F)	Entering Air Temp. (°F)	Total Capacity (MBtuH)	Power Input (kW)	Heat of Abs. (MBtuH)	COP
50°	60°	38.04	2.33	30.08	4.8
60°		42.34	2.47	33.92	5.0
70°		46.64	2.60	37.75	5.2
80°		50.93	2.74	41.59	5.5
50°	70°	35.97	2.37	27.87	4.4
60°		40.03	2.51	31.46	4.7
70°		44.09	2.65	35.05	4.9
80°		48.16	2.79	38.64	5.1
50°	80°	33.55	2.42	25.27	4.1
60°		37.33	2.57	28.57	4.3
70°		41.11	2.71	31.87	4.4
80°		44.89	2.85	35.17	4.6

LOW TEMP HEATING

Antifreeze Required

25°	60°	26.76	1.99	19.96	3.9
30°		28.87	2.06	21.83	4.1
40°		33.08	2.20	25.58	4.4
25°	70°	25.32	2.03	18.39	3.7
30°		27.31	2.10	20.15	3.8
40°		31.29	2.24	23.66	4.1
25°	80°	23.62	2.07	16.55	3.3
30°		25.47	2.14	18.16	3.5
40°		29.18	2.28	21.39	3.7

Units are complete packages containing compressor, reversing valve, expansion valve, metering device, ECM fan motor and heat exchangers. Also included are safety controls: Overload protection for motors, high and low refrigerant pressure switches and solid state lock-out circuit. Optional UL approved internal electric heater, factory installed with primary thermal overload protection and magnetic contactors (208/230-1-60 only) optional UL approved internal Heat Recovery Package and/or Ground Loop Pump with purge connections available.

Performance based on ARI/ISO rated air flow, fluid flow and voltage. For conditions other than rated, consult the FHP EAD selection software. Due to variations in installation actual performance may vary marginally from tabulated values.

As a result of continuing research and development, specifications are subject to change without notice.
AP035.2IP60 Rev 1-08

FHP MANUFACTURING COMPANY
601 N.W. 65th Court - Fort Lauderdale, FL 33309
Phone: (954) 776-5471 - Fax: (800) 776-5529
<http://www.fhp-mfg.com>