


[illegible]

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

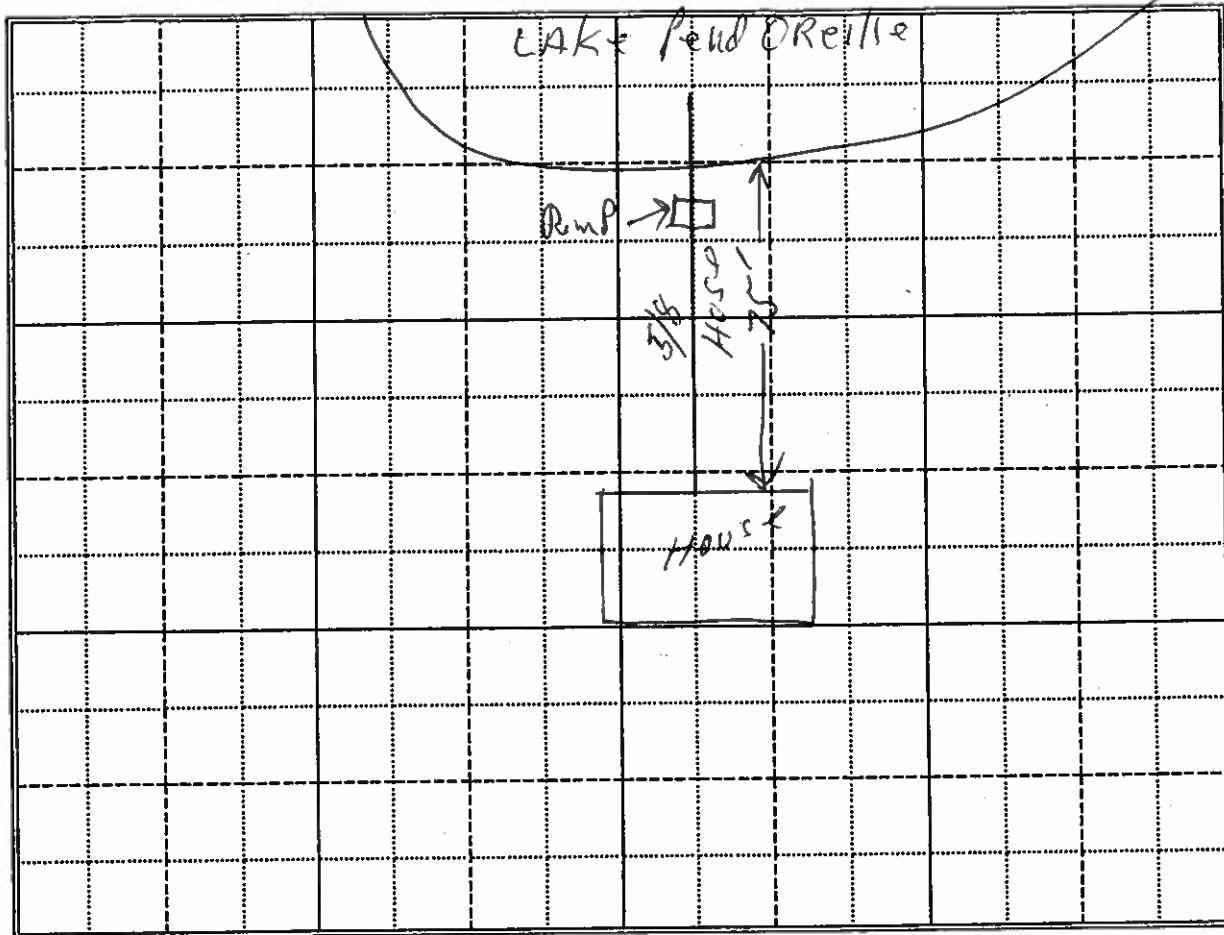

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	~~Homelite~~				
	Homelite	?	AP125	Homelite	7/8

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

E. NARRATIVE/REMARKS/COMMENTS

Water is currently pumped to holding tank in house. House is under construction (inside remodel)

Have conditions of permit approval been met? ☒ yes ☐ no

F. FLOW CALCULATIONS

Measured Method:

Additional Computation Sheets Attached

5 gal bucket

5 gal in 16 sec = $18.75 \text{ gpm} \times 1.33681$

60

.04 cfs

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic	01-01	12-31	.04	1.2
Totals:			.04	1.2

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other



I. AUTHENTICATION

Field Examiner's Name Wayne Balchun Date 9-5-08

Reviewer [Signature] Date 9/22/8

SEAL

96-8954





002



place of use



pumppod

96- 8954



96-8954





96-8954