

State of Idaho
Department of Water Resources
Permit to Appropriate Water
NO. 95-09298

Priority: September 06, 2005

Maximum Diversion Rate: 0.26 CFS

This is to certify, that WOODLAND SHORES WATER & SEWER ASSOCIATION
4302 S TAMPA ST
SPOKANE WA 99223

has applied for a permit to appropriate water from:

Source: GROUND WATER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
MUNICIPAL	01/01 to 12/31	0.26 CFS

LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER L3 (SW¼NE¼) Sec. 18, Twp 48N,Rge 04W, B.M. KOOTENAI County

GROUND WATER L3 (SW¼NE¼) Sec. 18, Twp 48N,Rge 04W, B.M. KOOTENAI County

GROUND WATER L3 (SW¼NE¼) Sec. 18, Twp 48N,Rge 04W, B.M. KOOTENAI County

GROUND WATER L5 (NW¼SW¼) Sec. 17, Twp 48N,Rge 04W, B.M. KOOTENAI County

CONDITIONS OF APPROVAL

1. Proof of application of water to beneficial use shall be submitted on or before **April 1, 2008**.
2. Subject to all prior water rights.
3. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code and applicable Well Construction Rules of the Department.
4. Place of use is within the area served by the public water supply system of Woodland Shores Water & Sewer Association. The place of use is generally located within Sections 17, 18 & 20, Township 48N, Range 4W, B. M.
5. A map depicting the place of use boundary for this water right at the time of this approval is attached to this document for illustration purposes.
6. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which the permit holder had no control.
7. Rights 95-9298 and 95-8402 when combined shall not exceed a total diversion rate of 0.26 cfs and a total annual maximum diversion volume of 56 afa.

State of Idaho
Department of Water Resources

Permit to Appropriate Water

NO. 95-09298

CONDITIONS OF APPROVAL CONTINUED

8. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.
9. The points of diversion for this right include two (2) existing points of diversion shared with Right 95-8402 and two (2) new points of diversion authorized under this right.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code. Witness the signature of the Director, affixed at Boise, this 7th day of April, 2006.


for KARL J DREHER, Director

State of Idaho
Department of Water Resources
Permit to Appropriate Water

NO. 95-09298

Digital Boundary for Woodland Shores Water & Sewer Association
April 5, 2006



1000 0 1000 2000 Feet

White Outline -- Woodland Shores Water & Sewer District
Yellow Grid -- Quarter Quarter Sections



RECEIVED

MAK 29 2006

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

RECEIVED

SEP 06 2005

IDWR/North

DEPARTMENT OF WATER RESOURCES

1. Name of Applicant Woodland Shores Water & Sewer Association Phone 509-921-9415

Mailing address 4302 S. Tampa St., Spokane WA 99223

2. Source of water supply 4 Wells which is a tributary of N/A

3. Location of point of diversion is Township 48N Range 4W B.M. Sec. 18 in the SW 1/4, (Well #5)
NE 1/4, 3 Govt. Lot 3 B.M., Kootenai County;

additional points of diversion if any: Well #2 SW NE, SEC 18, Well #4 SW NE, SEC 18, Well #3 NW SW, SEC 17

4. Water will be used for the following purposes: All TWP 48N Rng 4W B.M. (SEE MAP)

- Amount .50 for Municipal purposes from Jan 1 to Dec 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) .50 cubic feet per second and/or (b) 125 acre feet per annum

6. Proposed diverting works:

a. Describe type and size of devices used to divert water from the source Well #2, 8" well 300' (50 gpm)

Well #3, 8" well, 650' (20 gpm) Well #4, 8" well 700' (10 gpm) Well #5 (proposed 250')

b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total (100 gpm)
reservoir capacity _____ acre-feet

c. Proposed well diameter is 10 inches; proposed depth of well is 250-300 feet

d. Is ground water with a temperature of greater than 85°F being sought? _____

e. If well is already drilled, when? yes (#2, 3, 4); Drilling firm H2O drilling for Well #5

Well was drilled for (well owner) Wells 2 and 3; Drilling Permit No. 95-8402

7. Time required for completion of works and application of water to proposed beneficial use is 2 years (minimum 1 year)

8. Description of proposed uses (if irrigation only, go to item 9):

a. Hydropower; show total feet of head and proposed capacity in kW. _____

b. Stockwatering; list number and kind of livestock. _____

c. Municipal; show name of municipality. Woodland Sh

d. Domestic; show number of households. Woodland Shores Water & Sewer Association

e. Other; describe fully. ID# 1280203, 125 members in Association
approximately 60 currently connected with potential
of 125 connections

Per T.C.
w/Geo. Schlumberger

3. Description of place of use: (SEE ATTACHED SERVICE AREA MAP)

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
48N	4W	18		✓															
48N	4W	18			✓														
48N	4W	18				✓													
48N	4W	18													✓				
48N	4W	17					~~ALL NW 1/4~~				ALL SW 1/4								
48N	4W	20					✓												
48N	4W	20	ALL NE 1/4																

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. Licence 95-8402, for 35 units and 2 wells

11. a. Who owns the property at the point of diversion? We have easement & lease with owners


b. Who owns the land to be irrigated or place of use? _____

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: yes, public water system provider, each place

12. Remarks: of use has a membership in Woodland Shores water & sewer association

13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8 1/2"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

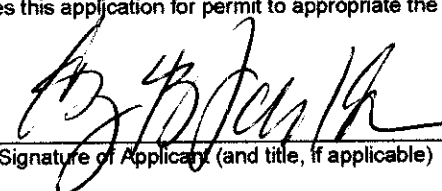
Signature of Applicant (and title, if applicable)

Received by db Date 9/6/05 Time 1:40 p Preliminary check by db Date 9/6/05
Fee \$ 250.00 Received by db # 0017161 Date 9/15/05
Publication prepared by db Date 9/7/05 Published in ada page 9/15+23/05
Publication approved db Date 9/27/05

**STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES**

APPLICATION FOR PERMIT

To appropriate the public water of the State of Idaho

PLACE OF USE: MUNICIPAL

Twp Rge Sec	NE				NW				SW				SE				Totals
	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
48N 04W 17							X			X	X	X			X		
48N 04W 18			X	X							X		X				
48N 04W 20			L 3		X				X								
											L 6				L 7		
											L 1						

9a. Who owns the property at the point of diversion? If other than applicant, describe the arrangement enabling the applicant to make this filing.

APPLICANT

9b. Who owns the land to be irrigated or place of use? If other than applicant, describe the arrangement enabling the applicant to make this filing.

APPLICANT

10. Remarks:

Public water system provider, each place of use has a membership in Woodland Shores Water & Sewer Association

11. Map of proposed point of diversion and place of use attached? []

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Applicant

Received by _____ Date _____ Time _____ Preliminary check by _____

Publication prepared by _____ Date _____ Published in _____

Publication approved _____ Date _____

Receipt No. N017161

Date: _____

Received by: _____

95-9298

T48N R4W

Sections 17, 18 & 20



Place of Use



Point of Diversion


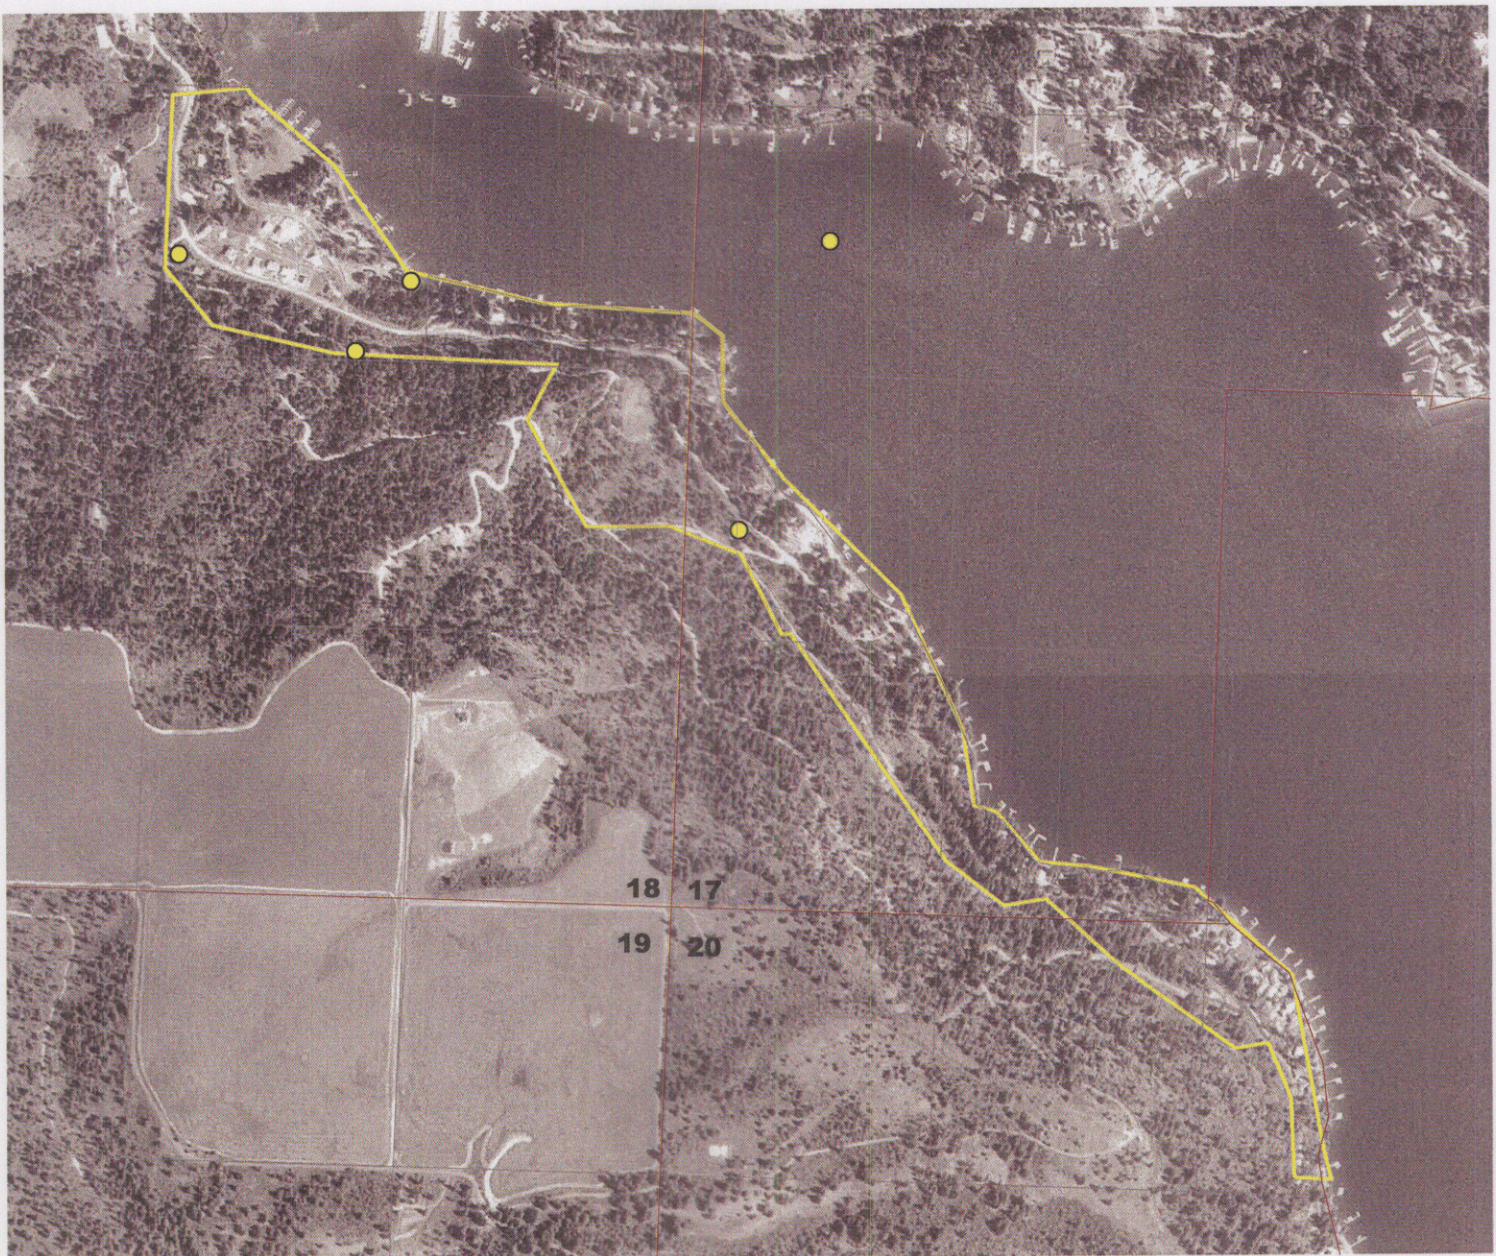


Figure 1. Woodland Shores Water and Sewer Assn. Delineation and Potential Contaminant Inventory.



Legend

- | | | |
|---------------------------|-------------------------|-------------------------------|
| ● Wellhead | ⊙ RICRIS Site | AST |
| ■ Buildings | ⊙ Business Mailing List | ● Recharge Point |
| == Roads | ☆ Dairy | ⊙ SARA Title III Site (EPCRA) |
| □ 1000 Foot Buffer Zone | ● LUST Site | ● Injection Well |
| ⌵ Mine | UST Site | ● Group I Site |
| ⊕ Enhanced Inventory | ▲ Closed | ● Cyanide Site |
| ⊕ Toxic Release Inventory | ▲ Open | ■ Landfill |
| ⊕ CERCLIS Site | ● NPDES Site | ■ Wastewater Land App. Site |

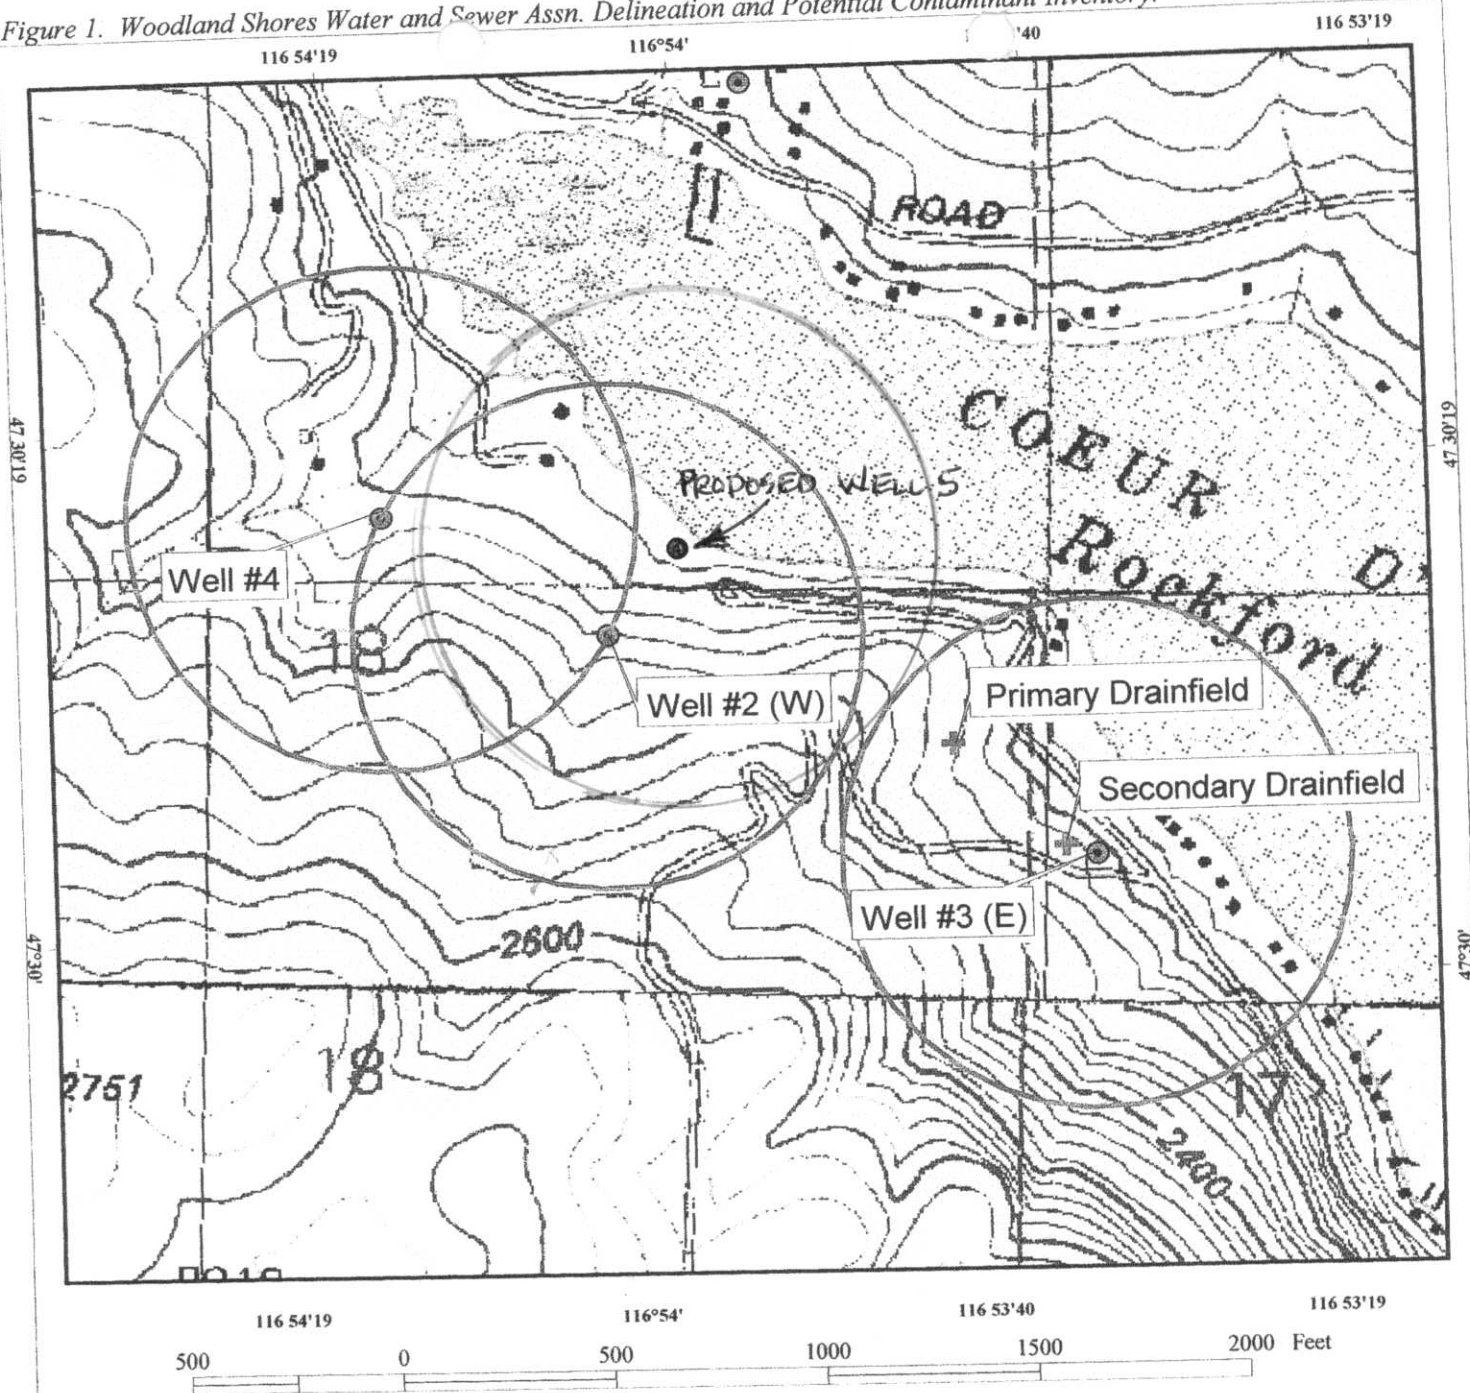


PWS # 1280203
Woodland Shores
Water and Sewer Assn.
Wells #2, #3, #4


PROPOSED WELL NUMBER 5 REVISED 4/22/05
WOODLAND SHORES WATER & SEWER ASSN., INC.

G.K.P. SHEET 1/5


1-4-95

LOT BOUNDARIES TRACED
FROM ASSESSOR'S MAPS AT
ONE INCH EQUALS 100 FT. SCALE
BUT PIPE AND VALVE LOCATIONS
ARE APPROXIMATE

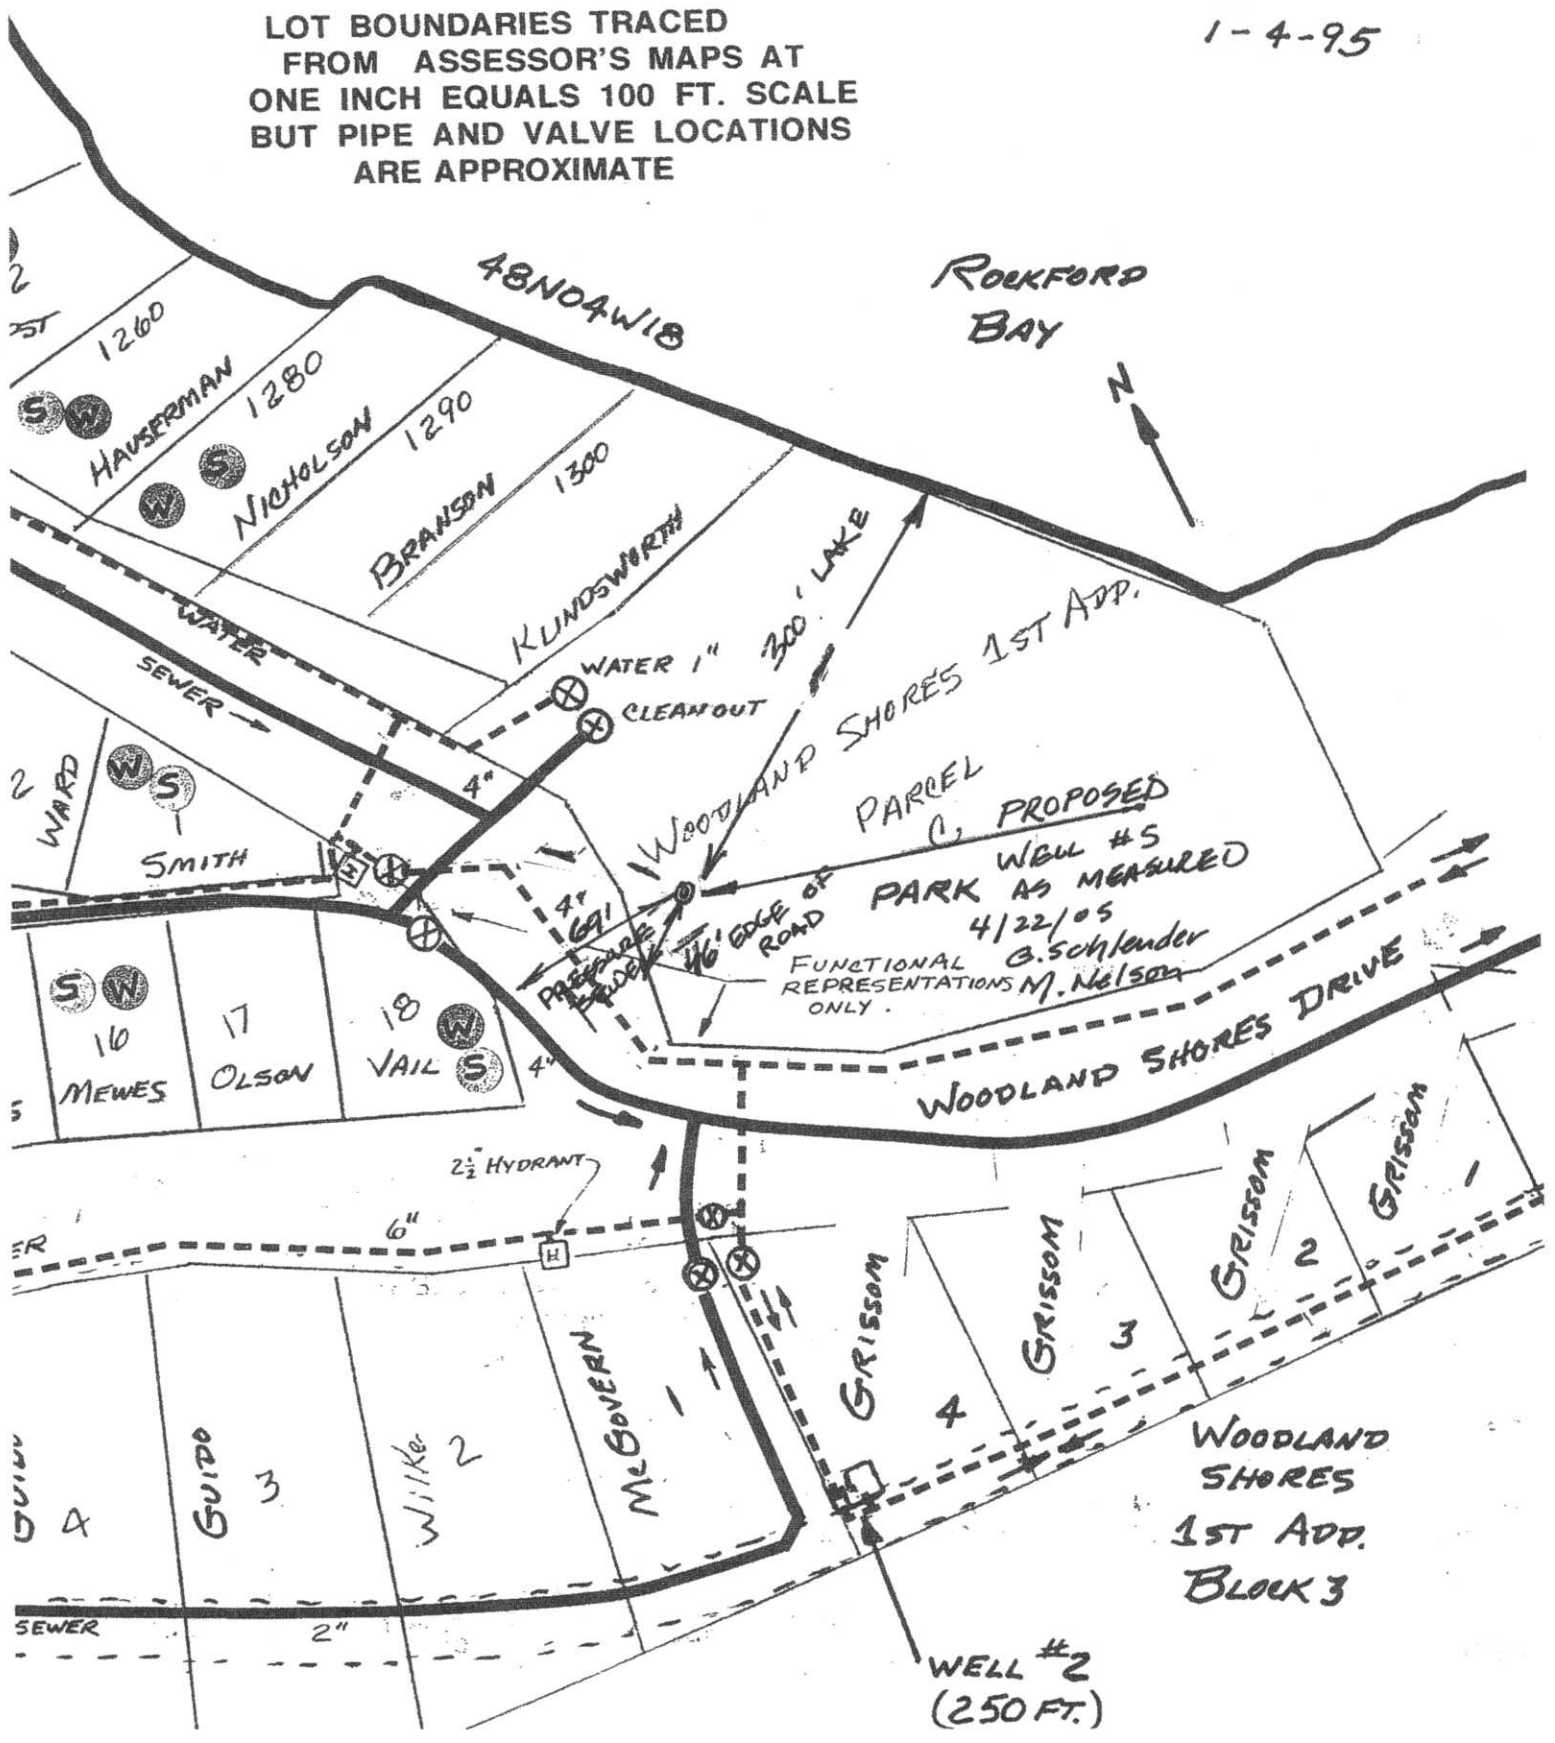

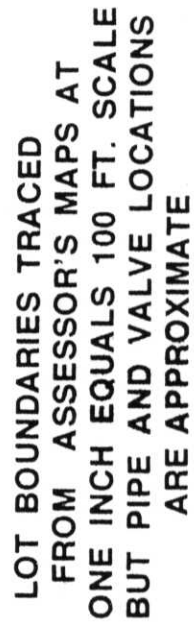


12-17-94

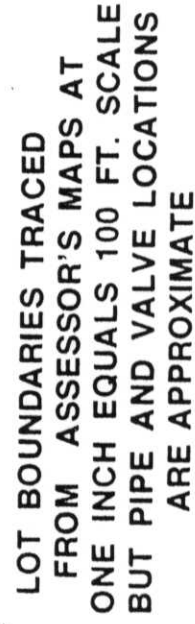

LOT BOUNDARIES TRACED
FROM ASSESSOR'S MAPS AT
ONE INCH EQUALS 100 FT. SCALE
BUT PIPE AND VALVE LOCATIONS
ARE APPROXIMATE

S.W. 1/4 SEC 17 TWP 48N R 4W
48N04W17

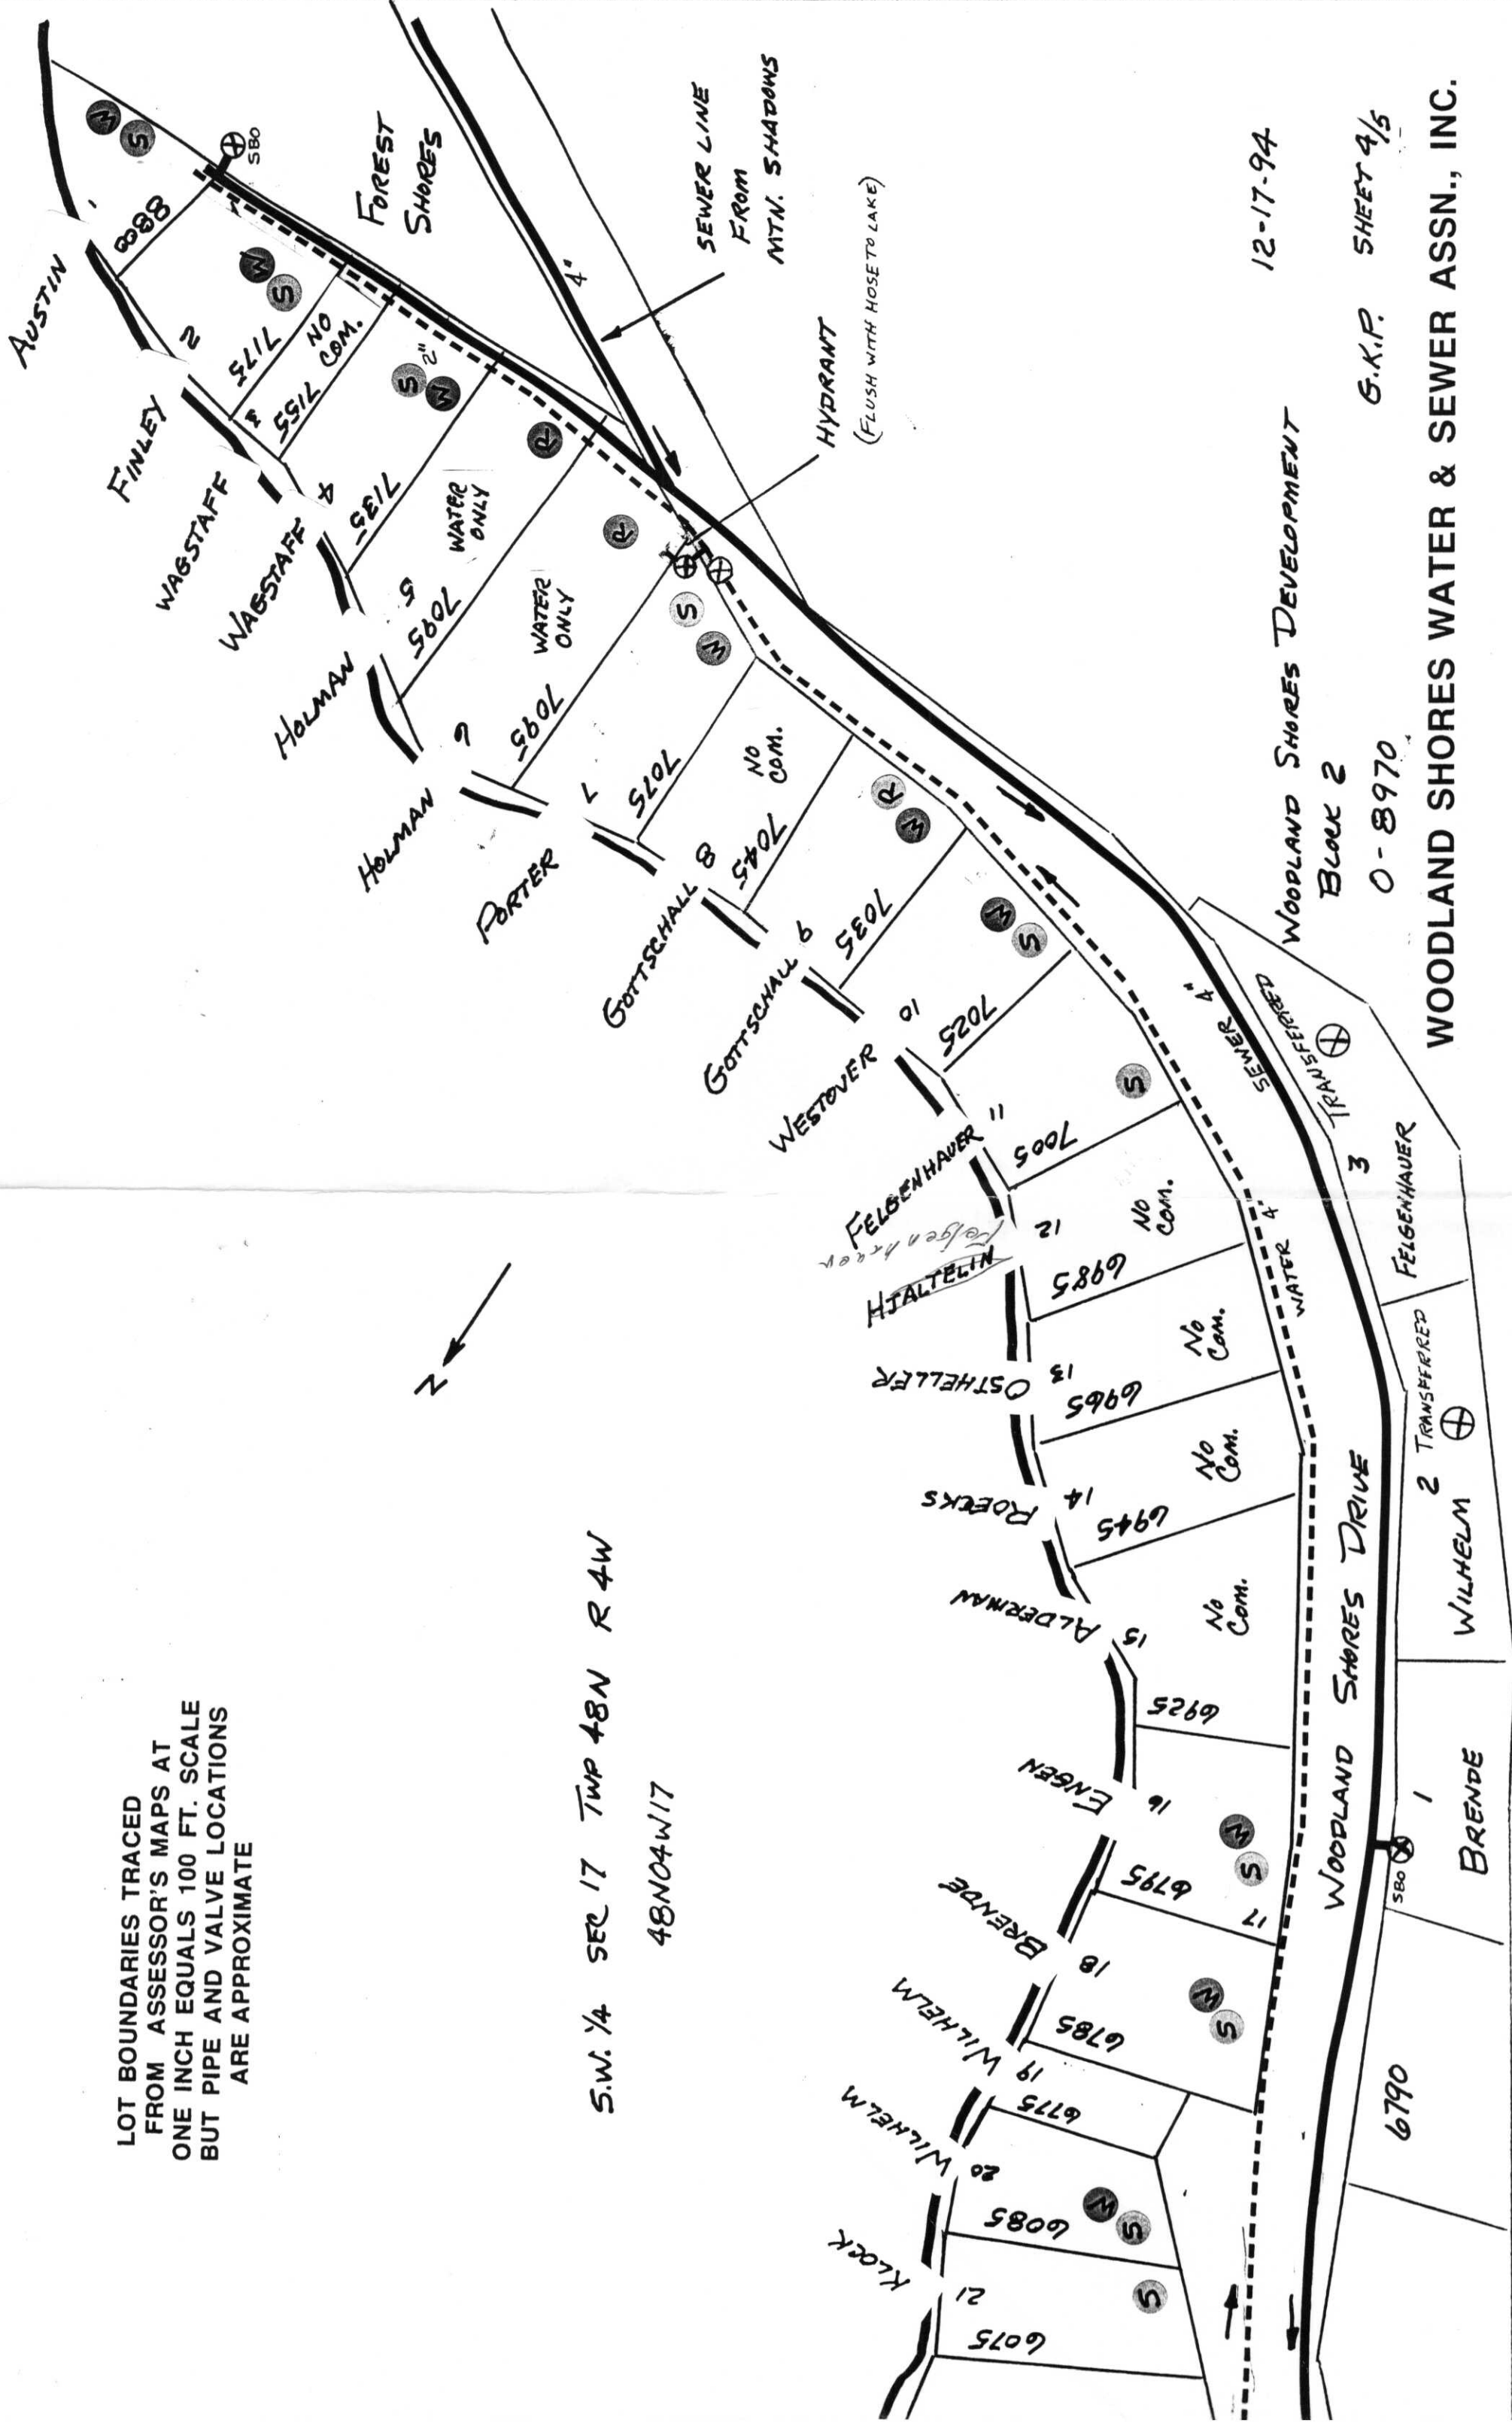

12-17-94


WOODLAND SHORES DEVELOPMENT

Block 2

0-8970

G.K.P. SHEET 4/5

WOODLAND SHORES WATER & SEWER ASSN., INC.

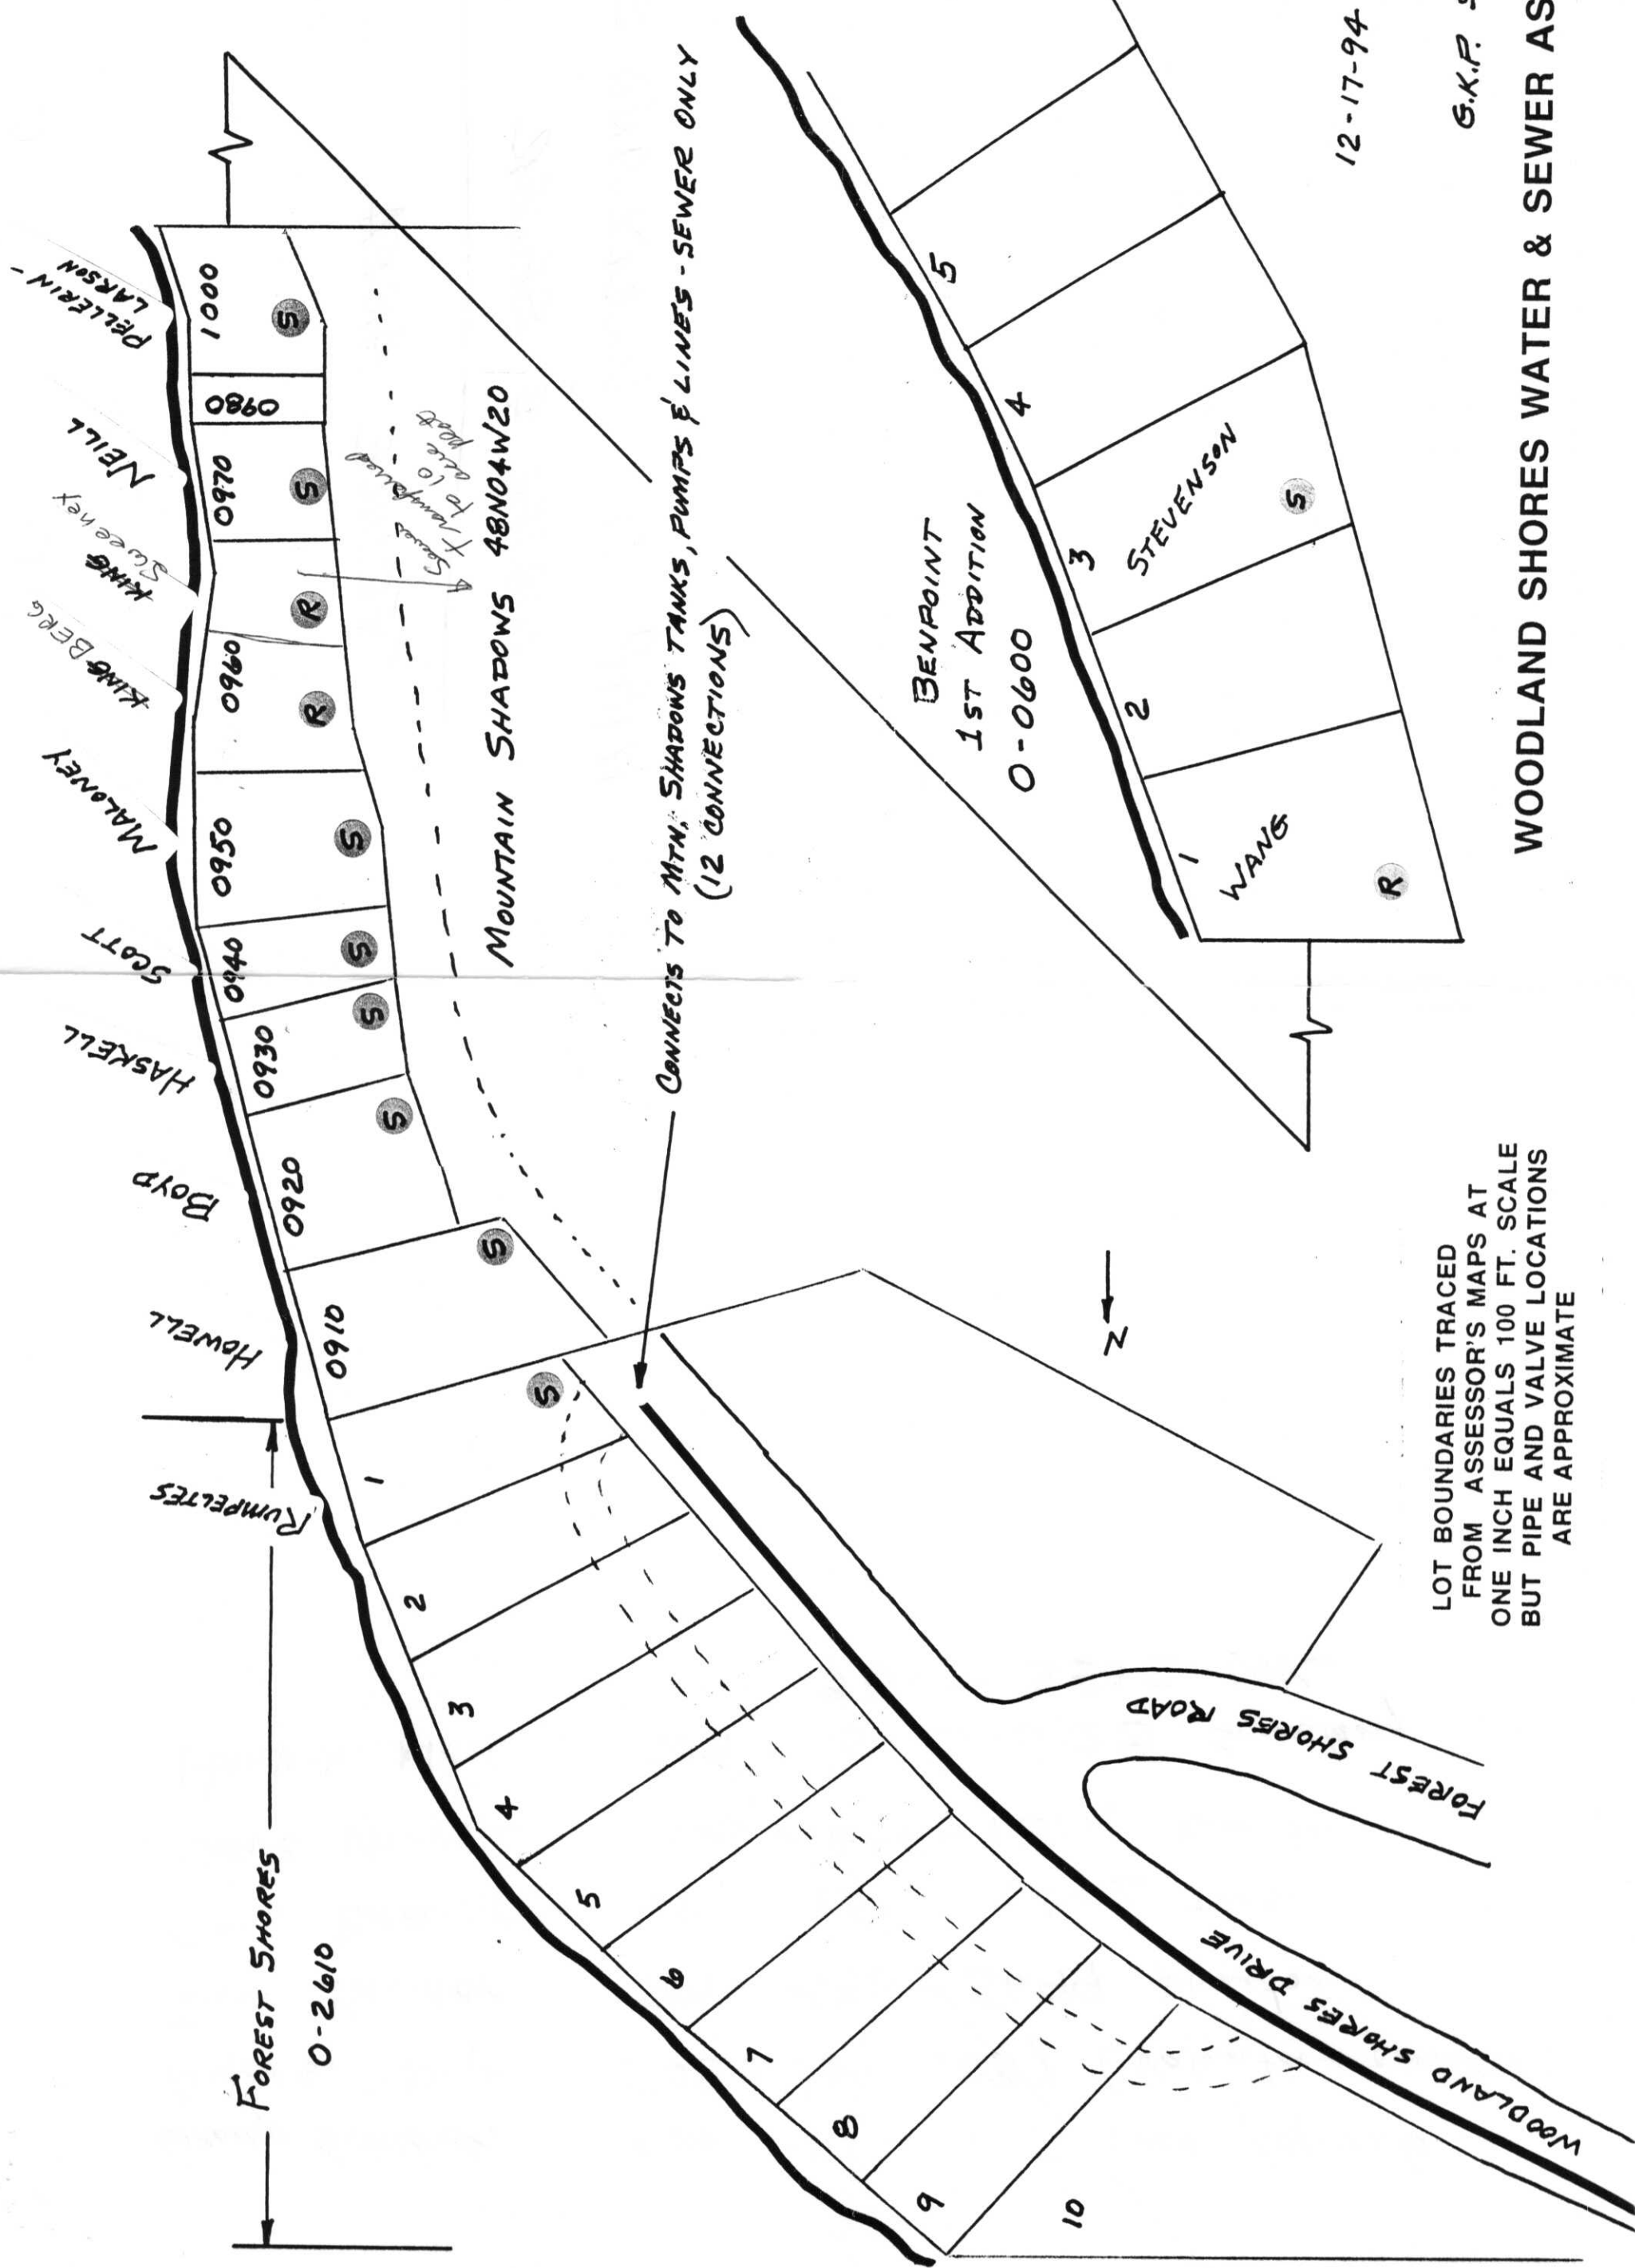

LOT BOUNDARIES TRACED
FROM ASSESSOR'S MAPS AT
ONE INCH EQUALS 100 FT. SCALE
BUT PIPE AND VALVE LOCATIONS
ARE APPROXIMATE

12-17-94

G.K.P. SHEET 5/5


WOODLAND SHORES WATER & SEWER ASSN., INC.

George Schlender	509-921-9415	pres. /operator
Ayers, Wayne	208-769-7037	(Volunteer operator)
Don Bender	509-838-5699	Director
Otis Brende	509-455-8242	Tres.
Dave Morse	208-699-1514	Director
Howard Neill	509-332-5128	Secretary
	334-3505	WK

MAP OF WOODLAND STRIPS
 WATER & SEWER
 SERVICE AREA.

1-4-95

Rockford
Bay

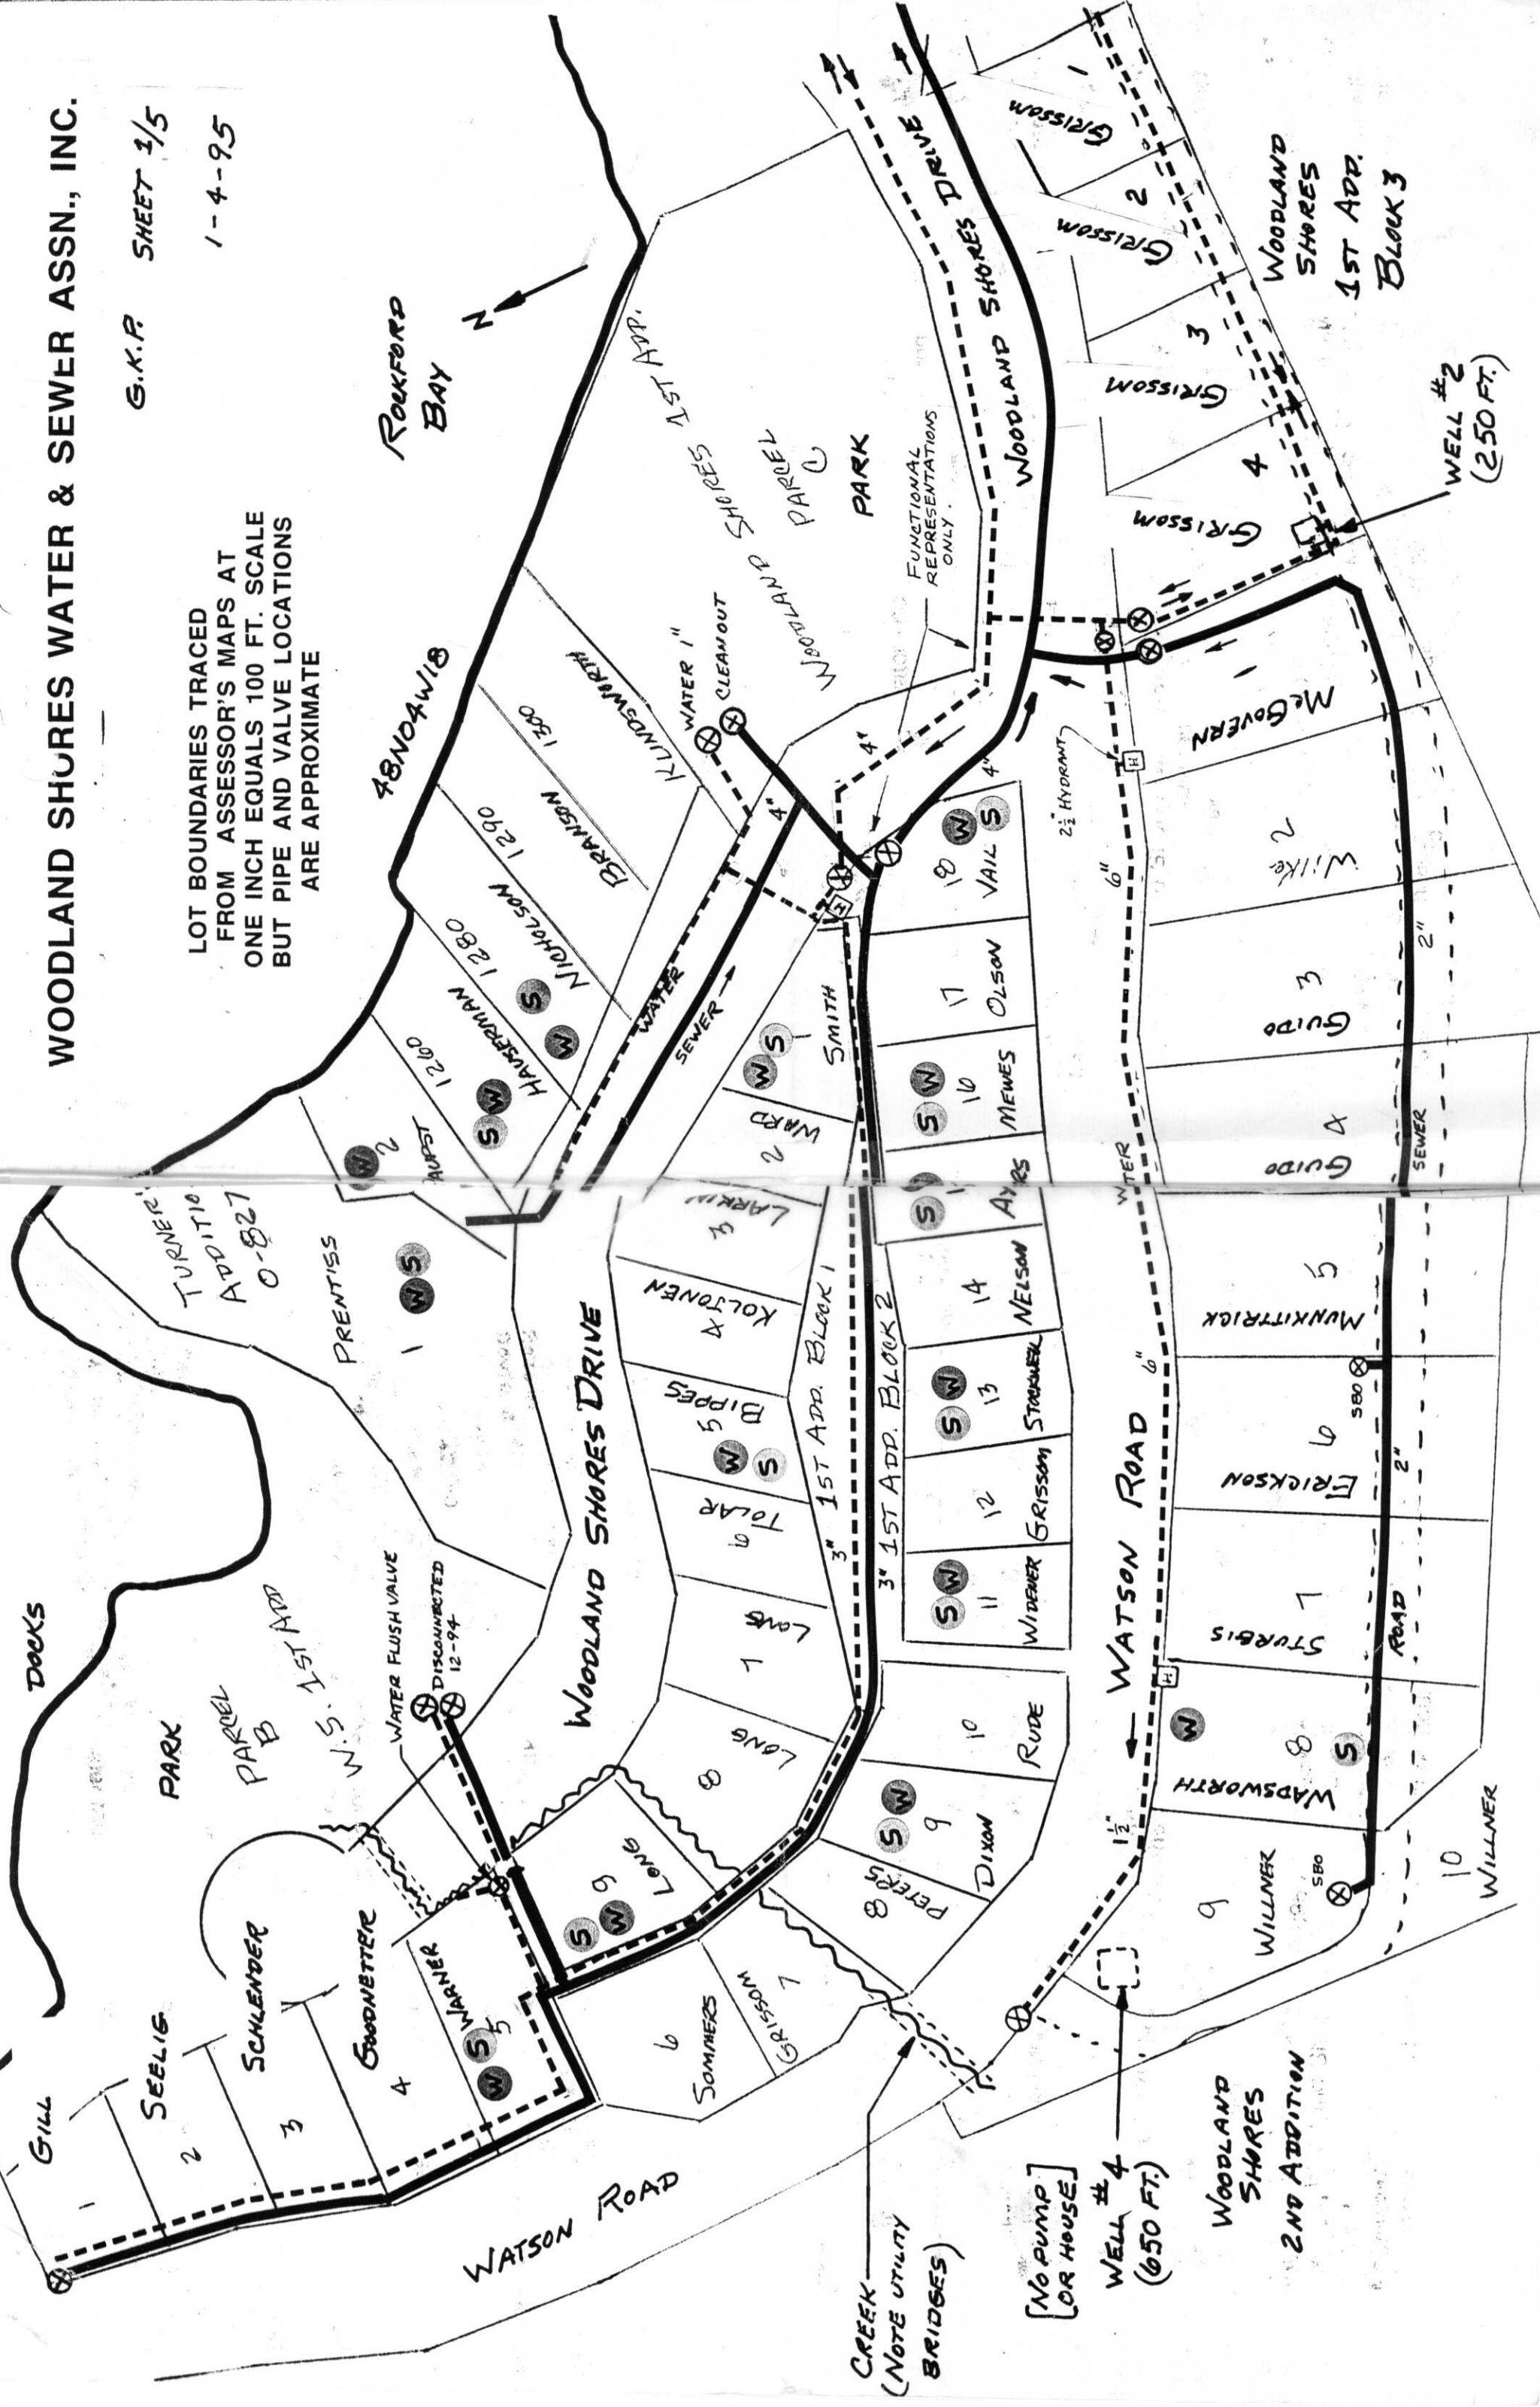

**Woodland Shores Water and Sewer Association
4302 South Tampa St.
Spokane WA 99223
George Schlender – President**

RE: Settlement Proposal to Kootenai Environmental Alliance (KEA) for Idaho Water Resources Application for Permit NO. 95-9298

Background

On October 18, 2005 at 3Pm, George Schlender met with three board members of the KEA to provide information and a proposal for settlement for the water license application to drill Woodland Shores Water and Sewer Association Well #5 and to include Well # 4 within our water rights and correct the number of units served. An overview of the two existing wells which range in depth from 670 to 700 feet into the granite above Lake Coeur d' Alene and their production was outlined to the board members. The current production of the two wells at Woodland Shores is at 25-30 gallons per minute with the main well (Well #2) pumping air. Woodland Shores Water and Sewer Association have 125 members of which some have individual wells and Mountain Shadows Addition has their own water system. We currently have 65 connections to the water system. Woodland Shores is rated a "transient non-community" water system due to the fact we do not have 15 permanent connections or 25 people that use the water year round but have more than 25 people use water for more than 60 days out of the year. In short, we have housing connections but most are summer use with only a few permanent users year round.

On October 3, 2005 KEA protested Woodland Shores application for permit 95-9298 which requests 4 wells and up to .5 cfs of water withdrawal. Woodland shores made this request as a maximum knowing it would be reduced to actual usage by Idaho Department of Water Resources (IDWR). Woodland Shores currently enjoys water right number 95-8402 in the amount of Domestic of .2 cfs and 21 acre feet and .060 cfs for irrigation and 6.3 acre feet. Wells drilled in the Woodland Shores area are poor producers and based on a hydrogeologic study done by Dr. John Buchanan, Woodland Shores Well #5 is expected to only produce 50 GPM or less. All wells drilled in the Woodland Shores area are high in minerals (Iron, Manganese) and low PH. All this data was presented to the three KEA board members on October 18, 2005.

Proposed Settlement

At the meeting on October 18, 2005, George Schlender proposed that Woodland Shores could stay within the combined instantaneous of .260 cfs under water right number 95-8402 but would need authorization to expand the number units to 125 and allow the use of Well # 4 (not currently authorized) and the new Well #5. Mr. Schlender also proposed that Woodland Shores could live with 400 gallons per day per household or the minimum

acceptable daily quantity required by law through DEQ, but no less than 400 gallons per unit. The 400 would equate to 56 acre feet per year or an increase of 28.7 acre feet of water under application 95-9298. This concept was deemed acceptable to Dale Marcy and concurred by the other board member in attendance (the third board member left the meeting). As a condition to settlement, Mr. Marcy wanted to know the amount of water used by Woodland Shores in 2004. Both Wells 2 and 4 are metered and the water use for 2004 for 65 water hookups was 1, 998, 824 gallons or 6.13 acre feet.

Settlement Parameters:

1. Woodland Shores Water and Sewer will revise their application NO. 95-9298 to be supplemental for instantaneous quantity of .260 cfs under water right number 95-8402. We will request no new instantaneous quantity, only ask IDWR to authorize all three current wells and the new Well #5.
2. Woodland Shores Water and Sewer will request that application 95-9298 only add two points of withdrawal (wells 4 and 5) and an increase in annual quantity of 28.7 acre feet or the minimum required by DEQ for public water systems in Idaho under law, whichever is greater.

KEA Agrees:

1. By accepting Woodland Shores Water and Sewer conditions 1 and 2 above settlement, KEA agrees to rescind their protest of Woodland Shores application 95-9298 and allow IDWR to continue to process the water right to allow the drilling of Well #5.

AGREEMENT

Woodland Shores Water and Sewer Assoc.

Kootenai Environmental Alliance

_____ date _____

Barry Rosenberg date 12/23/05

**Woodland Shores Water and Sewer Association
4302 South Tampa St.
Spokane WA 99223
George Schlender – President**

**RE: Settlement Proposal to Kootenai Environmental Alliance (KEA) for Idaho
Water Resources Application for Permit NO. 95-9298**

Background

On October 18, 2005 at 3Pm, George Schlender met with three board members of the KEA to provide information and a proposal for settlement for the water license application to drill Woodland Shores Water and Sewer Association Well #5 and to include Well # 4 within our water rights and correct the number of units served. An overview of the two existing wells which range in depth from 670 to 700 feet into the granite above Lake Coeur d' Alene and their production was outlined to the board members. The current production of the two wells at Woodland Shores is at 25-30 gallons per minute with the main well (Well #2) pumping air. Woodland Shores Water and Sewer Association have 125 members of which some have individual wells and Mountain Shadows Addition has their own water system. We currently have 65 connections to the water system. Woodland Shores is rated a "transient non-community" water system due to the fact we do not have 15 permanent connections or 25 people that use the water year round but have more than 25 people use water for more than 60 days out of the year. In short, we have housing connections but most are summer use with only a few permanent users year round.

On October 3, 2005 KEA protested Woodland Shores application for permit 95-9298 which requests 4 wells and up to .5 cfs of water withdrawal. Woodland shores made this request as a maximum knowing it would be reduced to actual usage by Idaho Department of Water Resources (IDWR). Woodland Shores currently enjoys water right number 95-8402 in the amount of Domestic of .2 cfs and 21 acre feet and .060 cfs for irrigation and 6.3 acre feet. Wells drilled in the Woodland Shores area are poor producers and based on a hydrogeologic study done by Dr. John Buchanan, Woodland Shores Well #5 is expected to only produce 50 GPM or less. All wells drilled in the Woodland Shores area are high in minerals (Iron, Manganese) and low PH. All this data was presented to the three KEA board members on October 18, 2005.

Proposed Settlement

At the meeting on October 18, 2005, George Schlender proposed that Woodland Shores could stay within the combined instantaneous of .260 cfs under water right number 95-8402 but would need authorization to expand the number units to 125 and allow the use of Well # 4 (not currently authorized) and the new Well #5. Mr. Schlender also proposed that Woodland Shores could live with 400 gallons per day per household or the minimum

acceptable daily quantity required by law through DEQ, but no less than 400 gallons per unit. The 400 would equate to 56 acre feet per year or an increase of 28.7 acre feet of water under application 95-9298. This concept was deemed acceptable to Dale Marcy and concurred by the other board member in attendance (the third board member left the meeting). As a condition to settlement, Mr. Marcy wanted to know the amount of water used by Woodland Shores in 2004. Both Wells 2 and 4 are metered and the water use for 2004 for 65 water hookups was 1, 998, 824 gallons or 6.13 acre feet.

Settlement Parameters:

1. Woodland Shores Water and Sewer will revise their application NO. 95-9298 to be supplemental for instantaneous quantity of .260 cfs under water right number 95-8402. We will request no new instantaneous quantity, only ask IDWR to authorize all three current wells and the new Well #5.
2. Woodland Shores Water and Sewer will request that application 95-9298 only add two points of withdrawal (wells 4 and 5) and an increase in annual quantity of 28.7 acre feet or the minimum required by DEQ for public water systems in Idaho under law, whichever is greater.

KEA Agrees:

1. By accepting Woodland Shores Water and Sewer conditions 1 and 2 above settlement, KEA agrees to rescind their protest of Woodland Shores application 95-9298 and allow IDWR to continue to process the water right to allow the drilling of Well #5.

AGREEMENT


Woodland Shores Water and Sewer Assoc.

Kootenai Environmental Alliance

George B Schleuder date 12/27/05 Barry Rosenberg date 12/23/05

TOWNSHIP 48 NORTH RANGE 4 WEST OF THE BOISE MERIDIAN, IDAHO

KOOTENAI COUNTY 055
COEUR D'ALENE DISTRICT

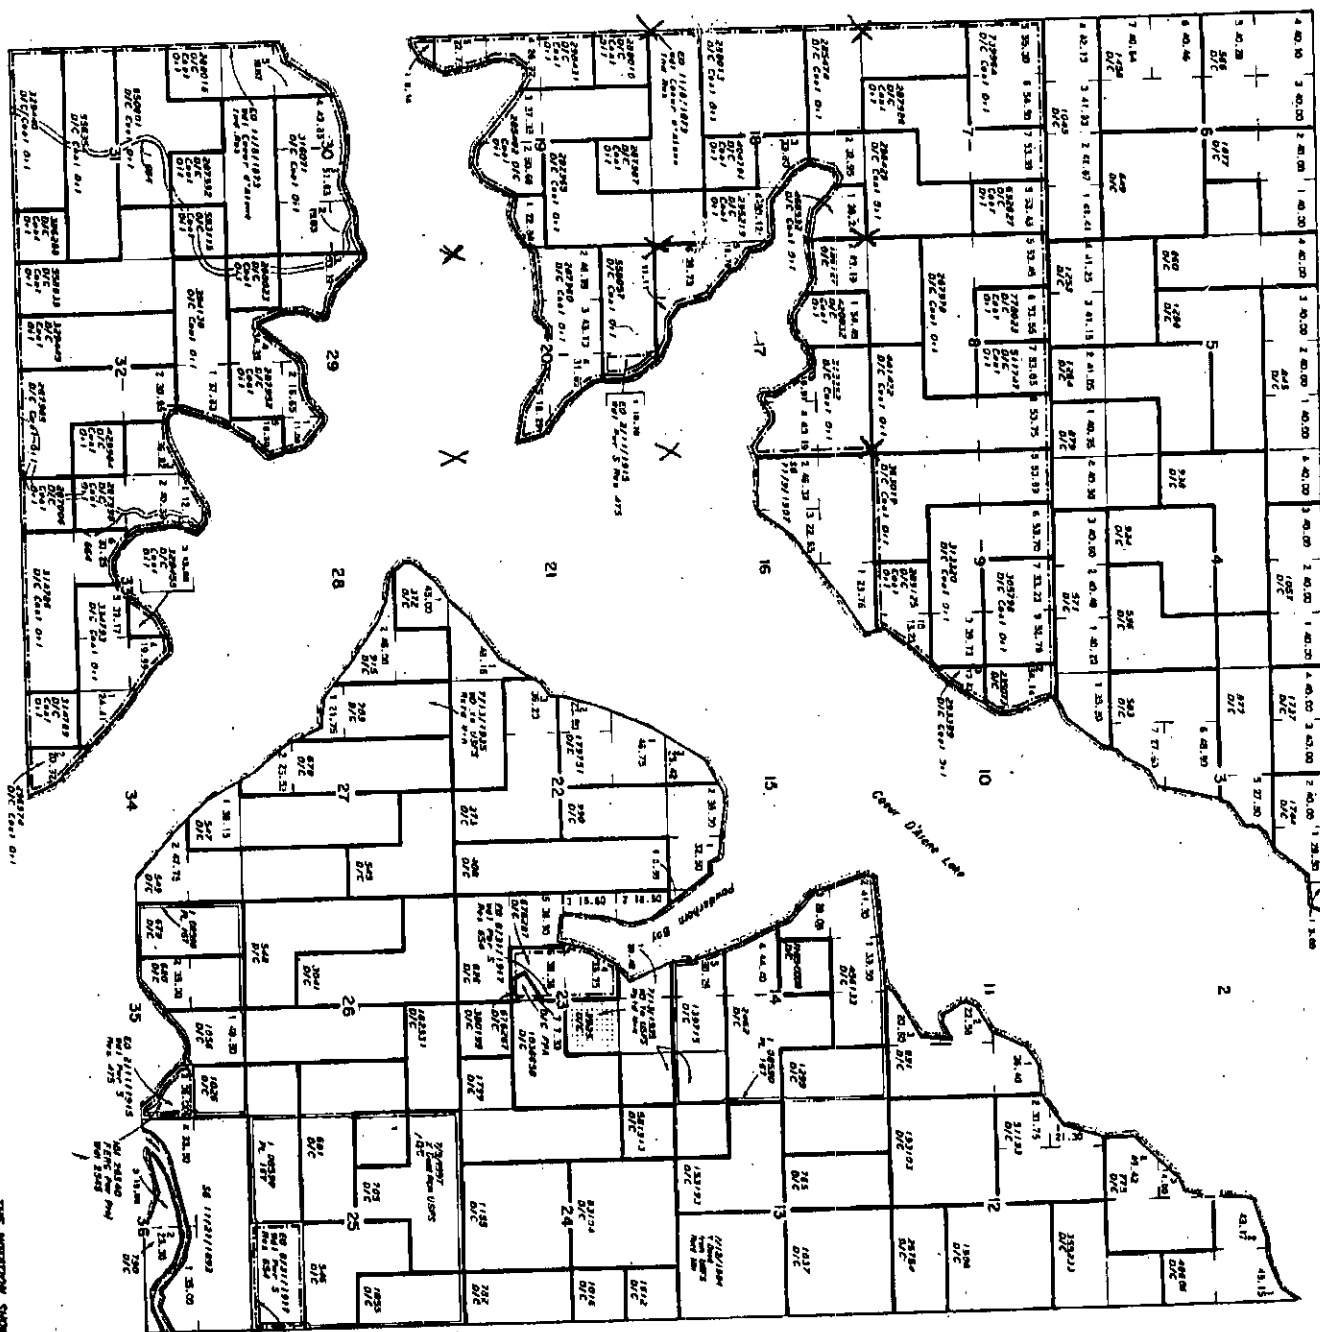

SCALE in Chords

[illegible]

THE NOTATION SHOWN ON WITHDRAWALS REPRESENT THE LAST ACTION TAKEN BUT MAY NOT BE THE EFFECTIVE DATE. SEE THE HISTORICAL INDEX FOR THE DATE OF THE ORIGINAL WITHDRAWAL ORDER.

MT PLAT

STATUS OF PUBLIC DOMAIN
LAND AND MINERAL TITLES
AND ACQUIRED LANDS[illegible]

Leaf 1: April 0. 50/3/1955. All (long leg by DJS)
administered as part of Cancer Alliance by William
Sect 13: 7/5/57. S2
Sect 14: 26/5/57
Sect 23: 26/5/57. S1, S2
Sect 25: 5/6/57
Sect 27: Leaf 1. 7/6/57

Act of Cong S/19/1958 that all unexpired cases
land in favor of Alamo Ind Nat to Tribal

100586 Da: PL 167 (Ac) of Ceq 7/23/1955)

Completed 9/28/1958. All PD instructions by RL
1 01007a (a) PL 167 (Act of Cong 7/23/1955)

completed 4/19/1962. All NE surface point by US

1. The first step in the process is to identify the problem or issue that needs to be addressed. This involves gathering information and understanding the context of the problem.

1. The first line of the document is "1. The first line of the document is".

(continued)

[illegible]

FOR ORDERS EFFECTING DISPOSAL OR USE OF
UNIDENTIFIED LANDS REFER TO INDEX OF
UNCLASSIFIED DOCUMENTS.

QUESTIONS TO	ANSWERS TO
1. What is the purpose of the study?	To determine the effect of the new drug on the rate of tumor growth.
2. What is the hypothesis?	The new drug will significantly reduce the rate of tumor growth compared to the control group.
3. What are the independent and dependent variables?	The independent variable is the treatment (new drug vs. control). The dependent variable is the rate of tumor growth (measured by tumor volume).
4. What are the experimental groups?	There are two groups: the control group (receiving a placebo) and the experimental group (receiving the new drug).
5. How were the groups assigned?	The groups were assigned randomly to ensure that the results are not biased by any pre-existing differences between the groups.
6. What were the results of the study?	The experimental group showed a significantly lower rate of tumor growth compared to the control group.
7. What are the conclusions of the study?	The new drug appears to be effective in reducing the rate of tumor growth, suggesting it may be a promising treatment for this type of cancer.

DATE	MAY 24 1998
TIME	
LOCATION	
REMARKS	


506

REMAINS REPRESENT THE LAST
THE EFFECTIVE DATE. SEE

DATE OF THE ORIGINAL WITH-

Date Recd _____
 T. 434
 R. 434

1420
6043
517
518
520

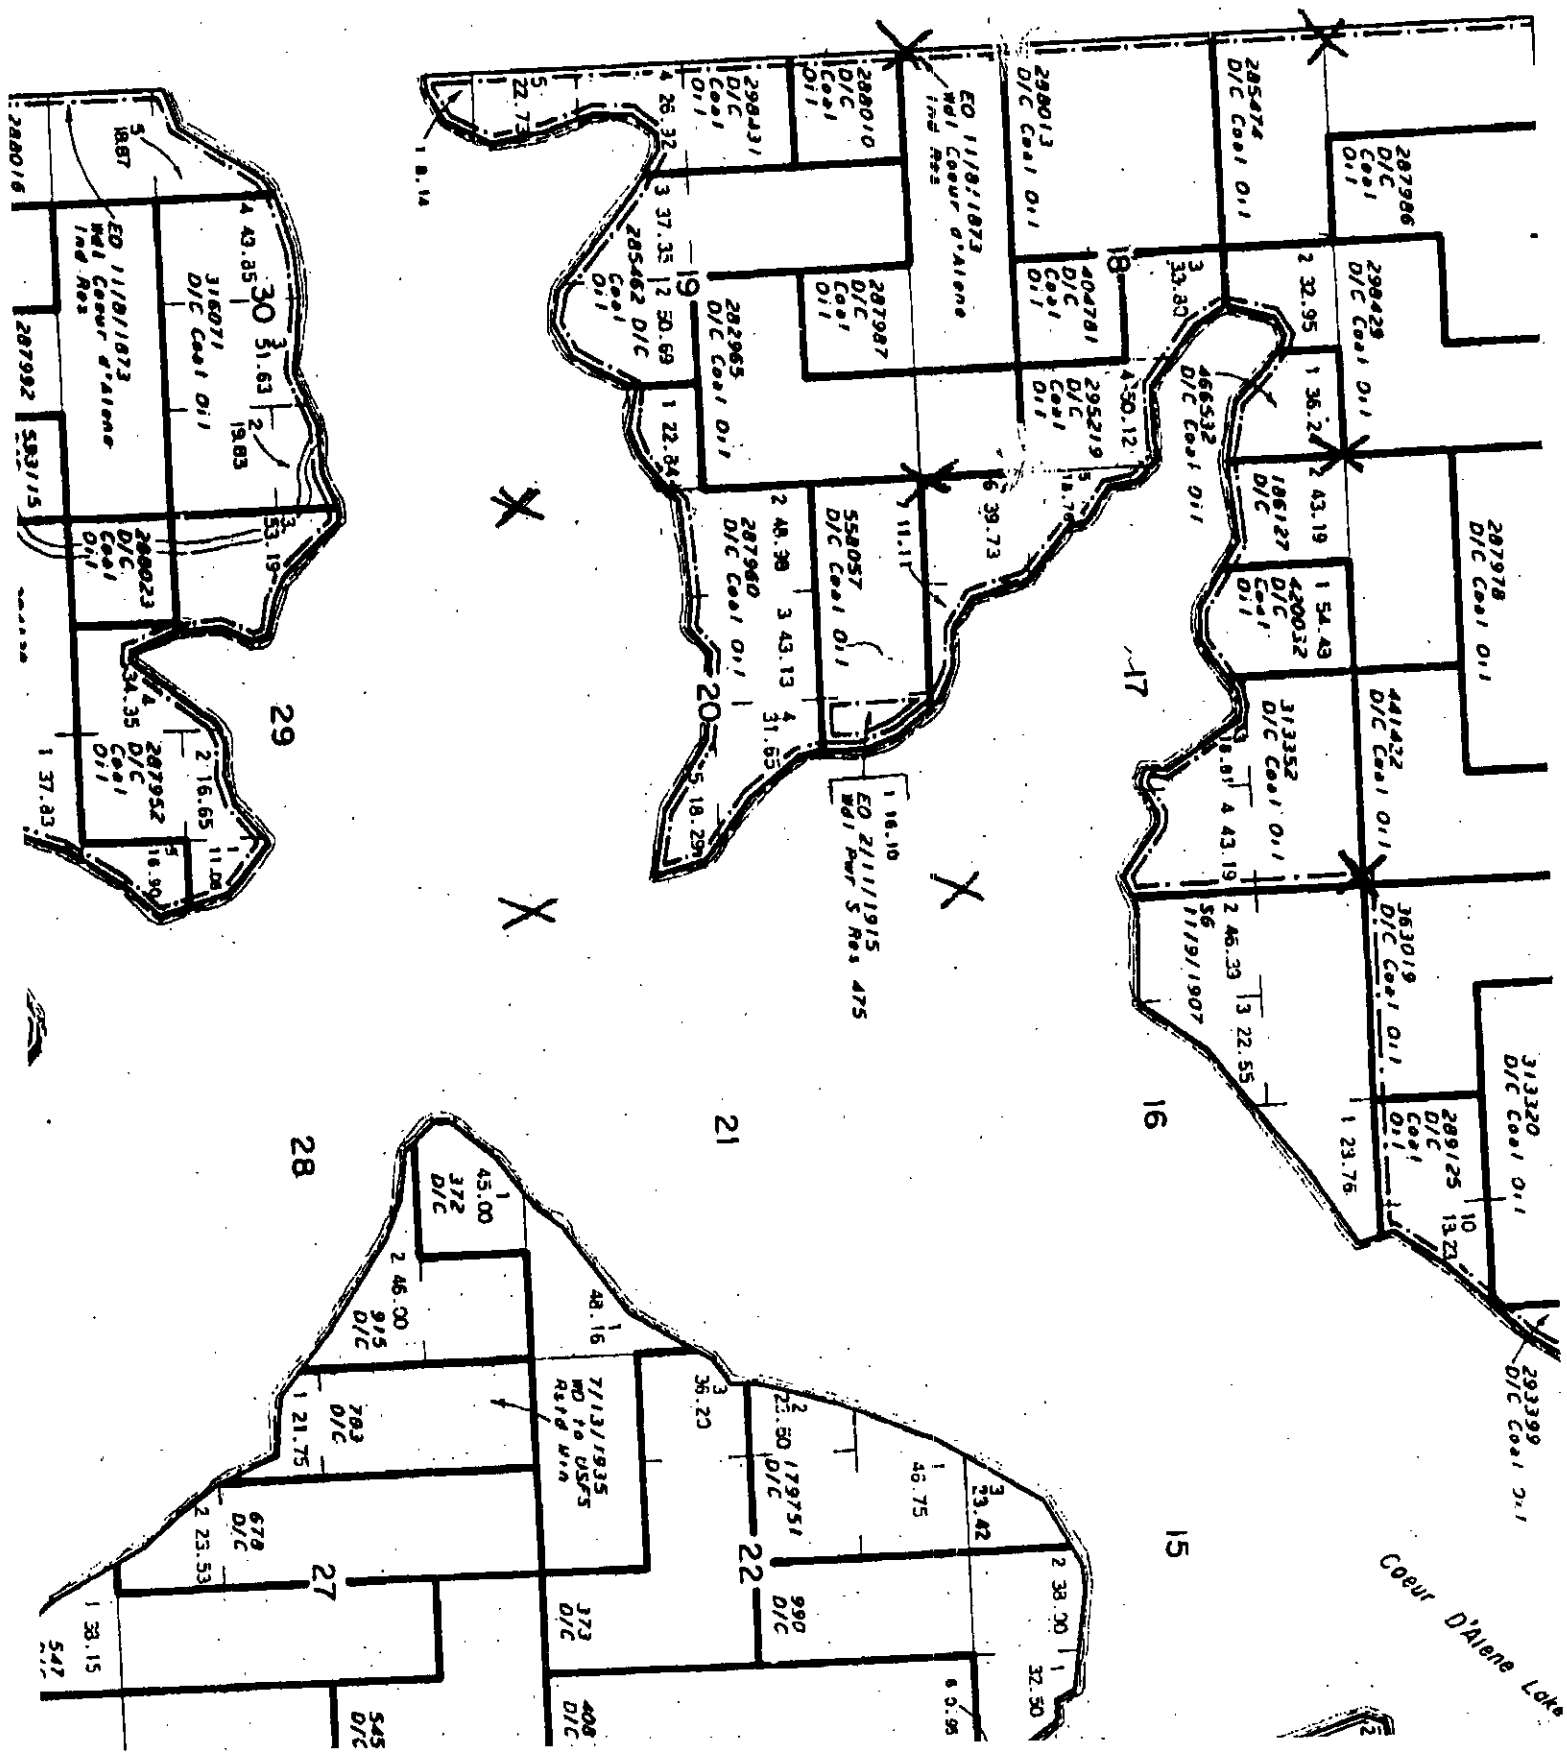

AFFIDAVIT OF PUBLICATION

RECEIVED

SEP 23 2005

IDWR/North

STATE OF IDAHO,
County of Kootenai,

SS,

Kattie Hay

being first duly sworn

upon oath deposes and says:

1. I am now and at all times hereinafter mentioned was a citizen of the United States, resident of the State of Idaho, over the age of twenty-one years and not a party of the above entitled action.

2. I am now and at all times hereinafter mentioned was the printer (principal clerk) of the "Coeur d'Alene Press," a newspaper printed and published daily except Sunday in Coeur d'Alene, Kootenai County, Idaho, and having a general circulation in said county.

3. The

Legal Notice


of which the annexed is a printed copy, was published in the regular issue of said newspaper for 2 consecutive Thursday weeks commencing on the 15 day of September 2005, and ending on the 22 day of September 2005, and such publication was made as often during said period as said Daily newspaper was regularly issued.

4. That said newspaper has been continuously and uninterruptedly published in said Kootenai County, during a period of more than seventy-eight consecutive weeks immediately prior to the first publication of said notice. On this 22 day of September in the year of 2005, before me, a Notary Public, personally appeared Kattie Hay, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he executed the same.

Regina Mason

Notary Public for the State of Idaho
residing at Coeur d'Alene, Idaho.

MY COMMISSION EXPIRES 6/18/09

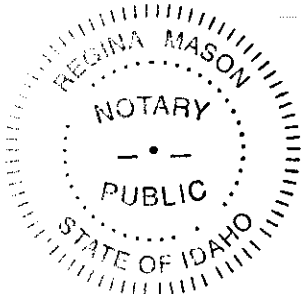

The following application(s) have been filed to appropriate the public waters of the State of Idaho.

LES D VAWTER
DANA VAWTER
PO BOX 226
OSBURN ID 83849
Point(s) of Diversion SENW S34 T49N R01W KOOTENAI County
Source GROUND WATER
Use: DOMESTIC 01/01 To 12/31 0.04 CFS
Total Diversion: 0.04 CFS
Date Filed: 08/23/2005
Place Of Use: DOMESTIC
T49N R01W S34 SWNW SENW
Remark: Domestic use is for 1 home.
95-9295

SANDRA K LARSON-SWICK
RANDALL G SWICK
PO BOX 3185
COEUR D ALENE ID 83816
Point(s) of Diversion L1 (NWNW) S12 T49N R04W KOOTENAI County
Source COEUR D ALENE LAKE Tributary To SPOKANE RIVER
Use: DOMESTIC 01/01 To 12/31 0.03 CFS
Total Diversion: 0.03 CFS
Date Filed: 08/23/2005
Place Of Use: DOMESTIC
T49N R04W S1 SWSW
Remark: Domestic use is for 1 home.
95-9296

BART NELSON
PO BOX 1065
COEUR D ALENE ID 83814
Point(s) of Diversion L1 (NENW) S29 T50N R03W KOOTENAI County
Source COEUR D ALENE LAKE Tributary To SPOKANE RIVER
Use: DOMESTIC 01/01 To 12/31 0.2 CFS
Total Diversion: 0.2 CFS
Date Filed: 08/22/2005
Place Of Use: DOMESTIC
T50N R03W S29 NENW Lot 1
Remark: Domestic use will be for 5 homes
95-9297

PAUL ROBERGE
JOYCE ROBERGE
17222 N SMITH AVE
HAUSER ID 83854
Point(s) of Diversion NWSE S6 T51N R05W KOOTENAI County
Source GROUND WATER
Use: DOMESTIC 01/01 To 12/31 0.02 CFS
Total Diversion: 0.02 CFS
Date Filed: 08/12/2005
Place Of Use: DOMESTIC
T51N R05W S6 NESE NWSE
Remark: Domestic use is for 1 home.
95-9298

WOODLAND SHORES WATER & SEWER ASSOCIATION
4302 S TAMPA ST
SPOKANE WA 99223
Point(s) of Diversion (3) L3 (SWNE) S18 T48N R04W
Point(s) of Diversion L5 (NWSW) S17 T48N R04W
KOOTENAI County
Sources GROUND WATER
Use: MUNICIPAL 01/01 To 12/31 0.5 CFS
Total Diversion: 0.5 CFS
Date Filed: 09/06/2005
Place Of Use: MUNICIPAL
Remark: Municipal use is for applicants service area
96-9253

KOOTENAI LAND & TRUST LLC
PO BOX 1570
POST FALLS ID 83877
Point(s) of Diversion (2) L2 (NWNE) S1 T53N R03W KOOTENAI County
Source GROUND WATER
Use: MUNICIPAL 01/01 To 12/31 0.3 CFS
Total Diversion: 0.3 CFS
Date Filed: 07/29/2005
Place Of Use: MUNICIPAL
Remark: Municipal use is within service area of applicant.

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec 42-203A, Idaho Code.
Any protest against the approval of this application must be filed with the Director, Dept. of Water Resource, Northern Region, 1910 Northwest Blvd, Suite 210, Coeur d'Alene ID 83814 together with a protest fee of \$25.00 for each application on or before 10/03/2005. The protestant must also send a copy of the protest to the applicant.
KARL J DREHER, Director
Legal 7888
September 15, 22 2005

PROPOSED WELL #5

Woodland Shores test boring, Rockford Bay area, Idaho

Boring log by John P. Buchanan

Driller: Budginer and Associates, Inc., Spokane, WA

Equipment: Longyear

Date: 5/3/05 and 5/4/05

DEPTH ENCOUNTERED MATERIAL (feet)

- 0 - 11 Soil and artificial fill material
- 11 - 16 Unconsolidated sand and gravel
- 16 - 25 Semiconsolidated sand and gravel
- 25 - 51 Basalt, vesicular on top, grading downward to dense, with some fractures
- 51 - 64 Sedimentary interbed, semiconsolidated siltstone and sandstone
- 64 - 66 Vesicular basalt
- 66 - 68 Semiconsolidated siltstone and sandstone
- 68 - 87 Variably weathered crystalline rocks (gneiss), soft
- 87-110 Competent crystalline rocks (gneiss) with micaceous partings and fractures

NOTES:

Groundwater level in boring stabilized at ~45 feet below land surface
Land surface elevation at site is ~62 feet above high stage of Lake Coeur d'Alene
Depths are in feet below land surface
Boring was pumped at ~2 gpm for 2 hours with negligible drawdown
Groundwater sample taken on 5/5/05 by Steve Burchett, Budinger and Associates

NOTE: THIS TEST WELL WAS DECOMMISSIONED &
TEMPORARY CASING PULLED.