

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 95-09018

Priority: May 19, 1999

Maximum Diversion Rate: 0.06 CFS
Maximum Diversion Volume: 3.0 AF

It is hereby certified that STATE OF IDAHO
DEPT OF PARKS & RECREATION
2750 KATHLEEN AVE #1
COEUR D ALENE ID 83815 has complied with the terms and
conditions of the permit, issued pursuant to Application for Permit dated May 19, 1999; and has
submitted Proof of Beneficial Use on January 28, 2000. An examination indicates that the works have a
diversion capacity of 0.06 cfs of water from:

SOURCE

COEUR D ALENE LAKE

Tributary: SPOKANE RIVER

and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL DIVERSION VOLUME</u>
IRRIGATION	03/15 to 11/15	0.06 CFS	3.0 AF

LOCATION OF POINT(S) OF DIVERSION:

COEUR D ALENE LAKE L2 (SW¼SW¼) Sec. 20, Twp 50N, Rge 03W, B.M. KOOTENAI County

PLACE OF USE: IRRIGATION

Twp Rge Sec	NE				NW				SW				SE				Totals
	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
50N 03W 19													1.0				1.0
													1.6				

Total Acres: 1

CONDITIONS OF APPROVAL

1. A fish screen of 1/4 inch or smaller mesh shall be installed and maintained at the point of diversion.
2. The approach velocity at the point of diversion shall not exceed 0.5 feet per second.
3. This right when combined with all other rights shall provide no more than 0.06 cfs per acre nor more than 3.0 afa per acre at the field headgate for irrigation of the lands above.
4. The issuance of this right does not grant any right-of-way or easement across the land of another.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed and sealed this 18TH day of DECEMBER, 2002.

MICROFILMED

MAY 24 2003

Acting for

KARL J. DREHER
Director



RECEIVED

AUG 16 1999

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 95-09018 Telephone No. (208) 769-1511
2. Name(s) of Permit Holder(s): Idaho State Parks and Recreation
3. Mailing Address: 2750 Kathleen Ave., #1
4. Source of Water: Coeur d'Alene Lake If GROUNDWATER (well), Date Drilled: mo. ____ / yr. ____
 - a. Well Driller: _____ Drilling Permit Number: ____ - ____ - ____
 - b. OPTIONAL:
Pump Horsepower: _____ Pressure (psi): _____ Dynamic pumping level (ft): _____
5. Use(s) (as authorized by the water right permit):
Domestic (No. of households): _____ Stockwater (No. and type of stock): _____
Irrigation (No. of acres): 3 Other: _____
6. Total rate of diversion and/or volume for which proof is submitted: .12 cfs OR _____ acre feet
7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)
(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device:	Is a measuring device required?	Yes _____	or	No <u>X</u>
	Has the measuring device been installed?	Yes _____	or	No <u>X</u>
Flow Measurement Port:	Is a flow measurement port required?	Yes _____	or	No <u>X</u>
	Has the measurement port been installed?	Yes _____	or	No <u>X</u>
8. Fee Enclosed: \$ 50⁰⁰ (See Fee Schedule on back of the instructions for filing proof of beneficial use)
To be paid by intra agency billing
9. Person to contact to accompany the Department representative during field examination of the water system.
Name: Randall R. Butt Telephone Number: (208) 769-1511
Address: 2750 Kathleen Ave., #1 Coeur d'Alene ID
10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: Randall R. Butt Park Manager Date: 8-11-99
(include your title, if on behalf of company or organization)

JAN 16 2000

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 95-09018

Proposed Priority: May 19, 1999

Maximum Diversion Rate:

0.12 CFS

This is to certify, that STATE OF IDAHO

DEPT OF PARKS & REC
2750 KATHLEEN AVE #1
COEUR D ALENE ID 83815

has applied for a permit to appropriate water from:

COEUR D ALENE LAKE tributary of SPOKANE RIVER

and a permit is APPROVED for development of water as follows:

BENEFICIAL USE

PERIOD OF USE

RATE OF DIVERSION

IRRIGATION

03/15 to 11/15

0.12 CFS

LOCATION OF POINT(S) OF DIVERSION: Lot 2 (SWSW), Sec. 20, Township 50N, Range 03W
KOOTENAI County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>		<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
50N	03W	19	Lot 6 (NESE)	2.5			2.5
		20	Lot 2 (SWSW)	0.5			0.5

Total number of acres irrigated: 3.0

CONDITIONS OF APPROVAL AND REMARKS

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before July 1, 2000.
2. Subject to all prior water rights.
3. The issuance of this right does not grant any right-of-way or easement across the land of another.
4. This right when combined with all other rights shall provide no more than 0.04 cfs per acre nor more than 3.0 afa per acre at the field headgate for irrigation of the lands above.
5. A fish screen of 1/4 inch or smaller mesh shall be installed and maintained at the point of diversion.
6. The approach velocity at the point of diversion shall not exceed 0.5 feet per second.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

13th day of July, 1999.

Karl J. Dreher
for Karl J. Dreher, Director

MICROFILMED

Ident. No. 95-09018

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED

JUL - 6 1999

To appropriate the public waters of the State of Idaho

Department of Water Resources

State of Idaho

1. Name of Applicant Department of Parks & Recreation Phone 769-1511
Mailing address 2750 Kathleen Ave., Suite One, Coeur d'Alene, ID 83815

2. Source of water supply Lake Coeur d'Alene which is a tributary of SPOKANE RIVER

3. Location of point of diversion is Township 50N Range 3W Sec. 20, in the SW 1/4, SW 1/4, Govt. Lot 2, B.M., KOOTENAI County;
additional points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 0.12 CFS for Landscape Irrigation purposes from April 1 to Nov. 1 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) .12 CFS and/or (b) _____
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Describe type and size of devices used to divert water from the source 2HP Suction Pump with Inlet
for irrigation line _____

b. Height of storage dam NA feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feet

c. Proposed well diameter is NA inches; proposed depth of well is _____ feet

d. Is ground water with a temperature of greater than 85°F being sought? NO

e. If well is already drilled, when? NA; Drilling firm _____
Well was drilled for (well owner) NA; Drilling Permit No. _____

7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)

8. Description of proposed uses (if irrigation only, go to item 9):

a. Hydropower; show total feet of head and proposed capacity in KW. _____
b. Stockwatering; list number and kind of livestock. _____
c. Municipal; show name of municipality. _____
d. Domestic; show number of households. _____
e. Other; describe fully. _____

MICROFILMED

JAN 18 2001

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

use below. See instructions for standard symbols.

[illegible]

Total number of acres to be irrigated

10. Describe any other water rights used for the same purposes as described above.

11. a. Who owns the property at the point of diversion?
Hagadone Hospitalty Co.

b. Who owns the land to be irrigated or place of use? State of Idaho, D.O.I.

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: Hagadone Hospitality has contracted with the State of Idaho to

12. Remarks:

trail between the trail head and the Beachouse Restaurant.

- MORE WATER THAN 1 MINUTE'S FLOW/HOUR IS RECOVERED
OR SHORTLY DIVERSION PERIOD + TIME GAINS IN PULVER AREA WITH

Rebuke more later.

13. **MAP OF PROPOSED PROJECT REQUIRED** - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

State of Idaho
Department of Parks & Recreation

Signature of Applicant (and title, if applicable)

Received by

Publication prepared by

Received by _____
Date _____

Time 4:35

Preliminary check by


Date _____

442

Publication approved

MICROFILMED

1963 9 1 1971

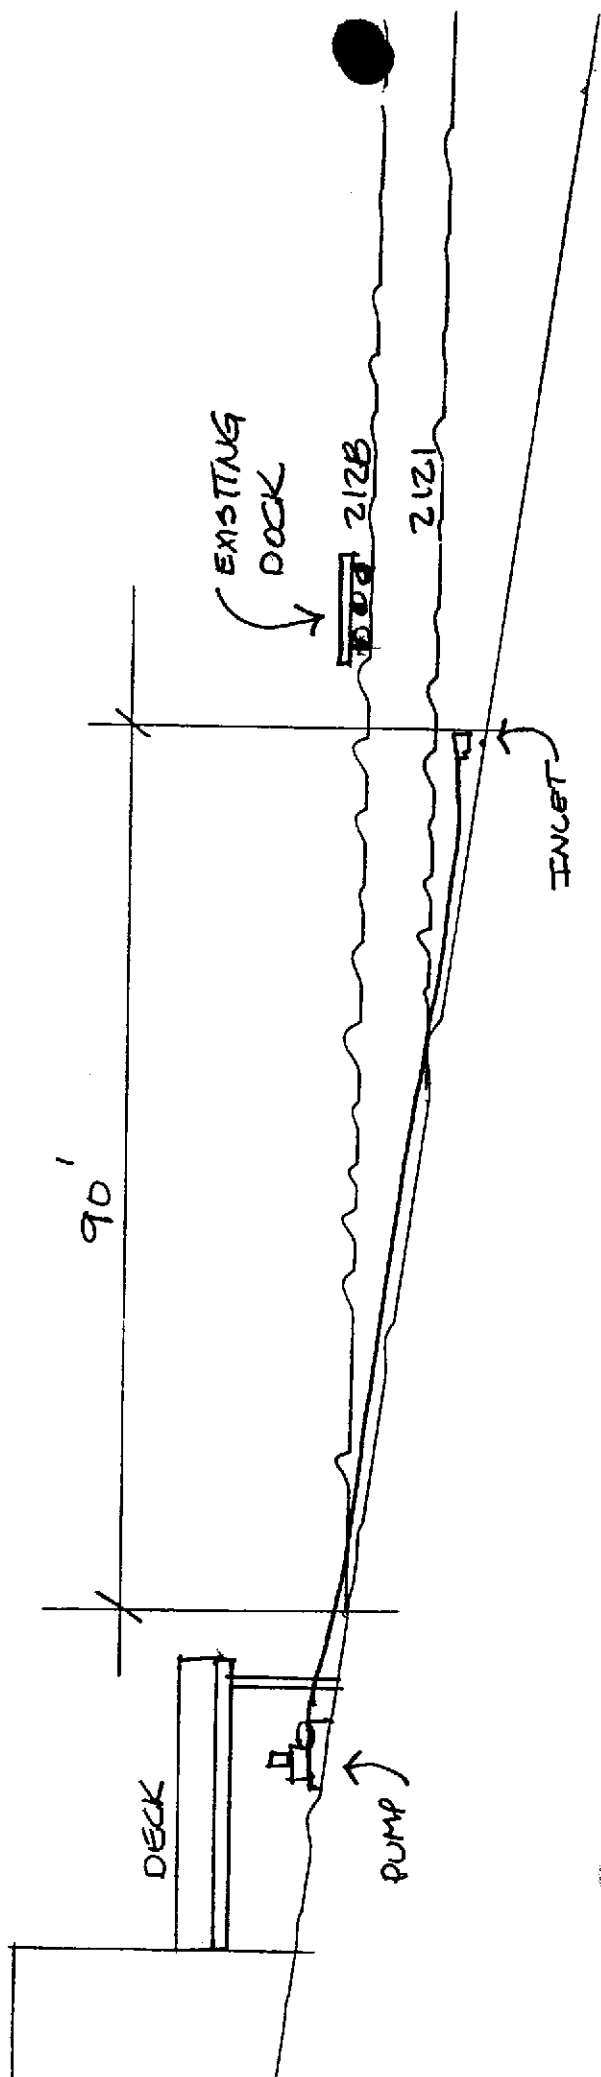

SECTION DRAWING

1" = 20'


MICROFILMED

JAN 16 2001

MAY 19th, 1999 BEACH HOUSE IRRIGATION

DATE _____

"PLACEMENT of SUBMERGIBLE PUMP"

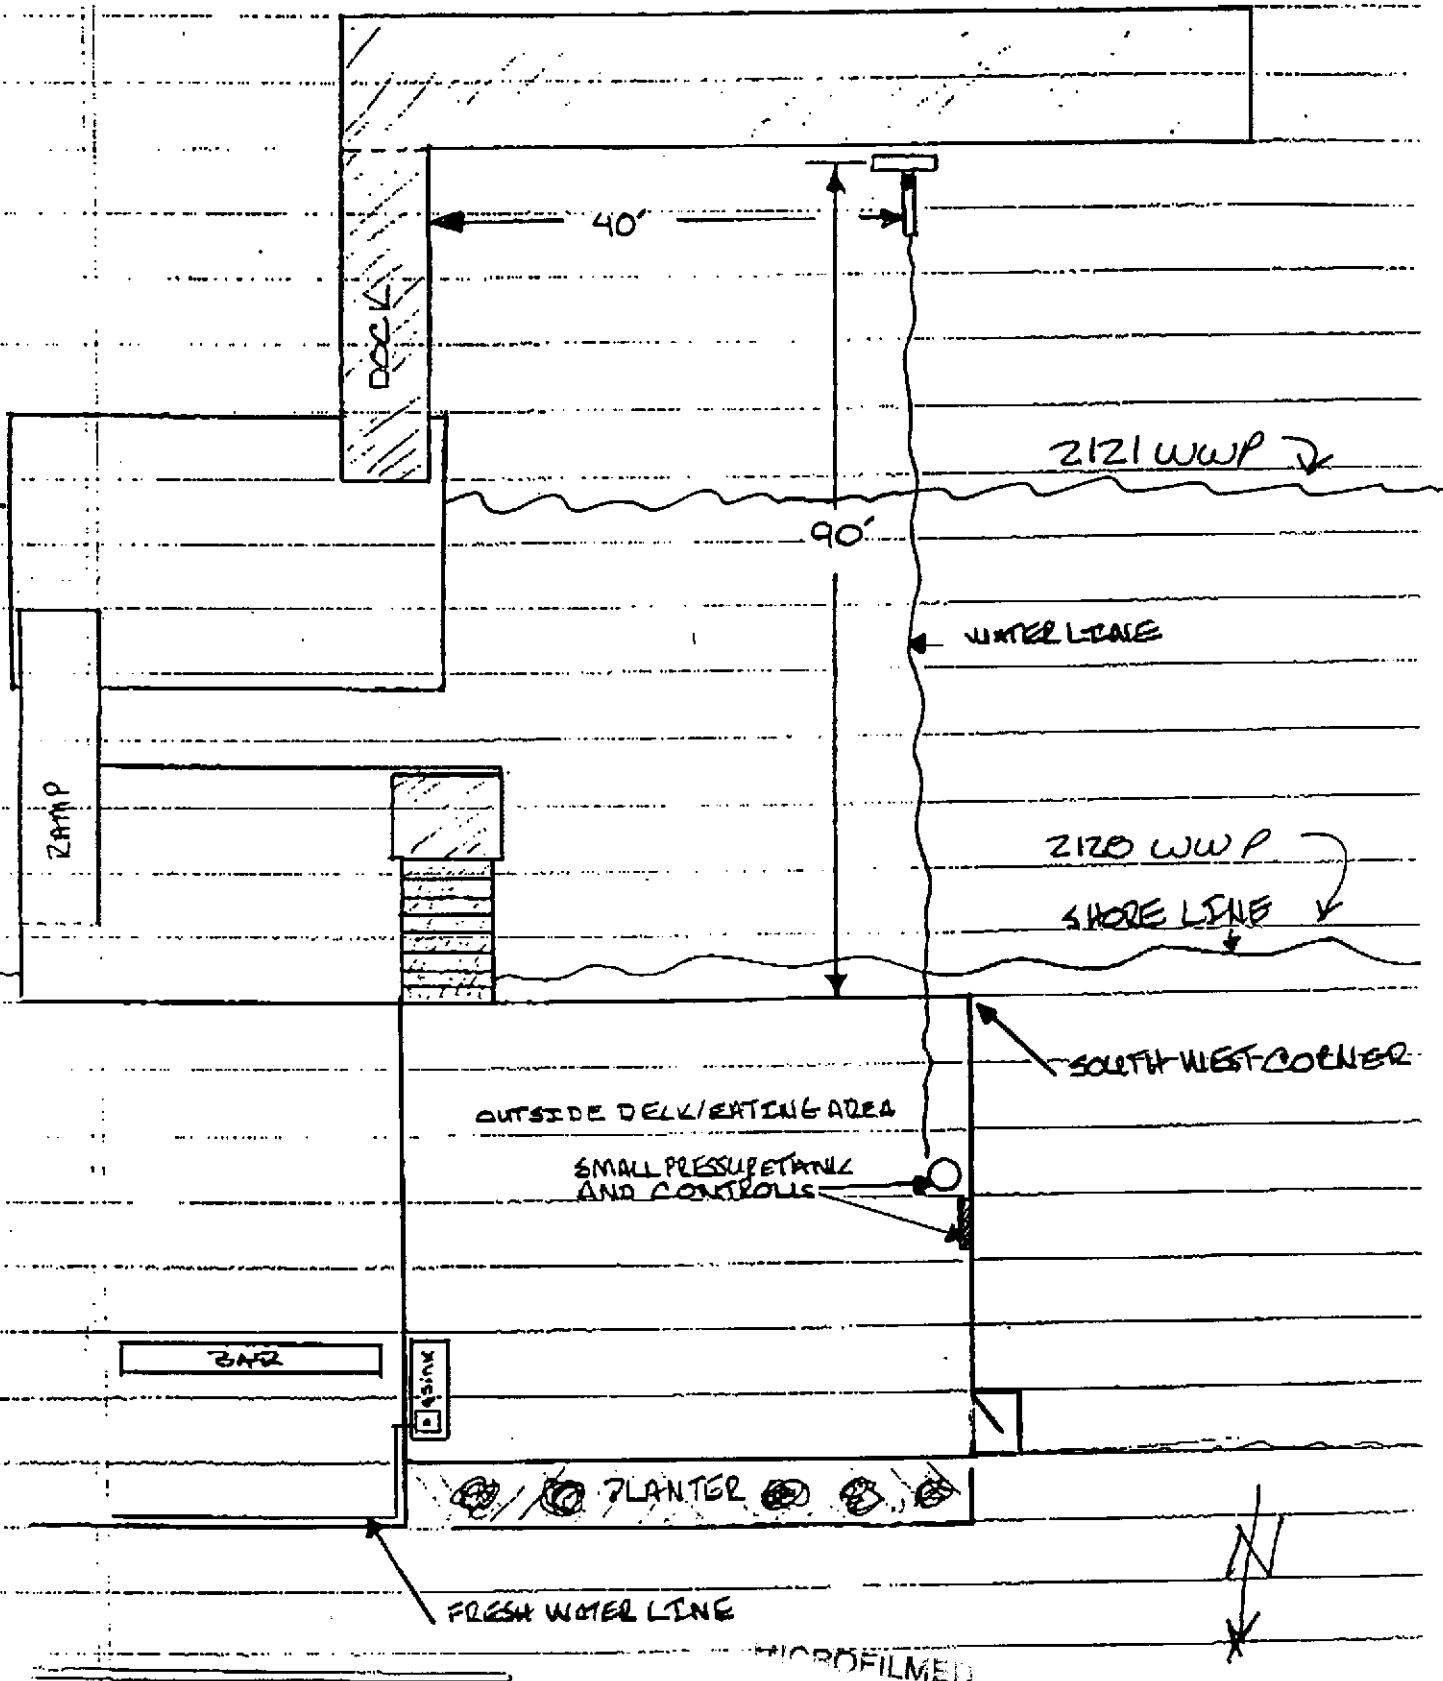


BEACHHOUSE RESTAURANT

MICROFILMED

100

WILLIAM H. HARRIS

PAGE

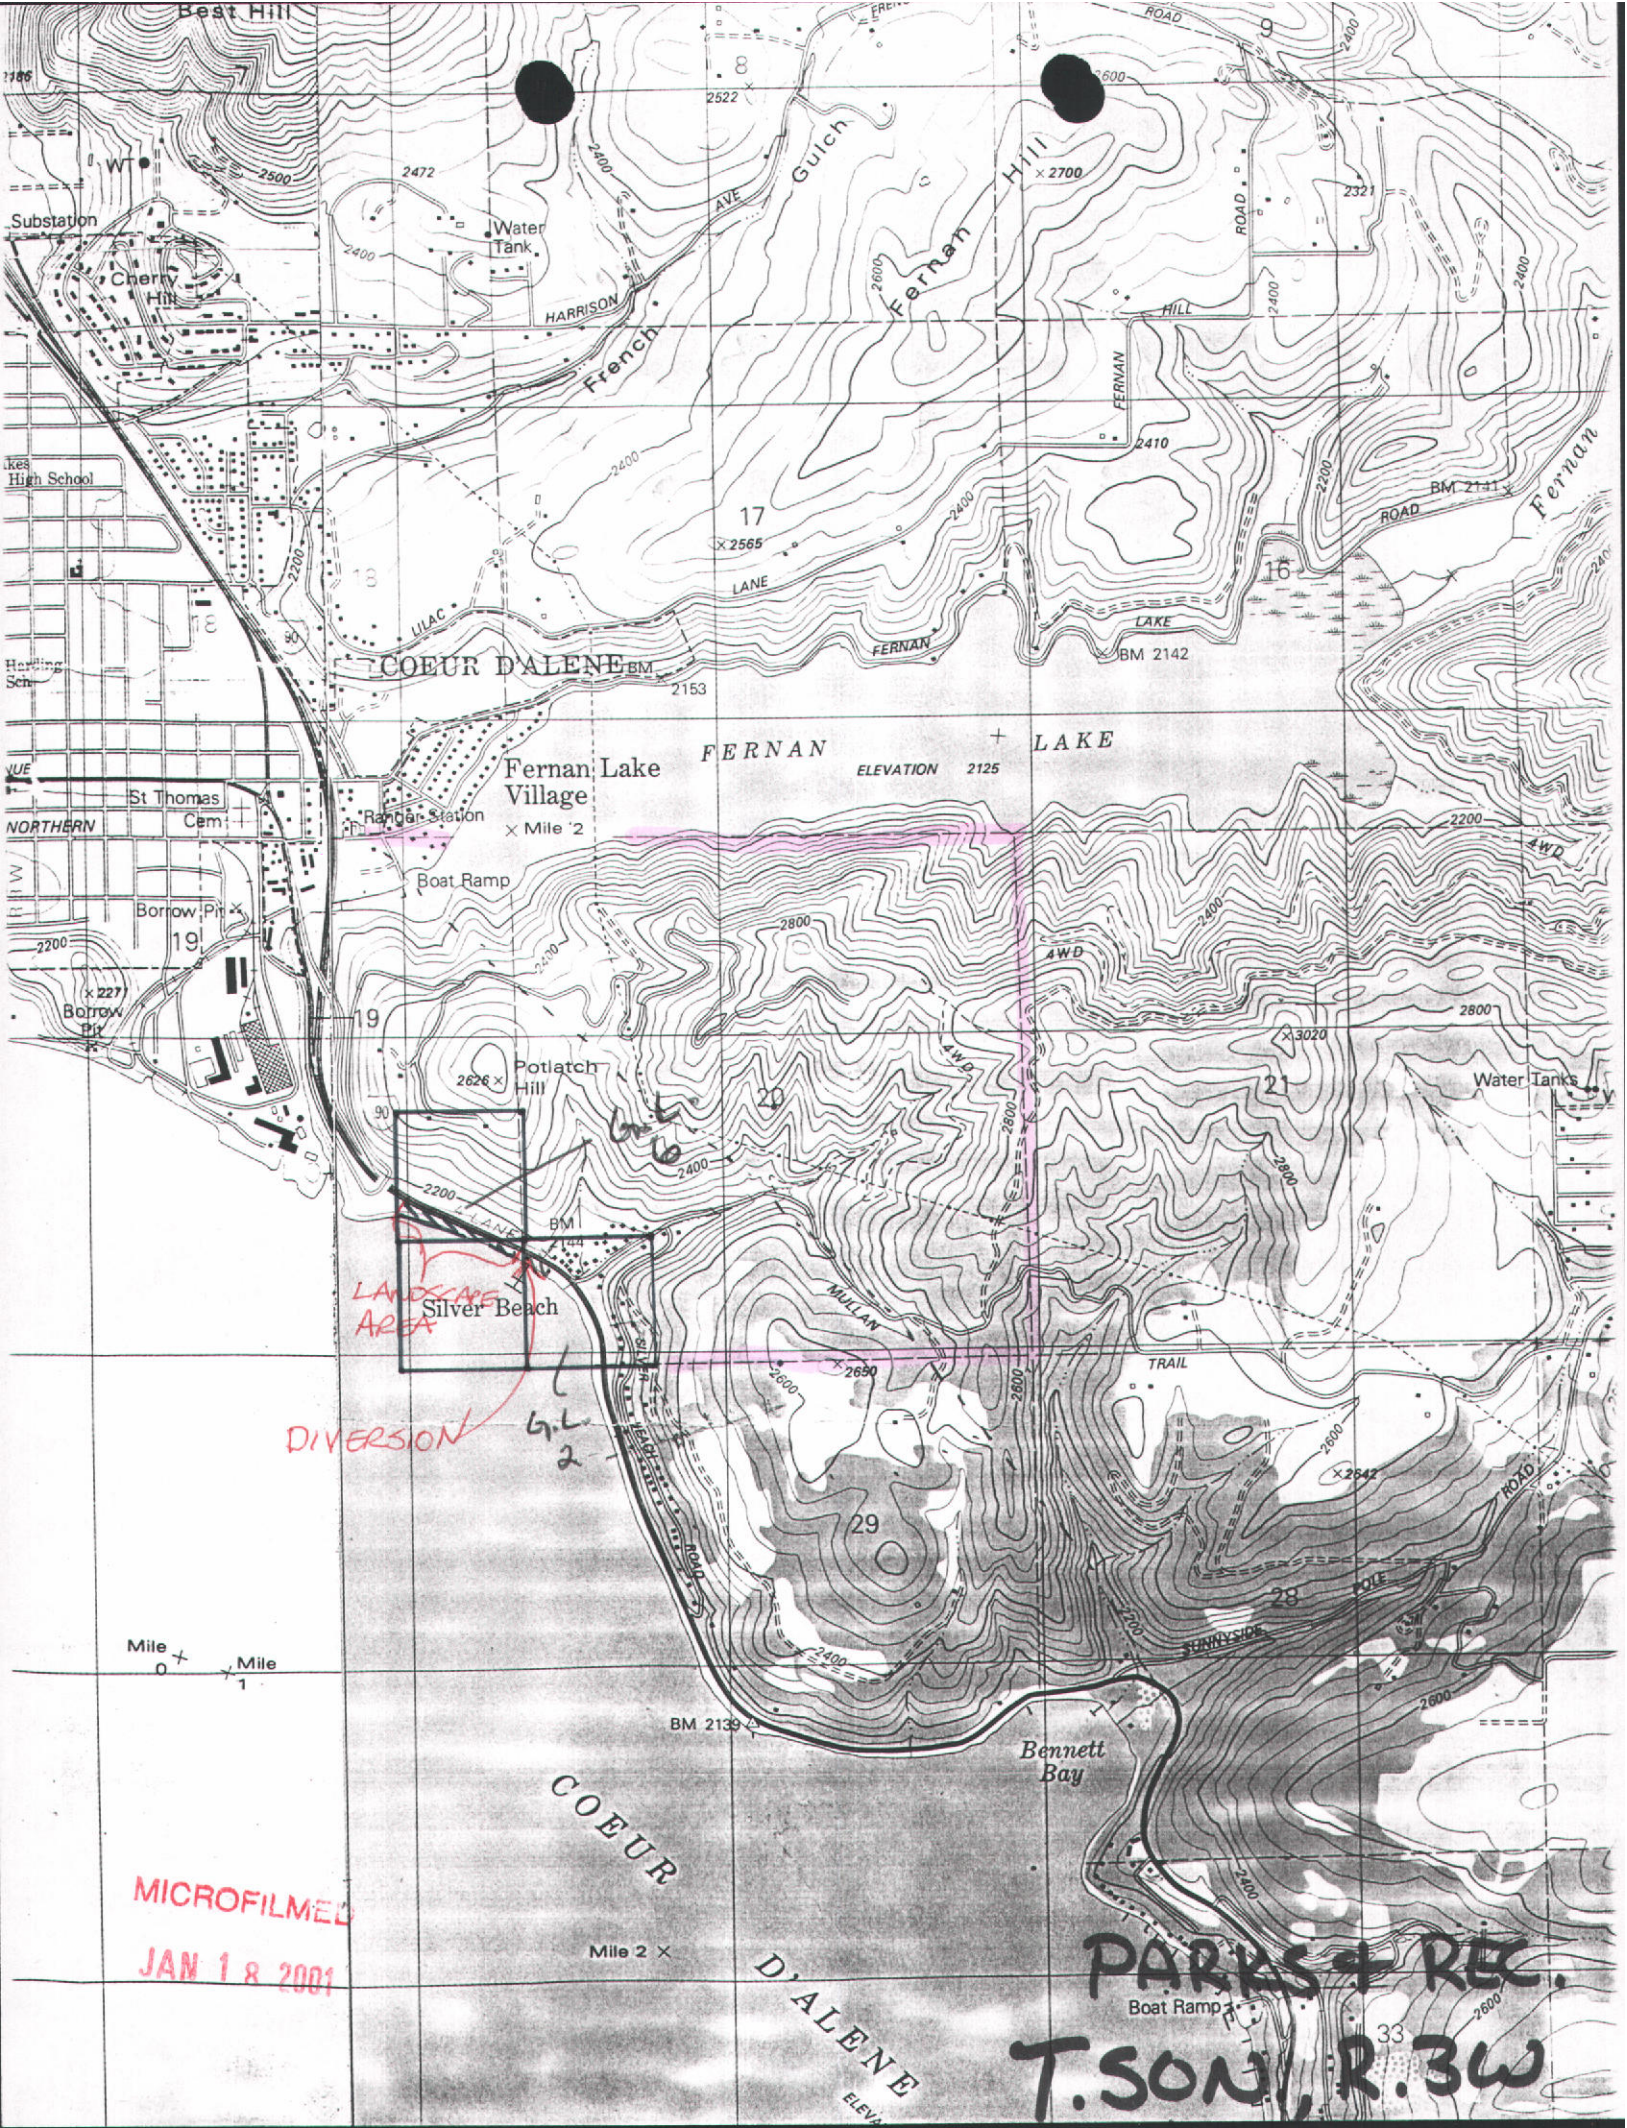

MICROFILMED
JAN 18 2001

PARKS & REC.
T. SON, R. 3W

1
K
L
M
E

THARSTON
T.50N, R.3W



MICROFILMED
JAN 1 1981

MEMORANDUM

Date: December 17, 2002
To: Water Right File 95-9018
From: S. Keen
Re: License Review 

License review and data entry by S. Keen on 12/17/2002. No overlapping rights found. Field examiner was told by the system installer that the capacity is 25 gpm (0.06 cfs). Examiner said he observed 35 gpm (0.08 cfs), but I am not sure he accounted for the pressure tank installed in the system. Therefore, the capacity will be listed as 0.06 cfs.

The permit carried a condition limiting the development to 0.04 cfs per acre, but actual development has been 0.06 cfs per acre. The additional rate per acre is justifiable under the same rationale used to justify 0.04/acre instead of 0.02/ acre -- the use is for irrigation of public space that can only be watered during hours of limited public use.

The examiner recommended 0.1 acres of irrigation in the SESE of Section 19, but there is no SESE, only Govt Lot 6.

MICROFILMED

MAR 24 2003

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

SEP 17 2002

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 95-09018

1. Owner: State of Idaho, Dept of Parks & Rec Phone No. (208) 769-1511

Current Address: 2750 Kathleen Ave #1 Coeur D'Alene Id 83815

2. Accompanied by: Randall Butt EXAM DATE: 9-3-02

Address: Same as above Phone No. _____

Relationship to Permit Holder: Park Ranger

3. Source: Coeur D'Alene Lake tributary to Spokane River

B. OVERLAP REVIEW

1. Other water rights with the same place of use: _____

2. Other water rights with the same point of diversion: _____

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
	02		SW	SW	20	50N	03W	Kootenai	US GS 7.5 min Quad

2. Place(s) of Use:


Indicate Method of Determination

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
50N	03W	19													09			01	1
													GL	06			GL	06	

MICROFILMED

MAR 24 2003

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

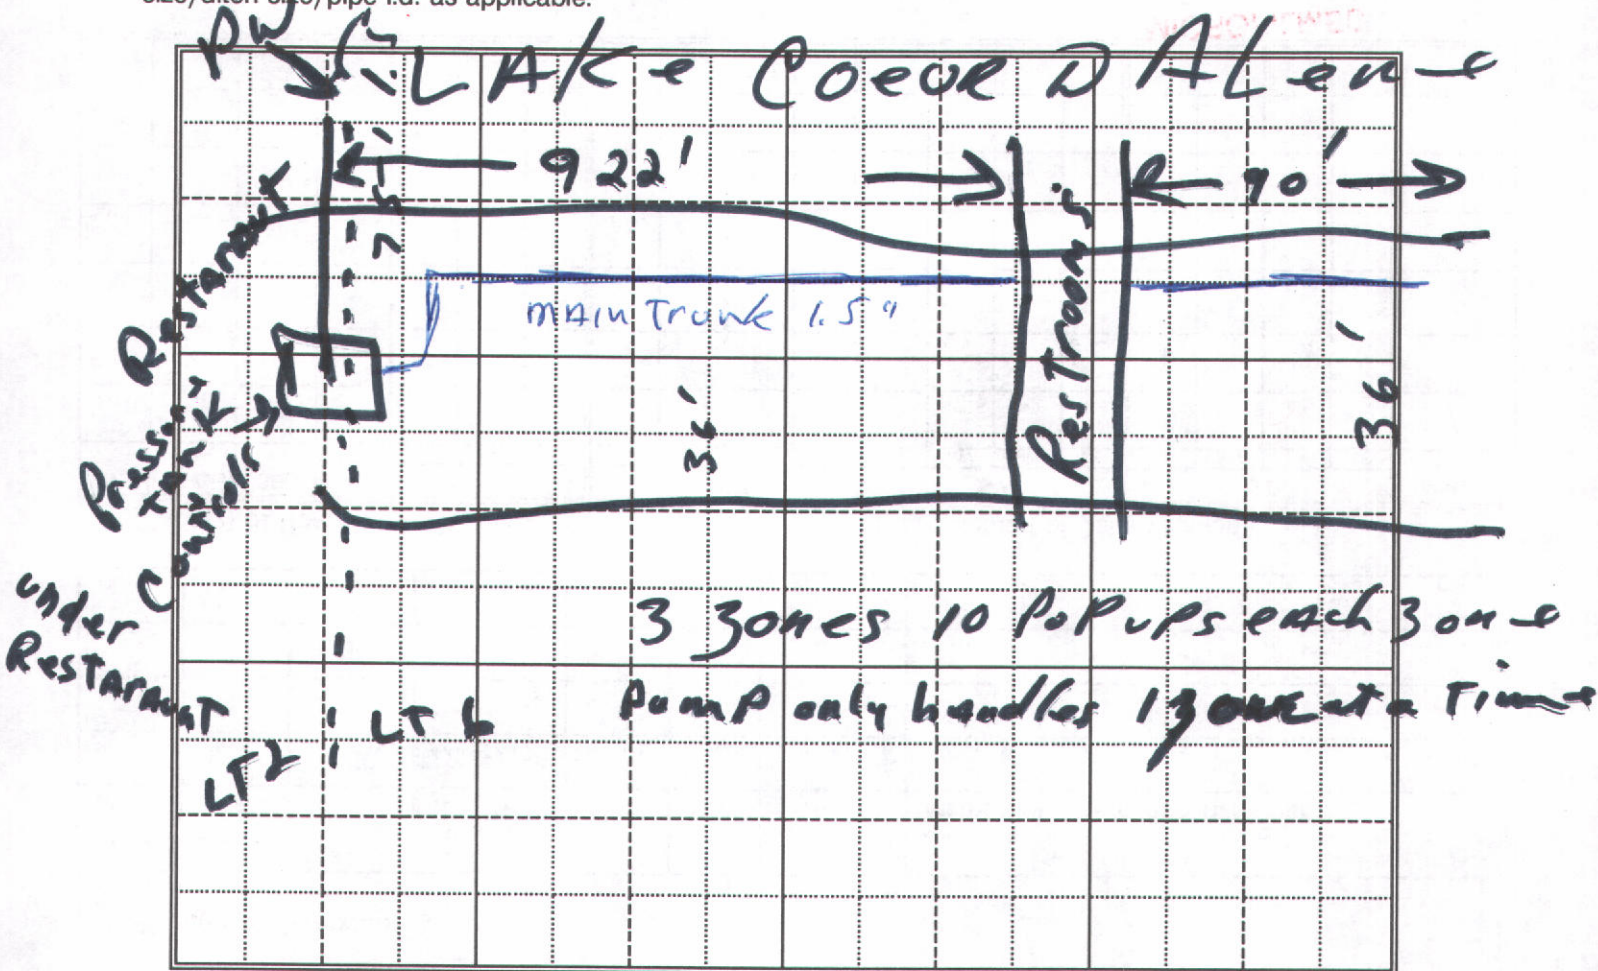

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Franklin	2	NA	Grundfos	SP4

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.



Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

MICROFILMED

MAR 24 2003

95-09018

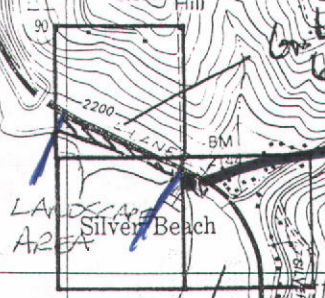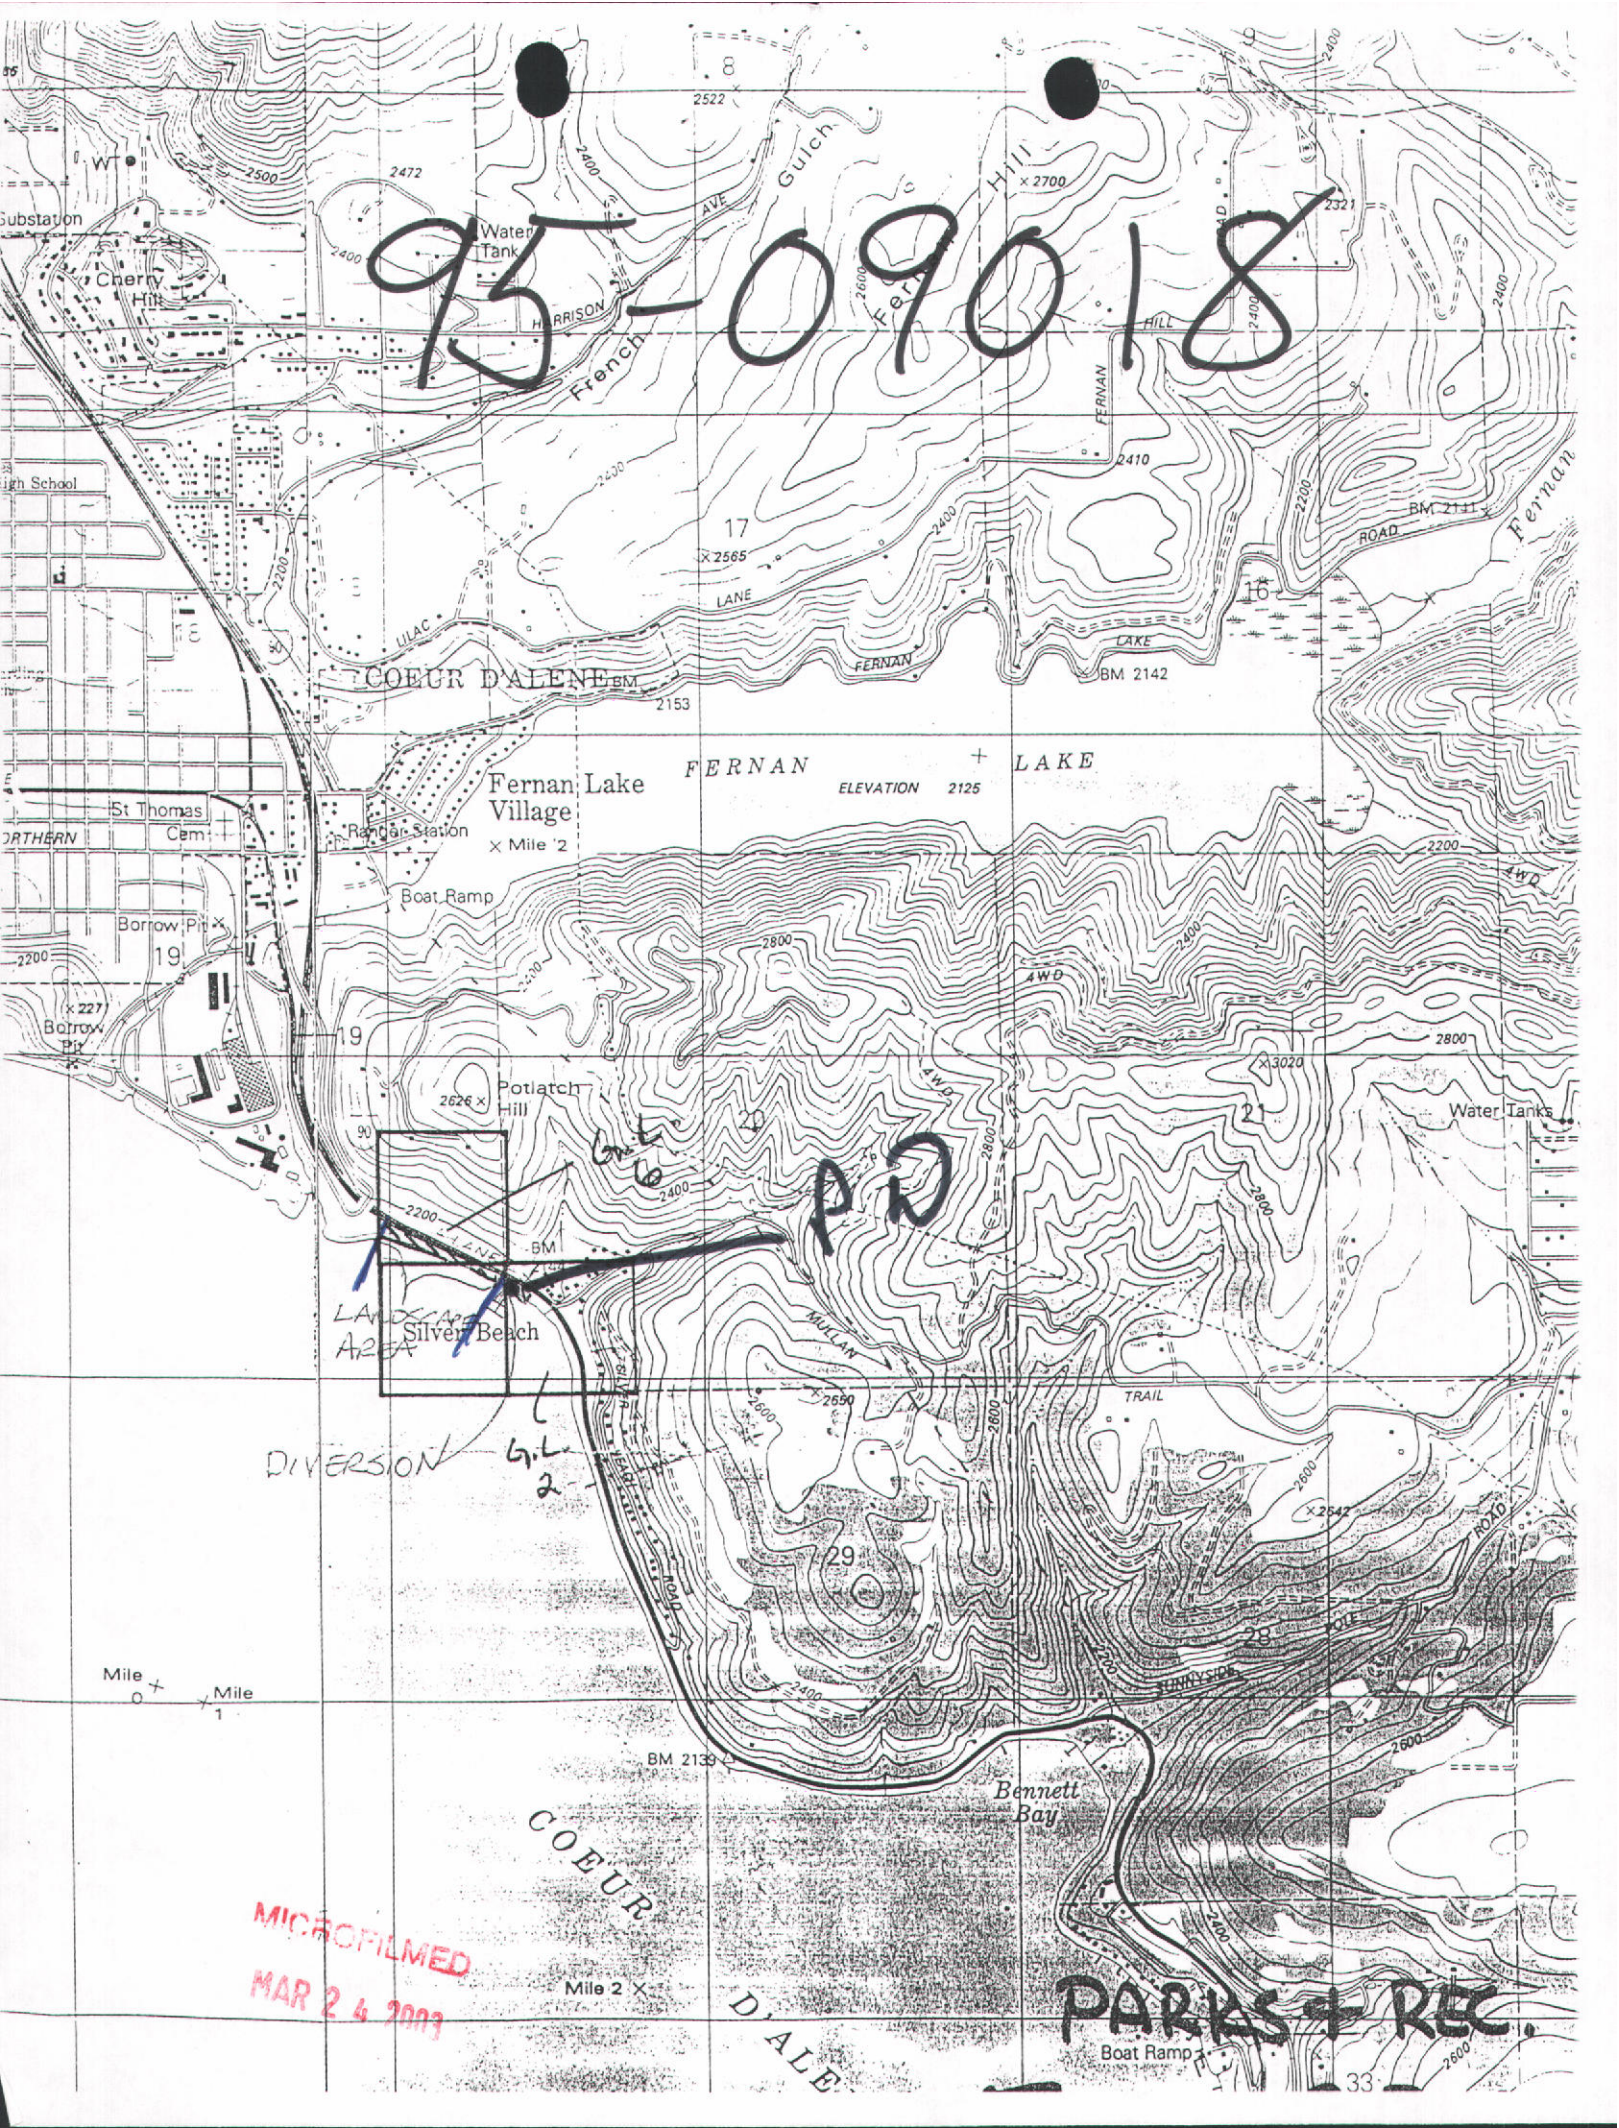

AD

MICROFILMED
MAR 24 2003

PARKS + REC.

95-09018



PW

Pressure Tank
controls, under
Restaurant

PV

MICROFILMED
MAR 24 2003

E. NARRATIVE/REMARKS/COMMENTS

Area measurement done by pacing. Notice
I rounded up to 1 acre

Measurement

This system is completely underground. There is
a pressure gage on it, it maintains 50 PSI while running
one zone 10 hedds (Irritorol XL series) measuring area I
estimated them at 3.5 gpm each. Which concurs with
theoretical calculations.

I called company that put in system. They
told me it's a 25 gpm system. I feel more
confident in theoretical. You Call.

Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED

MAR 24 2003

F. FLOW CALCULATIONS

Measured Method:

Additional Computation Sheets Attached

THEORETICAL
$$\frac{8.8(0.7)(2)}{30 + (2.31 \times 50)} = \frac{12.32}{145.5} = .08 \text{ cfs}$$

SEE NARRATIVE

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 1 \times 3 = 3$

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .08 \times 1.245 \times 1.9835 = 3.8$

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 3$

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Irrigator	03-15	11-15	.08	3
Totals:			.03	3

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☒ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name Wayne Salas Date 9-11-02

Reviewer _____ Date _____

SEAL

MICROFILMED

MAP 2 - 2003

ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE

Permit No. 95-09018 Reviewed by YSS Date 01-05-00

GENERAL CONSIDERATIONS

yes Name same as permit?

yes Address same as permit?

yes Proof timely received?
If not, complete calculation below.

TYPES OF USE

for - 3 ac

Correct Uses? yes

SOURCE OF WATER

☒ Surface water source

☐ Ground water source

☒ Drilling permit required?

☒ Copy in the file? Drilling Permit No.

☒ Amount paid for permit Correct?

☒ Well log in the file?

LICENSE EXAMINATION FEE

yes Required?

50 Amount Submitted

yes Correct?

MEASURING DEVICE

NO Required?

☒ Installed?

☒ Waiver requested?

PRIORITY CALCULATION

Date proof received	<u> </u>	<u> </u>
Date proof due	<u> </u>	<u> </u>
No. of days late	<u> </u>	<u> </u>
Priority Date	<u> </u>	<u> </u>
New Priority Date	<u> </u>	<u> </u>

DEFICIENCIES OR ACTION ITEMS

need the sample of \$50⁰⁰
none / ack proof

DATA ENTRY

New Address Proof Made 1-28-00

APPLICATION FOR PERMIT
STATE OFFICE ANALYSIS

No.: 95-09018 Name: IDPR Date: 7/12/99 Ad OK? ☒ / Gvmt Lts: by Curtis

AREA OF CONCERN: - No/Yes: _____ Mor / _____ GWMA / Trust / Non-trust

PROTESTED: - 020 (Protest Agreement) or *W19 (Order)

SYSTEM COMPLETED:

> 1 year - 26A-P17
≤ 1 year/no proof - P16

GROUNDWATER: (✓ FLO-CH)

DRILLING PERMIT

All wells (✓ WDQ3) - 046-P23
In Basin 34? - 085
Irr. within WD - P05 (new well location)
WMD (✓ MAP) - North / East / West
> 0.24 cfs/5 acres - 067
≤ 0.24 cfs/5 acres - No MD

WMD

Supp. irr. use only - 065-079 (if GW use SW)-(keep SW)-(GW not primary irr. source)
Supp. irr. + uses - 100-101
> 0.24 cfs/5 acres - 01M (report when notified)
≤ 0.24 cfs/5 acres - No MD

SURFACE WATER: (✓ FLO-CH) (Surface water that doesn't sink is regulated):

FISH & GAME CONTACTED: - Yes / No; WHEN: 6/29/99 RESPONSE: screen/velocity cond. wanted.

IN/ABOVE MSF (✓ MAP) - *WB9

IN-STREAM DEVELOPMENT - P62 (stream channel alteration)

WD (✓ MAP & LISTING) - R04 (WD # _____)

> 0.20 cfs - 01J-P08 (MD & LD)
≤ 0.20 cfs - 01H-P01 (LD), 01P or No MD (in-stream stock)

WMD (✓ MAP)

> 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)
≤ 0.24 cfs/5 acres - No MD

SPRINGS/SINK, INACTIVE WD & REST OF STATE

> 0.24 cfs/5 acres - 01M or No MD (in-stream stock or power)
≤ 0.24 cfs/5 acres - No MD

RIVER BASINS: (*Surface water):

Snake R (01) - *W22-P04, NA
(02/03-irr) - 007 (w/ remark *WB9 if above Weiser), NA
Payette R(65) - *W22 (regulated uses), 047-P04 (Payette Lake), NA
Salmon R (70's) - 029 (fish screens), NA
Weiser R (67) - 086, 087

USE:

STORAGE (✓ 3 compo.) - 18A (in & out MD for on-stream storage)-01H-P01 (LD)/01P, 18B-P09 (>10' dam), NA
IRR ≤ 5 acres - *R66/R67/R68/R69 (0.03 cfs/acre + 3.0/3.5/4.0/4.5 AF)
> 5 acres - R62/R63/R64/R65 (0.02 cfs/acre + 3.0/3.5/4.0/4.5 AF)
STOCKWATER - R37 (BLM/USFS); NA
MINING - 054(req)-081-P10
FISH PROPAGATION - 029(70's only)-007-042(req)-081 (WQ)-P10
HEATING/COOLING - R07 (injection well)
POWER - 17H/17K(+uses)-08A-025(P18)-01N-028-081(P10)-027 (if no other cons. use);
17G (FERC) or 17M (FERC); 18B-P09; >25 cfs-P18

MUNICIPAL

In restricted area? - 022, 075, 004 (+memo?)
Irr., GW supp. to SW? - 102

DOMESTIC

Surface water - *WB5 (Big Wood R or Boise R ↑ Star Bridge); 27A (Payette River); NA
>1 in rest. area - 071-070

FIRE PROTECTION

- 077

LOCATION:

BOISE FRONT LOGEO - 058 (<85° GW temp only)
MITIGATION - 120
42-248 AREA - P84 (in 20/30/40/50/60/70/80 (87) basin)
SWAN FALLS FLAG (✓ Code) -

Trust - 051-052-053-P74 (Consumptive Uses), NA
Non-Trust (1) - 048-049 (Consumptive Uses), NA

OWNERSHIP:

- 004 (PD/PU)

OTHER CONDITIONS:

STANDARD REMARKS:

0.015/2000

BENEFICIAL USE DUE:

7/11/2000

COMMENTS:

*turp. irr. shorter irr. times = 04 cfs/ac OK
spec. R66 cond.

RECEIVED

JUL - 6 1999

IDAHO DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEETWR1
WPA
PCAAPPLICATION # 95-09018

Department of Water Resources

INITIAL REVIEW

APPLICANT: PARKS + REC.BY: ABDATE: 5 / 20 / 99

ITEM REQUIRED INFORMATION

1. (x) Name and Address
2. (x) Source
3. (x) Point of Diversion & County
4. (x) Quantity
 - (x) Nature of Proposed Use
 - (x) Period of Use
5. (x) Total Quantity
6. (x) Description of diverting works
7. (x) Time required for b/u
8. (x) Proposed use
9. (x) Place of use or acres irrigated
10. (x) Other water Rights
11. (x) Ownership
12. (x) Map
 - (x) Signature
 - (x) Fee (Amt, receipt, acknowledgement)

*** Send info sheet Y() N()

ADDITIONAL INFORMATION

(Yes) (No)

- x Field check: by _____
- + Field report attached
- + Analysis Supp. attached (>5cfs/500af)
- + Water delivered by water master?
- Water District # _____

PROCESSING

(Yes) (No) PRIORITY DATE: 5 / 20 / 99x (Include Moratorium Remark)x Statewide Advertising: (Diversion rate greater than 10 cfs or 1,000 af).ADVERTISE IN: KOOTENAI County

LETTERS SENT REQUESTING:

() Dam Information () Fish Information

() Power Information () Other: N/A

INFORMATION RECEIVED:

() Dam Information () Fish Information

() Power Information () Other: N/A

GROUNDWATER SECTION

WD Permit No.'s:	TAG #	Type:	Fees	Receipt No.	Upgrade Needed?
<u>+</u>		Dom. Non-Dom.	Paid \$		Y () N ()
<u>+</u>		Dom. Non-Dom.	Paid \$		Y () N ()
<u>+</u>		Dom. Non-Dom.	Paid \$		Y () N ()

Groundwater management area

Critical ground water area

Well Drilling Permit required

Well Drilling Application and Fees received

Well Drilling Application approved?

Remarks: _____

FINAL REGIONAL PROCESSING/REVIEW

(Yes) (No)

Notice of pending void order issued. Final order response date: _____

Further information required from applicant

6/11 Affidavit of publication received6/11 Application published correctly. If not, record action taken: _____5/26 Publication dates and paper recorded on applicationSr. Agent initial ABProtests received, Final protest date: 6 / 31 / 99

Measuring device required

Measuring port required

✓ Special conditions:

Special conditions of approval supplement and/or cover letter attached:

Approval Recommended by: AB RYADate: 6 / 29 / 99

Memorandum

Date: June 29, 1999

To: Application for Permit Number 95-09018

From: Beardslee

~~~~~  
The Northern Regional Office has contacted the Panhandle Region of Fish and Game regarding the approval of this Water Right Application for Permit.

After providing the location, source and uses of water, Chip Corsi suggested the following conditions for approval:

✓ The intake structure should be screened to 1/4 inch or less mesh and that the intake velocities be 1/2 feet per second, or less.

MICROFILMED

JAN 1 R 2009