

APPLICATION FOR PERMIT STATE OFFICE ANALYSIS

by CindyNo.: 95-09005 Name: Doty Date: 4/13/99 Ad OK? ☒ Gvmt Lts: ☒

AREA OF CONCERN: - No/Yes: _____ Mor / _____ GWMA / Trust / Non-trust

PROTESTED: - 020 (Protest Agreement) or *W19 (Order)

SYSTEM COMPLETED:

- > 1 year - 26A-P17
- ≤ 1 year/no proof - P16

GROUNDWATER: (✓ FLO-CH)

DRILLING PERMIT

- All wells (✓ WDQ3) - 046-P23
- In Basin 34? - 085
- Irr. within WD - P05 (new well location)
- WMD (✓ MAP) - North / East / West
- > 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)
- ≤ 0.24 cfs/5 acres - No MD
- WMD
- Supp irr use only - 065-079 (if GW use SW)-(keep SW)-(GW not primary irr source)
- Supp. irr + uses - 100-101
- > 0.24 cfs/5 acres - 01M (report when notified)
- ≤ 0.24 cfs/5 acres - No MD

SURFACE WATER: (✓ FLO-CH) (Surface water that doesn't sink is regulated):

- FISH & GAME CONTACTED: - YES / NO; WHEN: _____ RESPONSE: OK
- IN/ABOVE MSF (✓ MAP) - *WB9
- IN-STREAM DEVELOPMENT - P52 (stream channel alteration)
- WD (✓ MAP & LISTING) - R04 (WD # 95A)
- > 0.20 cfs - 01J-P08 (MD & LD)
- ≤ 0.20 cfs - 01H-P01 (LD), 01P or No MD (in-stream stock)
- WMD (✓ MAP)
- > 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)
- ≤ 0.24 cfs/5 acres - No MD
- SPRINGS/SINK, INACTIVE WD & REST OF STATE
- > 0.24 cfs/5 acres - 01M or No MD (in-stream stock or power)
- ≤ 0.24 cfs/5 acres - No MD

RIVER BASINS: (*Surface water):

- Snake R (01) - *W22-P04, NA
- (02/03-irr) - 007 (w/ remark *WB9 if above Weiser), NA
- Payette R(65) - *W22 (regulated uses), 047-P04 (Payette Lake), NA
- Salmon R (70's) - 029 (fish screens), NA
- Weiser R (67) - 086, 087

USE:

- STORAGE (✓ 3 compo.) - 18A (in & out MD for on-stream storage), 18B-P09 (>10' dam), NA
- IRR ≤ 5 acres - R66/R67/R68/R69 (0.03 cfs/acre + 3.0/3.5/4.0/4.5 AF)
- > 5 acres - R62/R63/R64/R65 (0.02 cfs/acre + 3.0/3.5/4.0/4.5 AF)
- STOCKWATER - R37 (BLM/USFS); NA
- MINING - 054(req) -081-P10
- FISH PROPAGATION - 029(70's only)-007-042(req)-081 (WQ)-P10
- HEATING/COOLING - R07 (injection well)
- POWER - 17H/17K(+uses)-08A-025(P18)-01N-028-081(P10)-027 (if no other cons. use); 17G (FERC) or 17M (FERG); 18B-P09; >25 cfs-P18
- MUNICIPAL
- In restricted area? - 022, 075, 004 (+memo?)
- Irr., GW supp. to SW? - 102

DOMESTIC

- Surface water - *WB5 (Big Wood R or Boise R ↑ Star Bridge); 27A (Payette River); NA
- >1 in rest. area - 071-070
- FIRE PROTECTION - 077

LOCATION:

- BOISE FRONT LOGEO - 058 (<85° GW temp only)
- MITIGATION - 120
- 42-248 AREA - P84 (in 20/30/40/50/60/70/80 (87) basin)
- SWAN FALLS FLAG (✓ Code) -
- Trust - 051-052-053-P74 (Consumptive Uses), NA
- Non-Trust (1) - 048-049 (Consumptive Uses), NA

OWNERSHIP:

- 004 (PD/PU) _____

OTHER CONDITIONS:

- _____

STANDARD REMARKS:

- ① W01/1/epT ② W60/LTS 16-19 N Shore Tr. ③ W59/LT 18

BENEFICIAL USE DUE:

- 4/1/2001

COMMENTS:

- _____

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 95-09005

Priority: December 17, 1998

Maximum Diversion Rate: 0.04 CFS
Maximum Diversion Volume: 1.2 AF

It is hereby certified that MARY LOUISE DOTY
49605 AVILA DR
LA QUINTA CA 92253-2310 has complied with the terms and
conditions of the permit, issued pursuant to Application for Permit dated December 17, 1998; and has
submitted Proof of Beneficial Use on March 26, 2001. An examination indicates that the works have a
diversion capacity of 0.04 cfs of water from:

SOURCE

HAYDEN LAKE

Tributary: SINKS

and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL DIVERSION VOLUME</u>
DOMESTIC	01/01 to 12/31	0.04 CFS	1.2 AF

LOCATION OF POINT(S) OF DIVERSION:

HAYDEN LAKE L2 (NW¼NE¼) Sec. 3, Twp 51N, Rge 03W, B.M. KOOTENAI County

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
51N	03W	3			X														
					L2														

CONDITIONS OF APPROVAL

1. Domestic use is for 1 home.
2. Point of diversion is located within Lot 18 of North Shore Tracts.
3. Place of use is located within Lots 16, 17, and 18 of North Shore Tracts.
4. The issuance of this right does not grant any right-of-way or easement across the land of another.
5. Upon specific notification by the Department, the right holder shall install a lockable device of a type acceptable to the Department in a manner that will provide the watermaster suitable control of the diversion.
6. Use of water under this water right will be regulated by the watermaster of State Water District No. 95A.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed and sealed this 27TH day of NOVEMBER, 2002.

MICROFILMED

MAR 24 2003

Acting for 
KARL J. DREHER
Director

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE STATE OF IDAHO

IN THE MATTER OF PERMIT NO.)
95-09005 IN THE NAME OF) **REINSTATEMENT ORDER**
MARY LOUISE DOTY)
_____)

WHEREAS, the Department issued the above-captioned permit with the condition that proof of construction of works and application of water to beneficial use (proof of beneficial use) be submitted to the Department on or before April 1, 2001; and,

WHEREAS, the Department notified the permit holder on January 31, 2001 by certified mail that proof of beneficial use was due and instructed the permit holder of the steps to be taken to submit the proof of beneficial use or an extension of time request; and,

WHEREAS, the Department sent the permit holder a lapse notice on April 5, 2001, since the Department had not received an acceptable proof of beneficial use statement or extension of time; and,

WHEREAS, Section 42-218a, Idaho Code, provides that the Department may reinstate a permit upon a showing of reasonable cause by the permit holder within sixty days of the date of the notice of lapsing; and,

WHEREAS, the permit holder timely submitted an acceptable proof of beneficial use on March 26, 2001 to the IDWR regional office.

IT IS, THEREFORE, HEREBY ORDERED that Permit No. 95-09005 is **REINSTATED** with no advance in priority.

DATED this 11th day of April, 2001.


L. GLEN SAXTON, Chief
Water Allocation Bureau

MICROFILMED

APR 11 2001

Amt. of Fee \$: 50.00
Receipt No. CM
Receipt By: N/4219
Date Received: 3/20/01

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

RECEIVED

PROOF OF BENEFICIAL USE

APR 06 2001

Department of Water Resources

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner.

1. Permit No. 95-9005 Telephone No. Summer - 208-762-5363
Water 760-771-0013

2. Name of Permit Holder(s):
MARY LOUISE DOTY

3. Mailing Address: 14412

City Hayden Lake State ID. Zip 83835

4. Source of Water: Hayden Lake If **GROUNDWATER** (well), Date Drilled: mo. _____ / yr. _____

Well Driller: _____ Drilling Permit Number: _____

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): 1 Stockwater (No. and type of stock): _____

Irrigation (No. of acres): _____ Other: _____

6. Total rate of diversion and/or volume for which proof is submitted: 0.04 cfs OR _____ acre-feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)

(This question is **not optional**. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device: Is a measuring device required?

Yes _____ or No X

Has the measuring device been installed?

Yes _____ or No X

8. Fee Enclosed: \$ 60.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: THE TRACTOR MAN GORDON GILMORE Telephone Number: 667-2895

Address: BOX 2656 HAYDEN LAKE, ID 83835

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted. I agree to relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: Mary Louise Doty Date: 3-19-01
(include your title, if on behalf of company or organization)

MICROFILMED

APR 11 2001

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 95-09005

Proposed Priority: December 17, 1998 Maximum Diversion Rate: 0.04 CFS

This is to certify, that **MARY LOUISE DOTY**
14200 E HAYDEN LAKE RD
HAYDEN LAKE ID 83835
has applied for a permit to appropriate water from:
HAYDEN LAKE tributary of **SINKS**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
DOMESTIC	01/01 to 12/31	0.04 CFS

LOCATION OF POINT(S) OF DIVERSION: Lot 3(NWNE), Sec. 3, Township 51N, Range 03W
KOOTENAI County

PLACE OF USE: DOMESTIC

TWN RGE SEC

51N 03W 3 Lot 3(NWNE)

CONDITIONS OF APPROVAL AND REMARKS

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before April 1, 2001.
2. Subject to all prior water rights.
3. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which permit holder had no control.
4. Use of water under this water right will be regulated by the watermaster of State Water District No. 95A.
5. Upon specific notification by the Department, the right holder shall install a lockable device of a type acceptable to the Department in a manner that will provide the watermaster suitable control of the diversion.
6. The issuance of this right does not grant any right-of-way or easement across the land of another.
7. Point of diversion is located within Lot 18, North Shore Tracts.
8. Place of use is located within Lots 16-18, North Shore Tracts.
9. Domestic use is for exterior use for 1 home.

MICROFILMED

APR 15 1999


State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 95-09005

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

14th day of April, 1999.

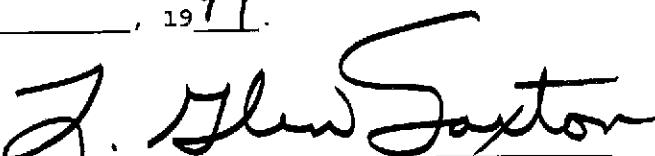
for Karl J. Dreher, Director



MICROFILMED

APR 15 1999

Ident. No. 95-09005

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED
APR 01 1999

To appropriate the public waters of the State of Idaho

Department of Water Resources
(760) 771-0013

1. Name of Applicant Mary Louise Doty Phone (208) 762-5363
Mailing address 14200 E. Hayden Lake Rd., Hayden Lake, Id. 83835

2. Source of water supply Hayden Lake which is a tributary of SINKS

3. Location of point of diversion is Township 51N Range 3W Sec. 3 in the 1/4,
NW 1/4, NE 1/4, Govt. Lot 3, B.M., ROOTENAI County;
additional points of diversion if any: _____

4. Water will be used for the following purposes:
Amount 20 Acre-ft for Domestic purposes from 01/01 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) 0.04 and/or (b) 20
cubic feet per second acre feet per annum

6. Proposed diverting works:
a. Describe type and size of devices used to divert water from the source ONE (1 1/2") POLY PIPE
WITH FOOT VALVE 3HP PUMP 16 GPM
b. Height of storage dam N/A feet; active reservoir capacity N/A acre-feet; total
reservoir capacity N/A acre-feet
c. Proposed well diameter is N/A inches; proposed depth of well is N/A feet
d. Is ground water with a temperature of greater than 85°F being sought? No
e. If well is already drilled, when? N/A; Drilling firm N/A
Well was drilled for (well owner) N/A; Drilling Permit No. N/A

7. Time required for completion of works and application of water to proposed beneficial use is 2 years (minimum 1 year)

8. Description of proposed uses (if irrigation only, go to item 9):
a. Hydropower; show total feet of head and proposed capacity in KW. _____
b. Stockwatering; list number and kind of livestock. _____
c. Municipal; show name of municipality. _____
d. Domestic; show number of households. LANE + GARDEN IRRIGATION ONLY
e. Other; describe fully. _____

MICROFILMED

APR 15 1999

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	N E				N W				S W				S E				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
5N	3W	3		D															
				GOVT LOT 3															

Total number of acres to be irrigated 1/4 ACRE

10. Describe any other water rights used for the same purposes as described above. _____

11. a. Who owns the property at the point of diversion? State of Idaho
- b. Who owns the land to be irrigated or place of use? Mary Louise Doty
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Remarks: _____


13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

MICROFILMED
APR 15 1999

Mary Louise Doty
Signature of Applicant (and title, if applicable)

Received by cm Date 12-17-98 Time 12:33 p.m. Preliminary check by [Signature]
 Fee \$ 50.00 Received by cm # N012569 Date 12-17-98
 Publication prepared by cd Date 1/28/99 Published in COA Press 2/17/99
 Publication approved cd Date 2/12/99

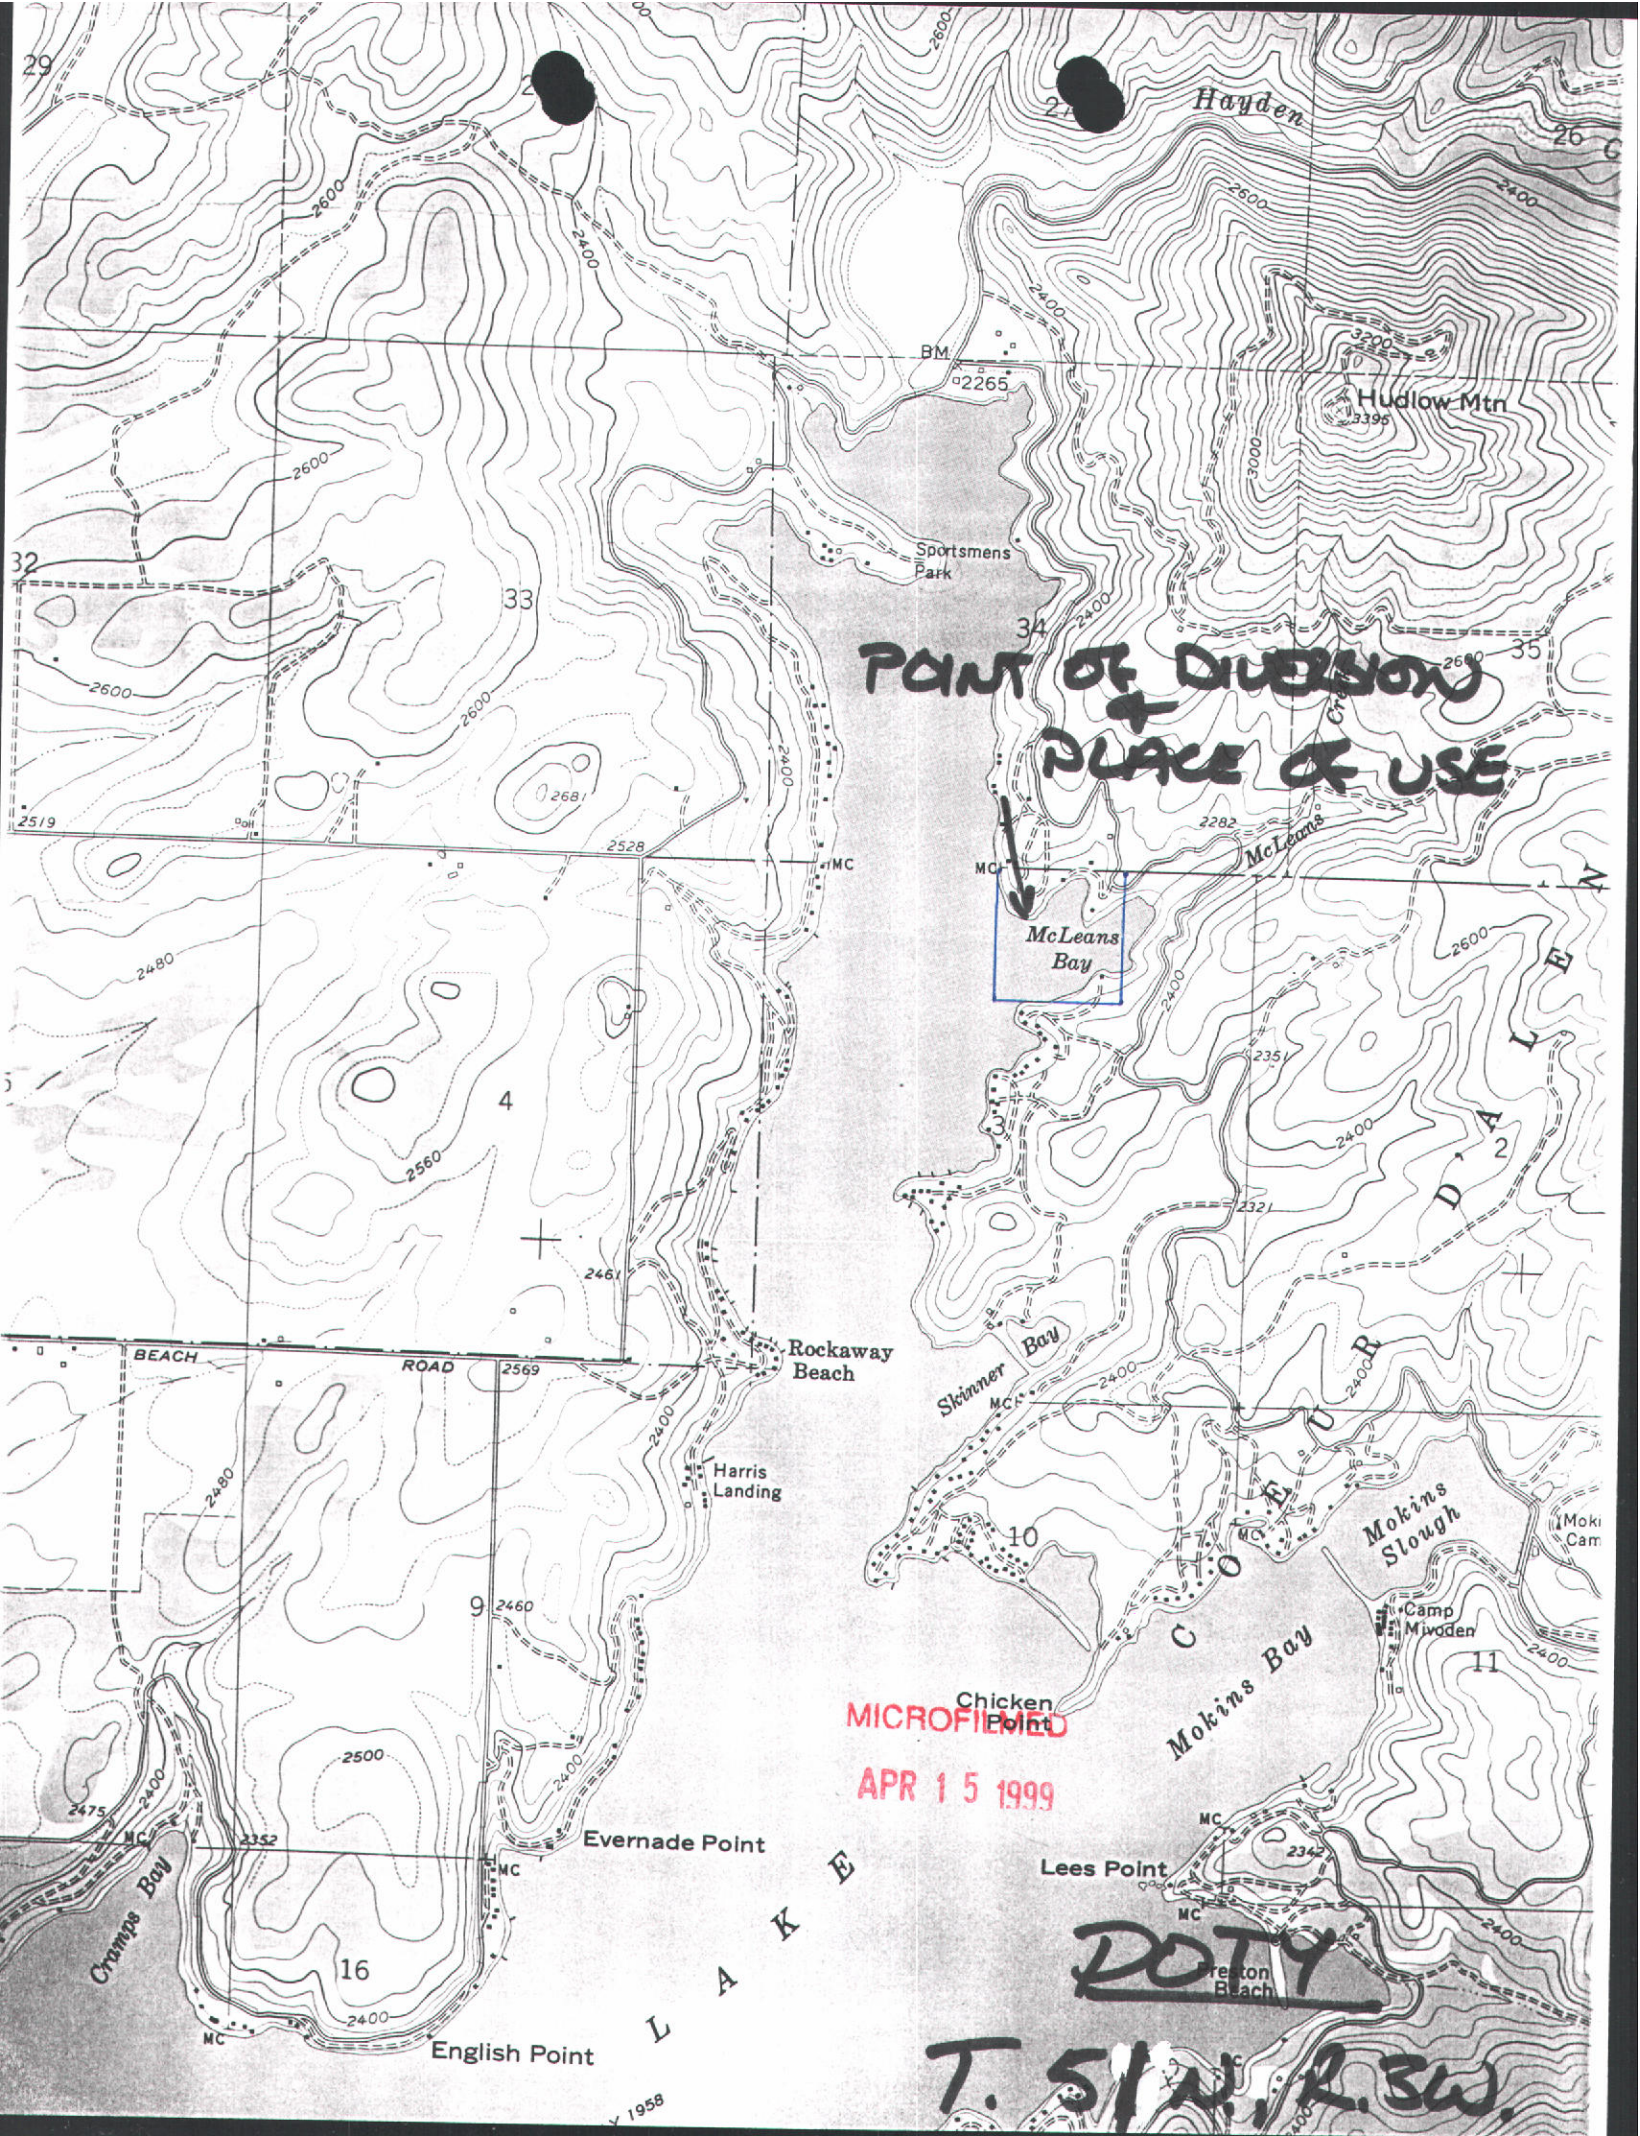

POINT OF DIVERSION
PLACE OF USE

McLeans Bay

MICROFILMED
APR 15 1999

DOTY

T. 51 N. R. 36 W.

OCT. -13' 9" (MON) 11:37


ALLIANCE ESCROW

TE 08 666 0169

P.008


ENCE
ODE 85

R SYSTEM
TOWNSHIP

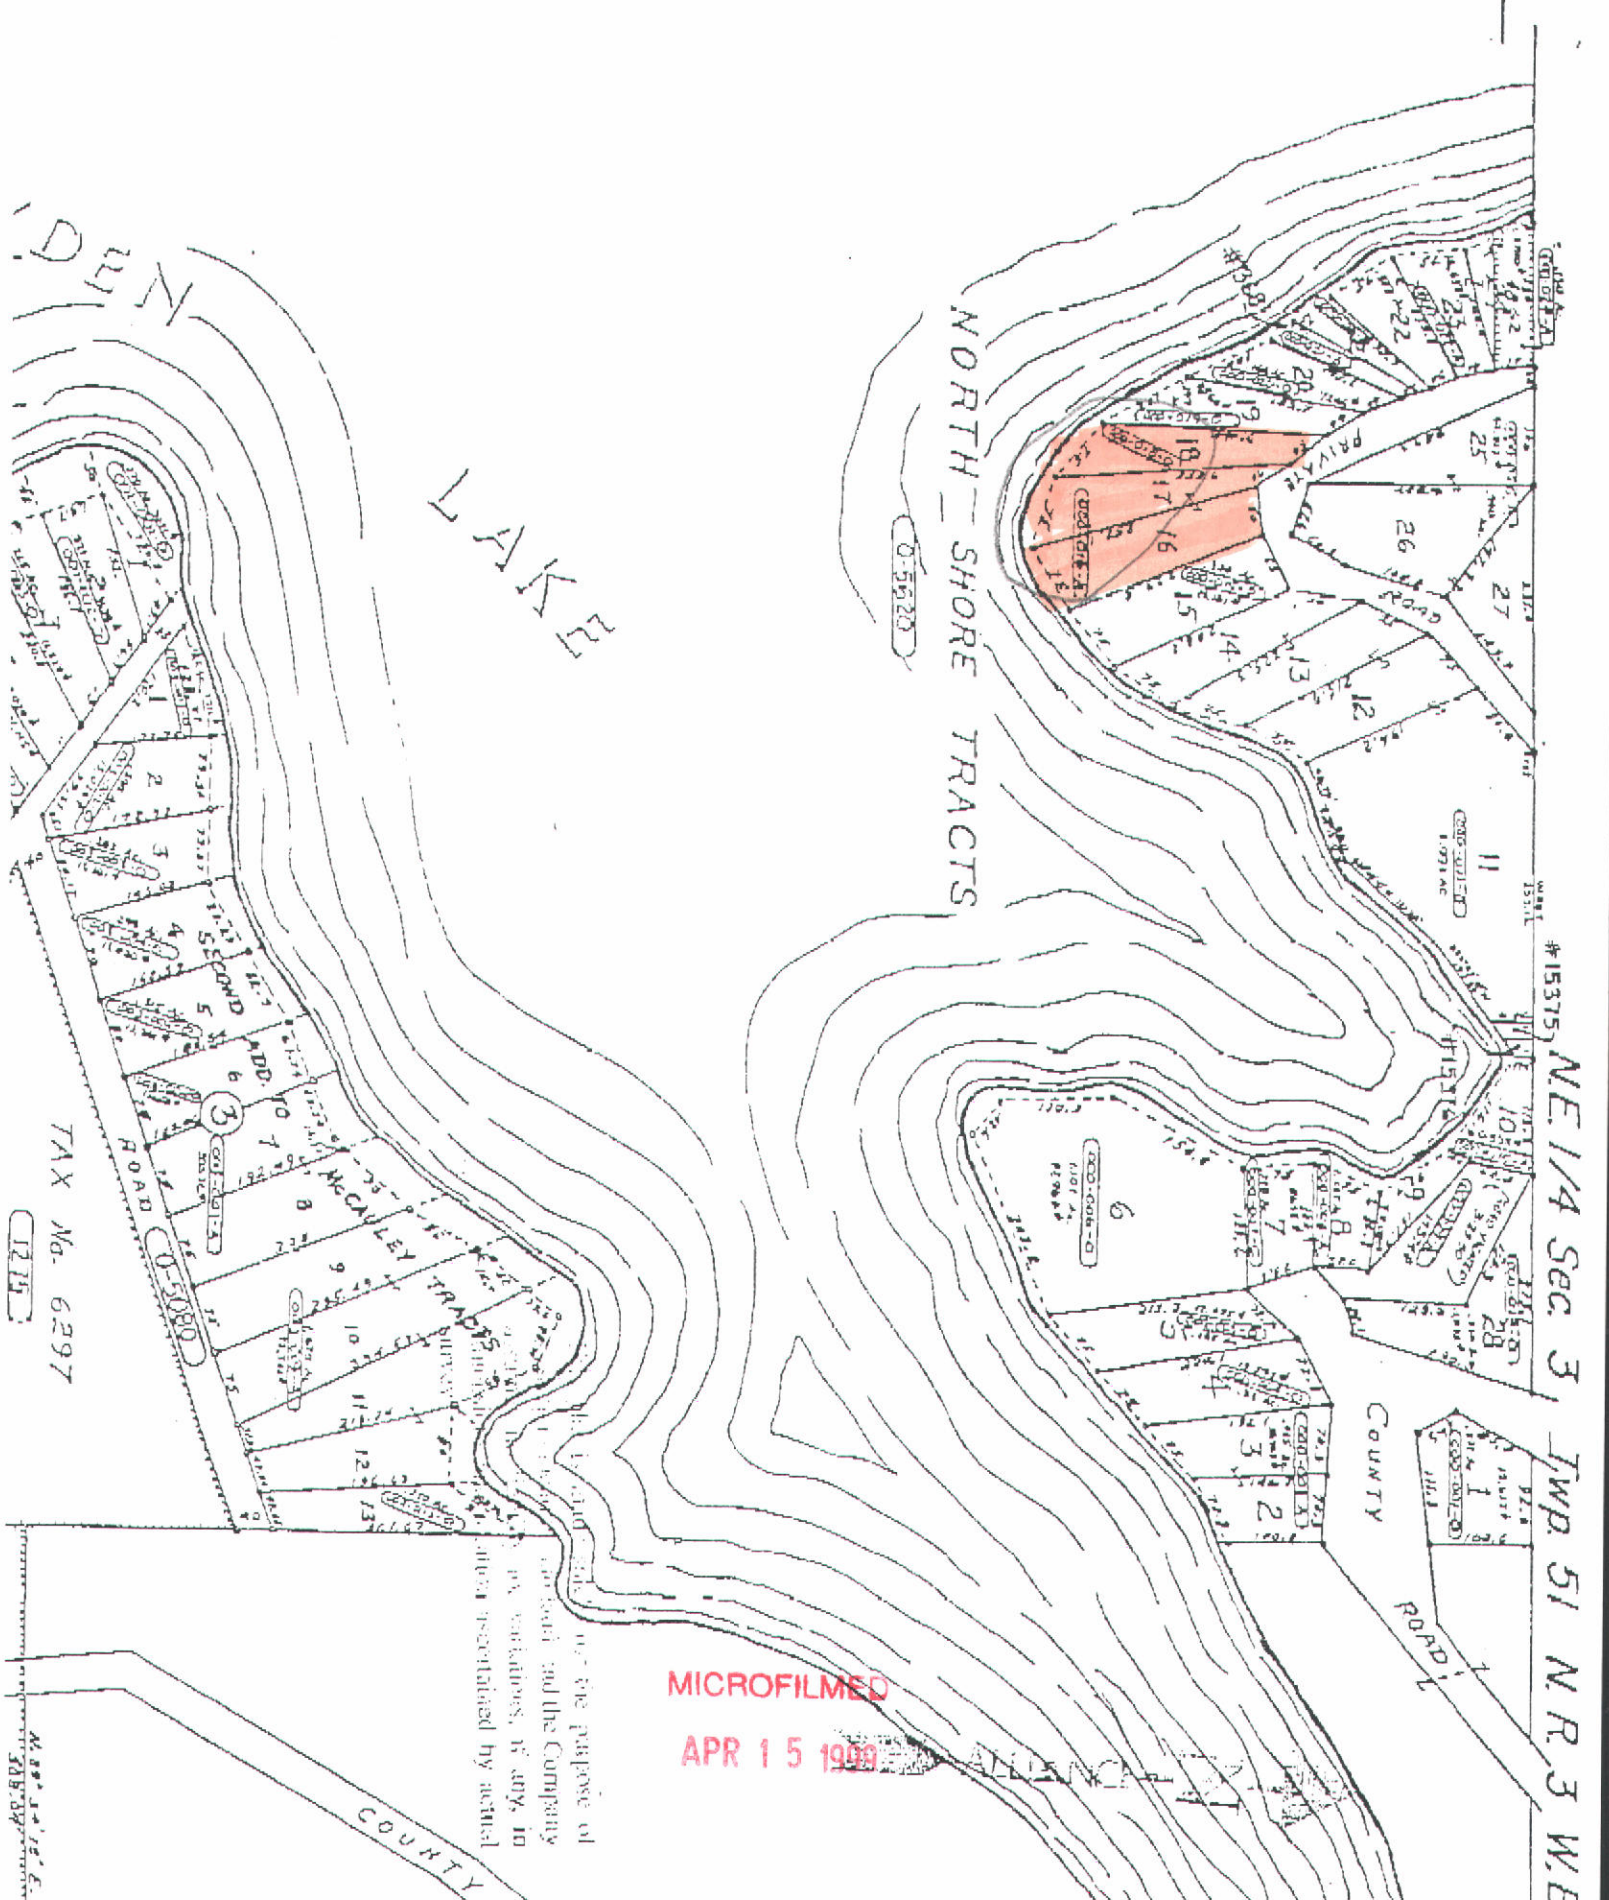

MICROFILMED
APR 15 1999


#15375 NE 1/4 Sec. 3 Twp 51 N.R. 3 W.B.

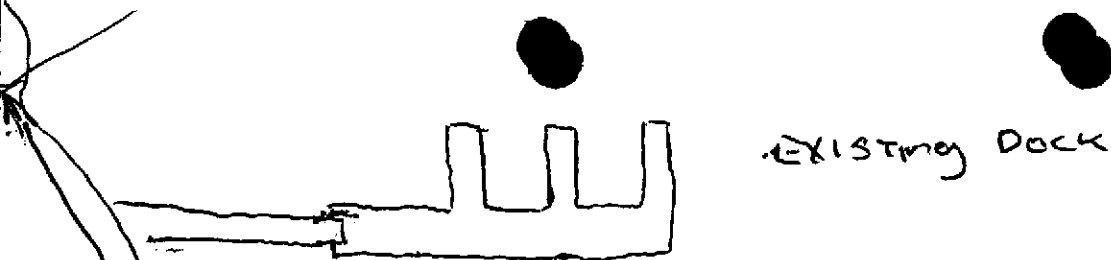


LOT 17 75'

LOT 18 75'

HAYDEN LAKE
HAYDEN ID.
KOOTENAI CO.

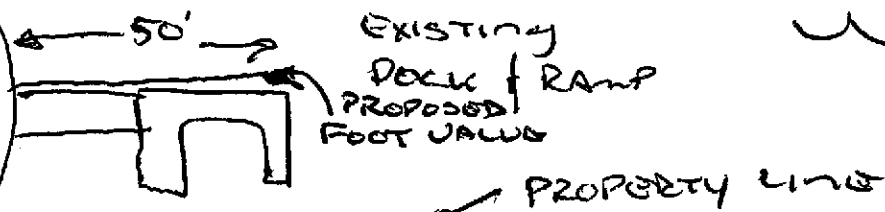

EXISTING DOCK & RAMP

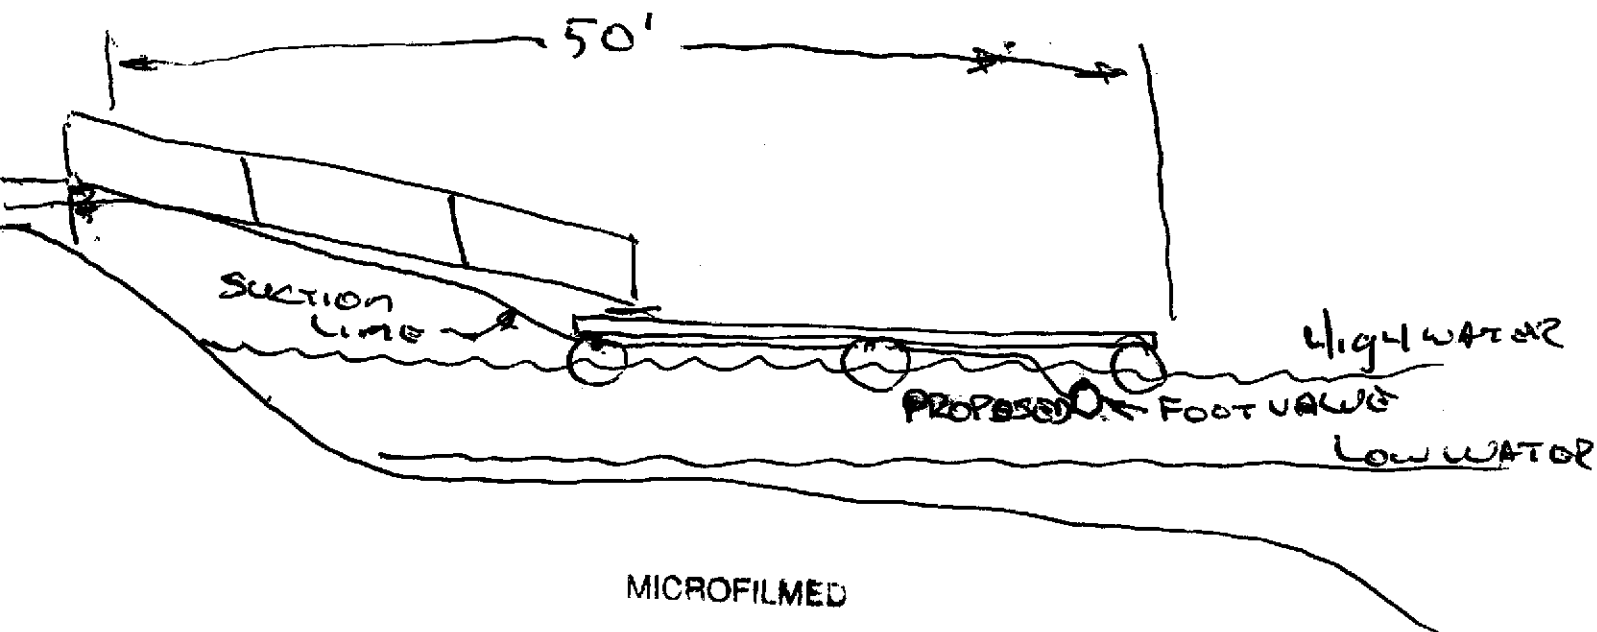

MICROFILMED

APR 15 1999

Vol. 103 West of the Boise

APR 15 1999

MEMORANDUM

Date: November 26, 2002
To: Water Right File 95-9005
From: S. Keen *SK*
Re: License Review

License review and data entry by S. Keen on 11/26/2002.


Place of use and point of diversion are in Govt. Lot 2, not in Govt. Lot 3. I confirmed this from the GCDB in ArcView and on the govt. plat. No amendment is necessary because the NWSE is still applicable.

MICROFILMED

MAR 24 2003

MAR 24 2003

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate well size/ditch size/pipe I.d. as applicable.

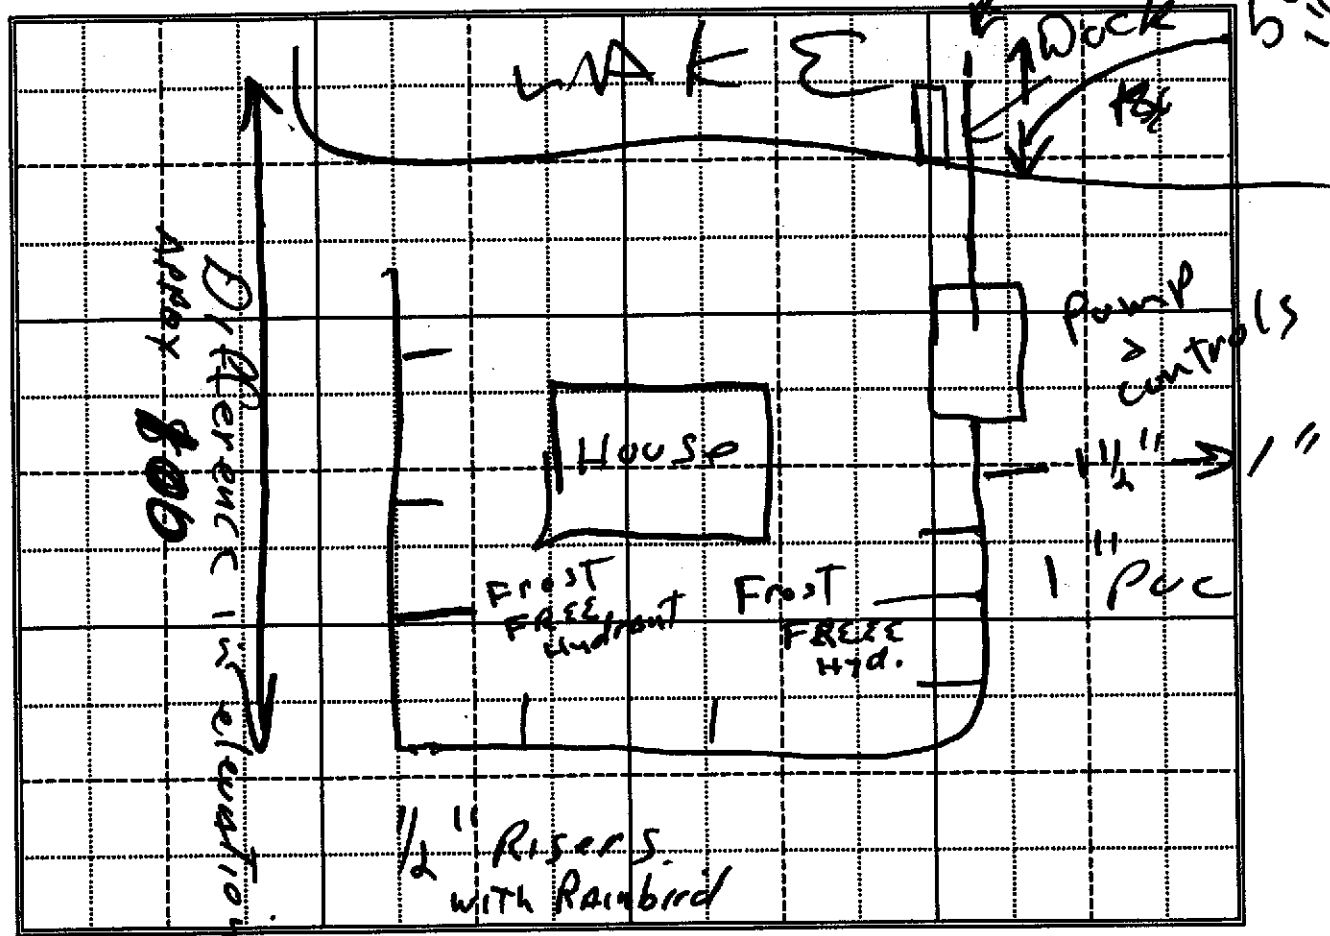

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Baldor	2	36409-201	Baldor	1 1/2

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.


Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

MICROFILMED

MAR 2 1977

95-09005

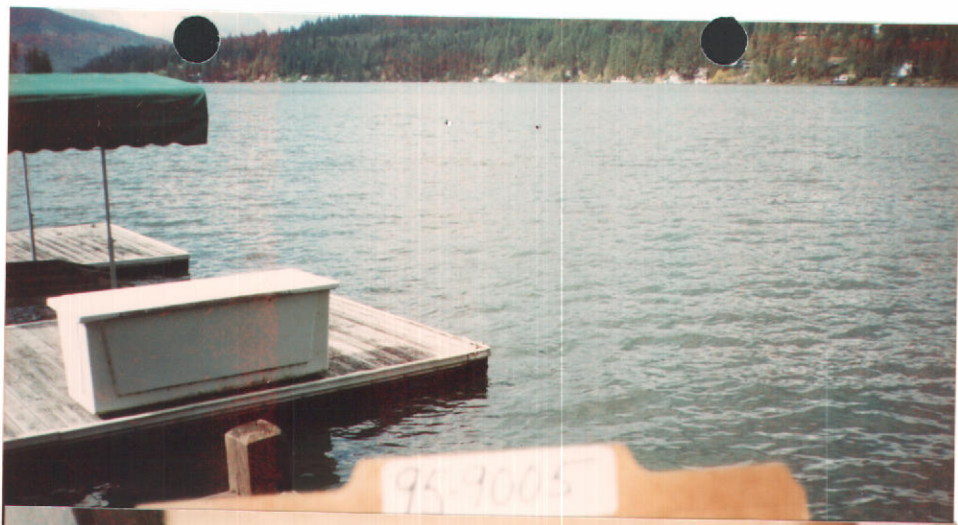

pu



pump




pu



pu

MICROFILMED
MAR 24 2003

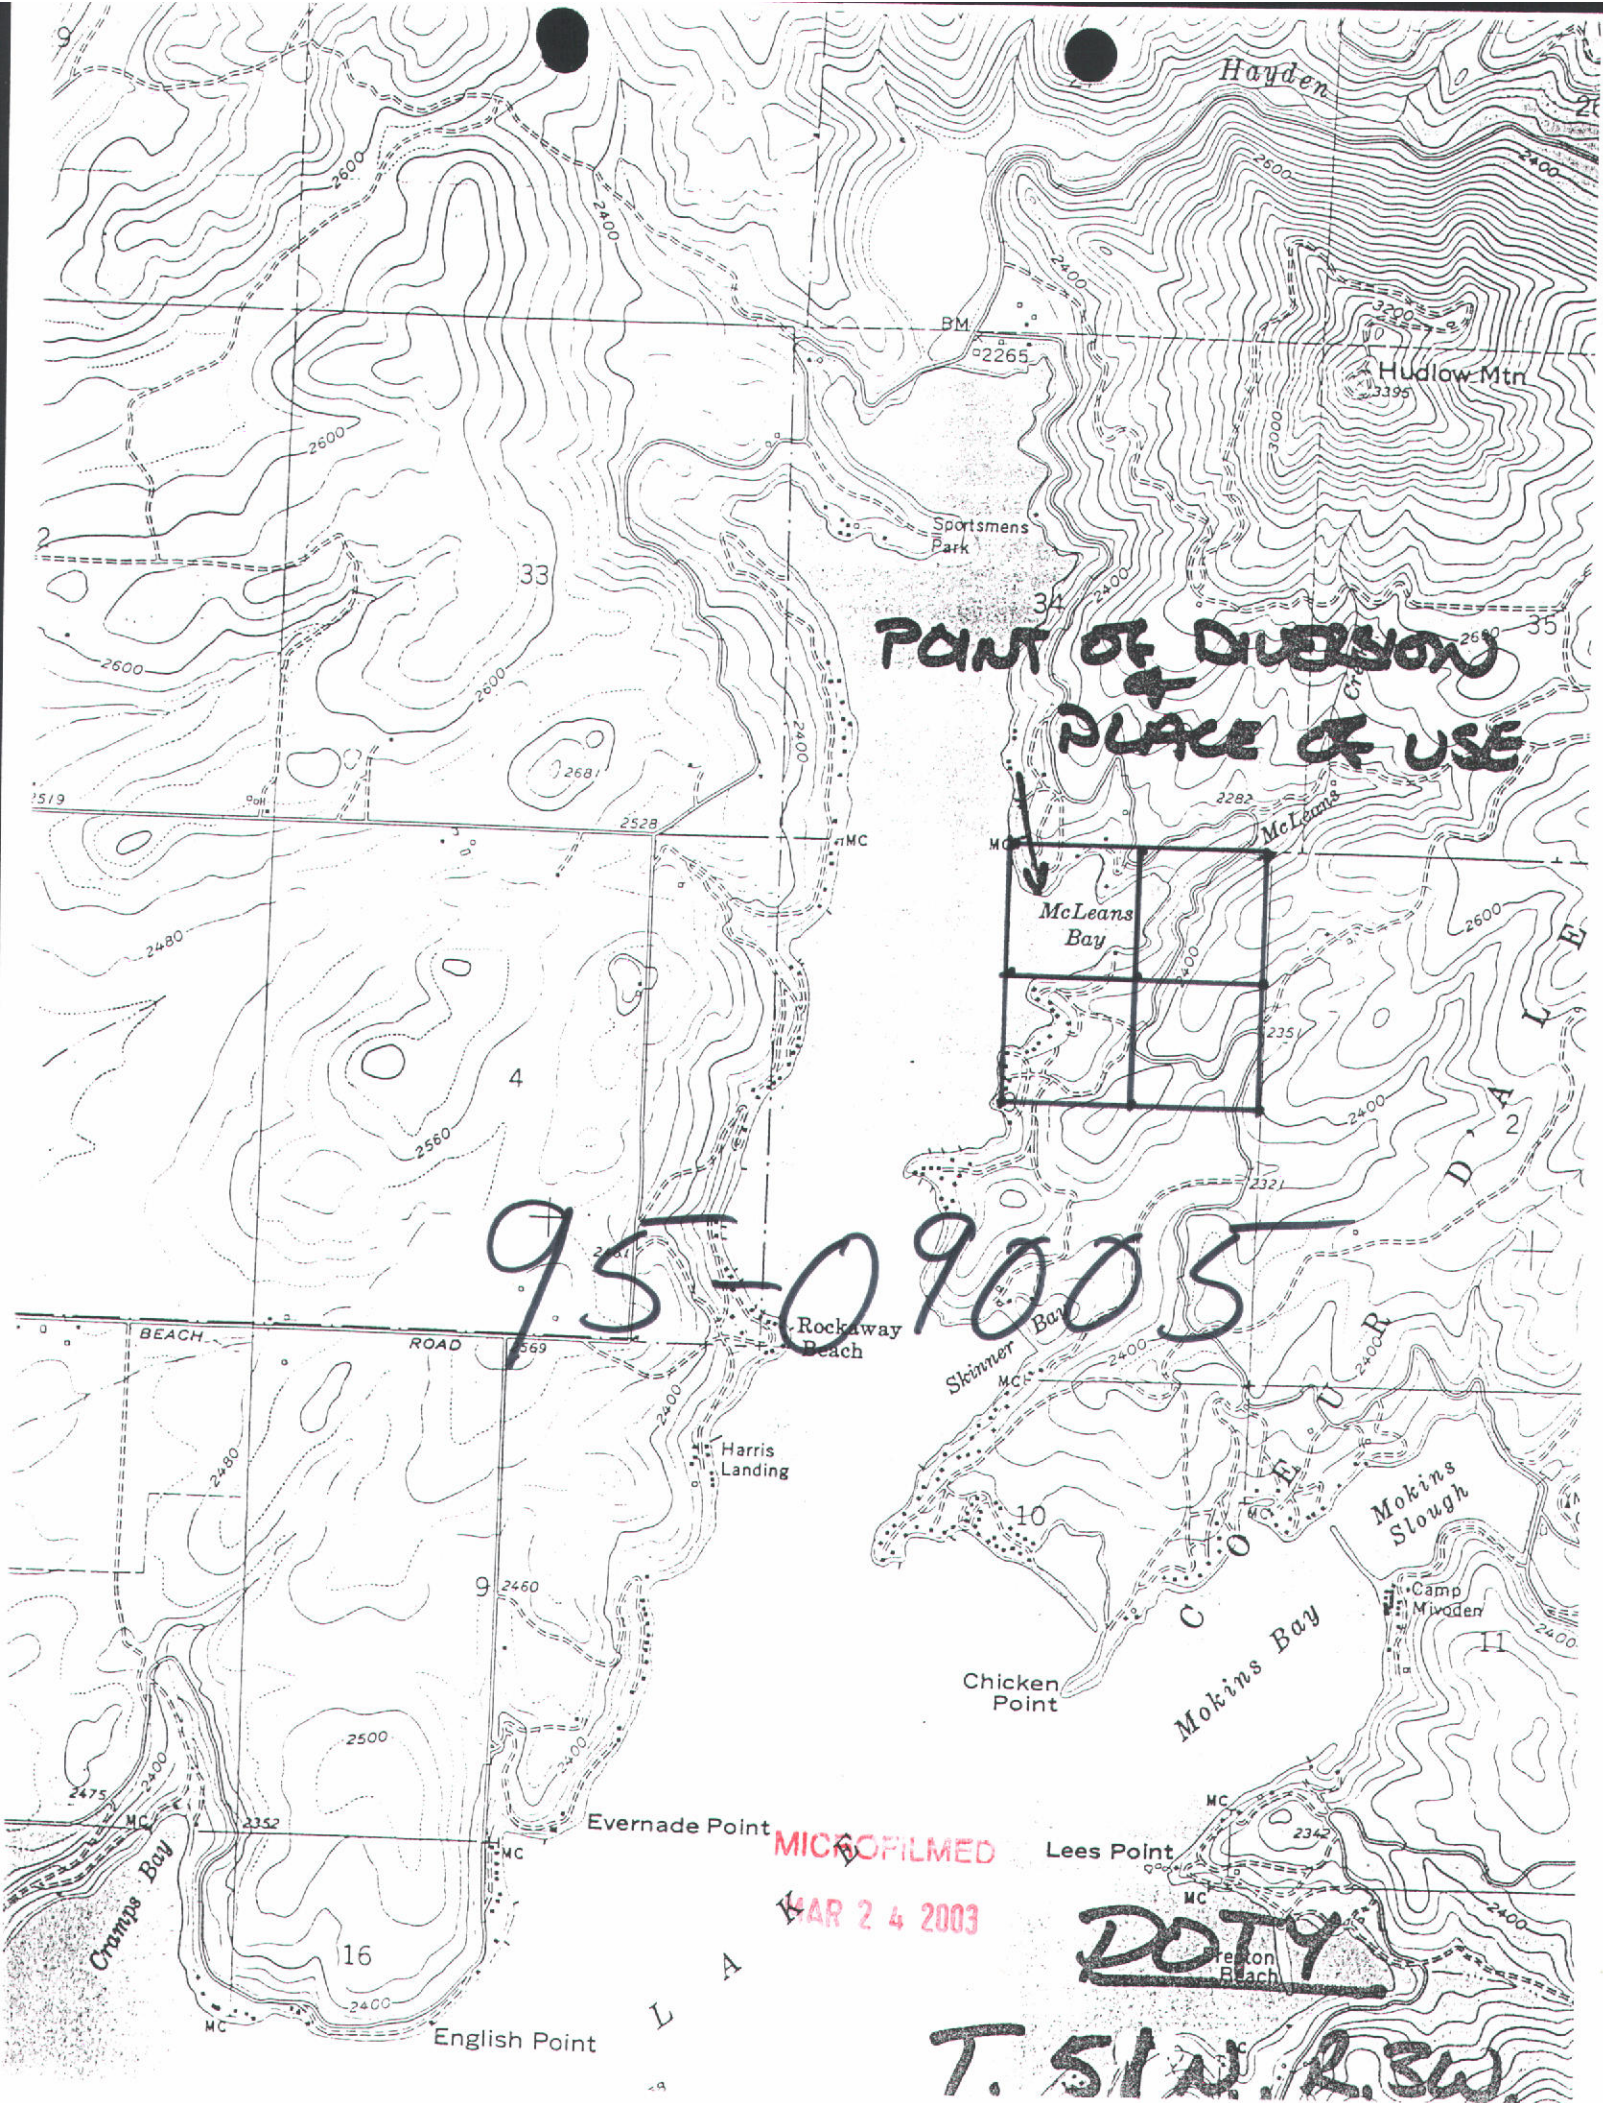

E. NARRATIVE/REMARKS/COMMENTS

The pump & controls are located in an enclosure that is kept locked. A key to this hangs in a place known to the water master (condition #5)

Prior to doing exam I spoke with Gordon Gilmore (installed system). He gave me system operating pressure and other info

Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED

MAR 24 2003

F. FLOW CALCULATIONS

Measured Method:

Additional Computation Sheets Attached

$$\frac{\text{Theoretical } 8.8(0.7)(2)}{100(2.31 \times 65)} = \frac{12.32}{250.15} = .049$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{\hspace{2cm}}$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{\hspace{2cm}}$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}}$$

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic	01-01	12-31	0.04	0.6
Totals:			1.04	0.6

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name Wayne Ballard Date 07-26-02

Reviewer _____ Date _____

SEAL

MICROFILM

MAR 24 2003

ANALYSIS SHEET FOR PROOF OF BENEFICIAL USE

Permit No.: 95-9005

Reviewed By: dgibson

Date: April 10, 2001

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Proof received timely?	X		Drilling permit required?		X
License examination fee required?	X		Drilling permit No.:		
Appropriate fee submitted?	X		Drilling permit upgrade needed?		
Receipt No.:		N014219	Well driller's report filed?		X
Additional Amount Due:			Measuring device required?		X
Name and address same as permit?		X	Measuring device installed?		
Are the water uses correct?	X		Measure device waiver requested?		

Priority Calculation

Date proof received		03/26/2001
Date proof due	-	04/01/2001
Lapse notice sent	-	
No. of days late	=	0
Holiday allowance	+	
Priority date	+	12/17/1998
New priority date	=	12/17/1998

Deficiencies of Actions Items

Acknowledge proof. Lapse notice sent, but fee and proof was received in regional office before due date. Reinstatement not necessary, because no change in priority date.

APPLICATION FOR PERMIT STATE OFFICE ANALYSIS

by *Cindy*No.: 95-09005 Name: Doty Date: 4/13/99 Ad OK? ☒ Gvmt Lts: ☒

AREA OF CONCERN: - No/Yes: _____ Mor / _____ GWMA / Trust / Non-trust

PROTESTED: - 020 (Protest Agreement) or *W19 (Order)

SYSTEM COMPLETED:

- > 1 year - 264-P17
- ≤ 1 year/no proof - P18

GROUNDWATER: (✓ FLO-CH)

DRILLING PERMIT

- All wells (✓ WDQ3) - 046-P23
- In Basin 34? - 085
- Irr. within WD - P05 (new well location)
- WMD (✓ MAP) - North / East / West
- > 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)
- ≤ 0.24 cfs/5 acres - No MD
- WMD
- Supp irr use only - 065-079 (if GW use SW)-(keep SW)-(GW not primary irr source)
- Supp. irr + uses - 100-101
- > 0.24 cfs/5 acres - 01M (report when notified)
- ≤ 0.24 cfs/5 acres - No MD

SURFACE WATER: (✓ FLO-CH) (Surface water that doesn't sink is regulated):

- FISH & GAME CONTACTED: - YES / NO; WHEN: _____ RESPONSE: OK
- IN/ABOVE MSF (✓ MAP) - *WB9
- IN-STREAM DEVELOPMENT - P62 (stream channel alteration)
- WD (✓ MAP & LISTING) - R02 (WD # 95A)
- > 0.20 cfs - 01J-P08 (MD & LD)
- ≤ 0.20 cfs - 01H-P01 (LD), 01P or No MD (in-stream stock)
- WMD (✓ MAP)
- > 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)
- ≤ 0.24 cfs/5 acres - No MD
- SPRINGS/SINK, INACTIVE WD & REST OF STATE
- > 0.24 cfs/5 acres - 01M or No MD (in-stream stock or power)
- ≤ 0.24 cfs/5 acres - No MD

RIVER BASINS: (*Surface water):

- Snake R (01) - *W22-P04, NA
- (02/03-irr) - 007 (w/ remark *WB9 if above Weiser), NA
- Payette R(65) - *W22 (regulated uses), 047-P04 (Payette Lake), NA
- Salmon R (70's) - 029 (fish screens), NA
- Weiser R (67) - 086, 087

USE:

- STORAGE (✓ 3 compo.) - 18A (in & out MD for on-stream storage), 18B-P09 (>10' dam), NA
- IRR ≤ 5 acres - R66/R67/R68/R69 (0.03 cfs/acre + 3.0/3.5/4.0/4.5 AF)
- > 5 acres - R62/R63/R64/R65 (0.02 cfs/acre + 3.0/3.5/4.0/4.5 AF)
- STOCKWATER - R37 (BLM/USFS); NA
- MINING - 054(req) -081-P10
- FISH PROPAGATION - 029(70's only)-007-042(req)-081 (WQ)-P10
- HEATING/COOLING - R07 (injection well)
- POWER - 17H/17K(+uses)-08A-025(P18)-01N-028-081(P10)-027 (if no other cons. use); 17G (FERC) or 17M (FERC); 18B-P09; >25 cfs-P18
- MUNICIPAL
- In restricted area? - 022, 075, 004 (+memo?)
- Irr., GW supp. to SW? - 102
- DOMESTIC
- Surface water - *WB5 (Big Wood R or Boise R ↑ Star Bridge); 27A (Payette River); NA
- >1 in rest. area - 071-070
- FIRE PROTECTION - 077

LOCATION:

- BOISE FRONT LOGEO - 058 (<85° GW temp only)
- MITIGATION - 120
- 42-248 AREA - P84 (in 20/30/40/50/60/70/80 (87) basin)
- SWAN FALLS FLAG (✓ Code) -
- Trust - 051-052-053-P74 (Consumptive Uses), NA
- Non-Trust (1) - 048-049 (Consumptive Uses), NA

OWNERSHIP:

- 004 (PD/PU)

OTHER CONDITIONS:

STANDARD REMARKS: - ① W01/1/4/T ② W60/LTS 16-19 N Shore Tr. ③ W59/LT 18BENEFICIAL USE DUE: - 2/1/2001

COMMENTS:

IDAHO DEPARTMENT OF WATER RESOURCES
APPROXIMATION APPLICATION ANALYSIS SHEET

RECEIVED
WRI
BCA
WRA

APR 01 1999

APPLICATION # 95-09005

INITIAL REVIEW

DEPARTMENT OF WATER RESOURCES

APPLICANT: DOTY BY: AS DATE: 12/17/98

ITEM REQUIRED INFORMATION

1. (X) Name and Address
2. (X) Source
3. (X) Point of Diversion & County
4. (X) Quantity
 - (X) Nature of Proposed Use
 - (X) Period of Use
5. (X) Total Quantity
6. (X) Description of diverting works
7. (X) Time required for b/u
8. (X) Proposed use
9. (X) Place of use or acres irrigated
10. (X) Other water Rights
11. (X) Ownership
12. (X) Map
 - (X) Signature
 - (X) Fee (Amt, receipt, acknowledgement)

*** Send info sheet Y () N ()

ADDITIONAL INFORMATION

(Yes) (No)

- X Field check: by _____
- X Field report attached
- X Analysis Supp. attached (>5cfs/500af)
- X Water delivered by water master?
- Water District # 95A

PROCESSING

(Yes) (No) PRIORITY DATE: 12/17/98

X (Include Moratorium Remark)

X Statewide Advertising: (Diversion rate greater than 10 cfs or 1,000 af).

ADVERTISE IN: KOOTENAI County

LETTERS SENT REQUESTING:

- () Dam Information () Fish Information
- () Power Information () Other: N/A

INFORMATION RECEIVED:

- () Dam Information () Fish Information
- () Power Information () Other: N/A

GROUNDWATER SECTION

WD Permit No.'s:	Type:	Fees	Receipt No.	Upgrade Needed?
_____	Dom. _____ Non-Dom. _____	Paid \$ _____	_____	Y () N ()
_____	Dom. _____ Non-Dom. _____	Paid \$ _____	_____	Y () N ()
_____	Dom. _____ Non-Dom. _____	Paid \$ _____	_____	Y () N ()

- X Groundwater management area
- X Critical ground water area
- X Well Drilling Permit required
- X Well Drilling Application and Fees received
- X Well Drilling Application approved?

Remarks: _____

FINAL REGIONAL PROCESSING/REVIEW

(Yes) (No)

- X Notice of pending void order issued. Final order response date: 1/1/99
- X Further information required from applicant
- X Affidavit of publication received
- X Application published correctly. If not, record action taken: _____

- X Publication dates and paper recorded on application | Sr. Agent initial AS
- X Protests received, Final protest date: 2/22/99
- X Measuring device required
- X Measuring port required
- X Special conditions:

Special conditions of approval supplement and/or cover letter attached:

Approval Recommended by: AS

Date: 3/29/99

Memorandum

RECEIVED

APR 01 1999

Date: March 29, 1999

Department of Water Resources

To: Application for Permit Number 95--0905

From: Beardslee

~~~~~  
The Norther Regional Office has contacted the Panhandle Region of Fish and Game regarding the approval of this Water Right Application for Permit.

After discussing the location, source and uses of water, Chip Corsi stated that he did not see a problem with approving this filing.

MICROFILMED  
APR 15 1999