



WELBORN'S LAND SURVEYING, INC. P.S.
 E. 7011 SECOND AVE.
 SPOKANE, WASHINGTON 99212
 (509) ~~926-5959~~
 924-3444

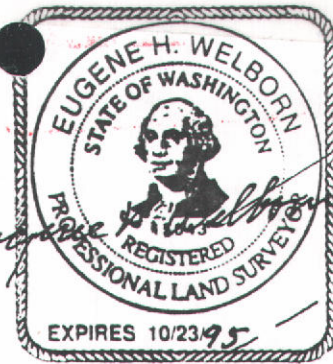


PLEASANT VIEW
 HOMESITES

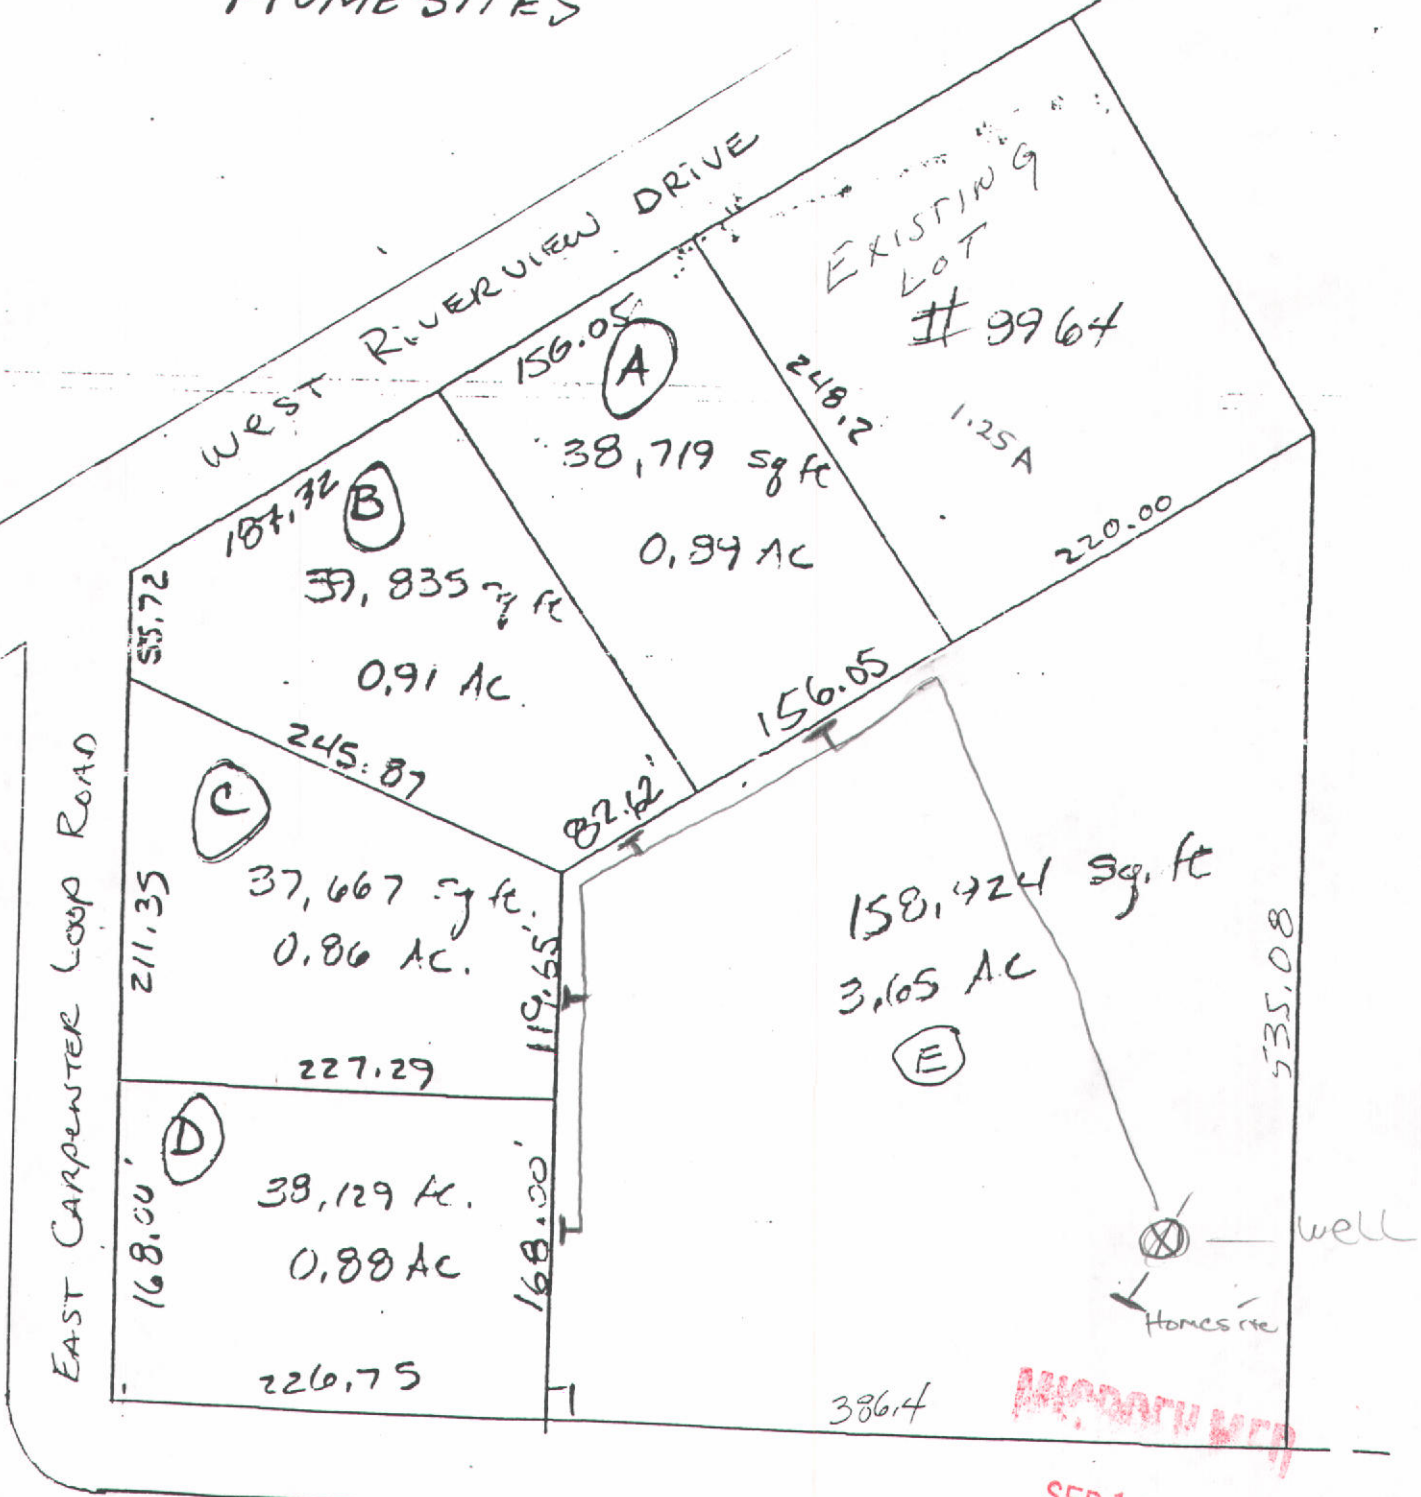

SEP 12 1994

PTN SE 1/4 of SE 1/4 Sec. 7 T2N 50N R. 5W.

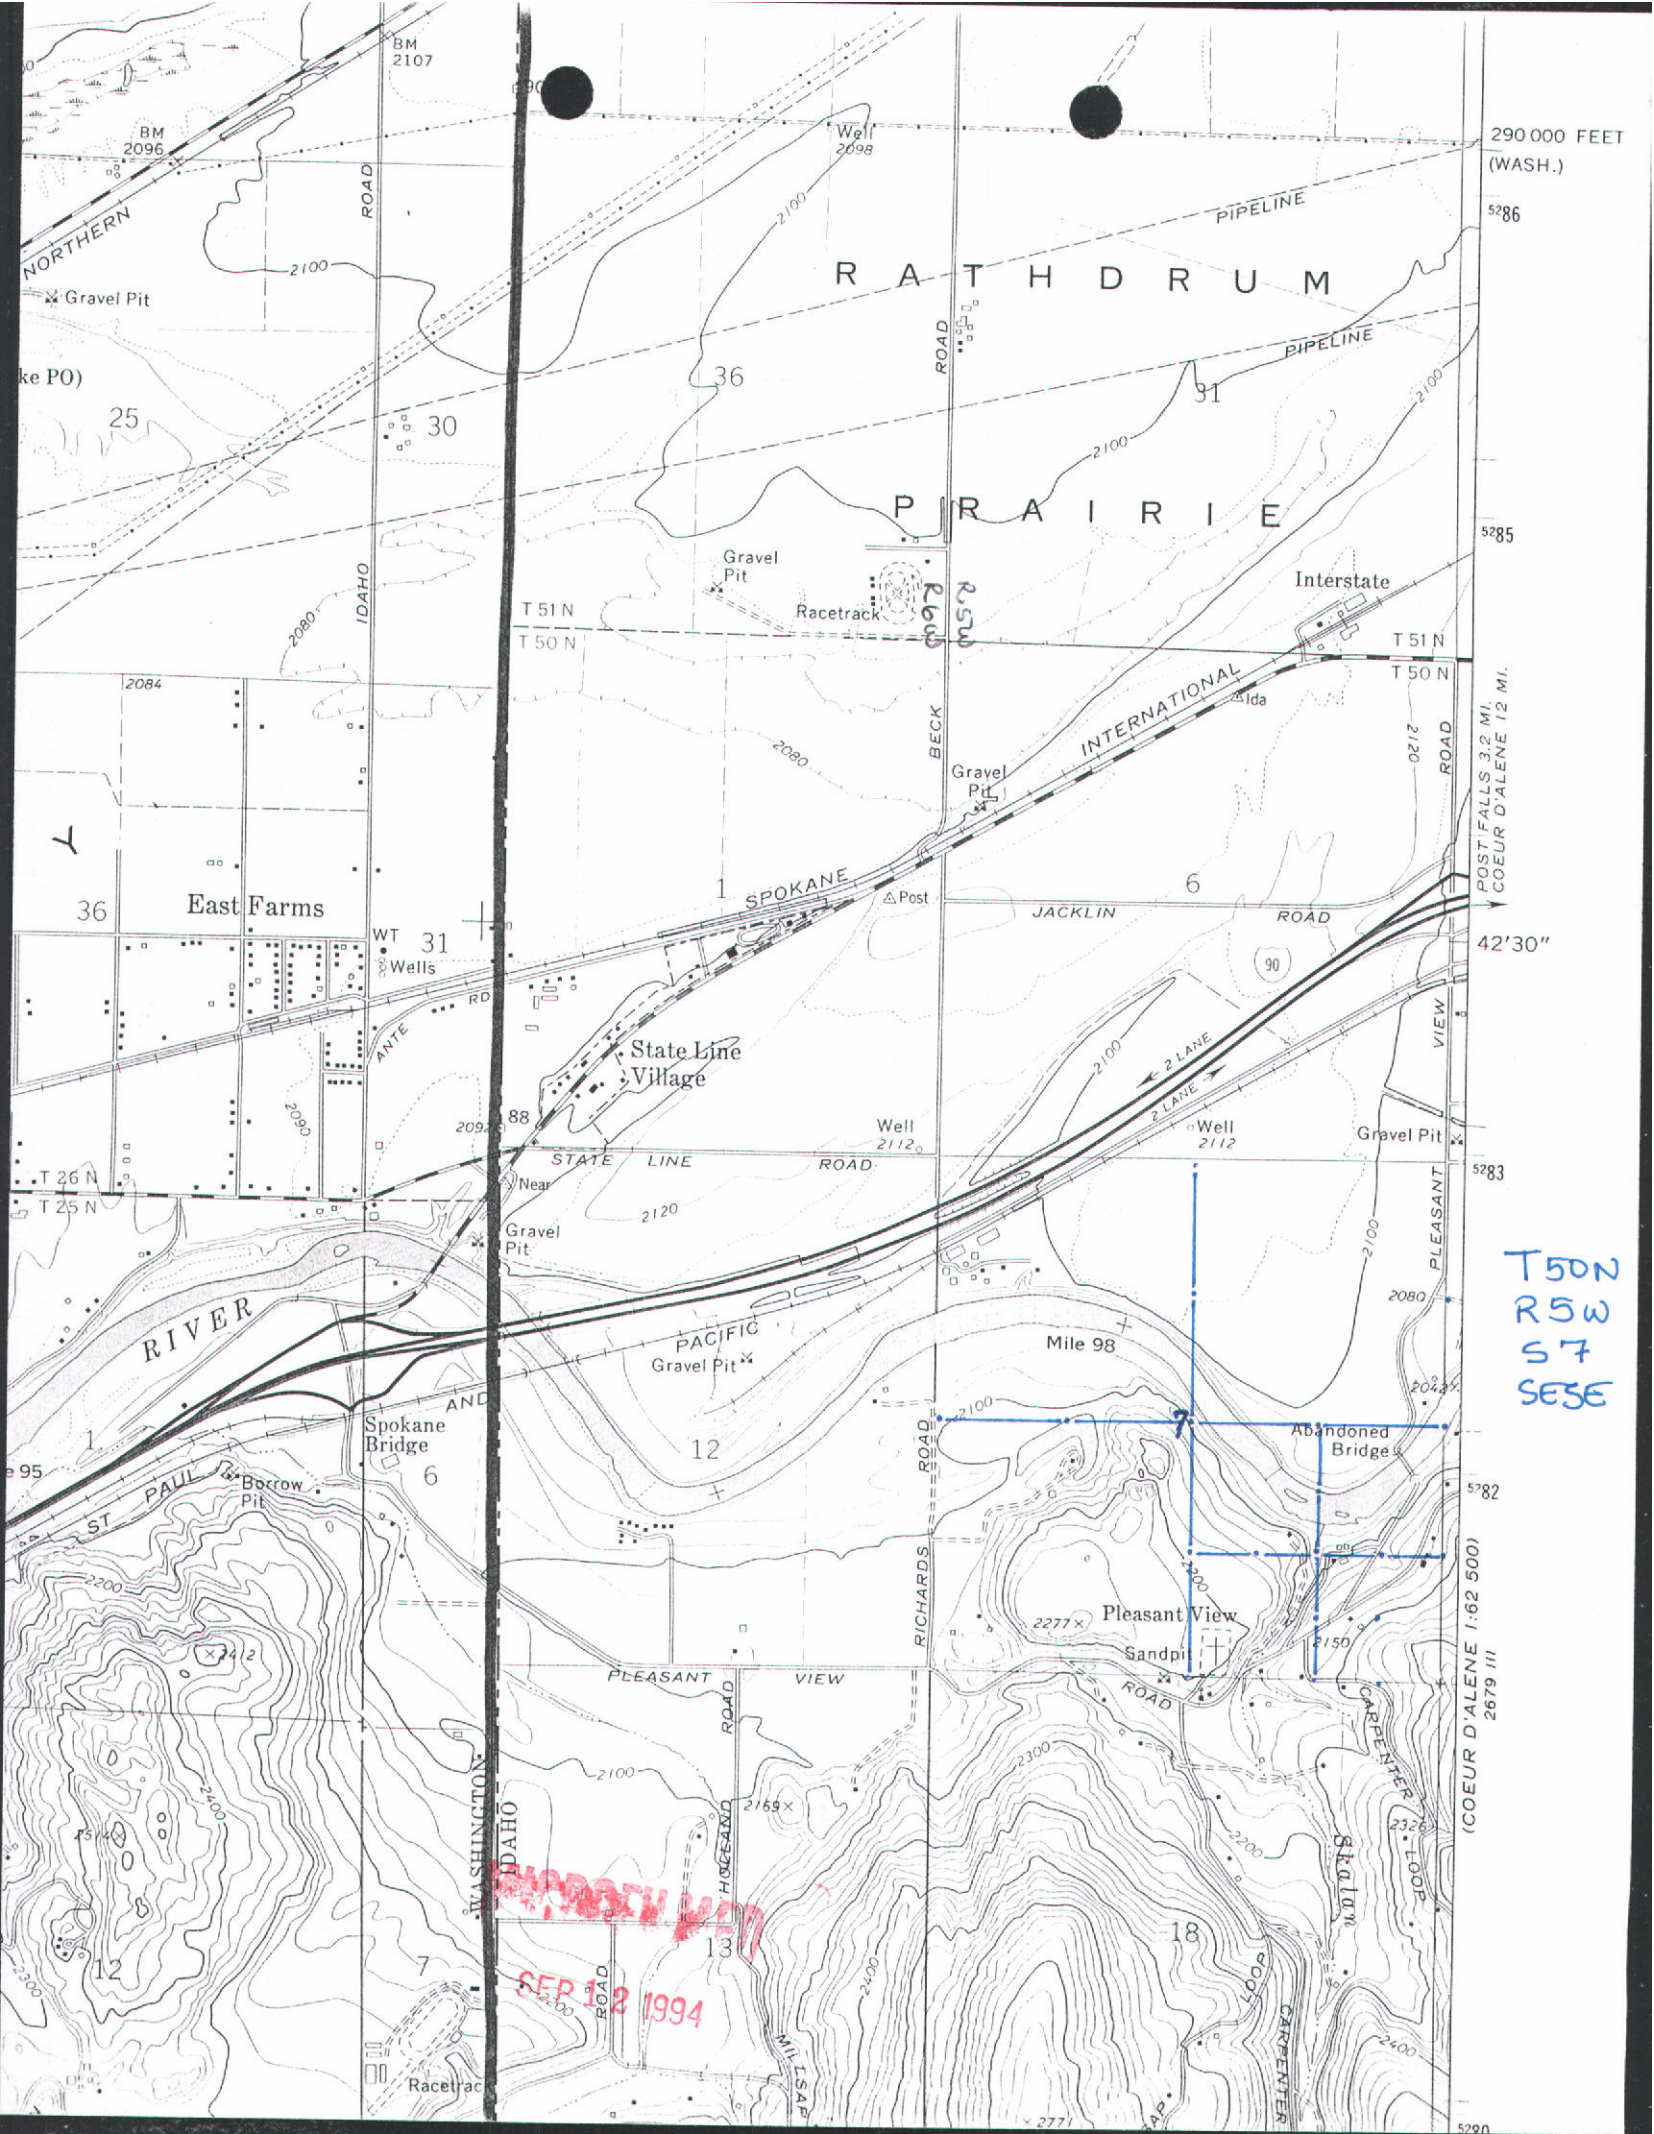

RATHDRUM

PIRAIRIE

East Farms

State Line Village


Pleasant View

T50N
R5W
S7
SESE

SEP 12 1994

(WASH.)

50N
5W

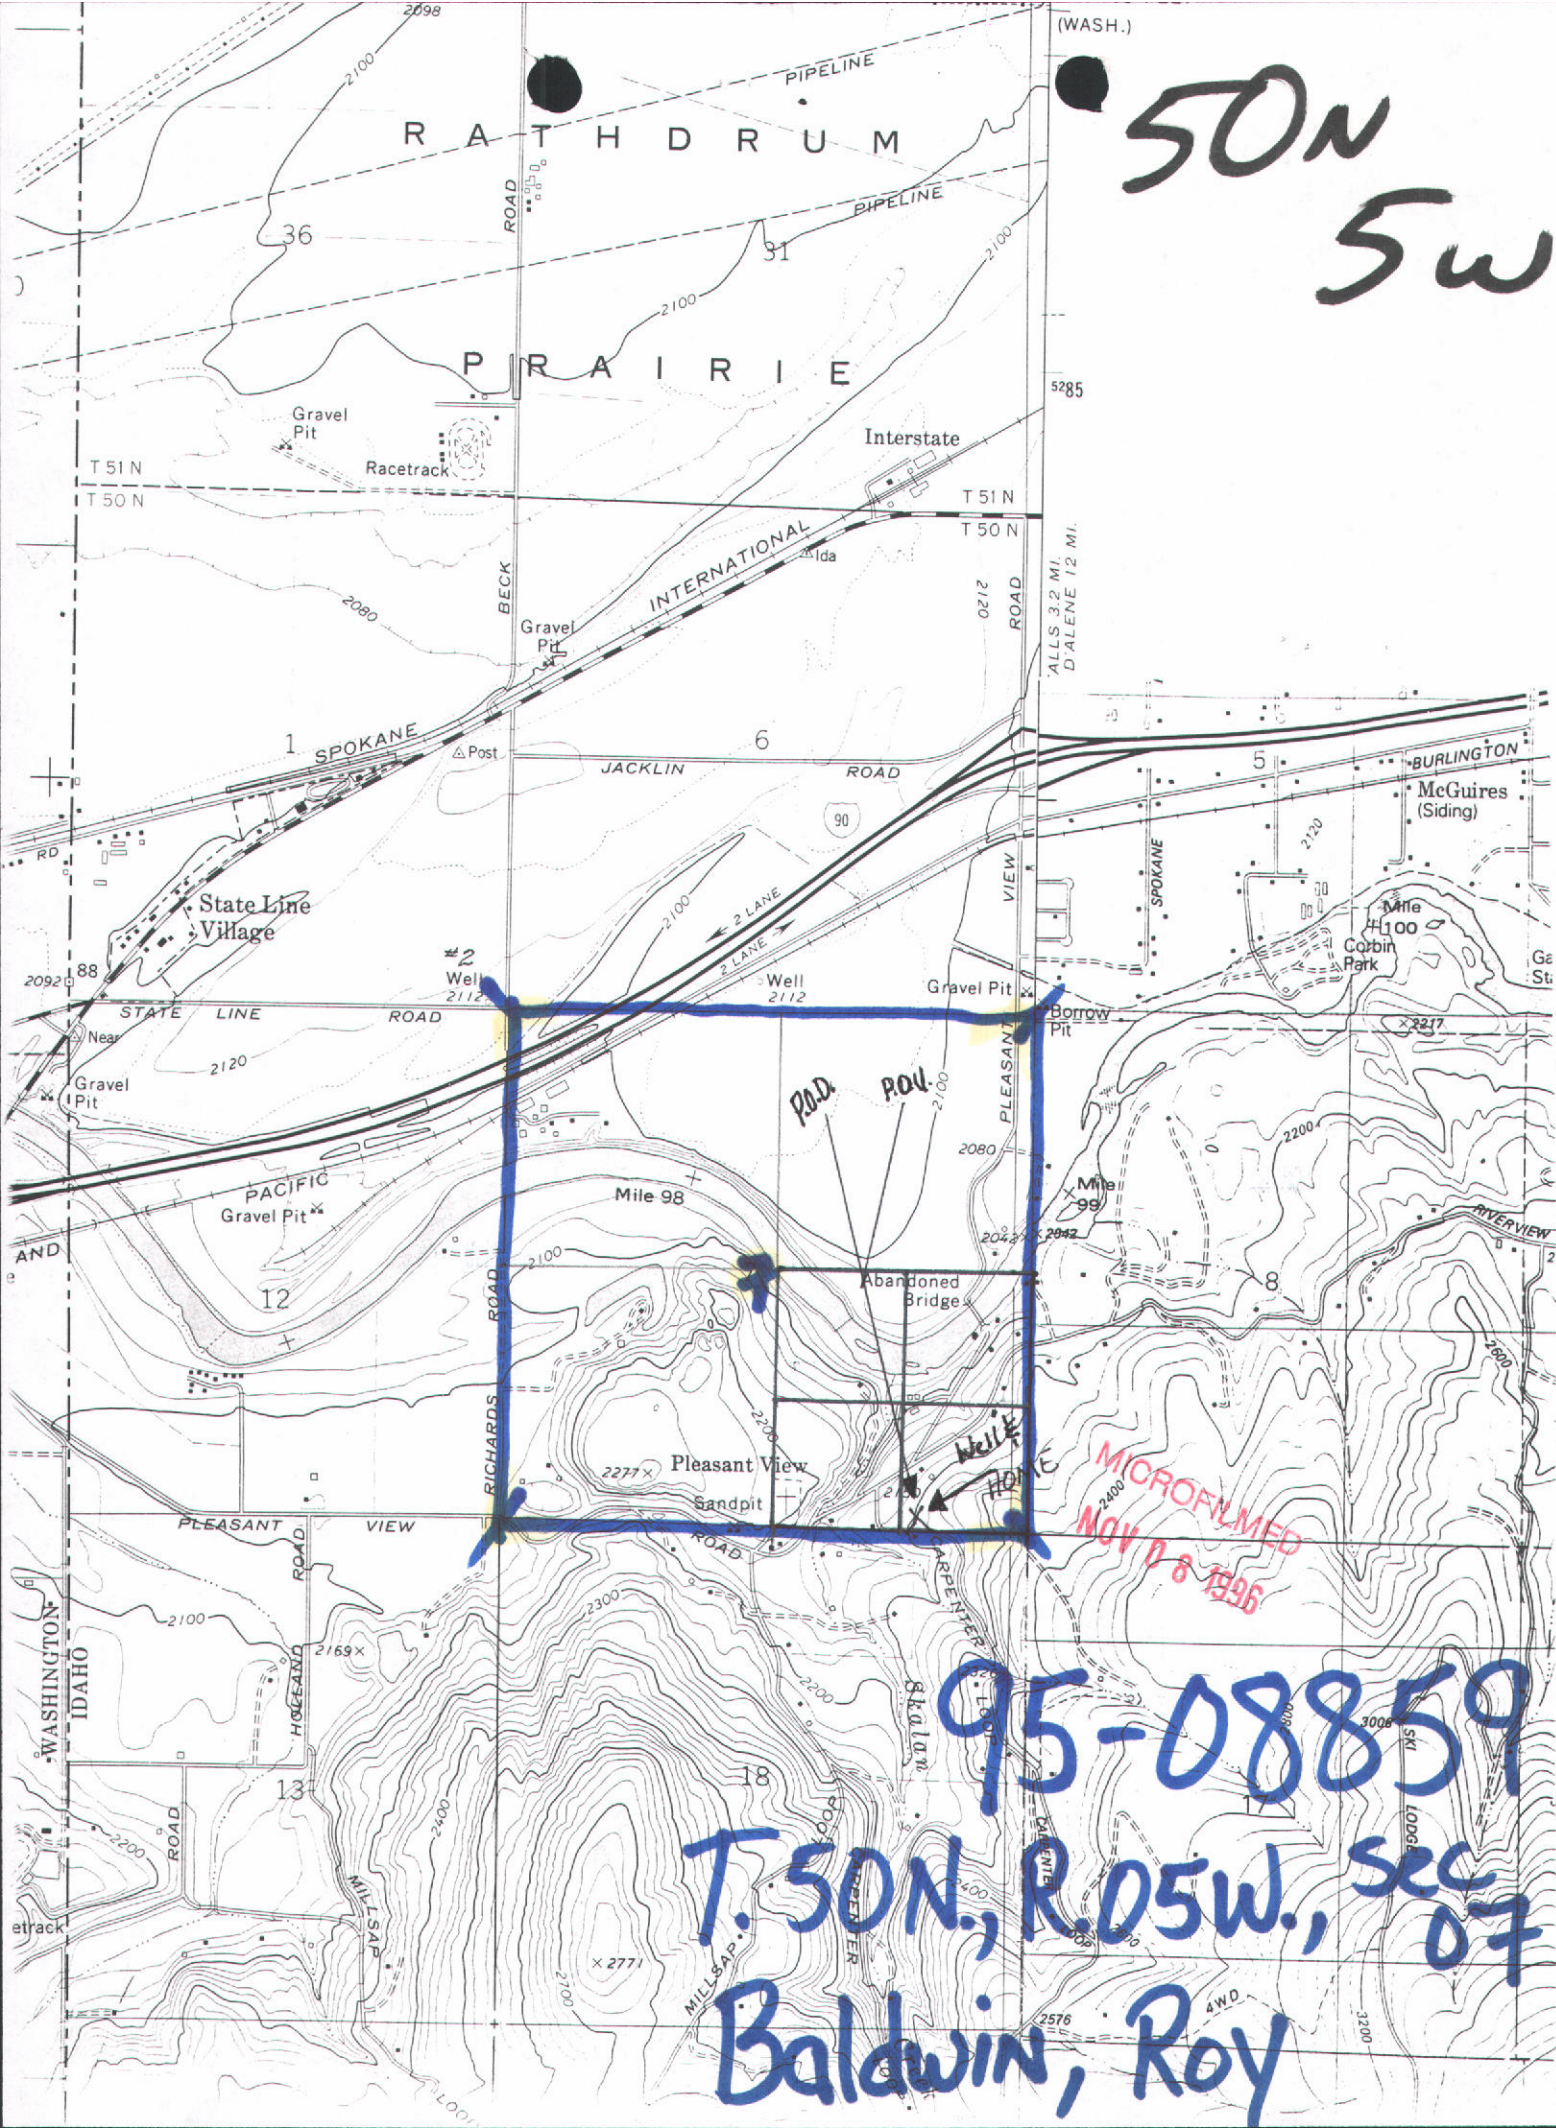

MICROFILMED
NOV 18 1996

95-08859
T. 50N, R. 05W, Sec 07
Baldwin, Roy

PERMIT #

95-08859

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
FIELD REPORT SUPPLEMENT

PHOTOGRAPHS



HOME FOR DOMESTIC USE
Other Photo's did not turn out!

MICROFILMED

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 95-08859

Priority: July 15, 1994

Maximum Diversion Rate:

0.04 CFS

Maximum Diversion Volume:

1.2 AF

This is to certify, that ROY BALDWIN

N 770 ELM

POST FALLS ID 83854

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated March 21, 1994; and has submitted Proof of Beneficial Use on May 1, 1995. An examination indicates that the works have a diversion capacity of 0.040 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

BENEFICIAL USE

PERIOD OF USE

RATE OF DIVERSION

ANNUAL VOLUME

DOMESTIC

01/01 to 12/31

0.04 CFS

1.2 AF

LOCATION OF POINT(S) OF DIVERSION:

SESE , Sec. 7, Township 50N, Range 05W
KOOTENAI County

PLACE OF USE: DOMESTIC

TWN RGE SEC

50N 05W 7

SESE

CONDITIONS OF APPROVAL AND REMARKS

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 1 home.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 29TH day of OCTOBER, 1996.

MICROFILMED

NOV 08 1996

Acting for KARL J. DREHER, Director

IN THE MATTER OF PERMIT NO. 95-08859)
)
) **ORDER OF**
IN THE NAME OF ROY BALDWIN) **REINSTATEMENT**
)

SEP 18 1995

RECEIVED

MAY 03

Department of Water Resources

FOR OFFICE USE ONLY
Amt. of Fee \$: 50.00
Receipt No. N-8862
Receipt By: MB
Date Received: 5/1/95

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 95-08869 Telephone No. 777-9316

2. Name(s) of Permit Holder(s): ROY BALDWIN

3. Mailing Address: N. 770 ELM POST FALLS ID 83864

4. Source of Water: GROUNDWATER If GROUNDWATER (well), Date Drilled: mo. / yr.

a. Well Driller: AQUA DRILLING Drilling Permit Number: 95-94-N-26

b. **OPTIONAL:**
Pump Horsepower: 2.0 Pressure (psi): Dynamic pumping level (ft):

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): 2 Stockwater (No. and type of stock):

Irrigation (No. of acres): 2 Other:

6. Total rate of diversion and/or volume for which proof is submitted: 0.12 cfs OR acre feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)
(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device: Is a measuring device required? Yes or No X
Has the measuring device been installed? Yes or No

Flow Measurement Port: Is a flow measurement port required? Yes or No X
Has the measurement port been installed? Yes or No

8. Fee Enclosed: \$ 50.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: SAME Telephone Number:

Address:

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: X Roy O. Baldwin Date: 5/1/95
(include your title, if on behalf of company or organization)

AUG 1 5 1995

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 95-08859

Proposed Priority: March 21, 1994

Maximum Diversion Rate:

0.21 CFS

This is to certify, that **ROY BALDWIN**

2517 POWDERHORN ST

POST FALLS ID 83814

has applied for a permit to appropriate water from: **GROUNDWATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.10 CFS
DOMESTIC	01/01 to 12/31	0.11 CFS
	Totals	0.21 CFS

LOCATION OF POINT(S) OF DIVERSION:

SESE , Sec. 7, Township 50N, Range 05W
KOOTENAI County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
50N	05W	7	SESE	5		5

Total number of acres irrigated: 5

PLACE OF USE: DOMESTIC, same as IRRIGATION use

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before May 1, 1995.
2. Subject to all prior water rights.
3. Prior to diversion of water under this approval, the right holder shall provide a means of measurement acceptable to the Department from all authorized points of diversion which will allow determination of the total rate of diversion.
4. The rate of diversion of water for irrigation under this right and all other water rights on the same land shall not exceed 0.02 cubic feet per second for each acre of land.
5. Place of use is within Lots A, B, C, D, and E, Pleasant View Homesites.
6. Domestic use is for 5 homes.
7. The domestic use authorized under this permit shall not exceed 13,000 gallons per day per dwelling in accordance with Section 42-111, Idaho Code.

RECEIVED

SEP 12 1994

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 95-08859

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

12th day of May, 1994

R. Keith Higginson
R. Keith Higginson, Director

for

SEP 12 1994

RECEIVED
JAN 202
10/92
MAY 02 1994

Ident. No. 95-8859

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Department of Water Resources

To appropriate the public waters of the State of Idaho

1. Name of applicant Roy BALDWIN Phone 667-7911
Post office address 2517 POWDERHORN, POST FALLS, IDAHO 83814
2. Source of water supply GROUNDWATER ~~Underground~~ which is a tributary of _____
3. Location of point of diversion is SE ~~SW~~ 1/4 of SE 1/4 of Govt. Lot _____
Sec. 7 Township 50 N. Range 5 W B.M. Kootenai County; additional points of diversion if any: _____
4. Water will be used for the following purposes:
Amount 0.11 ~~0.04~~ for Domestic purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount 0.10 for IRRIGATION purposes from 3/15 to 10/15 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 0.21 cubic feet per second and/or (b) _____ acre feet per annum
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. WELL, MAINLINE WITH STUBS TO 5 PARCELS.
b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet; period of year when water will be diverted to storage: _____ to _____ inclusive.
c. Proposed well diameter is 6" inches; proposed depth of well is 200' feet.
d. Is ground water with a temperature of greater than 85°F being sought? No
e. If well is already drilled, when? 2/15/94; Drilling firm AGUA DRILLING, COA ID.
Well was drilled for (well owner) ROY A. BALDWIN
7. Time required for the completion of the works and application of the water to be proposed beneficial use is 1 year years (minimum 1 year).

SEP 12 1994

- Remarks: - 4 parcels above (1) Area in size area being sold to other individuals. Water lines will be directed to each parcel from the well which will stay within my ownership within my own personal 3 1/2 acres of property


WELBORN'S LAND SURVEYING, INC. P.S.

E. 7011 SECOND AVE.


SPOKANE, WASHINGTON 99212

(509) ~~926-5959~~

924-3444

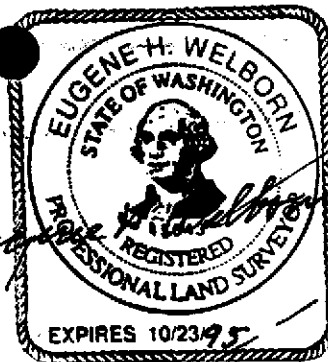


PLEASANT VIEW HOMESITES

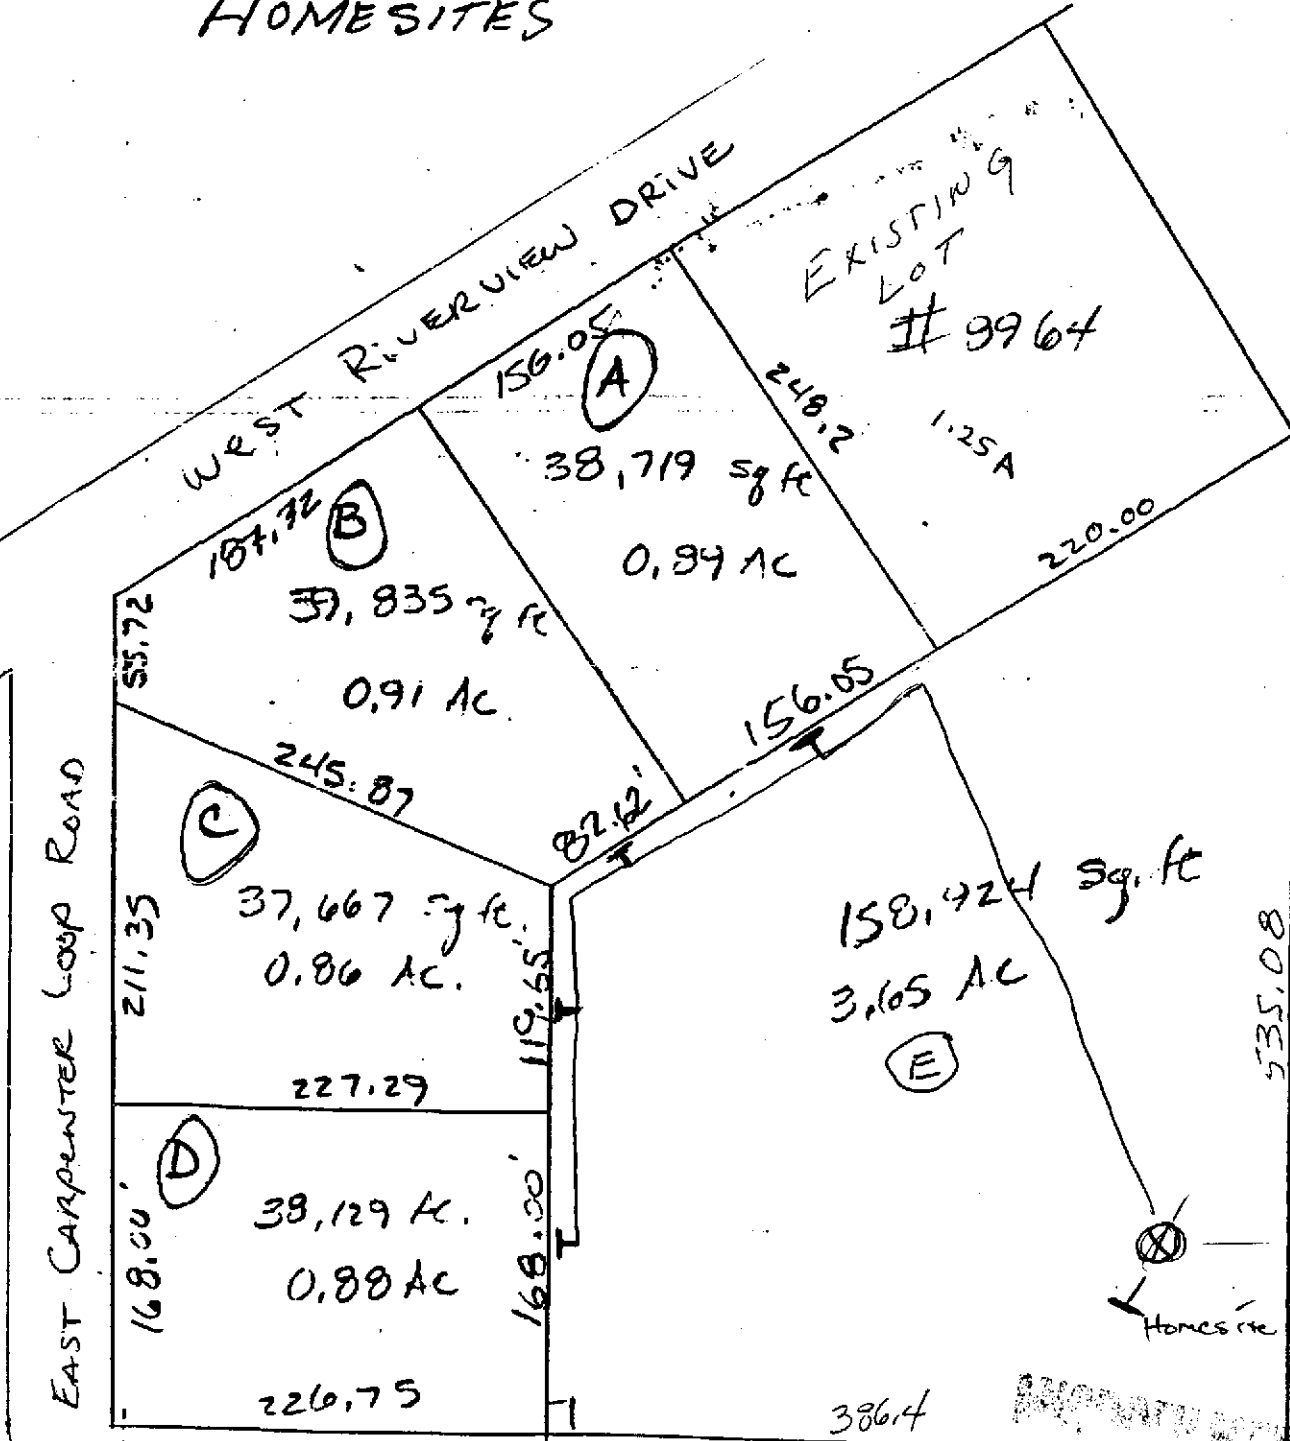

RTN SE 1/4 OF SE 1/4 Sec. 7 T2N 50N R. 5W.

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.


PTN. SE 1/4 SE 1/4 SEC. 7 T4N 50N. R. 5W.

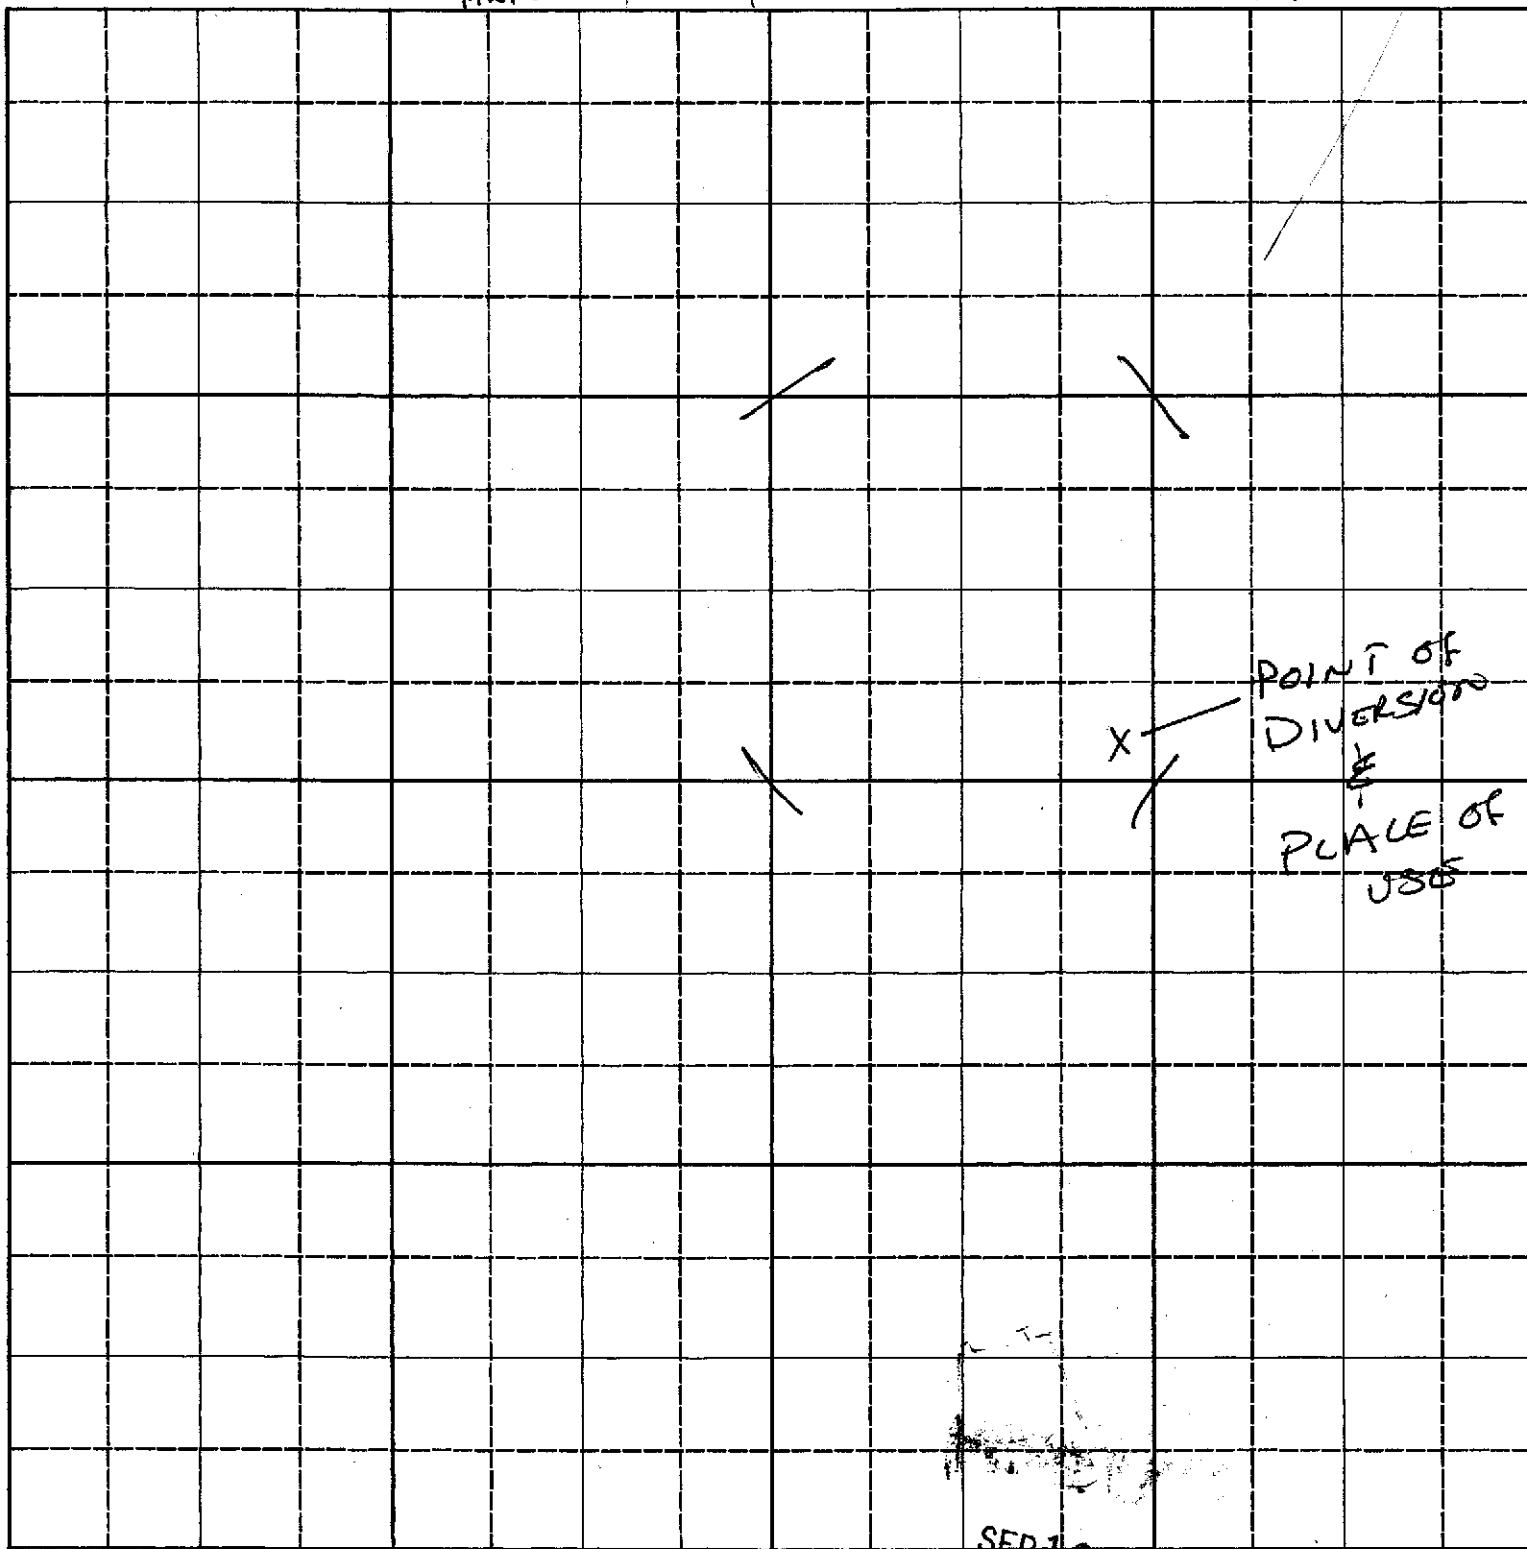

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Ray P. Baldwin
(Applicant)

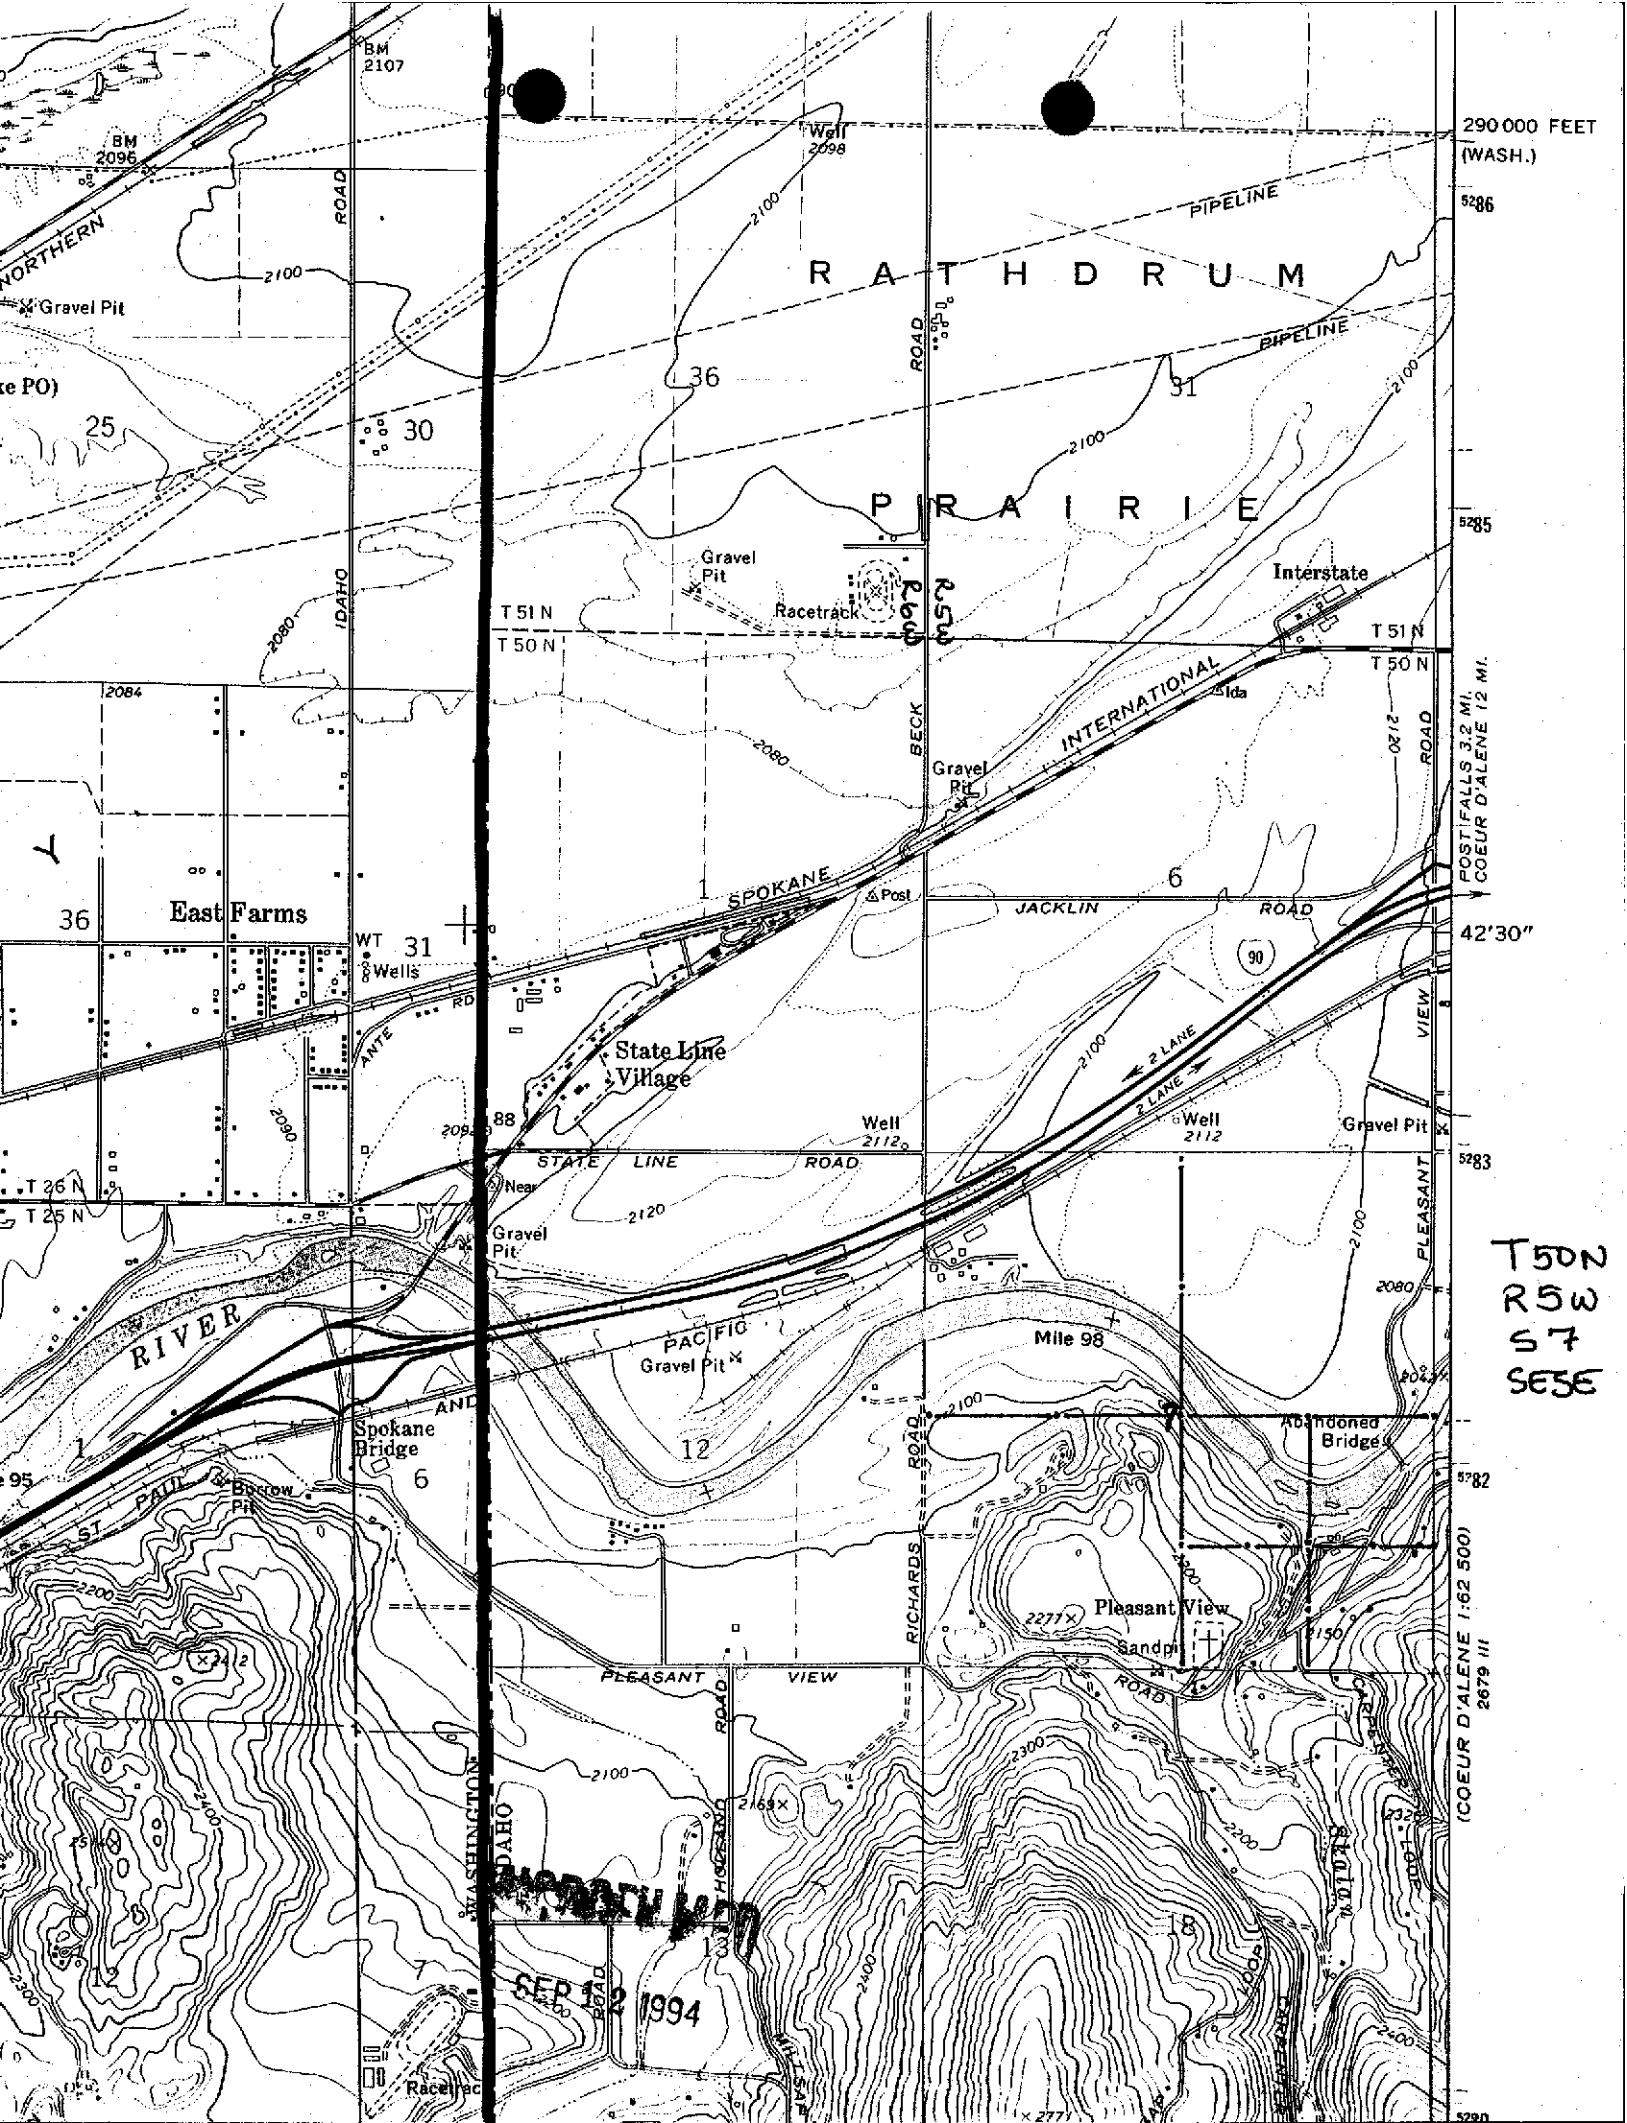

290 000 FEET
(WASH.)

5286

5285

42'30"

5283

5282

(COEUR D'ALENE 1:62 500)
2679 III

T50N
R5W
S7
SE3E

SEP 12 1994

IDAHO DEPARTMENT OF WATER RESOURCES

WELL DRILLER'S REPORT


 Use Typewriter
or
Ball Point Pen

 1. DRILLING PERMIT NO. 95-94-N-26-000
Other IDWR No. 95-08859

2. OWNER:

 Name Roy Baldwin
Address General Delivery
City Post Falls State ID Zip 83854

3. LOCATION OF WELL by legal description:

Sketch map location must agree with written location.
 Twp. 50 N North ☐ or South ☐
Rge. 5 W East ☐ or West ☐
Sec. 7 SE 1/4 SE 1/4
Gov't Lot _____ County 20 Kootenai

 Address of Well Site Carpenter Loop rd.
City Post Falls

(Give at least name of road + Distance to Road or Landmark)

Lt. _____ Blk. _____ Sub. Name _____

4. PROPOSED USE:

☒ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☐ Other _____

5. TYPE OF WORK

☒ New Well ☐ Modify or Repair ☐ Replacement ☐ Abandonment

6. DRILL METHOD

☐ Mud Rotary ☒ Air Rotary ☐ Cable ☐ Other _____

7. SEALING PROCEDURES

SEAL/FILTER PACK			AMOUNT		METHOD
Material	From	To	Sacks or Pounds		
<u>Bentonite</u>	<u>-88'</u>	<u>0</u>	<u>10</u>		
	<u>0</u>	<u>58'</u>			

Was drive shoe used? ☒ Y ☐ NWas drive shoe seal tested? ☒ Y ☐ N How? Air Pressure

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
<u>6"</u>	<u>+2</u>	<u>-58'</u>	<u>250</u>	<u>Steel</u>	☒	☐	☒	☐
<u>4"</u>	<u>-200</u>	<u>-40</u>	<u>250</u>	<u>PVC</u>	☐	☒	☒	☐

 Length of Headpipe +2 Length of Tailpipe 58

9. PERFORATIONS/SCREENS

☒ Perforations Method Saw cut
☐ Screens Screen Type _____

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
<u>-195</u>	<u>-165</u>	<u>1/8x6"</u>	<u>58</u>	<u>4</u>	<u>PVC</u>	☐	☒

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

45 ft. below ground Artesian pressure _____ lb.

Depth flow encountered _____ ft. Describe access port or

 control devices: weld plate
SE SE 7 50N 5W

11. WELL TESTS:

☐ Pump ☐ Bailer ☒ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
<u>100</u>		<u>-200</u>	<u>2 hrs</u>

 Water Temp. Cool Bottom hole temp. _____

 Water Quality test or comments: Good

12. LITHOLOGIC LOG: (Describe repairs or abandonment)

Water

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Y	N
<u>8</u>	<u>0</u>	<u>58</u>	<u>Decomposed Granite</u>		☒
<u>6</u>	<u>58</u>	<u>95</u>	<u>Hard granite</u>	☒	
	<u>95</u>	<u>200</u>	<u>Hard granite</u>	☒	

RECEIVED

JUN 30 1994

 NORTHERN REGION
DWR

MICROFILMED

JAN 12 1998

 AQUA DRILLING
& EXPLORATION INC.
P.O. Box 2850 Hayden Lake, ID
83835

 Completed Depth 200' (Measurable)
Date: Started 2-5-94 Completed 2-15-94

13. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

 Firm Name AQUA DRILLING & EXP. INC. Firm No. 1123

 Firm Official Scott M. Burumbee Date 2-16-94

and _____

 Supervisor or Operator David Montoya Date 2-16-94

(Sign once if Firm Official & Operator)

LICENSE REVIEW CHECKLIST

PERMIT NO. 95-08859

DATE 10/28/95

REVIEWER: S H A R L A

NAME Change OK

Address Change No

SOURCE Change OK

Is change clarification of originally intended source? Yes
If not, prepare Notice of Intent to Void

POINT OF DIV Change OK

Amendment required No

PLACE OF USE Change OK

Amendment required No

Does map agree with written description? Yes no

OVERLAPS P/D P/U

RATE OF DIV

Permitted Rate .21 cfs

Fee limit .20 cfs \$50⁰⁰

Measured cfs

Theoretical .04 cfs $1.5 \times 8.8 \times 7 / 200 + (2.31 \times 1.25) = .04$

Recommended Total Div Rate .04 cfs

ANNUAL VOLUME/
NATURE OF USES

Use <u>Dom</u>	Volume Calculation <u>30.125 x 5 = 1.5</u> af
<u>Dom</u> <u>.04</u>	<u>1.2 standard</u> af
<u> </u>	<u> </u> af
<u> </u>	<u> </u> af
SUBTOTAL	<u>1.2</u> af

Flow rate .04 cfs X 365 days X 1.98^{af} = 29.0 af

Total volume recommended 1.2 af

(SUBTOTAL or Flow Rate, whichever is less)

REMARKS

DI home using not incl.
1.21 (0.3 + 1.5)

CONDITIONS Watermaster Control WD#

 GW Measurement/Measuring Device

 Overlap

 Use-specific conditions

Advancement of Priority Date Required yes no

SRBA Claim Filed N/A
Adjustment Memo

1st Amend Letter N/A
2nd Amend Letter

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

SEP 19 1996

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 95-08859

1. Owner: ROY BALDWIN Phone No. 777-9316

Current Address: N. 770 ELM, POST FALLS, Id. 83854

2. Accompanied by: Julie Baldwin EXAM DATE: 8-29-96

Address: Same as above Phone No. Same as above

Relationship to Permit Holder: Permit holder / Wife

3. Source: Groundwater tributary to _____

B. OVERLAP REVIEW

1. Other water rights with the same place of use: NONE

2. Other water rights with the same point of diversion: NONE

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
Well #1			SE	SE	07	50N	05W	Kootenai	U.S.G.S. Topo; Site Visit


2. Place(s) of Use:

Indicate Method of Determination

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
50N	05W	07																.5	.5

MICROFILMED
NOV 08 1995

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

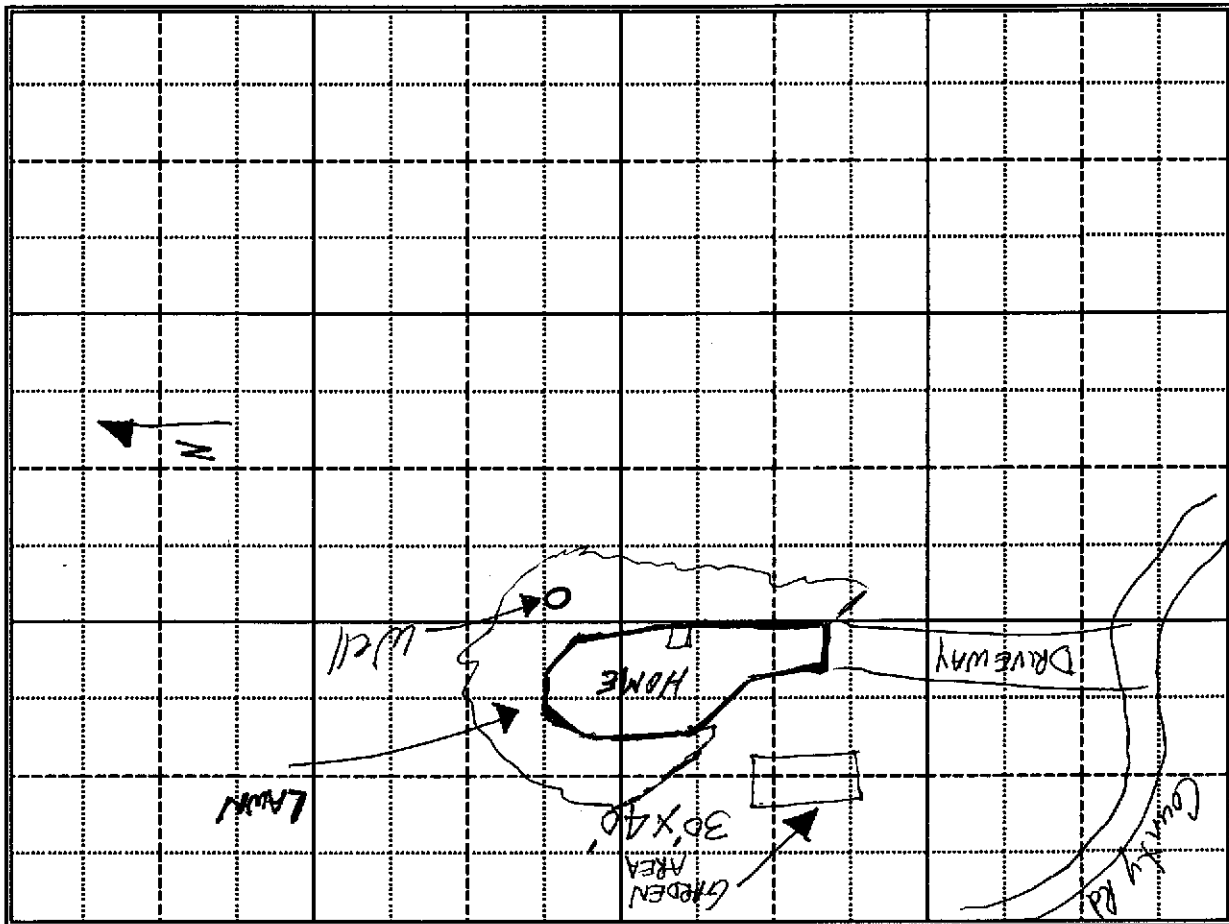

Scale: 1" = 100'

Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

Aerial Photo Attached (required for irrigation of 10+ acres)

Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well #1	Submersible	1.5		Foulds	186315412

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

MICROFILMED

NOV 8 8 1996

E. NARRATIVE/REMARKS/COMMENTS

Domestic water supplied to 1 home w/ lawn & garden
Less than 1/2 acre of IRRIGATION.

Have conditions of permit approval been met? ☒ yes

no
MICROFILMED
NOV 08 1996

Measured Method:

Additional Computation Sheets Attached

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{IR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = .5 \times 3.0 = 1.5$$

$$V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .04 \times 214 \times 1.9835 = 16.98$$

$$V = \text{Smaller of } V_{IR} \text{ and } V_{DR} = 1.5$$

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use

Domestic

From

10-10

Period of Use

To

12-31

(c) 0

40

Rate of Diversion

V (a) (a)

12

Annual Volume

2. Recommended Amendments

Change P.D. as reflected above

Change P.U. as reflected above

Add P.D. as reflected above _____ None

Add P.U. as reflected above

I. AUTHENTICATION

Field Examiner's Name

Date _____

Reviewer

Date 8-29-96

MICROFILMED

9561 8 0 AOM

SEAL

1. DRILLING PERMIT NO. 95-94-N-26 .
Other IDWR No. _____

2. OWNER:

Name Roy Baldwin
Address General Delivery
City Post Falls State ID Zip 83854

3. LOCATION OF WELL by legal description:

Sketch map location must agree with written location.

N
 W E
 S
 Twp. 50 N North ☐ or South ☐
 Rge. 5 W East ☐ or West ☐
 Sec. 7 SE $\frac{1}{4}$ SE $\frac{1}{4}$
 Gov't Lot _____ County 20 Rooter
 10 acres 10 acres 160 acres

Address of Well Site Carpenter Loop Rd.
City Post Falls

(Give at least name of road + Distance to Road or Landmark)

Lt. _____ Blk. _____ Sub. Name _____

4. PROPOSED USE:

☒ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☐ Other _____

5. TYPE OF WORK

☒ New Well ☐ Modify or Repair ☐ Replacement ☐ Abandonment

6. DRILL METHOD

☐ Mud Rotary ☒ Air Rotary ☐ Cable ☐ Other _____

7. SEALING PROCEDURES

SEAL/FILTER PACK			AMOUNT	METHOD
Material	From	To	Sacks or Pounds	
Bentonite	-88	0	10	
	0	58'		

Was drive shoe used? Y~~X~~ N ☐

Was drive shoe seal tested? Y ☒ N ☐ How? Air Pressure

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
6"	+2	-58	250	Steel	☒	☐	☒	☐
4"	-200	-40	~~250~~	PVC	☐	☒	☒	☐
					☐	☐	☐	☐

Length of Headpipe 72 Length of Tailpipe 58

9. PERFORATIONS/SCREENS

2 Perforations Method Saw cut

Screens **Screen Type** _____

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
-195	-165	1/8x6"	58	4	PVC	☐	☒
						☐	☐
						☐	☐

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

45 ft. below ground Artesian pressure _____ lb.

Depth flow encountered _____ ft. Describe access port or

control devices: weld plate

11. WELL TESTS:

☐ Pump ☐ Bailer ☒ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
100		200	2 hrs

Water Temp. 600 Bottom hole temp. _____

Water Quality test or comments: Good

12. LITHOLOGIC LOG: (Describe repairs or abandonment) Water

[illegible]

Completed Depth 200' (Measurable)
Date: Started 2-5-94 Completed 2-15-94

13. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.


Firm Name AQUA DRILLING & EXP. INC. Firm No. 1163

Firm Official Scott W. Brumby Date 2-16-94

and 1 1/2 1 1

Supervisor or Operator Donald Montoya Date 2-16-94

50N
5w

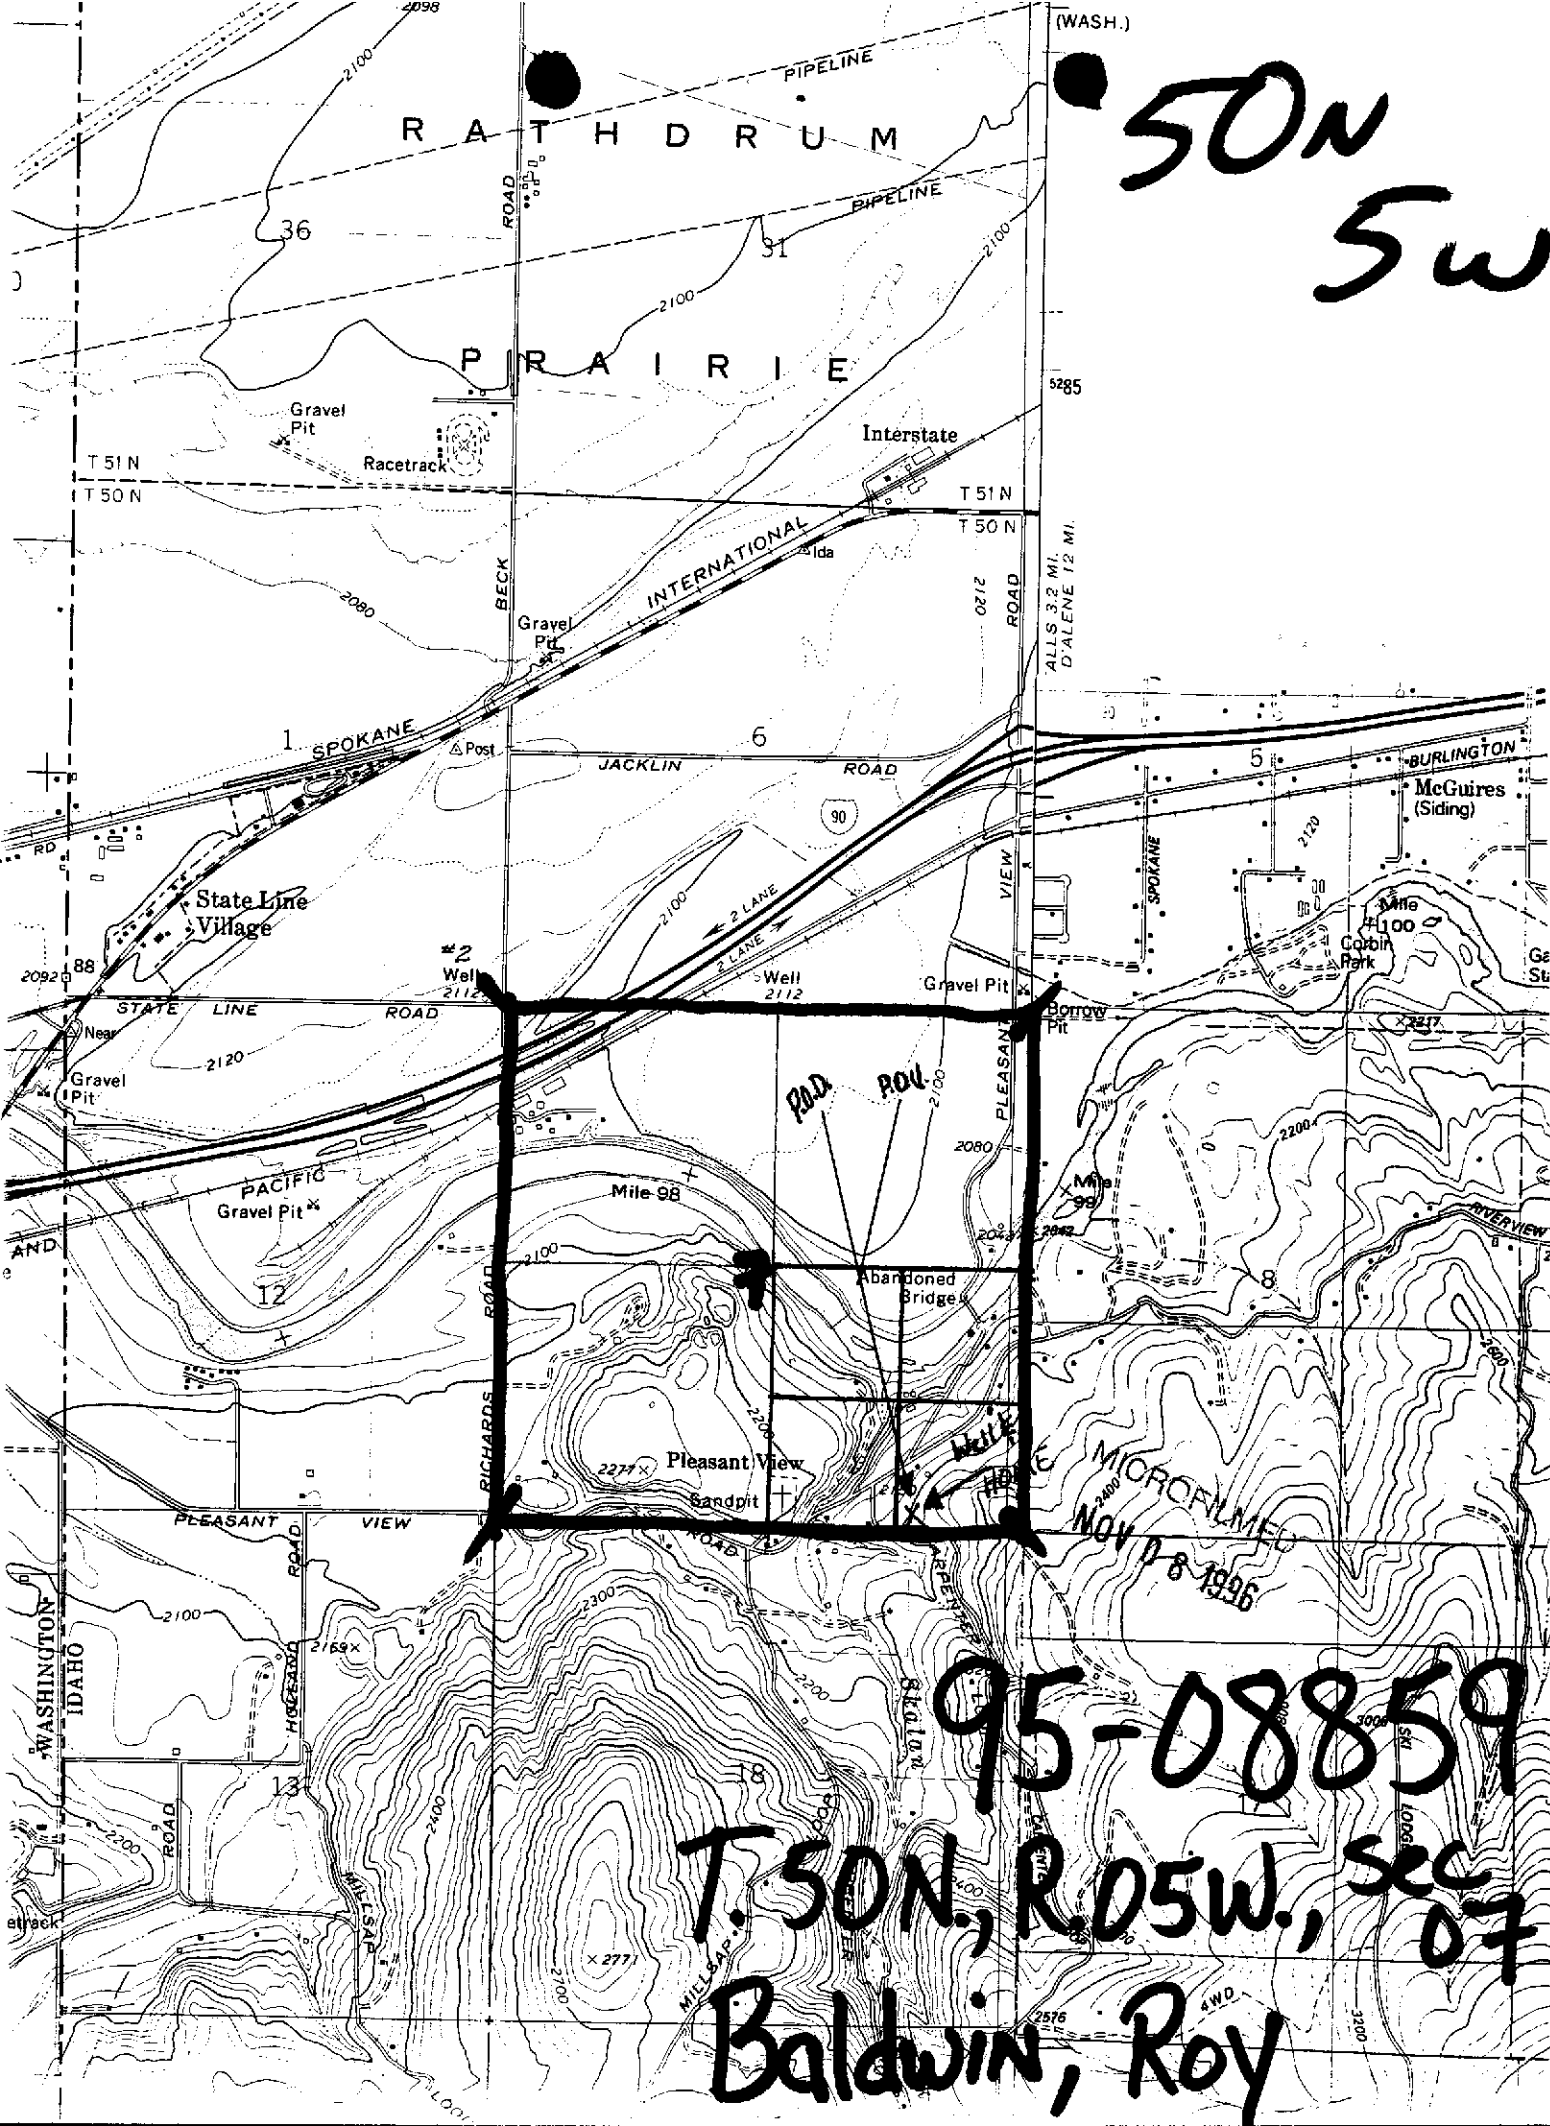

95-08859

T. 50N., R. 05W., Sec 07

Baldwin, Roy

PERMIT #

95-08859

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
FIELD REPORT SUPPLEMENT

P H O T O G R A P H S



HOME FOR DOMESTIC USE
Other Photos did not turn out!

MICROFILMED

**ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE**

Permit No. 95-08859 Reviewed by AWJ Date 5-15-95

GENERAL CONSIDERATIONS

TYPES OF USE

yes Name same as permit?

Dom. Irr.

no Address same as permit?

yes Proof timely received?

Correct Uses? yes

If not, complete calculation below.

SOURCE OF WATER

 Surface water source

✓ Ground water source

yes Drilling permit required?

no Copy in the file?

Drilling Permit No. 95-94-N-0026-000

35.00 Amount paid for permit

no Correct?

no Well log in the file?

LICENSE EXAMINATION FEE

MEASURING DEVICE

yes Required?

yes Required?

50.00 Amount Submitted

no Installed?

yes Correct?

no Waiver requested?

PRIORITY CALCULATION

Date proof received 8-25-95 237

Date proof due ^(lapsed) 6-27-95 5-1-95 - 121

No. of days late = 116

Priority Date 3-21-94 + 80

New Priority Date 7-15-94 196

7/15/94

DEFICIENCIES OR ACTION ITEMS

Return for additional 165.00 drill perm. fee.
advise of measuring device condition.
8/25 - Fee Received - Proof acceptable

DATA ENTRY

New Address N. 770 Elm
Post Falls, ID. 83854

Proof Made 8/25/95

WELL DRILLER: PLEASE COMPLETE FOR VERBALS

IDWR Employee Issuing Verbal: _____

Verbal Issued Date: _____ Time: _____

VERBAL: 95-94-N-26

State of Idaho
Department of Water Resources**APPLICATION FOR DRILLING PERMIT****RECEIVED**

MAR 11 1994

NORTHWEST REGION
IDWR1. Applicant (please print): BALDWIN, ROY2. Mailing Address: General DeliveryCity & State Post Falls, ID Zip Code 83854 Telephone 773-5039☒ Well Owner ☐ Well Operator ☐ Contractor or Other, specify _____3. Proposed Well Location: Twp. 50N, Rge. 5W, Sec. 7, SE 1/4 SE 1/4Gov't Lot No. _____ County KootenaiStreet Address of Well Site Carpenter Loop RD

Lot, block and subdivision _____

4. Proposed Use of Well:

☒ DOMESTIC: The use of water for homes, organization camps, public campgrounds, livestock (1,000 head or less) and for any other purpose in connection therewith, including irrigation of up to 1/2 acre of land, if the total use is not in excess of 13,000 gpd; or any other uses, if the total use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

Domestic does not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

NON-DOMESTIC: ☐ Irrigation ☐ Municipal ☐ Industrial
☐ Stock ☐ Test ☐ Other _____
(Over 1,000 Head) (Describe)☐ INJECTION☐ MONITORING: A well bore schematic and map is required for each blanket permit.

No. of proposed wells: _____

5. Well Construction Information:

A. ☒ New well ☐ Modify (Deepen or Enlarge) ☐ Replace - See Condition 9B. Proposed Casing Diameter 6" Proposed Maximum Depth 250'

C. Anticipated bottom hole temperature:

☒ 85°F or less (Cold Water Well) ☐ 85°F to 212°F (Low Temp. Geo. Well) ☐ 212°F or more (Geothermal Well)6. Construction Start Date: 2/4/947. Anticipated Well Driller: Agua Drilling & Exploration, INC / Scott N. Braun / President #16
NOTE: The actual well driller must be identified prior to drilling.8. Applicant's Signature Scott N. Braun Date 2/4/94Title Driller

(Owner, Firm Representative, Other)

AUG 15 1995

ACTION OF THE DEPARTMENT OF WATER RESOURCES

APPROVED

Date

MAR 14 1997

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY!

GENERAL CONDITIONS:

1. The well must be constructed in compliance with the applicable statutes, specific conditions of approval shown on the water right permit, injection well permit, transfer or amendment and the rules and regulations of the Department for water appropriation, injection wells and well construction standards.

2. This drilling permit is valid for two (2) months from the above approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.

3. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required before construction of this well.

4. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.

5. Approval of this drilling permit does not authorize trespass on the land of another party.

6. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
7. This drilling permit does not represent a right to divert and use the water of the State of Idaho.

8. If a bottom hole temperature of 85° or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.

9. If this permit is for a replacement well, the well being replaced must be abandoned in accordance with Department Rules and Regulations.

SPECIFIC CONDITIONS:

Signature of Authorized Department Representative

Robert S. Hays

Title

REGIONAL MANAGER

Receipt No. *N7735* Received by *[Signature]* Fee *\$5.00* Date *3/11/97*

EXTENSION OF DRILLING PERMIT

Extension approved by

Approval Date

This extension expires:

AUG 15 1998

APPLICATION FOR PERMIT
STATE OFFICE REVIEW
by Cindy Zimmerman

Application #: 95-8859 Name: Baldwin Date: 5/9/94

AREA OF CONCERN? - No/Yes _____ Mor _____ GWMA Trust/Non-trust

SYSTEM COMPLETED:

No - 26A-P17

Complete in 1 year - P16

Yes

Proof not submitted - P16

Proof submitted - NA

GROUNDWATER:

+ 0.2 cfs <flo-ch> - T17 (new), 01K (existing), No MD

- 0.2 cfs - no MD <flow chart>

Drilling Permit:

Included w/permit - Permit No. 95-94-N-0026-000, P99

Existing well - NA (pre 7/1/87)

No WD permit? - 046-46A(Irr)-46B-P23 (post 7/1/87)

SURFACE WATER: not in WD - T17 (+.2 w/pump), No MD <flow chart>

LOCATION:

Water District(dem) - WD No. _____

*Surface water - 005 (req) 01J-P08 <flow chart>
(doesn't sink) or 01H-P01 <flow chart>; No MD

Groundwater - P05 (new irrigation well)

In stream channel - 030 (stream channel alteration)

Irr Dist/Canal Co. - 023 (Twin Falls area)

Drainage Districts - 024

Flood Control Dist. - 063

Boise Front (63) - 058 (-85° Groundwater temp)

Swan Falls Flag - B <See condition code chart>

Trust - 051-052-053-P74 (Consumptive Uses), NA

Non Trust <1> - 048-049 (Consumptive Uses), NA

RIVER BASINS (*Surface water):

Boise R(63) - 05A (if WD), 11E (non-domestic use), NA

Payette R(65) - 064(consump. use), 047-P04(Payette Lake), NA

Snake R(01/02/03) - 11A-P04 (01), 061-P07 (02/03 No W.D.Cond.), NA

USE:

Fish Propagation - 07A-042 (req) & 010/06A/09E(WQ)-P10
044 (N 1000 Spr)

Irrigation - 803(if GW use SW 1st)(+5A do POU comp), NA

Power - 08A-17K-025-027(req); 01F(MD)-P19; 09E(WQ)-P10;
+25 cfs-P18; 17G(FERC) or 17M(FERC); 18B-P09

Mining - 054 (req) & 06A/010/09E-P10

Storage(✓ 3 compo.) - 18A(multi MD in WD), 18B-P09 (+10' dam), NA

Domestic (surface) - 021(Boise R + L Peak), 27A(Payette R), NA

OWNERSHIP:

Non land owner - 004 (PD/PU) _____

PROTESTED:

Prehearing agreement- 020

OTHER CONDITIONS:

REMARKS:

- ① P/U located in LT A,B,C,D,E, Pleasant View Homosites.
② W01(5) ② W04

BENEFICIAL USE DUE:

- 5-1-1995

COMMENTS:

- ① New Desc.

No. a
4/87-06/92n

ILLINOIS DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

APPLICATION # _____

***** INITIAL REVIEW *****

APPLICANT: BALDWIN BY: AS DATE: 3/21/94

ITEM REQUIRED INFORMATION

1. (x) Name and Address
2. (x) Source
3. (x) Point of Diversion & County
4. (x) Quantity
(x) Nature of Proposed Use
(x) Period of Use
5. (x) Total Quantity
6. (x) Description of diverting works
7. (x) Time required for b/u
8. (x) Proposed use
9. (x) Place of use or acres irrigated
10. (x) Other Water Rights
11. (x) Ownership
12. (x) Map
(x) Signature
13. (x) Fee (Amt, recpt, acknowlegment)

*** Send info sheet Y() N()

ADDITIONAL INFORMATION

- Yes No
- x Field check: by _____
- 1 Field report attached
- 1 Analysis Supp. attached(>5cfs/500af)
- 1 Water delivered by water master?
- Water District # _____

PROCESSING

Yes No PRIORITY DATE: 3/21/94

x (Include Moratorium Remark)

x Statewide Avertising: (Diversion rate greater than 10 cfs or 1,000 af).

ADVERTISE IN: KOOTENAI County.

LETTERS SENT REQUESTING:

() Dam Information () Fish Information

() Power Information () Other: N/A

INFORMATION RECEIVED:

() Dam Information () Fish Information

() Power Information () Other: N/A

***** GROUNDWATER SECTION *****

- (Yes) (No)
- x Groundwater management area
- 1 Critical ground water area
- 1 Well Drilling Permit required
- 1 Well Drilling Application and Fees received
- 1 Well Drilling Application approved?
- Well Drilling Application Number _____

Checked by: _____

Remarks: _____

RECEIVED
MAY 02 1994

Department of Water Resources

***** FINAL REGIONAL PROCESSING/REVIEW *****

- (Yes) (No)
- 1 Notice of pending void order issued. Final order response date: 4/28/94
- 1 Further information required from applicant
- 1 Affidavit of publication received
- 1 Application published correctly, If not, record action taken: _____
- 1 Publication dates and paper recorded on application | Sr. Agent initial AS
- 1 Protests received. Final protest date: 4/25/94
- 1 Measuring device required
- 1 Measuring port required
- 1 Special conditions: _____
- 1 Special conditions of approval supplement and/or cover letter attached:

Approval Recommended by: AS RMA

Date: 4/28/94