


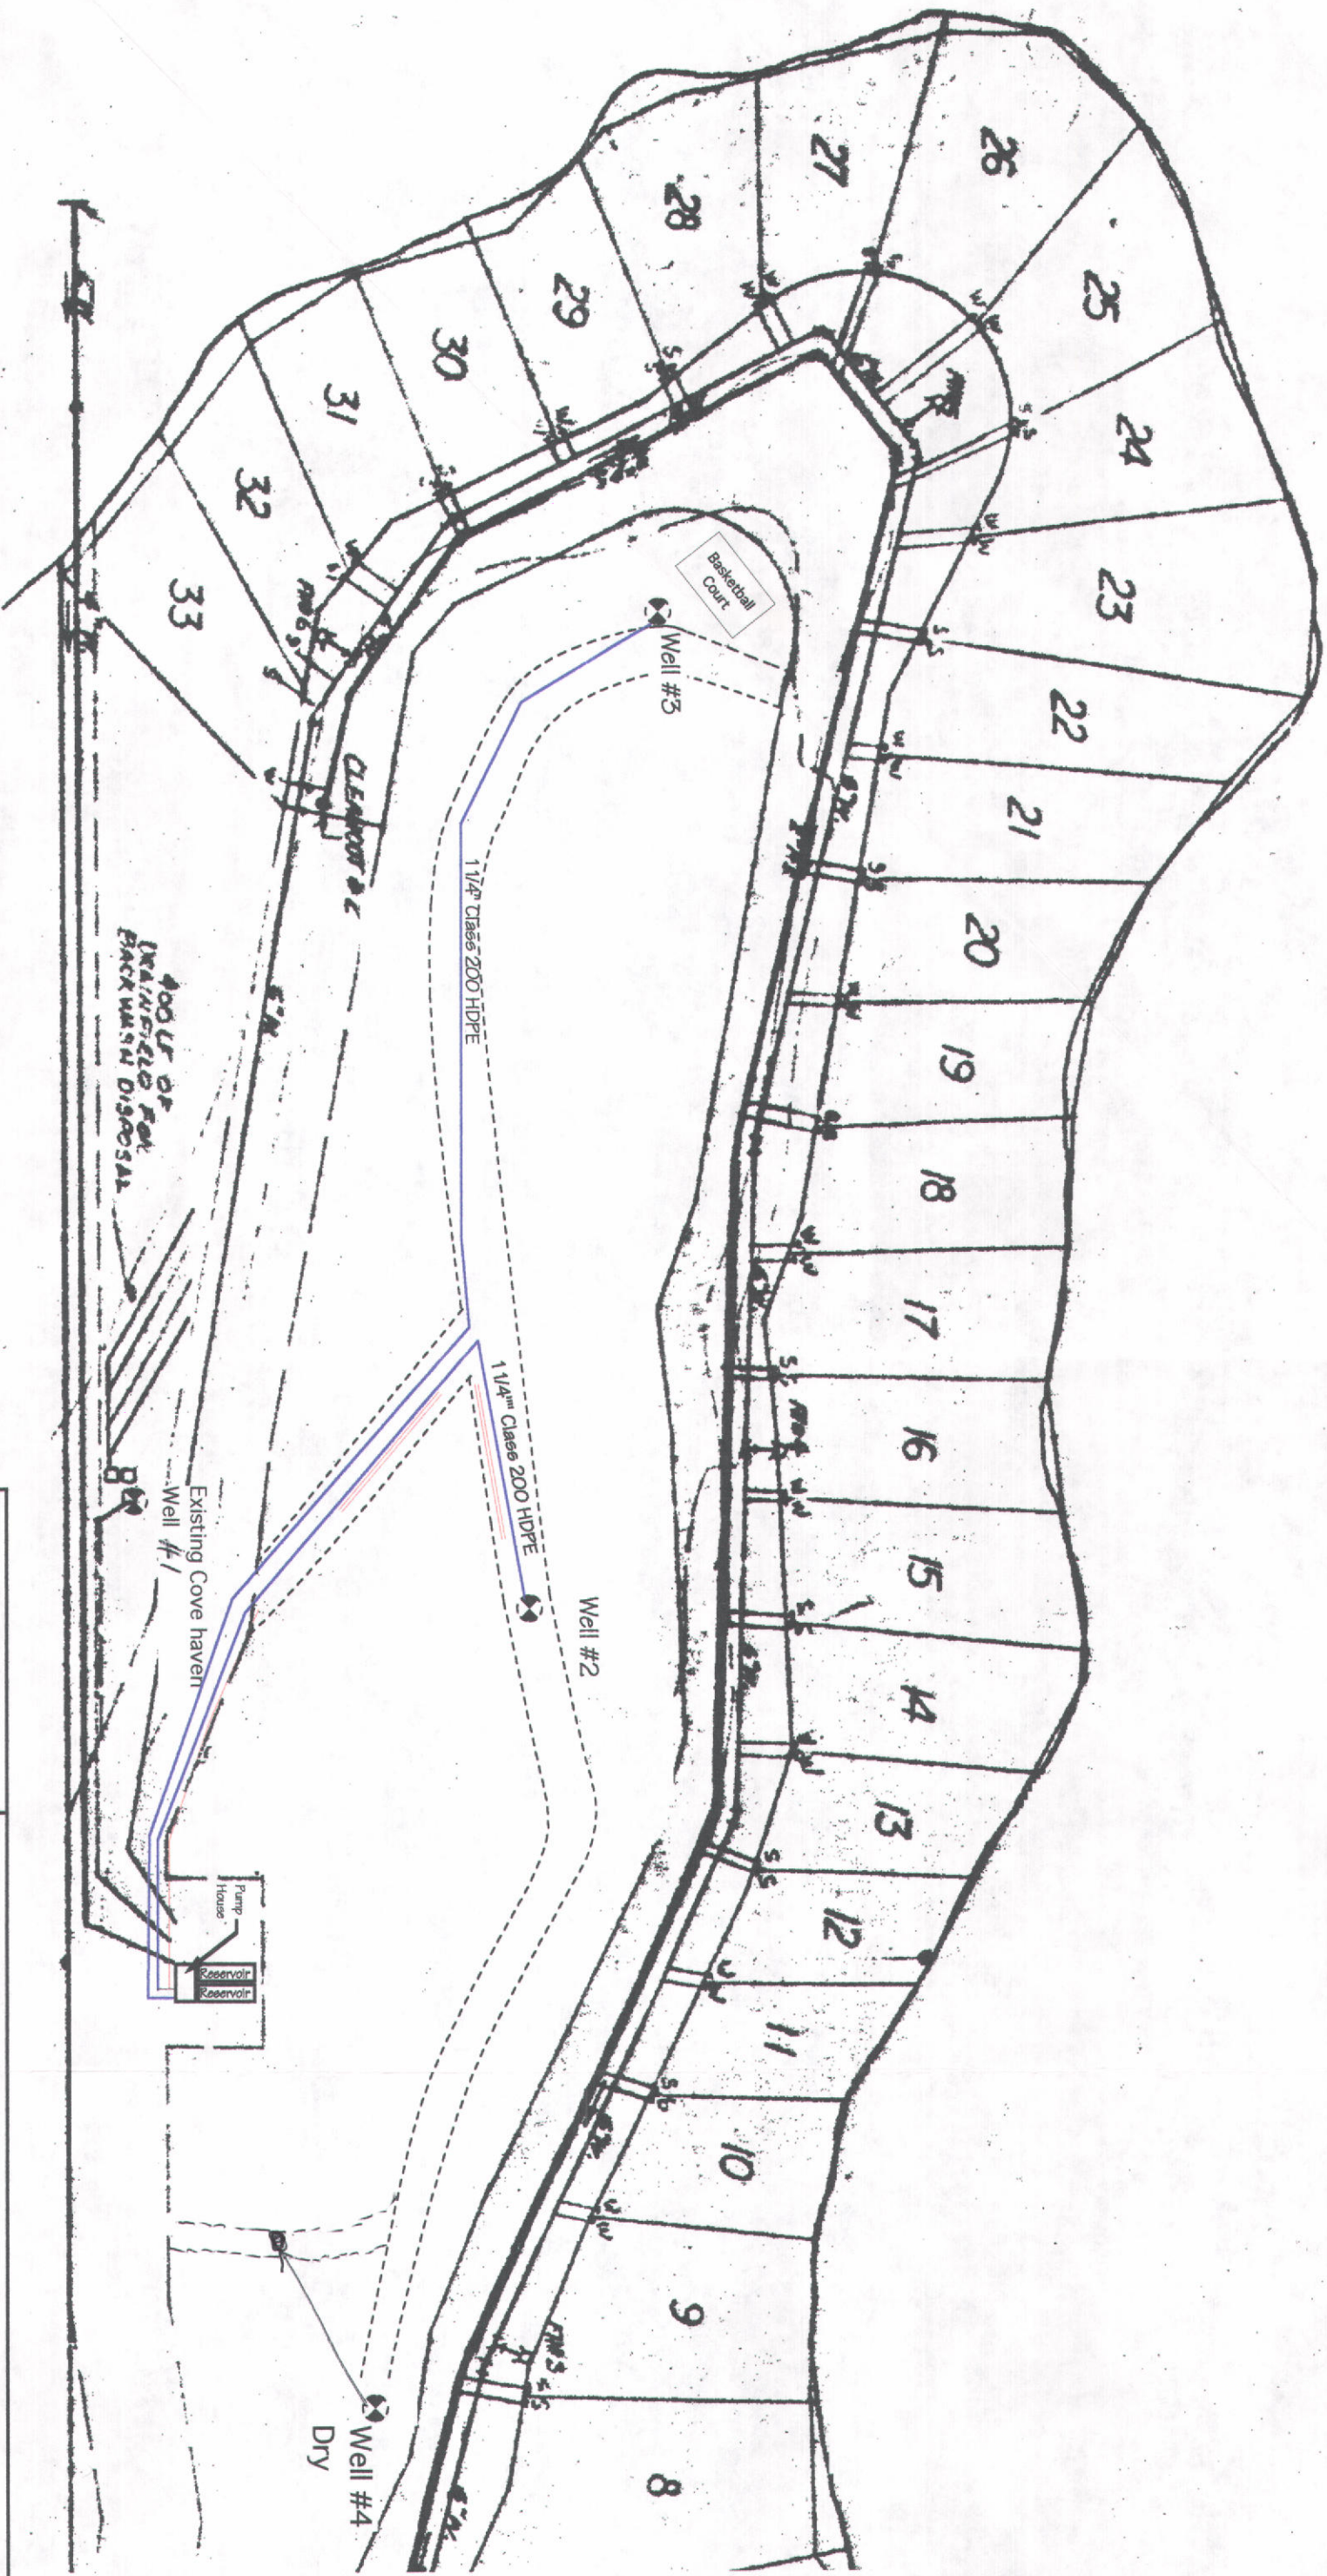


Base Map Source:
Meckel Engineering and Surveying, 1987

New Wells: Well #2 and Well #3

QUANTUM Environmental

Engineering and Geologic Consulting


ENGINEER:	Jim De Smet	Site Plan
DRAWN BY:	Jim De Smet	New Well Installations
DATE:	4/9/98	Cove Haven Water Association
SCALE:	1" = 100'	Kootenai County, Idaho
SHEET:	1 of 4	

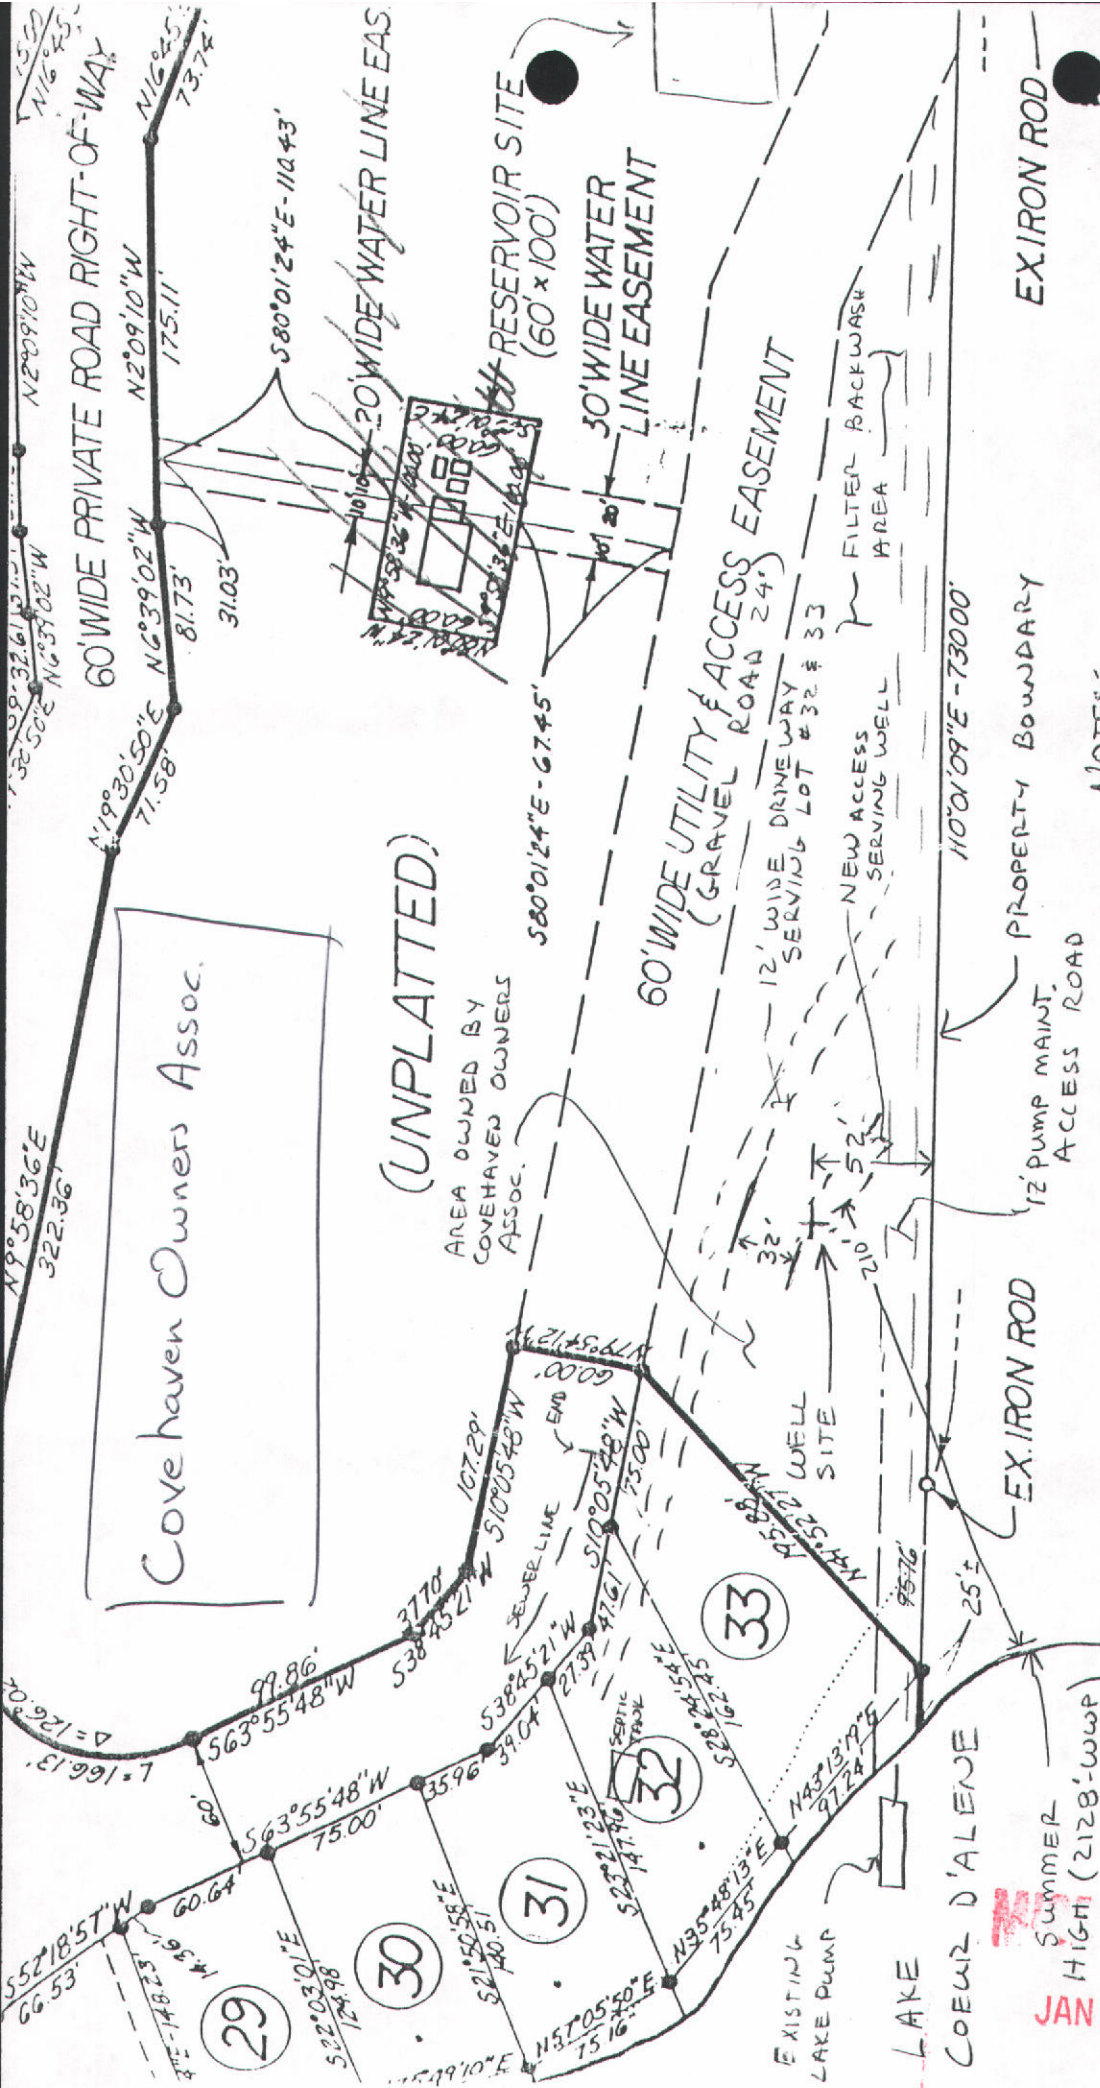


NOTES:

1. WELL SITE IS MORE THAN 50' FROM ANY SEWER LINE.
2. WELL SITE IS MORE THAN 100' FROM ANY SEPTIC TANK.
3. WELL SITE IS MORE THAN 100' FROM ANY DRAIN FIELD.
4. WELL SITE IS MORE THAN 200' FROM LAKE.
5. COVEHAVEN OWNERS ASSOC. OWNS AT LEAST A 50' RADIUS AROUND WELL SITE.
6. THERE IS A 12' GRAVEL DRIVEWAY (EASEMENT) SERVING LOT 32 & 33 PASSING 32' FROM WELL SITE.

SCALE: 1" = 87'

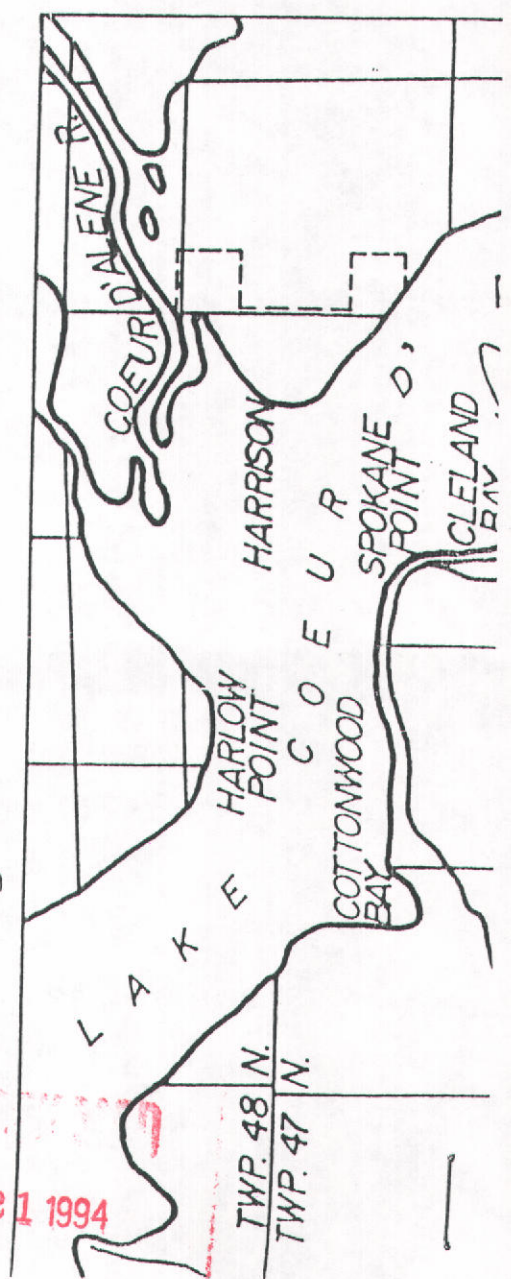

LAKE COEUR D'ALENE
(LOWMEISTER BAY)

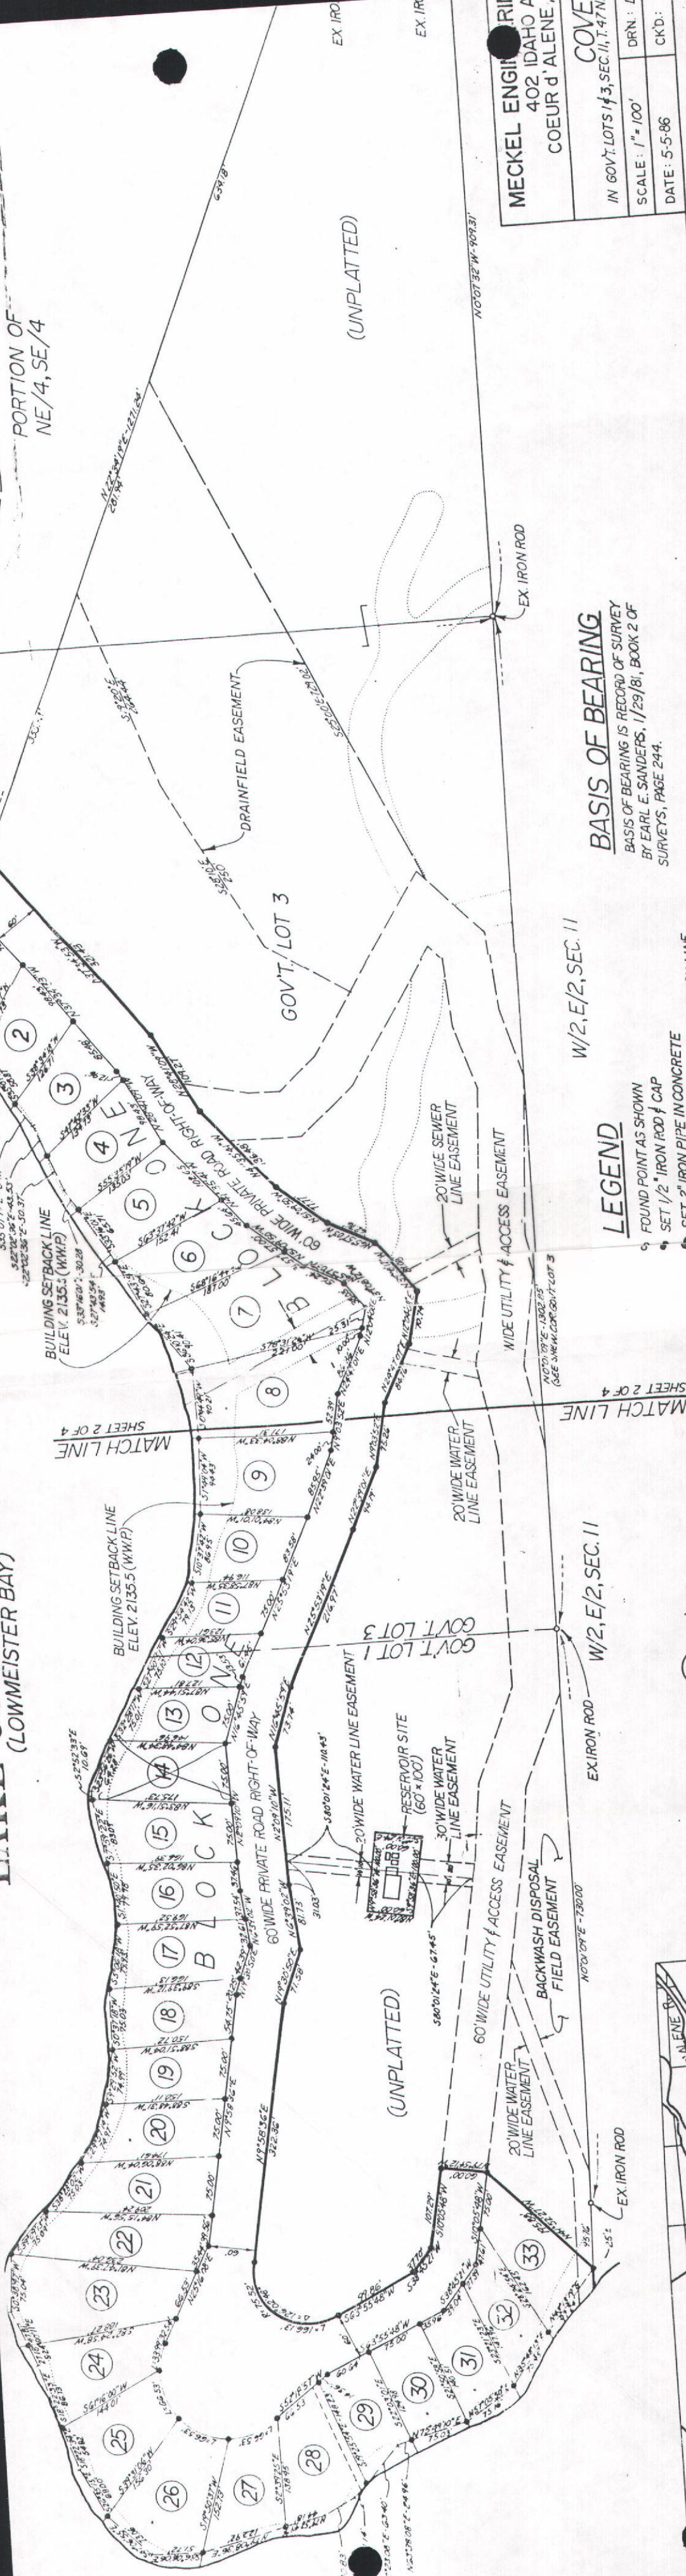

BASIS OF BEARING
BASIS OF BEARING IS RECORD OF SURVEY
BY EARL E. SANDERS, 1/29/81, BOOK 2 OF
SURVEYS, PAGE 244.

LEGEND

FOUND POINT AS SHOWN
SET 1/2" IRON ROD & CAP
SET 2" IRON PIPE IN CONCRETE
DRAINAGE ESMT./BUT BUTILITY EASEMENT

W/2 F/2 SEC. 11

MECKEL ENGINEERING
402 IDAHO AVE.
COEUR D'ALENE, ID.

COVE

IN GOVT LOTS 1 & 3, SEC. 11, T. 47N

DRN: L	
100' = 1" = 100'	


SCALE: 1" = 100'	ACK'D:

DATE: 5-5-86	CRS
--------------	-----

Covehaven Owners Assoc.

LEGEND

FOUND POINT AS SHOWN
SET 1 1/2" IRON ROD & CAP

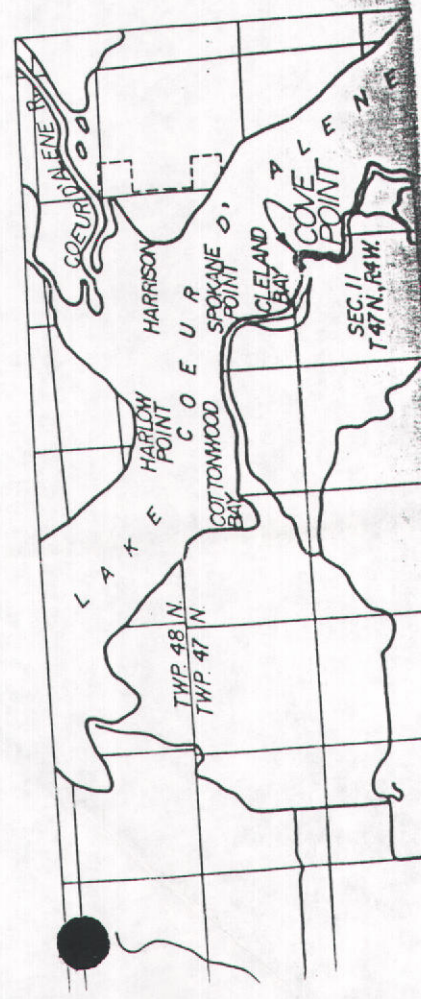

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

AMENDMENT OF PERMIT
PERMIT NO. 95-08834

This is to certify, that COVEHAVEN OWNERS ASSN INC
C/O JAMES R ALLEN
4343 GREY STONE LANE
SPOKANE WA 99223

has requested a change to the above captioned water right(s). This change in water right(s) is authorized pursuant to the provisions of Section 42-211, Idaho Code. The approved amendment of permit is described as follows:

SOURCE

GROUNDWATER

Priority: September 29, 1993

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.18 CFS
DOMESTIC	01/01 to 12/31	0.18 CFS
	Totals	0.18 CFS

LOCATION OF POINT(S) OF DIVERSION: Lot 1(NENE), Sec. 11, Township 47N, Range 04W
KOOTENAI County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
47N	04W	11	Lot 1(NENE) 10	Lot 3(ENE) 5		15

Total number of acres irrigated: 15

PLACE OF USE:

DOMESTIC, same as IRRIGATION use

CONDITIONS OF APPROVAL AND REMARKS

1. Subject to all prior water rights.
2. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
3. This right when combined with all other rights shall provide no more than 0.02 cfs per acre nor more than 3.5 afa per acre at the field headgate for irrigation of the lands above.
4. Domestic use is for 33 homes.
5. Three points of diversion are located within the NENE, S11, T47N, R4W.

Witness my hand this

13 th day of November, 1998

J. Blus Saylor
Chief, Water Allocation Bureau

MICROFILMED

NOV 2 / 1998

(Internet)

Receipt No. NO12373
 Received By [Signature]
 Date 9/1/98

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR AMENDMENT OF A PERMIT

RECEIVED

OCT 26 1998

Applicant Cove Haven Owners Association Phone 509 332 7526 Department of Water Resources

Address 4343 Grey Stone Lane Spokane, WA 99223

I am the owner and holder of Permit to appropriate the Public Waters of the State of Idaho No. 95-08834, and request that the permit and permit map be amended and/or changed as follows:

Purpose of Amendment: _____ Change point of diversion -x- Add point of diversion 2 new Wells
Change place of use _____ Change nature of use _____ Change period of use _____ Other _____

1. Point of diversion: 1/4 NE 1/4 NE 1/4, Section 11, Township 47N, Range 4W, B.M.
County of Kootenai, Other points of diversion GOVT LOT 1

2. Period and nature of use: (Irrigation, domestic, stockwatering, industrial, etc.)

Amount 0.18 cfs for Irrigation purposes from 3/15 to 11/15 (both dates inclusive)
(cfs or acre feet) (Begin month) (End month)

Amount 0.18 cfs for Domestic purposes from 1/01 to 12/31 (both dates inclusive)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(lets or acre foot per annum) (water use) (Begin month) (End month)

3. Place of use or land to be irrigated:

[illegible]


Total number of acres to be irrigated 15

4. a. Who owns the property at the point of diversion? Applicant
b. Who owns the land to be irrigated at the place of use? Members of Association
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

MICROFILMED

NOV 27 1958

See Attached Map
and Site Plan

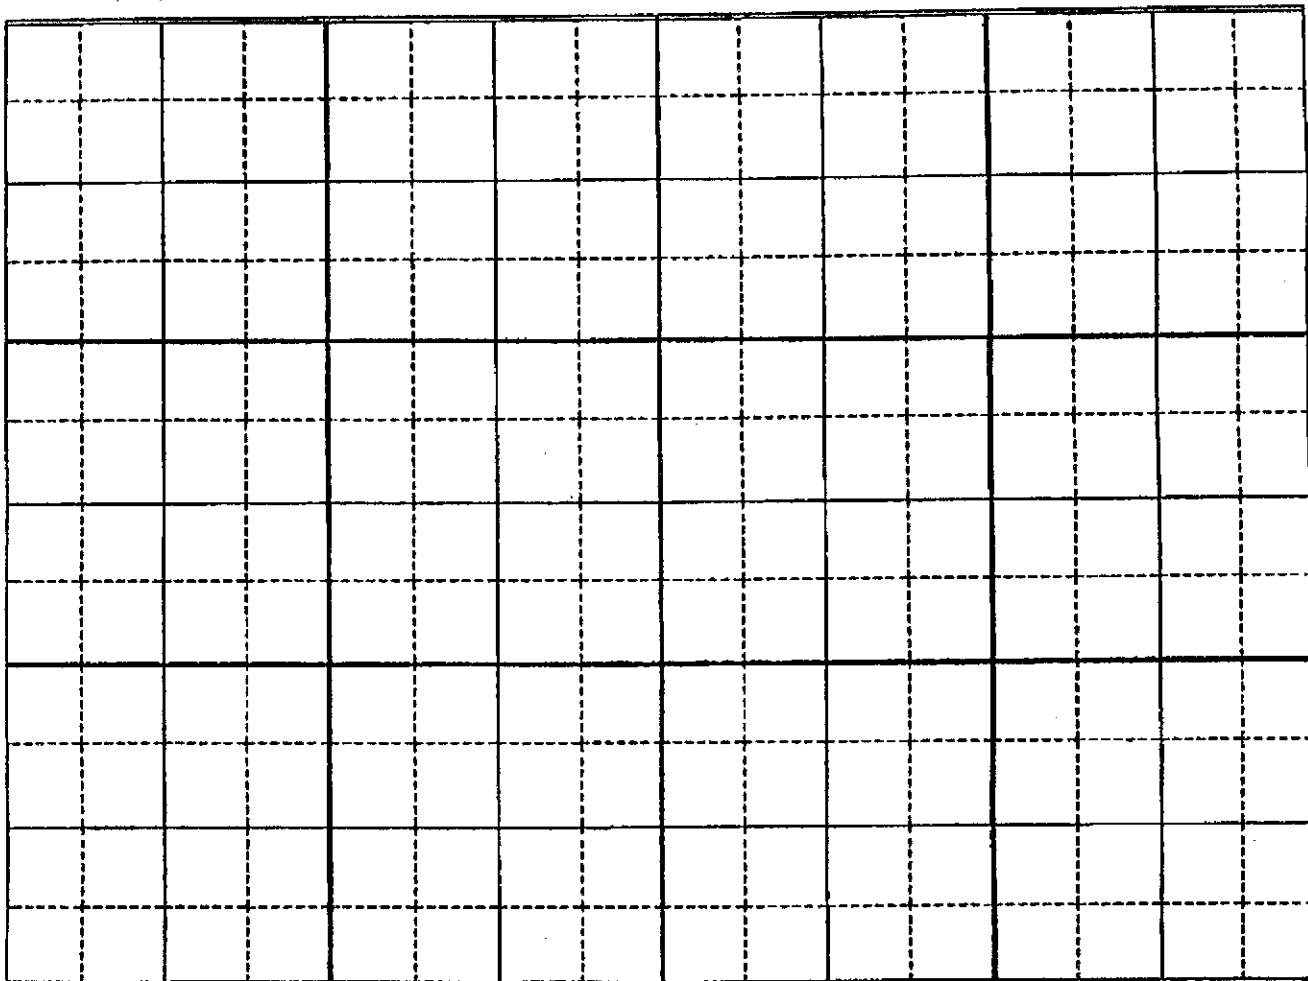

Butcher: 2 ranch/water sprayers & 1 tractor

I hereby request approval of this change subject to the fact that no one will be injured by the change, and that the change will be made at my own risk.

Signed this 19th day of May, 19 98

_____ President
Permit Holder
Carehaven Owners Assoc.

ACTION OF THE DEPARTMENT OF WATER RESOURCES

Preliminary check by JS Publication prepared by CC Date 9/23/98

Published in CIA Press Publication dates 10/1 + 8/198

I, _____, of the Department of Water Resources hereby

Witness my hand this _____ day of _____, 19____

SIGNATURE

MICROFILMED

NOV 27 1969

RECEIVED

OCT 21 1996

FOR OFFICE USE ONLY
Amt. of Fee \$: _____
Receipt No. _____
Receipt By: _____
Date Received: _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 95-08834 Telephone No. 208-658-3835

2. Name(s) of Permit Holder(s): Covehaven Owner's Association, Inc.

3. Mailing Address: 25630 Cove Point Road, Worley, ID 83876

4. Source of Water: groundwater If **GROUNDWATER** (well), Date Drilled: mo. 04 / yr. 96 ^{deepened}

a. Well Driller: H₂O Well Service, Inc. Drilling Permit Number: 95 - 93N - 246 - 000

b. **OPTIONAL:**
Pump Horsepower: _____ Pressure (psi): _____ Dynamic pumping level (ft): _____

5. Use(s) (as authorized by the water right permit):
22
Domestic (No. of households): potential 33 Stockwater (No. and type of stock): _____
Irrigation (No. of acres): _____ Other: _____

6. Total rate of diversion and/or volume for which proof is submitted: not determined cfs OR _____ acre feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)
(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device:	Is a measuring device required?	Yes <u>x</u> or No _____
	Has the measuring device been installed?	Yes <u>x</u> or No _____
Flow Measurement Port:	Is a flow measurement port required?	Yes _____ or No _____
	Has the measurement port been installed?	Yes _____ or No _____

8. Fee Enclosed: \$ see enclosed (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: Don Johnson Telephone Number: 208-689-3835

Address: 25630 Cove Point Road, Worley, ID 83876

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: *James R. Allen* Date: Oct 17, 1996
(include your title, if on behalf of company or organization)
President, Covehaven Owners Assoc.
MICROFILMED
DEC 02 1996

RECEIVED
NOV 27 1995

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Department of Water Resources

REQUEST FOR EXTENSION OF TIME
TO PROVIDE ADDITIONAL TIME IN WHICH TO SUBMIT PROOF OF
BENEFICIAL USE FOR A WATER RIGHT PERMIT

The Idaho Department of Water Resources will consider this form as a request that the permit holder(s) be granted an additional period of time under the provisions of Section 42-204, Idaho Code in which to complete development of a water right.

Permit No. 95-08834

Name(s) of Permit Holder: Covehaven Owners Association, Inc.

Mailing Address: 25630 Cove Point Road Worley, ID 83876

Date Proof is Due: December 1, 1995 Telephone No. (208) 689-3835

Describe what work has been completed toward the development of this water right:
(This must be filled out! If no work has been completed, show "none".)

Well has been drilled to a depth of 190 ft. which provides a low yield of
about 450 gal/day. Because this volume is inadequate for a development of
24 homes and because we have the potential to improve yield by drilling
deeper, we propose to deepen the well.

Costing \$ \$5,500.00

The permit holder(s) has been unable to complete the remainder of the work for the following reasons:

Permit holder(s) request an extension to 1 November, 19 96.

FEE: \$50.00

[Signature] 11-25-95
(Signature)* President, Covehaven Owners Assoc.
*If other than permit holder, Power of Attorney must be supplied.

ACTION OF THE DEPARTMENT OF WATER RESOURCES

IT IS HEREBY ORDERED that the above request for extension of time be APPROVED and the time within which to submit proof of beneficial use is extended to December 1, 1996.

Signed this 5th day of December, 19 95.

[Signature]
JAN 31 1996
Chief, Water Allocation Bureau

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 95-08834

Proposed Priority: September 29, 1993 Maximum Diversion Rate: 0.18 CFS

This is to certify, that **COVEHAVEN OWNERS ASSN INC**
JAMES R ALLEN PRESIDENT
RT 1 BOX 71A
WORLEY ID 83876

has applied for a permit to appropriate water from: **GROUNDWATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.18 CFS
DOMESTIC	01/01 to 12/31	0.18 CFS
	Totals	0.18 CFS

LOCATION OF POINT(S) OF DIVERSION: Lot 1(NENE), Sec. 11, Township 47N, Range 04W
KOOTENAI County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
47N	04W	11	Lot 1(NENE) 10	Lot 3(SENE) 5		15
Total number of acres irrigated:						15

PLACE OF USE: DOMESTIC, same as IRRIGATION use

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before **December 1, 1995**.
2. Subject to all prior water rights.
3. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which permit holder had no control.
4. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
5. A well drilled pursuant to this permit must be located at least 500 feet from any existing well. Well spacing closer than 500 feet must be approved by the Department of Water Resources.
6. Construction of the well must comply with Idaho well construction standards.
7. The rate of diversion of water for irrigation under this right and all other water rights on the same land shall not exceed 0.02 cubic feet per second for each acre of land.

APPROVED

JAN 21 1994

State of Idaho
Department of Water Resources

Permit To Appropriate Water


NO. 95-08834

CONDITIONS/REMARKS:

8. Domestic use is for 33 homes.
9. The domestic use authorized under this permit shall not exceed 13,000 gallons per day per dwelling in accordance with Section 42-111, Idaho Code.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

16th day of November, 1993

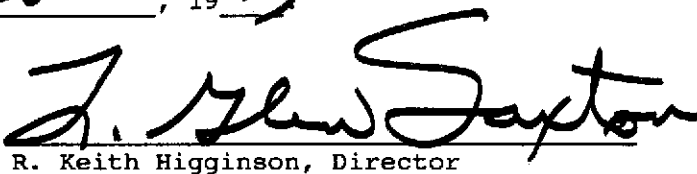
R. Keith Higginson, Director

for

RECEIVED
JAN 21 1994

JAN 21 1994

RECEIVED
10/92
NOV 09 1993

Ident. No. 95-8834

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Department of Water Resources

To appropriate the public waters of the State of Idaho

James R. Allen, President

1. Name of applicant Covehaven Owners Association Inc Phone (509) 332-7526 (work)

Post office address Rt. 1 Box 71A Worley ID 83876

2. Source of water supply ground water which is a tributary of N.A.

3. Location of point of diversion is 1/4 of NE 1/4 of NE 1/4, Govt. Lot 1

Sec. 11 Township 47 N Range 4 W B.M. Kootenai County; additional

points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 0.18 cfs for Domestic purposes from Jan 1 to Dec 31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount 0.18 for IRRIGATION purposes from 5/15 to 11/15 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) 0.18 cfs and/or (b) _____
cubic feet per second acre feet per annum

6. Proposed diverting works: (1) WELL, RESERVOIR & DELIVERY SYSTEM

a. Description of ditches, flumes, pumps, headgates, etc. (1) WELL, RESERVOIR & DELIVERY SYSTEM

b. Height of storage dam N.A. feet; active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet; period of year when water will be diverted to storage: _____ to _____ inclusive.

c. Proposed well diameter is 8 inches; proposed depth of well is 200 feet.

d. Is ground water with a temperature of greater than 85°F being sought? No

e. If well is already drilled, when? No; Drilling firm N.A. JAN 21 1994

Well was drilled for (well owner) N.A.

7. Time required for the completion of the works and application of the water to be proposed beneficial use is 2 years (minimum 1 year).

a. Hydropower; show total feet of head and proposed capacity in KW. N.A.

b. Stockwatering; list number and kind of livestock. N.A.

c. Municipal; show name of municipality. N.A.

d. Domestic; show number of households. 33

e. Other; describe fully. _____

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

[illegible]


5

Surface water - Lake Coeur d'Alene

b. Who owns the land to be irrigated or place of use? 33 owner / members of Covahaven Owners Association Inc

12. Remarks:

JAN 21 1994

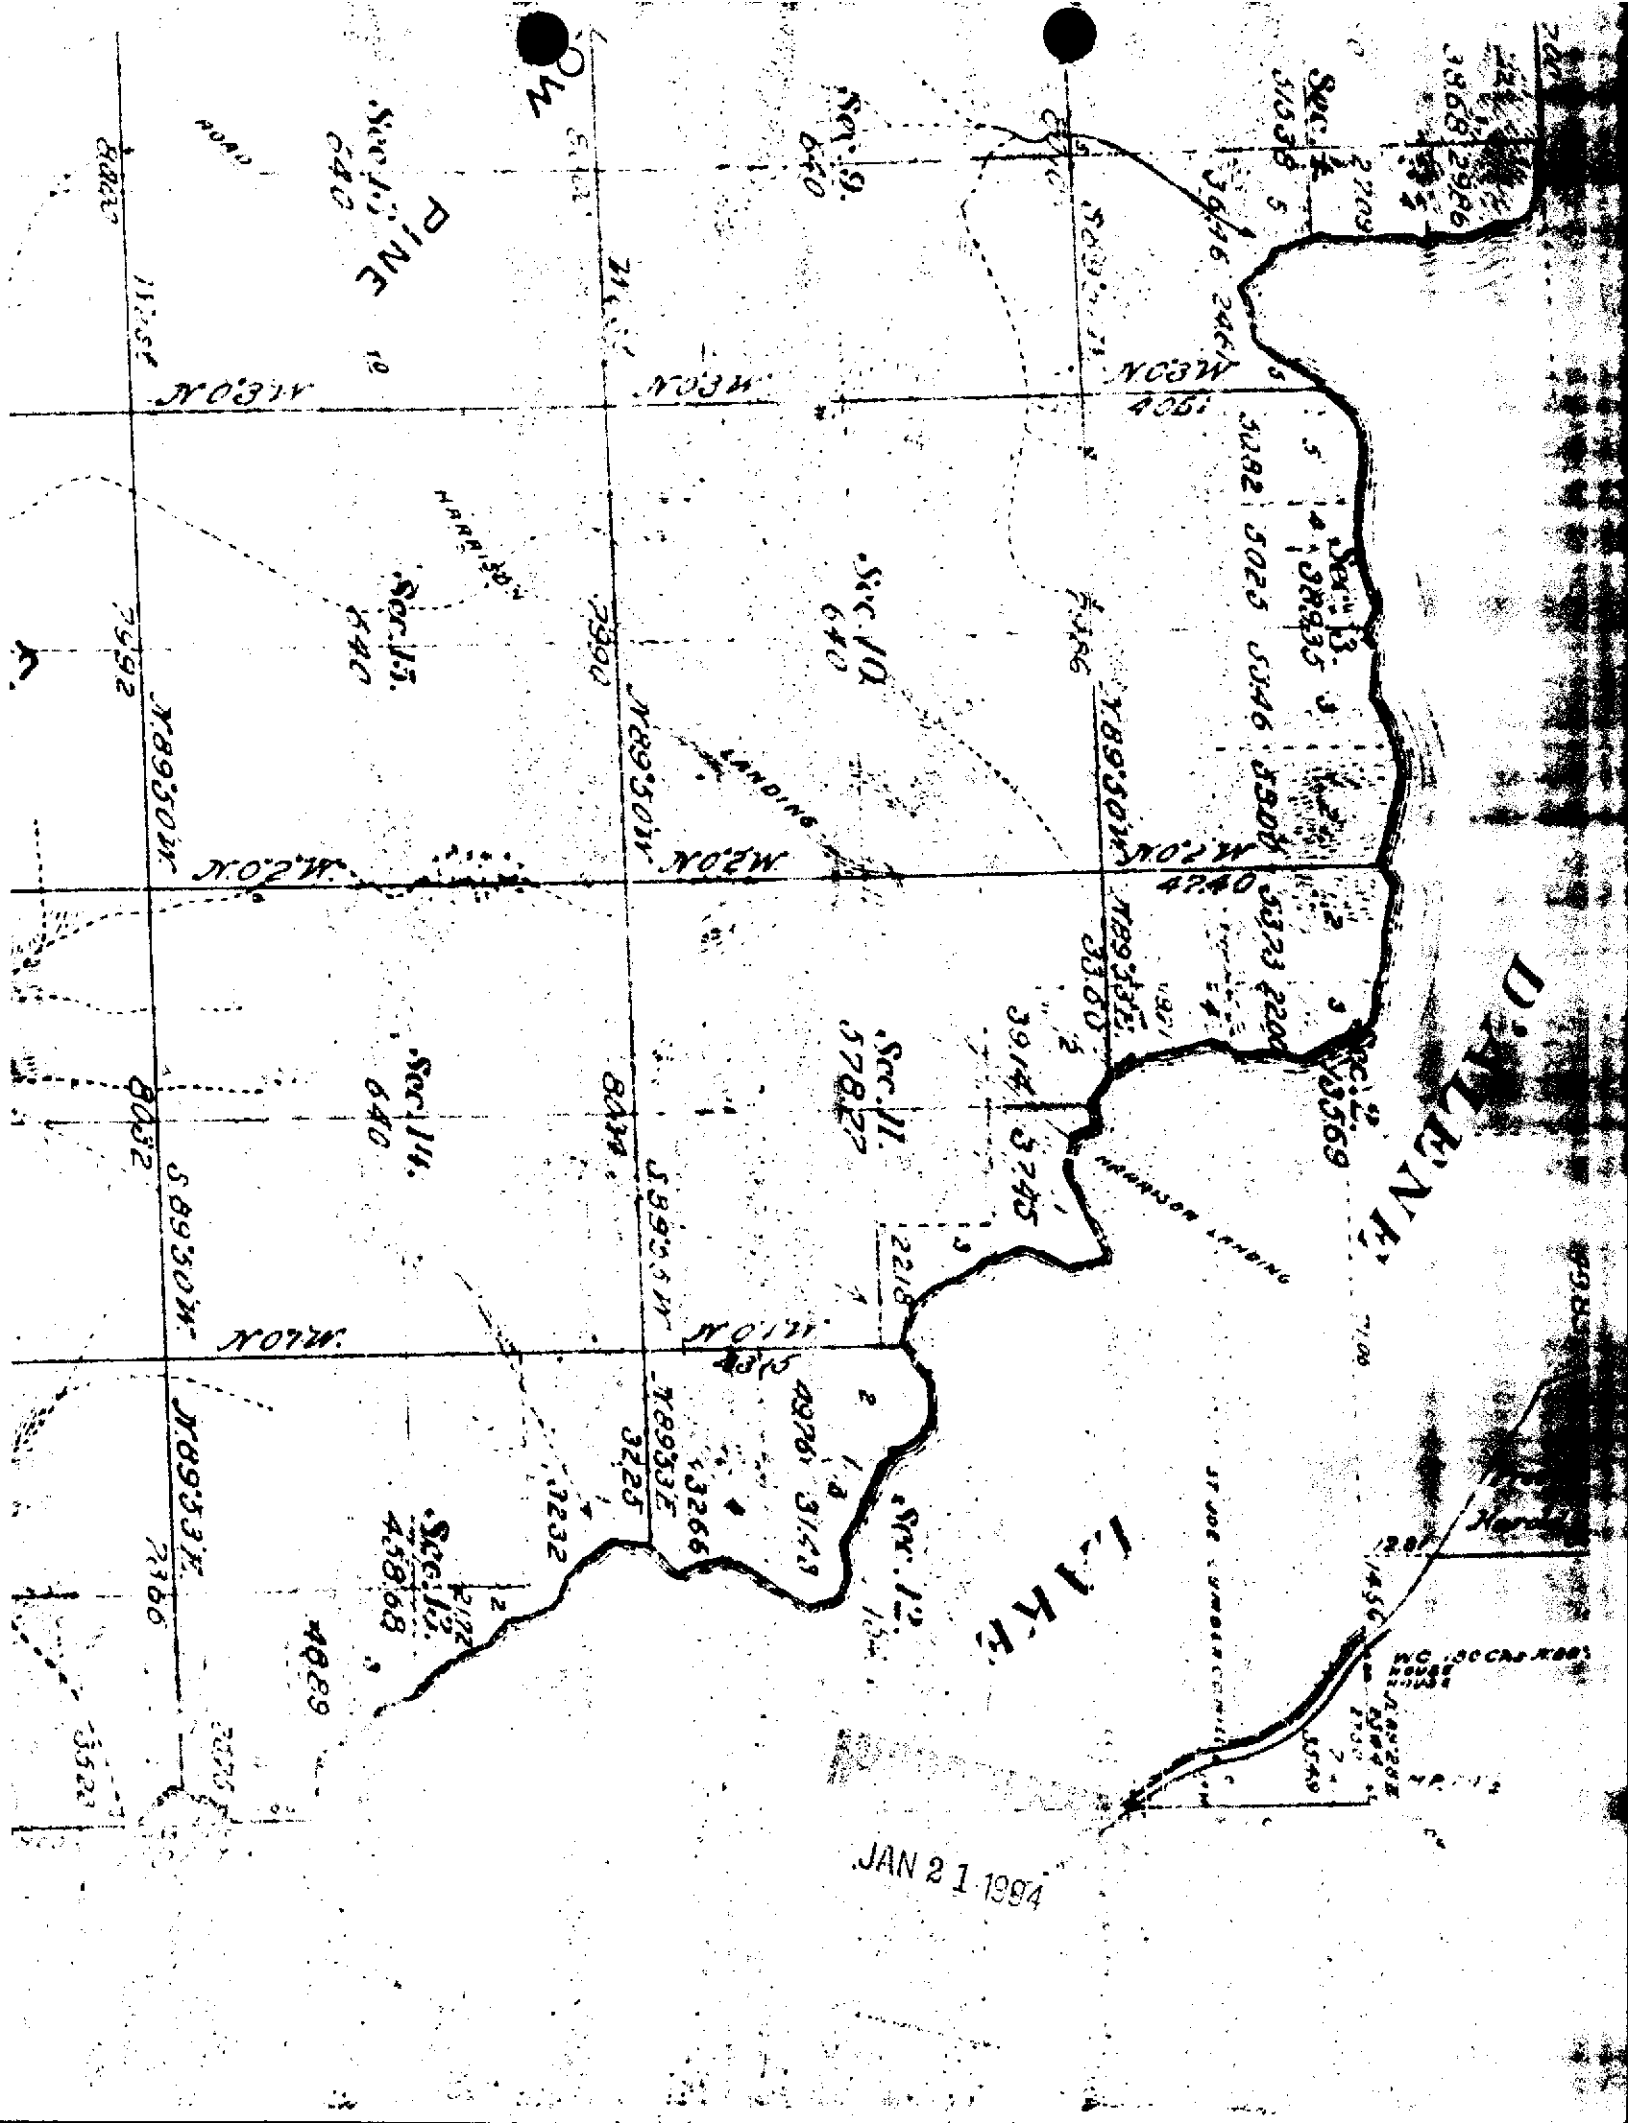

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number. *See attached*

See attached

[illegible]

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

James Allen, President
(Applicant)
Covehaven Owners Association Inc.

JAN 21 1994

10/21/93

e. Other:

d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.

c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.

19

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

1. Approval of said application is subject to the following limitations and conditions:

Idaho No. _____, and said application is hereby _____

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

Received by	Date	Time	Preliminary check by
<i>[Signature]</i>	9/29/93	2:00 PM	<i>[Signature]</i>
Fee \$	30.00	Received by	Date
		<i>[Signature]</i>	9/29/93
		#	N 7017
		Date	10/21/93
		Published in	10/21-28/93
		Date	10/21/93
		Publication prepared by	<i>[Signature]</i>
		Publication approved	<i>[Signature]</i>

Responding to Preliminary Orders Issued by the Idaho Department of Water Resources

The Idaho Department of Water Resources (Department) issues water right permits, licenses, and transfers as preliminary orders pursuant to section 67-5243, Idaho Code. A preliminary order can and will become a final order without further action of the department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of the order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from a preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, a preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to a preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

ORAL ARGUMENT

If the Department grants a petition to review a preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

MICROFILMED
NOV 27 1998

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with a preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

NOTED

NOV 27 1998

AMENDMENT OF PERMIT REVIEW

Review Date 10/26/98

PERMIT NO. 95-08834 NAME Cove Haven Owners Assn.

TYPE: A = AMENDED E = CHANGE N/U I = CHANGE P/D & P/U
B = CHANGE P/D F = CHANGE Per/U J = ADD P/D & CHANGE P/U
C = ADD P/D G = OTHER
D = CHANGE P/U H = CHANGE P/D & + P/D

AREA OF CONCERN: _____ Mor _____ GWMA Trust/Non-trust

PROOF OF B/U RECEIVED? (Yes) Due < 6 months? Yes/No

GROUNDWATER:

Drilling Permit No. _____;
Drilled _____

95-93-N-0246-000 10" 175'
8" 280'
deeper 100 6" 190'
deeper 101 5" 240'
12/93
7/94
1/96
100+ gpm
30+ gpm

Swan Falls Flag _____

Conditions of Approval: ~~041~~?, 046, R43

Remarks/Comments D/33 homes.

3 fld in NENE

State of Idaho
Department of Water Resources
AMENDMENT ANALYSIS SHEET

INITIAL REVIEW BY: [Signature]

Right Number 95-08834 Applicant COVE HAVEN
Purpose of Amendment: ☐ Change point of diversion. ☒ Add diversion point(s).
☐ Increase amount. ☐ Change place of use. ☐ Other _____

CHECK:

- ☒ Description of amended point(s) of diversion.
- ☒ Amount, nature and period of use. If increased, delay date of priority.
- ☒ Description of amended places of use. If expanded, delay date of priority.
- ☒ Ownership of point of diversion and place of use.
- ☒ Map.
- ☒ Signature (must be permit holder).
- ☒ Fee.
- ☒ Existing water rights from the same source, amended place of use.
- ☐ Right number(s) _____
- ☒ Yes ☐ No Should amendment be advertised?
- ☐ Yes ☐ No Should date of priority be delayed? If yes, to what date? _____

To dda Pres 9/23/98
Final prot. date 10/19/98
Transferred to SC
to Janet 9/23/98

FINAL REGIONAL PROCESSING REVIEW:

- ☐ Affidavit of publication received.
- ☐ Amendment published correctly.
- ☐ Protests processed.
- ☐ Approve.
- ☐ Deny.

Conditions _____

By [Signature] Date 10-20-98

STATE OFFICE PROCESSING:

- ☐ Amendment correct and complete. By _____ Date _____
- ☐ Approved copy sent to applicant and to Region. By _____ Date _____

NOTICE OF AMENDMENT

NOTICE IS HEREBY GIVEN THAT APPLICATION FOR PERMIT NO. 95-08834 in the name of Covehaven Owners Association, 4343 Grey Stone Lane, Spokane, WA 99223, was amended.

The location of the point of diversion was originally described as an individual well located in T47N R04W SEC 11, GOVERNMENT LOT 01 (NENE); whereas, amended it is described as the original well plus two additional wells located in T47N, R04W SEC 11, GOVERNMENT LOT 01, (NENE), for a total of three wells located in T47N R04W SEC 11, GOVERNMENT LOT 01 (NENE).

(For additional information concerning the property location, call the Northern Regional Office at 769-1450.)

Any protests against the approval of the above-referenced amendment must be filed with the applicant and with the Director, Dept. of Water Resources, 1910 Northwest Blvd., Suite 210, Coeur d'Alene, Id. 83814, together with a protest fee of \$25.00 on or before October 19, 1998.

KARL J. DREHER, DIRECTOR

Published in the Coeur d Alene Press on October 1 and 8, 1998.

RECEIVED

NOV 27 1998

SD-0603-2 Township: 47N Range: 04W				Section: 11	Tract:	Lot:			
S	Year:	Region:	Max # Records	12	L				
E	A	Permit	Name	W	S	O	Approval	S	
L	Sec Tract	Lt c	Number	Last, First	U	T	G	P	
							Date		
	NENE	V	95-96-N-0154-000	SCHWEITZER, ED	D	C	00/00/0000		
	NENE 01		95-93-N-0246-000	ALLEN, JAMES R	C	P L	12/13/1993		
	NENE 01 L		95-93-N-0246-100	ALLEN, JAMES R	C	P L	12/13/1993		
	NENE 01 L		95-93-N-0246-101	ALLEN, JAMES R	C	F L	01/10/1996		
	NWNE	L	95-97-N-0043-000	SCHWEITZER, EDWARD	D	F L	06/05/1997		
	NWNE		95-93-C-0075-000	KELLY, DAVE	D	P L	05/10/1993		
	#2* NWNE	L	95-97-N-0053-000	COVEHAVEN OWNERS AS	C	F L	06/19/1997		
	#3* NWNE	L	95-97-N-0107-000	COVEHAVEN OWNERS AS	C	P L	09/15/1997		
	SENE		95-87-N-0070-300	BUDDRIUS, DEWAYNE S	D	L	00/00/0000		
	SENE		95-87-N-0071-000	BUDDRIUS, DEWAYNE S	D	L	00/00/0000		
	SENE		95-87-N-0075-300	BUDDRIUS, DEWAYNE	D	L	00/00/0000		
	NESE		95-87-N-0077-000	ZEUBCHEL, ALAN	D	L	00/00/0000		

(Enter=Continue)

(GOLD7=This Query)

(Menu _____)

MICROFILMED
NOV 27 1998

Permit No. 95-08834 Reviewed by [Signature] Date 11-21-96

TYPES OF USE

dom.

Correct Uses? yes

SOURCE OF WATER

✓ Ground water source

no Copy in the file? Drilling Permit No. 95-93-N-0246-000

yes Correct?

LICENSE EXAMINATION FEE

MEASURING DEVICE

no Required?

YES Installed?

Waiver requested?

Date proof received

Date proof due

No. of days late

Priority Date

New Priority Date

DEFICIENCIES OR ACTION ITEMS

DEFICIENCIES OR ACTION ITEMS
Advise permit holder of domestic limitations.
Proof acceptable.

DATA ENTRY

New Address 10-21-96 Proof Made

ANALYSIS SHEET FOR EXTENSION OF TIME

Permit No. 95-08834 Reviewed by JY Date 12-5-95

BASIC INFORMATION

11-27-95 Date stamp received
yes Extension received timely
yes Fee received and receipted
yes Name and signature same as permit
yes Address Change

BASIS FOR EXTENSION REQUEST

yes Has adequate work been completed to demonstrate due diligence?
_____ Has the permit been involved in litigation?
Is supporting documentation needed to complete the file? _____ Requested? _____
_____ Is delay by a government agency?
Is supporting documentation needed to complete the file? _____ Requested? _____
_____ Is the project more than 25,000 acre feet for irrigation or 10,000 acre feet for a reservoir?

ACTION TAKEN

Recommend extend to Dec. 1, 1996, on basis of due diligence.

PRIORITY CALCULATION

Date extension received	_____	=	_____
Proof due date	_____	=	_____
Number of days late	_____	=	_____
Priority date	_____	=	_____
New Priority Date	_____	=	_____

DATA ENTRY

New Address 25630 Cove Point Wy.
Change Proof Due Date 12-1-96
Change Priority Date X

RECEIVED

IDAHO DEPARTMENT OF WATER RESOURCES

JUL 03 1996

WELL DRILLER'S REPORT

Use Typewriter or Ballpoint Pen

Office Use Only			
Inspected by			
Twp	Rge	Sec	
1/4	1/4	1/4	
Lat	:	:	Long

1. DRILLING PERMIT NO. 95-93-N-246-101

Other IDWR No.

95-08834

2. OWNER

Well Number:

Name COVEHAVEN OWNERS ASSOC. 378


Address RT 1 BOX 71-A

City WORLEY

State ID Zip 83867

3. LOCATION OF WELL by legal description

sketch map location must agree with written location

Twp. 47 ☒ North or ☐ SouthRge. 04 ☐ East or ☒ West

E Sec. 11 1/4 NE 1/4 NE 1/4

Gov't Lot County KOOTENAI

Lat: : : Long: : :

Address of Well Site Above Lowmiester Bay
City

(Give at least name of road + Distance to Road or Landmark)

Lt. Blk. Sub. Name

4. USE:

☐ Domestic ☒ Municipal ☐ Monitor ☐ Irrigation☐ Thermal ☐ Injection ☐ Other

5. TYPE OF WORK check all that apply (Replacement, etc.)

☐ New Well ☒ Modify ☐ Abandonment ☒ Other Deepen 2nd time

6. DRILL METHOD

☒ Air Rotary ☐ Cable ☐ Mud Rotary ☐ Other

7. SEALING PROCEDURES

SEAL/FILTER PACK			AMOUNT	METHOD
Material	From	To	Sacks or Pounds	

Was drive shoe used? ☐ Y ☐ N Shoe Depth(s)Was drive shoe seal tested? ☐ Y ☐ N How?

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
5	175	235	.250	STEEL	☒	☐	☒	☐

Length of Headpipe Length of Tailpipe

9. PERFORATIONS/SCREENS

☒ Perforations Method TORCH☐ Screens Screen Type

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
215	235	1/4X6	40	5	STEEL	☒	☐

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

184 ft. below ground Artesian pressure lb.

Depth flow encountered ft. Describe access port or control devices:

11. WELL TESTS:

☐ Pump ☐ Bailor ☒ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
30+			

Water Temp. Bottom Hole Temp

Water Quality test or comments:

Depth first Water encountered

12. LITHOLOGIC LOG:(Describe repairs or abandonment)

				Water	
Bore Diam	From	To	Remarks: Lithology, Water Quality, Temperature	Y	N
6	190	235	Basalt Broken	☒	☐
6	235	240	Clay Redish Brown	☐	☒
	0	0	Basalt Interbeds	☐	☐
	0	0	2 Hours Development time	☐	☐
	0	0	3 Hours to Open Hole up for 5" casing	☐	☐
RECEIVED AUG 22 1996 Department of Water Resources MICROFILMED DEC 02 1996					
Completed Depth 239' (Measurable)					
Date: Started 04/22/96 Completed 04/23/96					

13. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Firm Name H2O WellService, Inc. Firm No. 448

Firm Official *[Signature]* Date 5-2-96

and

Supervisor or Operator *[Signature]* Date 5-3-96

(Sign Once if Firm Official and Operator)

NENE 11 47N 4W

APPLICATION FOR PERMIT
STATE OFFICE REVIEW

Application #: 95-8834 Date: 11/15/93 Reviewer: Cindy Zimmerman

AREA OF CONCERN? - No/Yes _____
SYSTEM COMPLETED:
No - 26A-P17
Complete in 1 year - P16
Yes
Proof not submitted - P16
Proof submitted - NA
GROUNDWATER:
+ 0.2 cfs <flo-ch> - 01G-P03 (new), 01C-P03 (existing), NMR
- 0.2 cfs - NMR <flow chart>
Drilling Permit:
Included w/permit - Permit No. _____, P99
Existing well - N/A (if drilled before 7/1/87)
No WD permit? - 046-46A<Irr>-46B-P23 (if drilled after 7/1/87)
SURFACE WATER: not in WD - 01C-P03 (+.2 w/pump), NMR <flow chart>
LOCATION:
Water District - WD No. _____
Surface water - 005 (req) 01J-P08 <flow chart>
(doesn't sink) or 01H-P01 <flow chart>; NMR
Groundwater - P05 (if well has not been drilled)
In stream channel - 030 (stream channel alteration)
Irrigation Dist. - 023
Canal Co. Areas - 023
Drainage Districts - 024
Flood Control Dist. - 063
Boise Front (63) - 058 (Groundwater temperature)
Swan Falls Flag - B <See condition code chart>
Trust - 051-052-053-P74 (Consumptive Uses), NA
Non Trust <1> - 048-049 (Consumptive Uses), NA
RIVER BASINS (Surface): Water District Control Condition (005) &....
Boise (63) - 05A (req), 11E (non-domestic use), NA
Payette (65) - 064(consump. use), 047-P04(Payette Lake), NA
Snake (01, 02 & 03) - 11A-P04 (01), 061-P07 (02/03 No W.D.Cond.), NA
USE:
Fish Propagation - 010/06A/09E-P10(WQ) & 07A-042 (req)
444 (N 1000 Spr)
Irrigation - 803(if GW use SW 1st)(+5A do POU comp.), NA
Power - 08A-17K-025-027 (req); 01F-P19; 09E-P10;
+25 cfs-P18; 17G(FERC) or 17M(FERE); 18B-P09
Mining - 06A/010/09E-P10 & 054 (req)
Storage(✓ 3 compo.) - 18A-for multi MD in WD, 18B-P09 (+10' dam), NA
Domestic (surface) - 021(Boise R + L Peak), 27A(Payette R), NA
OWNERSHIP:
Non land owner - 004 (P/D or P/U)
PROTESTED:
Prehearing agreement- 020
OTHER CONDITIONS: -
REMARKS: - ① W01(33) ② W04 ③ W05
BENEFICIAL USE DUE: - 12-1-1995
COMMENTS: - ① Div Desc.

No. a
4/87-06/92n

IDAHO DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

RECEIVED
NOV 09 1993

APPLICATION # _____

Department of Water Resources

***** INITIAL REVIEW *****

APPLICANT: COVENHAGEN BY: AB DATE: 10/1/93

ITEM REQUIRED INFORMATION

1. ☒ Name and Address
2. ☒ Source
3. ☒ Point of Diversion & County
4. ☒ Quantity
☒ Nature of Proposed Use
☒ Period of Use
5. ☒ Total Quantity
6. ☒ Description of diverting works
7. ☒ Time required for b/u
8. ☒ Proposed use
9. ☒ Place of use or acres irrigated
10. ☒ Other Water Rights
11. ☒ Ownership
13. ☒ Map
☒ Signature
☒ Fee (Amt, recpt, acknowledgment)

*** Send info sheet Y() N()

ADDITIONAL INFORMATION

Yes No

- ☒ Field check: by _____
☒ Field report attached
☒ Analysis Supp. attached(>5cfs/500af)
☒ Water delivered by water master?
Water District # _____

PROCESSING

Yes No

PRIORITY DATE: 9/29/93

☒ (Include Moratorium Remark)

☒ Statewide Avertising: (Diversion rate greater than 10 cfs or 1,000 af).

ADVERTISE IN: KOOTENAI County.

LETTERS SENT REQUESTING:

- () Dam Information () Fish Information
() Power Information () Other: ☒

INFORMATION RECEIVED:

- () Dam Information () Fish Information
() Power Information () Other: ☒

LIST OF OFFICERS

***** GROUNDWATER SECTION *****

(Yes) (No)

Checked by: _____ Date: ____/____/____

Remarks: _____

- ____ Groundwater management area
____ Critical ground water area
____ Well Drilling Permit required
____ Well Drilling Application and Fees received
____ Well Drilling Application approved?
____ Well Drilling Application Number _____

***** FINAL REGIONAL PROCESSING/REVIEW *****

(Yes) (No)

- ____ Notice of pending void order issued. Final order response date: ____/____/____
____ Further information required from applicant
☒ Affidavit of publication received
☒ Application published correctly, If not, record action taken: _____
☒ Publication dates and paper recorded on application | Sr. Agent initial AB
____ Protests received. Final protest date: 11/8/93
____ Measuring device required
____ Measuring port required
____ Special conditions: _____
____ Special conditions of approval supplement and/or cover letter attached:

Approval Recommended by: AB RMA Date: 11/2/93

**Covehaven Owners Association, Inc.
Officers and Board of Managers
1993**

**James R. Allen, President
NE 1165 Lybecker
Pullman, WA 99163**

**Robert Redmond, Secretary/Treasurer
E. 3807 16th
Spokane, WA 99223**

**Donald Johnson
Rt. 1 Box 71A
Worley, ID 83876**


**Sallie Gordon
25680 S. Cove Point Rd
Worley, ID 83876**

**Richard Herdner
S. 5615 Willamette
Spokane, WA**

Note: The above are mailing addresses. All board members own property in the Covehaven development.

MISSOURI MED

JAN 21 1994

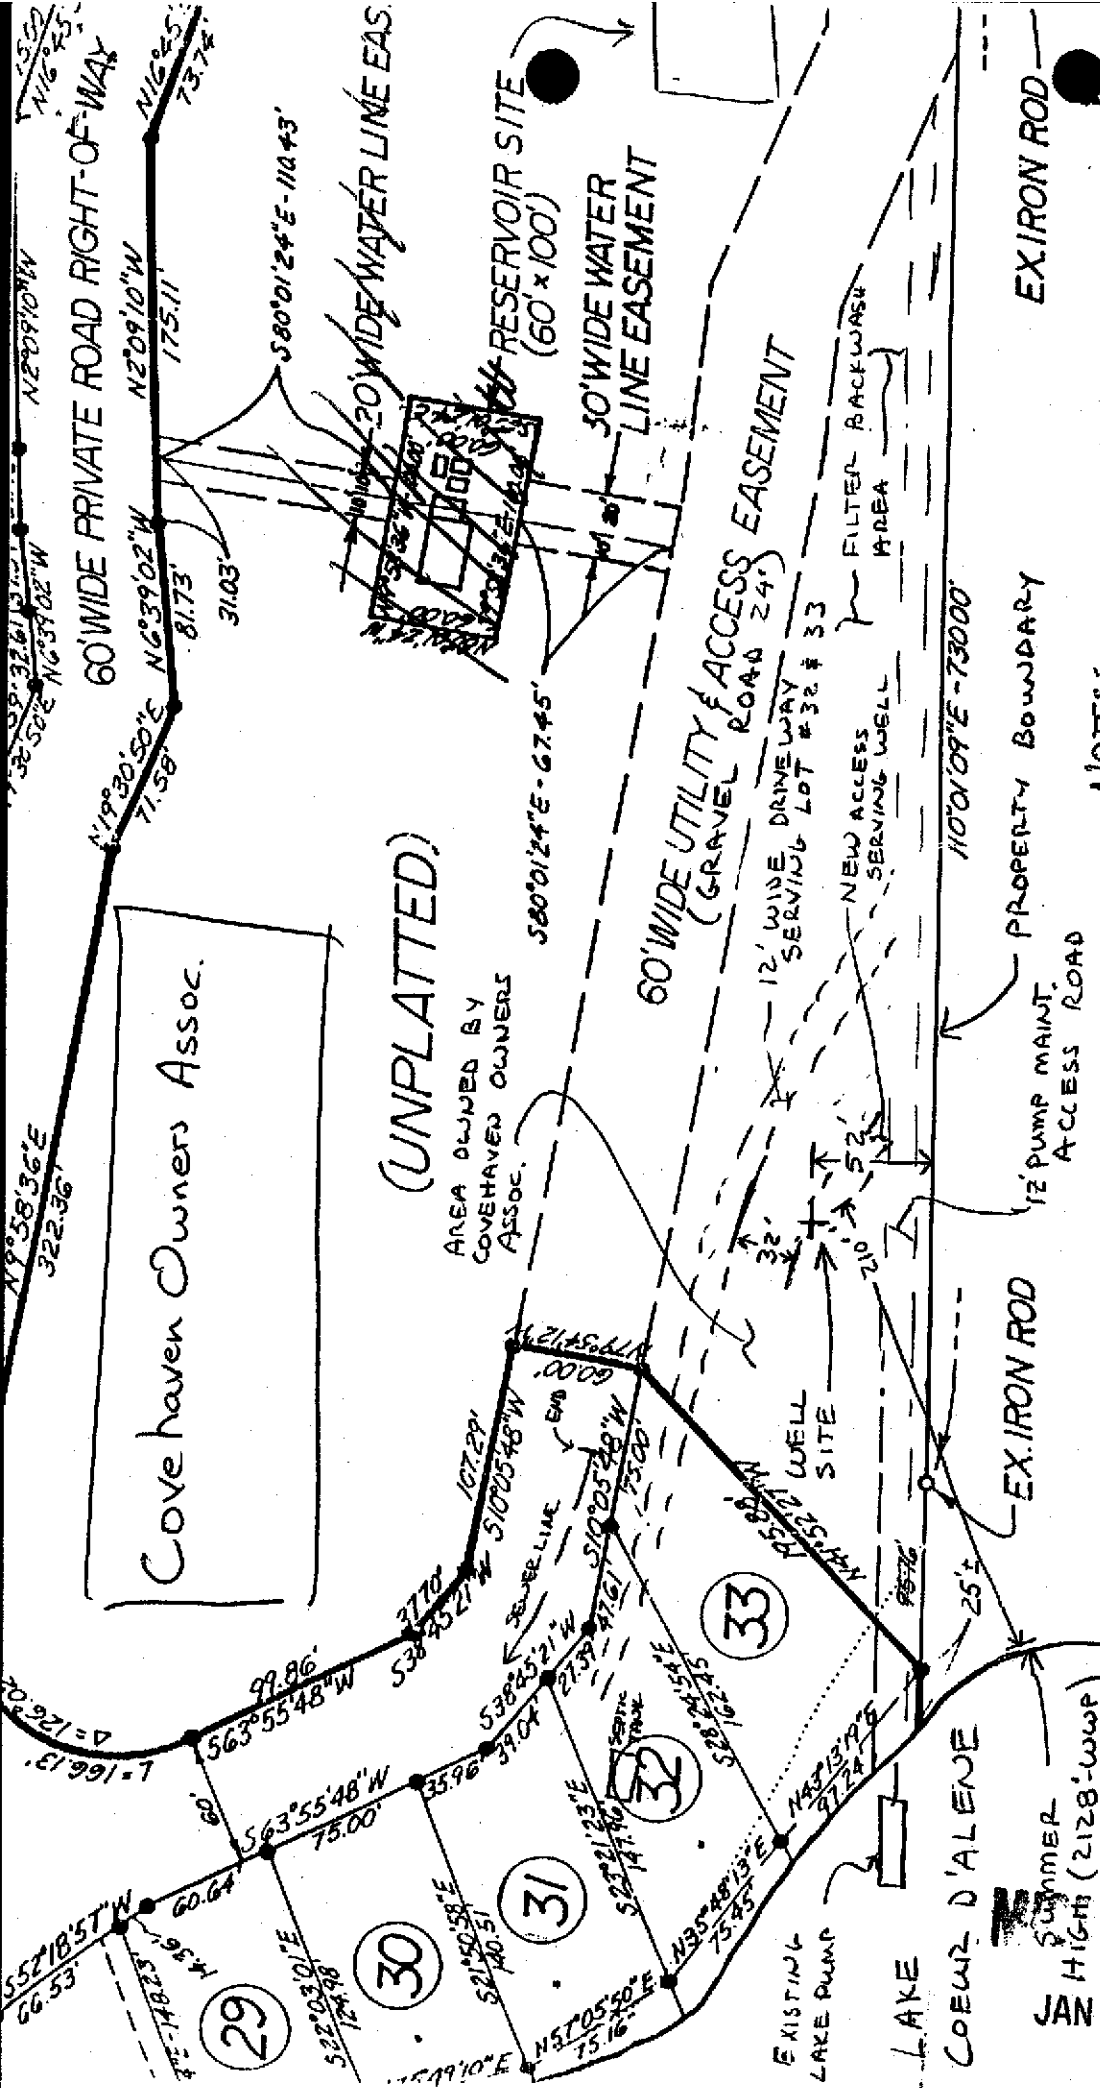


NOTES:

1. WELL SITE IS MORE THAN 50' FROM ANY SEWER LINE.
2. WELL SITE IS MORE THAN 100' FROM ANY SEPTIC TANK.
3. WELL SITE IS MORE THAN 100' FROM ANY DRAIN FIELD.
4. WELL SITE IS MORE THAN 200' FROM LAKE.
5. COVEHAVEN OWNERS ASSOC. OWNS AT LEAST A 50' RADIUS AROUND WELL SITE.
6. THERE IS A 12' GRAVEL DRIVEWAY (EASEMENT) SERVING LOT 32 & 33 PASSING 32' FROM WELL SITE.

SCALE: 1" X 87'

LAKE COEUR D'ALENE (LOWMEISTER BAY)

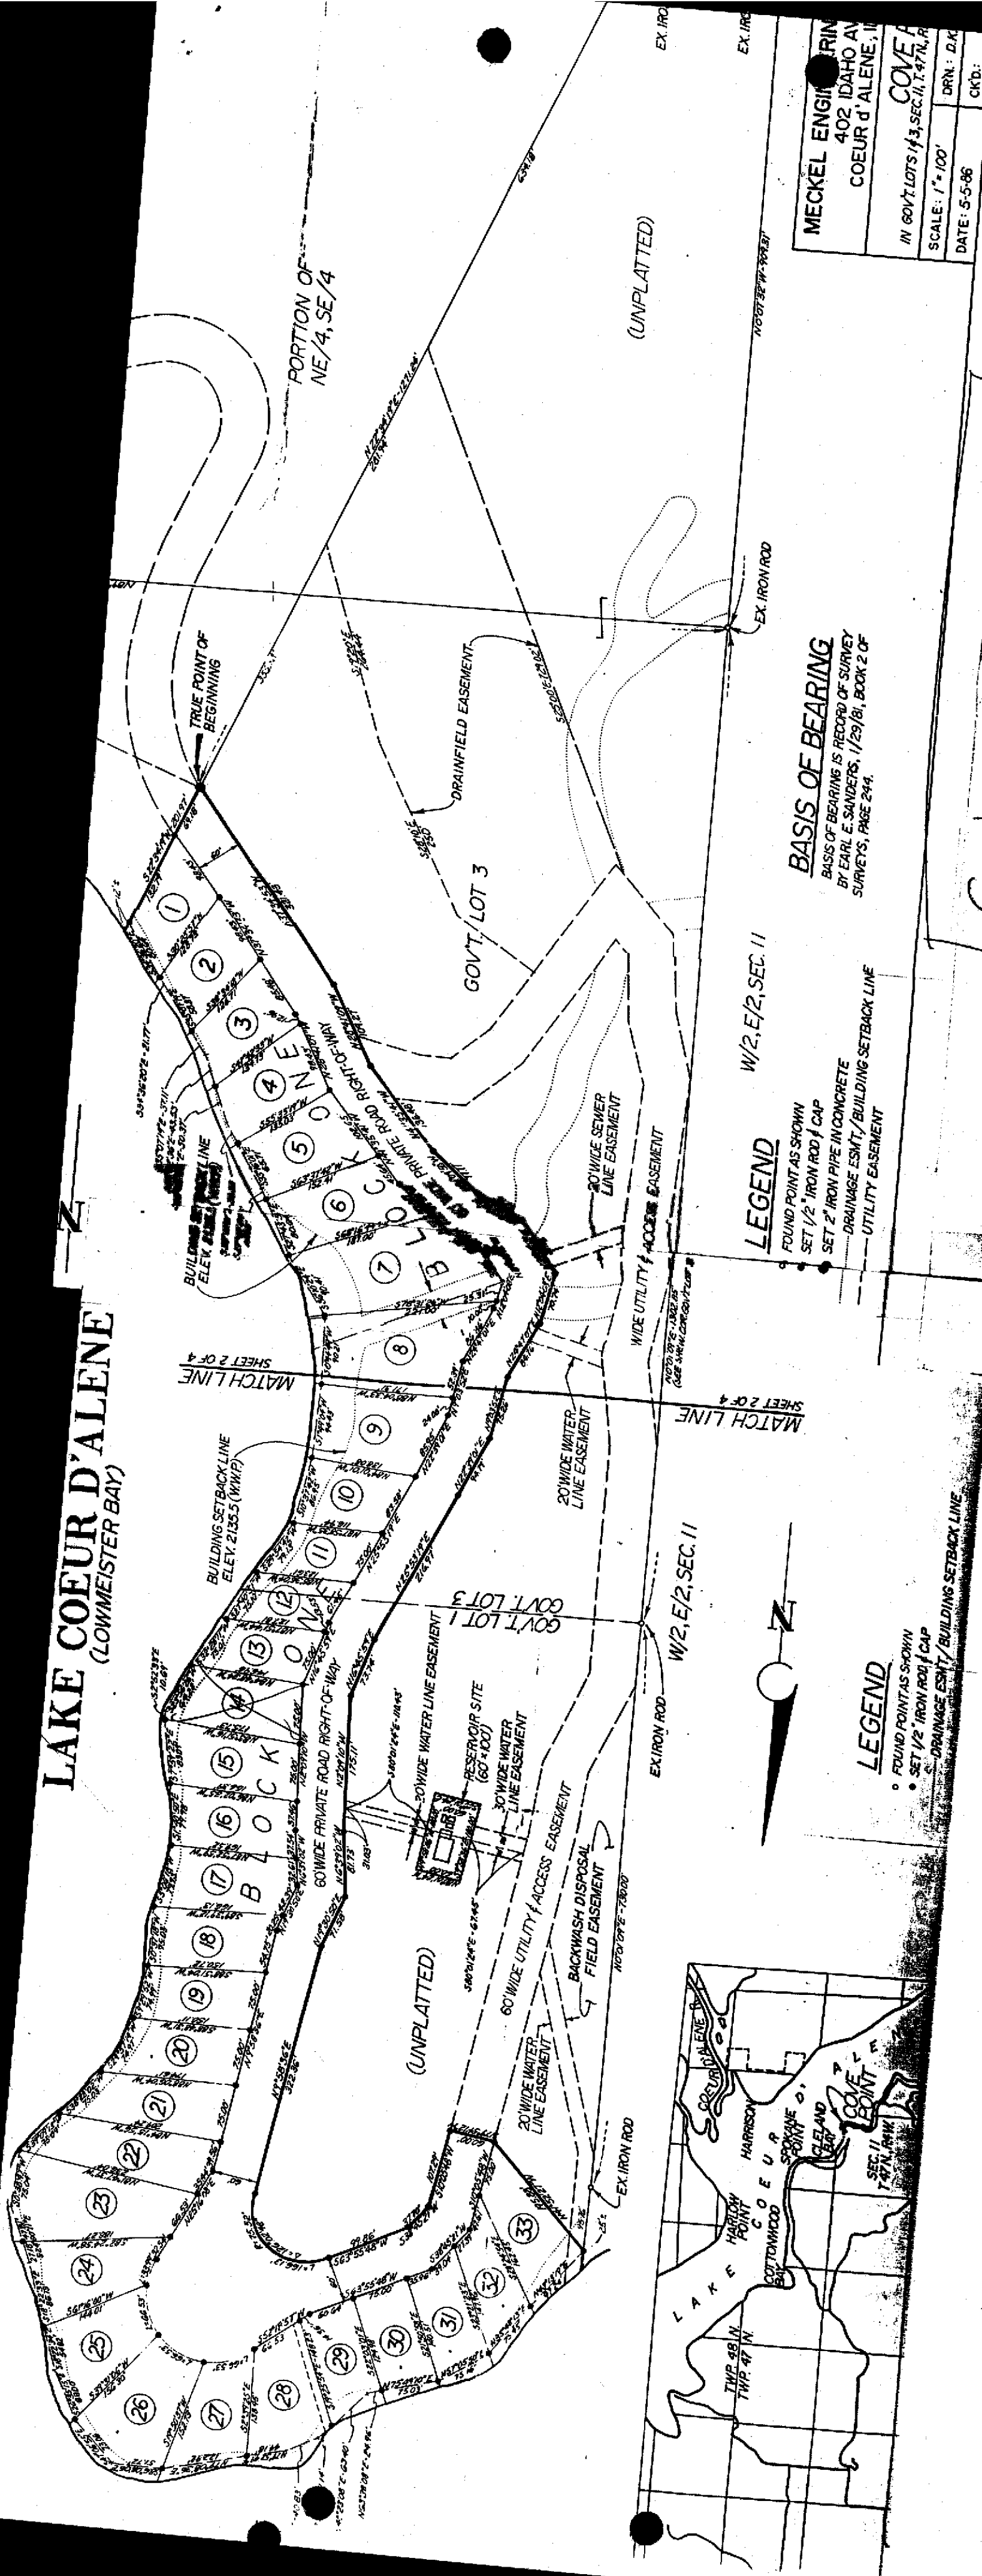

LEGEND

- FOUND POINT AS SHOWN
- SET 1/2" IRON ROD & CAP
- SET 2" IRON PIPE IN CONCRETE
- DRAINAGE ESMT./BUILDING SETBACK LINE
- UTILITY EASEMENT

BASIS OF BEARING
BASIS OF BEARING IS RECORD OF SURVEY
BY EARL E. SANDERS, 1/29/81, BOOK 2 OF
SURVEYS, PAGE 244.

W/2, E/2, SEC. 11


EX IRON ROD

(UNPLATTED)



LEGEND

- FOUND POINT AS SHOWN
- SET 1/2" IRON ROD & CAP
- DRAINAGE ESMT./BUILDING SETBACK LINE

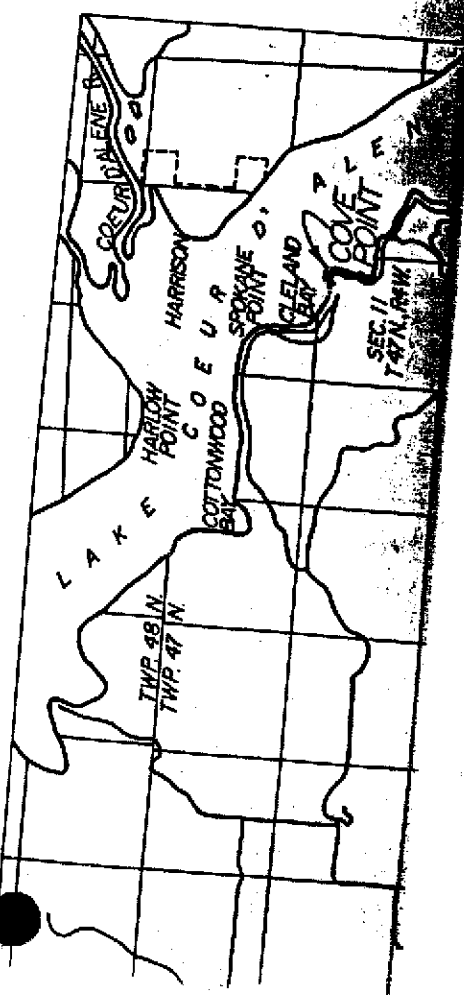

Covehaven Owners Assoc.

MECKEL ENGINEERING 402 IDAHO AV COEUR D'ALENE, ID	
IN GOVT LOTS 1 & 3, SEC. 11, T. 47 N., R. 10 E.	
SCALE: 1" = 100'	DRN: D.K.
DATE: 5-5-86	CKD: