


1/6
12/7
RANGE 6
RANGE 5

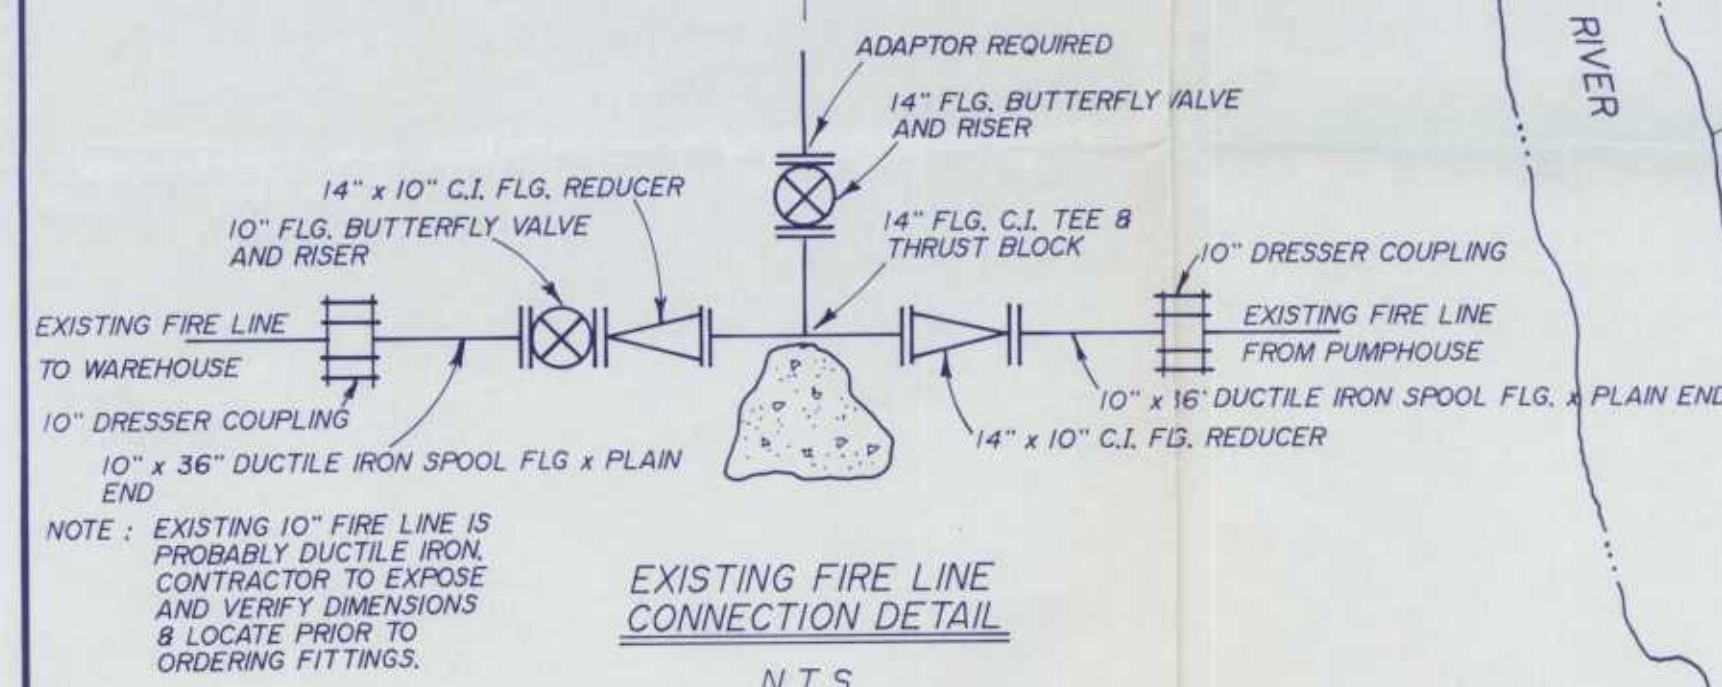

EXISTING FIRE LINE CONNECTION DETAIL

N.T.S.

MICROFILMED
Noted as field
in place of map.

100% JUL 1 2004
SCANNED
SCANNED
JUL 1 2 2004

NOTE: FIRE LINE TO BE DUCTILE IRON
CL 150 C-900 PVC OR EQUAL
AT OWNERS' OPTION.

WELL AND RESERVOIR LOT DETAIL

1" = 20'

RIVERBEND FIRE AND DOMESTIC WATER DISTRIBUTION SYSTEM			
SCALE: NOTED	6, 7, 50-SW	PI 75(W)	DRAWN BY: JHF
DATE: FEB. 89			REVISED:

LE PARD & FRAME, Inc.
Consulting Engineers
Coeur d'Alene, Idaho

SHEET 2
OF 6
LF

John A. Brantner Jr.
2/26/88