

**STARTING
LEFT
SIDE OF
FILE**

State of Idaho
Department of Water Resources
Permit to Appropriate Water

NO. 95-09365

Priority: October 20, 2006

Maximum Diversion Rate: 0.78 CFS

This is to certify, that RIVER HOUSE DEVELOPMENT INC
912 NW BLVD
COEUR D ALENE ID 83814

has applied for a permit to appropriate water from:

Source: GROUND WATER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
HEATING	01/01 to 12/31	0.78 CFS
COOLING	01/01 to 12/31	0.78 CFS

LOCATION OF POINTS OF DIVERSION:

GROUND WATER L4 (NE¼ SE¼) Sec. 10, Twp 50N, Rge 04W, B.M. KOOTENAI County
GROUND WATER L4 (NE¼ SE¼) Sec. 10, Twp 50N, Rge 04W, B.M. KOOTENAI County

PLACE OF USE: HEATING, COOLING

Twp Rge Sec	NE				NW				SW				SE				Totals
	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
50N 04W 10																	X L 4

CONDITIONS OF APPROVAL

1. Proof of application of water to beneficial use shall be submitted on or before **June 01, 2010**.
2. Subject to all prior water rights.
3. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code and applicable Well Construction Rules of the Department.
4. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.
5. Use of water under this right shall be non-consumptive.
6. Return flow discharged to a subsurface system must be authorized by a separate injection well permit.
7. When notified by the Department, the right holder shall install and maintain a measuring device of a type acceptable to the Department as part of the diverting works.
8. This right authorizes the diversion of ground water within the Rathdrum Prairie Ground Water Management Area (RPGWMA). Use of water under this right shall be subject to the provisions of the management plan approved by the director for the RPGWMA.

State of Idaho
Department of Water Resources
Permit to Appropriate Water
NO. 95-09365

9. When notified by the Department, the right holder shall record the quantity of water diverted and annually report diversions of water and/or other pertinent hydrologic and system information as required by Section 42-701, Idaho Code, and/or the management plan for the Rathdrum Prairie Ground Water Management Area.
10. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which the permit holder had no control.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code. Witness the signature of the Director, affixed at Boise, this 20th day of June, 20 07.


for DAVID R. TUTHILL, JR., Director

Renumbered 95-9365

FORM 202
12/99Ident. No. ~~95-9363~~

73233

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED

OCT 20 2006

IDWR/North

To appropriate the public waters of the State of Idaho

River House Development, Inc.1. Name of Applicant Howard Ruder operator Phone 208-818-2101Mailing address 912 NW Boulevard Coeur d'Alene ID 838142. Source of water supply Aquafer which is a tributary of _____3. Location of point of diversion is Township 50 N Range 4 W Sec. 10, in the _____ 1/4,
NE SE 1/4, SE 1/4, Govt. Lot 4, B.M., Kootenai County;additional points of diversion if any: X 2

4. Water will be used for the following purposes: SA7 - Closed Loop Heat Pump Return
- | |
|---|
| Amount <u>0.78</u> for <u>Heating</u> purposes from <u>1/1</u> to <u>12/31</u> (both dates inclusive) |
| (cfs or acre-feet per annum) |
| Amount <u>0.78</u> for <u>Cooling</u> purposes from <u>1/1</u> to <u>12/31</u> (both dates inclusive) |
| (cfs or acre-feet per annum) |
| Amount _____ for _____ purposes from _____ to _____ (both dates inclusive) |
| (cfs or acre-feet per annum) |
| Amount _____ for _____ purposes from _____ to _____ (both dates inclusive) |
| (cfs or acre-feet per annum) |
| Amount _____ for _____ purposes from _____ to _____ (both dates inclusive) |
| (cfs or acre-feet per annum) |

5. Total quantity to be appropriated is (a) 1756 PM x 2 wells = 3506 PM total
139 CFS Ea well (0.78 CFS) - total Both wells
cubic feet per second and/or (b) _____ acre feet per annum

6. Proposed diverting works: _____

a. Describe type and size of devices used to divert water from the source _____

b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feetc. Proposed well diameter is 8" inches; proposed depth of well is 250 LF feetd. Is ground water with a temperature of greater than 85°F being sought? NO

e. If well is already drilled, when? _____; Drilling firm _____

Well was drilled for (well owner) _____; Drilling Permit No. _____

7. Time required for completion of works and application of water to proposed beneficial use is 3 years (minimum 1 year)

8. Description of proposed uses (if irrigation only, go to item 9):

a. Hydropower; show total feet of head and proposed capacity in kW. _____

b. Stockwatering; list number and kind of livestock. _____

c. Municipal; show name of municipality. _____

d. Domestic; show number of households. _____

e. Other; describe fully. SA7 Closed Loop Heat Pump Return2 - Supply Wells - 1756 PM Each - total 3506 PM250 LF Deep - 8" Casings - 1 - Return well - 8" Casings - 250 LF Deep
Heating & Cooling

9. Description of place of use:

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW $\frac{1}{4}$				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
50N	4W	10																	

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. _____

11. a. Who owns the property at the point of diversion? Applicant
b. Who owns the land to be irrigated or place of use? Applicant
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: operator of wells for owner

12. Remarks: SA7 - Closed Loop Heat Pump Return
2 - Supply wells - 175 GPM Each - 8" Casing - 350 GPM total
139 CFS Each well - 178 CFS total
1 - Return well - 8" Casing
water Temp Return 85°-100°F

13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Howard Ruela operator

Signature of Applicant (and title, if applicable)

Received by [Signature] Date 10/20/06 Time 2:50 p Preliminary check by _____
Fee \$ 250.00 Received by [Signature] # N017949 Date 10/20/06
Publication prepared by [Signature] Date 12/13/06 Published in Coa Press 12/21 - 28/06
Publication approved [Signature] Date 12/29/06

95-9365



0.06 0 0.06 0.12 Miles

-  Kootenai taxlots
-  GCDB50N04W GCDB
-  Foster.shp
-  Pou.shp
-  Pod.shp
-  Administrative BasinsAdminbas.shp



LIFT STATION

R/W

BEEFE BLVD.

RECEIVED
OCT 20 2006
IDWR/North

1 - Return well - 250 LF Deep

2 - 8" Casing 250 LF Deep
Supply wells
125 GPM each well
350 GPM total - Both wells
139 CFS Per well
178 CFS (Both wells)

LIBRIVE LANE

20+00

51+00

10" SAN

14" DEEP DRYWELL

12" W

12" W

12" W


12" W

12" W


12" W

12" W

12" W

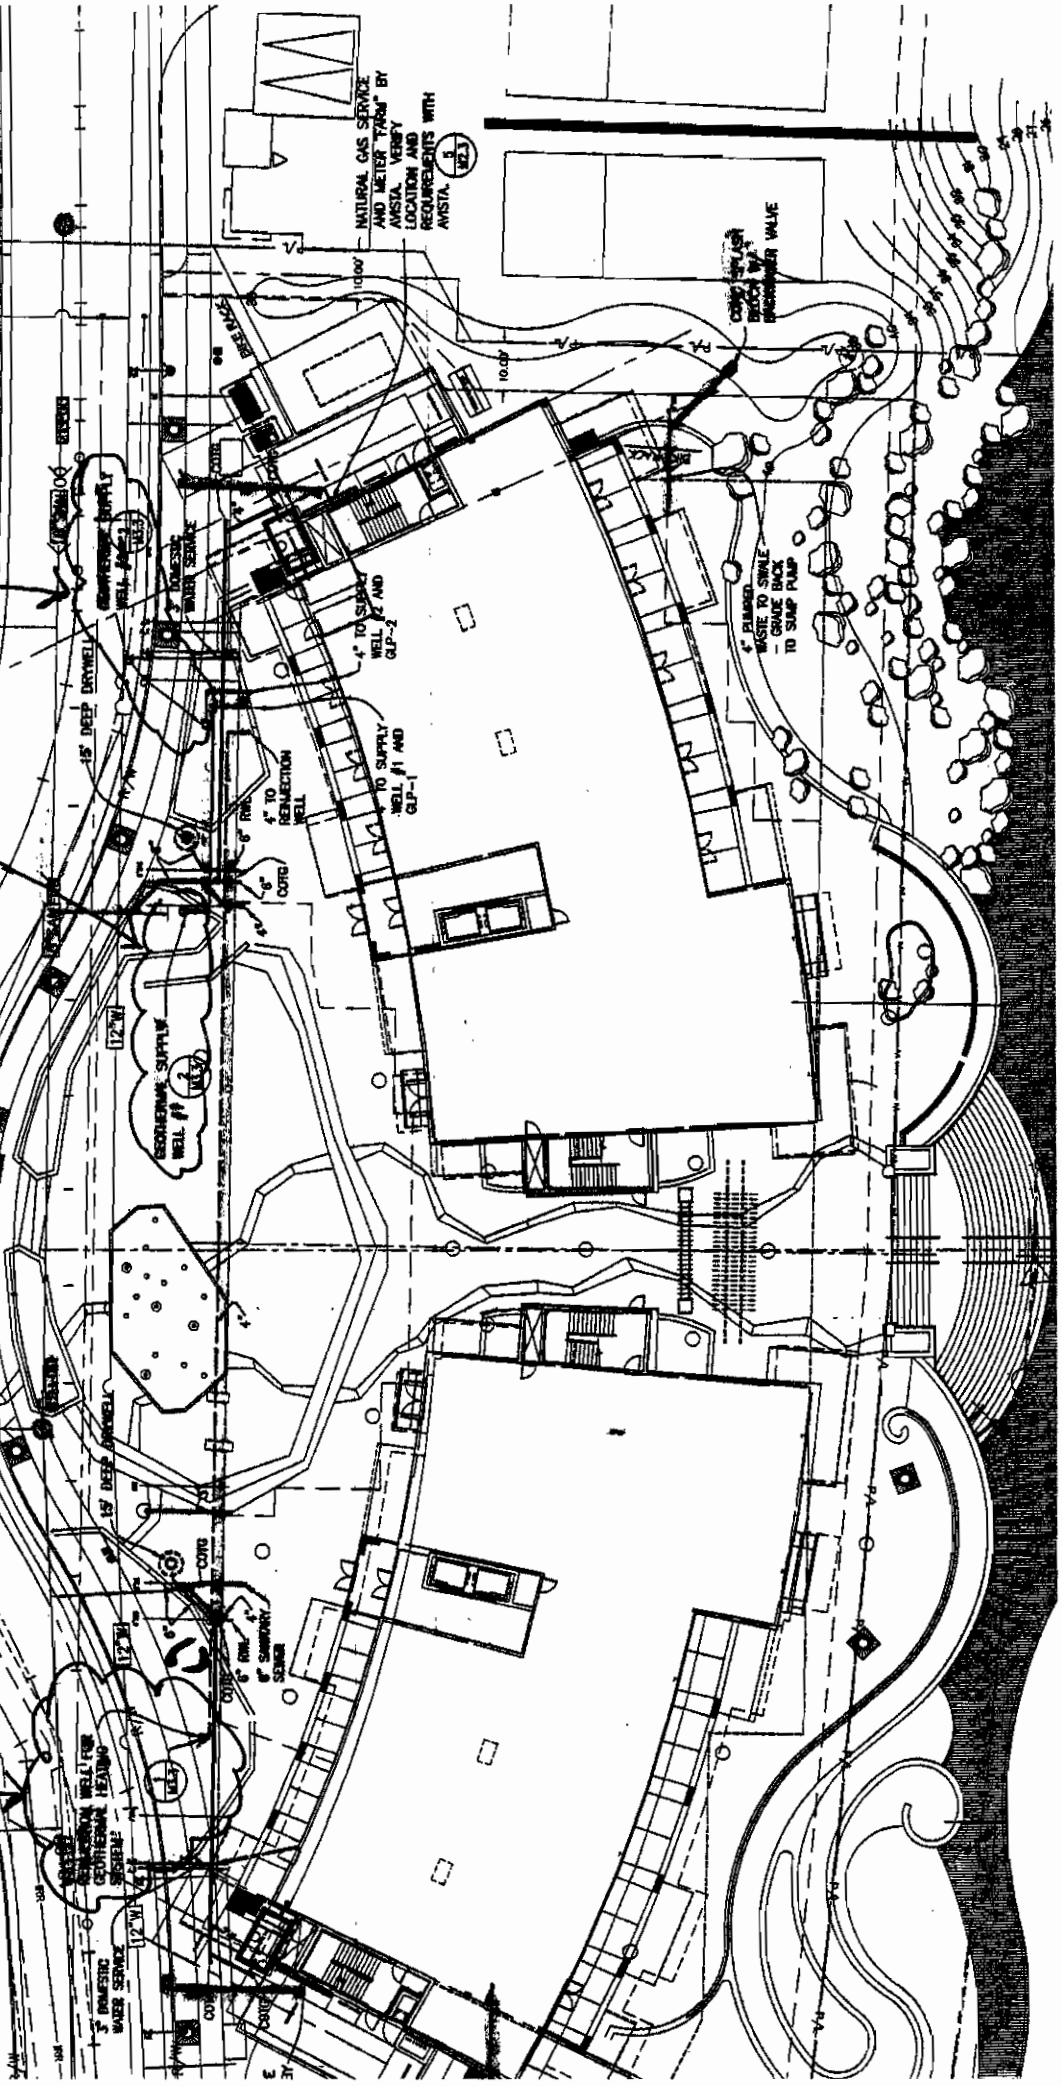

RECEIVED
OCT 20 2006
IDWR/North

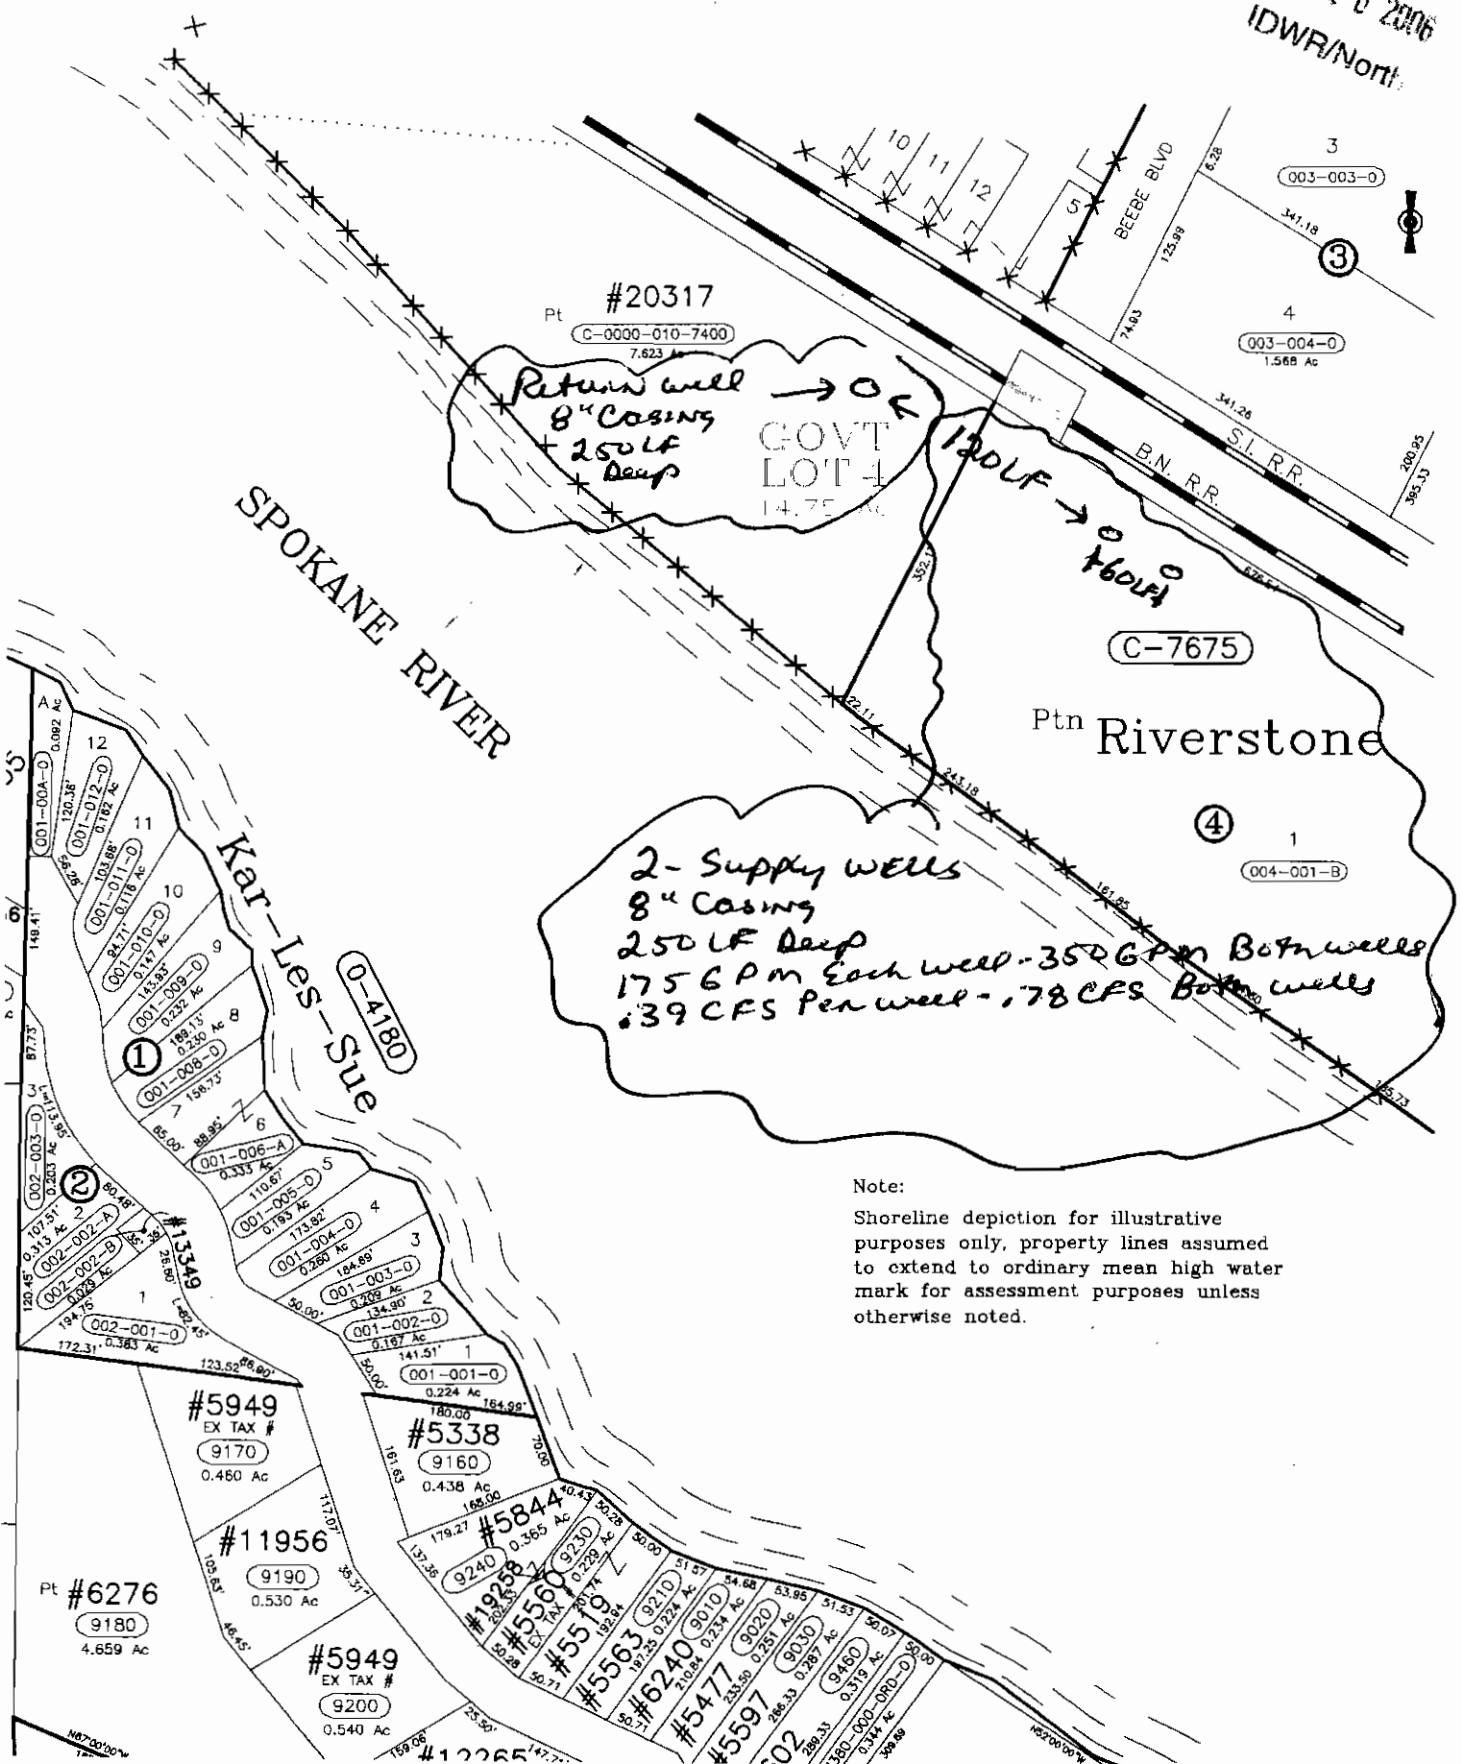

idwfr/north

twip-50w
RGE-4w
SEE^{KW} 10
SEE 74^W EL



ARTICLES OF INCORPORATION

(General Business)

(Instructions on back of application)

The undersigned, in order to form a Corporation under the provisions of Title 30, Chapter 1, Idaho Code, submits the following articles of incorporation to the Secretary of State.

FILED EFFECTIVE

2005 NOV 18 AM 11:08

SECRETARY OF STATE
STATE OF IDAHO

RECEIVED

OCT 26 2006

IDWR/North

Article 1: The name of the corporation shall be:

River House Development, Inc.

Article 2: The number of shares the corporation is authorized to issue: 100,000

Article 3: The street address of the registered office is: 912 Northwest Blvd, Coeur d'Alene, ID 83814

and the registered agent at such address is: Marshall R. Chesrown

Article 4: The name of the incorporator is: Nancy E. Nick

and address of the incorporator is: 912 Northwest Blvd, Coeur d'Alene, ID 83814

Article 5: The mailing address of the corporation shall be:

P.O. Box 3070, Coeur d'Alene, ID 83816

Optional Articles:

Questions, Call
Howard Rude
818-2101

Signature of at least one incorporator:

Nancy E. Nick

Typed Name: Nancy E. Nick

Typed Name:

Customer Acct #:

(if using pre-paid account)

Secretary of State use only

g:\corp\forms\corp forms\artofinc\profit.p65
Revised 07/2002

IDAHO SECRETARY OF STATE
11/18/2005 05:00
CK: 1267 CT: 185012 BN: 922852
1 @ 100.00 = 100.00 CORP # 2
1 @ 20.00 = 20.00 EXPEDITE C # 3

Web Form

C163470

RECEIVED
OCT 26 2006
IDWR/North

Name and Title

Signature

Signature

[Handwritten Signature]

[Handwritten Signature]

[Handwritten Signature]

X Chas. Amato
Secretary / Assistant Secretary

Y Jeffrey B. ...
President

Page 3

**NOW
STARTING
RIGHT
SIDE OF
FILE**



State of Idaho

DEPARTMENT OF WATER RESOURCES

322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098

Phone: (208) 287-4800 • Fax: (208) 287-6700 • Web Site: www.idwr.idaho.gov

June 21, 2007

C. L. "BUTCH" OTTER
Governor

DAVID R. TUTHILL, JR.
Interim Director

RIVER HOUSE DEVELOPMENT INC
912 NW BLVD
COEUR D ALENE ID 83814

RE: Permit No. 95-9365

Permit Approval Notice

Dear Permit Holder:

The Department of Water Resources has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.

The permit is a PRELIMINARY ORDER issued by the Department pursuant to Section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

As a permit owner you must commence the excavation or construction of the diverting works within one year of the date the permit was issued, and you must proceed diligently until the project is completed. The date shown under condition no. 1 is the date when the project must be completed.


The Department will send you a 'Proof Due Notice' approximately 60 days prior to the above referenced date requesting you to file either a Proof of Beneficial Use form or a Request for Extension of Time form.

The right to drill a well is not a part of this permit to appropriate water. Beginning in July of 1987, a statute was enacted which requires a drilling permit for new well construction and deepening of existing wells. If the well(s) proposed for use under this water right permit were drilled or deepened after July 1, 1987, a separate drilling permit must be obtained from this Department. Please contact the Ground Water Protection Section located here at this office or our regional office nearest you.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-287-4947.

Sincerely,


for Shelley W. Keen, Manager
Water Right Permits Section


Enclosure(s)

CERTIFICATE OF SERVICE

I hereby certify that on June 22, 2007 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved Permit) to the person listed below:

RE: WATER RIGHT NO. 95-9365

**RIVER HOUSE DEVELOPMENT INC
912 NW BLVD
COEUR D ALENE ID 83814**

A handwritten signature in cursive script, reading "Emalee Rushing", is positioned above a horizontal line.

**Emalee Rushing
Technical Records Specialist**

Statement of Available Procedures and Applicable Time Limits

RESPONDING TO PRELIMINARY ORDERS ISSUED BY THE IDAHO DEPARTMENT OF WATER RESOURCES (To be used in connection with actions when a hearing was not held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs; requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MEMORANDUM

Date: June 20, 2007
To: Water Right File 95-9365
From: eretelle
Re: permit review

No WD
RPGWMA - conditions included

No overlaps
No protests

Heating & Cooling - system calculations included: peak use 257 gpm (0.57 cfs). Conversation with applicant and narrative from consultant say the additional rate is for the safety factor. The capacity of the 2 pumps together is 350 gpm, but the average flow rate will likely be 175 gpm.

Recommend approval as suggested by IDWR Northern



- PLUMBING
- HEATING
- BUILDING SOLUTIONS
- DESIGN BUILD SPECIALISTS

May 29, 2007

Attn: Erin Retelle
Department of Water Resources
7600 Mineral Drive, Suite 100
Coeur d'Alene, ID 83815

PROJECT: Riverfront House / Coeur d'Alene

SUBJECT: APPLICATION FOR PERMIT 95-9365
MAY 2, 2007 REQUEST FOR CALCULATIONS AND/OR SYSTEM DESIGN SPECIFICATIONS


Dear Erin:

As per your request, attached please find calculations and system design specifications for the geothermal heat pump system listed in our application. The calculations provided were prepared by L&S Engineering (mechanical engineers).

Please note that none of the water will be consumed. All of the water removed by the supply wells will be re-injected back into the water source.

If you have any additional questions or if I can be of any further assistance, please feel free to call me. (208-818-2101)

Thank you,
ETCO SERVICES LLC


Howard Rude
Owner / President

Attachments: ° L&S Engineering's Project Journal dated Regarding Ground Water Use
° L&S Engineering's Design Ground Loop Information Dated 12-15-05

May 27 07 10:49p

RE VED 05/27/2007 22:46 2087625807

ETCO SERVICES
2087723135

p.2

**PROJECT JOURNAL**

☒ MEMORANDUM	☐ SITE	DATE _____
☐ DESIGN	☐ CONFERENCE	JOB. NO. _____
☐ CONSTRUCTION	☐ TELEPHONE	BY <u>R. Wilkinson</u>

PROJECT Riverfront House, Coeur d' Alene, IDCOMPANY: Etco ServicesATTN: Howard RudeSUBJECT: Ground water use for heating and cooling

REMARKS:

Howard,

Please find attached, our groundwater flow calculations for the geothermal heat pump system. These calculations estimate the maximum groundwater flow required to heat and cool the entire building. We estimate the maximum flow rate to be about 300 gallons per minute. The pumps are selected to allow for some safety factor, 350 gallons per minute (0.78 cubic feet per second). This maximum flow will most likely occur on the warmest summer day. During winter and spring/fall months, the flow will be only a fraction of the maximum flow.

We would like to emphasize that the groundwater will be not be consumed in any way and will be returned to the same basin from which it is drawn. In this way, we will not deplete this resource. We only intend to change it's temperature, and otherwise return it in the same condition from which we found it. As we change it's temperature, we will use pumps, piping and heat exchangers to treat it as though it is potable water suitable for drinking, before returning it to the ground.

May 27 07 10:49p

RIVED 05/27/2007 22:45 2087625807

ETCO SERVICES
2087723135

p.3



Date: 12/15/2005

Project No:

Project Name: Riverfront House/RiversEdge

Subject: Design ground loop

Revision:

By: R. Wilkinson

Problem: Determine: Maximum groundwater flowrate
 Water temperatures at all 4 pipes leading to and from heat exchanger
 Heat Exchanger selection
 Minimum Aqueous Prop. Glycol solution

Assumptions: Sum of Zone Peaks	Summer, m bh	Winter, mbh
Condos	2,237	852
Restaurant East	486	40
Restaurant West	486	40
Switchgear Rm	85	(85)
Elevator Rooms	127	(84)
Total	3,421	783
Adjust for diversity	-10%	3,079
Adjust for safety factor	25%	3,849

Specific Heat of bldg loop fluid, 25% Dowfrost:

Summer (80°F)	0.913	btu/lb-°F
Winter (20°F)	0.949	btu/lb-°F

Analysis: Heat Exchanger

Assume a perfect heat exchanger, Determine required flow rates.

Building Loop Side	Heating Mode	Cooling Mode
Building Loop Entering temperature	20 °F	80 °F
Building Loop Leaving temperature	30 °F	60 °F
Actual ΔT	10 °F	20 °F
Required Building Loop Flow Rate	193 gpm	421 gpm
Groundwater side		
Entering groundwater temperature	45 °F	45 °F
Desired ΔT	10 °F	30 °F
Leaving groundwater temperature	55 °F	75 °F
Required groundwater Flow Rate	176 gpm	257 gpm

Conclusions:

Retelle, Erin

To: hrude@etcoservices.com
Cc: Franklin, Keith
Subject: RE: Application for Permit 95-9365

Dear Howard:

The Department of Water Resources is reviewing the application you filed for 0.78 cfs of water to be used for heating and cooling purposes. IDWR is required in Section 42-203A(5), *Idaho Code*, to ensure that new water uses are not contrary to the conservation of water resources in Idaho. In other words, new water uses must meet reasonable standards of efficiency.

In order for IDWR to evaluate your application, we need information describing how you determined the amount of water you have applied to appropriate. Please provide the calculations and/or system design specifications you used to determine that 0.78 cfs is the necessary diversion rate for your project.

We will hold any action on your application pending receipt of the necessary information. If we do not receive the information within 30 days, IDWR will reject or deny the application and it will not be processed.

If you have any questions, please contact me at (208) 287-4949 or erin.retelle@idwr.idaho.gov.

Sincerely,

Erin Retelle
Senior Water Resource Agent

phone: (208) 287-4949
fax: (208) 287-6700

Cc: IDWR, Northern Region

RECEIVED

DEC 29 2006

IDWR/North

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
County of Kootenai,

} ss.

Amy McCue

being first duly sworn

upon oath deposes and says:

1. I am now and at all times hereinafter mentioned was a citizen of the United States, resident of the State of Idaho, over the age of twenty-one years and not a party of the above entitled action.

2. I am now and at all times hereinafter mentioned was the printer (principal clerk) of the "Coeur d'Alene Press," a newspaper printed and published daily except Sunday in Coeur d'Alene, Kootenai County, Idaho, and having a general circulation in said county.

3. The


Legal Notice

of which the annexed is a printed copy, was published in the regular Thursday issue of said newspaper for 21 consecutive weeks commencing on the 21 day of December, 2006, and ending on the 28 day of December, 2006, and such publication was made as often during said period as said newspaper was regularly issued.

4. That said newspaper has been continuously and uninterruptedly published in said Kootenai County, during a period of more than seventy-eight consecutive weeks immediately prior to the first publication of said notice. Amy McCue On this 28 day of December, in the year of 2006, before me, a Notary Public, personally appeared Amy McCue, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he executed the same.

Regina Mason
Notary Public for the State of Idaho,
residing at Coeur d'Alene, Idaho.

MY COMMISSION EXPIRES 6/18/09

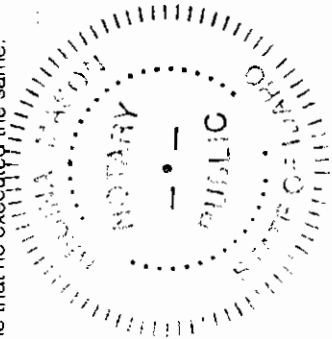

LEGAL NOTICE

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

RIVER HOUSE DEVELOPMENT INC
912 NW BLVD

COEUR D'ALENE ID 83814

Points of Diversion (2) 1A (NESE) S10 T50N R04W KOOTENAI County

Source GROUND WATER

Use: HEATING 01/01 To 12/31 0.78 CFS

Use: COOLING 01/01 To 12/31 0.78 CFS

Total Diversion:

Date Filed: 10/20/2006

Place Of Use: HEATING and COOLING

T50N R04W S10 NESE Lot 4

95-9369

MICHAEL MEJIE

RENEE MEJIE

4099 WEST BOEKEL RD

RATHDRUM ID 83858

Point(s) of Diversion SESESW S33 T52N R04W KOOTENAI Co

Source GROUND WATER

Use: IRRIGATION 04/01 To 11/01 0.07 CFS

Use: DOMESTIC 01/01 To 12/31 0.02 CFS

Total Diversion:

Date Filed: 11/21/2006

Place Of Use: DOMESTIC and IRRIGATION

T52N R04W S33 SESW

Number of Acres 2.5

Remark: Domestic use is for 1 home.

95-9370

PETER STANTON

PO BOX 2191

SPOKANE WA 99210

Point(s) of Diversion 13 (NWSW) S10 T48N R04W KOOTENAI Co.

Source COEUR D'ALENE LAKE - Tributary To SPOKANE RIVER

Use: IRRIGATION 03/15 To 11/15 0.03 CFS

Total Diversion: 0.03 CFS

Date Filed: 10/03/2006

Place Of Use: IRRIGATION

T48N R04W S10 NWSW Lot 3

Number of Acres 1

Permits will be subject to all prior water rights. / Protests may be submitted based on the criteria of Sec 42-203A, Idaho Code.

Any protest against the approval of this application must be filed with the Director, Dept. of Water Resource, Northern Region, 7500 Mineral Drive, Suite 100, Coeur d'Alene ID 83815 together with a protest fee of \$25.00 for each application on or before 01/08/2007. The protestant must also send a copy of the protest to the applicant.

Legal 270

December 21, 28, 2006

KARL J DREHER, Director

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

95-9365

RIVER HOUSE DEVELOPMENT INC

912 NW BLVD

COEUR D'ALENE ID 83814

Point(s) of Diversion (2) L4 (NESE) S10 T50N R04W KOOTENAI County

Source GROUND WATER

Use: HEATING 01/01 To 12/31 0.78 CFS

Use: COOLING 01/01 To 12/31 0.78 CFS

Total Diversion: 0.78 CFS

Date Filed: 10/20/2006

Place Of Use: HEATING and COOLING

T50N R04W S10 NESE Lot 4

95-9369

MICHAEL MEJIE

RENEE MEJIE

4099 WEST BOEKEL RD

RATHDRUM ID 83858

Point(s) of Diversion SESESW S33 T52N R04W KOOTENAI County

Source GROUND WATER

Use: IRRIGATION 04/01 To 11/01 0.07 CFS

Use: DOMESTIC 01/01 To 12/31 0.02 CFS

Total Diversion: 0.09 CFS

Date Filed: 11/21/2006

Place Of Use: DOMESTIC and IRRIGATION

T52N R04W S33 SESEW

Number of Acres 2.5

Remark: Domestic use is for 1 home.

95-9370

PETER STANTON

PO BOX 2191

SPOKANE WA 99210

Point(s) of Diversion L3 (NWSW) S10 T48N R04W KOOTENAI County

Source COEUR D'ALENE LAKE - Tributary To SPOKANE RIVER

Use: IRRIGATION 03/15 To 11/15 0.03 CFS

Total Diversion: 0.03 CFS

Date Filed: 10/03/2006

Place Of Use: IRRIGATION

T48N R04W S10 NWSW Lot 3

Number of Acres 1

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec 42-203A, Idaho Code.

Any protest against the approval of this application must be filed with the Director, Dept. of Water Resource, Northern Region, 7600 Mineral Drive, Suite 100, Coeur D'Alene ID 83815 together with a protest fee of \$25.00 for each application on or before 01/08/2007. The protestant must also send a copy of the protest to the applicant.

KARL J DREHER, Director Published Dec. 21 & 28, 2006



State of Idaho

DEPARTMENT OF WATER RESOURCES

Northern Region, 7600 Mineral Drive, Suite 100, Coeur d'Alene, Idaho 83815

Phone: (208) 762-2800 FAX: (208) 762-2819 www.idwr.idaho.gov

JAMES E. RISCH
Governor

KARL J. DREHER
Director

December 13, 2006

AMY McCREE, GLENDA JEFFERSON & DEE DUQUETTE
LEGAL NOTICE DEPARTMENT
COEUR D ALENE PRESS
201 N 2ND
COEUR D ALENE ID 83814

RE: Application for Permit No. 95-9365, 95-9369 and 95-9370

Please FAX proof copy before this goes to press, to 208 762-2819
Thanks, Dianne

Dear Amy, Glenda & Dee:

Enclosed you will find a legal notice which we wish to have published in your newspaper on the dates indicated, December 21 and 28, 2006, (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 01/08/2007. Your cooperation is always greatly appreciated.

Thank you for all your good help, and attention to details,

Sincerely

Dianne

Dianne Ball
Administrative Assistant

Ball, Dianne

From: Ball, Dianne
Sent: Wednesday, December 13, 2006 11:36 AM
To: Legal Notices-CdA Press (E-mail); Legal Notices-CdA Press2 Glenda Jefferson (E-mail);
Legal Notices-CdA Press3 Amy (E-mail); Legal Notices-CdA Press4 Dee Duquette (E-mail)
Subject: Legal notice for publication Dec. 21 and 28, 2006

Good day to you,

Attached is our cover letter requesting publication of a legal notice on December 21 and 28, 2006. The legal notice is also attached.

I will follow this up with a FAX also.

If you have ANY questions, please call me at 762-2800.

ALSO - PLEASE FAX A PROOF PRIOR TO PUBLICATION.

Thanks for all your help.

Dianne

*Dianne Ball
Administrative Assistant
Idaho Dept of Water Resources
7600 Mineral Drive Suite 100
Coeur d'Alene, ID 83815
Phone (208)762-2800 FAX (208)762-2819*



CoverLetter
2-13-06 CdA e-mai.



LegalNotice
2-13-06 CdA e-mai.



State of Idaho

DEPARTMENT OF WATER RESOURCES

Northern Region, 7600 Mineral Drive, Suite 100, Coeur d'Alene, Idaho 83815

Phone: (208) 762-2800

Fax: (208) 762-2819

Web Site: www.idwr.idaho.gov

JAMES E. RISCH
Governor

KARL J. DREHER
Director

December 13, 2006

RIVER HOUSE DEVELOPMENT INC
912 NW BLVD
COEUR D ALENE ID 83814

RE: Application for Permit No 95-9365

Dear Applicant(s):

The Department of Water Resources acknowledges receipt of your water right application. Please refer to the above referenced number in all future correspondence regarding this application.

A legal notice of the application has been prepared and is scheduled for publication in the Coeur d'Alene Press on December 21 and 28, 2006. Submittal of protests to this application will be allowed for a period ending ten days after the second publication.

If the application is protested you will be sent a copy of the protest(s). All protests must be resolved before the application can be considered for approval. If the protest(s) cannot be resolved voluntarily, the Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our State Office in Boise for final processing. The State Office will notify you of any action taken on the application and will send you a copy of the permit if approved. A typical processing time for an unprotested application is about eight to twelve weeks.

Please feel free to contact this office if you have any questions.

Sincerely,

A handwritten signature in black ink, appearing to read 'Keith E. Franklin', is written over a horizontal line.

Keith E. Franklin
Senior Water Resource Agent