



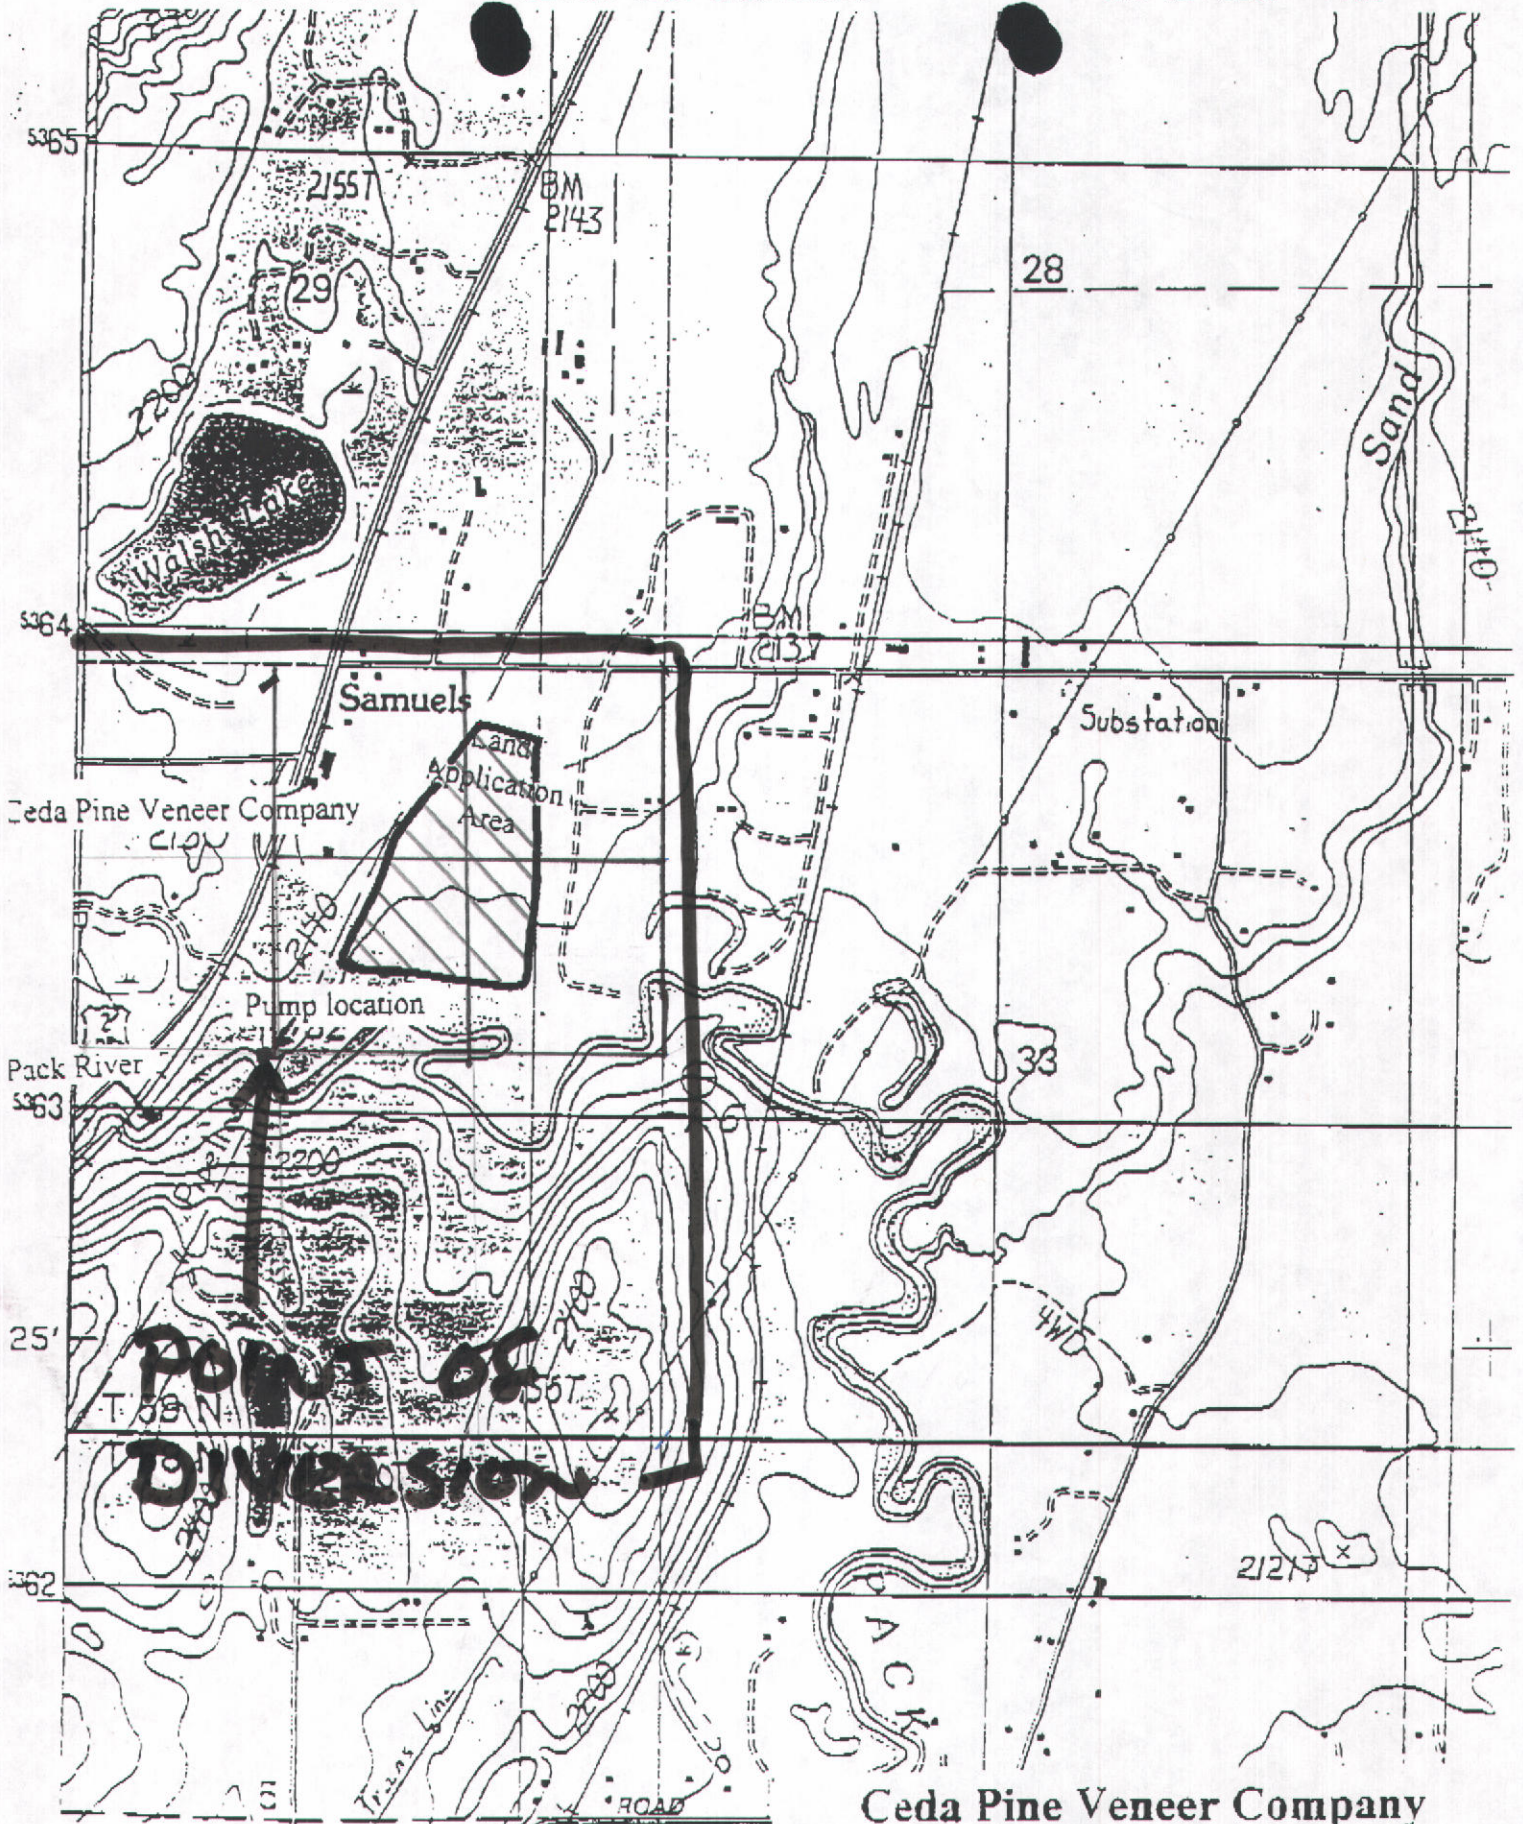

Ceda Pine Veneer Company

MICROFILMED Surface Water Rights Application
SEP 29 1998 Site Map

96-08979

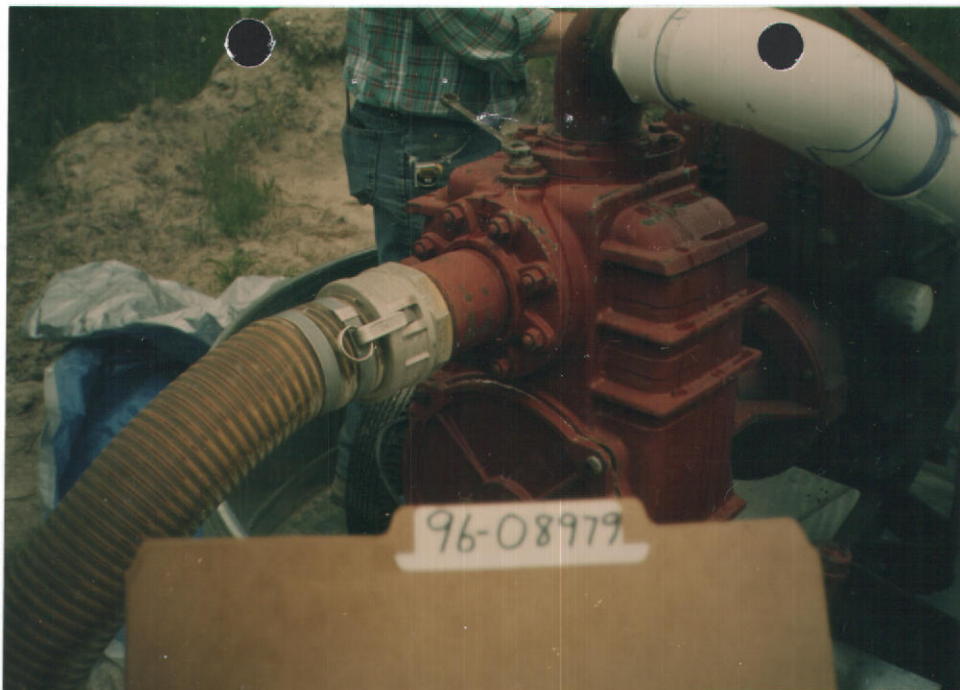

PD
→
Pump

Reservoir Lagoon
→
Pump Station



Plant




Tanker for
dust abatement

JUN 16 2004

RECEIVED

96-08979

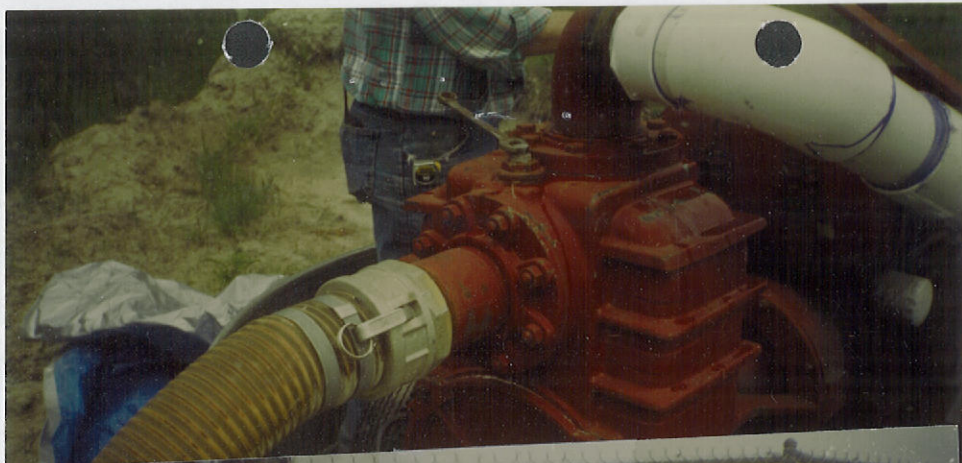

PW
x
Pump

Reservoir Lagoon
x
Pump Station



Plant




Tanker for
dust abatement

JUN 16 2004

RECEIVED



96-08979

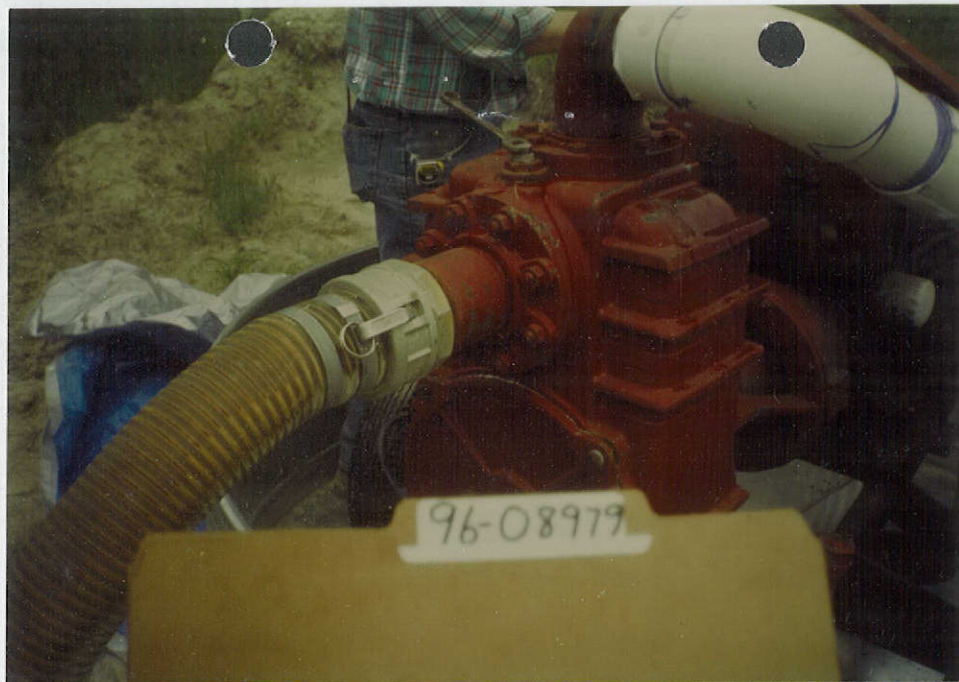

PW
→
Pump

Reservoir Lagoon
+
Pump Station



Plant



Tanker for
dust abatement

JUN 16 2004

RECEIVED

96-08979



PW
Pump

Reservoir Lagoon
+ Pump Station




Plant



Tanker for
dust abatement

JUN 16 2004

IMAGED

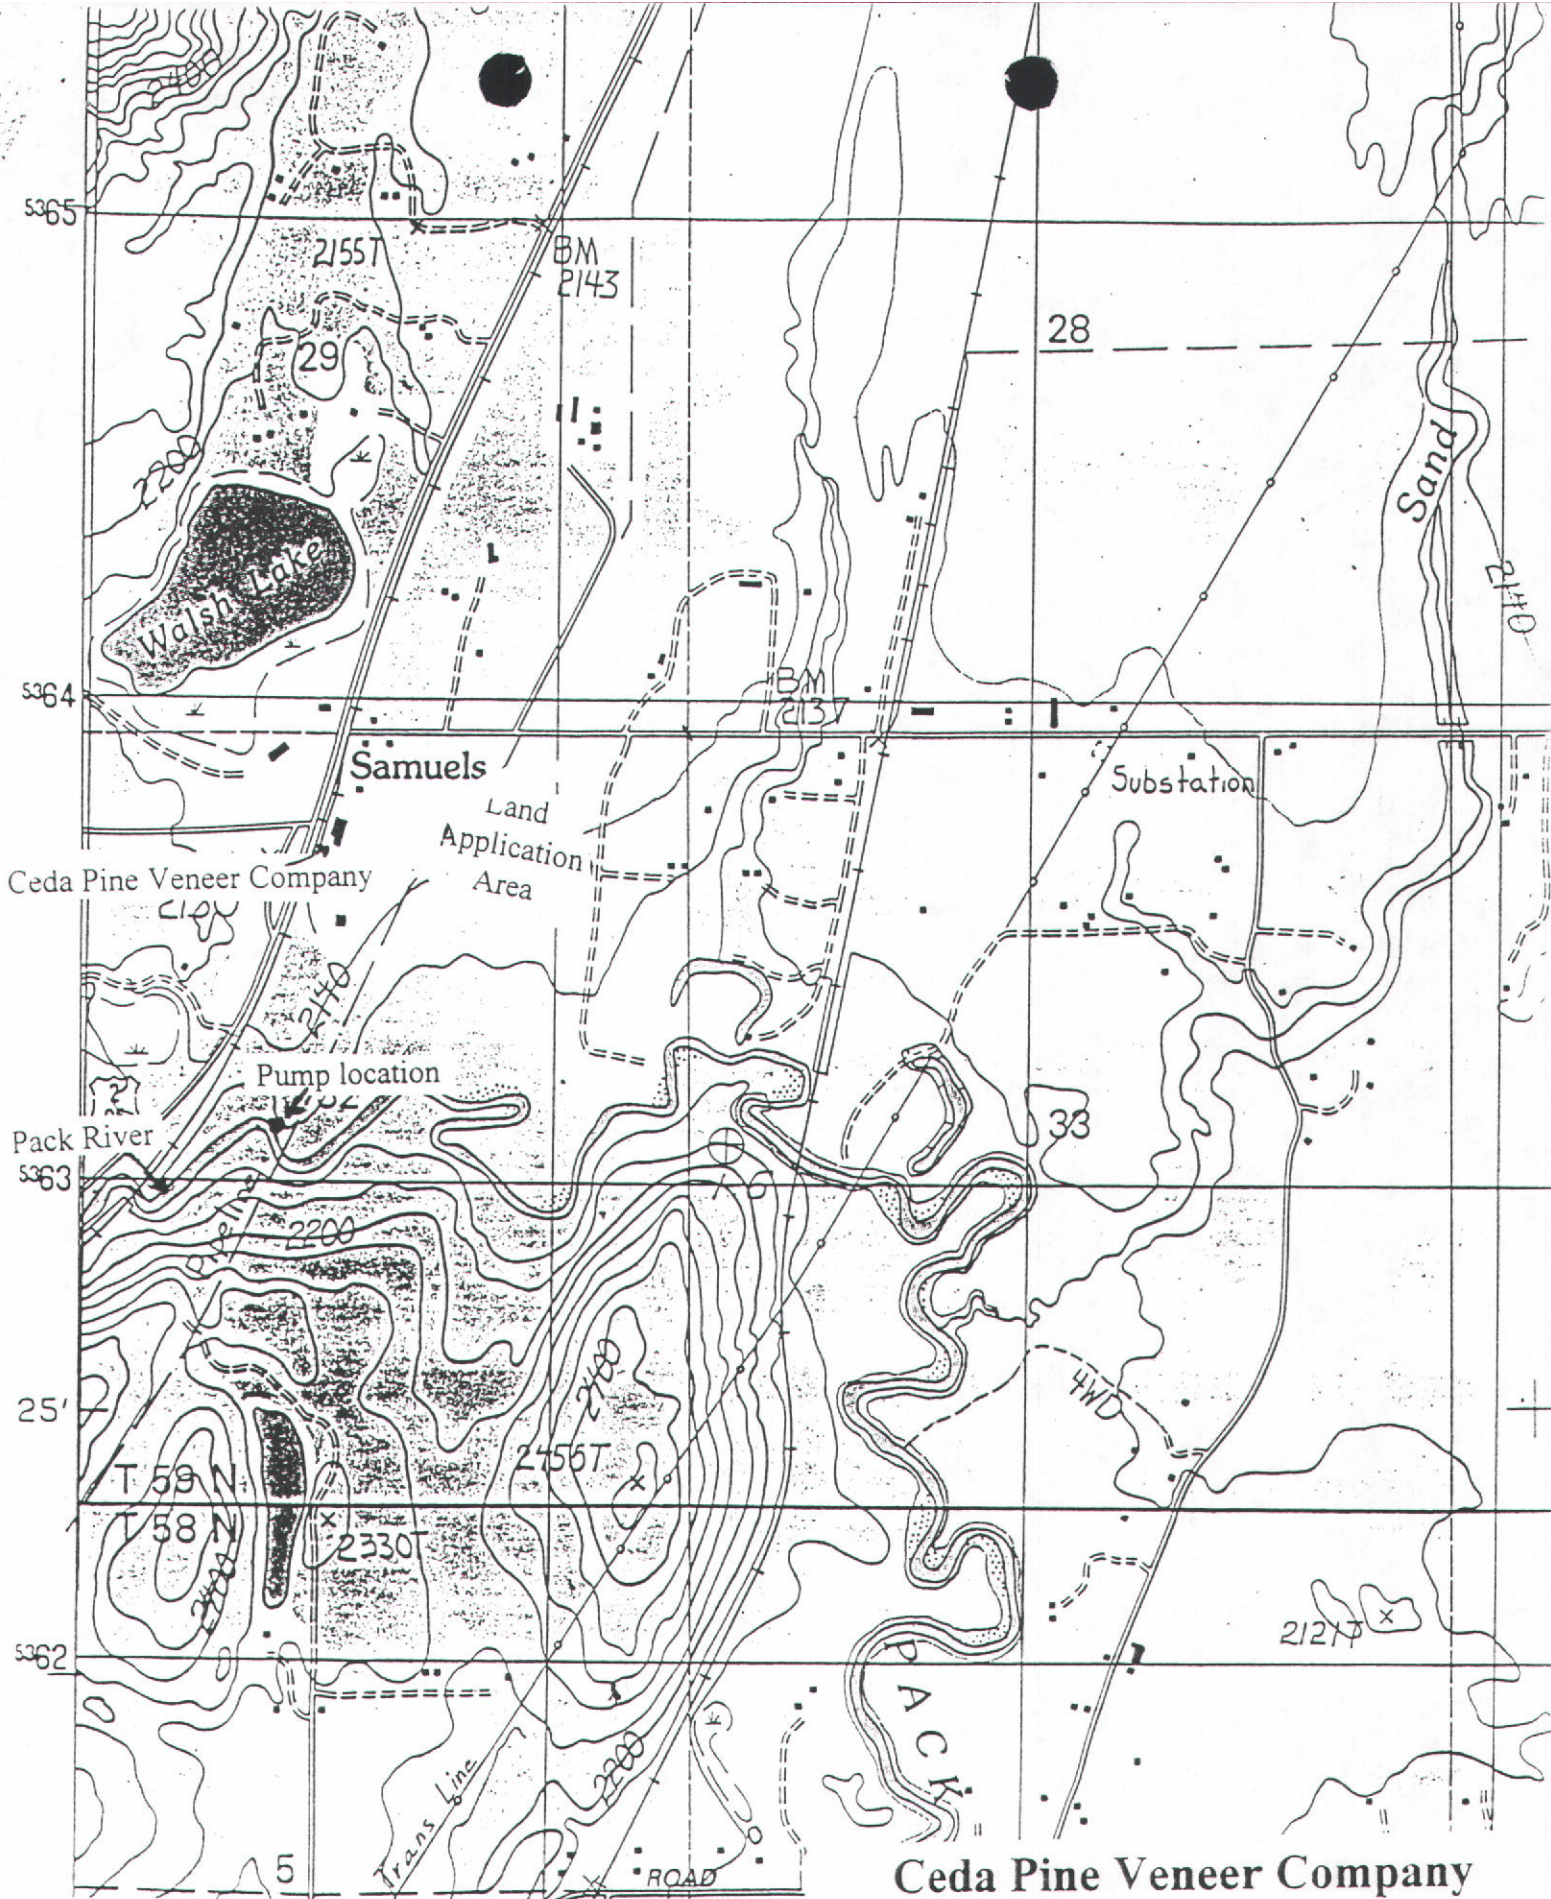


Ceda Pine Veneer Company


MICROFILMED

SEP 29 1998

Surface Water Rights Application
Site Map

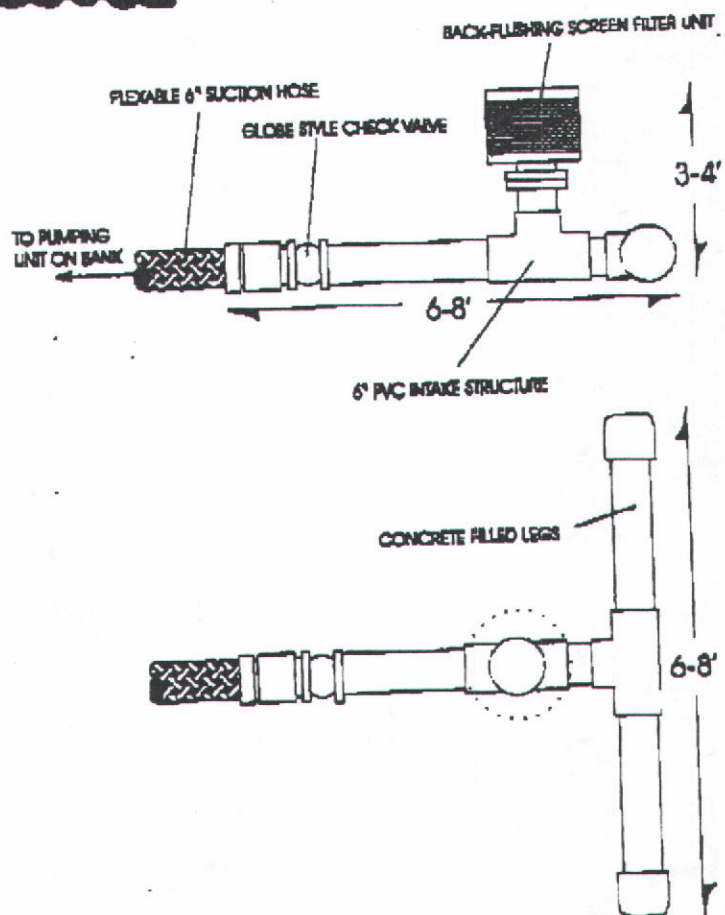

INSTALLATION DRAWING

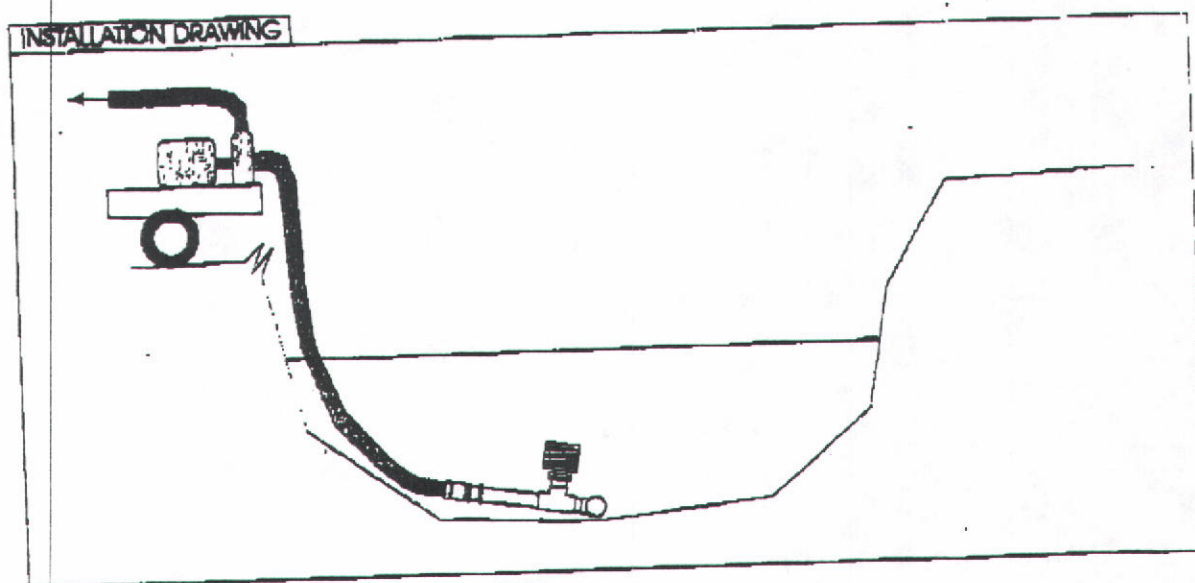

MICROFILMED

SEP 29 1998



century west
ENGINEERING CORPORATION

Gretchen E. Hoy
Environmental Services Manager

1825 North Hutchinson Road, Second Floor
Spokane, Washington 99212
Phone: (509) 838-3810 FAX: (509) 624-0355

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES RECEIVED
MAR 11 2003
PROOF OF BENEFICIAL USE

Department of Water Resources

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee; when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner.

1. Permit No. 96-08979 Telephone No. (208)-263-7527
2. Name of Permit Holder(s): Ceda-Pine Veneer, Inc.
3. Mailing Address: P.O. Box 536
City Post Falls State ID Zip 83877
4. Source of Water: Pack River If **GROUNDWATER** (well), Date Drilled: mo. _____ / yr. _____
Well Driller: _____ Drilling Permit Number: _____
5. Use(s) (as authorized by the water right permit):
Domestic (No. of households): _____ Stockwater (No. and type of stock): _____
Irrigation (No. of acres): 30.9 acres Other: Road/Dust Abatement & Industrial Use
6. Total rate of diversion and/or volume for which proof is submitted: .5 cfs OR _____ acre-feet
7. Measuring Device Requirement: **(refer to the approval conditions on your permit and respond accordingly)**
(This question is **not optional**. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)
Measuring Device: Is a measuring device required? Yes _____ or No X *
Has the measuring device been installed? Yes _____ or No _____
8. Fee Enclosed: \$ 100.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)
9. Person to contact to accompany the Department representative during field examination of the water system.
Name: Dan Campbell Telephone Number: (208) 263-7527
Address: 26 Samuels Road Samuels, Idaho 83864
10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted. I agree to relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: Dan J. Hally - Vice President Date: 03-06-03
(include your title, if on behalf of company or organization)

* Measuring Device will be installed.

MICROFILMED
MAR 24 2003

RECEIVED

FEB 28 2001

For Office Use Only
\$50 Fee Received by 50.00
Date 2/28/01 J. Barton
Receipt No. C052466

STATE OF IDAHO Department of Water Resources
DEPARTMENT OF WATER RESOURCES
REQUEST FOR EXTENSION OF TIME
TO PROVIDE ADDITIONAL TIME IN WHICH TO SUBMIT PROOF OF
BENEFICIAL USE FOR A WATER RIGHT PERMIT

The Idaho Department of Water Resources will consider this form as a request that the permit holder(s) be granted an additional period of time under the provisions of Section 42-204, Idaho Code in which to complete development of a water right.

Permit No. 96-8979
Name(s) of Permit Holder: Ceda-Pine Veneer, Inc. (P.O. Box 536 Post Falls, Id. 83877)
Address: 26 Samuels Road City Samuels State Id. Zip 83864
Telephone No. 1-208-263-7527 Date Proof is Due: April 1, 2001

Describe what work has been completed toward the development of this water right:
(This must be filled out! If no work has been completed, show "none".)

Preliminary studies have been undertaken, which include:
research, engineering, mapping, land use and all costs associated
with this project.

Costing \$ 2,000.00

The permit holder(s) has been unable to complete the remainder of the work for the following reasons:

The current lumber market is very poor, severely restricting
cash flow. As market conditions improve, we hope to proceed
on permit no. 96-8979.

Permit holder(s) request an extension to April 1, 2003

(Signature)*

*If other than permit holder, Power of Attorney must be supplied.

ACTION OF THE DEPARTMENT OF WATER RESOURCES

MICROFILMED

IT IS HEREBY ORDERED that the above request for extension of time be

APPROVED and the time within which to submit proof of beneficial use
is extended to April 1, 2003.

Signed this 1st day of March, 2001

L. Glen Saxton
L. GLEN SAXTON, CHIEF
WATER ALLOCATION BUREAU

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
INSTRUCTIONS FOR EXTENSION OF TIME REQUEST
TO SUBMIT PROOF OF BENEFICIAL USE

If the water right development authorized by your permit is not complete and you need more time to submit proof of beneficial use of water under your permit, please read the following:

Under the provisions of Section 42-204, Idaho Code, the department can extend the proof due date of your permit only once, and then only if you can demonstrate that you have been pursuing development of the permit with due diligence.

The Request for Extension of Time form requires that you indicate the extent of development that has occurred, the cost, and the reason(s) the work has not been completed. This information must be provided in enough detail to show due diligence. Examples of work performed are: well drilled, pump installed, 10 acres now irrigated, fish propagation ponds constructed, sprinkler system purchased, etc.

If no work has been accomplished, the statutes provide that the Request for Extension of Time must be denied. **Lack of financial resources, the state of the economy or personal illness usually cannot be considered adequate reasons to approve a Request for Extension of Time.**

EXCEPTIONS TO ONLY ONE EXTENSION

The proof due date for a permit that has not been developed for one of the following reasons may be granted one or more extensions of time even though no work has been accomplished:

- When there is a lack of a required consent or final approval from a federal government agency (**evidence of delay must be submitted with the request**), i.e. right-of-way easement or land classification such as Desert Land Entry or Carey Act.
- When litigation related to title of the water has prevented development of the permit (**evidence must be submitted with the request**).
- When the water project is of a large scale — storage of more than 10,000 acre-feet or diversion of more than 25,000 acre-feet in one irrigation season for an irrigation project of at least 5,000 acres.
- When the water right permit is held by the United States of America (**reason for request must be submitted**).

A non-refundable filing fee of \$50.00 must accompany the Request for Extension of Time form.

***NOTE** that in no case should a Proof of Beneficial Use form and a Request for Extension of Time form both be submitted. If your water development project is completed, then the proof of beneficial use form should be completed and returned. If the project is started but not completed, then the Request for Extension of Time form should be completed and returned in compliance with the guidelines above. If the project has not been initiated and does not fit into one of the exceptions listed above, then neither form should be returned and the permit will lapse and become of no further force nor effect.*

MICROFILMED

MAR 24 2000

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 96-08979

Proposed Priority: January 28, 1998 Maximum Diversion Rate: 0.50 CFS

This is to certify, that CEDA PINE VENEER CO

PO BOX 536

POST FALLS ID 83877-0536

has applied for a permit to appropriate water from:

PACK RIVER

tributary of PEND OREILLE LAKE

and a permit is APPROVED for development of water as follows:

BENEFICIAL USE

PERIOD OF USE

RATE OF DIVERSION

INDUSTRIAL

01/01 to 12/31

0.50 CFS

LOCATION OF POINT(S) OF DIVERSION:

NESW , Sec. 32, Township 59N, Range 01W
BONNER County

PLACE OF USE: INDUSTRIAL

TWN RGE SEC

59N 01W 32

NENE

NWNE

SWNE

SENE

CONDITIONS OF APPROVAL AND REMARKS

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before April 1, 2001.
2. Subject to all prior water rights.
3. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which permit holder had no control.
4. After specific notification by the department, the right holder shall install a suitable measuring device or shall enter into an agreement with the department to determine the amount of water diverted from power records and shall annually report the information to the department.
5. Use of water under this approval shall comply with applicable water quality standards of the Division of Environmental Quality of the Idaho Department of Health and Welfare.
6. Water shall not be diverted under this right when flows in the Pack River are below established minimum stream flow amounts.
7. Industrial use is for herbicide mixing, dust abatement, saw cooling, and steam vat tanks.

MICROFILMED

SEP 29 1998


State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 96-08979

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

27th day of March, 1998.

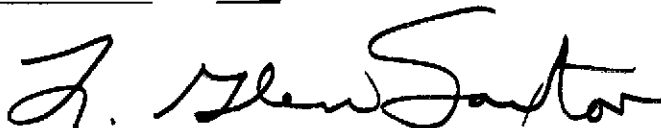

Karl J. Dreher, Director

for



MICROFILMED

SEP 29 1998

Ident. No. 96-08979

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

RECEIVED

MAR 19 1998

Department of Water Resources

1. Name of Applicant Ceda Pine Veneer Company Phone 208-263-7527
Mailing address P.O. Box 536, Post Falls, ID 83877
2. Source of water supply Pack River which is a tributary of Lake Pend Oreille
3. Location of point of diversion is Township 59N Range 1W Sec. 32, in the NE 1/4,
NE 1/4, SW 1/4, Govt. Lot N/A, B.M., Bonner County;
additional points of diversion if any: N/A
4. Water will be used for the following purposes:
 Amount 2.5 for Industrial Land Farm purposes from May 1 to Dec 31 (both dates inclusive)
 (cfs or acre-feet per annum)
 Amount 2 for Road/Dust Abatement purposes from May 1 to Oct 31 (both dates inclusive)
 (cfs or acre-feet per annum)
 Amount 4 for Industrial Use Plant purposes from May 1 to Oct 31 (both dates inclusive)
 (cfs or acre-feet per annum)
 Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per annum)
 Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per annum)
 Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 8.33×10^{-3} and/or (b) 62 (1500 lbs/yr)
 cubic feet per second acre feet per annum
6. Proposed diverting works:
 - a. Describe type and size of devices used to divert water from the source 25 HP, variable speed, 300 gpm max.
portable pump. Intake to be removable - as shown on attached drawing.
 - b. Height of storage dam N/A feet; active reservoir capacity .7 acre-feet; total
 reservoir capacity .7 acre-feet
 - c. Proposed well diameter is N/A inches; proposed depth of well is N/A feet
 - d. Is ground water with a temperature of greater than 85°F being sought? N/A
 - e. If well is already drilled, when? N/A; Drilling firm N/A
 Well was drilled for (well owner) N/A; Drilling Permit No. N/A
7. Time required for completion of works and application of water to proposed beneficial use is 3 years (minimum 1 year)
8. Description of proposed uses (if irrigation only, go to item 9):
 - a. Hydropower; show total feet of head and proposed capacity in KW. N/A
 - b. Stockwatering; list number and kind of livestock. N/A
 - c. Municipal; show name of municipality. N/A
 - d. Domestic; show number of households. N/A
 - e. Other; describe fully. Dust control for landfarm area and napweed control, dust abatement for high traffic
areas, and supplemental industrial water for saw cooling and steam vat tanks. **MICROFILMED**

SEP 29 1998

9. Description of place of use:

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	N E				N W				S W				S E				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
59N	1W	32	I	I	I	I													~~2~~
59N	1W	32	~~Q~~	~~Q~~	~~Q~~	~~Q~~													~~2~~

Total number of acres to be irrigated 0

10. Describe any other water rights used for the same purposes as described above. Groundwater currently being used for road dust abatement and industrial uses. (96-08827)

11. a. Who owns the property at the point of diversion? Ceda Pine Veneer Co.

b. Who owns the land to be irrigated or place of use? Ceda Pine Veneer Co.

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Remarks: This surface water request will supplement the existing groundwater supply.
(Issuance of surface water rights may decrease groundwater withdrawal rates.)

Application revised in Feb 1998 to reflect: changes in volume, use and pump.

INDUSTRIAL USE IS FOR LAND FARM APPLICATION, DUST ABATEMENT AND FOR PLANT OPERATION.


13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth. MICROFILMED

SEP 29 1998
 - V. Pres
 Signature of Applicant (and title, if applicable)

Received by dp Date 1/28/98 Time 1145a Preliminary check by AB
 Fee \$ 2/28/98 \$100 - Received by dp # NO11664 Date 10/14/97
 Publication prepared by dp Date 2/11/98 Published in Boise Co. Daily Bee 2/19+26/98
 Publication approved dp Date 3/4/98


RECEIPTING NOTE - NO11664 ORIGINAL WAS RECEIPTED FOR \$160 -
 A \$60 - REFUND SHOULD BE INITIATED.

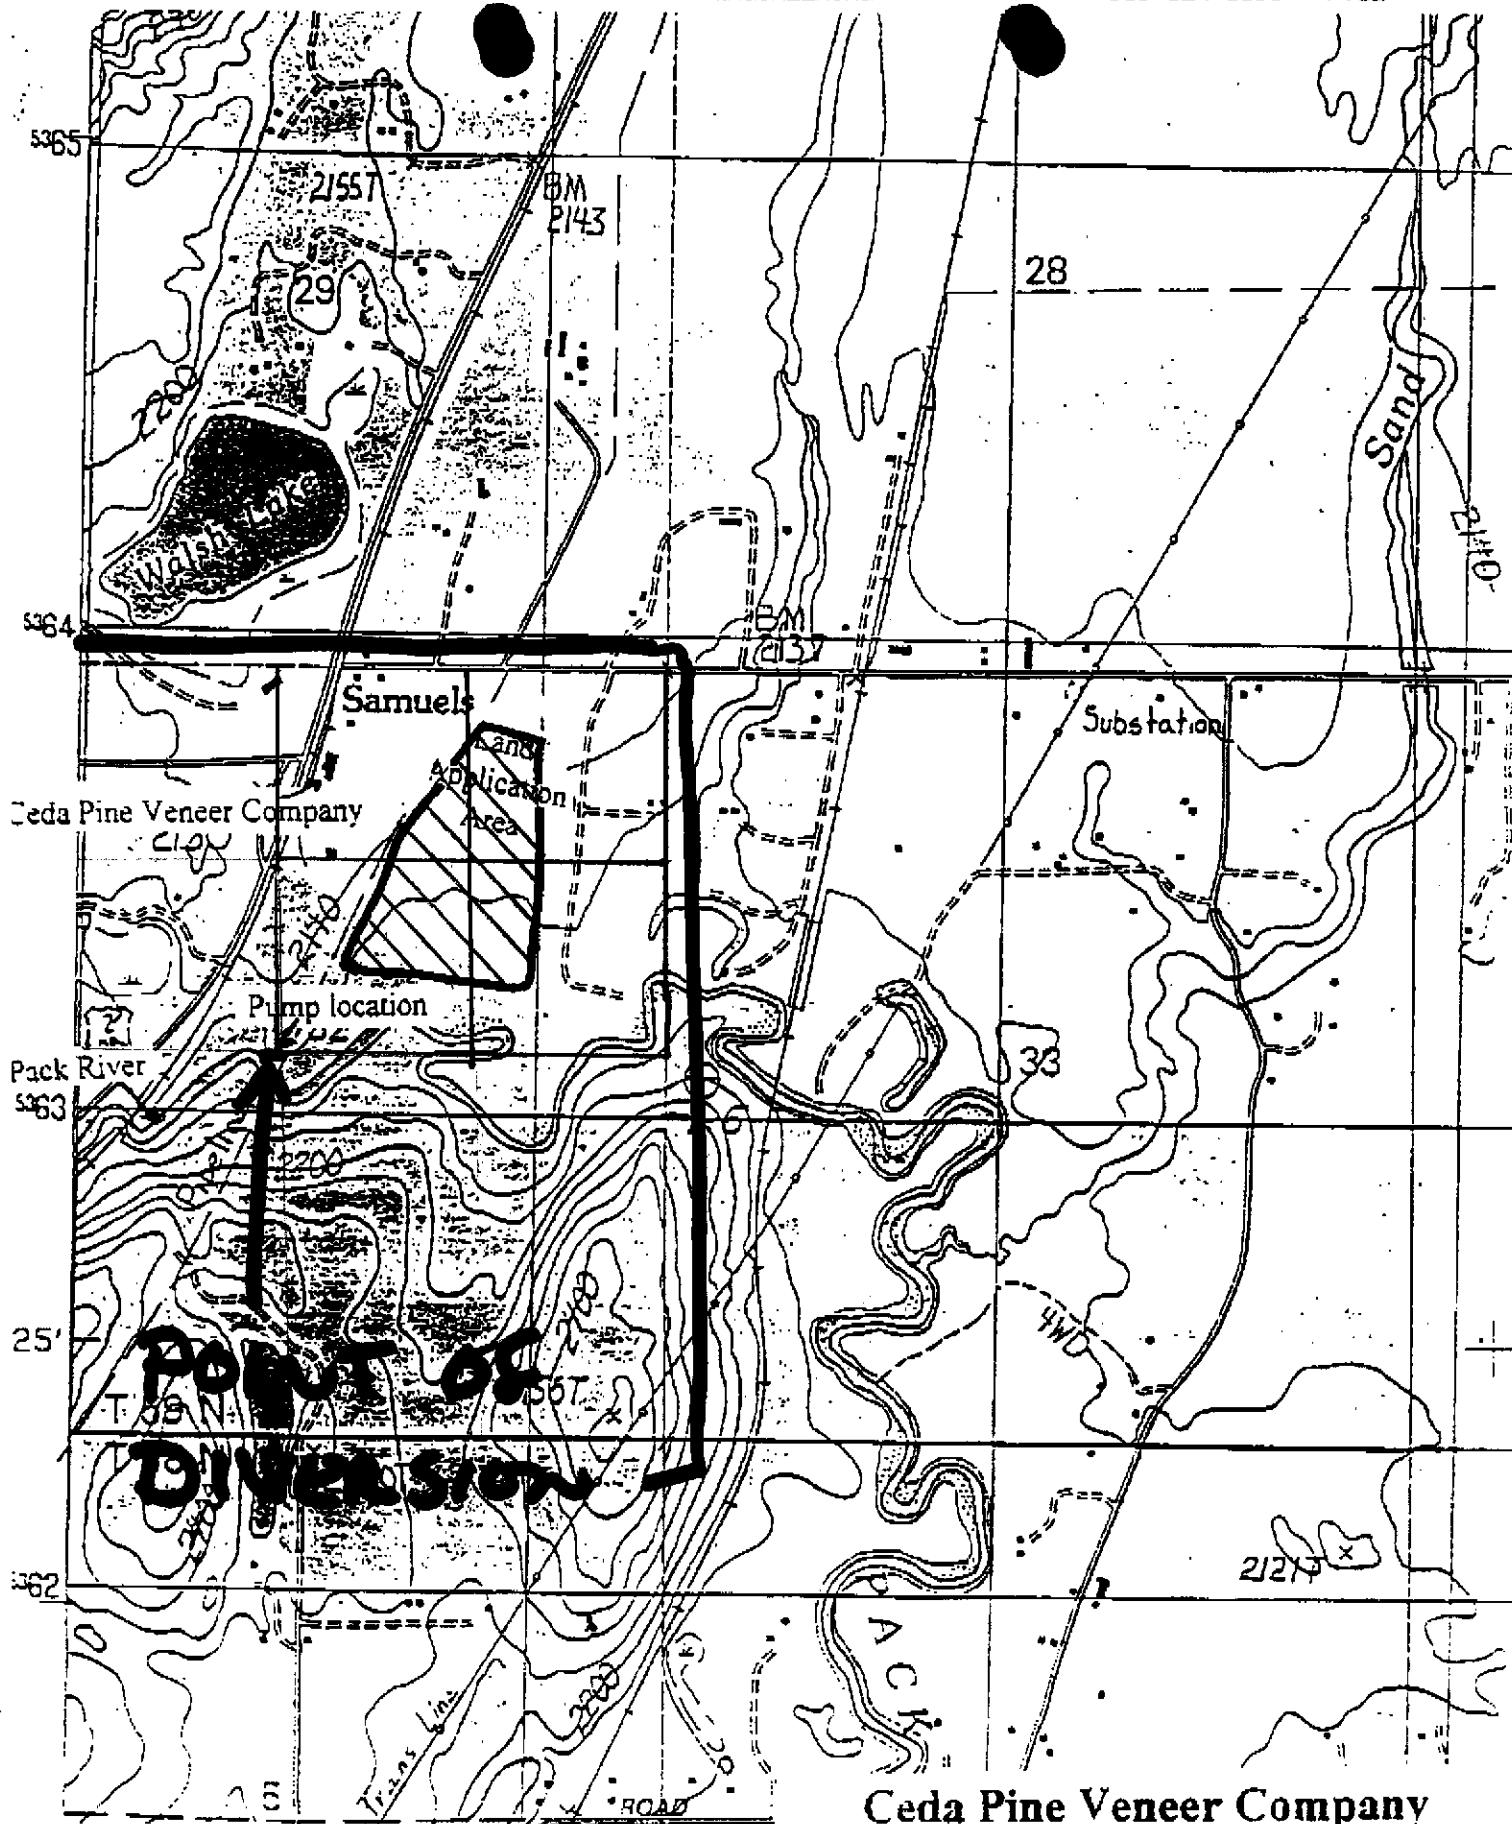

Ceda Pine Veneer Company

MICROFILMED Surface Water Rights Application
Site Map


SEP 29 1998

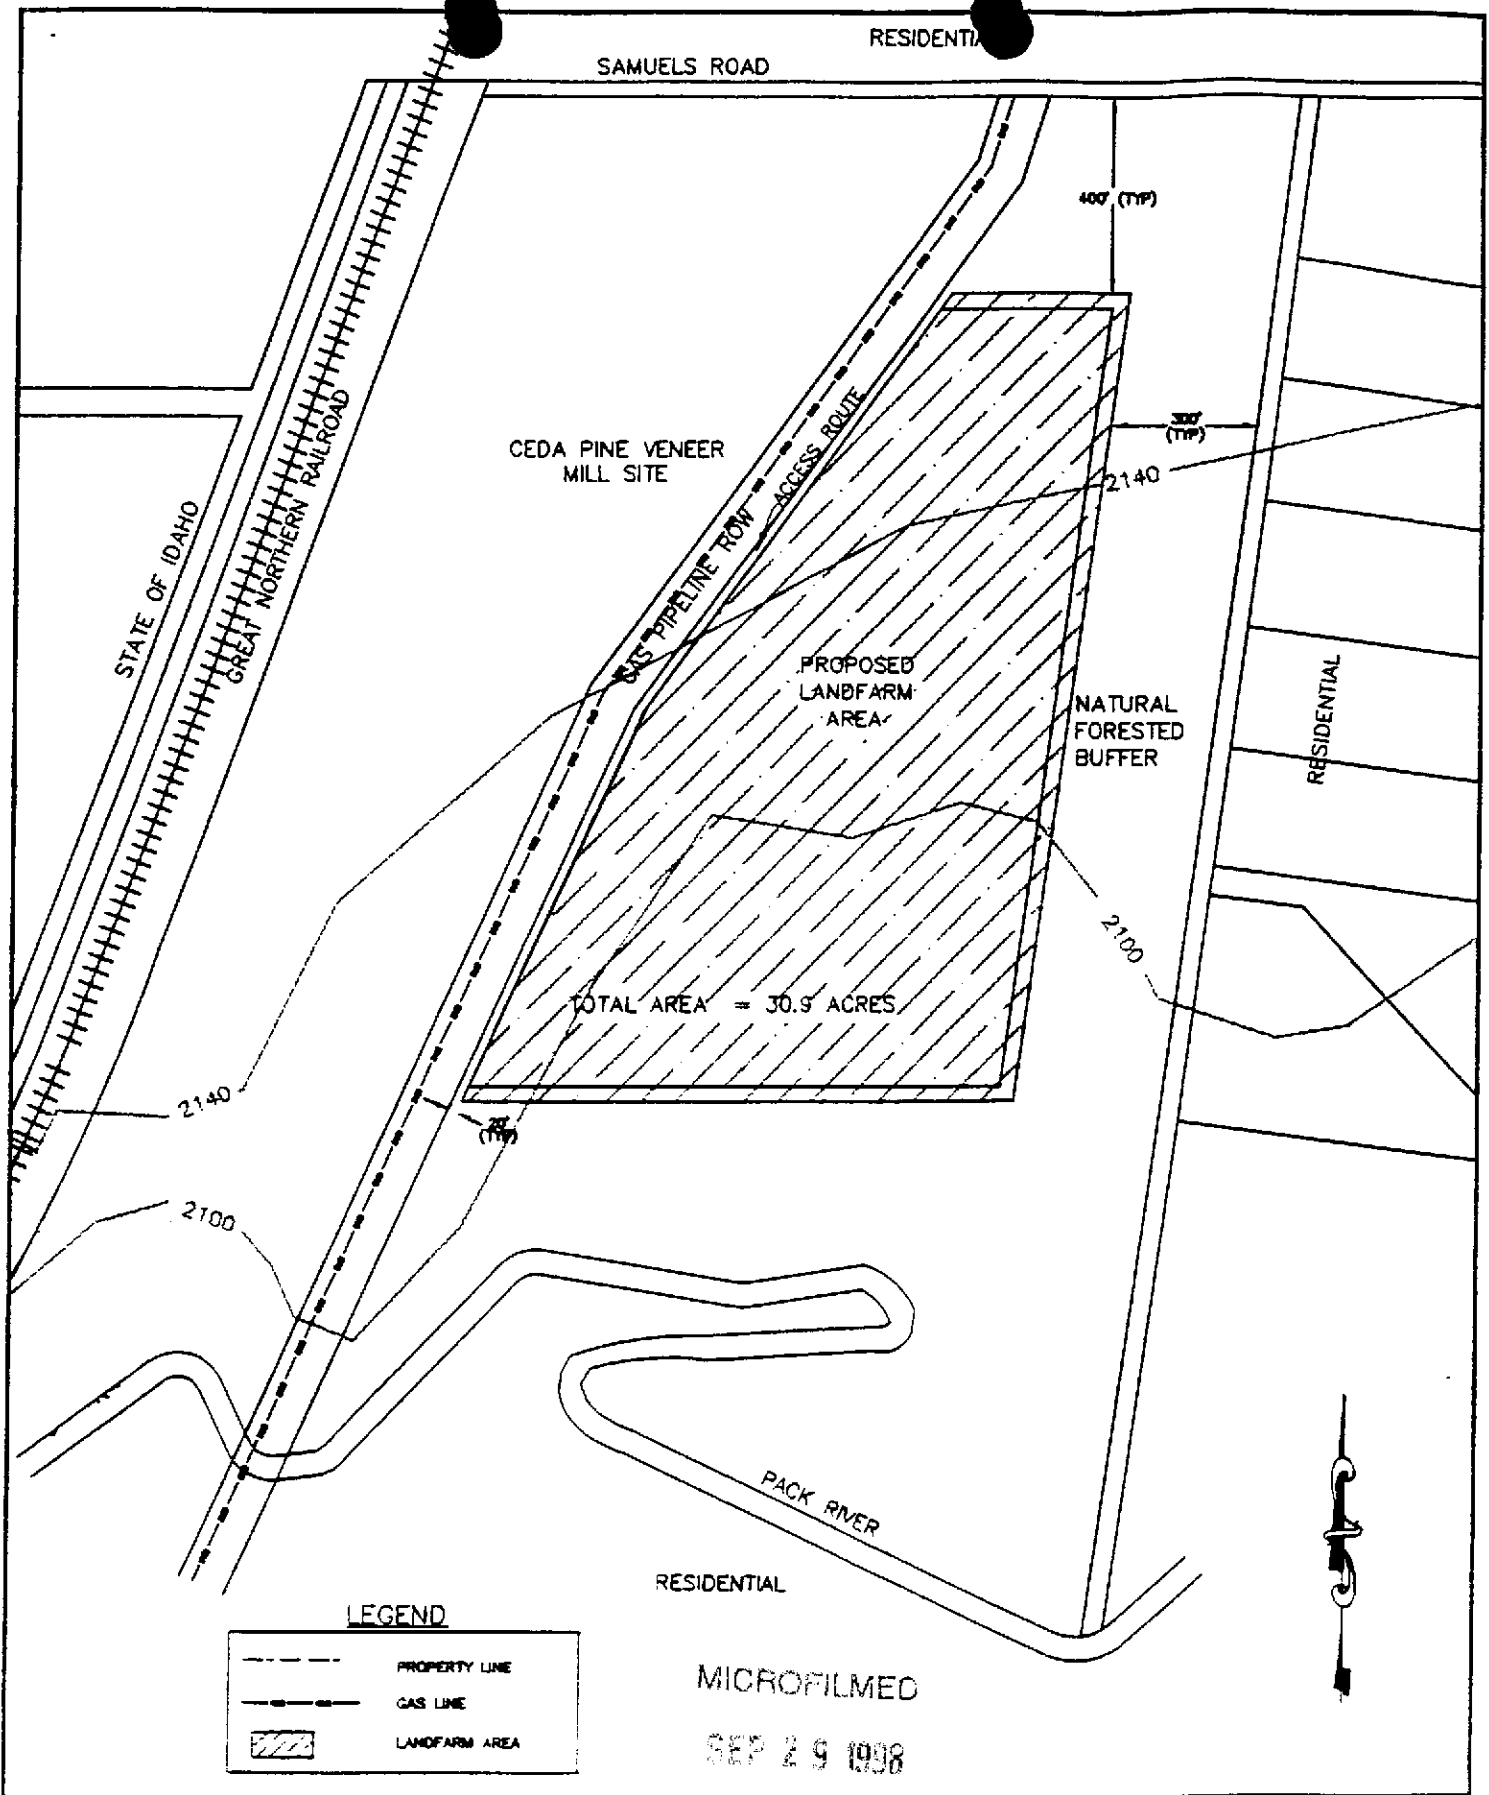

DSGND BY: GEH		CHCKD BY:	IDAHO VENEER CO. CEDA PINE VENEER CO. LANDFARM PROPOSAL	 centurywest ENGINEERING CORPORATION		
DRWN BY: WMS		SCALE: 1"=400'			DATE: 11/97	FIGURE: 1
PROJECT NO: 30398						

144 1 6 2004

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

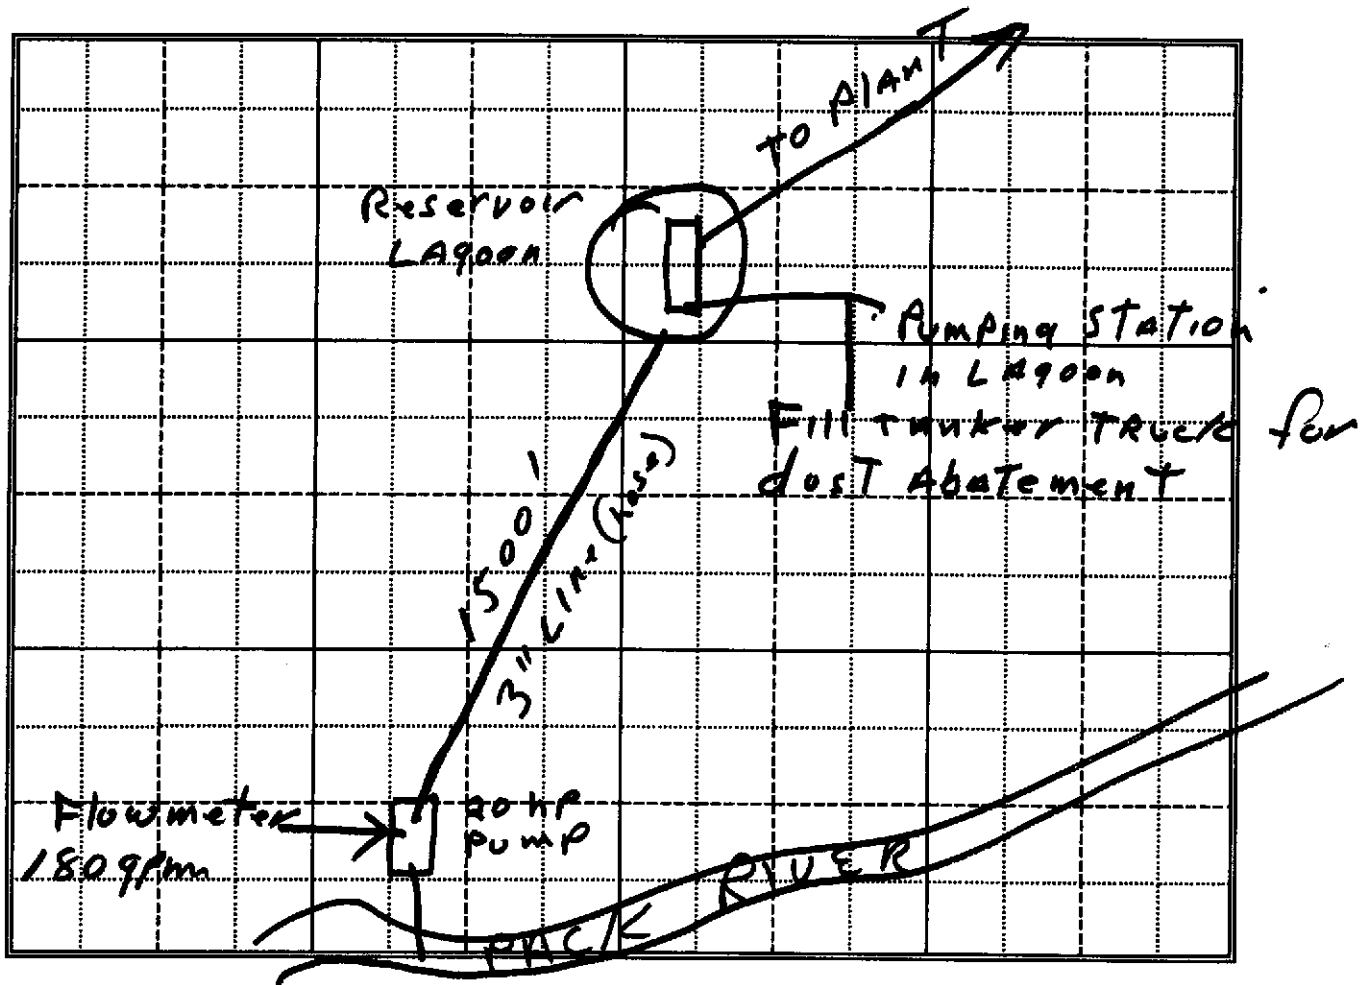

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for Irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	P	20	Not Legible	HATZ	08979 3"
	Gas Powered				

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

MICROFILM

JUN 16 2003

E. NARRATIVE/REMARKS/COMMENTS

A gas powered pump delivers from pack river to storage lagoon/reservoir via a 3" flexible line laid over land. From there a pumping station delivers to veneer plant, and also fills a 3,000 gal tank truck used for dust abatement.

Proof of beneficial use form shows 30.9 acres of irrigation. This is not happening.

Annual Volume figures provided to me by Dan Campbell

Pack River Permit #96-08979

We can pump 175 gals per min with existing pump with 3" discharge hose. We will only need to pump during May thru Oct.

$175 \text{ gals per min May thru Oct (184 days)} = 46,368,000 \text{ gals}$

Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED

JUN 15 2008

F. FLOW CALCULATIONS

Measured Method:

Additional Computation Sheets Attached

Flow meter $\frac{180 \text{ gpm} \times 1.33681}{60} = 0.4 \text{ cfs}$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

 $V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____ $V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____ $V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

$\frac{46,368,000 \text{ gal}}{325,850} = 142.3 \text{ AFA}$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<i>Industrial</i>	<i>01-01</i>	<i>12-31</i>	<i>.4</i>	<i>142.3</i>
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
Totals:			<i>.4</i>	<i>142.3</i>

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other


I. AUTHENTICATIONField Examiner's Name *Wayne Baldwin* Date *6-12-03*

Reviewer _____ Date _____

SEAL

MICROFILMED

FEB 15 2004

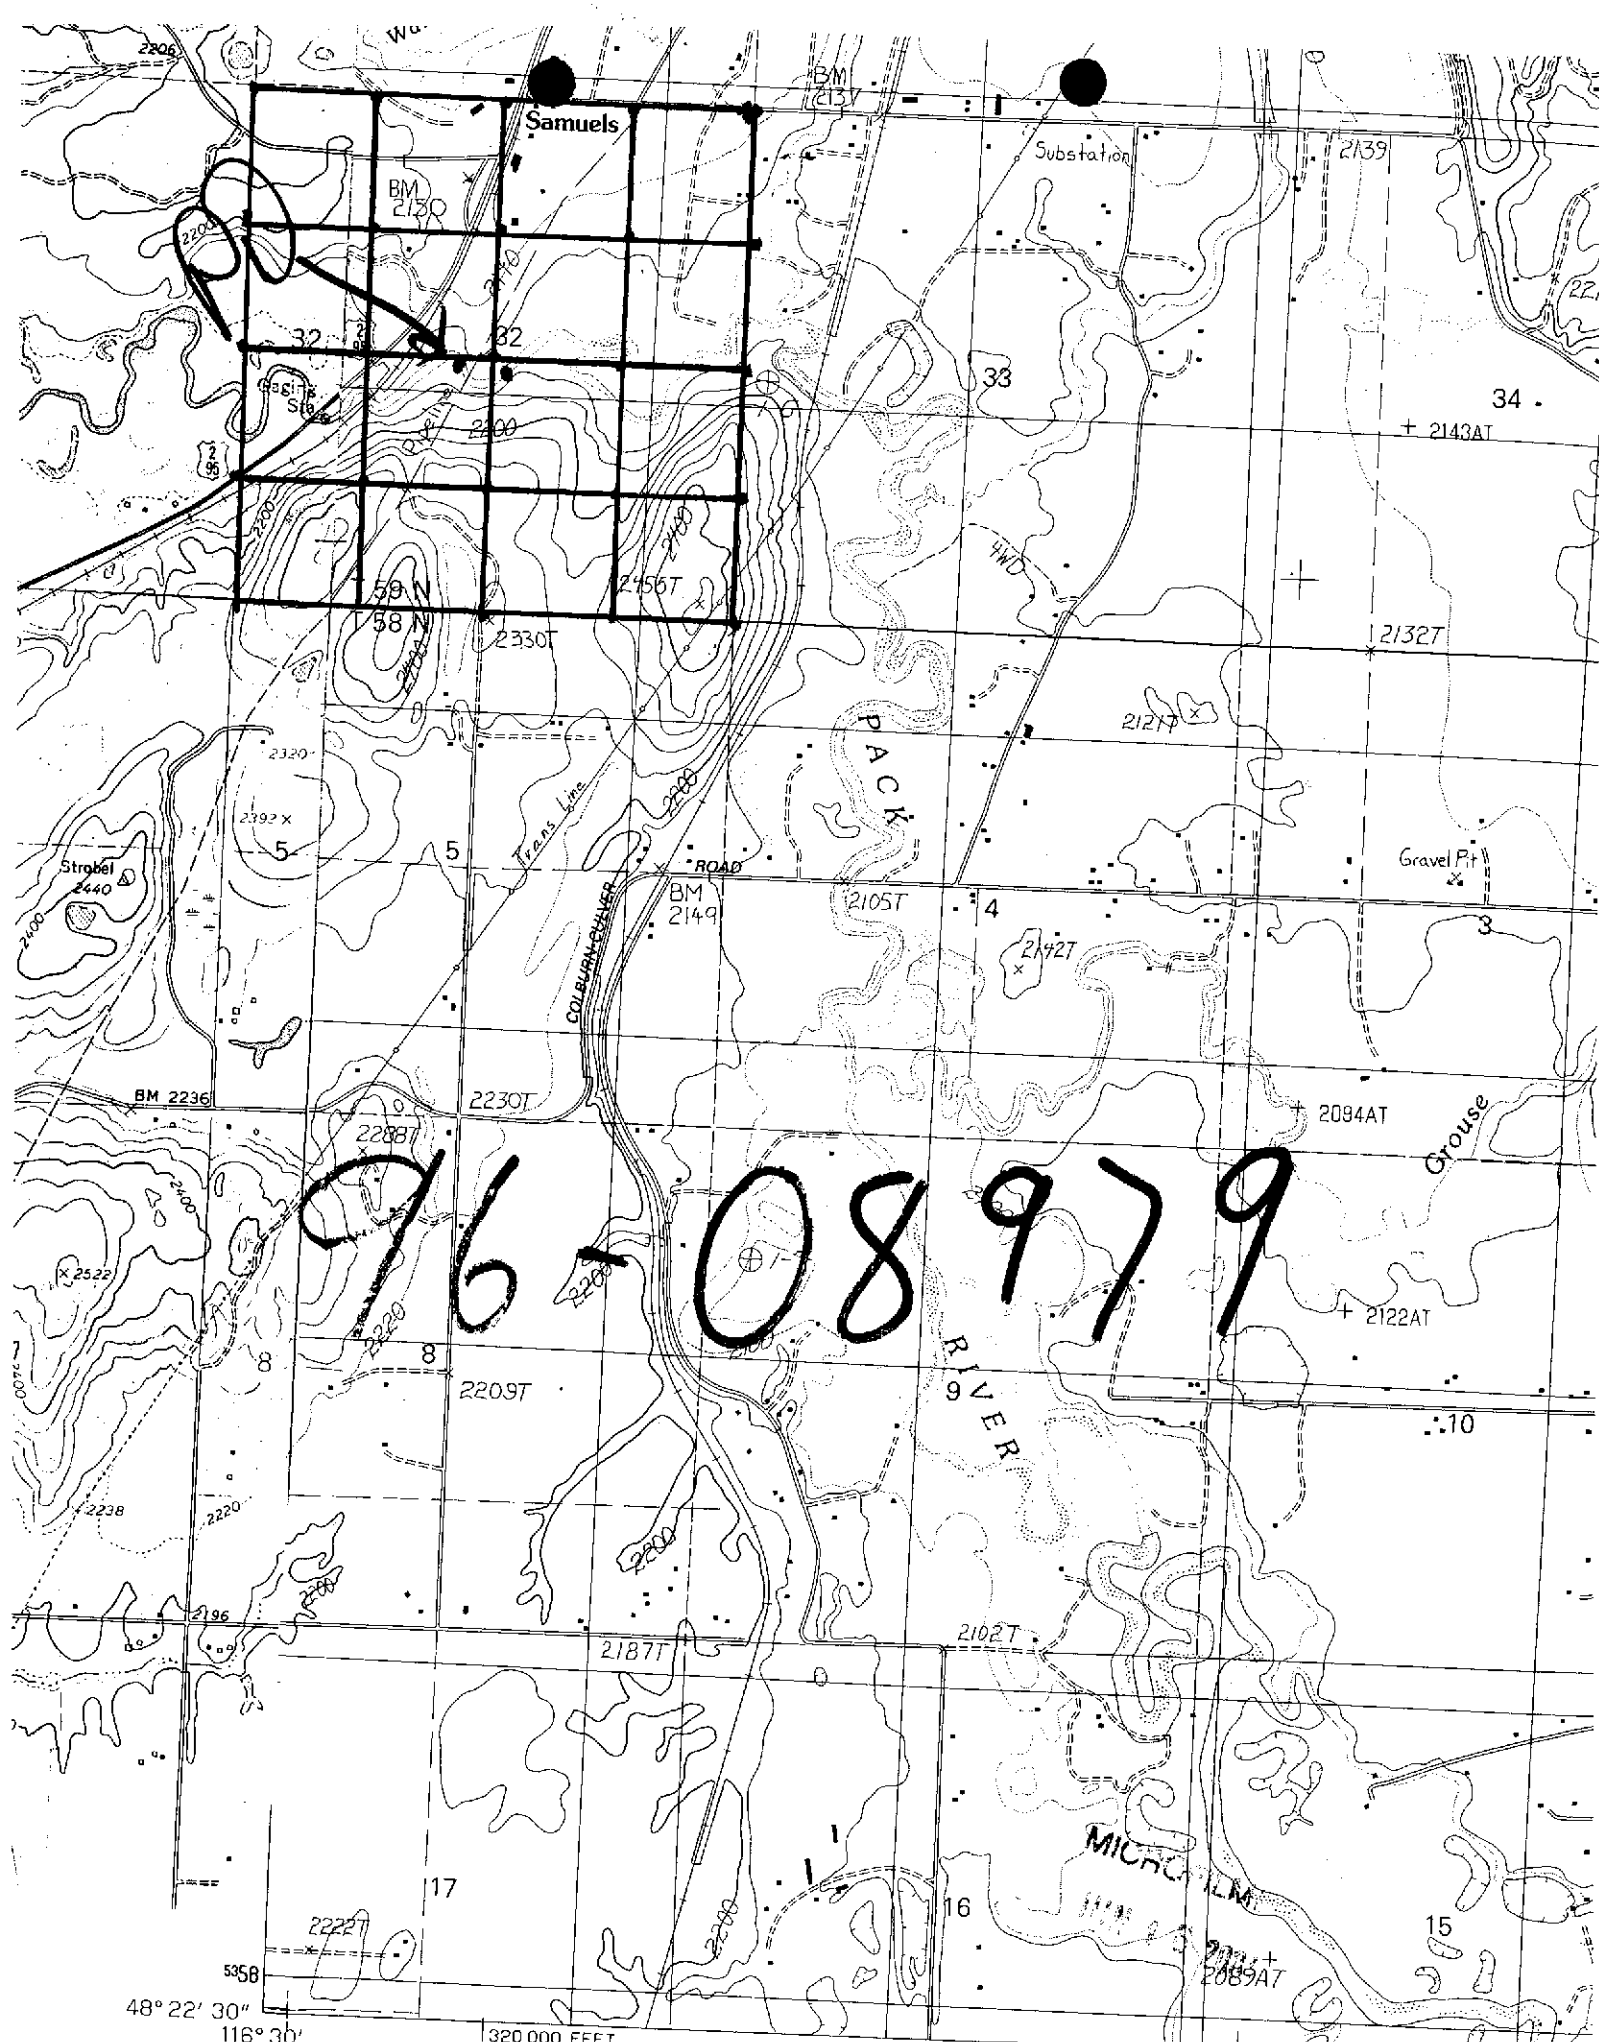

96-08979

96-08979



PD
Pump

Reservoir Lagoon
+
Pump Station



96-08979

Plant



96-08979

Tanker for
dust abatement

PW
→
Pump

Reservoir Lagoon
→
Pump Station

Plant

Tanker for
dust abatement

96-08979

96-08979

96-08979

96-08979




PW
→
Pump



Reservoir Lagoon
→
Pump Station



Plant

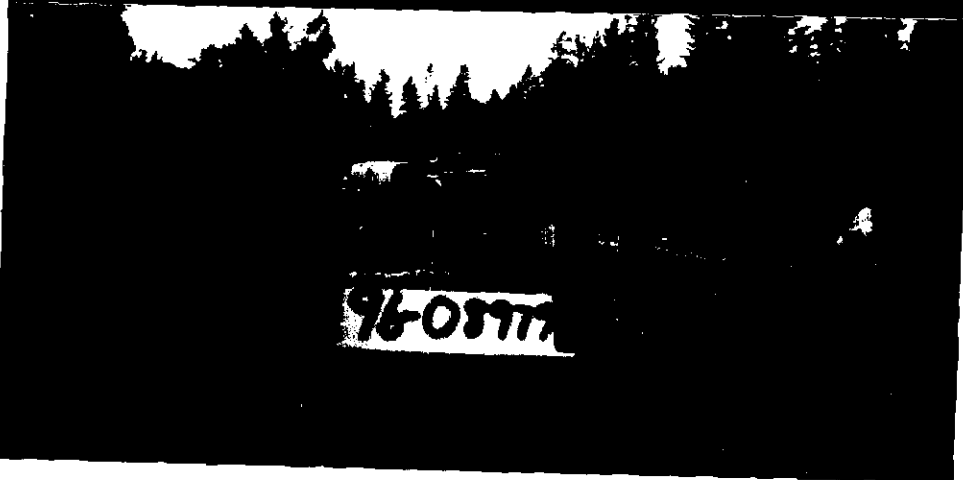

Tanker for
dust abatement

96-08979


96-08979



PD
x
Pump



Reservoir Lagoon
x
Pump Station

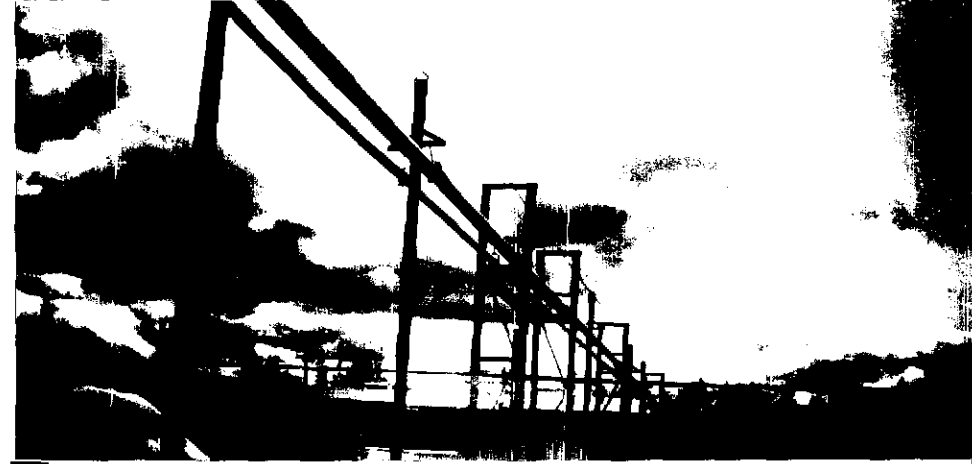

Plant



Tanker for
dust abatement

96-08979



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098

Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

March 14, 2003

CEDA-PINE VENEER INC
PO BOX 536
POST FALLS ID 83877

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 96-08979

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to contact you to schedule a field examination to determine and confirm the use being made of the water, and that it meets the permitted beneficial use. However, during my review of your file, and based upon the proof you filed there are some questions the department needs clarified about your usage of the water.

- According to the proof you filed, you show that you are irrigating 30.9 acres. Your permit authorizes only **Industrial** use, specifically herbicide mixing, dust abatement, saw cooling, and steam vat tanks. If you are irrigating land, that use should be covered under a separate permit, but if you are only applying water to an area on an as need basis for dust abatement, then the information in the irrigation blank is not accurate. The field examiner will make that determination at the time he examines this development prior to licensing.

Be advised that Section 42-248, Idaho Code, requires you or the owner of these water rights to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

If you have questions, please contact either the department's **Northern Regional Office** in Coeur d'Alene at (208) 769-1450, or me at (208) 327-7953.

Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Enclosures
c: IDWR - Regional Office

MICROFILMED
MAR 24 2003

ANALYSIS SHEET FOR PROOF OF BENEFICIAL USE

Permit No.: 96-8979

Reviewed By: dgibson

Date: March 12, 2003

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Proof received timely?	X		Drilling permit required?		X
License examination fee required?	X		Drilling permit No.:		
Appropriate fee submitted?	X		Drilling permit upgrade needed?		
Receipt No.:		C067843	Well driller's report filed?		X
Additional Amount Due:			Measuring device required?		X
Name and address same as permit?	X		Measuring device installed?		
Are the water uses correct?		X	Measure device waiver requested?		

Priority Calculation

Date proof received	03/11/2003
Date proof due	- 04/01/2003
Lapse notice sent	-
No. of days late	= 0
Holiday allowance	+
Priority date	+ 01/28/1998
New priority date	= 01/28/1998

Deficiencies of Actions Items

Acknowledge proof. Notify right holder that there is no provision for irrigation under this right.

January 31, 2003

CEDA-PINE VENEER INC
PO BOX 536
POST FALLS, ID 83877-0536

PROOF DUE NOTICE

RE: PERMIT NO. 96-8979

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before April 01, 2003. (See last page of your approval permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a completed field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.


Sincerely,

Deborah J. Gibson, Administrative Assistant
Water Allocation Bureau

Enclosures

MICROFILMED

MAR 24 2003

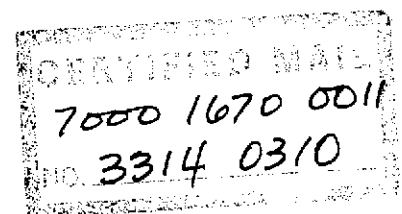



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

March 1, 2001

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

CEDA PINE VENEER CO
PO BOX 536
POST FALLS ID 83877-0536

RE: PERMIT NO. 96-08979

Dear Permit Holder:

I have enclosed a copy of the approved request for extension of time submitted in connection with the above referenced permit which extends the time within which to submit proof of beneficial use to **April 1, 2003**. Please note that the department granted the extension based on due diligence. Therefore, it is important that you work diligently towards completion of the project since the department **may not** be able to grant future extension requests based on due diligence.

Section 42-248, Idaho Code requires you or the owner of this water right to maintain current ownership and address records on file with the department. Please contact this office or any regional office of the department for the proper form to file a change of ownership of a water right and/or a change in the address of the owner.

Please contact the department, if you have any questions regarding this matter.

Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Enclosure

c: IDWR - Regional Office

MICROFILMED

MAR 1 2001

ANALYSIS SHEET FOR EXTENSION OF TIME

Permit No.: 96-8979

Reviewed By: dgibson

Date: March 1, 2001

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Request received	X		Is the delay a government agency?		X
Appropriate fee	X		Is supporting documentation needed to support the file?		
Additional Amount Due:					
Receipt No.:	C052466		Has the permit been involved in litigation?		X
Name and signature same as permit?	X		Is supporting documentation needed to support the file?		
Is address same as permit?	X		Is the project more than 25,000 acre feet for irrigation or 10,000 acre feet for a reservoir?		X
Has adequate work been completed to demonstrate due	X				

Priority Calculation

Extension request received	02/28/2001	New proof due date	04/01/2003
Date proof due	- 04/01/2001		
Lapse notice sent	-		
No. of days late	= 0		
Holiday allowance	+		
Priority date	+ 01/28/1998		
New priority date	= 01/28/1998		

Action Taken

Acknowledge request and change proof due date to 4/1/2003.

January 31, 2001

CEDA PINE VENEER CO
PO BOX 536
POST FALLS, ID 838770536

PROOF DUE NOTICE

RE: PERMIT NO. 96-8979

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before April 01, 2001. (See last page of your approval permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a completed field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.


Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Enclosures

MICROFILMED

MAR 24 2001

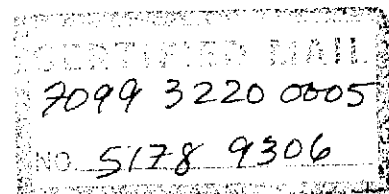

4/8/98

MAR-25-1998 15:33

CENTURY WEST ENGINEERING

509 624 0355 P.01

#96-08979

TO: CINDY BIRD

RE: TO FILE

FROM: AL - NORTHERN



century west
ENGINEERING CORPORATION

RECEIVED

APR 14 1998

Department of Water Resources

FAX TRANSMITTAL

TO: Al Beardslee 208-769-1454

FROM: A. Huy

DATE: 3/25/98

PROJECT NUMBER
NAME: Cedar Pine - Water Rights

NUMBER OF SHEETS 1 (Including Transmittal)

COMMENTS:

Hi Al!

The word is -> OK to let the application for GW expire
for now. The hope is that the surface water will be
approved - and they will actually abandon the gw well
(bentonite, etc).

If the surface water right is not approved - they will
need to upgrade the well & re-apply for use.

Make sense?

gh

MICROFILMED

1825 N Hutchinson Road, 2nd Floor Spokane, Washington 99212
Phone: (509) 838-3810 FAX: (509) 624-0355



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

March 30, 1998

PHILIP E. BATT
GOVERNOR

CEDA PINE VENEER CO
PO BOX 536
POST FALLS ID 83877-0536

KARL J. DREHER
DIRECTOR

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 96-08979

Dear Permit Holder:

The Department of Water Resources (IDWR) has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.

The permit is a preliminary order issued by IDWR pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by IDWR unless a party petitions for reconsideration or files an exception and/or brief as described in the enclosed information sheet.

As a permit owner you must commence the excavation or construction of the diverting works within one year of the date the permit was issued, and you must proceed diligently until the project is completed. The date shown under condition no. 1 is the date when the project must be completed.

The Department will send you a "Proof Due Notice" approximately 60 days prior to the above referenced date requesting you to file either a Proof of Beneficial Use form or a Request for Extension of Time form.

Please note that a separate stream channel alteration permit must be obtained from the IDWR prior to any activity in the stream channel other than construction or maintenance of the diversion structure for your water right(s). Applications for stream channel alteration permits must be filed at least sixty days prior to the commencement of work in the stream.

If you have any questions, please call me at 208-327-7946.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:klt
Enclosures

MICROFILMED

SEP 29 1998

CERTIFICATE OF MAILING

I hereby certify that on the 30th day of **March, 1998**, I mailed a true and correct copy, postage prepaid, of the foregoing **PRELIMINARY ORDER (Approved Permit)** to the person(s) listed below:

Water Right No. 96-08979

**CEDA PINE VENEER CO
PO BOX 536
POST FALLS ID 83877-0536**


Kari Lynn Townsend
Secretary

MICROFILMED

SEP 29 1998

Responding to Preliminary Orders Issued by the Idaho Department of Water Resources

The Idaho Department of Water Resources (Department) issues water right permits, licenses, and transfers as preliminary orders pursuant to section 67-5243, Idaho Code. A preliminary order can and will become a final order without further action of the department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of the order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from a preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, a preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to a preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

ORAL ARGUMENT

If the Department grants a petition to review a preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

MICROFILMED

SEP 29 1998

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with a preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MICROFILMED
SEP 29 1998

APPLICATION FOR PERMIT STATE OFFICE REVIEW

by Cindy Lou

No.: 96-8979 Name: Cedar Pine Veneer Co Date: 3/20/98 Ad OK? ☒ ☒ Gvmt Lts: ☒

AREA OF CONCERN: - No/Yes: _____ Mor / _____ GWMA / Trust / Non-trust

PROTESTED: - 020 (Protest Agreement) or *W19 (Order)

SYSTEM COMPLETED:

> 1 year - 26A-P17

≤ 1 year/no proof - P16

GROUNDWATER: (✓ FLO-CH)

WMD (✓ MAP)

> 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)

≤ 0.24 cfs/5 acres - No MD

WMD Supplemental use - 065-079 (if GW use SW 1st-statewide)-(cannot move SW off)

> 0.24 cfs/5 acres - 01M (report when notified)

≤ 0.24 cfs/5 acres - No MD

DRILLING PERMIT:

All wells (✓ WDQ3) - 046-P23

Included w/permit - Permit No. _____ - _____ - _____ - _____, P99

irr. in WD - P05 (new well location)

SURFACE WATER: (✓ FLO-CH) (Surface water that doesn't sink is regulated):

IN/ABOVE MIN. STR. FLOW (✓ MAP) - *WB9 Payette R.

WD (✓ MAP & LISTING) - R04 (WD # _____)

> 0.10 cfs - 01J-P08 (MD & LD)

≤ 0.10 cfs - 01H-P01 (LD) or No MD (in-stream stock)

WMD (✓ MAP)

> 0.24 cfs/5 acres - 067 or No MD (in-stream stock or power)

≤ 0.24 cfs/5 acres - No MD

SPRINGS/SINK, INACTIVE WD & REST OF STATE

> 0.24 cfs/5 acres - 01M or No MD (in-stream stock or power)

~~≤ 0.24 cfs/5 acres~~ - No MD

RIVER BASINS: (*Surface water):

Snake R (01) - *W22-P04, NA

(02/03-irr) - 007 (w/ remark *WB9 if above Weiser), NA

Payette R(65) - *W22 (regulated uses), 047-P04 (Payette Lake), NA

Salmon R(70's) - 029 (fish screens), NA

USE:

Domestic surface - *WB5 (Big Wood R or Boise R ↑ Star Bridge); 27A (Payette River); NA

>1 in rest. area - 071-070

Fire Protection - 077

Fish Propagation - 029-007-042(req)-081 (WQ)-P10

Heating/Cooling - R07 (injection well)

Irr ≤ 5 acres - R66/R67/R68/R69 (0.03 cfs/acre + 3.0/3.5/4.0/4.5 AF)

> 5 acres - R62/R63/R64/R65 (0.02 cfs/acre + 3.0/3.5/4.0/4.5 AF)

Mining - 054(req)-081-P10

Municipal - 022, 075, 004 (+memo?), NA (not in restricted area)

Power - 17H/17K(+uses)-08A-025(P18)-01N-028-081(P10)-027 (if no other cons. use);

17G (FERC) or 17M (FERC); 18B-P09; >25 cfs-P18

Stockwater - R37 (BLM/USFS); NA

Storage (✓3 compo.) - 18A (in & out MD for on-stream storage), 18B-P09 (>10' dam), NA

LOCATION:

42-248 area - P84 (in 20/30/40/50/60/70/80 (87) basin)

Boise Front LoGeo - 058 (<85° GW temp only)

In-stream dev. - P52 (stream channel alteration)

Irr Dist/Canal Co. - 023 (Twin Falls area)

SWAN FALLS FLAG (See Code Chart)

Trust - _____

Non-Trust (1) - 051-052-053-P74 (Consumptive Uses), NA

048-049 (Consumptive Uses), NA

004 (PD/PU) _____

OWNERSHIP: - 081

OTHER CONDITIONS: - 081

STANDARD REMARKS: - End use

BENEFICIAL USE DUE: - 4/1/2001

COMMENTS: - Comp. Eff

No. 3720/98 53991 15:33:23 IDAHO SECRETARY OF STATE Annual Report Form 1997 Due No Later Than November 30.		2 Registered Agent and Office NOT A P.O. BOX PATRICK L MALLOY 734 4TH ST POST FALLS ID 83854	
Return to: SECRETARY OF STATE 700 WEST JEFFERSON PO BOX 83720 BOISE, ID 83720-0080 NO FEE REQUIRED * FIRST NOTICE *		1 Mailing Address: Please Correct If Not Correct CEDAR-PINE VENEER, INC. PATRICK L MALLOY P.O. BOX 535 POST FALLS ID 83854	
3 Organized Under the Laws of ID C 53991			
4. Corporations: Enter Names and Business Addresses of President, Secretary and Directors Limited Liability Companies: Enter Names and Addresses of ☐ Managers or ☐ Members (check one)			
Office held	Name	Street or P.O. Address	City State Zip
President:	Patrick L. Malloy	4545 N. Idaho Rd	Post Falls ID 83854
Secretary:	John W. Malloy	3060 W. Riverview	Post Falls ID 83854
Directors:	Patrick L. Malloy	4545 N. Idaho Rd	Post Falls ID 83854
	Daniel J. Malloy	4617 S. Hidden Springs Ln,	Verdale WA 99037
	John W. Malloy	3060 W. Riverview	Post Falls ID 83854
5. Nature of Business Manufacturing		6. Signature <u>Daniel J. Malloy</u> Date <u>8/1/97</u> Name (Typed or Printed) <u>DANIEL J. MALLOY</u> Title <u>Vice President</u>	

ISSUED: 07-04-1997

(DO NOT TAPE OR STAPLE)

25212

MICROFILMED
 SEP 29 1998

ADAMS DEAR. 1 OF WA. & RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

RECEIVED

WRI
WRA
BC

MAR 19 1998

APPLICATION # 96-08979

INITIAL REVIEW

DEPARTMENT OF WATER RESOURCES

APPLICANT: CEDA PINE

BY: AB

DATE: 1/1/98

ITEM REQUIRED INFORMATION

1. (X) Name and Address
2. (X) Source
3. (X) Point of Diversion & County
4. (X) Quantity
 - (X) Nature of Proposed Use
 - (X) Period of Use
5. (X) Total Quantity
6. (X) Description of diverting works
7. (X) Time required for b/u
8. (X) Proposed use
9. (X) Place of use or acres irrigated
10. (X) Other water Rights
11. (X) Ownership
12. (X) Map
 - (X) Signature
 - (X) Fee (Amt, receipt, acknowledgement)

*** Send info sheet Y () N ()

ADDITIONAL INFORMATION

(Yes) (No)

- X Field check: by _____
- X Field report attached
- X Analysis Supp. attached (>5cfs/500af)
- X Water delivered by water master?
- X Water District # _____

PROCESSING

(Yes) (No)

PRIORITY DATE: 1/1/98

X (Include Moratorium Remark)

X Statewide Advertising: (Diversion rate greater than 10 cfs or 1,000 af).

ADVERTISE IN: Banner County

LETTERS SENT REQUESTING:

- () Dam Information () Fish Information
- () Power Information () Other: N/A

INFORMATION RECEIVED:

- () Dam Information () Fish Information
- () Power Information () Other: N/A

GROUNDWATER SECTION

WD Permit No.'s:	Type:	Fees	Receipt No.	Upgrade Needed?
<u>1</u>	Dom. Non-Dom.	Paid \$ _____	_____	Y () N ()
<u>1</u>	Dom. Non-Dom.	Paid \$ _____	_____	Y () N ()
<u>1</u>	Dom. Non-Dom.	Paid \$ _____	_____	Y () N ()

- 1 Groundwater management area
- 1 Critical ground water area
- 1 Well Drilling Permit required
- 1 Well Drilling Application and Fees received
- 1 Well Drilling Application approved?

Remarks: _____

FINAL REGIONAL PROCESSING/REVIEW

(Yes) (No)

- 3/4/98 Notice of pending void order issued. Final order response date: 3/11/98
- 3/4 Further information required from applicant
- 2/11/98 Affidavit of publication received
- 3/4 Application published correctly. If not, record action taken: _____
- 2/11/98 Publication dates and paper recorded on application | Sr. Agent initial AB
- 1 Protests received, Final protest date: 3/19/98
- 1 Measuring device required
- 1 Measuring port required
- 1 Special conditions:
- 1 Special conditions of approval supplement and/or cover letter attached:

Approval Recommended by: AB RWH

Date: 3/11/98

AFFIDAVIT OF PUBLICATION

State of Idaho

ss.

County of Bonner,

RECEIVED

MAR 04 1998

NORTHERN REGION
IDWR

Sherilyn Plunk being first duly sworn on oath

deposes and says that he/she is BOOKKEEPER

of the Bonner County Daily Bee, a newspaper printed and

published at Sandpoint, Bonner County, Idaho; that the

said newspaper has been continuously and uninterruptedly

published in said Bonner County during a period of 12

months prior to the first publication of the hereto attached

notice of publication in the case of:

App for Water

as it was published in the regular and entire issue of the

said paper for a period of 2 consecutive weeks,

commencing on 19 day of Feb, 1998

and ending on the 26 day of Feb, 1998

and that said notice was published in said newspaper.

On this 26 day of Feb in the year

of 1998, before me, a Notary Public, personally

appeared Sherilyn Plunk,

known or identified to me to be the person whose name

subscribed to the within instrument, and being by me first

duly sworn, declared that the statements therein are true,

and acknowledged to me that he executed the same.

Carolyn L. Inge
Notary Public for Idaho

Residing at Sandpoint

My commission expires: 6/00

**NOTICE OF APPLICATION
FOR WATER RIGHT**

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

96-08979

CEDA PINE VENEER COMPANY

PO BOX 536

POST FALLS, ID 83877

Source: PACK RIVER Tributary:

LAKE PEND OREILLE

Diversion Pt: NENESW Sec 32 T

59N R 01W in BONNER County.

Use: INDUSTRIAL (0.500 CFS)

Total Diversion: (0.500 CFS)

Date Filed: 1/28/1998

In: BONNER County

T59N R01W S32 NENE NWNE

SWNE SENE

96-08980

HOLDEN, MICHELE

PO BOX

SANDPOINT, ID 83864

Source: SPRING Tributary: PEND

OREILLE RIVER

Diversion Pt: SESESE Sec 8 T 57N

R 02W in BONNER County.

Use: DOMESTIC (0.010 CFS)

Total Diversion: (0.010 CFS)

Date Filed: 2/9/1998

In: BONNER County

T57N, R02W S08 SESE

For additional information concerning the property location, call the Northern Regional Office at (208) 769-1450.

The permit(s) will be subject to all prior water rights. Protests must be filed with the applicant and with the Director, Dept. of Water Resources, Northern Region, 1910 Northwest Blvd., Suite 210, Coeur d'Alene, Idaho 83814, together with a protest fee of \$25.00 on or before MARCH 9, 1998.

KARL J. DREHER, Director
SNP#9009 Feb 19, 26, 1998

MICROFILMED

SEP 29 1998

9009

96-08979

CEDA PINE VENEER COMPANY
PO BOX 536
POST FALLS, ID 83877

Source: PACK RIVER

Tributary: LAKE PEND OREILLE

Diversion Pt: NENESW Sec 32 T 59N R 01W in BONNER County.

Use: INDUSTRIAL (0.500 CFS)
Total Diversion: (0.500 CFS)

Date Filed: 1/28/1998

In: BONNER County
T59N R01W S32 NENE NWNE SWNE SENE

MICROFILMED

SEP 29 1998

February 11, 1998

Ceda Pine Veneer Company
PO Box 536
Post Falls ID 83877

Re: Water Appropriation Application No. 96-08979

Gentlemen:

The Idaho Department of Water Resources hereby acknowledges receipt of the above referenced Application for Permit to appropriate the Public Waters of the State of Idaho. To assist us in providing you with prompt, accurate service, please refer to the above referenced number in all future matters concerning this water right application.


Your appropriation application is currently being prepared for advertising in the local county newspaper. This advertisement will be published for two consecutive weeks followed by a waiting period of ten days to allow for the submittal of protests. Normal processing time is approximately 3 to 4 months, if the application is not protested.

If the application is not protested, it will be forwarded to Boise to be considered for approval by the Director. State office personnel will then conduct a complete review, and you will be notified by mail of the outcome. However, if the application is protested during this waiting period, you will be sent a copy of the protest and instructions to aid you in resolving the protest without a hearing. All protests must be resolved before approval of the application can be made, so if the protestant does not voluntarily withdraw the protest, this department will conduct a conference and/or hearing on the matter.

You will receive your approved Application for Permit and instructions on filing the Proof of Beneficial Use from our State office in Boise.

If you have any questions or if I can be of any assistance please feel free to contact me at this office.

Sincerely,



ALLEN BEARDSLEE
Senior Water Resources Agent

AB:db

cc: Gretchen E. Hoy, Environmental Services Manager
Century West Engineering Corp, 1825 N Hutchinson Rd., 2nd Floor, Spokane WA 99212

SEP 29 1998



State of Idaho

DEPARTMENT OF WATER RESOURCES

NORTHERN REGION, Suite No. 210 • 1910 Northwest Blvd. • Coeur d'Alene, Idaho 83814-2615
(208) 769-1450

Fax (208) 769-1454

PHILIP E. BATT
Governor

KARL J. DREHER
Director

February 9, 1998

MEMO TO: DEBBIE ALLEN

FROM: DIANNE BALL - NORTHERN

RE: REFUND ON RECEIPTS NO. N011553 AND N011664

IT IS NECESSARY TO REFUND FEES RECEIVED UNDER THE ABOVE REFERENCED RECEIPTS, A COPY OF EACH IS ATTACHED FOR YOUR REFERENCE.

PLEASE REFUND THE AMOUNT OF \$160.00 ON RECEIPT NO. N011553, AND ALSO PLEASE REFUND \$60.00 ON RECEIPT NO. N011664, FOR A TOTAL REFUND OF \$220.00, TO THE FOLLOWING PERSON OR COMPANY:

REFUND TO: CEDA PINE VENEER INC
ADDRESS: PO BOX 536, POST FALLS, ID 83877

THE REASON FOR THE REFUND: OVERPAYMENT OF WATER RIGHT APPLICATION FEES.

IF YOU HAVE ANY QUESTIONS, PLEASE CALL ME AT THE NORTHERN REGIONAL OFFICE.

THANK YOU.

A handwritten signature in cursive script that reads "Dianne Ball".

DIANNE BALL

MICROFILMED

SEP 29 1998

Idaho Department Of Water Resources
Receipt Summary QueryDate: 02/05/98
Time: 13:58:23

Rec/No	From	Date	Fee	Ar/No	Status
N011553	CEDA PINE VENEER INC	08/20/1997	160.00		/ /
~~N011664~~	~~CEDA PINE VENEER INC~~	~~10/14/1997~~	~~160.00~~		/ /
N008369	CEDA-PINE VENEER	10/18/1994	300.00		/ /
C034137	CEDA-PINE VENEER, IN	12/15/1995	50.00		/ /
N008360	CEDA-PINE VENEER, IN	10/14/1994	300.00		/ /V
S009710	CEDAR CANYON, INC.	10/06/1989	219.00		W/ /
E008219	CEDAR CREEK GRAZING	05/30/1989	150.00		W/ /
C016792	CEDAR FARMS, INC.	05/11/1990	20.00		/ /
C023269	CEDAR FARMS, INC.	02/19/1992	175.00		/R/
E013785	CEDAR FARMS, INC.	04/27/1990	808.00		W/ /
E015907	CEDAR FARMS, INC.	04/05/1991	200.00		/ /
E009216	CEDAR HOLLOW FARMS	06/22/1989	50.00		W/ /
C011208	CEDAR INN	09/07/1989	54.00		W/ /
M002507	CEDAR LAKE RANCH	01/11/1989	25.00		W/ /
S010272	CEDAR LAKE RANCH	10/23/1989	10.00		/ /

(Enter=Continue)

(GOLD7=Selection Screen)

(GOLD8=Cancel)

2/9/97

D;

PLEASE REQUEST A \$220 REFUND TO BE
RETURNED TO CEDA PINE VENEER INC, FOR
OVERPAYMENT OF WR AP FEES.

2 RECEIPTS FROM 2 PAYMENTS -

N011664 - REFUND \$60.00 } done cz.
N011553 - REFUND \$160.00 }

MICROFILMED

SEP 29 1998

RECEIPT IS FROM THE STATE FILE

SD-0201-1

Idaho Department of Water Resources
Receipt Entry

Date: 02/05/98

Time: 13:59:06

Receipt No: N011553 AR No: _____ Date: 08/20/1997 Payoff Part of Acct? N
From: CEDA PINE VENEER INC _____ Payment Type: CK CHECK Doc No: 33814_
Remarks: _____

Description	Fund	FD	PCA	Obj	Subsid	
WR APP FEE	229	21	65103	1155		160.00
_____	_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____
Total Amount:						160.00

(Enter=Inq) (GOLD1=Add/Print) (GOLD2=Change) (GOLD3=Void) (GOLD5=Laser Print)
(GOLD6=Print 2nd Copy) (GOLD7=Enter WR Nos) (GOLD8=Cancel) (Menu _____)

MICROFILMED

SEP 29 1998

RECEIPT IS FROM THE STATE FILE

SD-0201-1

Idaho Department of Water Resources

Receipt Entry

Date: 02/05/98

Time: 13:57:14

Receipt No: N011664 AR No: _____ Date: 10/14/1997 Payoff Part of Acct? N

From: CEDA PINE VENEER INC _____ Payment Type: CK CHECK Doc No: 34228_

Remarks: _____


Description	Fund	FD	PCA	Obj	Subsid	
WR APPLICATION	229	21	65103	1155		160.00
_____	_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____
Total Amount:						160.00

(Enter=Inq) (GOLD1=Add/Print) (GOLD2=Change) (GOLD3=Void) (GOLD5=Laser Print)
(GOLD6=Print 2nd Copy) (GOLD7=Enter WR Nos) (GOLD8=Cancel) (Menu _____)

MICROFILMED

SEP 29 1998

**FAX TRANSMITTAL**TO: AL B. 208-769-1454FROM: C. HoyDATE: 1/29/98PROJECT NUMBER
NAME: CEDA PINE - WATER RIGHTSNUMBER OF SHEETS 3 (Including Transmittal)**COMMENTS:**HELLO AL!AS REQUESTED - THE PROPOSED LAND APPLICATION
AREA HAS BEEN MARKED ONTO THE US GS MAP.ALSO ATTACHED, IS THE "CALCULATION PAGE"
THAT WAS INADVERTENTLY OMITTED FROM YOUR
COPY. (SORRY!)IF THERE'S ANYTHING ELSE... 509-838-3810

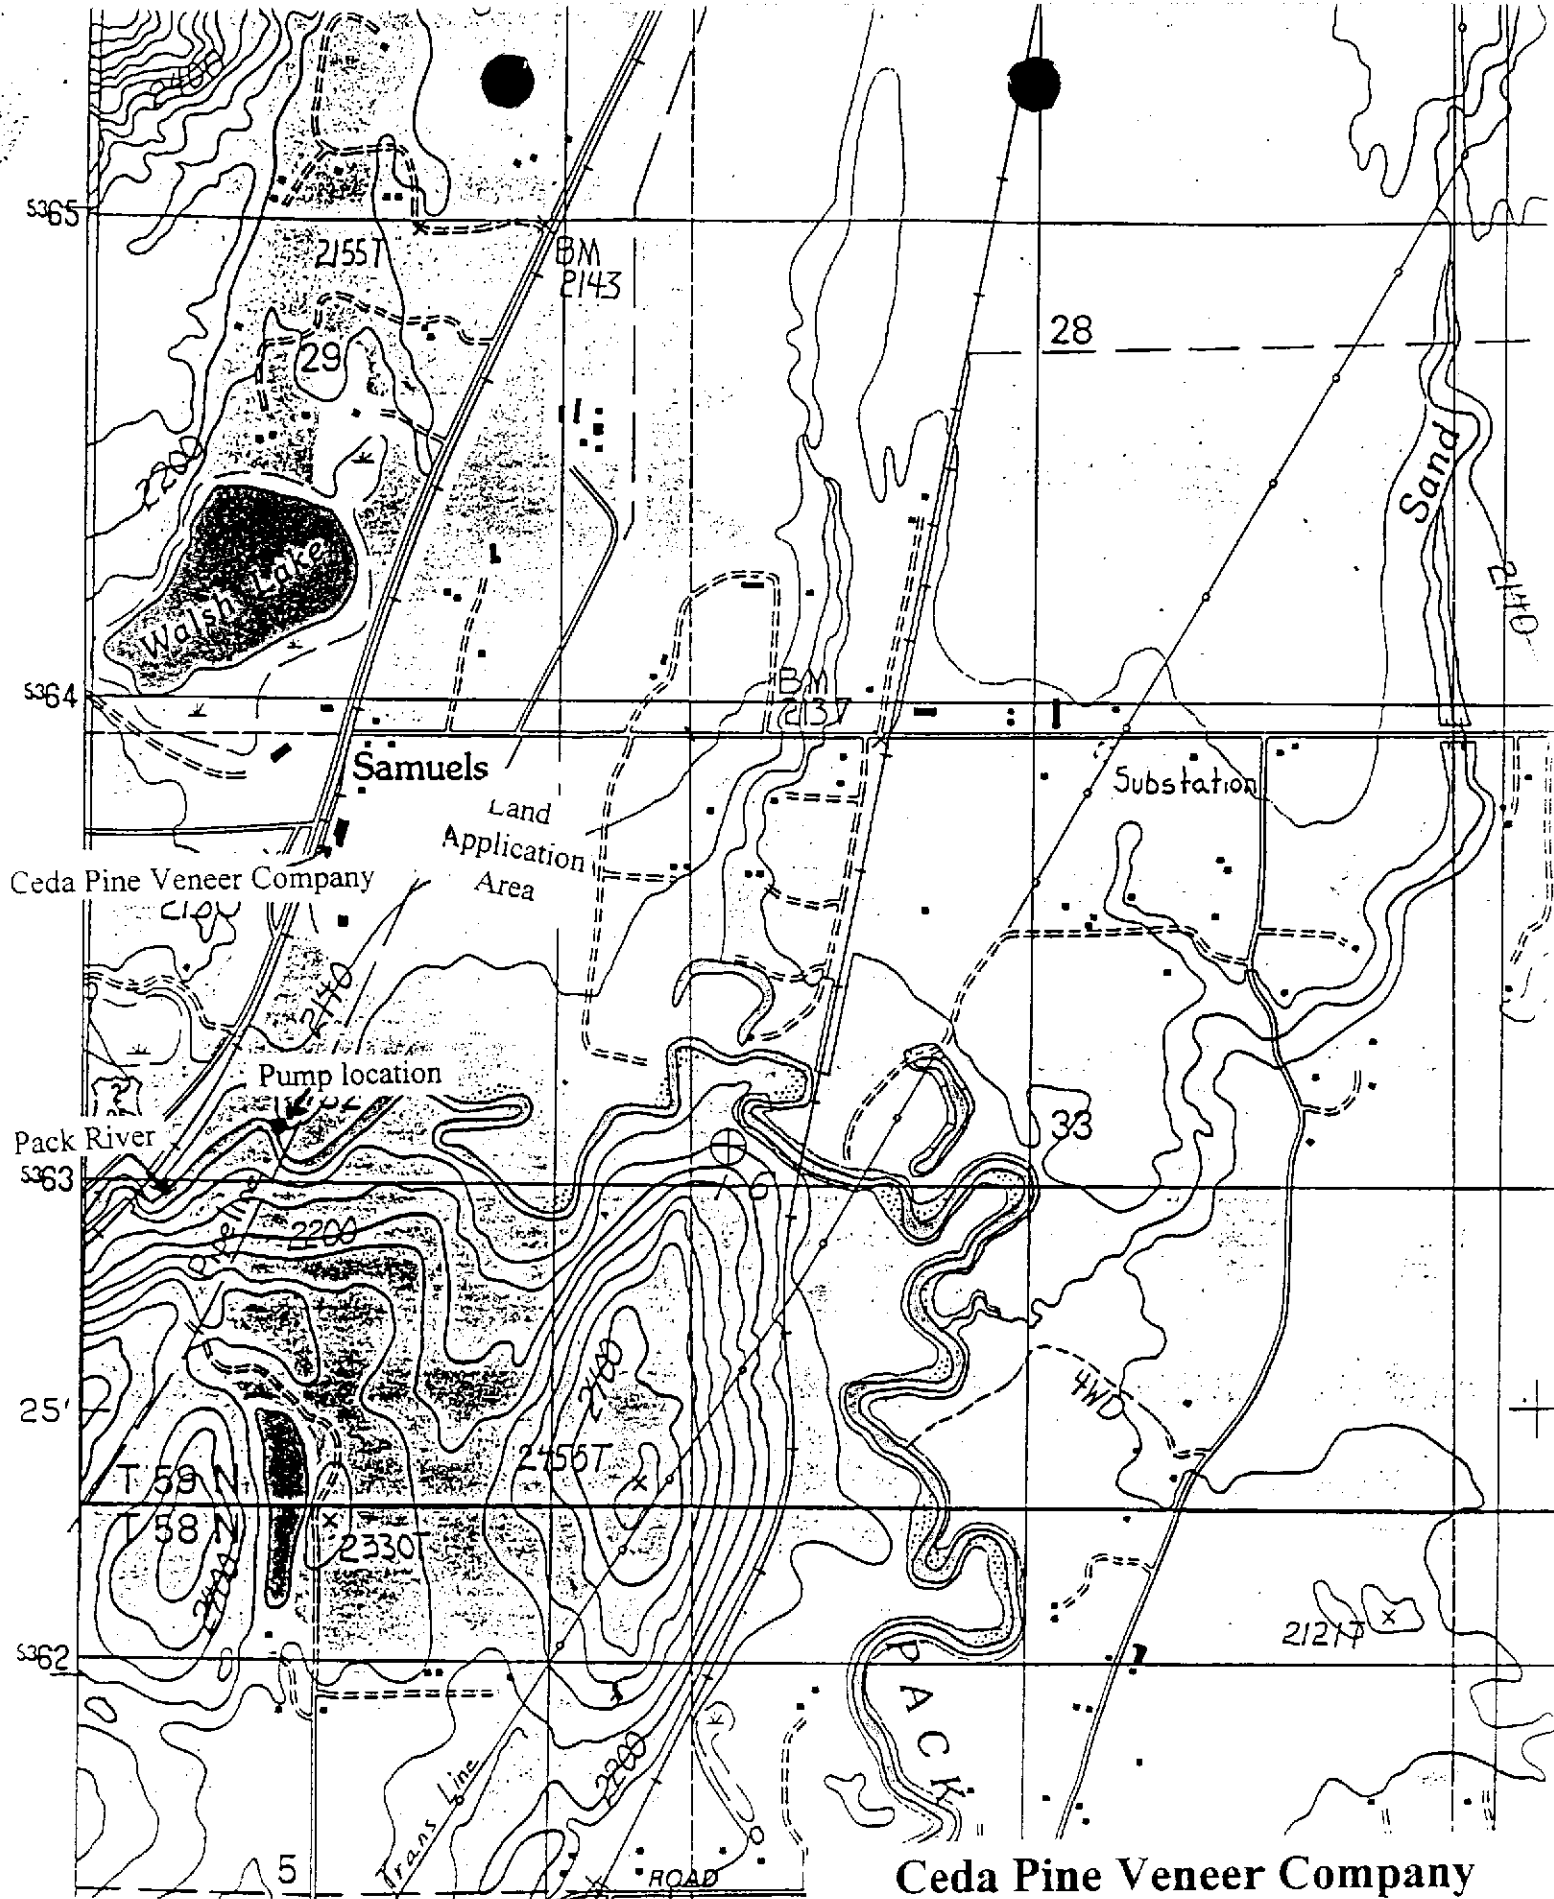

Ceda Pine Veneer Company

MICROFILMED

SEP 29 1986

Surface Water Rights Application
Site Map



FACSIMILE TRANSMISSION

625 BEST AVE COEUR D'ALENE, ID 83814
(208)664-2133 FAX (208)667-8775
INTERNET <http://pumping.com> e-mail allenw@dml.net

11/24/97

FROM: Allen Worst
TO: Dan Campbell
COMPANY: Ceda Pines Veneer
TRANSMITTING 1 PAGE INCLUDING THIS SHEET

NOTES:

Thank you for allowing us to help with the project as estimated below. The following numbers are my best estimation of costs based on the following:

1. The pump house must be placed down at the river area due to plaguing suction line problems associated with long suction line systems.
2. All excavation, backfill, and landscaping will be done by other.
3. A 15'X15' building will be built by other near the river edge.
4. All encroachments, easements, rights and permits will be worked out by owner.
5. R.C. Worst & Co., Inc will do all pump, piping, and electrical work to make a complete working system.
6. This quote is assuming electrical power will be provided to the road near the gas line easement.

System Pricing:

Parts Only:

1. 25HP Grundfos C-series pump unit:	\$2500.00
2. Variable speed drive for 25HP unit:	\$5800.00
3. 3500' of 6" CL160 PVC piping:	\$9100.00
4. Underground feeder cable:	\$5900.00
5. Misc fittings for underground piping:	\$1600.00
6. Fittings and foot valve for intake unit:	\$ 990.00
7. Electrical sub system for pump house:	\$2500.00
8. Pumping in pump house:	\$3300.00
9. Misc electrical equipment:	<u>\$ 550.00</u>

TOTAL MATERIALS \$37190.00

Labor, equipment use, use tax, and permits:

Field labor:	\$9350.00
Equipment use:	\$1100.00
Use tax:	\$1500.00
Permits:	<u>\$ 500.00</u>

TOTAL ABOVE \$12,450.00

TOTAL ALL \$49,640.00

MICROFILMED

SEP 29 1998



FACSIMILE TRANSMISSION

625 BEST AVE COEUR D'ALENE, ID 83814
(208)664-2133 FAX (208)667-8775
INTERNET <http://pumping.com> e-mail allenw@dmr.net

System Information:

Cubic feet per second at 300 GPM: 0.67

Size of intake device: 8' long, 8' wide, 2' tall with 6" pipe to beach.

Advantages of variable speed driven pumps:

1. Smaller building required (only one small pressure tank required).
2. More efficient (lower power consumption).
3. Lower initial cost of system (due to smaller building and less equipment).
4. Longer pump life.
5. Less equipment maintenance.
6. More constant pressure at supply.
7. Easily upgradable.



We appreciate the opportunity to provide you a quote on this system.

Thank you,

Allen Worst

MICROFILMED

SEP 29 1998

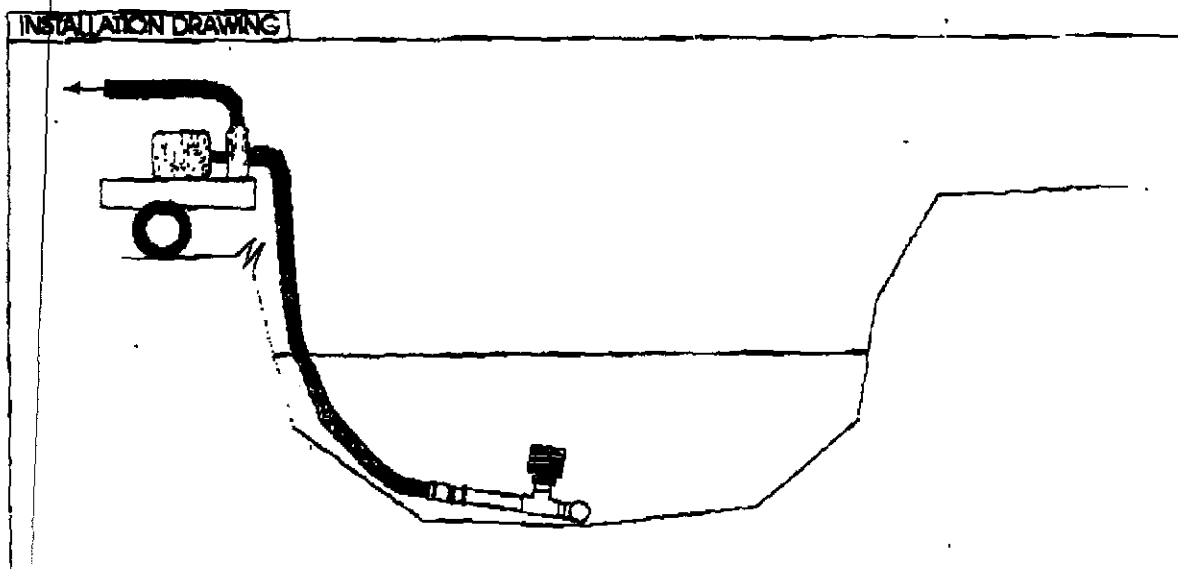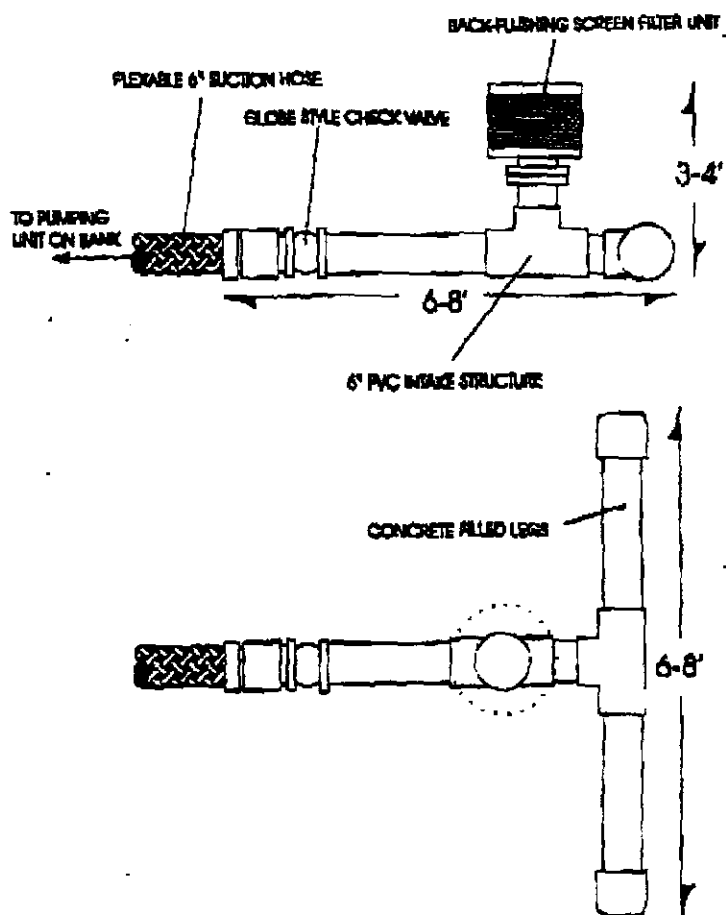

MICROFILMED

SEP 29 1998

Pumping Rate Calculations

maximum pumping rate:

$$0.5 \frac{\text{ft}^3}{\text{sec}} \times 3,600 \frac{\text{sec}}{\text{hr}} \times 1,500 \frac{\text{hr}}{\text{yr}} = 2,700,000 \frac{\text{ft}^3}{\text{yr}}$$

$$2,700,000 \frac{\text{ft}^3}{\text{yr}} \times 2.3\text{E-}05 \frac{\text{acre ft}}{\text{ft}^3} = 62 \frac{\text{acre ft}}{\text{yr}}$$

01/21/98

RTCALC.WK4

MICROFILMED

SEP 29 1998