





MICROFILMED

OCT 07 1991

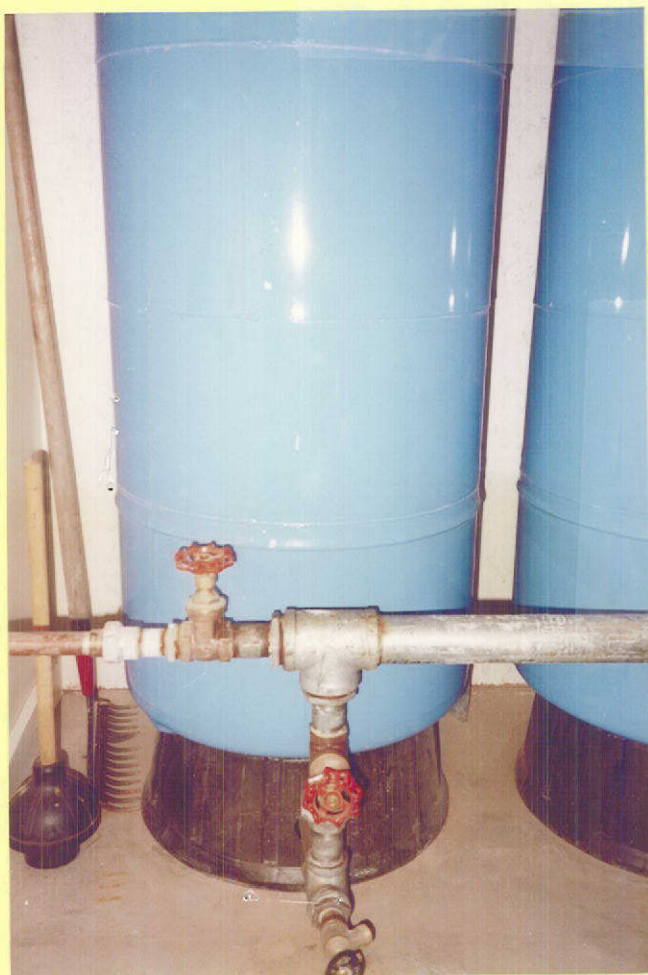

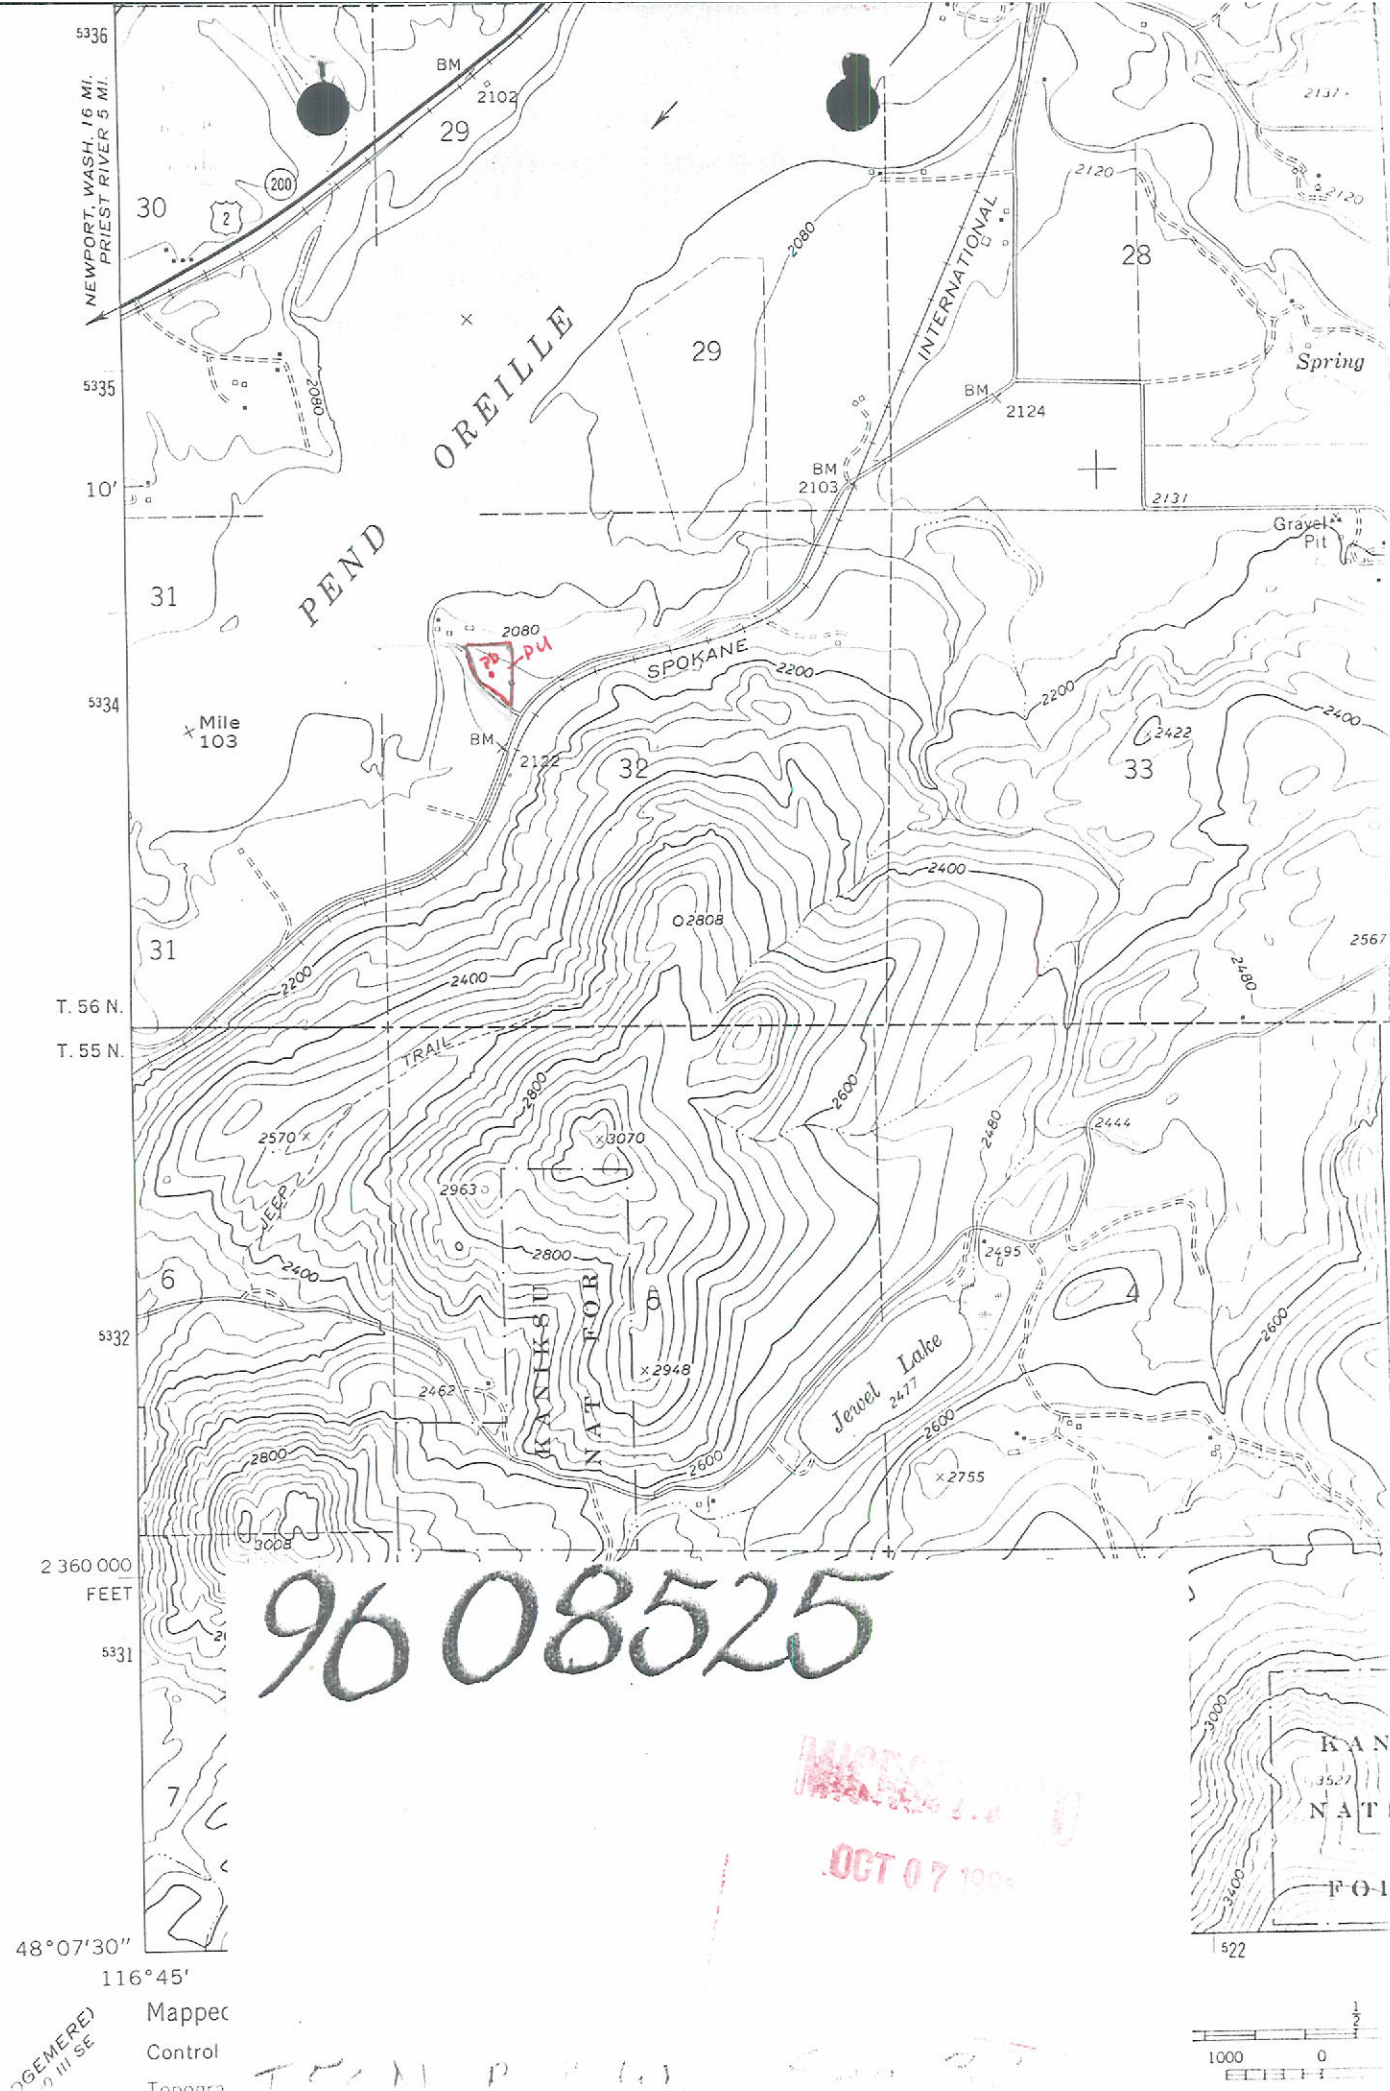


NGEMERE)
0 III SE

Mappec
Control
Topogra

TRAIL P P L L

MADE IN U.S.A.
OCT 07 1991

1000 0
FEET

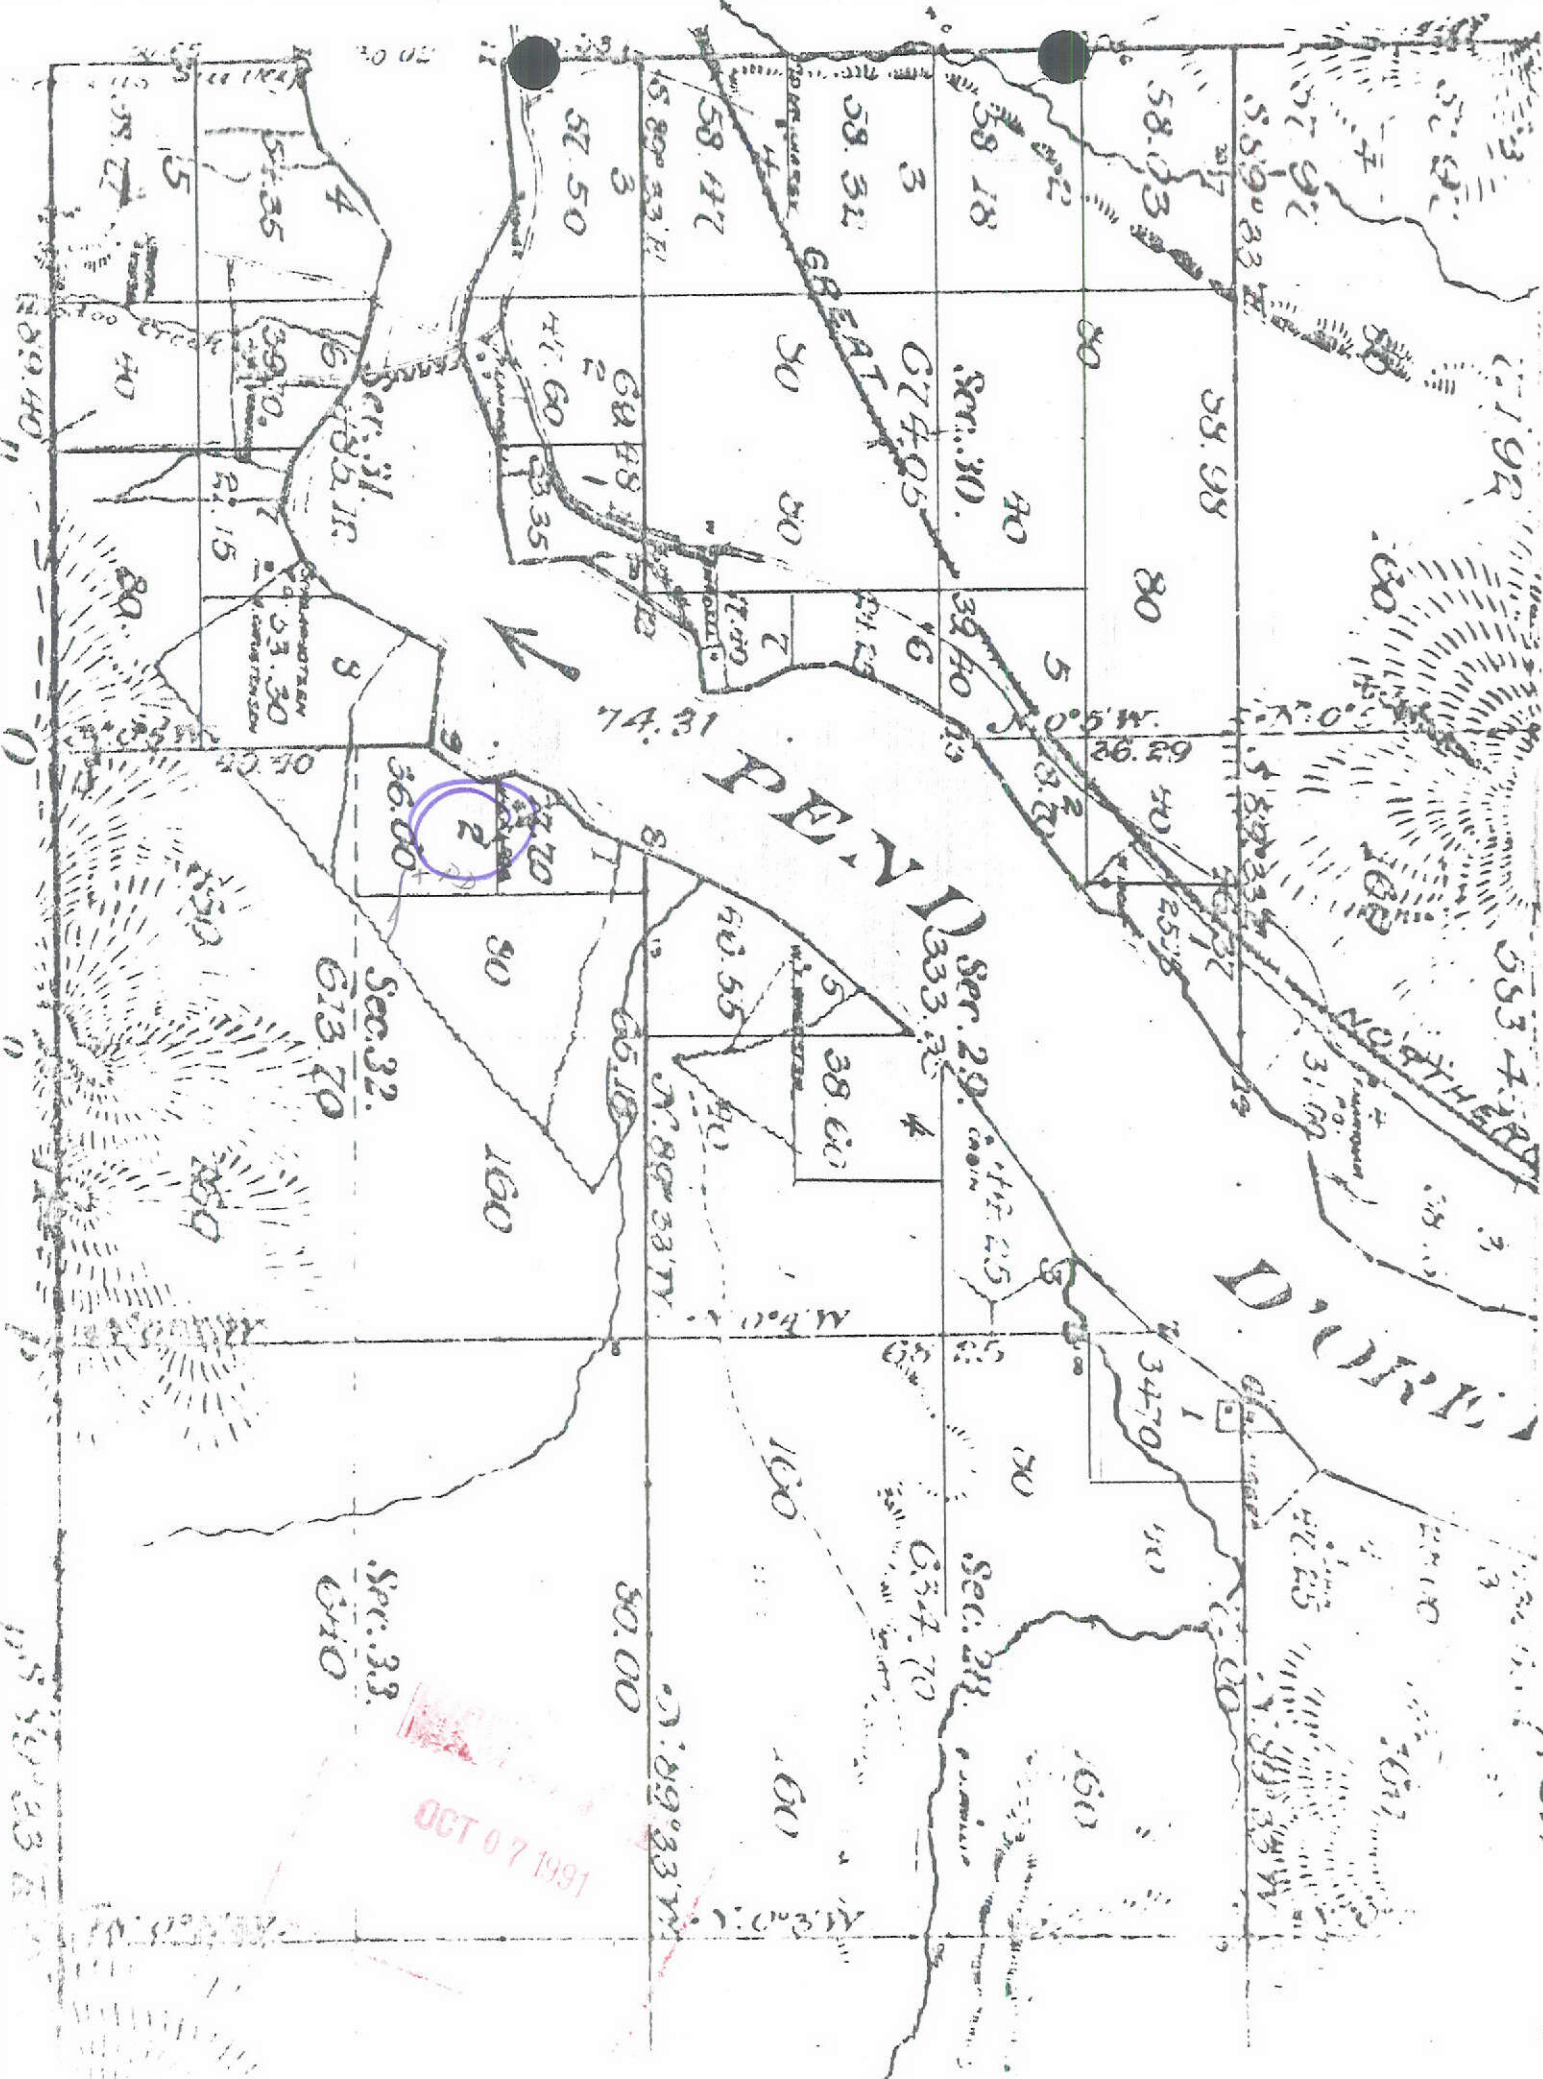

T56N
R3W
F

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 96-08525

Priority: June 24, 1988

Maximum Diversion Rate:

0.10 CFS

Maximum Diversion Volume:¹

6.6 AF

This is to certify, that JO ANN BALL
SANDY SCHULZ

3160 DUFORT RD
SAGLE ID 83860

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated June 24, 1988; and has submitted Proof of Beneficial Use on September 19, 1988. An examination indicates that the works have a diversion capacity of .140 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
COMMERCIAL	05/15 to 10/01	0.10 CFS	6.6 AF

LOCATION OF POINT(S) OF DIVERSION: LOT 2(SWNW), Sec. 32, Township 56N, Range 03W
BONNER County

PLACE OF USE: COMMERCIAL
TWN RGE SEC

56N 03W 32 SWNW

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Commercial use is for a 12-space R.V. park.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 3rd day of SEPTEMBER, 1991.

MICROFILMED

OCT 07 1991
7 1991

Acting for

R. Keith Higginson
R. Keith Higginson, Director

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Ident. No. 96-08525

To appropriate the public waters of the State of Idaho

APPROVED

1. Name of applicant SANDY SCHULZ & JO ANN BULL Phone 263-8896
Post office address 3160 DUFORT RD. SAGLE, IDAHO 83860

2. Source of water supply GROUND WATER which is a tributary of N/A

3. Location of point of diversion is SW $\frac{1}{4}$ of NW $\frac{1}{4}$ of $\frac{1}{4}$, Govt. Lot 2
Sec. 32 Township 56N Range 3W B.M. BONNER County; additional
points of diversion if any:

4. Water will be used for the following purposes:

Amount 0.1 for COMMERCIAL - JK 6/21/89 purposes from MAY 15 to OCT. 1 (both dates inclusive)
(cfs or acre-feet per annum)

Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)

Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)

Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) 0.10 and/or (b)
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. well & pump pressure
tanks & distribution system
1 1/2" diameter main to 3/4" hookup

b. Height of storage dam N/A feet; active reservoir capacity N/A acre-feet; total
reservoir capacity acre-feet; period of year when water will be diverted to storage:
 to inclusive.

c. Proposed well diameter is 6" inches; proposed depth of well is unknown feet.

d. Is ground water with a temperature of greater than 90°F being sought? NO

7. Time required for the completion of the works and application of the water to the proposed beneficial use is
2 Allow 1 yr. - kw
2 months years (minimum 1 year).

MICROFILMED

OCT 17 1988

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. _____
- e. Other; describe fully. Water to 12 R.V. Spaces to be used Seasonally

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
56N	36	32							C										FM MRD JK 6/21/88

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. _____


11. a. Who owns the property at the point of diversion? _____
- b. Who owns the land to be irrigated or place of use? Sandra J. Schell & Jo Ann C. Ball
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. _____

12. Remarks: _____

RECEIVED

OCT 17 1988

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

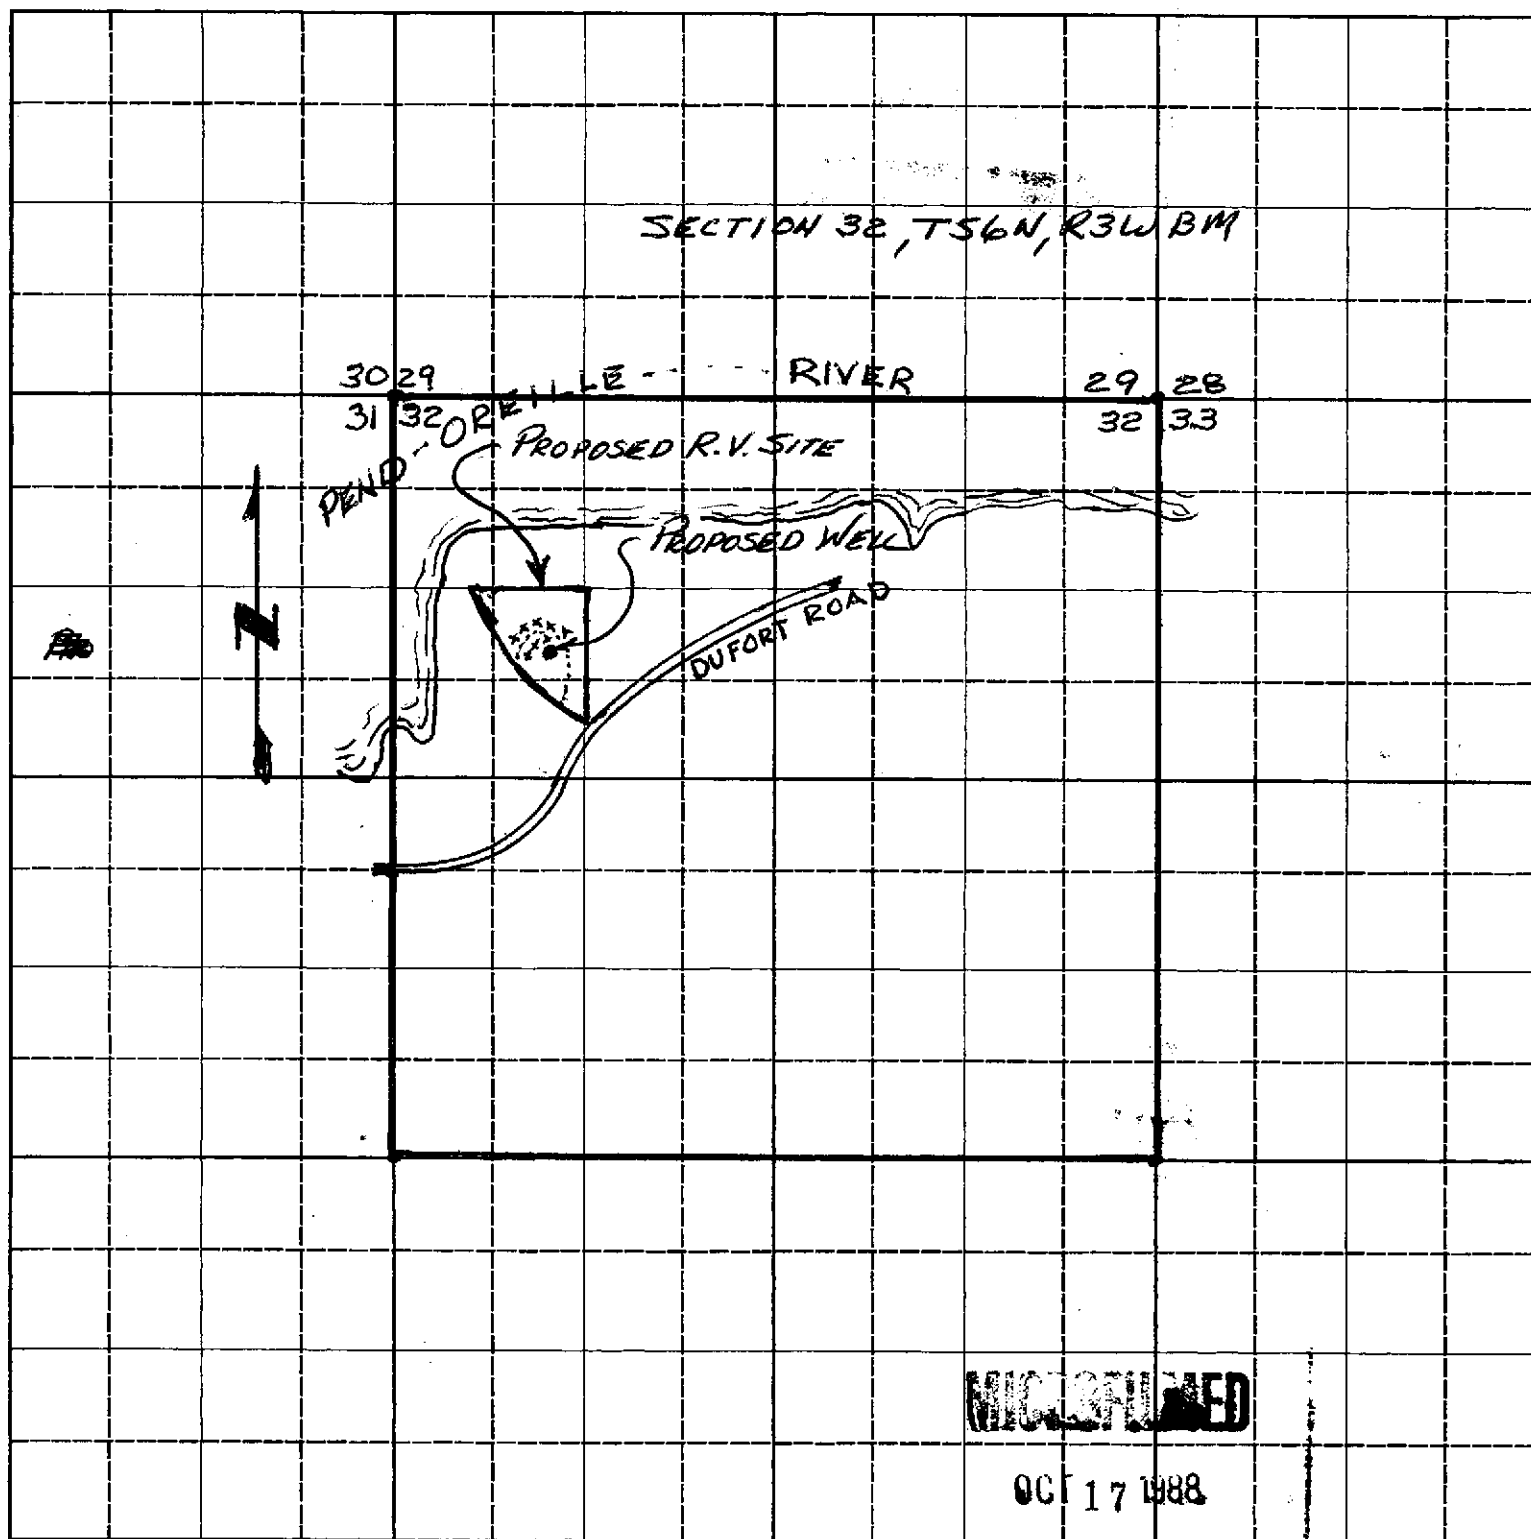

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Richard C. Tucker FOR SANDY SCHULZ
(Applicant)
TUCKER ENGINEERING
SANDPOINT, IDAHO *Sandy Schulz*

Received by RAH Date 6/24/88 Time 2:00 PM Priority 6/24/88
Fee \$ 30.00 Receipted by RAH # N362 Date 6/28/88
Publication prepared by fm Date 6/29/88 Published in 7/6/88
Publication approved fm Date 8/16/88

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 96-8525, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before September 1, 19 89.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.
- e. Other: Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
The issuance of this permit in no way grants any right-of-way or easement across the land of another.

Witness my hand this 30th day of August, 1988.

R. Keith Higgins
Director

NOT RECORDED

OCT 17 1988

Affidavit of Publication

STATE OF IDAHO

County of Bonner,

ss.

Mike McLean
being duly sworn, says that he is the news editor
of the PRIEST RIVER TIMES, a weekly newspaper printed and
published at Priest River, Bonner County, Idaho, and has been con-
tinuously and uninterruptedly published in said County during a period
of 78 consecutive weeks prior to the first publication of the annexed
notice for publication, is a newspaper of general circulation made up of
at least eight pages of at least six columns each, printed from typemater
or stereotyped forms of at least nineteen and three-fourths inches
depth, has at least 1250 bona fide subscribers living within said Bonner
County, and is published at regular weekly intervals. That the annexed
is a true copy of the notice for publication in the case of

635 Water rights (Ball)

as it was published in the regular and entire issue of said paper for a
period of two consecutive weeks, commencing on
the 6th day of July, 1988,
and

ending on the 13 day of July, 1988,
and that said notice was published in said newspaper proper, and not in
supplement form.

H. Michael McLean

Subscribed and sworn to before me this

13 day of July, 1988

Linda L. Ramsey
Notary Public for Idaho,

Residing at Priest River, Idaho

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have
been filed to appropriate the public
waters of the State of Idaho:

96-08525

BALL, JO ANN
SCHULZ, SANDY
3160 DUFORT RD.
SAGLE, ID 83860
Source: GROUNDWATER
Diversion Pt: LOT 2 (SWNW) Sec 32
T 56N R 03W
Use: COMMERCIAL (.100 CFS)
Date Filed: 6 24 1988
In: T56N R03W S32 SWNW

The permit(s) will be subject to all
prior water rights. Protests must be
filed with the Director, Dept. of
Water Resources, Northern Region,
Government Way Suite 9, Coeur
d'Alene, Idaho 83814 on or before
JULY 25, 1988.

R. KEITH HIGGINSON
Director

#635 July 6, 13, 1988

OK
5/16/88

RECEIVED
JUL 13 1988

MICROFILMED

OCT 17 1988

September 5, 1991

JO ANN BALL
SANDY SCHULZ
3160 DUFORT RD
SAGLE ID 83860

RE: WATER RIGHT NO. 96-08525

Dear Water Right Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

SHARLA CURTIS
Technical Records Specialist

SC:blm

Enclosure

SEP 07 1991

LICENSE REVIEW CHECKLIST

Permit No. 96-8525

Name/Address change? ok ✓

Priority date Advance? yes no ✓
Memo to advance no ✓
Order to reinstate needed? yes no ✓

Total cfs Limited by fee OK
Limited by capacity no

Total volume Limited by flow no
Chart checked for AF rate/ac N/A

Capacity Actual measurement checked no
Theoretical checked no
If greater than permit, check for other rts no

Source Changed? yes no ✓
If so, is memo needed to clarify? no

P/D Verify with map no permit no ✓
More than one per 1/4? Remember remark no
Check p/d overlap N/A

Uses Check irrigation period of use w/ chart N/A

P/U Verify with map no permit no ✓
> 5 acres irrigated, run overlap N/A

Remarks More than one p/d in 1/4 no ✓
Description of non-irrig uses no ✓
Special overlap condition no

Conditions -

Measuring device no
W.Master control no
Overlap no
Water quality no
Other no

Dates/Misc. -

Water Dist no
App Rec'd no
Proof Rec'd no

CHECK FOR ADJ. CLAIM

Needed according to proof filed no
Filed - needs amended no
Add'l fee required no
Not filed no
Not needed no

Comments/Changes to Examiner's Recommendations:

License no 10-day no 30-day no

Back of field report signed? no
Reviewer J. Carter Date 8/22/91 Review time 5 min.

OCT 07 1991

Right of Way
Condition not reg'd on lic
8/30/91

SENIOR AGENT REVIEW

Check List
for
Beneficial Use Field Report

Permit 96-08525

A. GENERAL INFORMATION

- ✓ 1. Name and address are most current available. (Check BU statement)
✓ 2. Exam Date
✓ 3. Source (Check Permit)

B. OVERLAP REVIEW

- ✓ 1. & 2. (Rule 5,1,4)

C. SYSTEM DESCRIPTION

- ✓ 1. Diversion System Diagram (Rule 5,1,3 / 5,1,4)
✓ 2. USGS (Rule 5,1,7 / 5,1,9) Aerial (Rule 5,1,17)
Photo of pd and/or pu or explanation
✓ 3. Word Picture (Rule 5,1,3 / 5,1,4)
✓ 4. Diversion (Rule 5,1,3)
✓ 5. Compare with USGS Map/Land Survey Maps/Aerial Photos/Permit. TB 12/12/90
Method of determination
✓ 6. Compare USGS/Land Survey? Aerial Photos/Permit.
Method of determination,
✓ Irrigation (Rule 5,1,8),

D. FLOW MEASUREMENTS Check math (Rule 5,1,13 / 5,1,14)

E. FLOW CALCULATIONS Check math (Rule 5,1,13 / 5,1,14)

F. OPTIONAL

G. VOLUME CALCULATIONS

- Three significant figures/not less than 0.10 (Rule 6,1,2)
Fish (Rule 5,1,11) number stock, homes, etc... (Rule 5,1,12)

H. REMARKS AND OVERLAP ANALYSES

- All actual uses listed (Rule 5,1,2):
All unused, permitted uses listed (Rule 5,1,2):
Overlaps (Rule 5,1,4):
Return flows (Rule 5,1,5):
Conditions (Rule 5,1,6).

I. RECOMMENDATIONS

1. Municipal (Rule 5,1,10): Compare with items E & G, permit, fee, capacity
(Rule 5,1,15): Measured flows for each use listed separately (Rule 5,1,14).
Period of year (Rule 5,1,13)
2. Compare permit to exam for amendments (Rule 5,1,16)

J. AUTHENTICATION

- Name, Signature, Certification Date, Exam Date.

WELL INSPECTION REPORT



- Check with permit and well log for discrepancies

Signature gokine Date 1-17-90



RECEIVED

OCT 07 1991

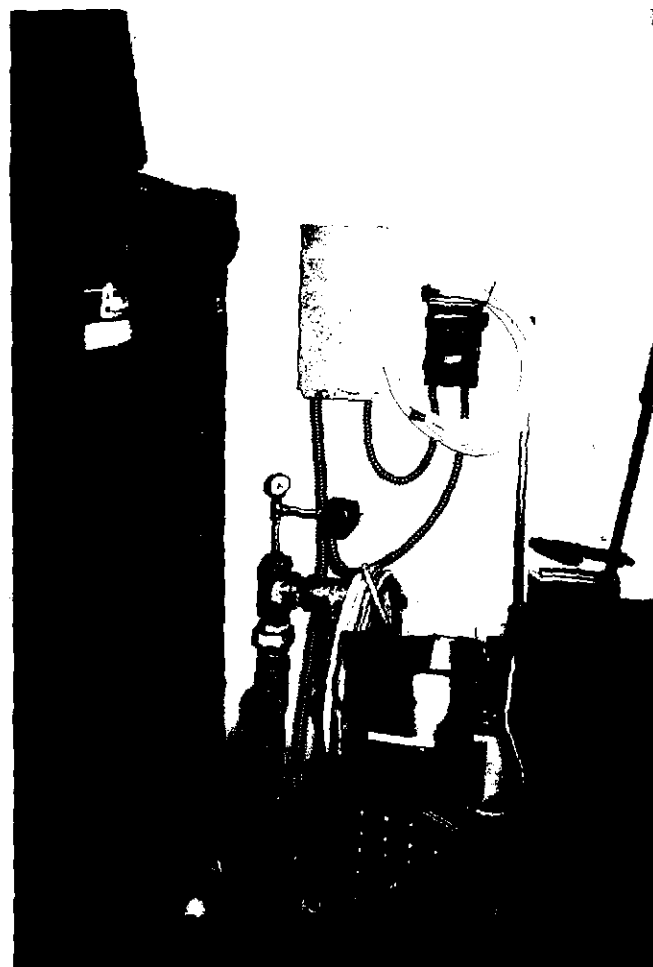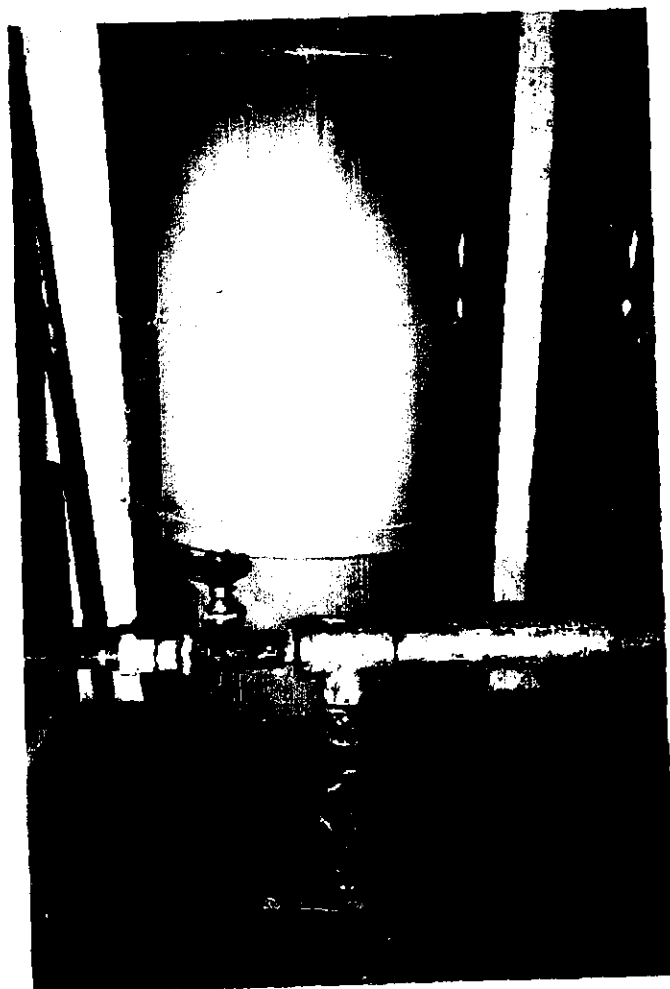

96-8525

RECEIVED

NOV 28 1988

NORTHERN REGION
IDWR

261 N. Stevens
Orange, Ca. 92668
Nov. 25, 1988

Tom D. King
State of Idaho Water Resources
Dear Mr. King:

In regard to your letter date Nov. 4, I am not in Idaho at this time and will be in Calif. until spring. We plan to open our R.V. park in mid May and would like to have this matter completed before then.

I have a caretaker who could meet you there, however the water tanks and lines are drained for the winter, so if you want to see this fully operational, it will have to wait until spring. Please let me know what your requirements are and we can set something up from there.

Sincerely
Sandy Schultz
permit # 96-8525

OCT 07 1991

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JUN 28 1991

Department of Water Resources

A. GENERAL INFORMATION

1. Owner: Sandy Schulz & JoAnn Ball
Current Address: 3160 Dufort Rd Sagle ID 83860
2. Accompanied by: Sandy Schulz
Address: Same
Relationship to Permit Holder: _____
3. Source: Groundwater tributary to N/A


Permit No. 9608525
Phone No. 263 8896
EXAM. DATE: 7/18/90
Phone No. Same

B. OVERLAP REVIEW

1. Other water rights with same place of use: none
_____ ☐ Copies Attached
2. Other water rights with same point of diversion: none
_____ ☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

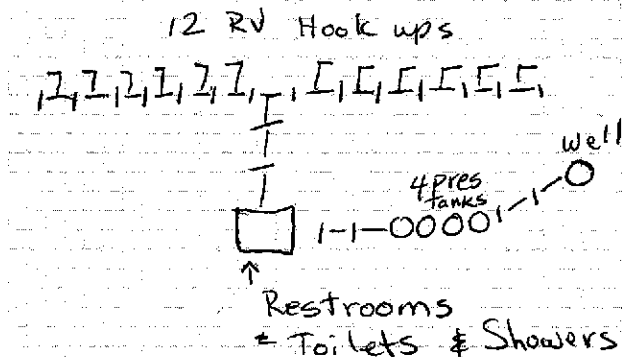

RECEIVED
OCT 07 1991

Scale: 1" = NTS

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and place(s) of use (required).
☐ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater).
☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).

System Description (continued)

3. **Narrative:** Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

Well with 3hp submersible pump and 4 pressure tanks. Restrooms and Showers are in same building. There is a buried pipe line with water hook-up for Recreational Vehicles at 12 sites.

☐ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Franklin Elec	3 hp	282 3029103		

*Code to correspond with No. on map and aerial photo

5. **Point(s) of Diversion:**

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
	2	NE	SW	NW	32	56N	3W	Bonner	Map


6. **Place(s) of Use:**

Indicate Method of Determination Map

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
56N	3W	32								C									

Do not use this space

OCT 07 1991

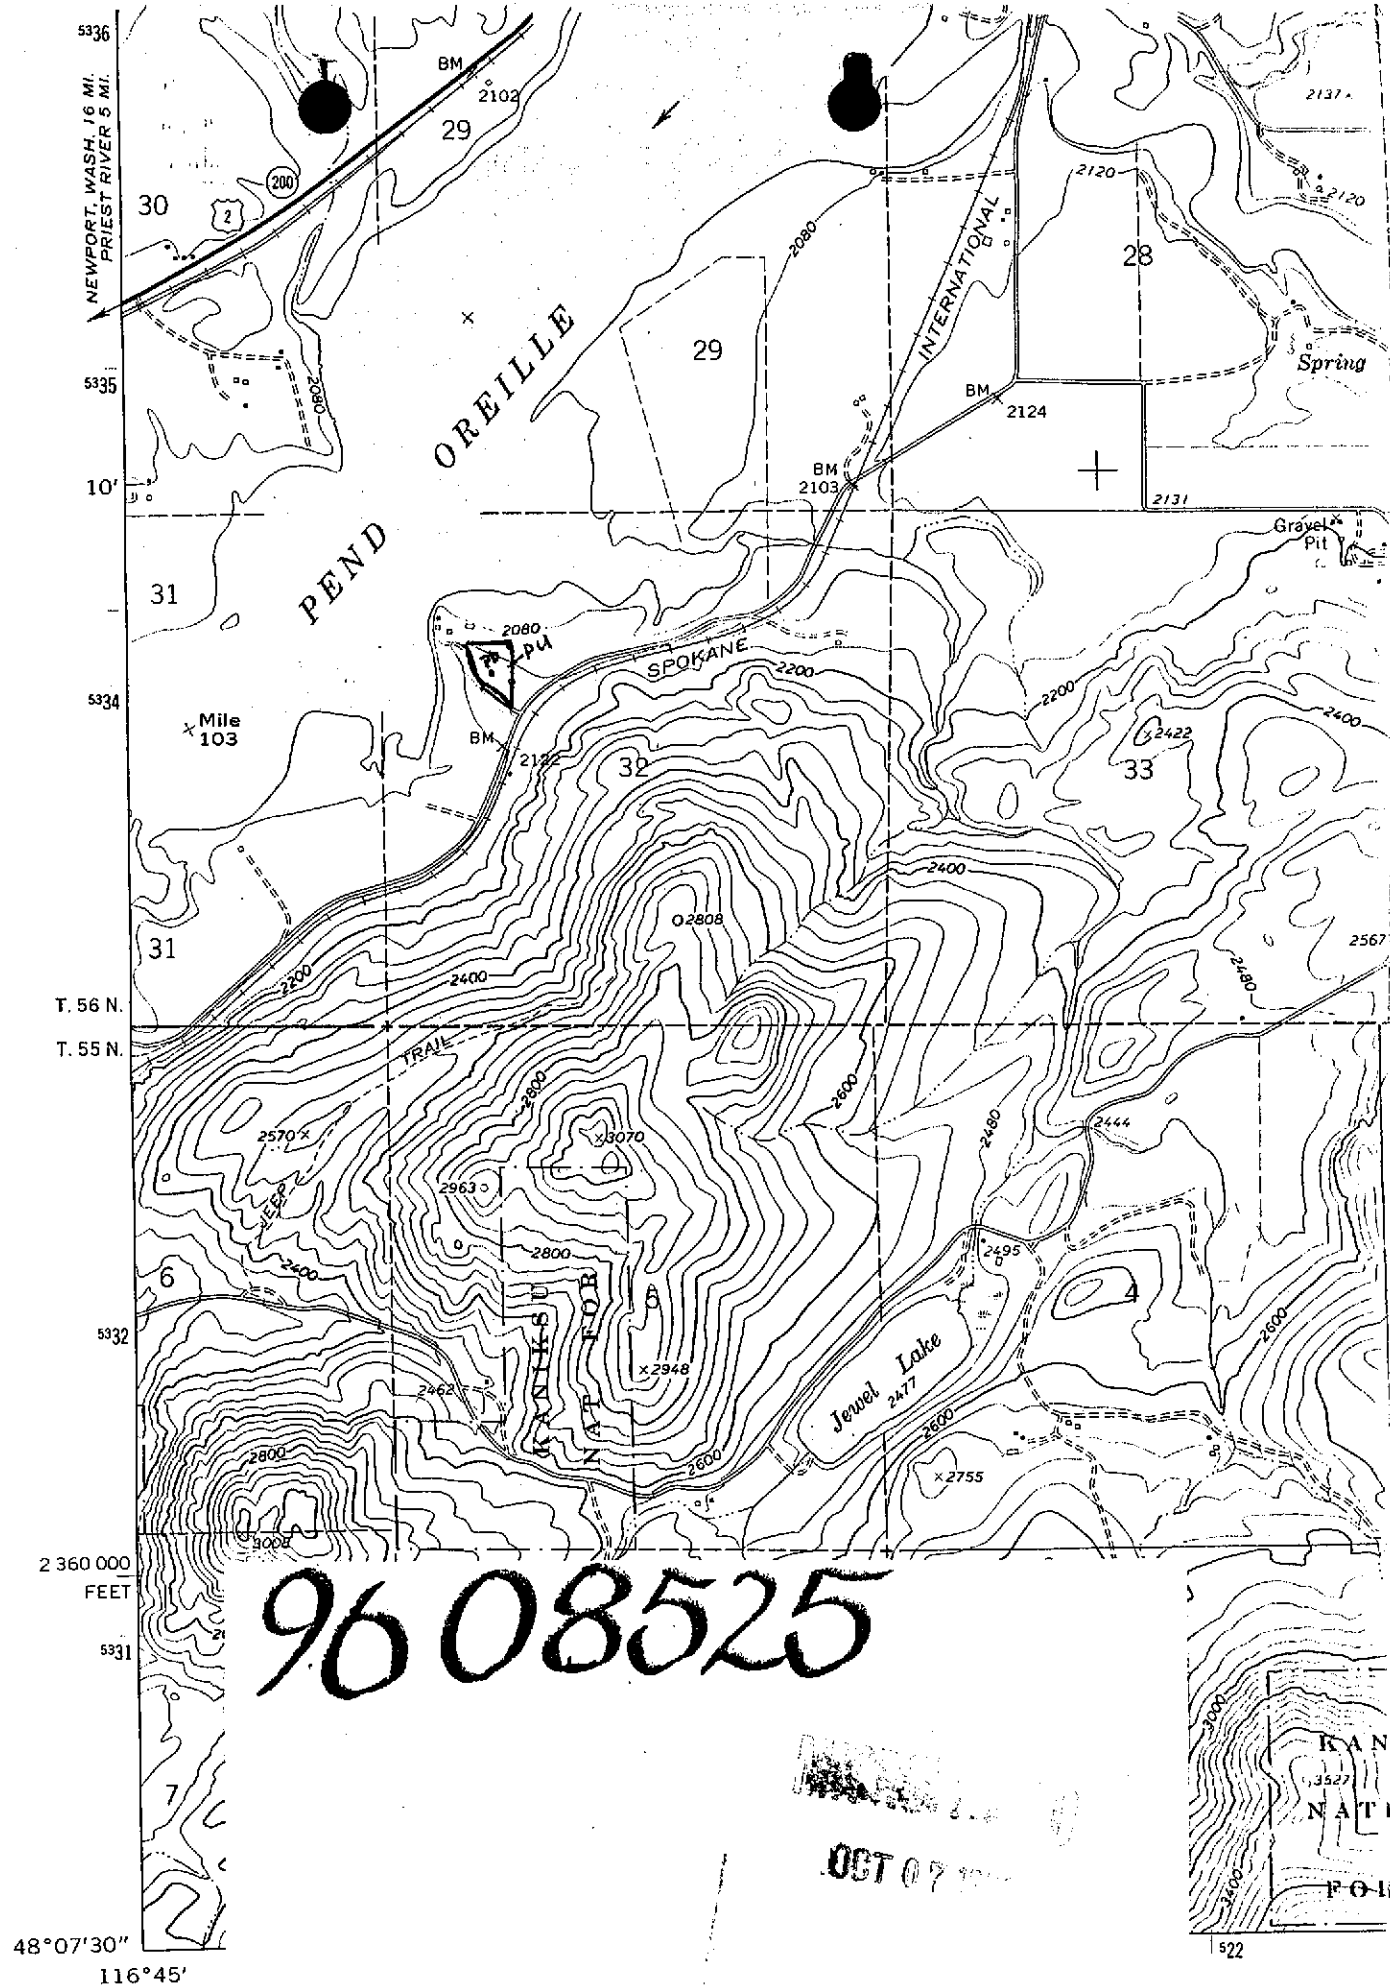


96 08525

OCT 07 1964

Mappec
Control
Topogra

TRAIL P 111, 500 35

1000 0
FEET

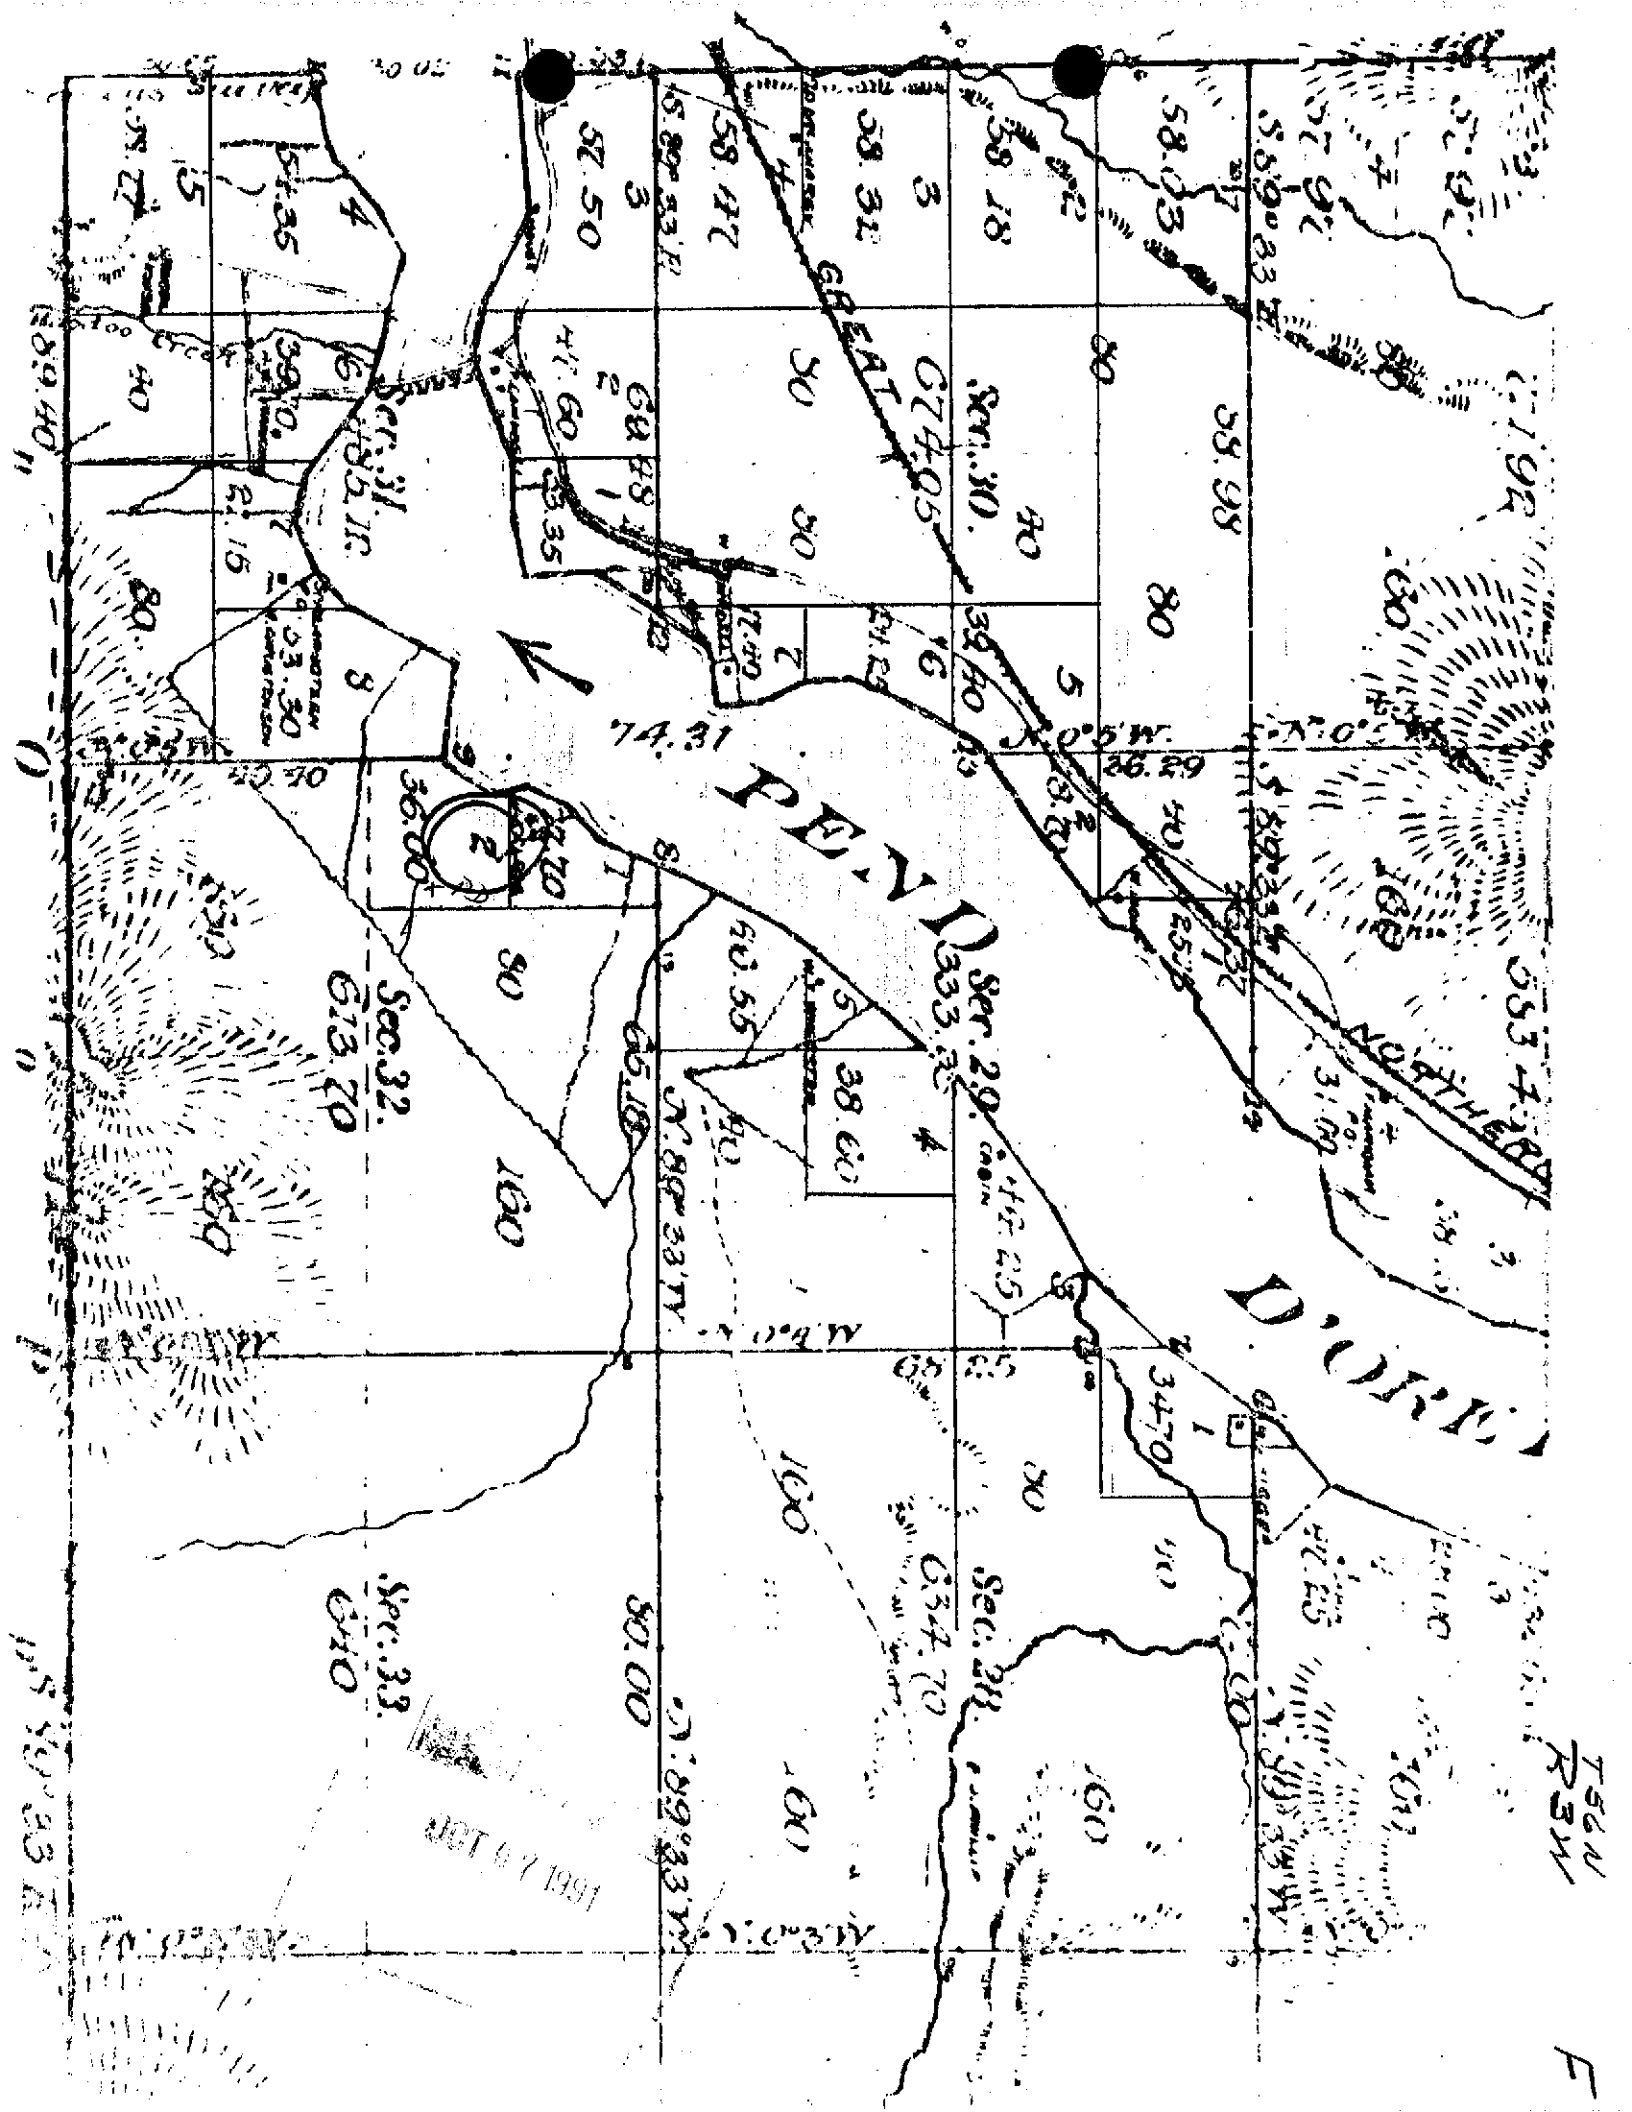

Do not use this space

D. FLOW MEASUREMENTS

None

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

E. FLOW CALCULATIONS

☐ Additional Computation Sheets Attached

1. Measured Method: $\frac{(8.8)(3hp)(60\%)}{(2.31)(20psi) + 71} = \frac{15.84}{117.2} = 0.135 cfs$ capacity
0.10 PER PERMIT TDR

2. Alternate Method for Checking Purposes:

~~12 sites @ 4 persons/site = 100g/site/day = 0.25 cfs~~
~~6.6 AFA ÷ 180 days = 0.036 AFA = 1.4835 ÷ 180 days = 0.02 cfs~~
~~0.19 gpm = 0.01 cfs~~

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3); Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Ampsx .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

12 sites @ 4 persons/site = 100g/site/day x 180 days = ~~2160~~
 $(12)(100)(180) = 216,000g = 6.6 AFA$
~~418.8~~
3258509/AF

MAINTAINED
OCT 07 1991

[illegible]


1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Comercial	5/15	10/1	0.10	6.6 AFA ^{SDK}
Totals:			0.10	6.6 AFA ^{SDK}

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

Field Examiner's Name Theresa J. Bright
Signature Theresa J. Bright
Certification Date 4/14/90
Field Report Preparation Date 7/20/90

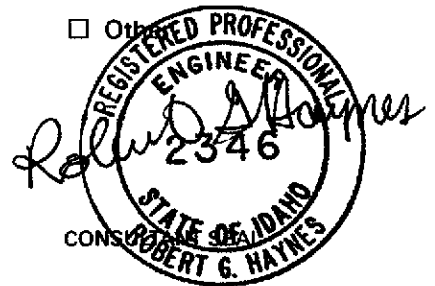

K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

RECEIVED
OCT 07 1941

State of Idaho
Department Of Water Resources
WELL INSPECTION FORM

If well is associated with water right, provide WR Permit No. 9608525

Otherwise provide legal description and a sketch map and/or address so that the well can be located easily.

1. Legal Description of Well Location:

Twp. 56 N, Rge. 3 W Sec. 32, SW $\frac{1}{4}$ NW $\frac{1}{4}$ Gov. Lot _____

2. Owner: Sandy Schulte & Jo Ann Ball

Address: 3160 Dufort Rd Sagle, Idaho 83860

City Sagle, State ID

3. Casing $\geq$ 12 inches above ground: Yes X No _____

4. Access Port: Y X N _____
Pressure Gauge: Y _____ N X
Flowing: Y _____ N X

Static Water Level: 7'
Casing Diameter: 6"
Temperature: 50°

5. Are there any obvious construction problems that may be a source for contamination or waste of water: Y _____ N X

If answer to Item 5 is Yes, describe in remarks and attach photo.

Remarks : _____

MICROFILMED

OCT 07 1991



State of Idaho

DEPARTMENT OF WATER RESOURCES

NORTHERN REGION, Suite No. 9 • 4055 Government Way • Coeur d'Alene, Idaho 83814 • (208) 765-4639

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

November 4, 1988

Mr. Sandy Shulz
3160 Dufort Rd.
Sagle, Id. 83860

Re: 96-8525

Dear Permitholder:

We acknowledge receipt of your statement of completion of water development use for the above-referenced permit.

Before a license can be issued, a field examination must be made by a representative of this Department. We do not know at this time when he will be able to conduct the examination; however, the examiner will try to contact you at the time he makes the examination so that you may show him the system. If you will not be available to show the system, please provide this office with the name and address of someone who will be able to do so. Your permit will remain valid until the examination is made.

If you have any questions concerning the field examination, please contact this office. Please be sure to use the above-referenced permit number in all future correspondence concerning this examination.

Sincerely,

/s/
TOM D. KING
Senior Water Resource Agent

TDK/pms

NOT RECORDED

OCT 07 1991



1/88

PROOF OF BENEFICIAL USE

ANALYSIS SHEET

Permit No. 96-8525

Date: 10/4/88

General Considerations:

Y Name same as permit
Y Signature the same as permit holder
N Address change _____ If yes, prepare a data entry
Y Proof received timely _____
_____ Reinstated

Source of Water:

_____ Surface water
Y Groundwater
_____ Y 1. well log in file
_____ Y 2. drilling permit
_____ Y A. amount of drilling fee paid for proposed uses

Extent of Use and Rate of Diversion:

Y Rate of diversion appropriate for uses
Y Is rate or volume and fee appropriate?
Y Has permit holder indicated when water was first put to a beneficial use?

Measuring Device:

_____ Is a measuring device or access port required?
N/A Has one been installed?
_____ Waiver or modification of measuring device requested

Remarks:

Proof acceptable

N/A

Priority Calculation:

Date proof received	_____	_____
Date proof due	_____	-
No. of days late	_____	=
Priority date	_____	+
NEW PRIORITY DATE	_____	=

SEND FILES TO DATA ENTRY AND THEN TO MICROFILM

03/86

REC

SEP 19 1988

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

Department of Water Resources

For Office Use Only

Fee Received \$50.00

Date 9/20/88

Receipt # 0002633

Receipt by CP

Reviewed by GS

Sent to region

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

Permit No. 96-08525

Name(s) of Permit Holder: JO ANN BALL & SANDY SCHULZ

Post Office Address: 3160 DUFORT RD

SAGLE, ID. 83860 Telephone No. 263-8896

Source of Water: DOMESTIC WELL

Extent of Use:

Domestic 12 RV SPACES (number of households) Stockwater (number and type of stock)

Irrigation (acres) Other/Remark

12 SPACE RV PARK + WASHROOM FAC. ON SEASONAL BASIS

Total rate and/or volume for which proof is submitted 0.10 (SEE ENCLOSED) cfs acre-feet

Show the date water was first diverted and beneficially used under this permit: 8/16/88 - TEST PUMPING

Measuring Device: Required? Yes No Installed? Yes No Fee enclosed \$ 50.00 (See License Examination Fee Schedule)

Flow Measurement Port: Required? Yes No Installed? Yes No

Person to contact to accompany the Department representative during the field examination:

SANDY SCHULZ (Name) 263-8896 (Telephone Number)

3160 DUFORT RD. SAGLE, ID. 83860 (Address)

The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

9-6-88 Date

Signature of Permit Holder (and title, if appropriate)

Sandy Schulz / Jo Ann Ball

To: File 96-85-25

From: Groundwater Protection

Date: 9/21

Drilling Permit: ☐ Not Applicable
☒ Found and in file
☐ Not Found

Well Drillers Report:

☐ Not found, due to reported age of well
probably not available
☒ Found and is in file
☐ Not found

Follow-up

☐ Request from permit holder the well
drillers report and/or the name of the
well driller.
☐ Ask permit holder when well was drilled
and notify holder of drilling permit
requirement if after July 01, 1987.

OK

JB

MICROFILMED

OCT 17 1988

Drilling Permit No. 96-88-N43
Water Permit No. _____
Injection Permit No. _____

State of Idaho
Department of Water Resources

DRILLING PERMIT

(Authorizing Construction of a Well)*

AUG 17 1988

1. Applicant SANDY SCHULZ Department of Water Resources
2. Address 3160 DUFORT RD.
SAGLE, ID 83860 Telephone _____
☒ Well Owner () Well Operator () Other, specify _____
3. Proposed well location SW 1/4 NW 1/4, or Gov't lot No. 2,
Sec. 32, Twp. 56N, Rge. 3W, County BONNER,
Lot, block and subdivision _____
4. Proposed use of well: (Check all that apply)
☒ Domestic () Stockwater () Monitoring
() Irrigation () Industrial () Municipal
() Injection () Other, Specify RV PARK 12 UNITS
5. Well construction information:
☒ New well () Deepen () Replace
Proposed surface diameter 6" Maximum depth ?
Anticipated bottom hole temperature: _____
(☒ 85°F or less (Cold water well)
() 85°F to 212°F (Low temp. geothermal well)
() 212°F or more (Geothermal well)
6. Anticipated construction start date 6/14/88
7. Well Driller (if known) INTERMOUNTAIN DRILLING 252
Address _____
8. Applicant's signature Sandy S. Schulz
Title _____
Date 6/14/88

OCT 17 1988

* After other pre-requisite approvals have been obtained.

* Fee is \$10 for single family domestic. Other uses may be \$100, \$50 or \$10.

ACTION OF IDWR

(☒) Approved () Denied

The approval of this permit authorizes the construction of a well as described on this application subject to the conditions on this permit.

GENERAL CONDITIONS:

1. The well must be constructed in compliance with the applicable statutes, specific conditions of approval shown on the water right permit, injection well permit, transfer or amendment and the rules and regulations of the Department for water appropriation, injection wells and well construction standards.
2. This drilling permit is valid for two (2) months from its date of issuance for the start of construction and is valid for one (1) year from the date of issuance for completion of the well unless an extension has been granted.
3. This permit does not constitute the approval of the District Health Department or the Idaho Department of Health and Welfare which may be required before construction of this well.
4. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.
5. Issuance of this drilling permit does not authorize trespass on the land of another party.
6. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
7. This drilling permit does not represent a right to divert and use the water of the State of Idaho.

SPECIFIC CONDITIONS:

Dated this 14 day of June, 1988.

Signed

Title

Robert J. Haynes
REGIONAL SUPERVISOR

OCT 17 1988

Received by KK Fee 100.00 Date 6/14/88

Receipt No. N-245 Construction start extension to _____

Extension approved by _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORTState law requires that this report be filed with the Director, Department of Water Resources
within 30 days after the completion or abandonment of the well.USE TYPEWRITER OR
SAFETY INK**RECEIVED**
RIT
AUG 25 1988 90.**1. WELL OWNER**Name Sandy Schuly - 20 Bail - 83860
Address 3160 Dupont Rd Sagla Ida.
Owner's Permit No. 96-88-N-043**7. WATER LEVEL**Static water level 71 feet below land surface.
Flowing? ☐ Yes ☒ No G.P.M. flow _____
Artesian closed-in pressure _____ p.s.i.
Controlled by: ☐ Valve ☐ Cap ☐ Plug
Temperature 50 OF. Quality good
Describe artesian or temperature zones below.**2. NATURE OF WORK**

- ☒
- New well
- ☐
- Deepened
- ☐
- Replacement
-
- ☐
- Abandoned (describe abandonment procedures such as materials, plug depths, etc. in lithologic log)

8. WELL TEST DATA☐ Pump ☒ Bailer ☐ Air ☐ Other _____

Discharge G.P.M. Pumping Level Hours Pumped

20+ NO DRAWDOWN 1 hr.**3. PROPOSED USE**

- ☒
- Domestic
- ☐
- Irrigation
- ☐
- Test
- ☐
- Municipal
-
- ☐
- Industrial
- ☐
- Stock
- ☐
- Waste Disposal or Injection
-
- ☐
- Other _____ (specify type)

4. METHOD DRILLED

- ☒
- Rotary
- ☒
- Air
- ☐
- Hydraulic
- ☐
- Reverse rotary
-
- ☒
- Cable
- ☐
- Dug
- ☐
- Other _____

5. WELL CONSTRUCTIONCasing schedule: ☒ Steel ☐ Concrete ☐ Other _____

Thickness	Diameter	From	To
<u>2.50</u> inches	<u>6</u> inches	<u>1</u> feet	<u>130.1</u> feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet

Was casing drive shoe used? ☒ Yes ☐ NoWas a packer or seal used? ☒ Yes ☐ NoPerforated? ☐ Yes ☒ NoHow perforated? ☐ Factory ☐ Knife ☐ Torch

Size of perforation _____ inches by _____ inches

Number	From	To
_____ perforations	_____ feet	_____ feet
_____ perforations	_____ feet	_____ feet
_____ perforations	_____ feet	_____ feet

Well screen installed? ☒ Yes ☐ NoManufacturer's name JOHNSONType STAINLESS Model No. 30Diameter 6 Slot size 30 Set from 130 feet to 140 feet

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Gravel packed? ☐ Yes ☒ No ☐ Size of gravel _____

Placed from _____ feet to _____ feet

Surface seal depth 18+ Material used in seal: ☐ Cement grout☒ Bentonite ☒ Puddling clay ☐ _____Sealing procedure used: ☐ Slurry pit ☐ Temp. surface casing☒ Overbore to seal depthMethod of joining casing: ☐ Threaded ☒ Welded ☐ Solvent


Weld

☒ Cemented between strata

Describe access port _____

6. LOCATION OF WELL

Sketch map location must agree with written location.



Subdivision Name _____

South lot 2Lot No. 1 Block No. 1

OCT 17 1988

County BonnerSW 1/4 NW 1/4 Sec. 32, T. 56 N, R. 3 E**10.**Work started 7-27 finished 8-2-88**11. DRILLER'S CERTIFICATION**I/We certify that all minimum well construction standards were
complied with at the time the rig was removed.Firm Name Intermountain Firm No. 252Address At-1 Box 312 Priest River Ida Date 8-3-88Signed by (Firm Official) Norman B. Hopper

and

(Operator) Same

Record# NUMBER LASTNAME FIRSTNAME

Record# NUMBER WRNUMBER INJWELLNO LASTNAME FIRSTNAME

Record# NUMBER WRNUMBER INJWELLNO LASTNAME FIRSTNAME
2480 96-88-N-043 SCHULZ SANDY

DRILLING PERMITS mm/dd/yy
NUMBER 96-88-N-043 DATE WELL LOG RECEIVED 09/13/88
LAST NAME SCHULZ FIRST NAME SANDY
ADDRESS 3160 DUFORT RD CITY SABLE STATE ID ZIP 83860
TELEPHONE NO
WATER RIGHT NUMBER INJECTION WELL NO

QTERQTER SWNW GOVT LOT 02 LOT&BLOCK SUBDIVISION

SECTION 32 TWP 56N RGE 03W COUNTY BONNER

USE 43 DESCRIBE USE DOM/R.V. PARK
NEW, DEEPENED OR REPLACED (N,D,R) N HOT (Y OR N) N
DRILLER NUMBER 252 DRILLER NAME INTERMOUNTAIN
CONDITIONS (Y OR N) N
COMMENTS

mm/dd/yy mm/dd/yy
FEE\$100 APPROVAL DATE 06/14/88 EXTENSION DATE / /

EDIT :<D:>:DRILPERM

:Rec: 2480/2678

:NumCaps

FILED

OCT 17 1988

**Rt. 2, Box 163F
1205 Dover Hwy.
Sandpoint, Idaho 83864
Phone: 208-263-8185**

Customer Phone No.: _____

Well Data

Test Pump Used: 3500

Pump Setting: 130'

Date of Test: 8-16-88

Legal Description of Property: _____

Well Test Summary: Excellent well

OCT 17 1988

THE

RECEIPT
For Monies Paid
to the
Idaho Department of Water Resource

Receipt No: N000245

Date: 06/14/88
Time: 09:02:25

Received
From: SCHULZ, SANDY

Type of Payment	Program Acct	Amount
WELL DRILLING PERMIT	0650350 1238 6390	\$100.00

Total \$100.00

CHECK 4

Idaho Department of Water Resources

Region: Northern

Signature: 

MICROFILMED

001 17 1988

S T A T E O F I D A H O

DEPARTMENT OF WATER RESOURCES

Statehouse
Boise, Idaho 83720
(208) 334-7900
August 31, 1988

JO ANN BALL
SANDY SCHULZ
3160 DUFORT RD.
SAGLE, ID 83860

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 96-08525

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

We have enclosed a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed for your convenience is a form entitled "Proof of Beneficial Use" that must be submitted to the Department when your project is completed.

Sincerely,

Gary Spackman
Supervisor, Water Allocation Section

GS: SC
Enclosures

MICROFILMED

OCT 17 1988

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY RSN DATE 6/29/88 APPLICATION NUMBER 96-8525

REQUIRED INFORMATION

- ☒ Name (If applicant is a corporation or partnership, names must be provided for the director, officers, & other partners.)
☒ Address
☒ Source (See USGS Quad for names of water sources)
☒ Point of Diversion (10 acres for spring, lot & block descriptions for subdivisions, local name, flow and/or volume)
☒ County
☒ Quantity (flow and/or volume)
☒ Period of Use
☒ Nature of proposed use (Include description of use.)
☒ Description of diverting works
☒ Time required for beneficial use of water
☒ Place of use or acres irrigated
☒ Map
☒ Signature (If applicant is corp. partnership, or municipality, title of signator is required)
☒ Fee
☒ Yes ☐ No* In form to receipt

ADDITIONAL INFORMATION

- ☐ Overlapping place of use (Describe source & relationship to present application on the back.)
☐ Overlapping point of diversion
☐ Yes ☒ No Field check required
Field check by _____
☐ Yes ☒ No Field report attached
☐ Yes ☒ No Critical groundwater area
☐ Yes ☒ No Groundwater management area
☐ Yes ☒ No Send dam safety information
☐ Yes ☒ No Send power requirement letter
☐ Yes ☒ No Send fish farm requirement letter
☐ Yes ☒ No Power residency affidavit
☐ Yes ☒ No Power efficiency form
☐ Yes ☒ No Within trustwater boundary (If yes, attach trust water supplementary analysis sheet.)
☐ Yes ☒ No Diversion greater than 5 cfs or 500 acre ft. (If yes, attach large diversion supplementary analysis sheet.)
☐ See reverse side for additional information

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT

Date Requested AUG 18 1988

Department of Water Resources

RECEIVED

PROCESSING

☒ Yes ☐ No In form for advertising
☐ Yes ☒ No Statewide advertising
☒ Yes ☐ No Fee amount, receipt date & No. recorded on application

SEND COPIES TO

☒ Idaho Dept. of Health & Welfare ☐ U.S. BLM
☐ Idaho Dept. of Fish & Game ☐ U.S. Forest Service
☐ Idaho Dept. of Lands ☐ Water District
☐ Adjudication Bureau Unit ☐ Other _____

FINAL REGIONAL PROCESSING REVIEW

☒ Yes ☐ No Affidavit of publication received
☒ Yes ☐ No Application published correctly. If not, record action taken.

☒ Yes ☐ No Publication dates & paper, recorded on application
☐ Yes ☒ No Protests received
Final date for protest 7/25/88
☒ Yes ☐ No Protests, dates, resolution of protest, recorded on application
☐ Yes ☒ No Recommendations attached
☐ Yes ☒ No Measuring device required
☐ Yes ☒ No Access port required
☐ Yes ☒ No Will water be delivered by watermaster? If yes, what Dist. _____
☐ Yes ☒ No Special conditions of approval or cover letter below. _____

☐ See below for additional information
Date of priority recommended 6/24/88
By PAH Date 8/18/88

STATE OFFICE REVIEW

P23

P16

4604

☐ See below for additional information
By KW Date 8/25/88

ADDITIONAL INFORMATION



State of Idaho
DEPARTMENT OF WATER RESOURCES

NORTHERN REGION, Suite No. 9 • 4055 Government Way • Coeur d'Alene, Idaho 83814 • (208) 765-4639

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

August 18, 1988

Divn. of Env. Quality
2110 Ironwood Pkwy.
Coeur d'Alene, Id. 83814

Gentlemen:

Enclosed is information which may be of interest to your Agency relating to an application recently filed with the Idaho Department of Water Resources.

Sincerely,

ROBERT G. HAYNES, P.E.
Regional Manager

RGH/pms
Enclosure



MICROFILMED

OCT 17 1988

Affidavit of Publication

STATE OF IDAHO
County of Bonner,

ss.

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have
been filed to appropriate the public
waters of the State of Idaho:
96-08525

BALL, JO ANN
SCHULZ, SANDY
3160 DUFORT RD.
SAGLE, ID 83860
Source: GROUNDWATER
Diversion Pt: LOT 2 (SWNW) Sec 32
T 56N R 03W
Use: COMMERCIAL (.100 CFS)
Date Filed: 6 24 1988
In: T56N R03W S32 SWNW

The permit(s) will be subject to all
prior water rights. Protests must be
filed with the Director, Dept. of
Water Resources, Northern Region,
Government Way Suite 9, Coeur
d'Alene, Idaho 83814 on or before
JULY 25, 1988.

R. KEITH HIGGINSON
Director

#635 July 6, 13, 1988

Mike McLean
being duly sworn, says that he is the *News Editor*
of the PRIEST RIVER TIMES, a weekly newspaper printed and
published at Priest River, Bonner County, Idaho, and has been con-
tinuously and uninterruptedly published in said County during a period
of 78 consecutive weeks prior to the first publication of the annexed
notice for publication, is a newspaper of general circulation made up of
at least eight pages of at least six columns each, printed from typemat-
ter or stereotyped forms of at least nineteen and three-fourths inches
depth, has at least 1250 bona fide subscribers living within said Bonner
County, and is published at regular weekly intervals. That the annexed
is a true copy of the notice for publication in the case of

#635 *Water Rights*

as it was published in the regular and entire issue of said paper for a
period of *two* consecutive weeks, commencing on
the *6th* day of *July*, 19 *88*,
and

ending on the *13* day of *July*, 19 *88*,
and that said notice was published in said newspaper proper, and not in
supplement form.

J. M. McLean

Subscribed and sworn to before me this

13 day of *July*, 19 *88*

Linda L. Loney
Notary Public for Idaho,
Residing at Priest River, Idaho

RECEIVED
JUL 24 1988

Department of Water Resources
Northern Region Office

John L. Loney

OCT 17 1988

3160 DuPont Rd.
Seale, Id. 83860
July 22, 1988

Mr. Robert Haynes
Dept. of Water Resources
Dear Mr. Haynes:

Enclosed is clipping from Priest River Times
regarding our application for water rights
in our R.V. park.

Sincerely,
Gandy Schulz

RECEIVED
JUL 28 1988

Department of Water Resources
Northern District Office

MICROFILMED

OCT 17 1988

Legal Notices

NOTIFICATION OF SHERIFF'S SALE

Description of Abandoned
Vehicle:

Name: Priest River Police
Department

Make: Ford

Model: Falcon Ranchero

Year: 1964

Manufacturer: Ford Motor
Company

License # (if available): HV 1423

Licensing State: Washington

VIN #: AR270130845

Description of where and when the
abandoned vehicle will be sold:

Date: July 21 - 10:00 A.M.

Location: Dailey's Body Shop,
Highway 57 & Beardmore.

#638 July 13, 20, 1988

NOTICE RELATED TO LEAD CONTAMINATION OF DRINKING WATER FROM THE CITY OF PRIEST RIVER

The City of Priest River notifies its customers, as required by 1986 amendments to the Safe Drinking Water Act, that they should consider testing household water supplies for lead content. Water provided by the system is currently well below current standards for lead contamination. Lead content can be reduced by replacing lead pipe or connections with lead-free materials. As part of the system's testing program, lead, copper and mineral content of the water are adjusted to deliver minimally corrosive water. The effect of this practice is to produce water that dissolves lead more slowly than corrosive water. Because the City of Priest River water system does not contain any lead pipe or service connections, THE CITY has no plans to replace pipe at this time. Any repairs or additions to the system

Lake Ranger District, Idaho Panhandle National Forests, made the decision to construct approximately 1068 feet of new trail for Continental Creek trail #28, on the Priest Lake Ranger District. This trail is an access route for the proposed Salmo-Priest Wilderness area and roadless area, also the upper Priest-River and upper Priest Falls area.

Copies for the Decision Notice are available for review at the Priest Lake Ranger District Office, HCR 5, Box 207, Priest River, ID 83856. This decision is subject to administrative appeal (36 CFR 211.18). Any appeal, to be timely, must be postmarked by August 19, 1988.

#639 July 13, 1988

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

96-08525

BALL, JO ANN
SCHULZ, SANDY
3160 DUFORT RD.
SAGLE, ID 83860

Source: GROUNDWATER
Diversion Pt: LOT 2 (SWNW) Sec 32
T 56N R 03W

Use: COMMERCIAL (.100 CFS)

Date Filed: 6 24 1988

In: T56N R03W S32 SWNW

The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Northern Region, Government Way Suite 9, Coeur d'Alene, Idaho 83814 on or before JULY 25, 1988.

R. KEITH HIGGINSON
Director

#635 July 6, 13, 1988



State of Idaho
DEPARTMENT OF WATER RESOURCES

NORTHERN REGION, Suite No. 9 • 4055 Government Way • Coeur d'Alene, Idaho 83814 • (208) 765-4639

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

Dear Claimant:

The Department of Water Resources acknowledges receipt of your water right application for permit.

This office is currently in the process of advertising the application in the local county newspaper. The advertisement will be published for two weeks, and a period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested, you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our state office in about five weeks. State office personnel will conduct a complete review prior to the final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Enclosed please find your receipt for the fee involved in filing this application.

Please feel free to contact this office if you have any questions regarding this procedure.

Sincerely,

ROBERT G. HAYNES, P.E.
Regional Manager

RGH/pms
Enc. - Receipt

MICROFILMED

OCT 17 1988

96-08525

BALL, JO ANN
SCHULZ, SANDY
3160 DUFORT RD.
SAGLE, ID 83860

Source: GROUNDWATER

Diversion Pt: LOT 2 (SWNW) Sec 32 T 56N R 03W


Use: COMMERCIAL (.100 CFS)

Date Filed: 6/24/1988

In: T56N R03W S32 SWNW

RECEIVED

OCT 17 1988



Tucker Engineering Consultants

617 CHURCH STREET • SANDPOINT, IDAHO, 83864 • 263-8558
SURVEYING • STRUCTURES • WATER AND SEWER SYSTEMS

June 23, 1988

RECEIVED
JUN 24 1988
Department of Water Resources
Northern District Office

State of Idaho
Department of Water Resources
4055 Government Way
Suite No. 9
Coeur d'Alene, ID 83814

RE: Well Permit - Sandy Schultz - Fox Farm

Enclosed is an application for permit to drill a well to serve a proposed R.V. park. Also enclosed is a copy of a drilling permit issued to Sandy Schultz on June 14, 1988.

The owners are anxious to proceed with this project and so we would appreciate anything you can do to expedite approval of this application.

If you have any questions, please feel free to contact us. Thank-you for your assistance.

Very truly yours,

TUCKER ENGINEERING CONSULTANTS

Richard C. Tucker, P.E.
Civil Engineer

Enclosure

RCT/cfw

MICROFILMED

OCT 17 1988



State of Idaho
DEPARTMENT OF WATER RESOURCES

NORTHERN REGION, Suite No. 9 • 4055 Government Way • Coeur d'Alene, Idaho 83814 • (208) 765-4639

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

June 21, 1988

Tucker Engineering Consultants
617 Church St.
Sandpoint, Id. 83864

Re. Appropriation Application


Dear Sirs:

This Department has received your check #92-360 in the amount of \$30.00 and the application to appropriate groundwater of Ms. Schultz and Ms. Ball. Since This department can not accept an application with out the signature of the applicant or a power of attorney the check and application are being returned to you.

I am also enclosing a well drilling permit application, which must be approved before the well driller can commence drilling.


If you have any questions or if I can be of any assistance please feel free to contact me at this office.

Sincerely,

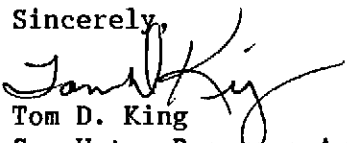
Tom D. King
Sr. Water Resource Agent

MICROFILMED

OCT 17 1988



Tucker Engineering Consultants

617 CHURCH STREET • SANDPOINT, IDAHO, 83864 • 263-8558
SURVEYING • STRUCTURES • WATER AND SEWER SYSTEMS

June 17, 1988

Idaho Department of
Water Resources
4055 Government Way
No. 9
Coeur d'Alene, ID 83814

RE: Well Permit - Sandy Schultz - Fox Farm

Enclosed is an application for permit to drill a well to serve a proposed R.V. park.

The owner is anxious to proceed with this project and so we would appreciate anything you can do to expedite approval of this application.

Thank-you for your assistance.

Very truly yours,

TUCKER ENGINEERING CONSULTANTS

Richard C. Tucker, P.E.
Civil Engineer

Enclosure

RCT/cfw

MICROFILMED

OCT 17 1988