


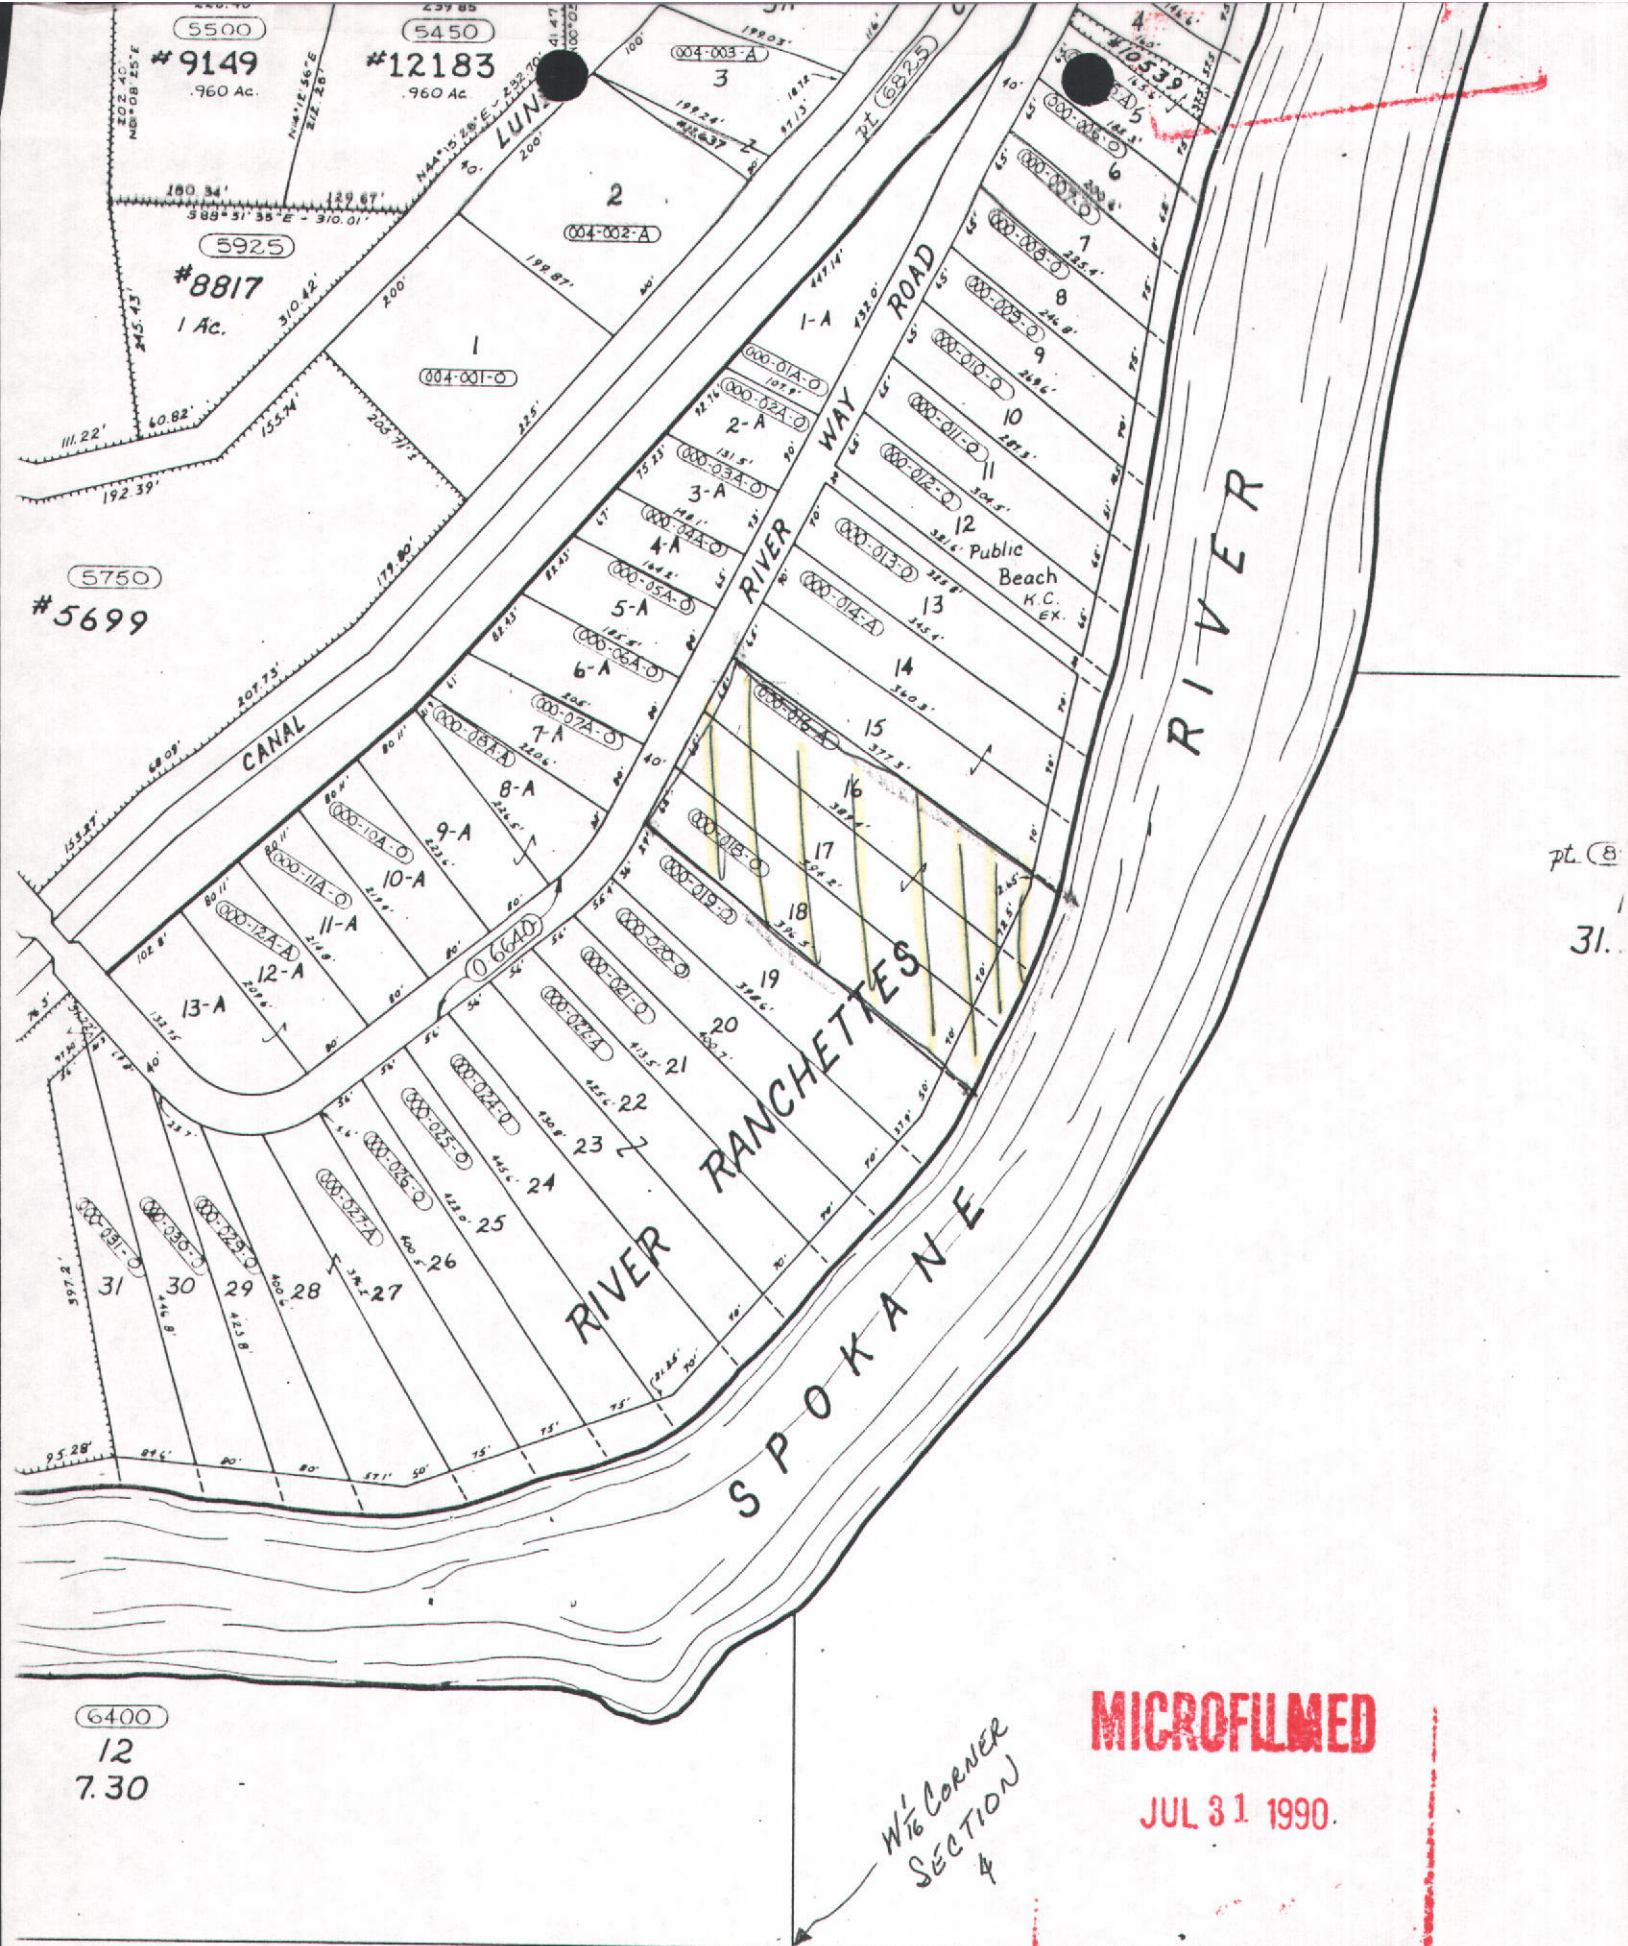


MICROFILMED

JUL 31 1990.

SCALE: 1 inch = 100 feet

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

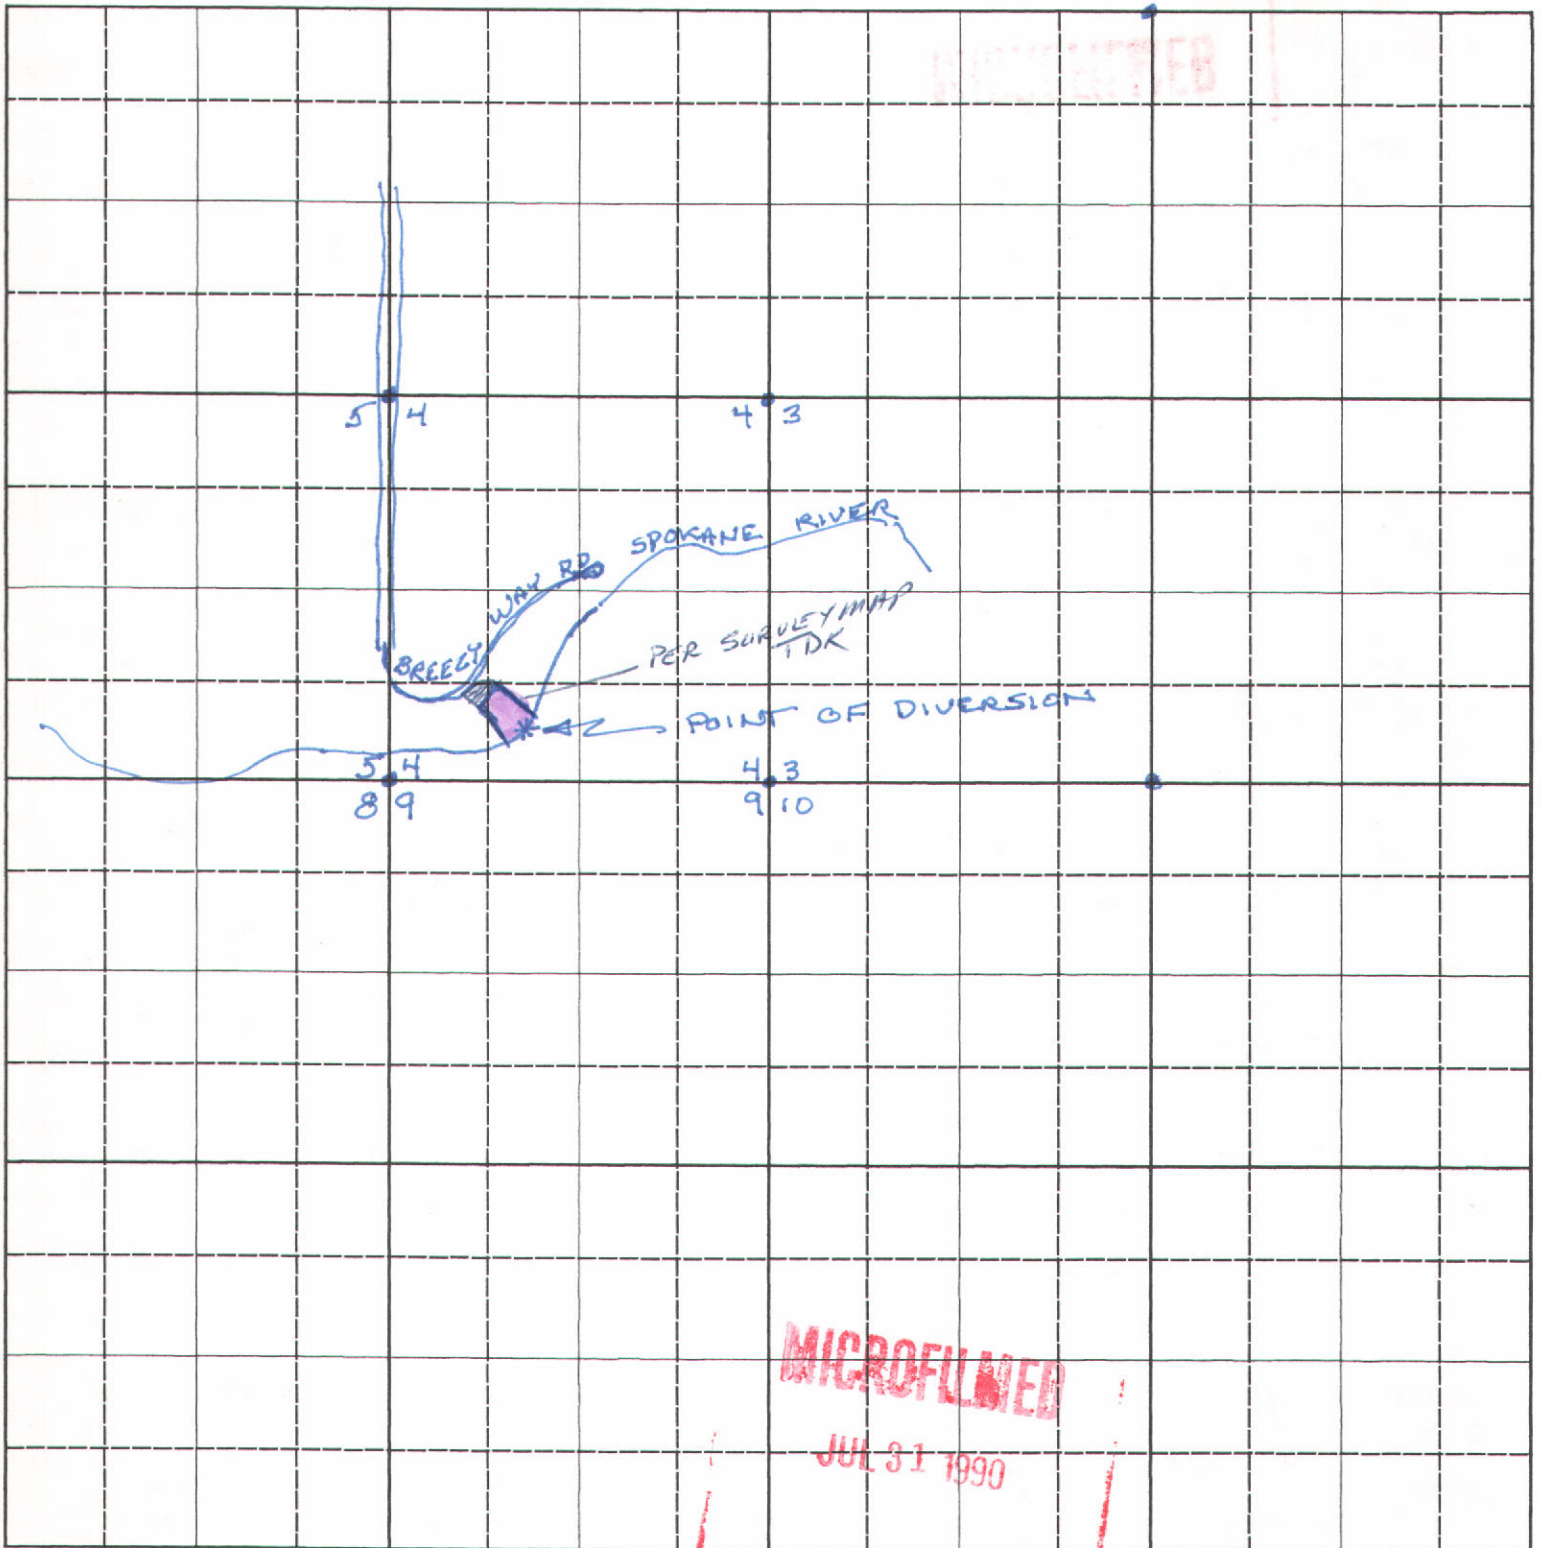

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Howard R. Justice
(Applicant)
James L. Justice

31 1998

RECEIVED

See: Theoretical Pump efficiency Calculation sheet.

2. Measurements:

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
None						


D. FLOW MEASUREMENTS

*Code to correspond with No. on map and aerial photo

Well or Diversion No. *	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
A.O.S. m. th	2	6281	Sears	1 1/2" model # 390-26100	

4.

Scale: 1" = _____
X Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).
Aerial Photo Attached (required for irrigation of 10+ acres)
X Photo of Diversion and System Attached

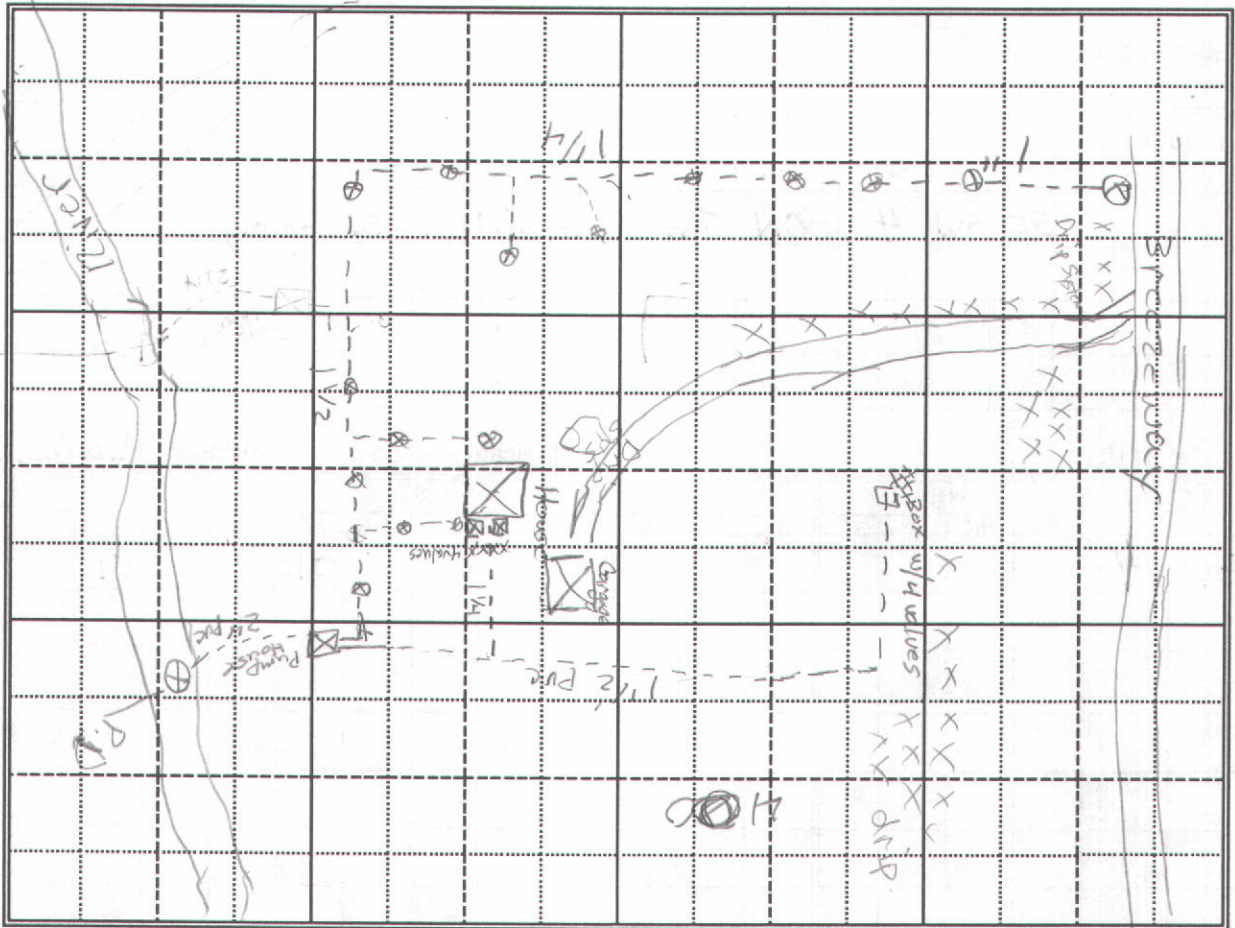

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate well size/ditch size/pipe l.d. as applicable.

Pump system & reduce to 20 lbs pressure

5288000mN

22

PIPELINE

PRAIRIE

AVE

2155

FISHER

AVENUE

2150

BM 2129

Borrow Pit

Grange Hall

28

2145

5287

ROAD

BURLINGTON

GRADE

INTERNATIONAL

27

Wells

Wells

Evergreen Cemetery

Water Tank

Trailer Park

RATHDRUM

POLE LINE

5286

PIPELINE

BM 2138

Grand Junction

CORPORATE

North Park

PIPELINE

OLD

NORTHERN

2145

CORBIN

33

5285

Trailer Park

Trailer Park

Trailer Park

McGuire-Wesleyan Church

BM 2135

Seltice Sch

Jr HS

Library

Post Falls

2198

BM 2163

City Hall PO

T51N
T50N

Trailer Park

Trailer Park

McGuire

BURLINGTON

McGuire's (Siding)

Trailer Park

NORTHERN

4

Powerhouse

Dam

Borrow Pit

Dam

Boat Ramp

River Park

SPOKANE

42°30"

5283

Borrow Pit

X 2217

Gaging Station

Cable Car

2351 X

JAN 8 1 1996

RIVERVIEW

DRIVE

2450

9

10

5282

Mile 99

X 2042



#95-08648

Mr. Justus
Home



Mr. Justus
P.D.



Mr. Justus
Pumphouse



RECEIVED
JAN 31 1996



95-08648
Mr. Justus
P. U. Irr.



Mr. Justus
P. U. for Irr.



INDEXED
JAN 31 1996

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
County of Kootenai,

} ss

Julie Jacobs

being first duly sworn

upon oath deposes and says:

1. I am now and at all times hereinafter mentioned was a citizen of the United States, resident of the State of Idaho, over the age of twenty-one years and not a party of the above entitled action.

2. I am now and at all times hereinafter mentioned was the printer (principal clerk) of the "Coeur d'Alene Press," a newspaper printed and published daily except Sunday in Coeur d'Alene, Kootenai County, Idaho, and having a general circulation in said county.

3. The

Legal Notice

of which the annexed is a printed copy, was published in the regular issue of said newspaper for *2* consecutive *Thurs* weeks commencing on the *7th* day of *June*, 19 *90*, and ending on the *14th* day of *June*, 19 *90*, and such publication was made as often during said period as said *Daily* newspaper was regularly issued.

4. That said newspaper has been continuously and uninterruptedly published in said Kootenai County, during a period of more than seventy-eight consecutive weeks immediately prior to the first publication of said notice.

Julie Jacobs

Subscribed and sworn to before me this

14th

day of

June

19 *90*

Roberta Manley

Notary Public for the State of Idaho,
residing at Coeur d'Alene, Idaho.

ROBERTA MANLEY
My commission expires *2-3-93*

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

95-08648

JUSTUS, HOWARD K.

JUSTUS, MAVIS L.

W. 2020 BREEZY WAY

POST FALLS, ID 83854

Source: SPOKANE RIVER Tributary:

COLUMBIA RIVER

Diversion Pt: SESW Sec 4 T 50N R 05W

Use: IRRIGATION (.040 CFS)

Total Diversion: (.040 CFS)

Date Filed: 4/10/1990

In: T50N R05W S04 SESW SWSE

2.0 ACRES TOTAL

96-08593

SILVERWOOD, INC.

N. 26225 HWY. 95

ATHOL, ID 83801

Source: GROUNDWATER

Diversion Pt: SESE Sec 28 T 53N R 03W

Use: COMMERCIAL (.800 CFS)

Total Diversion: (.800 CFS)

Date Filed: 4/5/1990

In: T53N R03W S28 SENE NESE NWSE
SWSE SESE

For additional information concerning the property location, call the Northern Regional Office at 765-4639.

The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Northern Region, 1910 Northwest Blvd., Suite 210, Coeur d'Alene, Idaho 83814 on or before June 25, 1990.

R. KEITH HIGGINSON, Director

Legal 914

June 7, 14, 1990

MICROFILMED

JUL 31 1990

RECEIVED
JUN 15 1990
NORTHERN REGION
IDWR

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
County of Kootenai,

} ss.

Julio Jacobs

being first duly sworn
upon oath deposes and says:

1. I am now and at all times hereinafter mentioned was a citizen of the United States, resident of the State of Idaho, over the age of twenty-one years and not a party of the above entitled action.

2. I am now and at all times hereinafter mentioned was the printer (principal clerk) of the "Coeur d'Alene Press," a newspaper printed and published daily except Sunday in Coeur d'Alene, Kootenai County, Idaho, and having a general circulation in said county.

3. The

Legal Notice

of which the annexed is a printed copy, was published in the regular issue of said newspaper for *2* consecutive *weeks* commencing on the *14th* day of *April*, 19*90*, and ending on the *21st* day of *April*, 19*90*, and such publication was made as often during said period as said *Daily* newspaper was regularly issued.

4. That said newspaper has been continuously and uninterruptedly published in said Kootenai County, during a period of more than seventy-eight consecutive weeks immediately prior to the first publication of said notice.

Subscribed and sworn to before me this *21st* day of *April*, 19*90*.

Roberta Manley

Notary Public for the State of Idaho,
residing at Coeur d'Alene, Idaho.

ROBERTA MANLEY

My commission expires *2-3-93*

NOTICE OF APPLICATION
FOR WATER RIGHT
The Following application(s) have
been filed to appropriate the public
waters of the State of Idaho:

95-08648

JUSTUS, HOWARD K.
JUSTUS, MAVIS L.
W. 2020 BREEZY WAY
POST FALLS, ID 83854
Source: SPOKANE RIVER Tributary:
COLUMBIA RIVER
Diversion Pt: SESW Sec 4 T 50N R 05W
Use: IRRIGATION (.040 CFS)
Total Diversion: (.040 CFS)
Date Filed: 4/10/1990
In: T50N R05W S04 SESW *SWSE*
2.0 ACRES TOTAL

96-08593

SILVERWOOD, INC.
N. 26225 HWY. 95
ATHOL, ID 83801
Source: GROUNDWATER
Diversion Pt: SESE Sec 28 T 53N R 03W
Use: COMMERCIAL (.800 CFS)
Total Diversion: (.800 CFS)
Date Filed: 4/5/1990
In: T53N R03W S28 SENE NESE NWSE
SWSE SESE

For additional information concern-
ing the property location, call the
Northern Regional Office at 765-4639.

The permit(s) will be subject to all
prior water rights. Protests must be filed
with the Director, Dept. of Water Re-
sources, Northern Region, 1910
Northwest Blvd., Suite 210, Coeur d'
Alene, Idaho 83814 on or before MAY 7,
1990.

R. KEITH HIGGINSON, Director
Legal 703
Apr. 14, 21, 28, May 5, 1990

RECEIVED

APR 24 1990

NORTHERN REGION
IDWR

JUL 31 1990

*wrong date
will be corrected
with correction*

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 95-08648

Priority: April 10, 1990

Maximum Diversion Rate:

0.04 CFS

Maximum Diversion Volume:

6.0 AF

This is to certify, that HOWARD K JUSTUS
MAVIS L JUSTUS

W 2020 BREEZY WAY
POST FALLS ID 83854

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated April 10, 1990; and has submitted Proof of Beneficial Use on June 10, 1993. An examination indicates that the works have a diversion capacity of 0.120 cfs of water from:

SPOKANE RIVER

tributary to COLUMBIA RIVER

source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/15 to 11/15	0.04 CFS	6.0 AF

LOCATION OF POINT(S) OF DIVERSION: SESW , Sec. 4, Township 50N, Range 05W
KOOTENAI County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
50N	05W	4	SESW 1	SWSE 1		2

Total number of acres irrigated: 2

CONDITIONS OF APPROVAL AND REMARKS

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount that can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. This right when combined with all other rights shall provide no more than .02 cfs per acre nor more than 3.0 afa per acre for the lands above.

JAN 31 1996

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 95-08648


CONDITIONS OF APPROVAL AND REMARKS

6. Place of use is located within Lots 16, 17 and 18 of the River Ranchettes Subdivision.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 12TH day of DECEMBER, 1995.

Acting for

KARL J. DREHER, Director

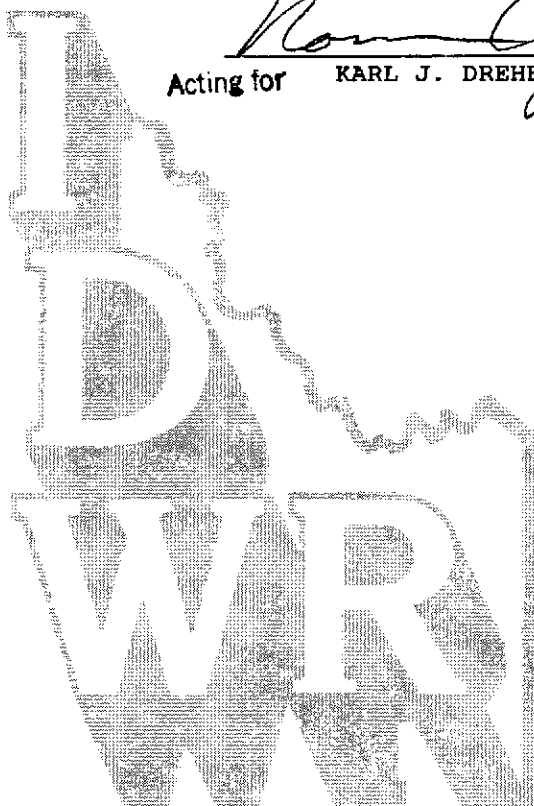

NOV 1 1995

RECEIVED

JUN 10 1993

Department of Water Resources

OFFICE USE ONLY

Amt. of Fee \$ 50.00

Date 6-10-93

Receipt No. CO27806

Receipt by JW

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 95-08648 Telephone No. 773 7312
2. Name(s) of Permit Holder(s): HOWARD K. AND MAVIS L. JUSTUS
3. Mailing Address: W 2020 BREEZY WAY, POST FALLS, ID. 83854
4. Source of Water: SPOKANE RIVER (4 MILES EAST OF WA. BORDER)

If GROUNDWATER, Well Driller's Name: _____ Date Drilled: _____

OPTIONAL:

Pump horsepower: 2 Pressure (psi): 40 Dynamic pumping level (ft.): _____

5. Extent of Use (as authorized by the permit):

Domestic + NA (No. of households) Stockwater _____ (No. and type of stock)

Irrigation 2 (No. of acres) Other _____

6. Total rate and/or volume for which proof is submitted .04 cfs OR _____ acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? ☐ Yes ☒ No Installed? ☐ Yes ☐ No

OR

Flow Measurement Port: Required? ☐ Yes ☒ No Installed? ☐ Yes ☐ No

8. Fee Enclosed: \$ 50.00 (See License Fee Schedule on back of Instruction Sheet)

9. Person to contact to accompany the Department representative during field examination of the water system.

HOWARD JUSTUS 773-7312
Name Telephone No.

W 2020 BREEZY WAY, POST FALLS, ID. 83854
Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

RECORDED

JUL 07 1993

6/1/93
6/1/93
Date

Howard K. Justus
Signature (and title, if on behalf of a company or organization)

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 95-08648

Proposed Priority: April 10, 1990 Maximum Diversion Rate: 0.04 CFS

This is to certify, that HOWARD K. JUSTUS
MAVIS L. JUSTUS
W. 2020 BREEZY WAY
POST FALLS, ID 83854

has applied for a permit to appropriate water from:

SPOKANE RIVER tributary of COLUMBIA RIVER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
-----------------------	----------------------	--------------------------

IRRIGATION	03/15 to 11/15	0.04 CFS
------------	----------------	----------

LOCATION OF POINT(S) OF DIVERSION: SESW Sec. 4, Township 50N, Range 05W
KOOTENAI County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
50N	05W	4	SESW 1	SWSE 1		2

Total number of acres irrigated: 2

CONDITIONS/REMARKS:


1. Proof of construction of works and application of water to beneficial use shall be submitted on or before August 1, 1993.
2. Subject to all prior water rights.
3. Permit holder shall commence the excavation or construction of diverting works within one year of the date this permit is issued and shall proceed diligently until the project is complete.
4. The rate of diversion of water for irrigation under this permit and all other water rights on the same land shall not exceed 0.02 cubic feet per second for each acre of land.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

27 day of July, 1990.

MICROFILMED

JUL 31 1990

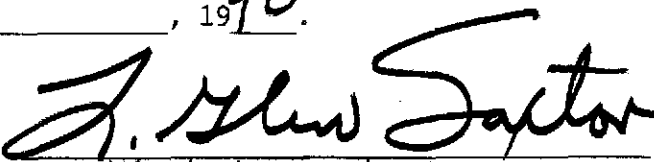for 
R. Keith Higginson, Director

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name of applicant HOWARD K. & MAVIS L. JUSTUS Phone 773 7312
Post office address W. 2020 BREEZY WAY, POST FALLS, ID. 83854
2. Source of water supply SPOKANE RIVER which is a tributary of COLUMBIA, R.
3. Location of point of diversion is SE $\frac{1}{4}$ of SW $\frac{1}{4}$ of _____ $\frac{1}{4}$, Govt. Lot _____
Sec. 4 Township 50 N Range 5 W B.M. KOOTENAI County; additional
points of diversion if any: _____

4. Water will be used for the following purposes:

Amount .04 cfs for IRRIGATION purposes from MAR. 15 to NOV. 15 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) .04 ^{OK 4/10/90} and/or (b) _____
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. PUMP & PIPELINE
SYSTEM /w 2" MAIN LINE

b. Height of storage dam 0 feet; active reservoir capacity 0 acre-feet; total
reservoir capacity 0 acre-feet; period of year when water will be diverted to storage:
0 to 0 inclusive.

c. Proposed well diameter is 0 inches; proposed depth of well is 0 feet.

d. Is ground water with a temperature of greater than 90°F being sought? No

7. Time required for the completion of the works and application of the water for proposed beneficial use is
3 years (minimum 1 year).

MICROFILMED

JUL 31 1990

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. _____
- e. Other; describe fully. _____

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (*example: D for Domestic*) in the corresponding place of use below. See instructions for standard symbols.

[illegible]


Total number of acres to be irrigated

10. Describe any other water rights used for the same purposes as described above.
11. a. Who owns the property at the point of diversion? Howard & Mavis Lustus
b. Who owns the land to be irrigated or place of use? Howard & Mavis Lustus
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing.

applicant to make this filing.

12. Remarks: LAND TO BE IRRIGATED IS LOTS # 16, 17, & 18

LOCATED IN THE RIVER RANCHET SUBDIVISION.

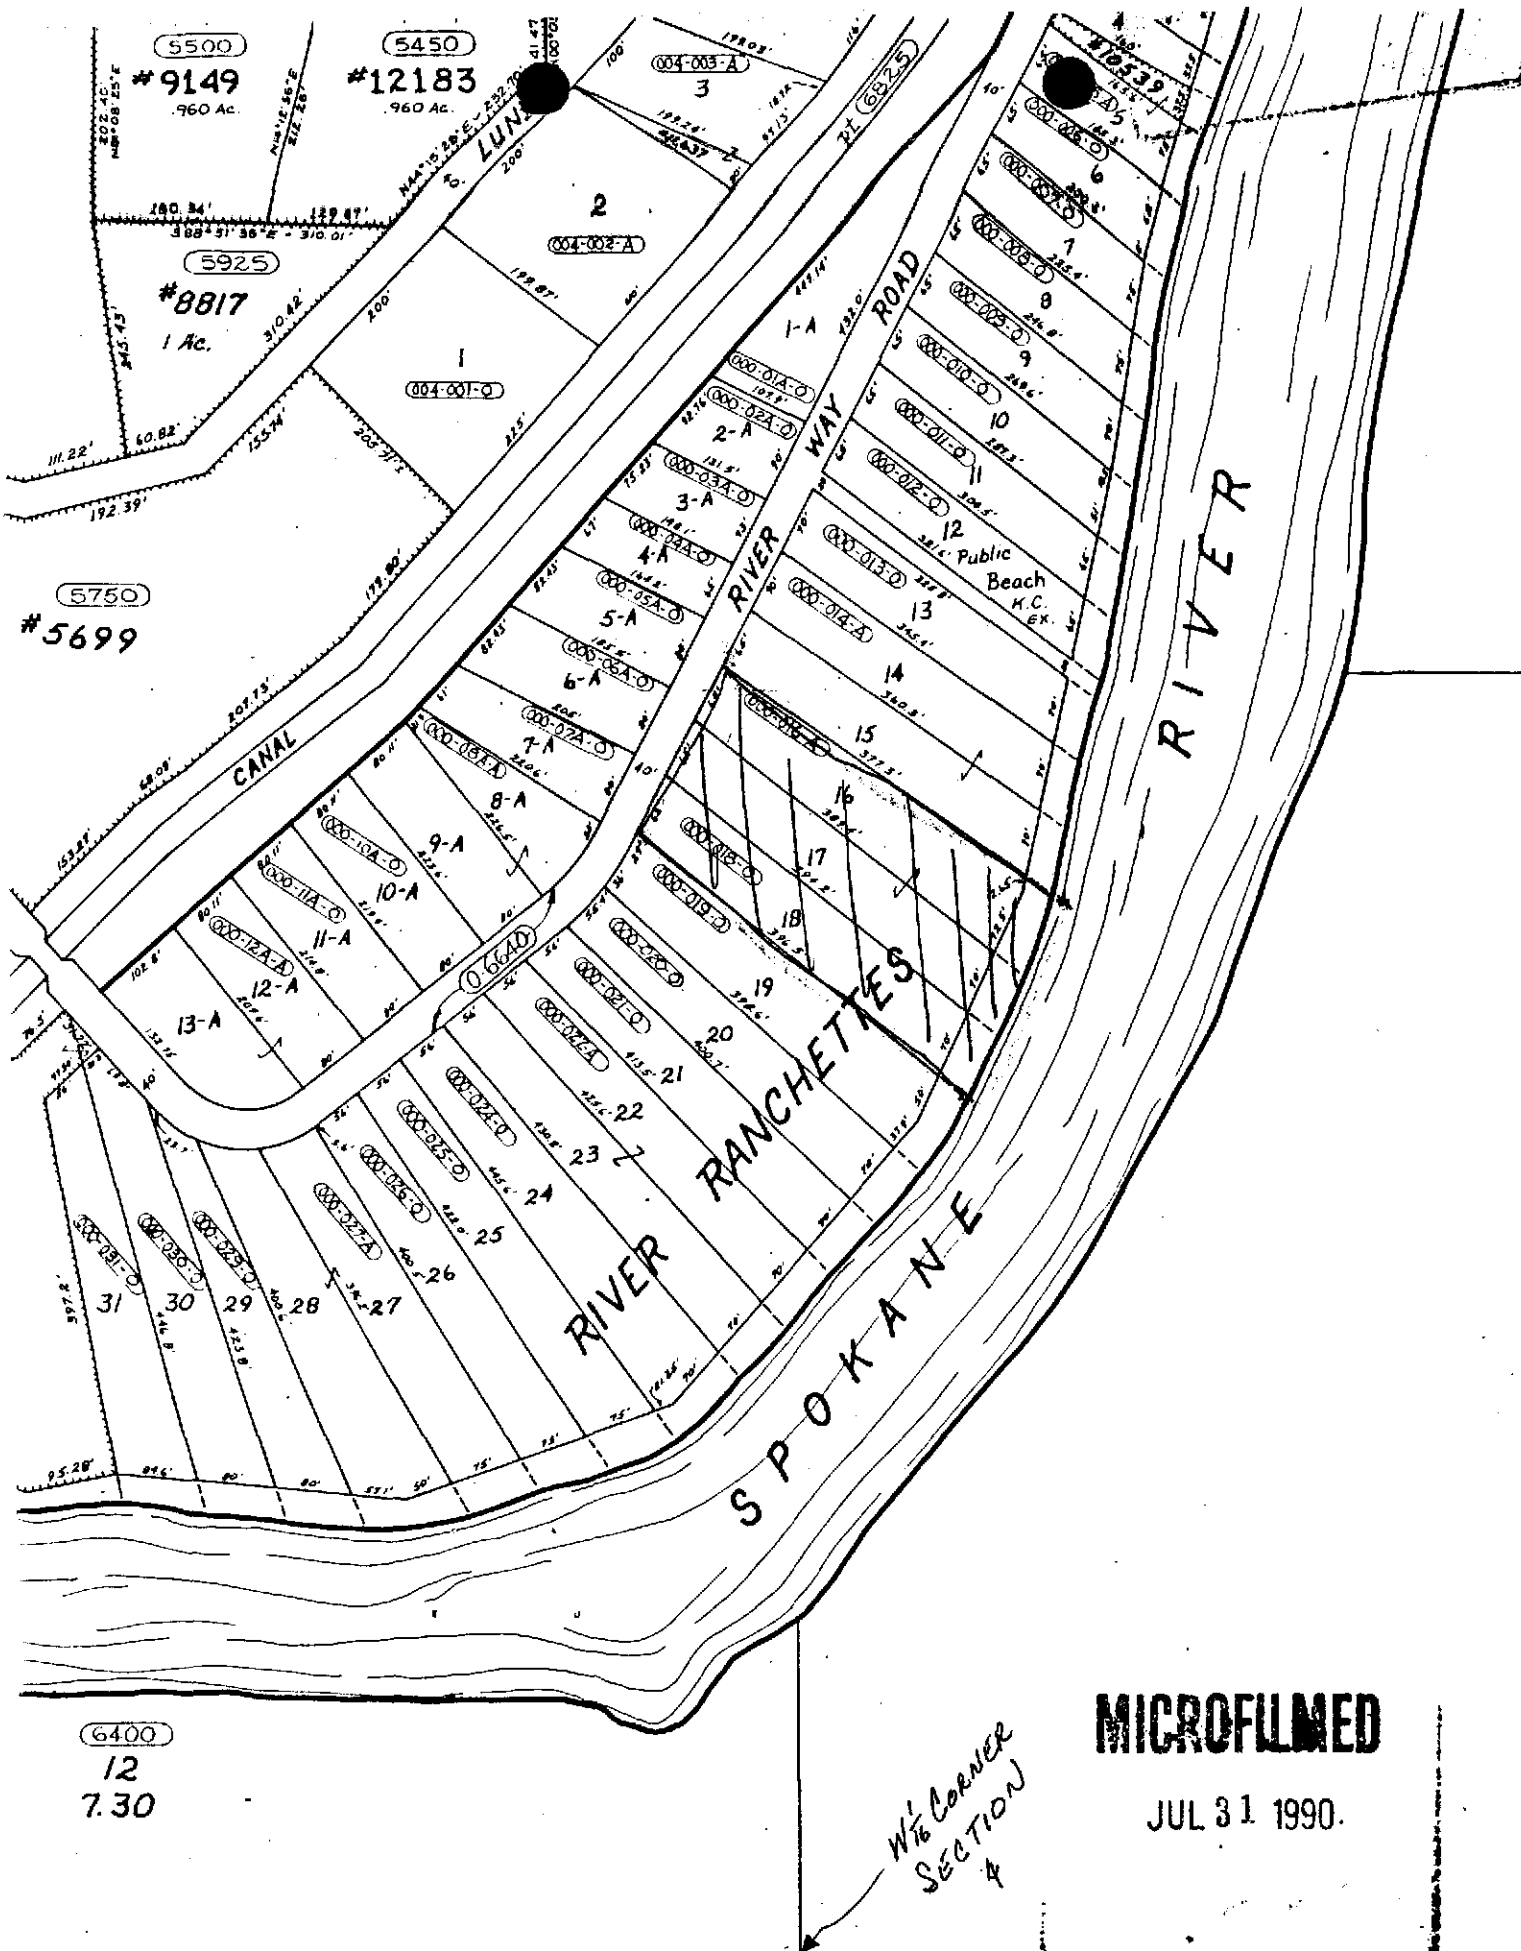

pt. (B)
31.


MICROFILMED

JUL 31 1990.

W 1/2 CORNER
SECTION 4

SCALE: 1 inch = 100 feet

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

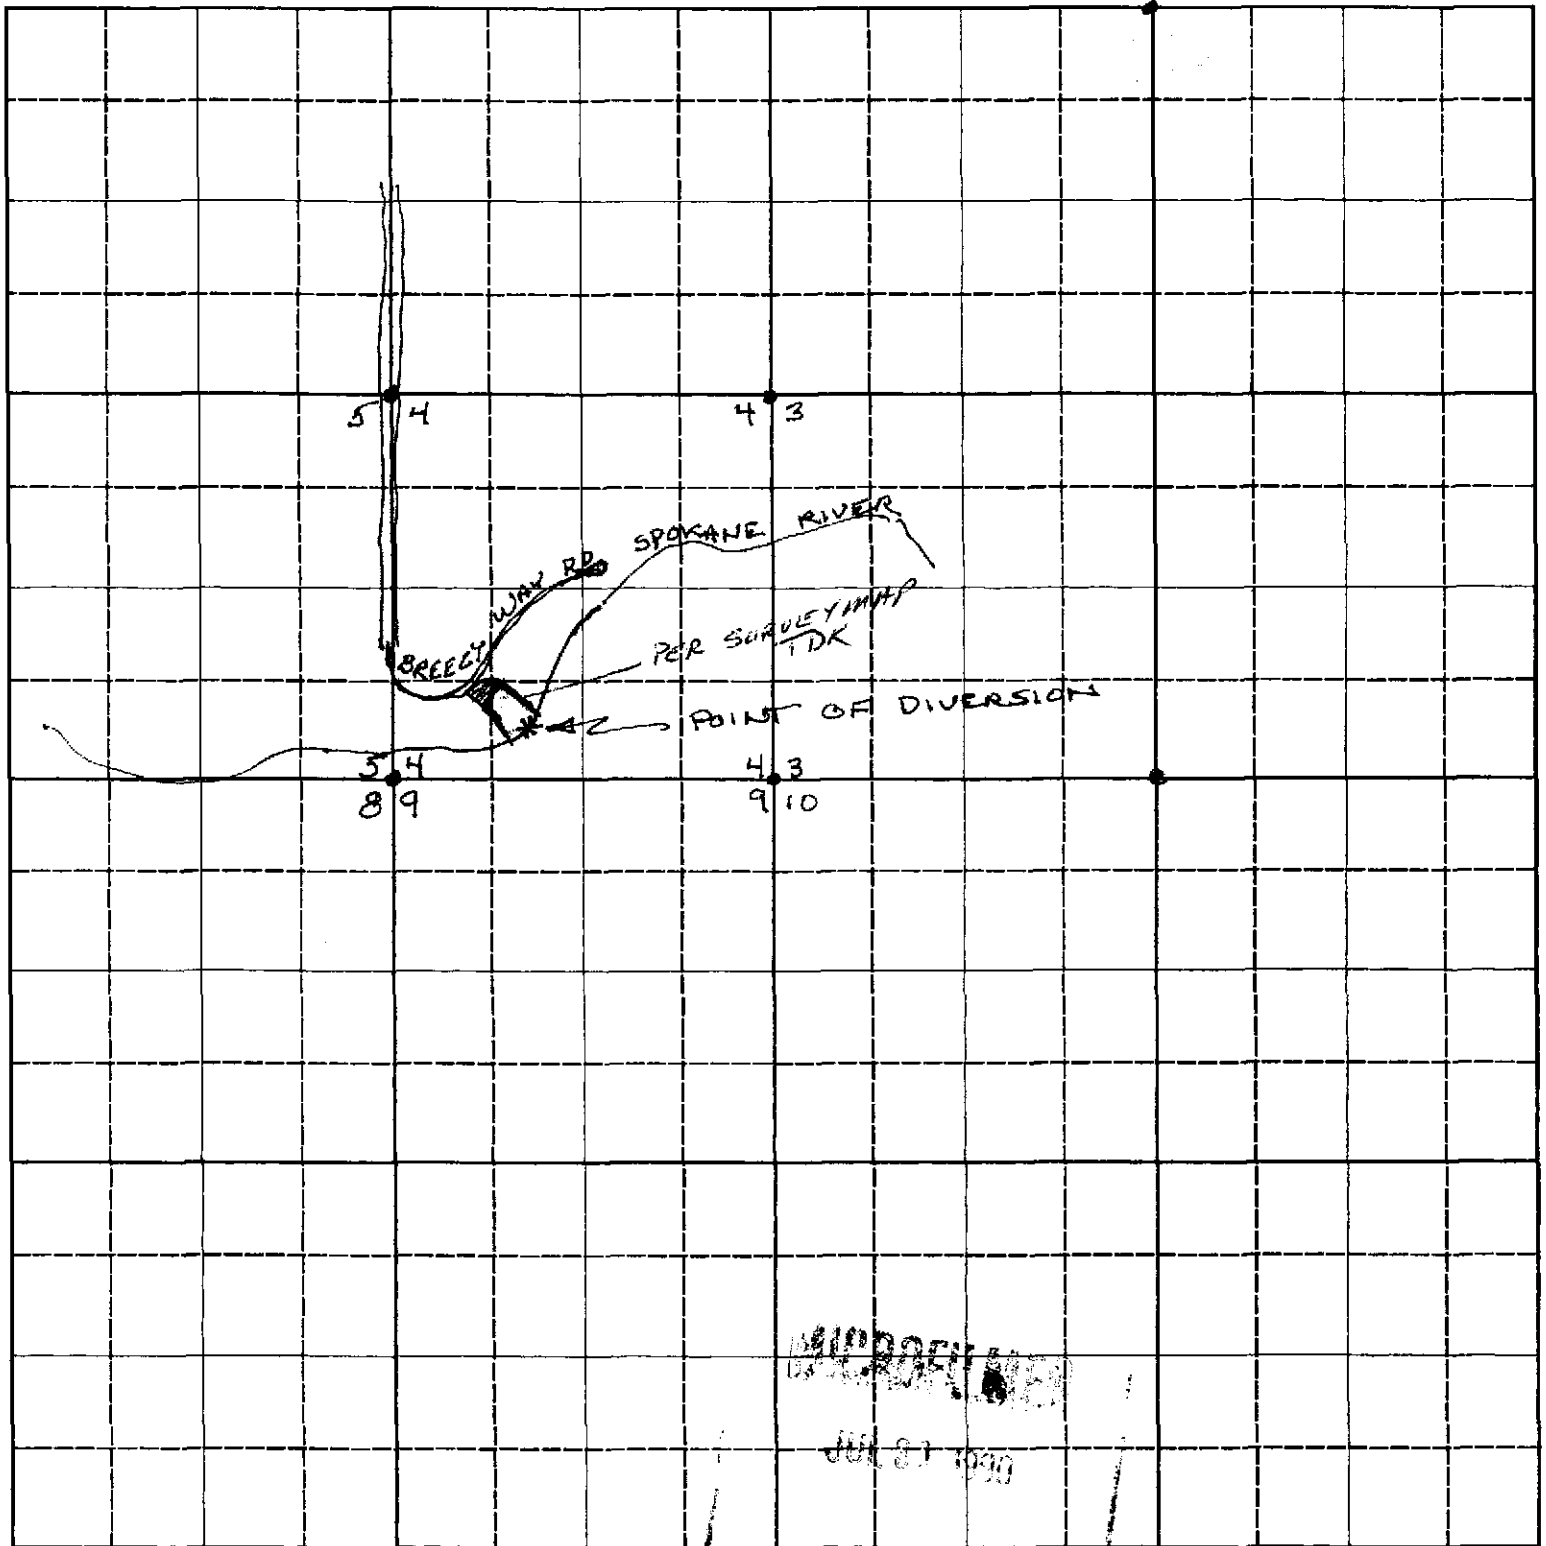

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Howard R. Justus
(Applicant)
Morris L. Justus

RECEIVED

JUL 31 1990

e. Other:

permit.

d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.

c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.

19

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

1. Approval of said application is subject to the following limitations and conditions:

Idaho No. _____, and said application is hereby _____

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

Received by Lee Date 4/10/90 Time 3:00 Preliminary check by TR
Fee \$ 30.00 Received by Lee # N-3651 Date 4/10/90
Publication prepared by pm Date 4/11/90 Published in Ground Water 4/19-20/90 6/14/90
Publication approved pm Date 4/30/90 6/21/90



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

December 13, 1995

HOWARD K JUSTUS
MAVIS L JUSTUS
W 2020 BREEZY WAY
POST FALLS ID 83854

RE: WATER RIGHT NO. 95-08648

Dear Water Right Holder(s):

Enclosed is a copy of the Water Right License issued on the above referenced permit. If you have any questions, please contact me within 10 days of receipt of this license.

Sincerely,

A handwritten signature in cursive script that reads "Shelley W. Keen".

Shelley W. Keen
Water Rights Supervisor

SK:rl

Enclosure

JAN 31 1996

LICENSE REVIEW CHECKLIST

PERMIT NO. 95-08648 DATE 11-30-95



NAME	Change	OK	Or Address Change?
PRIORITY DATE			Advance? _____ Advanced to: _____ Order to reinstate needed? _____ Incorrect fee for rate recommended? _____
SOURCE			Changes or just clarification of originally intended source? _____ Notice of Intent to Void necessary? _____
POINT OF DIV			Amendment needed? _____ Overlaps? <u>Neighbor</u>
PLACE OF USE			Amendment needed? _____ Overlaps? _____
DIV RATE			Permit/fee limits: <u>.04 CFS</u> Meas Q = _____ Theo Q = <u>.12</u> Recommend: <u>.04</u> <u>Adjusted theoretical capacity @ 70% efficiency.</u> <u>$2 \times .02 = .04$</u> Combined rates exceed capacity _____
ANNUAL VOLUME			Volume Limit: _____ Season: <u>D/3.0 (3-15 to 11-15)</u> Calculations: <u>$2 \times 3 = 6 AF$</u> Flow limit: _____ cfs x _____ x 1.9835 = _____ Combined volumes exceed capacity/allowable _____
USES			Change in Nature of Use or additional uses? _____ Amendment necessary? _____
ADDITIONAL INFO			Supplemental Groundwater _____ PPU Scenario _____ Irr/Dom Combination _____ Shared G/W System _____
NEW REMARKS			Multiple p/d(s) in $\frac{1}{4}$ $\frac{1}{4}$? _____ <u>YES</u> Other <u>plu located within lots 16, 17, 18 in the River Ranchettes Subdivision.</u>
NEW CONDITIONS			Watermaster control - District _____ Measuring/Locking Devices _____ <u>R29</u> Irrigation Overlap _____ Other _____ Water Quality _____ Heat/Cool/Fish verified _____

COMMENTS: _____

RECOMMENDATION	CFS	VOLUME	SRBA Claim Filed	
			Adjustment Memo Needed	<u>N/A</u>
<u>Irrigation</u>	<u>.04</u>	<u>6.0</u>		<u>YES</u>
			LICENSE	<u>✓</u>
			1ST AMEND LETTER	
			2ND AMEND LETTER	

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
AUG 29 1994

Department of Water Resources

A. GENERAL INFORMATION

Permit No.

95-08648

1. Owner: Howard K Justus

Phone No. (208) 773-7312

Current Address: W. 2020 Breezy Way, Post Falls, ID. 83854

2. Accompanied by: Mr. Justus

EXAM DATE: 6-16-94

Address: same

Phone No. same

Relationship to Permit Holder: owner

3. Source: Spokane

tributary to Columbia River

B. OVERLAP REVIEW

1. Other water rights with the same place of use: _____

2. Other water rights with the same point of diversion: 95-07461

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			SE	SW	4	50N	5W	Kootenai	U.S.G.S. Topo.,

2. Place(s) of Use:

Indicate Method of Determination U.S.G.S. Topo.,

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
50N	5W	4											01				01		2.0

JAN 31 1996

1998 11 31

2. Measurements: See: Theoretical Pump Efficiency Calculation sheet.


Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
None						

D. FLOW MEASUREMENTS

*Code to correspond with No. on map and aerial photo

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	A.O.S. m.f.h	2	6281	Sears	1 1/2" Model # 390-26100

Scale: 1" =
X Copy of USGS Quadrangle Attached (Showing location(s) of point(s) of diversion and place(s) of use (required).
X Aerial Photo Attached (required for irrigation of 10+ acres)
X Photo of Diversion and System Attached

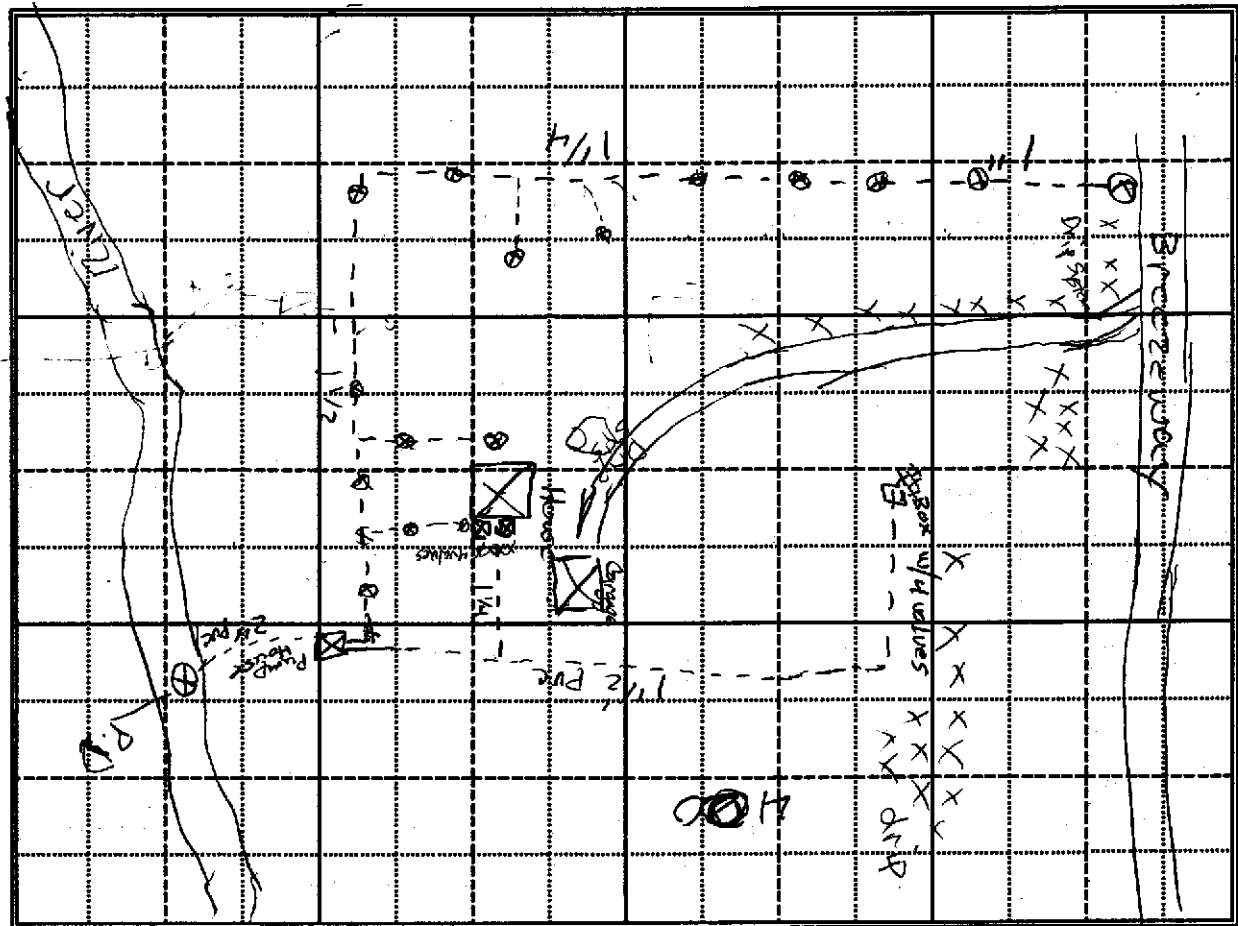

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate well size/ditch size/pipe l.d. as applicable.

Pump system Reduce to 20 lbs pressure

E. NARRATIVE/REMARKS/COMMENTS

* River was low this day. So, I couldn't take measurements from Mr. Sustus system.

There is 8 sections with 40 sprinklers total.

Have conditions of permit approval been met? ☒ yes ☐ no

APPROVED
JAN 31 1996

F. FLOW CALCULATIONS

Measured Method:

Additional Computation Sheets Attached

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{IR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 2 \times 3.5 = 7 \text{ AFA}$$

$$V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .04 \times 245 \times 1.9835 = 19.44$$

$$V = \text{Smaller of } V_{IR} \text{ and } V_{DR} = 7 \text{ ac.}$$

2. Volume Calculations for Other Uses:

$$4100' \times 2.25' = 9000' / 413560 = 2.07 \text{ ac. irrigated.}$$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use

Irrigation

Period of Use

From 03-15 To 11-15

Rate of Diversion

Q (cfs) .04

Annual Volume

V (afa) 7.0

2. Recommended Amendments

Change P.D. as reflected above
Change P.U. as reflected above

Add P.D. as reflected above
Add P.U. as reflected above
None
Other

I. AUTHENTICATION

Field Examiner's Name

Don M. Kunz

Date

Date

Reviewer

SEAL

* All calculations made. BG

JUN 8 1995

MEMORANDUM

TO: File 95-08648 / Howard Justus
FROM: Brenda Chapman
DATE: November 30, 1995
RE: Recommendation Adjustment(s)

=====

The final licensing recommendations for Right 95-08648 are based on the information below:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use	Rate of Div	Annual Vol
Irrigation	3-15 to 11-15	.04	6.0

The volume has been changed to the current recommended estimate of the consumptive irrigation requirement for crops and lawns in that area. [3.0 afa per acre]

RECEIVED
NOV 30 1995
1041 21 1000

THEORETICAL PUMP EFFICIENCY CALCULATIONS

FILE: 95-08648

DATE: 9-AUG-94

COMPLETE BY: JON M. KUNZ

HORSEPOWER = 2

PUMP EFFICIENCY = 75%

DYNAMIC LIFT = 12 FEET

SYSTEM PRESSURE = 40 PSI

QUANTITY = 0.13 CFS

RECEIVED
JAN 31 1995

5288000mN

22

5287


5286

5285

42°30'

5283

5282

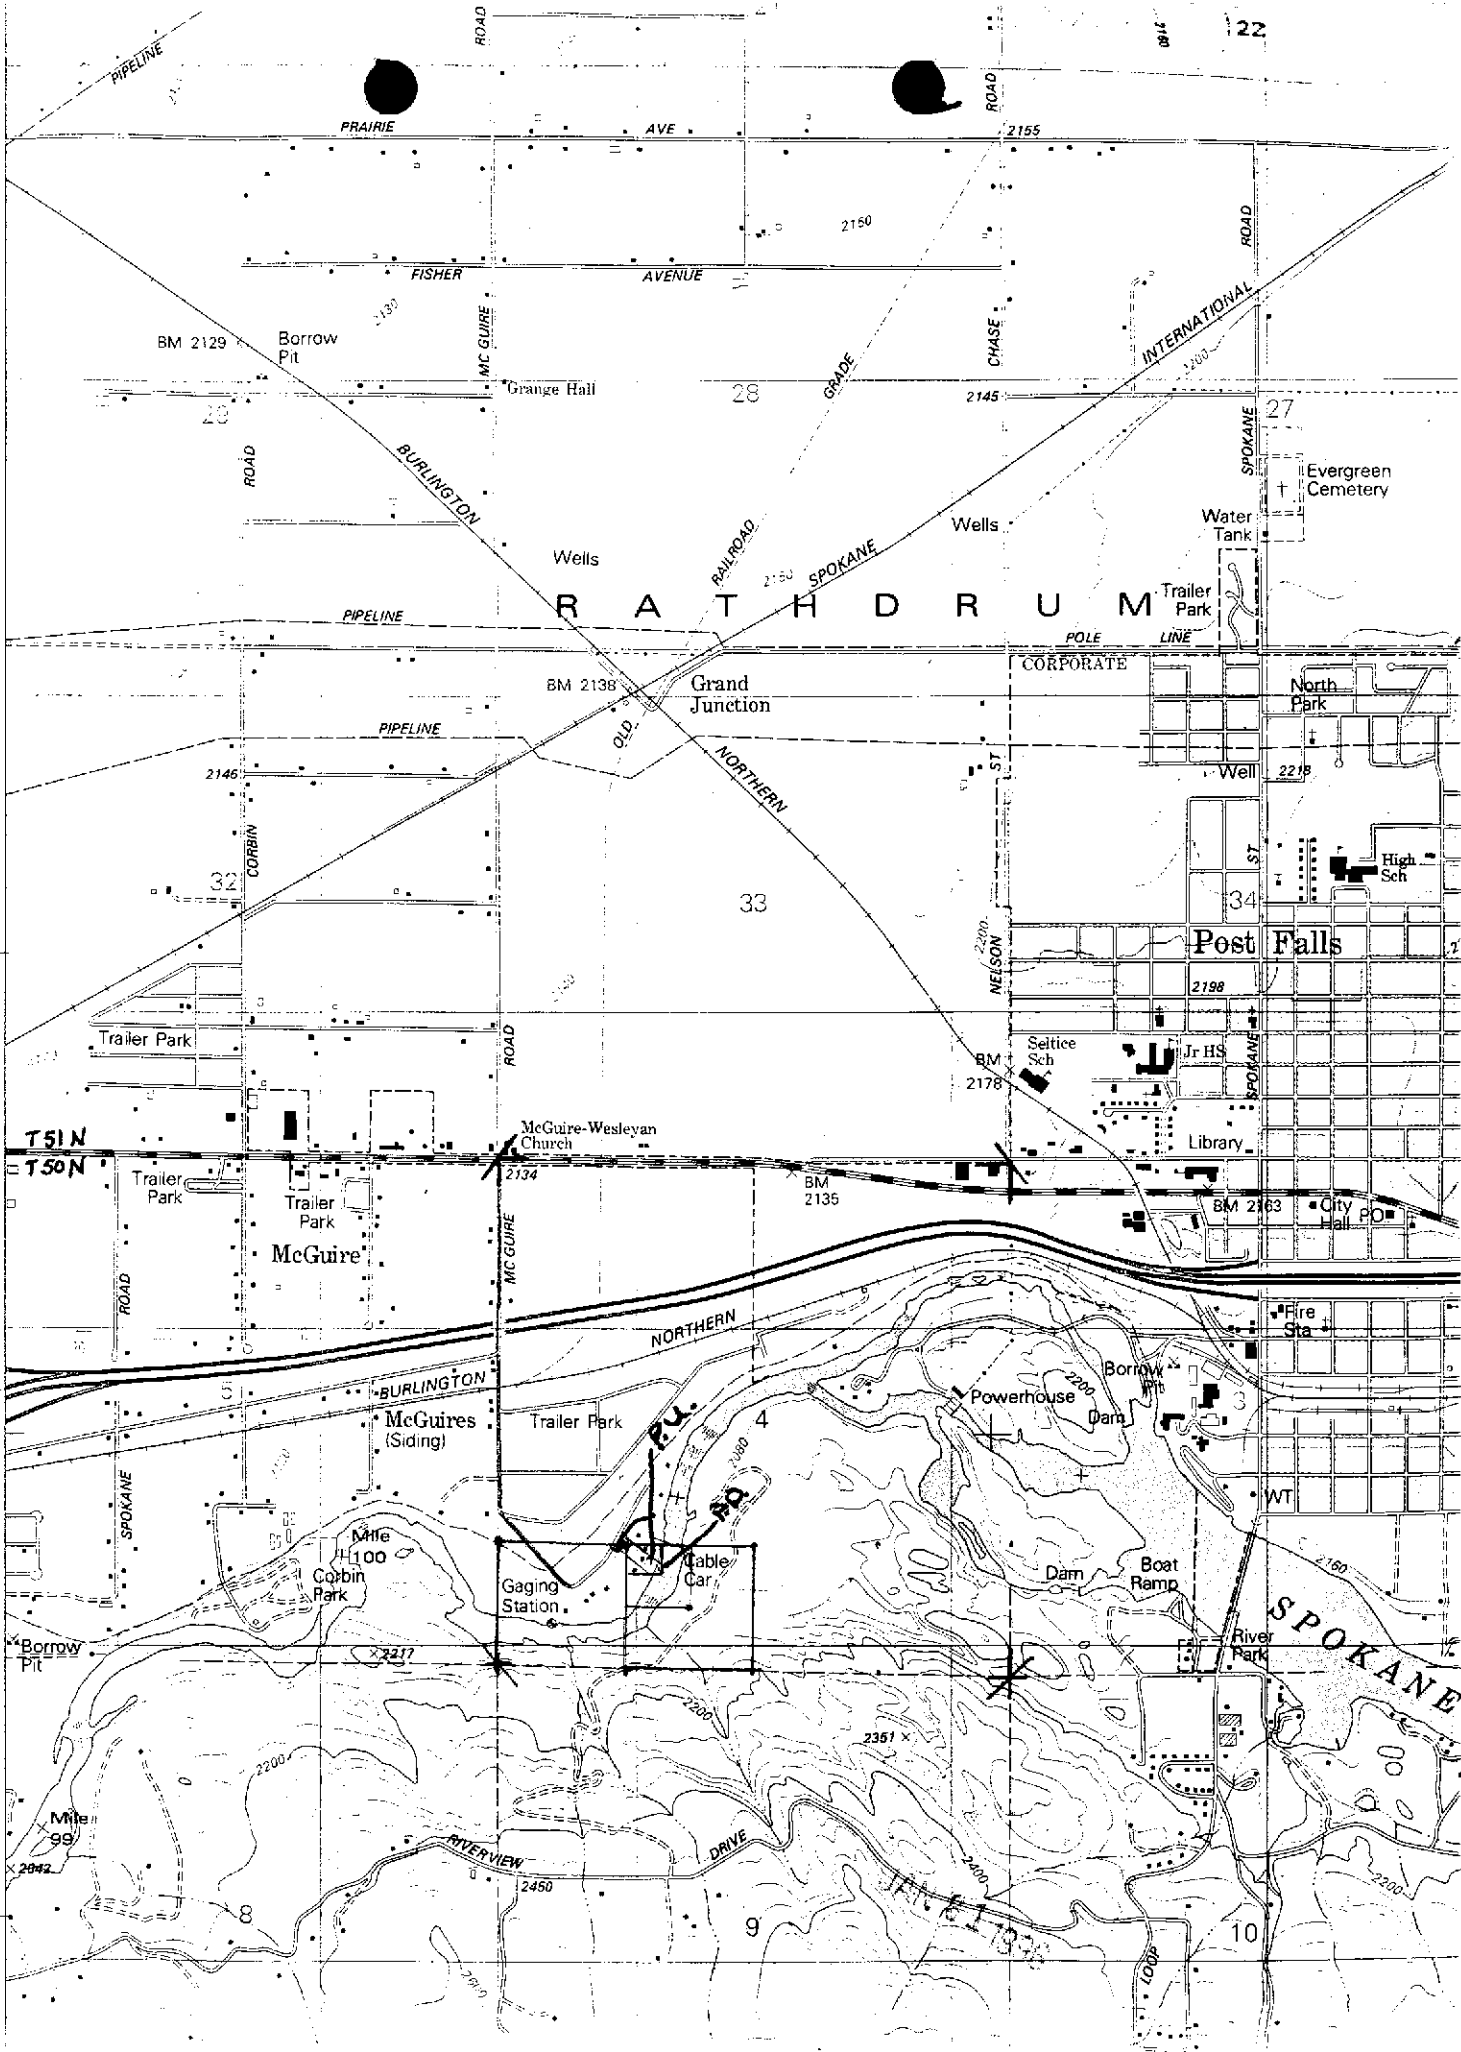


#95-08648

Mr. Justus
Home

Mr. Justus
P.D.

Mr. Justus
Pumphouse

JAN 21 1995

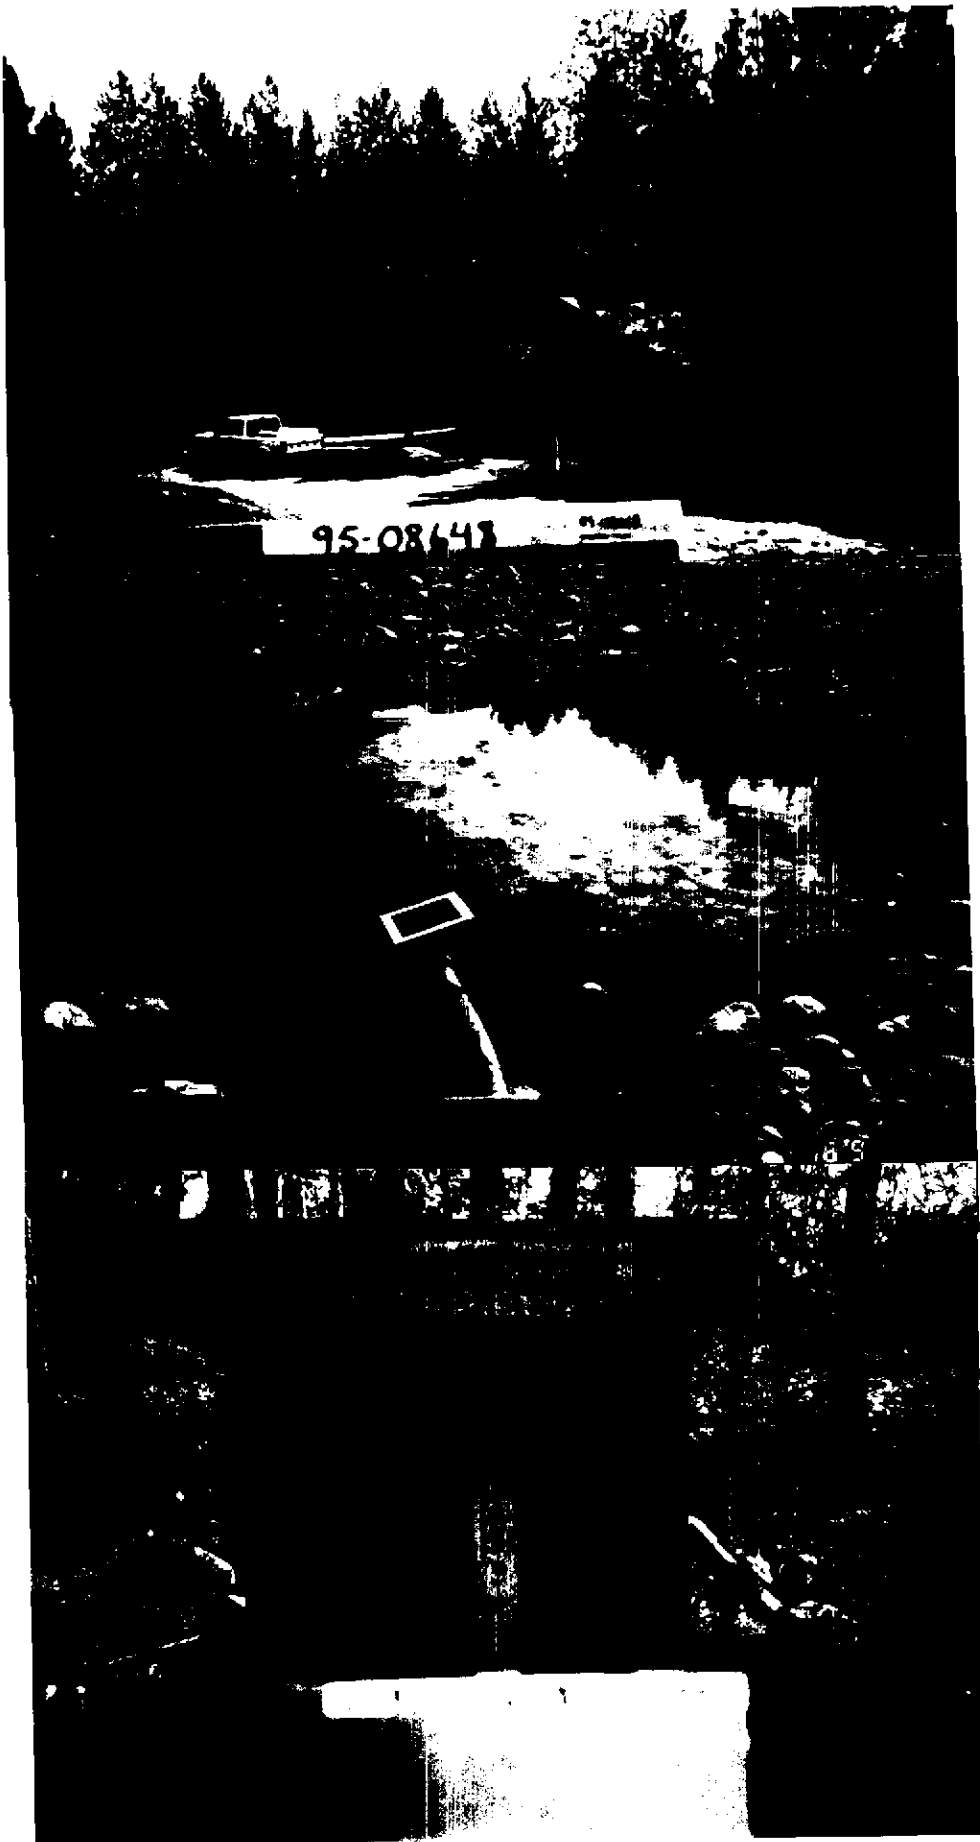



95-08648
Mr. Justus
P. U. Irr.



Mr. Justus
P. U. for Irr.



RECORDED
JAN 81 1995

June 11, 1993

HOWARD K. JUSTUS
MAVIS L. JUSTUS
W. 2020 BREEZY WAY
POST FALLS ID 83854

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 95-08648

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the NORTHERN Regional Office in Coeur D' Alene at (208)765-4639.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

c: IDWR - Region

RECEIVED
JUL 07 1993

May 31, 1993

HOWARD K. JUSTUS
MAVIS L. JUSTUS
W. 2020 BREEZY WAY
POST FALLS ID 83854

PROOF DUE NOTICE

RE: PERMIT NO. 95-08648

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before August 1, 1993. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.


If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Karen L. Gustafson
Secretary/Records Manager

Enclosures

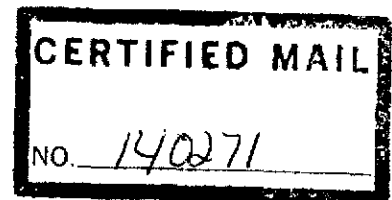

RECEIVED

JUL 07 1993

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
COMMENCEMENT OF WORKS

Permit No. P 95-08648
Name(s) of Permit Holder(s): HOWARD K. & MAVIS L. JUSTUS
Post Office Address: W 2020 BREEZY WAY, POST
FALLS, ID. 83854 Tel. No. 773 7312

☒ I hereby certify that construction of diversion works for the above referenced permit began on AUG. 15 1990 (date). I understand that I must continue to develop the water system with **MODIFIED** in a valid permit.


☐ I hereby certify that construction of diverting works on the above referenced project has not yet begun due to the following reason beyond my control*: JUL 07 1993

*Note: A financing difficulty is not an acceptable reason.

9/1/90
Date

Howard K. Justus
Signature of Permit Holder

H K. J. [unclear]
W 2020 BREEZY WY
POST FALLS, ID 83254



RECEIVED
SEP 7 1990



Idaho Resources
Department of Water
STATEHOUSE
BOISE, IDAHO 83720



UNPROCESSED

07 1993

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

Statehouse
Boise, Idaho 83720
(208) 327-7900
July 27, 1990

HOWARD K. JUSTUS
MAVIS L. JUSTUS
W. 2020 BREEZY WAY
POST FALLS, ID 83854

PERMIT APPROVAL NOTICE

RE: PERMIT NO. P95-08648

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Please note the requirement that as a permit holder you must commence the excavation or construction of diverting works within one year of the date the permit was issued, and you must proceed diligently until the project is completed. The enclosed blue card must be completed and returned to this office as soon as you commence construction, no later than one year from the date the permit was approved.

We have enclosed a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit into a license.

Sincerely,

GARY SPACKMAN, Supervisor
Water Right Permits Section

GS: SC
Enclosures

MICROFILMED
JUL 31 1990

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
County of Kootenai,

Julie Jacobs being first duly sworn
upon oath deposes and says:

1. I am now and at all times hereinafter mentioned was a citizen of the United States, resident of the State of Idaho, over the age of twenty-one years and not a party of the above entitled action.

2. I am now and at all times hereinafter mentioned was the printer (principal clerk) of the "Coeur d'Alene Press," a newspaper printed and published daily except Sunday in Coeur d'Alene, Kootenai County, Idaho, and having a general circulation in said county.

3. The *Legal Notice*

of which the annexed is a printed copy, was published in the regular *Thurs* issue of said newspaper for *2* consecutive *weeks* commencing on the *7th* day of *June*, 19 *90* and ending on the *14th* day of *June*, 19 *90*, and such publication was made as often during said period as said *Daily* newspaper was regularly issued.

4. That said newspaper has been continuously and uninterruptedly published in said Kootenai County, during a period of more than seventy-eight consecutive weeks immediately prior to the first publication of said notice *Julie Jacobs*

Subscribed and sworn to before me this *14th* day of *June*, 19 *90*.

Roberta Drankley
Notary Public for the State of Idaho,
residing at Coeur d'Alene, Idaho.

2-3-93

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

95-08648

JUSTUS, HOWARD K.

JUSTUS, MAVIS L.

W. 2020 BREEZY WAY

POST FALLS, ID 83854

Source: SPOKANE RIVER Tributary:
COLUMBIA RIVER

Diversion Pt: SESW Sec 4 T 50N R 06W

Use: IRRIGATION (.040 CFS)

Total Diversion: (.040 CFS)

Date Filed: 4/10/1990

In: T50N R05W S04 SESW SWSE

2.0 ACRES TOTAL

98-08593

SILVERWOOD, INC.

N. 26225 HWY. 95

ATHOL, ID 83801

Source: GROUNDWATER

Diversion Pt: SESE Sec 28 T 53N R 03W

Use: COMMERCIAL (.800 CFS)

Total Diversion: (.800 CFS)

Date Filed: 4/5/1990

In: T53N R03W S28 SENE NESE NWSE
SWSE SESE


For additional information concerning the property location, call the Northern Regional Office at 765-4639.

The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Northern Region, 1910 Northwest Blvd., Suite 210, Coeur d'Alene, Idaho 83814 on or before June 25, 1990.

R. KEITH HIGGINSON, Director

Legal 914

June 7, 14, 1990

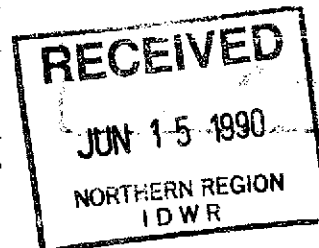

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
County of Kootenai,

} ss.

Julio Jacobs

being first duly sworn
upon oath deposes and says:

1. I am now and at all times hereinafter mentioned was a citizen of the United States, resident of the State of Idaho, over the age of twenty-one years and not a party of the above entitled action.

2. I am now and at all times hereinafter mentioned was the printer (principal clerk) of the "Coeur d'Alene Press," a newspaper printed and published daily except Sunday in Coeur d'Alene, Kootenai County, Idaho, and having a general circulation in said county.

3. The

Legal Notice

of which the annexed is a printed copy, was published in the regular *Sat.* issue of said newspaper for *2* consecutive *weeks* commencing on the *14th* day of *April*, 19*90*, and ending on the *21st* day of *April*, 19*90*, and such publication was made as often during said period as said *Daily* newspaper was regularly issued.

4. That said newspaper has been continuously and uninterruptedly published in said Kootenai County, during a period of more than seventy-eight consecutive weeks immediately prior to the first publication of said notice.

Julio Jacobs

Subscribed and sworn to before me this *21st* day of *April*, 19*90*.

Roberta Manley

Notary Public for the State of Idaho,
residing at Coeur d'Alene, Idaho.

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

95-08648

JUSTUS, HOWARD K.

JUSTUS, MAVIS L.

W. 2020 BREEZY WAY

POST FALLS, ID 83854

Source: SPOKANE RIVER Tributary:
COLUMBIA RIVER

Diversion Pt: SESW Sec 4 T 50N R 05W

Use: IRRIGATION (.040 CFS)

Total Diversion: (.040 CFS)

Date Filed: 4/10/1990

In: T50N R05W S04 SESW *SWSE*

2.0 ACRES TOTAL

96-08593

SILVERWOOD, INC.

N. 26225 HWY. 95

ATHOL, ID 83801

Source: GROUNDWATER

Diversion Pt: SESE Sec 28 T 53N R 03W

Use: COMMERCIAL (.800 CFS)

Total Diversion: (.800 CFS)

Date Filed: 4/5/1990

In: T53N R03W S28 SENE NESE NWSE

SWSE SESE

For additional information concerning the property location, call the Northern Regional Office at 765-4639.

The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Northern Region, 1910 Northwest Blvd., Suite 210, Coeur d'Alene, Idaho 83814 on or before MAY 7, 1990.

R. KEITH HIGGINSON, Director

Legal 703

Apr. 14, 21, 28, May 5, 1990

RECEIVED

RECEIVED

APR 24 1990

NORTHERN REGION
IDWR

2-3-93

JUL 21 1990

who copy all dates will be collected

This will be
re-adv. on 6/7 & 14/90
with charge included
at no charge because
paper covered up
dates of advertising.

pm
5/22/90

No charge.

95-08648

JUSTUS, HOWARD K.
JUSTUS, MAVIS L.
W. 2020 BREEZY WAY
POST FALLS, ID 83854

Source: SPOKANE RIVER

Tributary: COLUMBIA RIVER

Diversion Pt: SESW Sec 4 T 50N R 05W

Use: IRRIGATION (.040 CFS)

Total Diversion: (.040 CFS)

Date Filed: 4/10/ 1990

In: T50N R05W S04 SESW

2.0 ACRES TOTAL

MICROFILMED

JUL 31 1990

MEMORANDUM

TO: FILE

VIA: Robert Haynes - Manager, Northern Regional office.

FM: Tom King - Sr. Water Resource Agent, Northern Region TDK

Date: May 8, 1990

SUBJECT: Re-advertisement of 95-08648

=====

According to the survey plat the place of use should be one acre of irrigation within the SW SE 1/4 and one acre within the SE SW 1/4. Please re-advertise accordingly.

REPROFILMED

JUL 31 1990

RECEIVED

APR 19 1990

Department of Water Resources

STANLEY F. HAMILTON
DIRECTORBOARD OF LAND
COMMISSIONERSCECIL D. ANDRUS
GovernorPETE T. CENARRUSA
Secretary of StateJIM JONES
Attorney GeneralJ.D. WILLIAMS
State AuditorJERRY L. EVANS
Supt. of Public
Instruction

April 18, 1990

TO: Department of Water Resources
Northern Region

FROM: Bryce D. Taylor
Leasing Specialist

RE: 95-8648 - Justus
96-S-200-Cliff Hohman

95-8648 - This department has no objection to the application for a permit filed by the Justus's. However, if the pump and/or pipeline are to be installed below the ordinary high water mark, they should file for a stream alteration permit. The stream alteration permit, when issued, should contain a term that says "This permit also constitutes a permit from the Department of Lands".

96-S-200 - Brickel Creek is not a navigable creek. Does not require a permit from Lands.

Bryce
BDT:lr

**MICROFILMED**

JUL 31 1990



State of Idaho

DEPARTMENT OF WATER RESOURCES

NORTHERN REGION, Suite 210 • 1910 Northwest Blvd. • Coeur d'Alene, Idaho 83814 • (208) 765-4639

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

April 12, 1990

Idaho Dept. of Lands
Statehouse
Boise, Id. 83720

Re: 95-8648

Gentlemen:

Enclosed is a recent filing with this Department that may be of interest to
your Agency.

Sincerely,

TOM D. KING
Sr. Water Resource Agent

Enclosure

MICROFILMED

JUL 31 1990

