



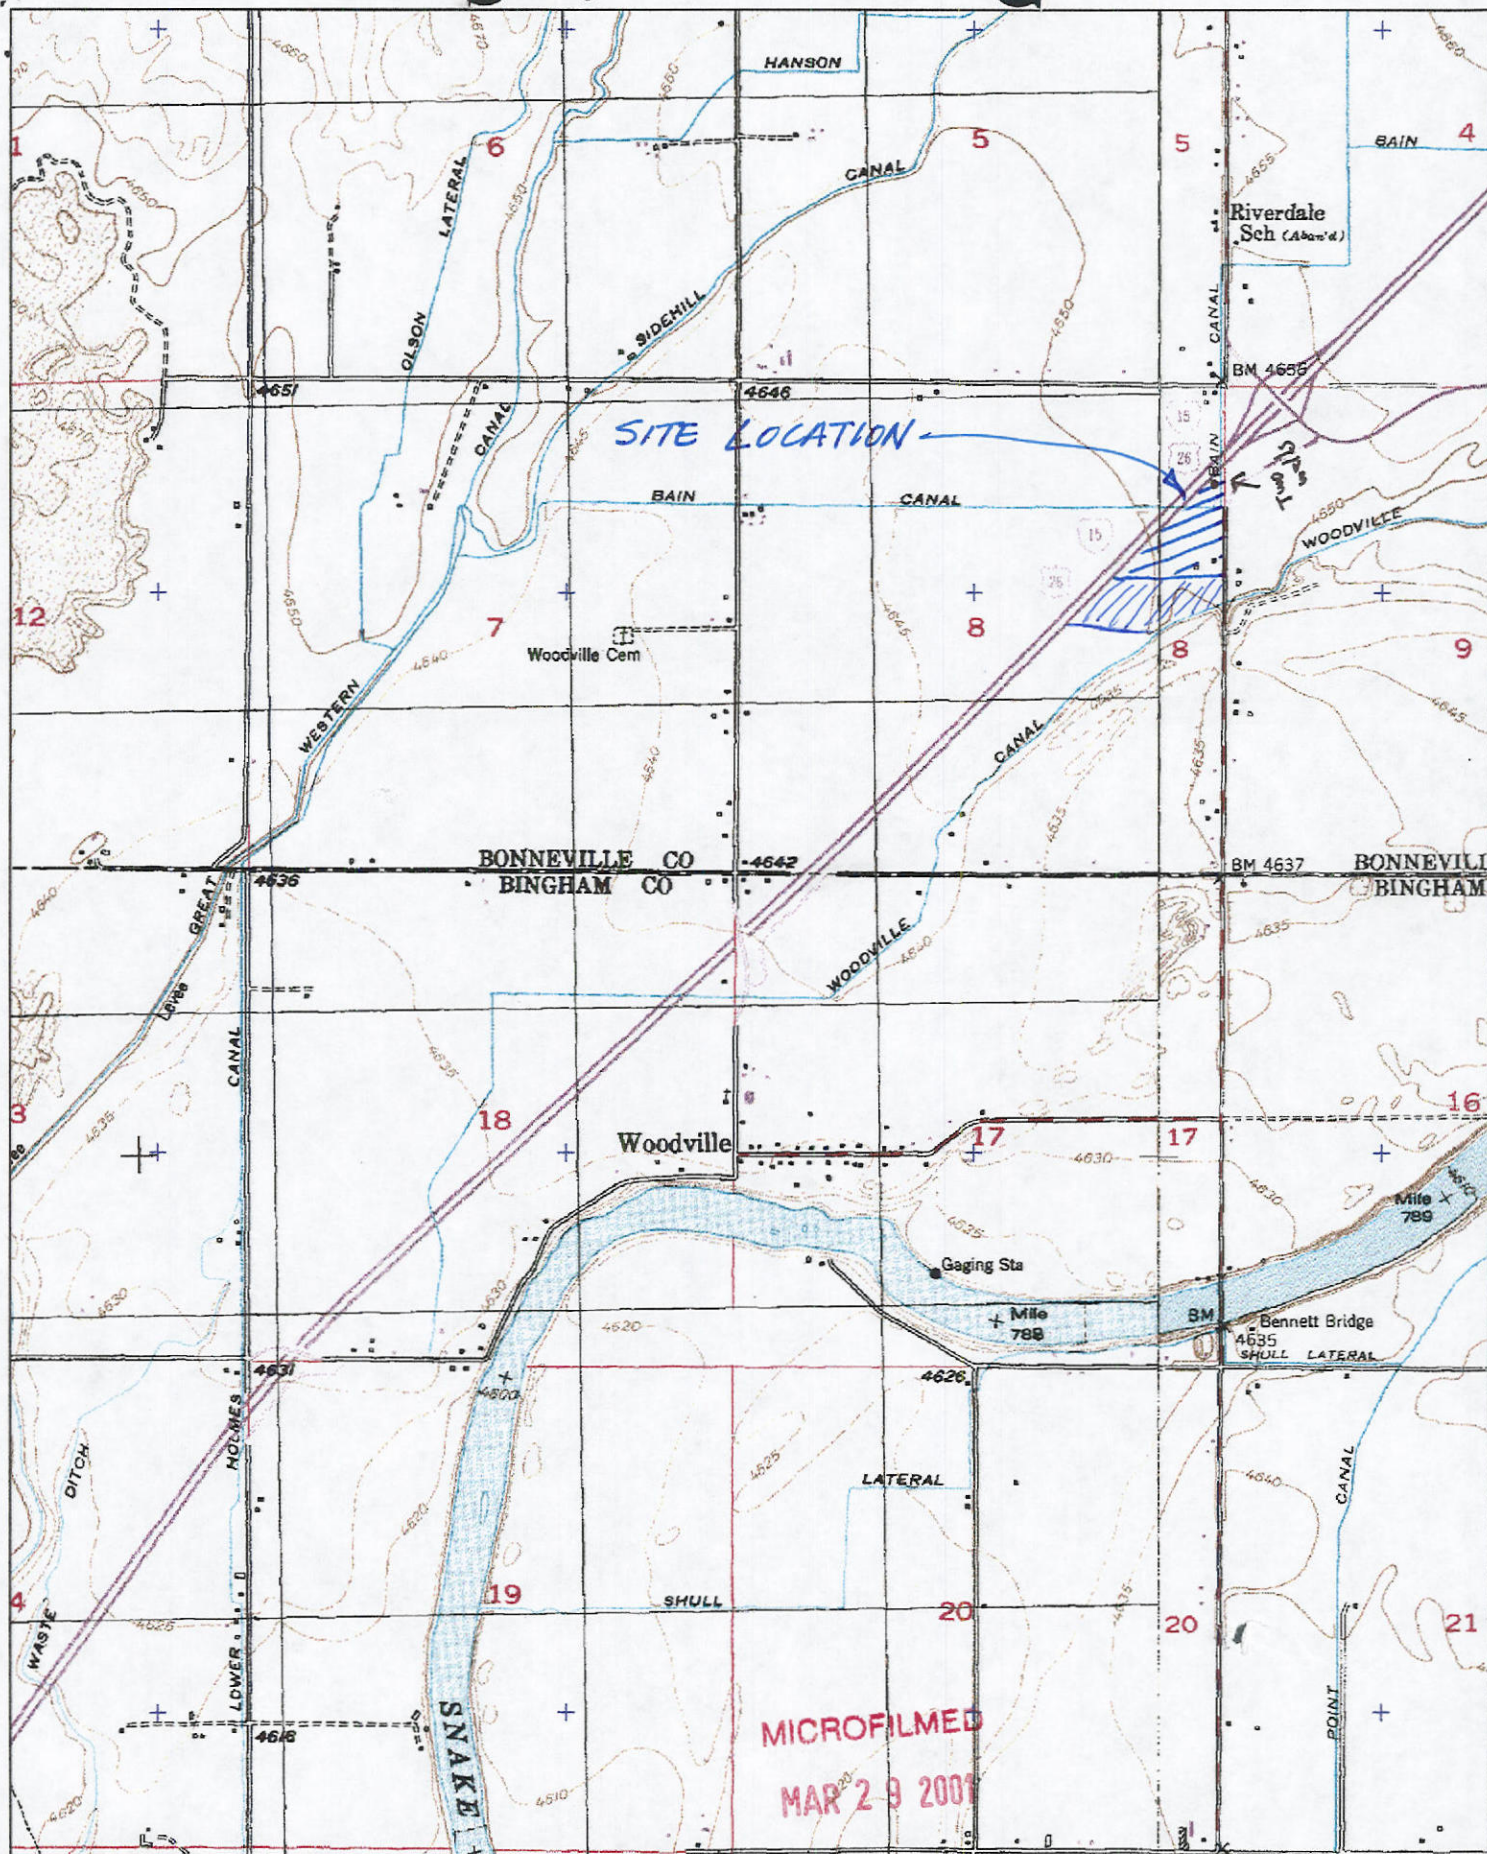


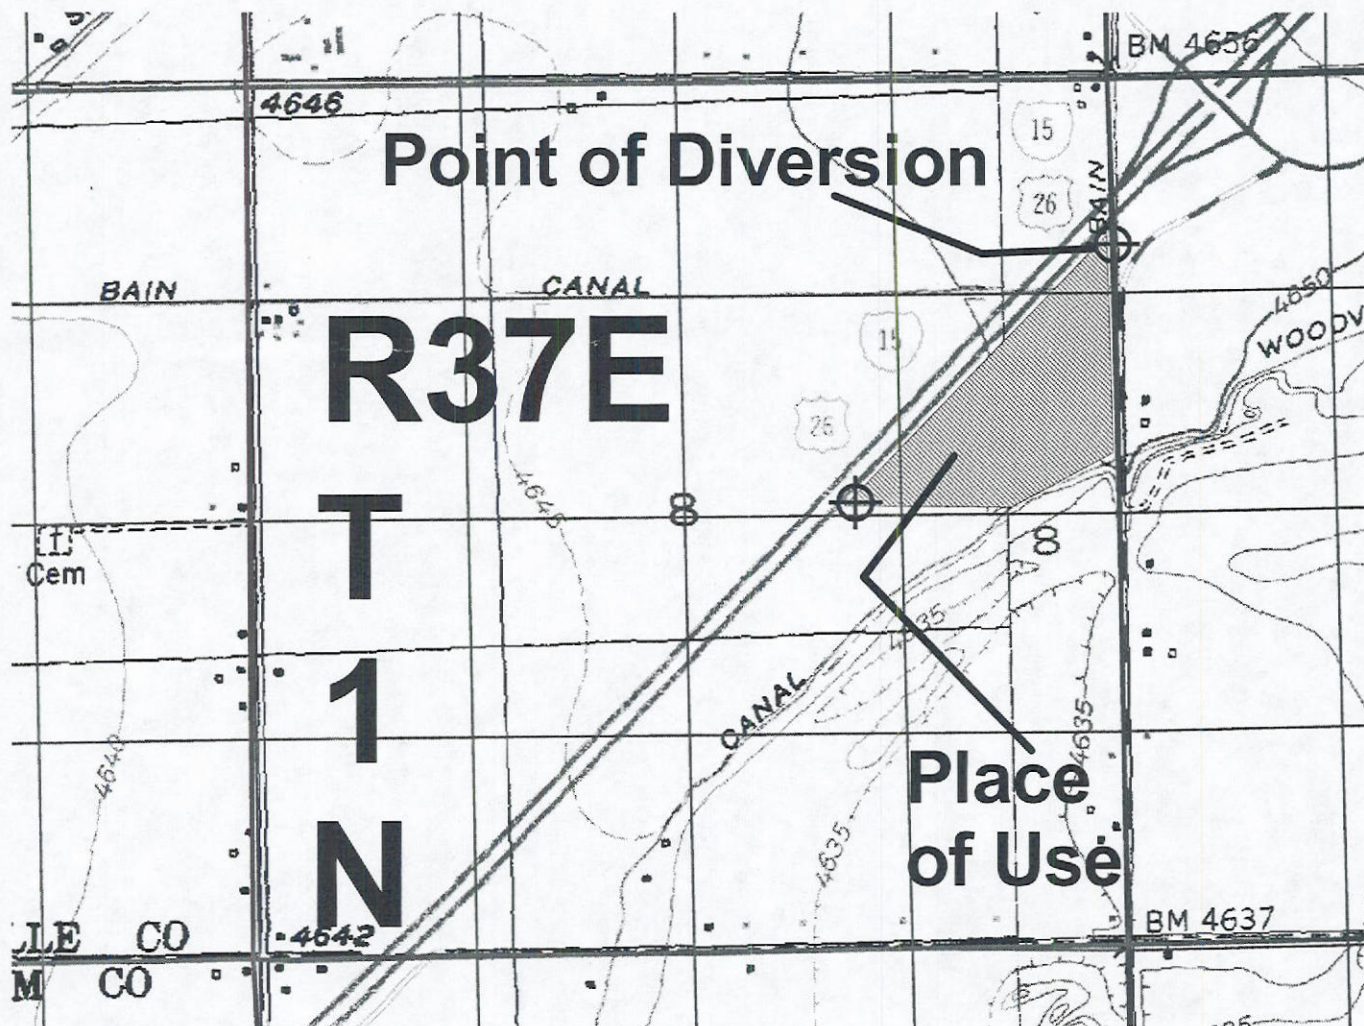

Model 6CLC 160 GPM

Domestic Pump Curve

GOULDS PUMPS

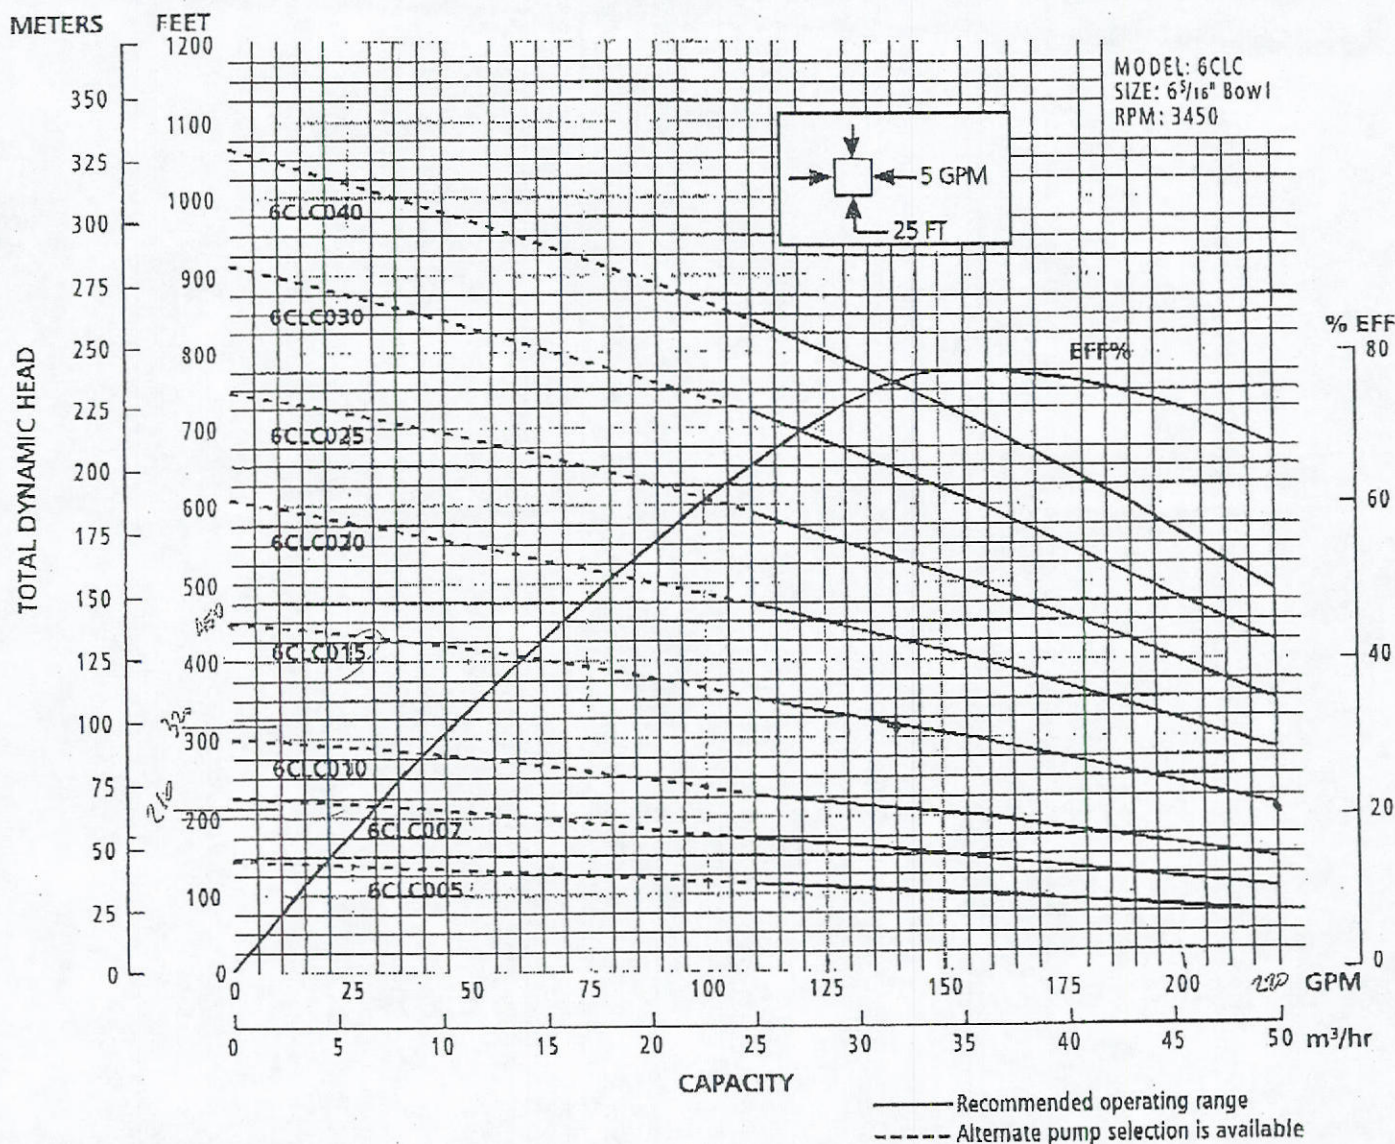

DIMENSIONS AND WEIGHTS


HP	Stages	W.E. Order Number	W.E. Length	W.E. Wt. (lbs.)
5	2	6CLC00544CTS	22 1/2	67
		6CLC00564CTS	24 3/4	72
7 1/2	3	6CLC00744CTS	27 1/2	84
		6CLC00764CTS	29 1/4	90
10	4	6CLC01064CTS	34 1/4	106
15	5	6CLC01564CTS	40	123
20	7	6CLC02064CTS	50 1/4	157
25	9	6CLC02564CTS	60 1/2	191
30	10	6CLC03064CTS	65 1/4	208
40	12	6CLC04064CTS	75 1/4	242

(All dimensions in inches and weights in lbs. Do not use for construction purposes.)

PLEASE NOTE:

- For alternate pump selection, consult factory.
- Solid line is recommended operating range. The dotted line (---) signifies an alternate pump selection is available.
- Please specify all options changes in W.E. order number.

4" NPT DISCHARGE CONNECTION

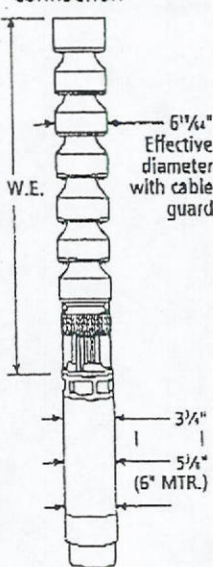

MATERIALS OF CONSTRUCTION

Part Name	Material
Shaft	ASTM A582 TYPE 416
Coupling	ASTM A582 S41600 CD
Suction Adapter	Ductile Iron ASTM A536
Discharge Bowl	ASTM A48 CL 30B
Rubber Bearings	RUBBER
Optional Bronze Bearings	ASTM B584
Discharge Bowl Bearing	ASTM B584
Taperlocks	ASTM A108 GR 101B
Bowl	ASTM A48 CL 30B
Upthrust Collar	Polyethylene
Impeller	ASTM B584
Fasteners	SAE J429 GR 8
Cable Guard	ASTM A240 S 30400
Suction Strainer	ASTM A240 S 30400

35-13285

JAN 09 2003

Performance Curves


150 GPM

Model 150S

FLOW RANGE: 30 -220 GPM

OUTLET SIZE: 3" NPT

NOMINAL DIA. 6"

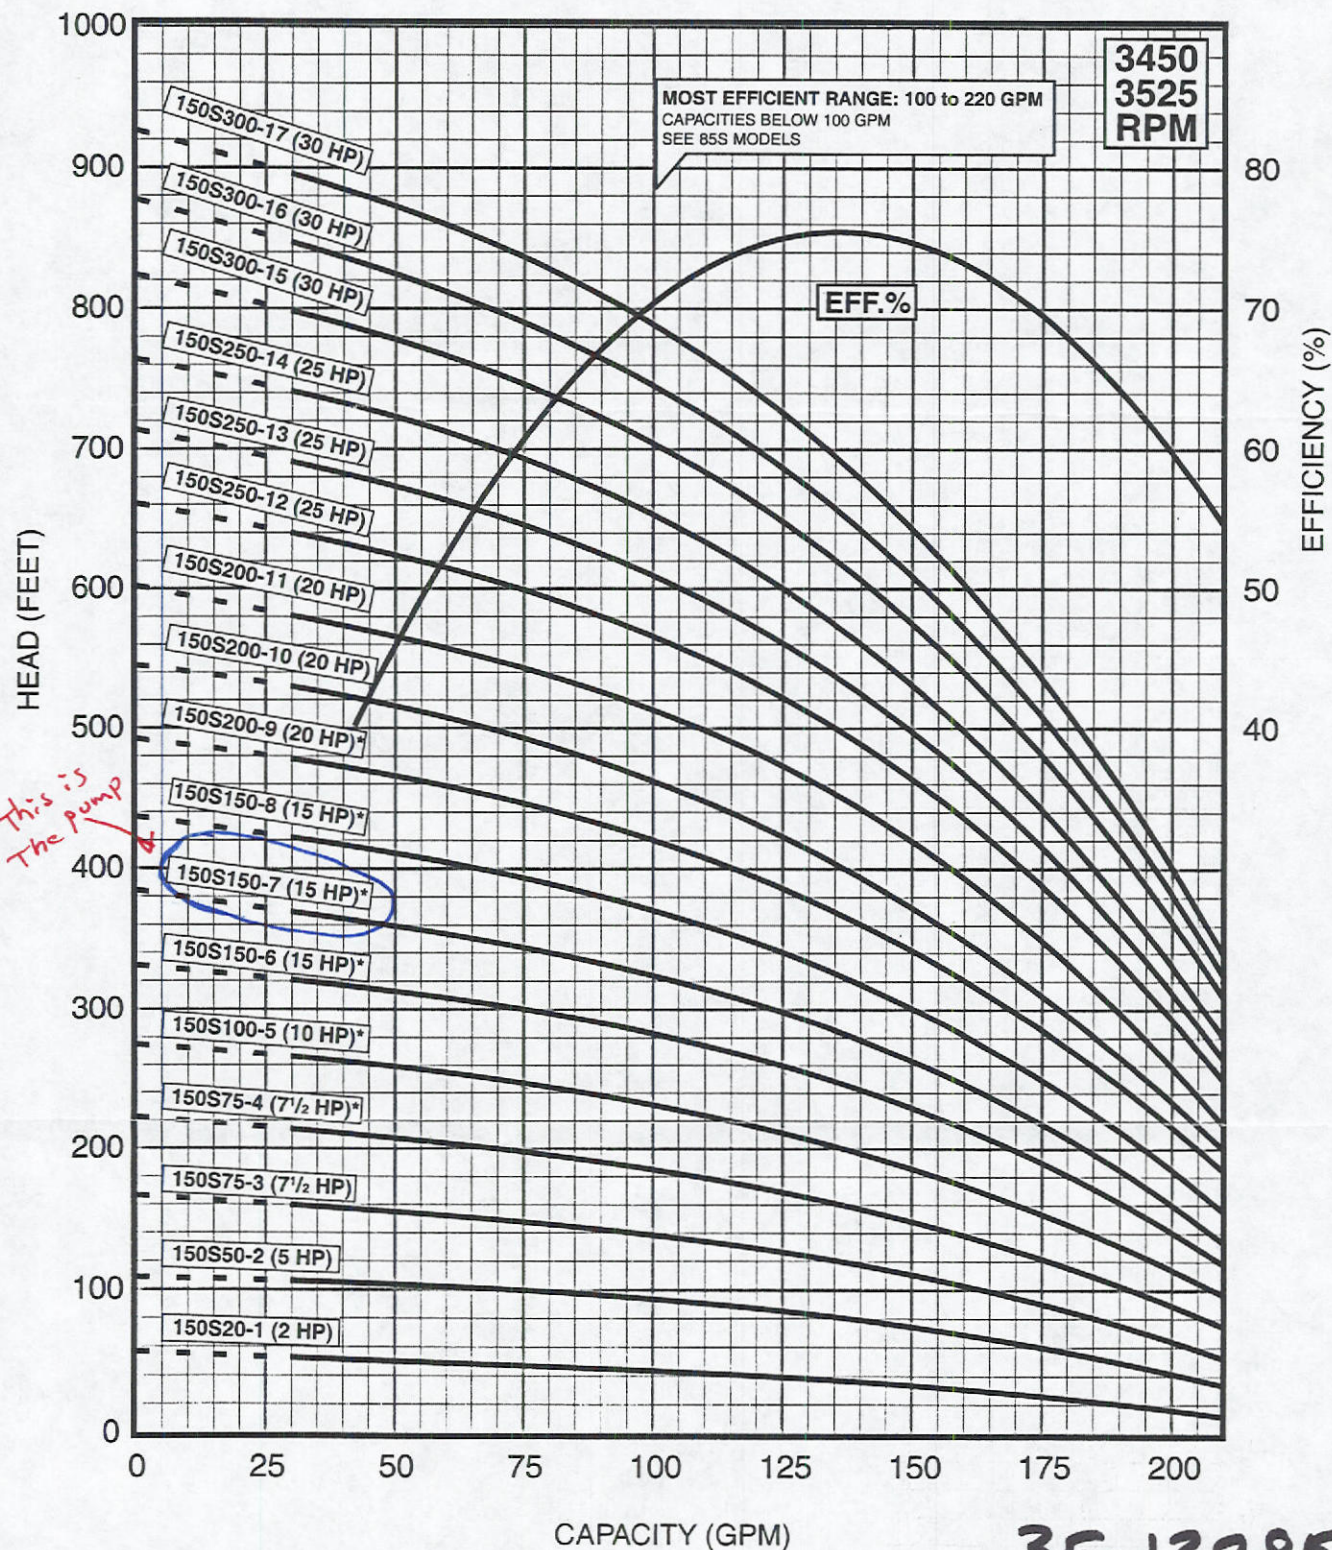

SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE.


4" MOTOR STANDARD, 2-10 HP/3450 RPM.

6" MOTOR STANDARD, 7.5-60 HP/3450 RPM.

8" MOTOR STANDARD, 75 HP/3525 RPM.

* Alternate motor sizes available.

Performance conforms to ISO 2548 Annex B
@ 5 ft. min. submergence.

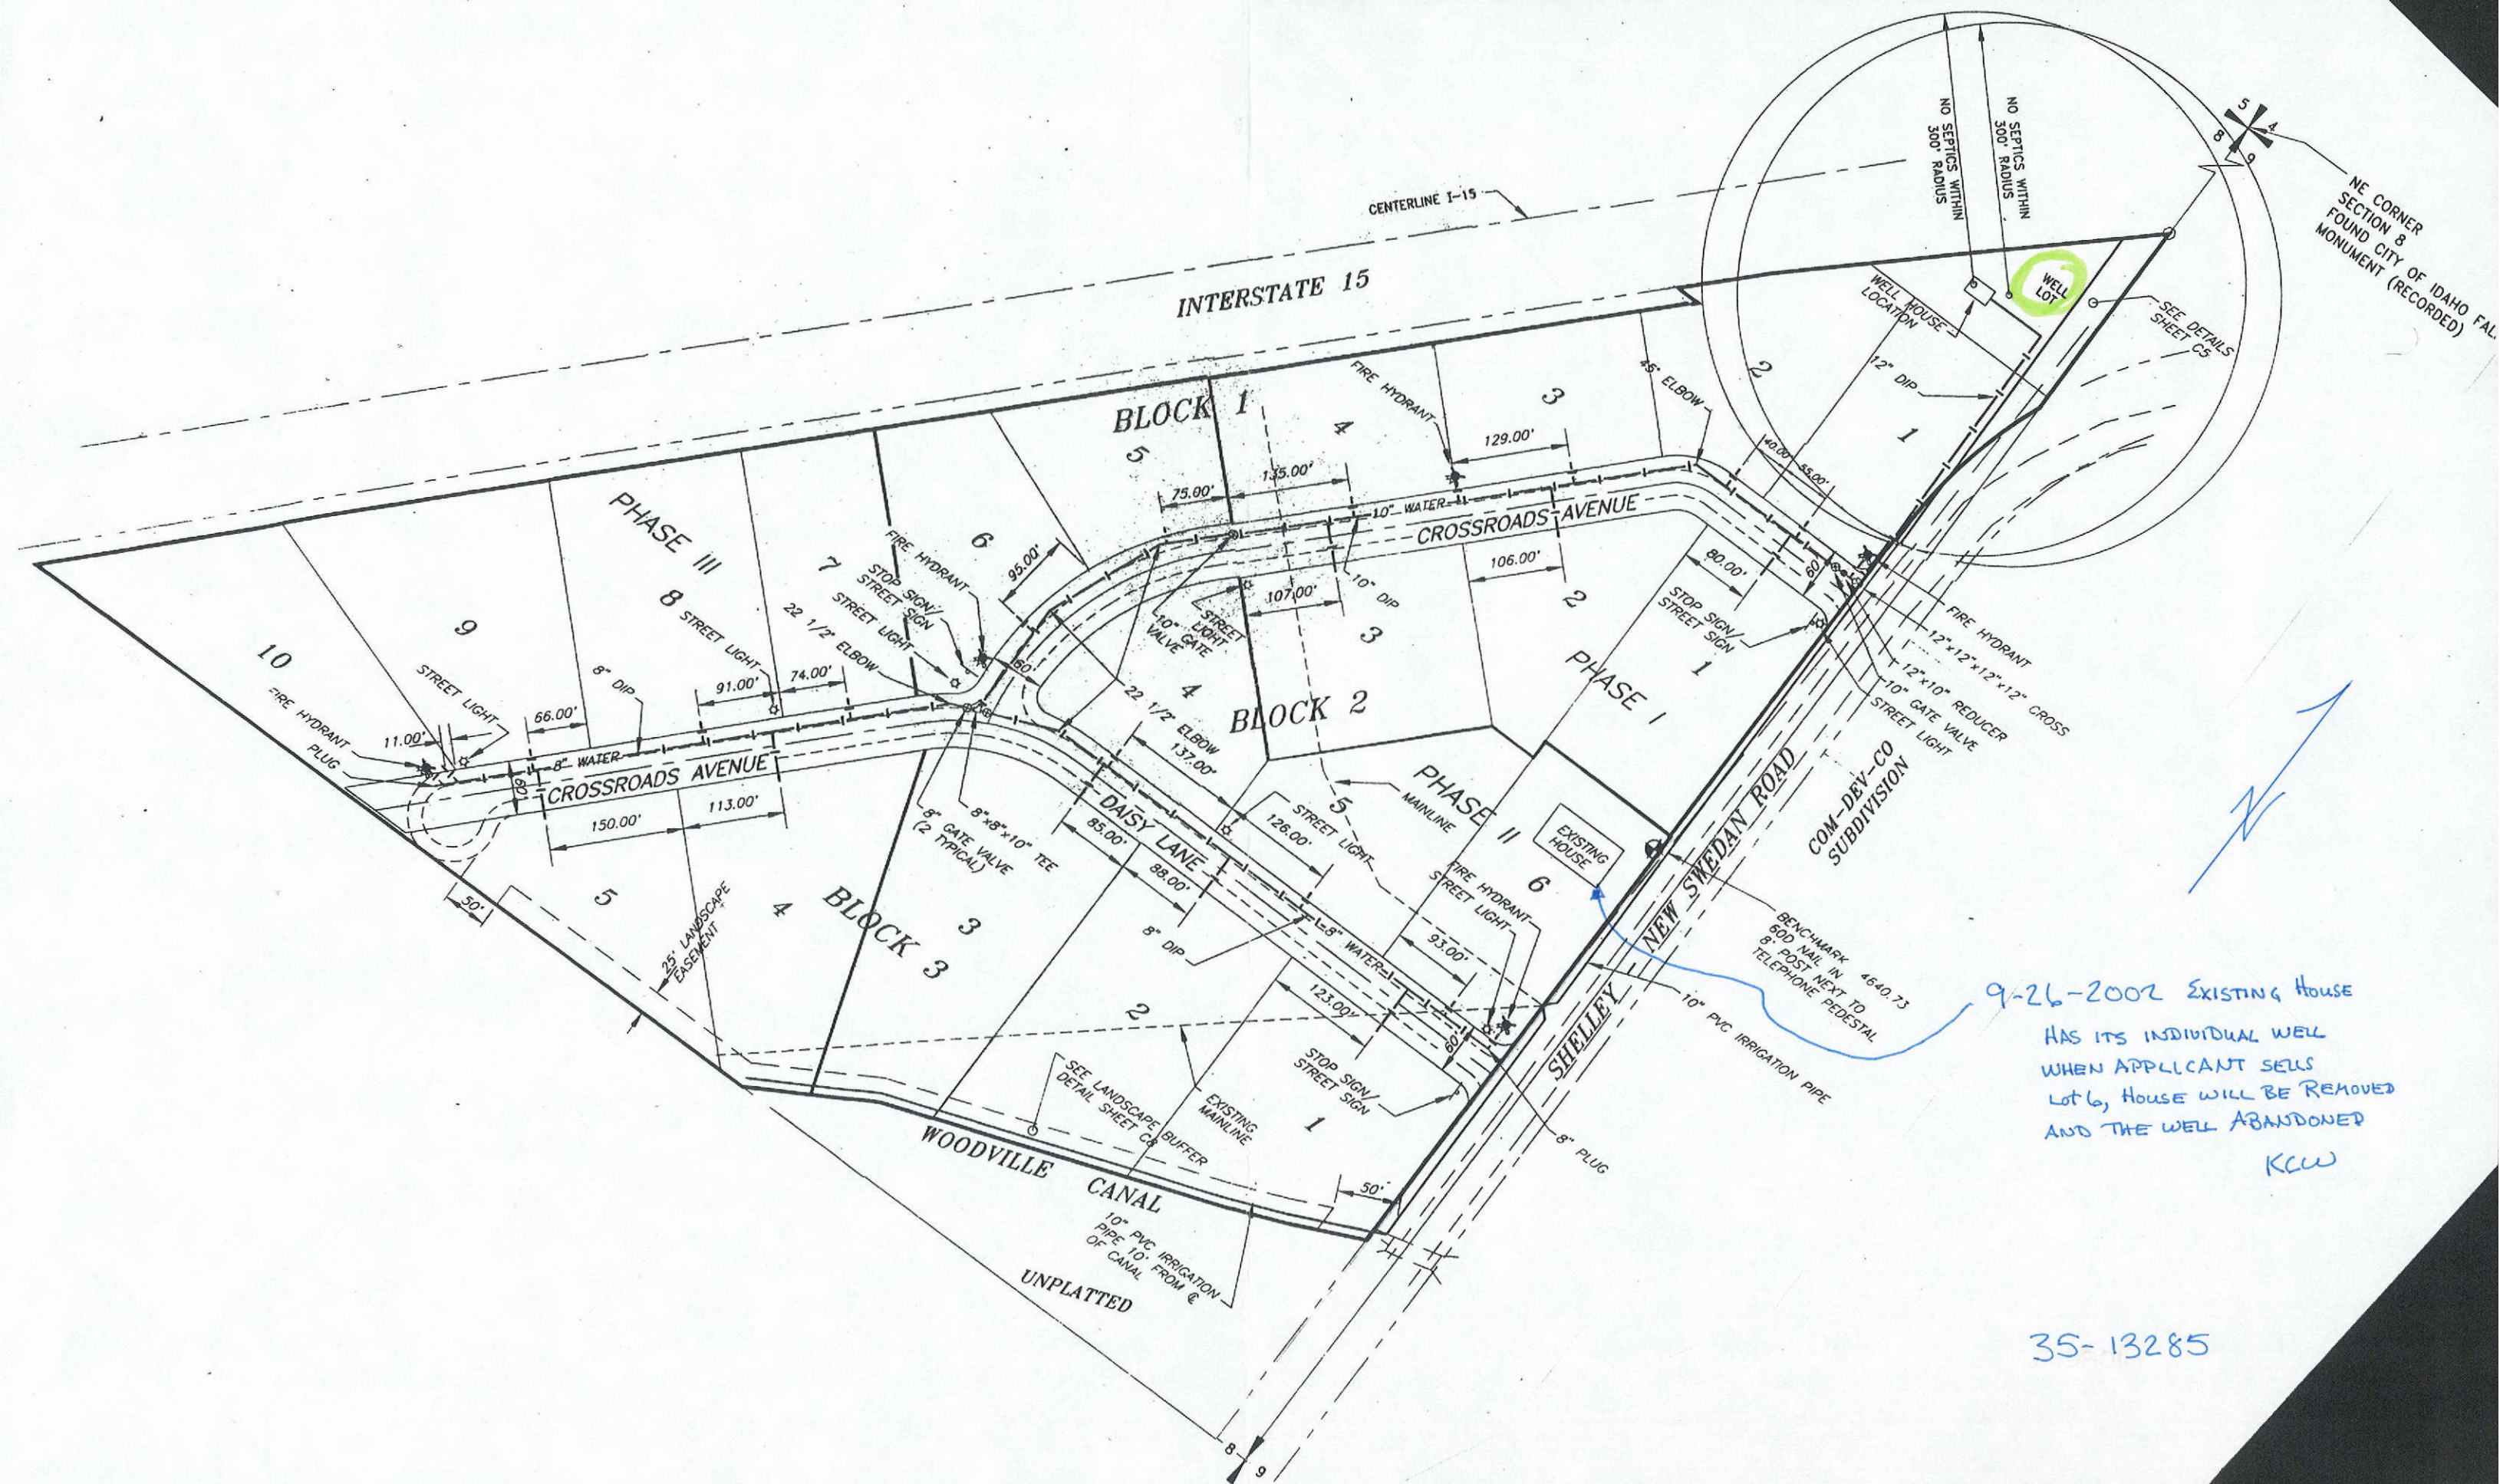

NE CORNER
SECTION 8
TOWN OF IDAHO FALLS
MONUMENT (RECORDED)

9-26-2002 Existing House
HAS ITS INDIVIDUAL WELL
WHEN APPLICANT SELLS
LOT 6, HOUSE WILL BE REMOVED
AND THE WELL ABANDONED
KCW

35-13285

ANALYSIS SHEET FOR PROOF OF BENEFICIAL USE

Permit No.: 35-13285

Reviewed By: dgibson

Date: March 19, 2002

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Proof received timely?	X		Drilling permit required?	X	
License examination fee required?	X		Drilling permit No.:		
Appropriate fee submitted?	X		Drilling permit upgrade needed?		
Receipt No.:		E026445,	Well driller's report filed?		X
Additional Amount Due:			Measuring device required?	X	
Name and address same as permit?	X		Measuring device installed?	X	
Are the water uses correct?	X		Measure device waiver requested?		

Priority Calculation

Date proof received	01/15/2002
Date proof due	- 03/01/2002
Lapse notice sent	-
No. of days late	= 0
Holiday allowance	+
Priority date	+ 01/29/2001
New priority date	= 01/29/2001

Deficiencies of Actions Items

Acknowledge proof. Ask Well Construction to check on drilling permit. Ask for a copy for the file.

3/20 - copies to April - asked for copy of drilling permit for w.r. file.

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 35-13285

Priority: January 29, 2001

Maximum Diversion Rate: 0.84 CFS
Maximum Diversion Volume: 28.1 AF

It is hereby certified that ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301 has complied with the terms and
conditions of the permit, issued pursuant to Application for Permit dated January 29, 2001; and has
submitted Proof of Beneficial Use on January 15, 2002. An examination indicates that the works have a
diversion capacity of 0.84 cfs of water from:

SOURCE

GROUND WATER

and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL DIVERSION VOLUME</u>
DOMESTIC	01/01 to 12/31	0.84 CFS	28.1 AF

LOCATION OF POINT OF DIVERSION:

GROUND WATER NE $\frac{1}{4}$ NE $\frac{1}{4}$ Sec. 8, Twp 01N, Rge 37E, B.M., BONNEVILLE County

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	Totals
01N	37E	8	X		X	X													


CONDITIONS OF APPROVAL

1. Domestic use is for 20 commercial business lots.
2. Place of use is located within Lots 1-8, 10, Blk. 1; Lots 1-6, Blk. 2; and Lots 1-5, Blk. 3; Cross-Roads Subdivision.
3. The daily diversion volume for the domestic use authorized under this right shall not exceed 2,500 gallons per day per lot upon which a commercial business is built.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed and sealed this 31st day of DECEMBER, 2002.

Acting for

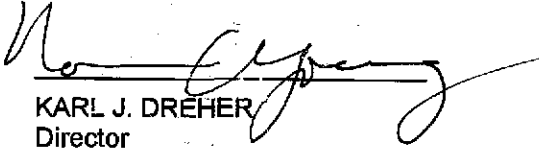
KARL J. DREHER
Director

MICROFILMED

JAN 09 2003

RECEIVED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

JAN 15 2002

Department of Water Resources
Eastern Region

PROOF OF BENEFICIAL USE

RECEIVED

JAN 22 2002

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner.

1. Permit No. 35-13285 Telephone No. 208 733-6062 Cell 208 731-3478

2. Name of Permit Holder(s): Alan Widaman

3. Mailing Address: 727 Rimview Lane West

City Twin Falls State ID Zip 83301 3608

4. Source of Water: Groundwater If **GROUNDWATER** (well), Date Drilled: mo. 01 / yr. 2002

Well Driller: Andrew Well Drilling Drilling Permit Number: D0021468

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): 21 - Commercial Stockwater (No. and type of stock): _____

Irrigation (No. of acres): _____ Other: _____

6. Total rate of diversion and/or volume for which proof is submitted: 0.84 cfs OR _____ acre-feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)

(This question is **not optional**. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device: Is a measuring device required?

Yes X or No _____

Has the measuring device been installed?

Yes X or No _____

8. Fee Enclosed: \$ 100.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: Jeff Freiberg - Harner-Leavitt Engineering Telephone Number: 208- 524-0212

Address: 985 N Capital Ave Idaho Falls Idaho 83405

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted. I agree to relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder:  Date: 01-15-02
(include your title, if on behalf of company or organization)

MICROFILMED

APR 03 2002

State of Idaho
Department of Water Resources
Permit to Appropriate Water

NO. 35-13285

Priority: 01/29/2001

Maximum Diversion Rate: 0.84 CFS

This is to certify, that ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301

has applied for a permit to appropriate water from:

Source: GROUND WATER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
DOMESTIC	01/01 to 12/31	0.84 CFS

LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER NE $\frac{1}{4}$ NE $\frac{1}{4}$ Sec. 8, Twp 01N, Rge 37E, B.M. BONNEVILLE County


PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
01N	37E	8	X			X	X												

CONDITIONS OF APPROVAL

1. Proof of application of water to beneficial use shall be submitted on or before **March 01, 2002**.
2. Subject to all prior water rights.
3. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. The right holder shall measure and annually report diversions of water and/or other pertinent hydrologic and system information as required by Section 42-701, Idaho Code.
5. The daily diversion volume for the domestic use authorized under this right shall not exceed 2,500 gallons per day per lot upon which a commercial business is built.
6. Domestic use is for 21 commercial business lots.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code. Witness the signature of the Director, affixed at Boise, this 15th day of March, 2001.

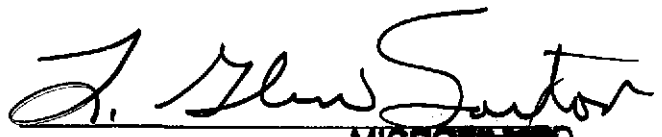
for **KARL J DREHER, Director**
MAR 29 2001

RECEIVED

MAR 12 2001

FORM 202
12/99

Department of Water Resources

Ident. No.

35-13285

#68849

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT
To appropriate the public waters of the State of Idaho

- Name of Applicant Alan Widaman Phone Work (208) 733-3478
Mailing address 727 Rimview Lane West Twin Falls Id 83401 Home (208) 733-6062
Cell (208) 731-3478
- Source of water supply Ground Water which is a tributary of Snake River
- Location of point of diversion is Township 1N Range 37E Sec. 8 in the NE 1/4, NE 1/4, Govt. Lot Bonneville County;
additional points of diversion if any: Cross-Roads Subdivision
- Water will be used for the following purposes:
Amount .84 cfs for Domestic purposes from Jan 1 to Dec 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount 3.34 cfs for Fire Protection purposes from Jan 1 to Dec 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)
Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)
Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)
Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)
- Total quantity to be appropriated is (a) .84 cubic feet per second and/or (b) acre feet per annum
- Proposed diverting works:
 - Describe type and size of devices used to divert water from the source Domestic 15Hp deep well electric 8" Well
Fire Protection 125 Hp Diesel 12" Well
 - Height of storage dam feet; active reservoir capacity acre-feet; total reservoir capacity acre-feet
 - Proposed well diameter is 8" / 12" inches; proposed depth of well is 200' / 300' feet
 - Is ground water with a temperature of greater than 85°F being sought? No
 - If well is already drilled, when? ; Drilling firm ;
Well was drilled for (well owner) ; Drilling Permit No.
- Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)
- Description of proposed uses (if irrigation only, go to item 9):
 - Hydropower; show total feet of head and proposed capacity in KW.
 - Stockwatering; list number and kind of livestock.
 - Municipal; show name of municipality.
 - Domestic; show number of households. 21 Commercial Lots, should have 21 Commercial Businesses
 - Other; describe fully. Fire Protection for the Subdivision plus a hookup for fire department use
All the above was required and approved by Bonneville Planning & Zoning, District 7 Health
department and DEQ.

MICROFILMED

MAR 29 2001

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
1N	37E	8	D		D	D													
1N	37E	8	F		F	F													

Total number of acres to be irrigated 0

10. Describe any other water rights used for the same purposes as described above. _____

11. a. Who owns the property at the point of diversion? Alan & Lynn Widaman
- b. Who owns the land to be irrigated or place of use? Alan & Lynn Widaman
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Remarks: As Lots sell and the Subdivision develops the Water system will be owned and operated by Cross-Roads Subdivision Property Owners Association .

No more than 2500 gallons per day shall be used per business per day per Idaho Code 42-111.


13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Alan Widaman Owner
Signature of Applicant (and title, if applicable)

Received by DN / Dennis Date 1-29-01 Time 10:26 AM Preliminary check by Alan Widaman
Fee \$ 250.00 Receipted by DN # E026445 Date 1-29-2001
Publication prepared by SC Date 2/15/01 Published in Post Register
Publication approved _____ Date _____

MICROFILMED
MAR 29 2001

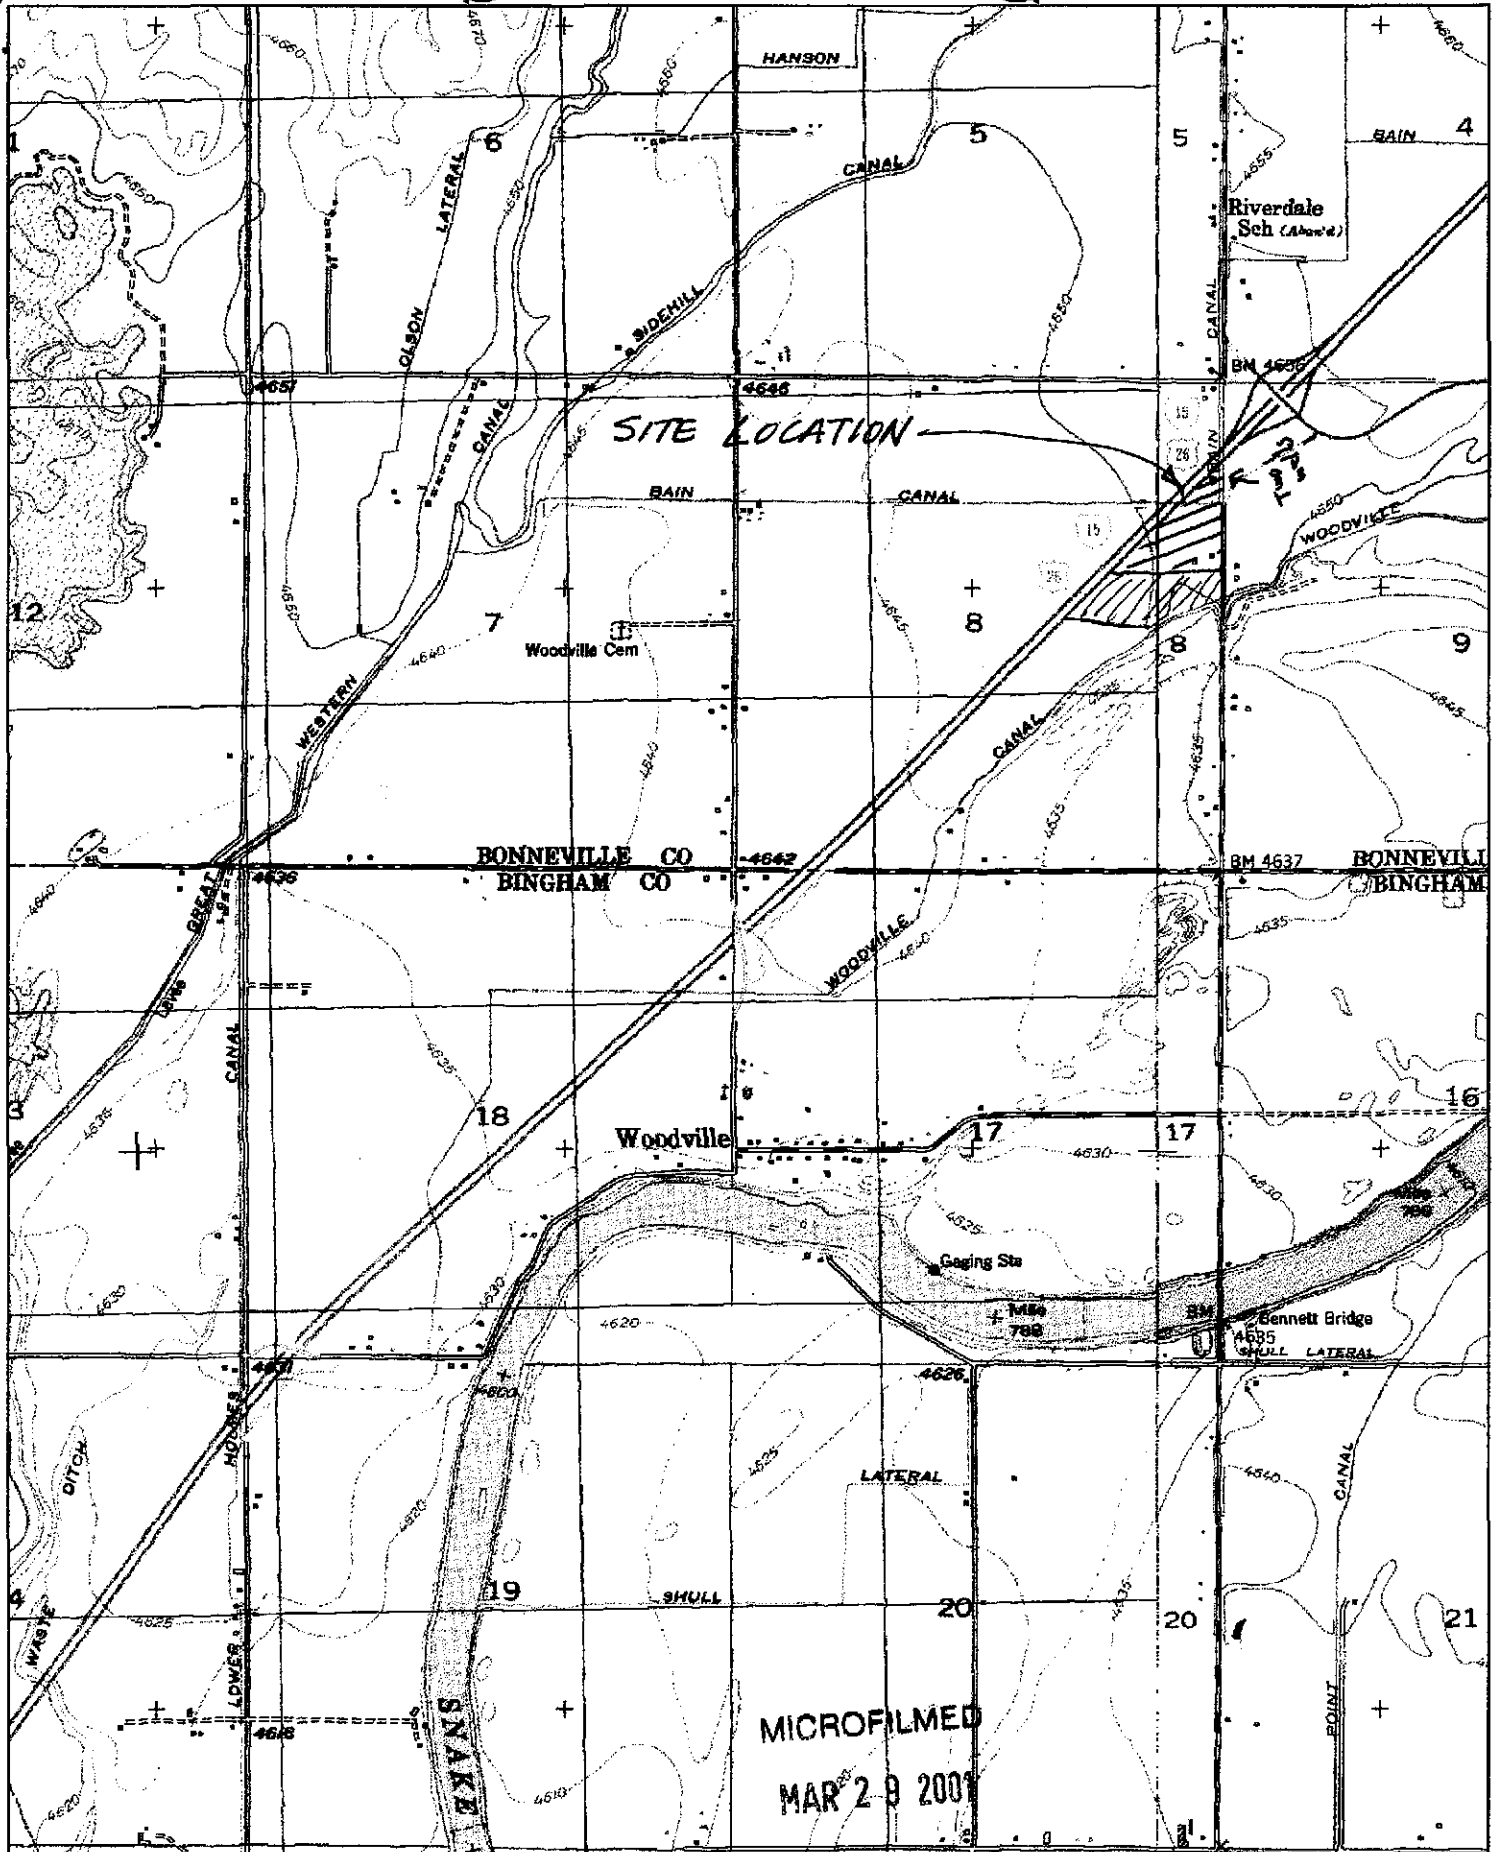



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

January 2, 2003

ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301

RE: License No. 35-13285 - Issuance of License

Dear Water Right Holder(s):

The Department of Water Resources has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review the conditions of approval and remarks listed on your license.

The license is a PRELIMINARY ORDER issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-327-7946.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SWK:klt

Enclosure(s)

MICROFILMED

JAN 09 2003


CERTIFICATE OF SERVICE

I hereby certify that on January 2, 2003 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER(Approved License) to the person(s) listed below:

RE: WATER RIGHT NO.

35-13285

**ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301**

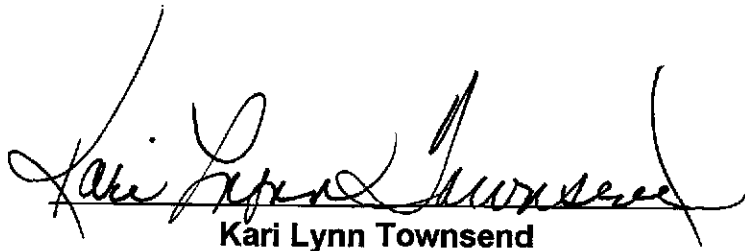

**Kari Lynn Townsend
Secretary**

**MICROFILMED
JAN 09 2003**

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

Comment Report

35-13285

1. kwilson 12/19/2002 Field Report Narrative

Comment: Well, pump, mainline to 10 pressure tanks to domestic system (commercial business lots) for Cross Roads Subdivision. At time of exam only one (1) business was on the system occupying Lots 2, 3, & 4 Block 1 of the subdivision. Therefore, there will be a maximum of 20 businesses on the system.

The domestic system for Cross Roads Subdivision is complete except for hooking up the businesses as they are established. Cross Roads Subdivision will be developed in three phases:

Phase 1 - Lots 1, 2, 3, & 4, Block 1, and Lots 1, 2, & 3, Block 2 (Completed at time of exam.)

Phase 2 - Lots 5 & 6 Block 1: Lots 4, 5, & 6, Block 2, and Lots 1, 2, & 3 Block 3

Phase 3 - Lots 7, 8, & 10 Block 1 and Lots 4 & 5, Block 3.

2. kwalker 12/30/2002 License Recommendations

Comment: License recommended for 20 commercial businesses.

3. Shelley Keen 3/12/2001 Application Review

Comment: Today I consulted with Skip Jones and Sharla Cox, who told me that Application 35-13285 has been reviewed and is ready to be approved. They did not complete a paper checklist for the water right file because we are testing our ability to rely on the computer checklist.

4. SCURTIS 3/13/2001 3:25:06 PM Special Administration Area Notes

Comment: Special Administration Areas : Snake River

Exempt: Y

Reason: Non-Consumptive Use

Doc Attached:

Explanation: Domestic use is for 21 commercial businesses which will be conditioned as limited to 2500 gpd/business.

Special Administration Areas : Bonneville-Jefferson Ground Water District

Exempt: N

Reason:

Doc Attached:

Explanation:

MICROFILMED

JAN 09 2003

RECEIVED

DEC 27 2002

Department of Water Resources

Permit No: 35-13285

Page 1

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 35-13285

Exam Date: 9/26/2002

1. Current Owner: ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301

2. Accompanied by:

Phone No:

Address:

Relationship to Permit Holder:

3. SOURCETRIBUTARY

GROUND WATER

B. OVERLAP REVIEW

1. Other water rights with the same place of use:
2. Other water rights with the same point of diversion:

C. DIVERSION AND DELIVERY SYSTEM

1. LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER

NE1/4NE1/4

Sec. 8, Twp 01N, Rge 37E, B.M.

BONNEVILLE County

Method of Determination:

2.

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
01N	37E	8	X		X	X													

NOTE:

License still had 21 businesses

7
12-30-02

per phone con.
w/ examiner
only 20 businesses
should be
licensed — kw

MICROFILMED

JAN 03 2003

Method of Determination:

3. _____ Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
 _____ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
 _____ Aerial Photo Attached (required for irrigation of 10+ acres).
 _____ Photo of Diversion and System Attached

4.

<u>Well or Diversion ID No.*</u>	<u>Motor Make</u>	<u>Hp</u>	<u>Motor Serial No.</u>	<u>Pump Make</u>	<u>Pump Serial No. or Discharge Size</u>
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

<u>Measurement Equipment</u>	<u>Type</u>	<u>Make</u>	<u>Model No.</u>	<u>Serial No.</u>	<u>Size</u>	<u>Calib. Date</u>
_____	_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____

2. Measurements:

E. FLOW CALCULATIONS

Measured Method:

_____ Additional Computation Sheets Attached

MICROFILMED

JAN 09 2003

F. VOLUME CALCULATIONS**1. Volume Calculations for Irrigation:**

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation season}) \times 1.9835 =$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$$

2. Volume Calculations for Other Uses:**G. NARRATIVE/REMARKS/COMMENTS**

Well, pump, mainline to 10 pressure tanks to domestic system (commercial business lots) for Cross Roads Subdivision. At time of exam only one (1) business was on the system occupying Lots 2, 3, & 4 Block 1 of the subdivision. Therefore, there will be a maximum of 20 businesses on the system.

The domestic system for Cross Roads Subdivision is complete except for hooking up the businesses as they are established. Cross Roads Subdivision will be developed in three phases:

Phase 1 - Lots 1, 2, 3, & 4, Block 1, and Lots 1, 2, & 3, Block 2 (Completed at time of exam.)

Phase 2 - Lots 5 & 6 Block 1: Lots 4, 5, & 6, Block 2, and Lots 1, 2, & 3 Block 3

Phase 3 - Lots 7, 8, & 10 Block 1 and Lots 4 & 5, Block 3.

Have conditions of permit approval been met? ☐ Yes ☐ No

H. RECOMMENDATIONS**1. Recommended Amounts**

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.840 CFS	28.10 AF
<u>Totals:</u>		0.840 CFS	28.10 AF

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name _____ Date _____

Reviewer _____ Date _____

MICROFILMED

JAN 09 2003

MEMORANDUM

Date: December 19, 2002
To: Water Right File 35-13285
From: kwilson
Re: Field Report Narrative

Well, pump, mainline to 10 pressure tanks to domestic system (commercial business lots) for Cross Roads Subdivision. At time of exam only one (1) business was on the system occupying Lots 2, 3, & 4 Block 1 of the subdivision. Therefore, there will be a maximum of 20 businesses on the system.

The domestic system for Cross Roads Subdivision is complete except for hooking up the businesses as they are established. Cross Roads Subdivision will be developed in three phases:

- Phase 1 - Lots 1, 2, 3, & 4, Block 1, and Lots 1, 2, & 3, Block 2 (Completed at time of exam.)
- Phase 2 - Lots 5 & 6 Block 1: Lots 4, 5, & 6, Block 2, and Lots 1, 2, & 3 Block 3
- Phase 3 - Lots 7, 8, & 10, Block 1, and Lots 4 & 5, Block 3.

MICROFILMED

JAN 09 2003

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No. 35-13285

1. Owner: Alan Widaman

Phone No. (208) 731-3478 (cell)
733-6062 (h)

Current Address: 727 Rimview Lane West, Twin Falls, ID 83301

2. Accompanied by: Alan Widaman

EXAM DATE: 9/26/2002

Address: —

Phone No. —

Relationship to Permit Holder: —

3. Source: GROUNDWATER

tributary to —

B. OVERLAP REVIEW

1. Other water rights with the same place of use: —

2. Other water rights with the same point of diversion: —

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			NE	NE	8	1N	37E	Bonneville	092614A GPS Sta

2. Place(s) of Use: Cross Roads Subdivision


Indicate Method of Determination GPS
On site, Plat map

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
1N	37E	8	D		D	D													

MICROFILMED

JAN 09 2003

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe I.D. as applicable.

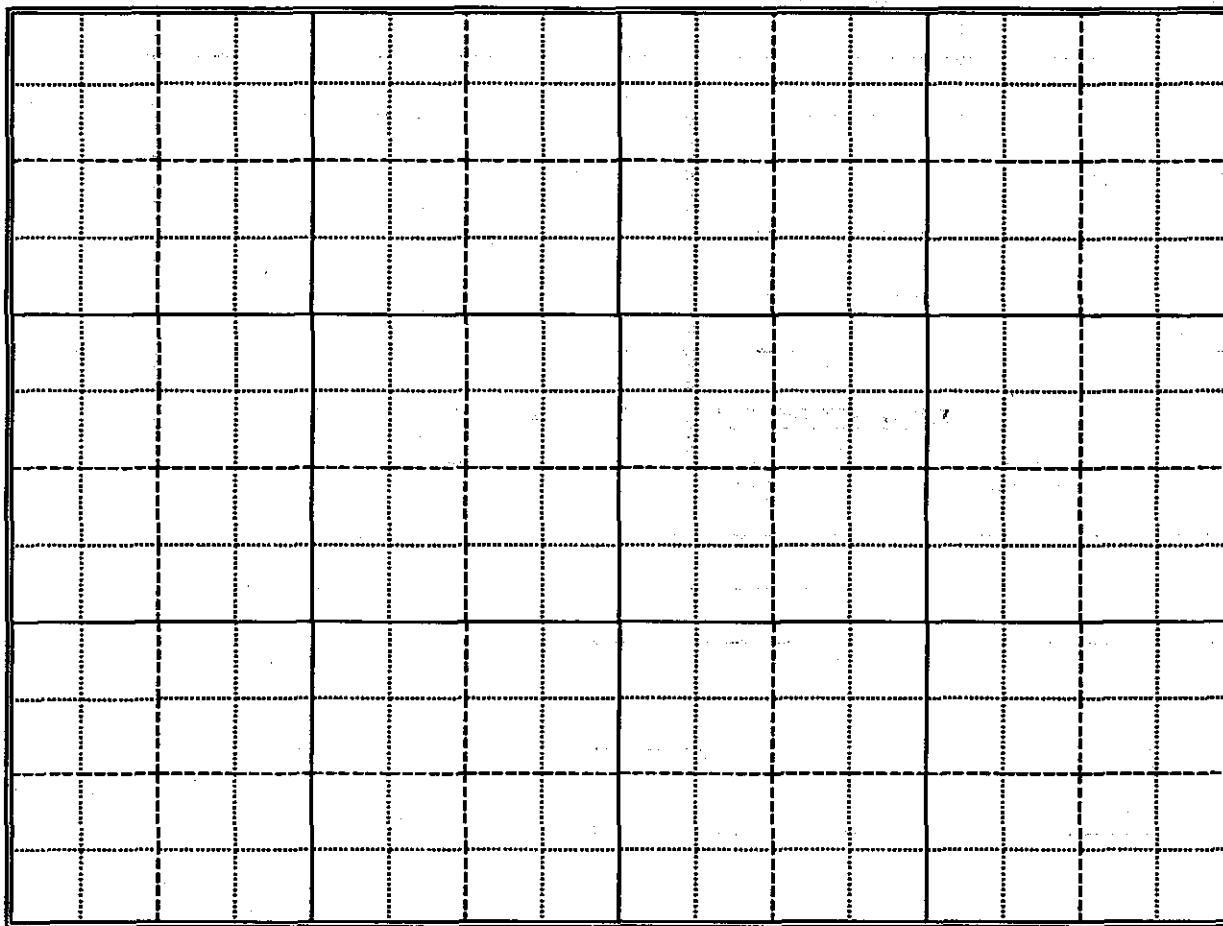

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
092614 a GRS FILE	FRANKLIN	15		GRUNDFOS Model 150S 150S150-7	4"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Totalizing Meter	In-Line	Water Specialists	ML-DCL	20015004	6"	

2. Measurements: 225 gpm instantaneous on (Pressure Tanks^{still} supplying portion of water)

MICROFILMED

JAN 09 2003

E. NARRATIVE/REMARKS/COMMENTS

Well pump mainline with 10 pressure tanks to Domestic System (Commercial business lots) for Cross Roads Subdivision

Pump on @ 52 psi

off @ 60 psi

(1) $50 \text{ gal} / 1.44 = 2622 \text{ gpm}$ instantaneous on Pressure tanks ^{still} supplementing flow

(2) $330 \text{ gal} / 52.6 \text{ sec} = 376.4 \text{ gpm} = 0.838 \text{ cfs} \approx 0.84 \text{ cfs}$

GPS POINT 092615a SW most corner of property

NOTE: Existing house (Lot 6, Block 2, Phase II) has its own individual well. As Project develops house will be removed & well abandoned

at time of Exam only 1 business (ARMY WAREHOUSE) on system occupying Lots 2, 3 & 4 Block 1 of Project

Phase I consists of developing Lots 1, 2, 3 & 4 Block 1 and Lots 1, 2 & 3 of Block 2 Cross Roads Subdivision

Phase II consists of developing Lots 5 & 6 Block 1; Lots 4, 5 & 6 Block 2 and Lots 1, 2 & 3 Block 3 Cross Roads Subdivision

Phase III consists of developing Lots 7, 8, 9 & 10 Block 1 and Lots 4 & 5 Block 3 Cross Roads Subdivision

@ time of Exam Phase I has been completed

As platted with Lots 2, 3 & 4 Block 1 being occupied by ARMY SURPLUS STORE there will be a maximum of 20 businesses in

Have conditions of permit approval been met? ☐ yes ☐ no

MICROFILMED

JUN 9 2003

F. FLOW CALCULATIONS

Additional Computation Sheets Attached

Measured Method:

$$Q = 330 \text{ gal} / 52.6 \text{ sec} = 376.4 \text{ gpm} = 0.838 \text{ cfs} = 0.84 \text{ cfs}$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$$

2. Volume Calculations for Other Uses: Assume 12hr/day, $\approx 183 \text{ days/yr}$

$$V_{\text{max allowed}} = 2500 \text{ g/d/business} \times 20 \text{ businesses} \times 183 \text{ days/yr} = 28.1 \text{ afa}$$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic	1/1	12/31	0.84 cfs	28.1 afa
(20 commercial businesses)				
Totals:			0.84 cfs	28.1 afa

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other


I. AUTHENTICATION

Field Examiner's Name KATH C WILSON Date 9/26/2002

Reviewer _____ Date _____

SEAL

MICROFILMED
JAN 09 2003

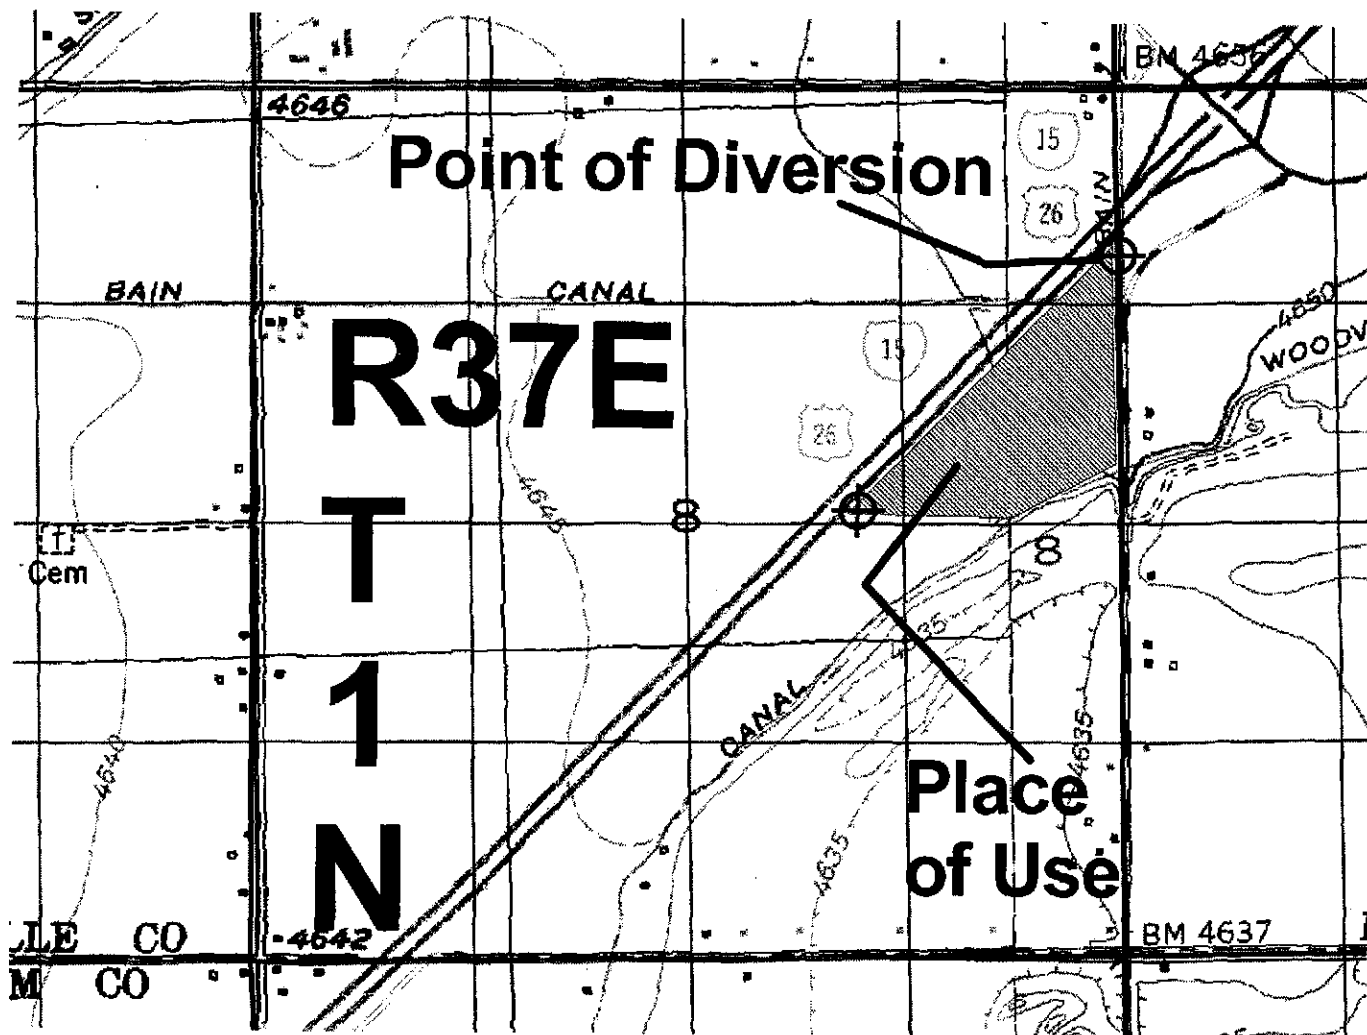

-  Sections.shp
-  T01n37e.shp
-  Posnpnt.dbf
-  Widamanpu.shp

35-13285


MICROFILMED

JAN 09 2003

Model 6CLC 160 GPM

Domestic Pump Curve

GOULDS PUMPS

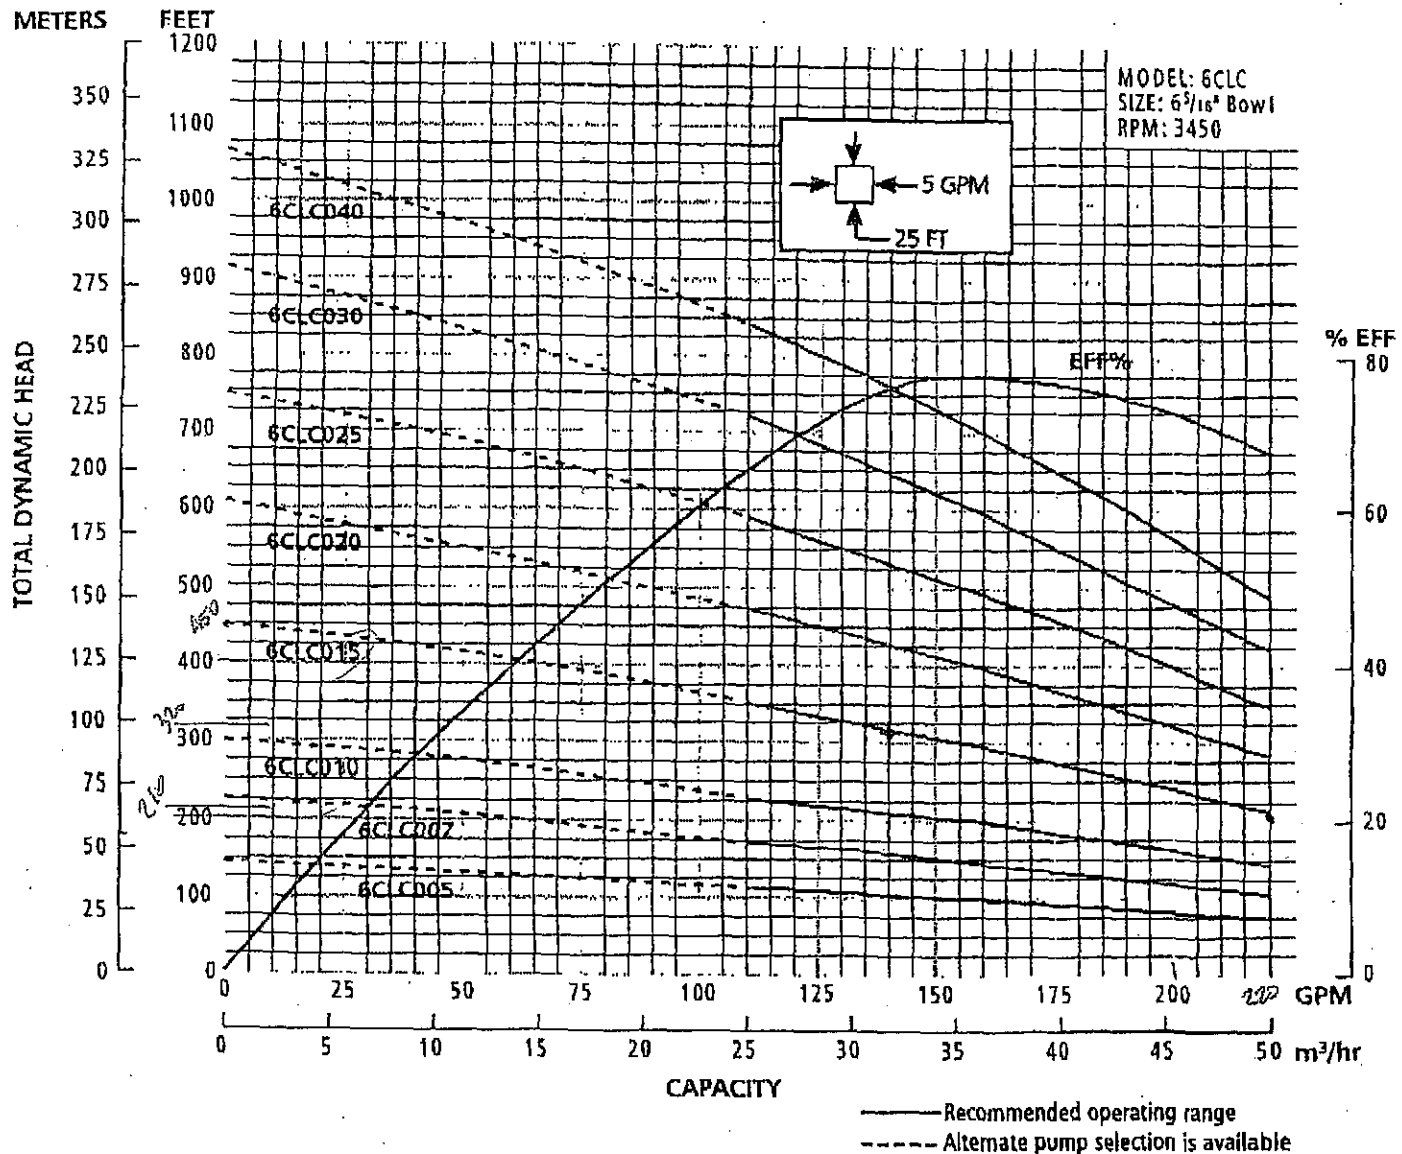

DIMENSIONS AND WEIGHTS


HP	Stages	W.E. Order Number	W.E. Length	W.E. Wt. (lbs.)
5	2	6CLC0054ACTS	22 1/4"	67
		6CLC00564ACTS	24 1/4"	72
7 1/2	3	6CLC00744ACTS	27 1/4"	84
		6CLC00764ACTS	29 1/4"	90
10	4	6CLC01064ACTS	34 1/4"	106
15	5	6CLC01564ACTS	40"	123
20	7	6CLC02064ACTS	50 1/4"	157
25	9	6CLC02564ACTS	60"	191
30	10	6CLC03064ACTS	65 1/4"	208
40	12	6CLC04064ACTS	75 1/4"	242

(All dimensions in inches and weights in lbs. Do not use for construction purposes.)

PLEASE NOTE:

- For alternate pump selection, please specify the alternate pump selection in the order number.
- Solid line is recommended operating range. The dotted line (---) signifies an alternate pump selection is available.
- Please specify all options changes in W.E. order number.

4" NPT DISCHARGE CONNECTION

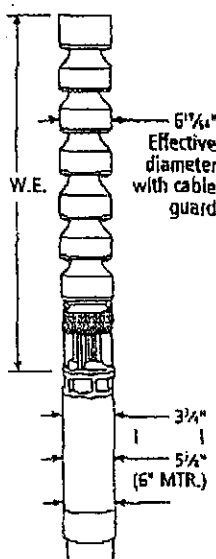

MATERIALS OF CONSTRUCTION

Part Name	Material
Shaft	ASTM A582 TYPE 416
Coupling	ASTM A582 S41600 CD
Suction Adapter	Ductile Iron ASTM A536
Discharge Bowl	ASTM A48 CL 30B
Rubber Bearings	RUBBER
Optional Bronze Bearings	ASTM B584
Discharge Bowl Bearing	ASTM B584
Taperlocks	ASTM A108 GR 101B
Bowl	ASTM A48 CL 30B
Upthrust Collar	Polyethylene
Impeller	ASTM B584
Fasteners	SAE J429 GR 8
Cable Guard	ASTM A240 S 30400
Suction Strainer	ASTM A240 S 30400

35-13285

JAN 09 2003

Performance Curves


150 GPM

Model 150S

FLOW RANGE: 30 -220 GPM

OUTLET SIZE: 3" NPT

NOMINAL DIA. 6"

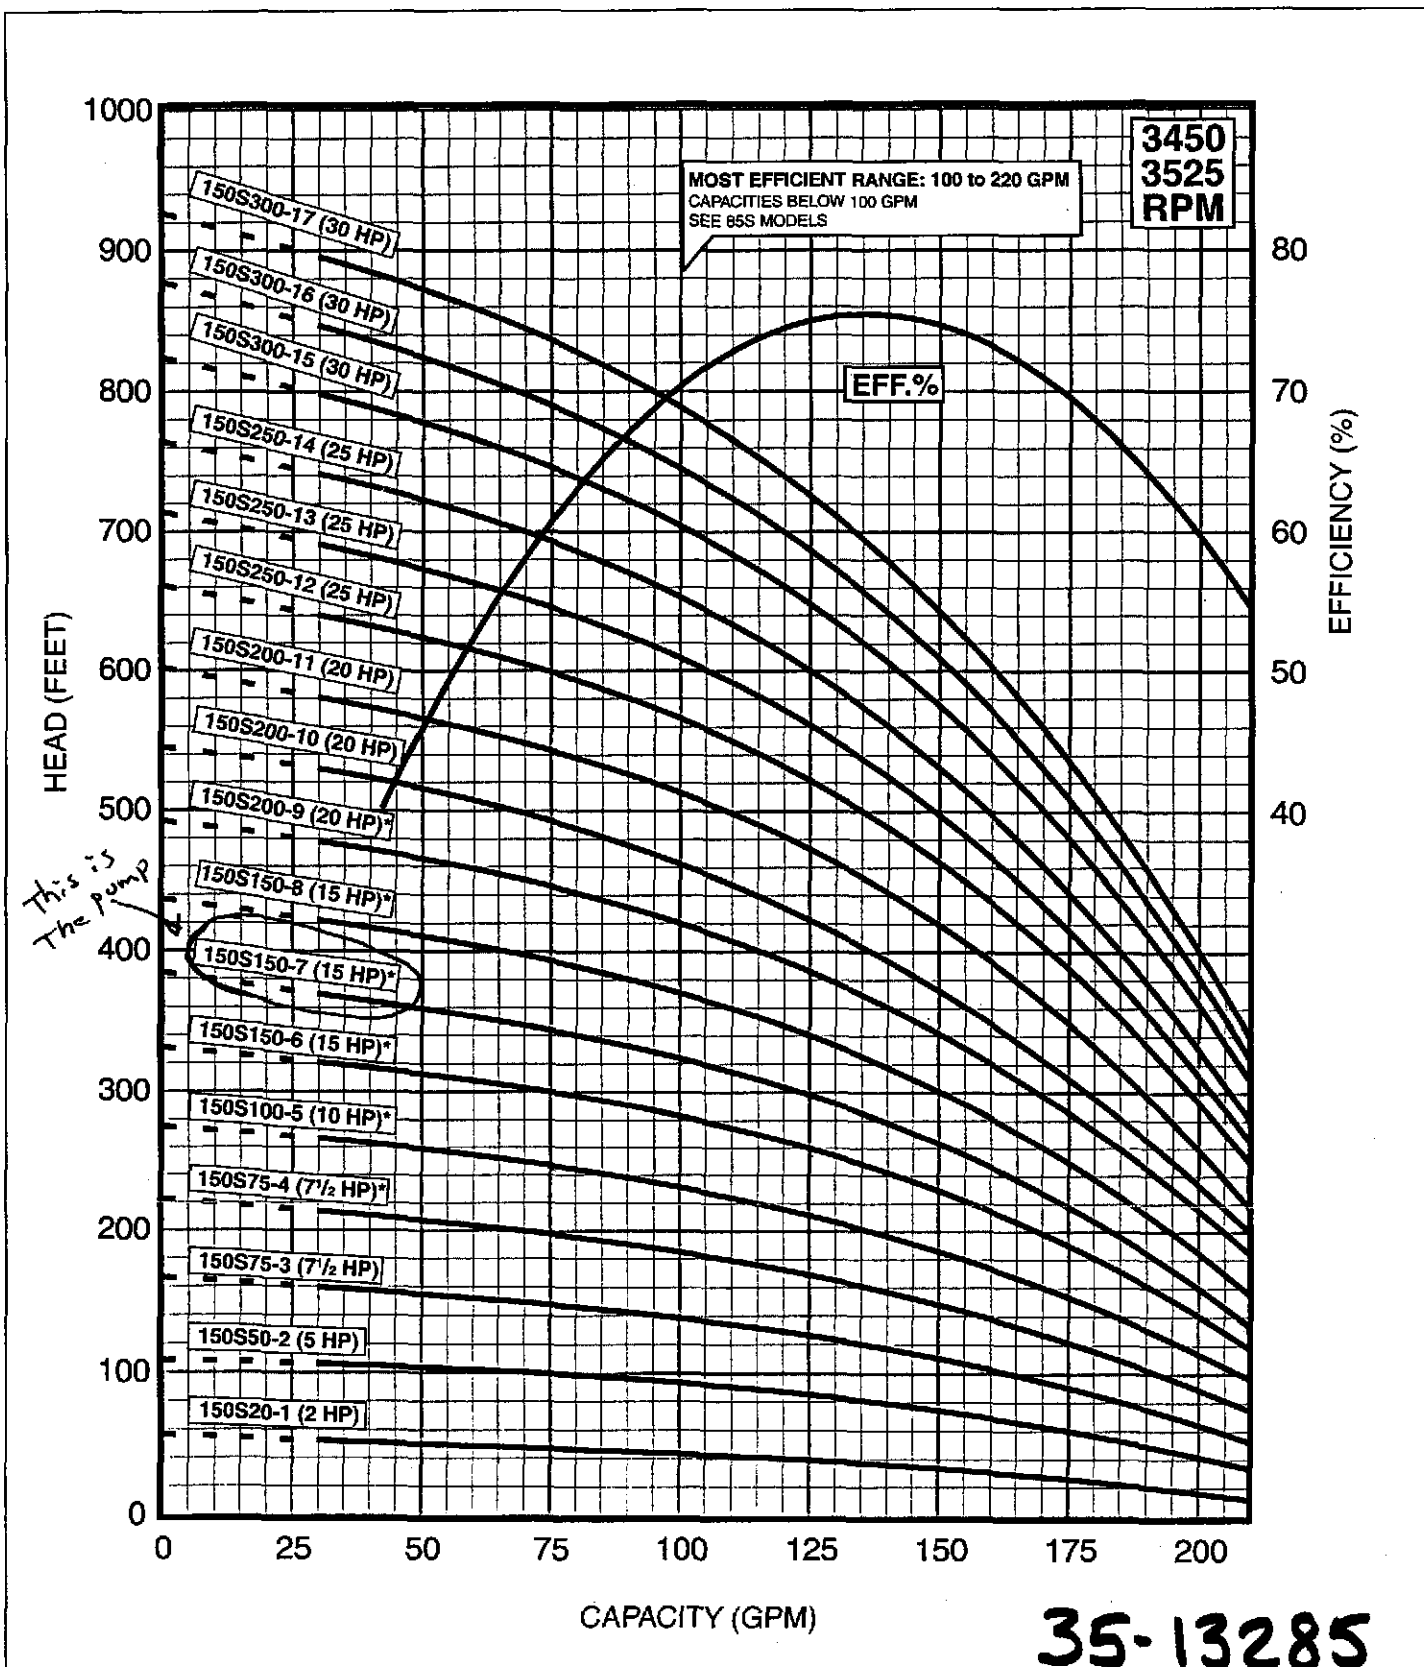

SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE.

4" MOTOR STANDARD, 2-10 HP/3450 RPM.

6" MOTOR STANDARD, 7.5-60 HP/3450 RPM.

8" MOTOR STANDARD, 75 HP/3525 RPM.

* Alternate motor sizes available.

JAN 09 2003

Performance conforms to ISO 2548 Annex B
@ 5 ft. min. submergence.



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

March 29, 2002

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 35-13285

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to contact you to schedule a field examination to determine and confirm the use being made of the water, and that it meets the permitted beneficial use.

Be advised that Section 42-248, Idaho Code, requires you or the owner of these water rights to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

If you have questions, please contact the **Southern** Regional Office of the department in Twin Falls at (208) 736-3033.

Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Encl.

c: IDWR - Regional Office (w/encl.)

MICROFILMED
APR 03 2002

ANALYSIS SHEET FOR PROOF OF BENEFICIAL USE

Permit No.: 35-13285

Reviewed By: dgibson

Date: March 19, 2002

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Proof received timely?	X		Drilling permit required?	X	
License examination fee required?	X		Drilling permit No.:		
Appropriate fee submitted?	X		Drilling permit upgrade needed?		
Receipt No.:	E026445,		Well driller's report filed?		X
Additional Amount Due:			Measuring device required?	X	
Name and address same as permit?	X		Measuring device installed?	X	
Are the water uses correct?	X		Measure device waiver requested?		

Priority Calculation

Date proof received	01/15/2002
Date proof due	- 03/01/2002
Lapse notice sent	-
No. of days late	= 0
Holiday allowance	+
Priority date	+ 01/29/2001
New priority date	= 01/29/2001

Deficiencies of Actions Items

Acknowledge proof. Ask for a copy of the permit.

3/20 - copies to April - asked for copy of drilling permit for w.r. file.

200⁰⁰
orm 235-1
2/6/96 (LDT)

Drilling Permit No. 770 629
Drilling Permit I.D. Tag No. 20021468
Water Right Permit No. 3513285
Injection Permit No. _____

app 867894
well 342578

State of Idaho
Department of Water Resources

35

RECEIVED

AUG 27 2001

APPLICATION FOR DRILLING PERMIT
(FOR THE CONSTRUCTION OF A WELL)

Department of Water Resources

Owner (please print): Alan Widaman

Mailing Address: 727 Rimview Lane West

City: Twin Falls State: Id Zip Code: 83301 Telephone: (208) 733-6062

Proposed Well Location: Twp. 1N Rge. 37E Sec. 8 1/4 NE 1/4 NE 1/4

Gov't Lot No. _____ County Bonneville Lat. _____ Long. _____

Street Address of Well Site 6831 S 45 W City Idaho Falls

Give at least name of road + Distance to Road or Landmark

Lot, block and subdivision Well Lot - Cross-Roads Subdivision

Proposed Use of Well:

☒ DOMESTIC: The use of water for homes, organization camps, public campgrounds, livestock (1,000 head or less) and for any other purpose in connection therewith, including irrigation of up to 1/2 acre of land, if the total use is not in excess of 13,000 gpd; or any other uses, if the total use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

Domestic does not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

NON-DOMESTIC: ☐ Irrigation ☐ Municipal ☐ Industrial
☐ Stock ☐ Test ☒ Other Subdivision - Domestic
(Over 1,000 Head) (Describe)

☐ INJECTION

☐ MONITORING: A well bore schematic and map is required for each blanket permit.
No. of proposed wells: _____

Well Construction Information:

A. ☒ New well ☐ Modify ☐ Replace

B. Proposed Casing Diameter 8" Proposed Maximum Depth 200'

C. Anticipated bottom hole temperature:
☒ 85°F or less (Cold Water Well) ☐ 85°F to 212°F (Low Temp. Geo. Well) ☐ 212° F. or more (Geothermal Well)

Construction Start Date: Week of 08-27-01

Anticipated Well Driller: Andrew Well Drilling Driller's Lic. No. 5
NOTE: The actual well driller must be identified prior to drilling.

Applicant's Signature: [Signature] Date 08-21-01

Address (if different than owner): _____

City: _____ State: _____ Zip Code: _____ Telephone: _____

Title: _____ (Owner, Firm Representative, Other)

MICROFILMED

APR 03 2002

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This Permit is Approved

Date 21 August 2001

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY!

GENERAL CONDITIONS:

1. This drilling permit is valid for two (2) months from the above approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.
2. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required before construction of this well. All wells must be drilled a minimum distance of 100 feet from a drain field. Domestic and Public Water Supply wells must be drilled a minimum of 50 feet and 100 feet respectively from a septic tank.
3. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.
4. Approval of this drilling permit does not authorize trespass on the land of another party.
5. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
6. This drilling permit does not represent a right to divert and use the water of the State of Idaho.
7. If a bottom hole temperature of 85° or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.
8. Idaho Code, S 55-2201 - 55-2210 requires the applicant and/or his contractors to contact "Digline" (DigLine is a one-call center for utility notification) not less than 2 working days prior to the start of any excavation for this project. The "DigLine" Number for your area is 1-800-342-1585.

SPECIFIC CONDITIONS:

Dennis M. Dunn Sr. Water Resource Agent
Signature of Authorized Department Representative Title

Receipt No. E027029 Received by CK Fee 200⁰⁰ Date 21 August 2001

EXTENSION OF DRILLING PERMIT

Extension approved by _____ Approval Date _____

This extension expires: _____

MICROFILMED

APR 03 2002

State of Idaho
Department of Water Resources
Permit to Appropriate Water

NO. 35-13285

Priority: 01/29/2001

Maximum Diversion Rate: 0.84 CFS

This is to certify, that ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301

has applied for a permit to appropriate water from:

Source: GROUND WATER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
DOMESTIC	01/01 to 12/31	0.84 CFS

LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER NE $\frac{1}{4}$ NE $\frac{1}{4}$ Sec. 8, Twp 01N, Rge 37E, B.M. BONNEVILLE County


PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	Totals
01N	37E	8	X		X	X													

CONDITIONS OF APPROVAL

1. Proof of application of water to beneficial use shall be submitted on or before March 01, 2002.
2. Subject to all prior water rights.
3. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. The right holder shall measure and annually report diversions of water and/or other pertinent hydrologic and system information as required by Section 42-701, Idaho Code.
5. The daily diversion volume for the domestic use authorized under this right shall not exceed 2,500 gallons per day per lot upon which a commercial business is built.
6. Domestic use is for 21 commercial business lots.


This permit is issued pursuant to the provisions of Section 42-204, Idaho Code. Witness the signature of the Director, affixed at Boise, this 15th day of March, 2001.

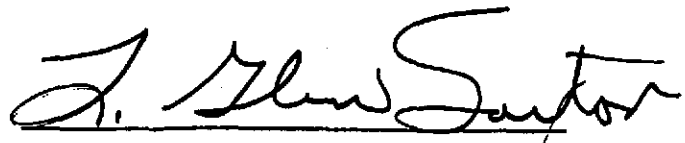
KARL J DREHER, Director
for

MICROFILMED

APR 03 2002

EXISTING GROUND SURFACE

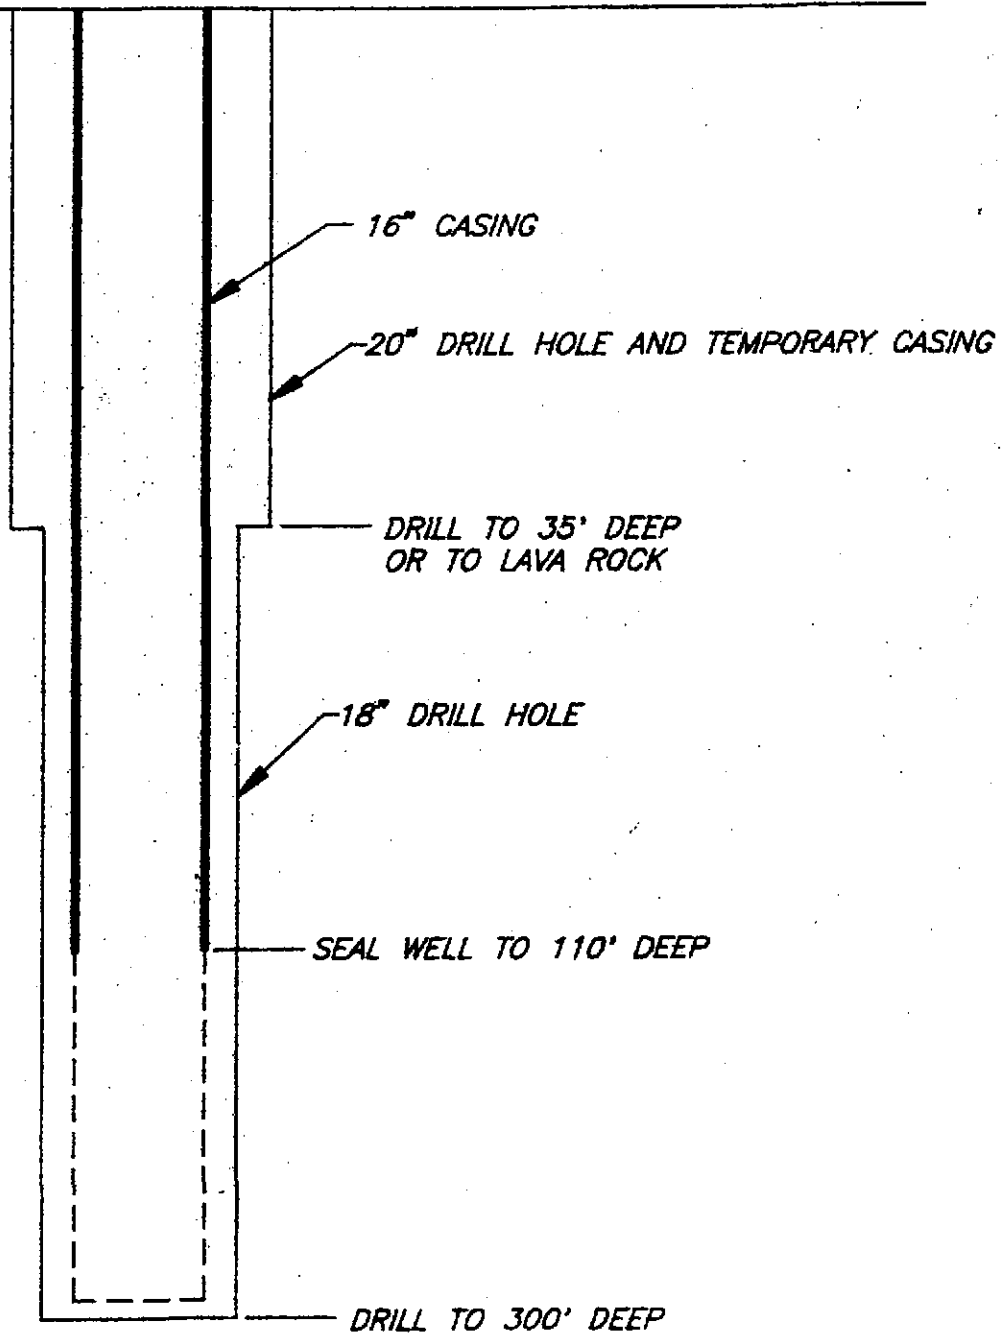

FIRE WATER WELL

NOT TO SCALE

MICROFILMED

APR 03 2002

DETAIL SHEET 3

CROSSROADS ADDITION

HE

Printed 03/28/2002
Drilling Permit No. 770629
Well Tag No. D0021468
Well ID # 342578
Water Right No. 35-13285
Receipt # E027039
Approved Date 08/22/2001

**STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
DRILLING PERMIT**

Relationship: Owner/Operator
Name: ALAN WIDAMAN
Address: 727 RIMVIEW LANE W
TWIN FALLS ID 83301

Phone:

Proposed Well Location: Township 01N, Range 37E, Section 8, NE, NE
COUNTY BONNEVILLE Sub Name CROSS ROADS SUBDIVISION

Street Address of Well Site: 6831 SOUTH 45 WEST
IDAHO FALLS ID

Proposed Use of Well: Domestic-Public Water Supply

Well Construction Information:

- A. New Well
- B. Proposed Surface Diameter: 8 Inches. Proposed Depth 200 Feet.
- C. Anticipated Bottom Hole Temperature: 85F and less

Construction Start Date: Aug 27 2001

Anticipated Well Drilling Company: ANDREW WELL DRILLING SERVICES INC (No. 5)

Applicant's Signature: _____ Date _____

Title: _____

MICROFILMED
2002 03 2002

Well ID # 342578

Well Tag No. D0021468

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This permit is Approved on Wednesday, August 22, 2001.

Signature of Authorized Dept. Representative

Title

MICROFILMED

APR 03 2002

December 31, 2001

ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS, ID 83301

PROOF DUE NOTICE

RE: PERMIT NO. 35-13285

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before March 01, 2002. (See last page of your approval permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a completed field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.


Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

Sincerely,

Deborah J. Gibson, Administrative Assistant
Water Allocation Bureau

Enclosures

MICROFILMED
APR 03 2002

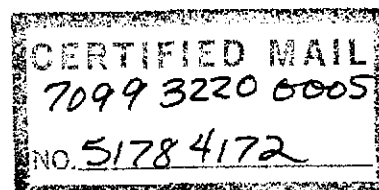



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

March 16, 2001

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301

RE: Permit No. 35-13285

Permit Approval Notice

Dear Permit Holder:

The Department of Water Resources has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.

The permit is a PRELIMINARY ORDER issued by the Department pursuant to Section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Enclosed is a form entitled 'Instructions for Proof of Beneficial Use.' Please read the instructions carefully since you must take further action to develop this permit into a licensed water right. Also enclosed is a form entitled 'Proof of Beneficial Use.' If your project is already completed, you should complete and submit this form immediately.

The right to drill a well is not a part of this permit to appropriate water. Beginning in July of 1987, a statute was enacted which requires a drilling permit for new well construction and deepening of existing wells. If the well(s) proposed for use under this water right permit were drilled or deepened after July 1, 1987, a separate drilling permit must be obtained from this Department. Please contact the Ground Water Protection Section located here at this office or our regional office nearest you.

MICROFILMED


MAR 29 2001

Please note that one of the conditions of approval on your permit requires that you measure your diversion and record other important hydrologic and physical features and report them annually to the Department. The Department will shortly send you further information about measuring devices, flow estimation using power records, and annual reporting forms. If you have questions about the measuring and reporting requirements, please call the Department at (208) 327-7900 and ask for someone in the Water Distribution Section.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-327-7946.

Sincerely,



Shelley W. Keen
Water Rights Supervisor

SWK:klt

Enclosure(s)

MICROFILMED

MAR 29 2001

CERTIFICATE OF MAILING

I hereby certify that on March 16, 2001 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER(Approved Permit) to the person(s) listed below:

RE: WATER RIGHT NO. 35-13285

**ALAN WIDAMAN
727 RIMVIEW LANE W
TWIN FALLS ID 83301**


**Kari Lynn Townsend
Secretary**

**MICROFILMED
MAR 29 2001**

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01302 (Rules of Procedure 302 and 303).

MICROFILMED
MAR 29 2001

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

APPLICATION FOR PERMIT
STATE OFFICE ANALYSIS

Reviewed by Sharla Curtis on 3/13/01

No. 35-13285 Name: Widaman Corp. Officers N/A Ad ok ✓ Govt Lots

AREA OF CONCERN: No/Yes SIC Moratorium GWMA TRUST/NON-TRUST

GROUNDWATER: (✓Flow Chart)

DRILLING PERMIT

All wells - 046
~~Basin 34~~ - 084 (if necessary)
WMD - North/East/West
~~≤ 0.24 cfs/5 acres~~ - No MD
> 0.24 cfs/5 acres - 067
~~WMD~~
Supp/irr (irr = only use) - 065-104
Supp/irr (+ other uses) - 100-105
≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M

LOCATION:

Boise Front LoGeo - 058 (<85 GW)
Mitigation - 121

Trust - 051 (consumptive uses)
Non-Trust N/A 048-049 (consumptive uses or non-cons. > 1.0 cfs)

USES:

STORAGE - 18A-01H-01P-18B-NA
IRR ≤ 5 ac - R66/R67/R68/R69 (0.03 cfs/ac)
> 5 ac - R62/R63/R64/R65 (0.02 cfs/ac)
STOCKWATER - R37 (BLM/USFS)
MINING - 054-106
FISH PROP - 029(70'S only)-007-042-106
HEAT/COOL - R07(injection well)
FIRE/PROT. - 077
COMMERCIAL/
INDUSTRIAL - 106-R07
DAIRY - 082-WD8

BENEFICIAL USE DUE: 3/01/2002

MISC CONDITIONS/REMARKS:

Protested - 020-W19
Development Period
> 1 yr - 26A
Ownership - 004
Non-consumptive - 027
Water Quality - 106-R07

SURFACE WATER: (✓Flow Chart)

F&G contacted - Yes/No Response
In/Above MSF - WB9
PLANNING REVIEW/RESPONSE
WD - R04 (WD#)
≤ 0.20 cfs/others - 01H(P01), 01P or No MD
> 0.20 cfs - 01J

SPRINGS/SINK, INACTIVE WD or WD

≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M or No MD

RIVER BASINS: (SW special considerations)

Snake R (01) - W22, N/A
(02,03) - 007 (w/ remark WB9 if above Weiser)
Payette R (65) - 047 (Payette Lake)
Salmon R (70's) - 029 (fish screens)
Weiser R (67) - 086-087

USES:

POWER - 17H-17K (+uses)-08A-025-01N-106
MUNICIPAL
Restricted area - 022,075
Irr., GW supp to SW - 102
DOMESTIC
Surface water - WB5 (Big Wood or Boise above Star Bridge)
27A (Payette R)
>1 in restricted area - 070-071-075(no parks/common areas, etc)
Irr use listed separate
or none allowed - WB5
Moratorium approvable - W03 (2500 gpd - meets domestic definition
i.e. D/convenience store)

IRRIGATION SEASON - (Per updated map)

IRR VOLUME/ACRE

OTHER CONDITIONS/REMARKS

COMMENTS

Multiple pd's per ¼¼ - W32
Subd lot desc (pd) - W59
Subd lot desc (pu) - W60
Use definitions - W02 example - S/50 range
Pre-1987 development - 068-074 (allow 120 days for proof due)
Single p/d intended - 076

D/21 comm. businesses

Comment Report

35-13285

1. Shelley Keen 3/12/01 Application Review

Comment: Today I consulted with Skip Jones and Sharla Cox, who told me that Application 35-13285 has been reviewed and is ready to be approved. They did not complete a paper checklist for the water right file because we are testing our ability to rely on the computer checklist.

MICROFILMED

MAR 29 2001

INTER-DEPARTMENT MEMO

TO: File 35-13285SUBJECT: fsFROM: HW JonesDATE: 3-8-01

I believe our thinking for using 0-84cfs on this application was to include an amount to cover fire protection. This thinking may be flawed. Please note in remarks that each business lot is restricted to no more than 2500 gpd.

MICROFILMED

MAR 29 2001

☒ For your information☐ Response requiredHW Jones
signature

ROSHOLT, ROBERTSON & TUCKER
Chartered

ATTORNEYS AT LAW

JOHN A. ROSHOLT
J. EVAN ROBERTSON
JAMES C. TUCKER
GARY D. SLETTE
JERRY V. JENSEN
JOHN K. SIMPSON
TIMOTHY J. STOVER
AMY D. CHESTNUT

Twin Falls Office
142 3rd Ave. North
P.O. BOX 1906
TWIN FALLS, IDAHO 83303-1906
TELEPHONE (208) 734-0700
FAX (208) 736-0041

March 2, 2001

Boise Office
1221 WEST IDAHO, SUITE 600
P.O. BOX 2139
BOISE, IDAHO 83701-2139
TELEPHONE (208) 336-0700
FAX (208) 344-6034

Ron Carlson
Idaho Department of Water Resources
900 North Skyline Drive
Idaho Falls ID 83402

RECEIVED

MAR 12 2001

Department of Water Resources

RECEIVED

MAR 05 2001

Department of Water Resources
Eastern Region

Re: Widaman - 35-13285

Dear Ron:

Twin Falls Canal Company and North Side Canal Company won't protest this application officially because it is in compliance with what the law should be. Recognizing that a domestic well can be drilled for each lot at 13,000 gallons per day, a better result is obtained by assessing a limitation of 2500 gallons per day per commercial lot. Technically, there should be no consumption since there is no irrigation listed.

A maximum total of 52,500 gallons per day is 8% of an acre foot. Our concern is why a diversion rate of .84 or 376.9 gallons per minute? The whole 52,500 can be pumped in less than 2 1/2 hours. There isn't a tank mentioned in the application.

We trust when issued the permit will have the usual conditions as well as a measuring device, which has a totaling capacity so daily diversions can be checked.

Please copy us with the permit when issued.

Respectfully,

John A. Rosholt

JOHN A. ROSHOLT,
Attorney for Twin Falls Canal Company
and North Side Canal Company

JAR/jl

cc: Vince Alberdi
Ted Diehl
Charles E. Brockway
Norm Young

(ljil/jar/letters/carlson1)

MICROFILMED

MAR 29 2001

RECEIVED

MAR 05 2001

Department of Water Resources
Eastern Region

Proof of Publication

The Post Register

State of Idaho
County of Bonneville

I, ~~S. Bob Bright~~ or Robert Park, first being duly sworn, depose and say: That I am the ~~Production Supervisor~~ or Asst. Prod. Supervisor of The Post Company, a corporation of Idaho Falls, Bonneville County, Idaho, publishers of The Post Register, a newspaper of general circulation, published daily at Idaho Falls, Idaho; said Post Register being a consolidation of the Idaho Falls Times, established in the year 1890; The Idaho Register, established in the year 1880 and the Idaho Falls Post, established in 1903, such consolidation being made on the First day of November, 1931, and each of said newspapers have been published continuously and uninterruptedly, prior to consolidation, for more than twelve consecutive months and said Post Register having been published continuously and uninterruptedly from the date of such consolidation, up to and including the last publication of notice hereinafter referred to.

That the notice, of which a copy is hereto attached and made a part of this affidavit, was published in said Post Register for 2 consecutive (days) weeks, first publication having been made on the 15TH day of FEBRUARY, 2001, last publication having been made on the 22ND day of FEBRUARY 2001 at the said notice was published in the regular and entire issue of said paper on the respective dates of publication, and that such notice was published in the newspaper and not in a supplement.


Robert Park

Subscribed and sworn to before me, this 28TH day of FEBRUARY, 2001

Ivy Berry

Notary Public

My commission expires January 10, 2003

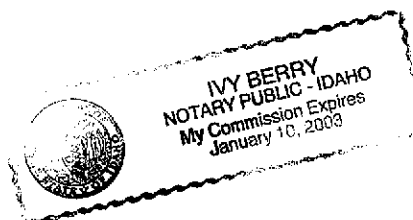

MICROFILMED

MAR 29 2001

PUBLIC NOTICE

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

35-13285

ALAN WIDAMAN
727 RIMVIEW LANE WEST
TWIN FALLS ID 83301

Point(s) of Diversion: NENE S8 T01N
R37E, BONNEVILLE County

Source GROUND WATER

Use: DOMESTIC: 01/01 To 12/31 .084
CFS

Total Diversion: 0.84 CFS

Date Filed: 01/29/2001

Place of Use: DOMESTIC

T01N R37E S8 NENE SWNE SENE

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec 42-203A, Idaho Code.

Any protest against the approval of this application must be filed with the Director, Dept. of Water Resource, Eastern Region, 900 N Skyline Dr Ste A, Idaho Falls ID 83402 together with a protest fee of \$25.00 for each application on or before March 5, 2001. The protestant must also send a copy of the protest to the applicant.

KARL J DREHER, Director
Published: February 15, 22, 2001

MICROFILMED

MAR 29 2001



State of Idaho
DEPARTMENT OF WATER RESOURCES

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

DIRK KEMPTHORNE
GOVERNOR

February 7, 2001

KARL J. DREHER
DIRECTOR

Alan Widaman
727 Rimview Lane West
Twin Falls ID 83301

RE: Applications for Permit #35-13285

Dear Applicant:

This office is currently in the process of advertising the application in the Post Register on February 15 and 22, 2001. The advertisement will be published once a week for two consecutive weeks, and a period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested, you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

Please feel free to contact this office if you have any questions regarding this procedure.

Sincerely,

A handwritten signature in cursive script that reads "Harold W. Jones".

Harold W. Jones
Water Right Supervisor

HWJ::sc

MICROFILMED

MAR 29 2001



State of Idaho

DEPARTMENT OF WATER RESOURCES

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

February 7, 2001

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

Legal Notice Department
POST-REGISTER
PO BOX 1800
IDAHO FALLS ID 83402

RE: Legal Advertising.


Dear Kathy Von Borstel:

Enclosed you will find a legal notice which we wish to have published in your newspaper on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before March 5, 2001. Your cooperation is appreciated.

Sincerely

Sharla Cox
Administrative Assistant

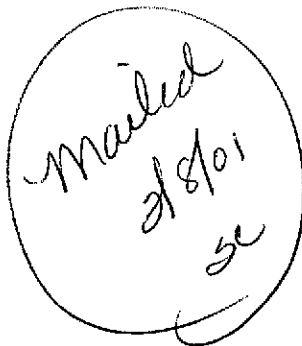

MICROFILMED

MAR 29 2001

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

35-13285

ALAN WIDAMAN
727 RIMVIEW LANE WEST
TWIN FALLS ID 83301

Point(s) of Diversion: NENE S8 T01N R37E, BONNEVILLE County
Source GROUND WATER

Use: DOMESTIC: 01/01 To 12/31 0.84 CFS

Total Diversion: 0.84 CFS

Date Filed: 01/29/2001

Place of Use: DOMESTIC

T01N R37E S8 NENE SWNE SENE

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec 42-203A, Idaho Code.

Any protest against the approval of this application must be filed with the Director, Dept. of Water Resource, Eastern Region, 900 N Skyline Dr Ste A, Idaho Falls ID 83402 together with a protest fee of \$25.00 for each application on or before March 5, 2001. The protestant must also send a copy of the protest to the applicant.

KARL J DREHER, Director

Published on February 15 and 22, 2001

MICROFILMED

MAR 29 2001